

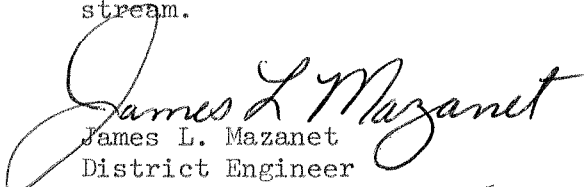
Ripon - Fond du Lac County

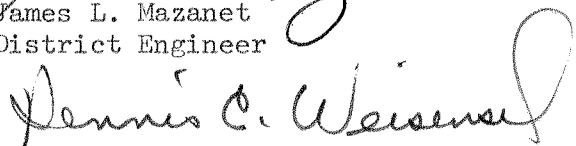
Wastewater Receiving Stream Classification

The City of Ripon discharges wastewater treatment plant effluent to Silver Creek. Silver Creek is a fast flowing stream with many riffle areas near the sewage treatment plant. Silver Creek has a  $7Q_{10}$  of 2.2 CFS. A biological survey was conducted on September 19, 1975. Upstream samples indicated a clean water benthic community, whereas downstream samples indicated polluted waters.

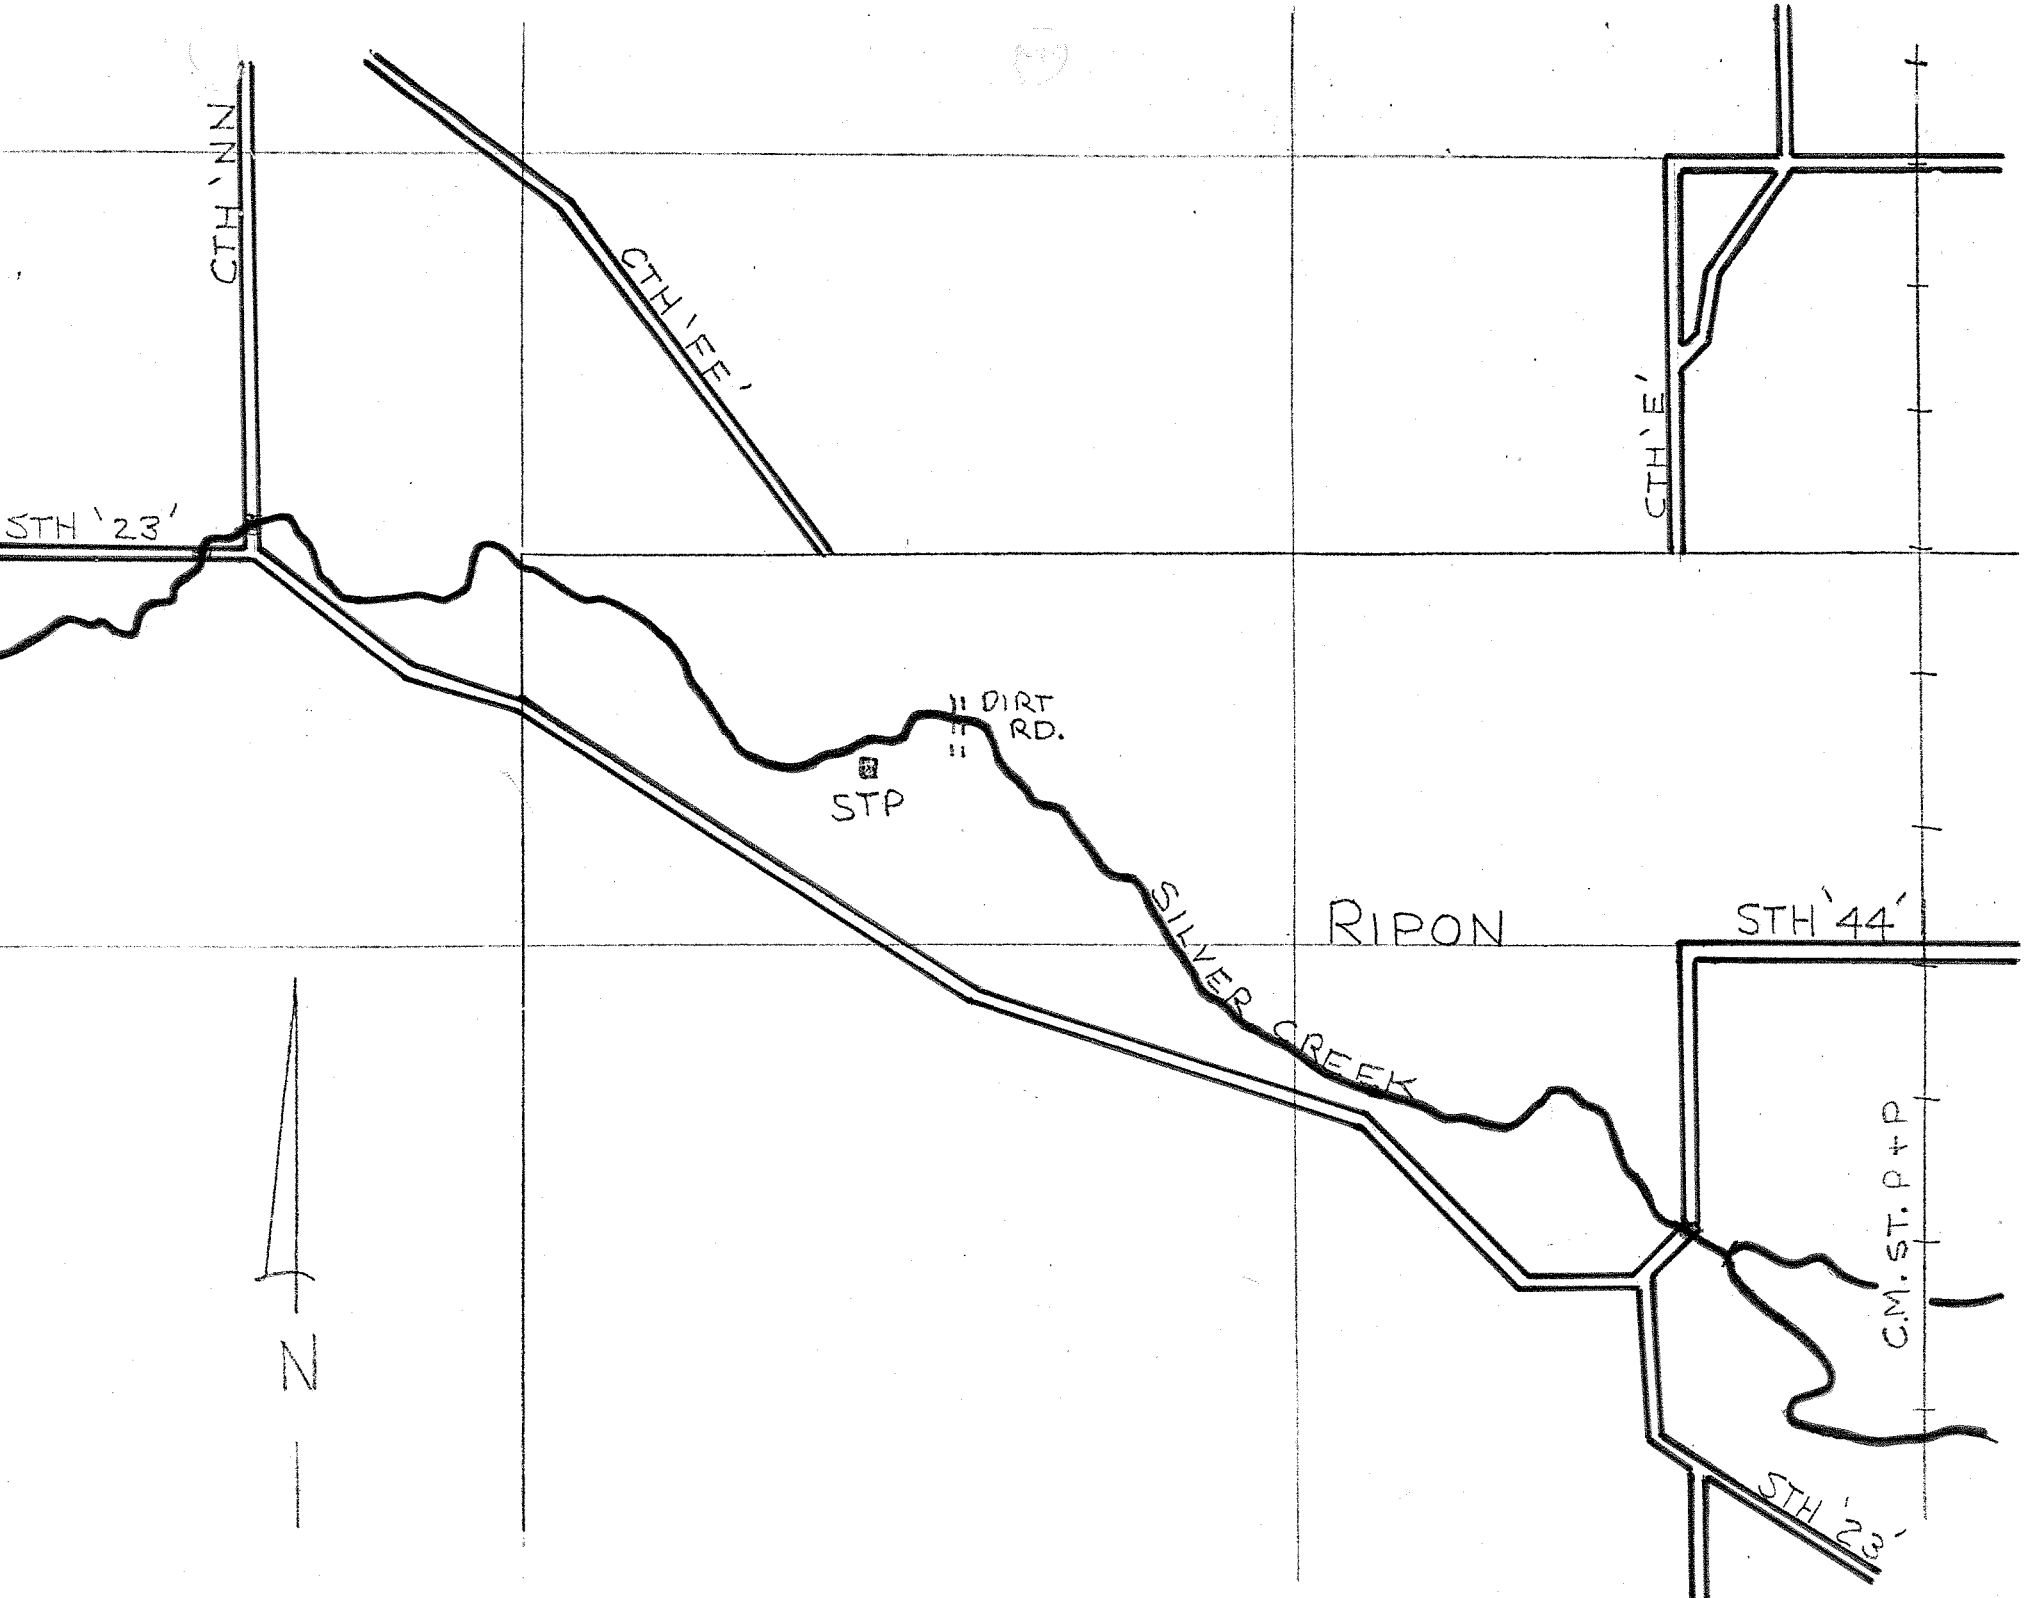
Recommendations

Silver Creek shall be classified as a continuous fish and aquatic life stream.

  
James L. Mazanet  
District Engineer

  
Dennis C. Weisensel  
District Biologist

JLM:DCW:sh





Silver Creek at dirt road above  
Ripon STP.



Silver Creek at County "NN" below Ripon  
STP.