

09-08-292/30

LMO CALUMET CO.

E&K HAZARDOUS WASTE SERVICES, INC.

"YOUR WASTE HANDLING ALTERNATIVE"

2905 PAINE AVENUE • P.O. BOX 1249
SHEBOYGAN, WISCONSIN 53082-1249 • (414) 458-6030

(from Kathy Sylvester)

68/62/16

TANK
TA-24
1000 gal UNLEADED
KMS 3/96

Date: 10/20/89

Mr. Ted Amman
Wisconsin Dept. of Natural Resources
P.O. Box 7921
SW/3
Madison, WI 53707

Mr. Amman:

Please review the attached petroleum product tank inventory form, and laboratory analyses (if required). Copies of the forms have been sent to the Safety and Building Division, Madison, pursuant to having the tanks removed from its inventory. Please record a clean closure, based on our findings. If you have any questions please call me at 414/458-6030.

Cordially,

Bruce Willever

Bruce Willever
Field Services Coordinator

enc.

*NO dispenser at time of tank removal
was believed to have been on top of tank
per Gene Clark
10/8/89
E&K*

*NO site sketch.
otherwise, clean*

CHAIN OF CUSTODY RECORD

PROJ. NO. 5980	PROJECT NAME TECUMSEH				Waste Profile														
SAMPLERS NICE WILLIAMS					Contact RICHARD NEUSTADTER					TPA MAC SEW					SAMPLE DESCRIPTION				
					Phone Number 898-5711														
Sample Number	DATE	TIME	COMP.	GRAB	Sample Source	Sampling Procedure													

718	9/29	9:45 AM		X	TARG Bldg W														
719	"	9:45 AM		X	" E														Soil: W. BTM #1
720	"	9:45 AM		X	" Bldg														" E. BTM #2
																			" C. BTM #3
721	9/29	10:00		Y	Gas Sledge 107														Gas tank Sledges

Released By: <i>Bruce Williams</i>	Date / Time: 9/29/89 4:00 PM	Received By: <i>Mal... [Signature]</i>	Released By:	Date / Time:	Received By:
Released By:	Date / Time:	Received By:	Released By:	Date / Time:	Received By:

ERK HAZARDOUS WASTE SERVICES, INC.
 "YOUR WASTE HANDLING ALTERNATIVE"
 P.O. BOX 1249 • 2905 PAINE AVENUE
 SHEBOYGAN, WISCONSIN 53082-1249

Remarks

**UNDERGROUND
PETROLEUM PRODUCT
TANK INVENTORY**

Wisconsin Department of Safety & Buildings Division
P.O. Box 7969
Madison, WI 53707
Telephone (608) 267-5280

For Office Use Only:
Tank ID # _____

This form is to be completed pursuant to Section 101.142, Wis. Stats., to register all underground tanks in Wisconsin that have stored or currently store petroleum or regulated substances. Please see the reverse side for additional information on this program. An underground storage tank is defined as any tank with at least 10 percent of its total volume (included piping) located below ground level. A separate form is needed for each tank. Send each completed form to the agency designated in the top right corner.

This registration applies to a tank that is (check one): 1. <input type="checkbox"/> In Use 2. <input type="checkbox"/> Abandoned With Product 3. <input type="checkbox"/> Abandoned No Product (empty) or With Water 4. <input checked="" type="checkbox"/> Abandoned - Tank Removed 5. <input type="checkbox"/> Abandoned - Filled With Inert Material 6. <input type="checkbox"/> Out of Service	Fire Department Providing Fire Coverage Where Tank Located: City of New Holstein
---	---

A. IDENTIFICATION: (Please Print)

1. Installation Name Tecumseh Products Company			2. Mailing Name if Different Than #1		
Installation Street Address 1604 Michigan Avenue			Mailing Address if Different Than #1		
<input checked="" type="checkbox"/> City	<input type="checkbox"/> Village	<input type="checkbox"/> Town of:	<input type="checkbox"/> City	<input type="checkbox"/> Village	<input type="checkbox"/> Town of:
New Holstein					
State Wisconsin	Zip Code 53061	County Calumet	State	Zip Code	County
3. Name of Contact Person Richard Neustadter			4. Owner Name if Different Than #3 Tecumseh Products Company		
Street Address 1604 Michigan Avenue			Street Address		
<input checked="" type="checkbox"/> City	<input type="checkbox"/> Town	State WI	Zip Code 53061	<input type="checkbox"/> City	<input type="checkbox"/> Town
<input type="checkbox"/> Village of: New Holstein				<input type="checkbox"/> Village of:	
County Calumet	Telephone No. (include area code) 414/898-5711	County	Telephone No. (include area code)		
5. Tank Age (date installed, if known; or years old) Unknown	6. Tank Capacity (gallons) 1,000	7. Tank Manufacturer's Name (if known) Unknown			

B. TYPE OF USER (check one):

1. <input type="checkbox"/> Gas Station	2. <input type="checkbox"/> Bulk Storage	3. <input type="checkbox"/> Utility	4. <input type="checkbox"/> Mercantile
5. <input checked="" type="checkbox"/> Industrial	6. <input type="checkbox"/> Government	7. <input type="checkbox"/> School	8. <input type="checkbox"/> Residential
9. <input type="checkbox"/> Agricultural	10. <input type="checkbox"/> Other (specify): _____		

C. TANK CONSTRUCTION:

1. <input checked="" type="checkbox"/> Bare Steel	2. <input type="checkbox"/> Cathodically Protected and Coated Steel (<input type="checkbox"/> Sacrificial Anodes or <input type="checkbox"/> Impressed Current)	5. <input type="checkbox"/> Other (specify): _____
3. <input type="checkbox"/> Coated Steel	4. <input type="checkbox"/> Fiberglass	
6. <input type="checkbox"/> Relined	7. <input type="checkbox"/> Steel - Fiberglass Reinforced Plastic Composite	

Is tank UL Approved? Yes No Is Tank Double Walled? Yes No

Overfill Protection Provided? Yes No If yes, identify type: _____

D. PIPING CONSTRUCTION

1. <input checked="" type="checkbox"/> Bare Steel	2. <input type="checkbox"/> Cathodically Protected Steel (With Coating? <input type="checkbox"/> Yes <input type="checkbox"/> No)	3. <input type="checkbox"/> Coated Steel
4. <input type="checkbox"/> Fiberglass	5. <input type="checkbox"/> Other (specify): _____	6. <input type="checkbox"/> Unknown

Cathodic Protection By: Sacrificial Anodes or Impressed Current UL Approved? Yes No Double Walled Yes No

E. TANK CONTENTS

1. <input type="checkbox"/> Diesel	2. <input type="checkbox"/> Leaded	3. <input checked="" type="checkbox"/> Unleaded	4. <input type="checkbox"/> Fuel Oil
5. <input type="checkbox"/> Gasohol	6. <input type="checkbox"/> Other	7. <input type="checkbox"/> Empty	8. <input type="checkbox"/> Sand/Gravel/Slurry
9. <input type="checkbox"/> Unknown	10. <input type="checkbox"/> Premix	11. <input type="checkbox"/> Waste Oil	12. <input type="checkbox"/> Propane
13. <input type="checkbox"/> Chemical * _____	14. <input type="checkbox"/> Kerosene	15. <input type="checkbox"/> Aviation	

* If # 13 is checked, indicate the chemical name(s) or number(s) of the chemical or waste.

If Tank Abandoned, Give Date (mo/day/yr): 9/29/89	Has Clean Closure Status Been verified? (see reverse side for details) <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No
--	---

If installation of a new tank is being reported, indicate who performed the installation inspection:

1. <input type="checkbox"/> Fire Department	2. <input type="checkbox"/> DILHR	3. <input type="checkbox"/> Other (identify) _____
---	-----------------------------------	--

Signature of Person Completing Report: <i>Steven Williams BSK</i>	Date Signed: 10/20/89
--	--------------------------



ENVIRONMENTAL SERVICES

CHEM-BIO CORPORATION
140 EAST RYAN ROAD OAK CREEK, WI 53154-4599 (414) 764-7005

10/16/89

LABORATORY REPORT

PAGE 1

E188 8441337 W81

E & K HAZARDOUS WASTE SERVICES
2905 PAINE AVENUE P.O. BOX 1249
SHEBOYGAN ,WI 53081
ATTN: SCOTT HANSON

SAMPLE 89284-E02287 SOIL /4718 /W. BTM #1 /TECUMSEH /9-29
DATE COLLECTED 09/29/89 DATE RECEIVED 10/11/89

TEST NAME	RESULT	UNITS
TOTAL PETROLEUM HYDROCARBONS	<4.0	PPM


PLEASE CONTACT OUR CLIENT SERVICE DEPARTMENT WITH QUESTIONS. REMAINING WASTE SAMPLES WILL BE RETURNED 6 WEEKS FROM THE RECEIVING DATE OF SAMPLE. WATER SAMPLES ARE DISPOSED OF 30 DAYS AFTER RECEIPT. WI DNR LAB CERTIFICATION #241283020/A.I.H.A. ACCREDITED.

! = REPRINT N/T = NOT TESTED N/A = NOT APPLICABLE APPROVAL *CBC*

FAX #414-764-0486

WI DNR LAB CERTIFICATION #241283020

1-800-365-3840



ENVIRONMENTAL SERVICES

CHEM-BIO CORPORATION
140 EAST RYAN ROAD OAK CREEK, WI 53154-4599 (414) 764-7005

10/16/89

LABORATORY REPORT

PAGE 1

E188 8441337 W81

E & K HAZARDOUS WASTE SERVICES
2905 PAINE AVENUE P.O. BOX 1249
SHEBOYGAN ,WI 53081
ATTN: SCOTT HANSON

SAMPLE 89284-E02288 SOIL /4719 /E. BTM #2 /TECUMSEH /9-29
DATE COLLECTED 09/29/89 DATE RECEIVED 10/11/89

TEST NAME	RESULT	UNITS
TOTAL PETROLEUM HYDROCARBONS	<4.0	PPM


PLEASE CONTACT OUR CLIENT SERVICE DEPARTMENT WITH QUESTIONS. REMAINING WASTE SAMPLES WILL BE RETURNED 6 WEEKS FROM THE RECEIVING DATE OF SAMPLE. WATER SAMPLES ARE DISPOSED OF 30 DAYS AFTER RECEIPT. WI DNR LAB CERTIFICATION #241283020/A.I.H.A. ACCREDITED.

! = REPRINT N/T = NOT TESTED N/A = NOT APPLICABLE APPROVAL CSH

FAX #414-764-0486

WI DNR LAB CERTIFICATION #241283020

1-800-365-3840



ENVIRONMENTAL SERVICES

CHEM-BIO CORPORATION
140 EAST RYAN ROAD OAK CREEK, WI 53154-4599 (414) 764-7005

10/16/89

LABORATORY REPORT

PAGE 1

E188 8441337 W81


E & K HAZARDOUS WASTE SERVICES
2905 PAINE AVENUE P.O. BOX 1249
SHEBOYGAN ,WI 53081
ATTN: SCOTT HANSON


SAMPLE 89284-E02289 SOIL /4720 /C. BTM #3 /TECUMSEH /9-29
DATE COLLECTED 09/29/89 DATE RECEIVED 10/11/89

TEST NAME	RESULT	UNITS
TOTAL PETROLEUM HYDROCARBONS	<4.0	PPM

PLEASE CONTACT OUR CLIENT SERVICE DEPARTMENT WITH QUESTIONS. REMAINING WASTE SAMPLES WILL BE RETURNED 6 WEEKS FROM THE RECEIVING DATE OF SAMPLE. WATER SAMPLES ARE DISPOSED OF 30 DAYS AFTER RECEIPT. WI DNR LAB CERTIFICATION #241283020/A.I.H.A. ACCREDITED.
N/T = NOT TESTED N/A = NOT APPLICABLE APPROVAL CSE

Spills: (Location Unknown) All Cls.
 04-08-168369 (polyglycol)
 04-08-283169 (gasoline)
 04-08-229768 (most presentatives)

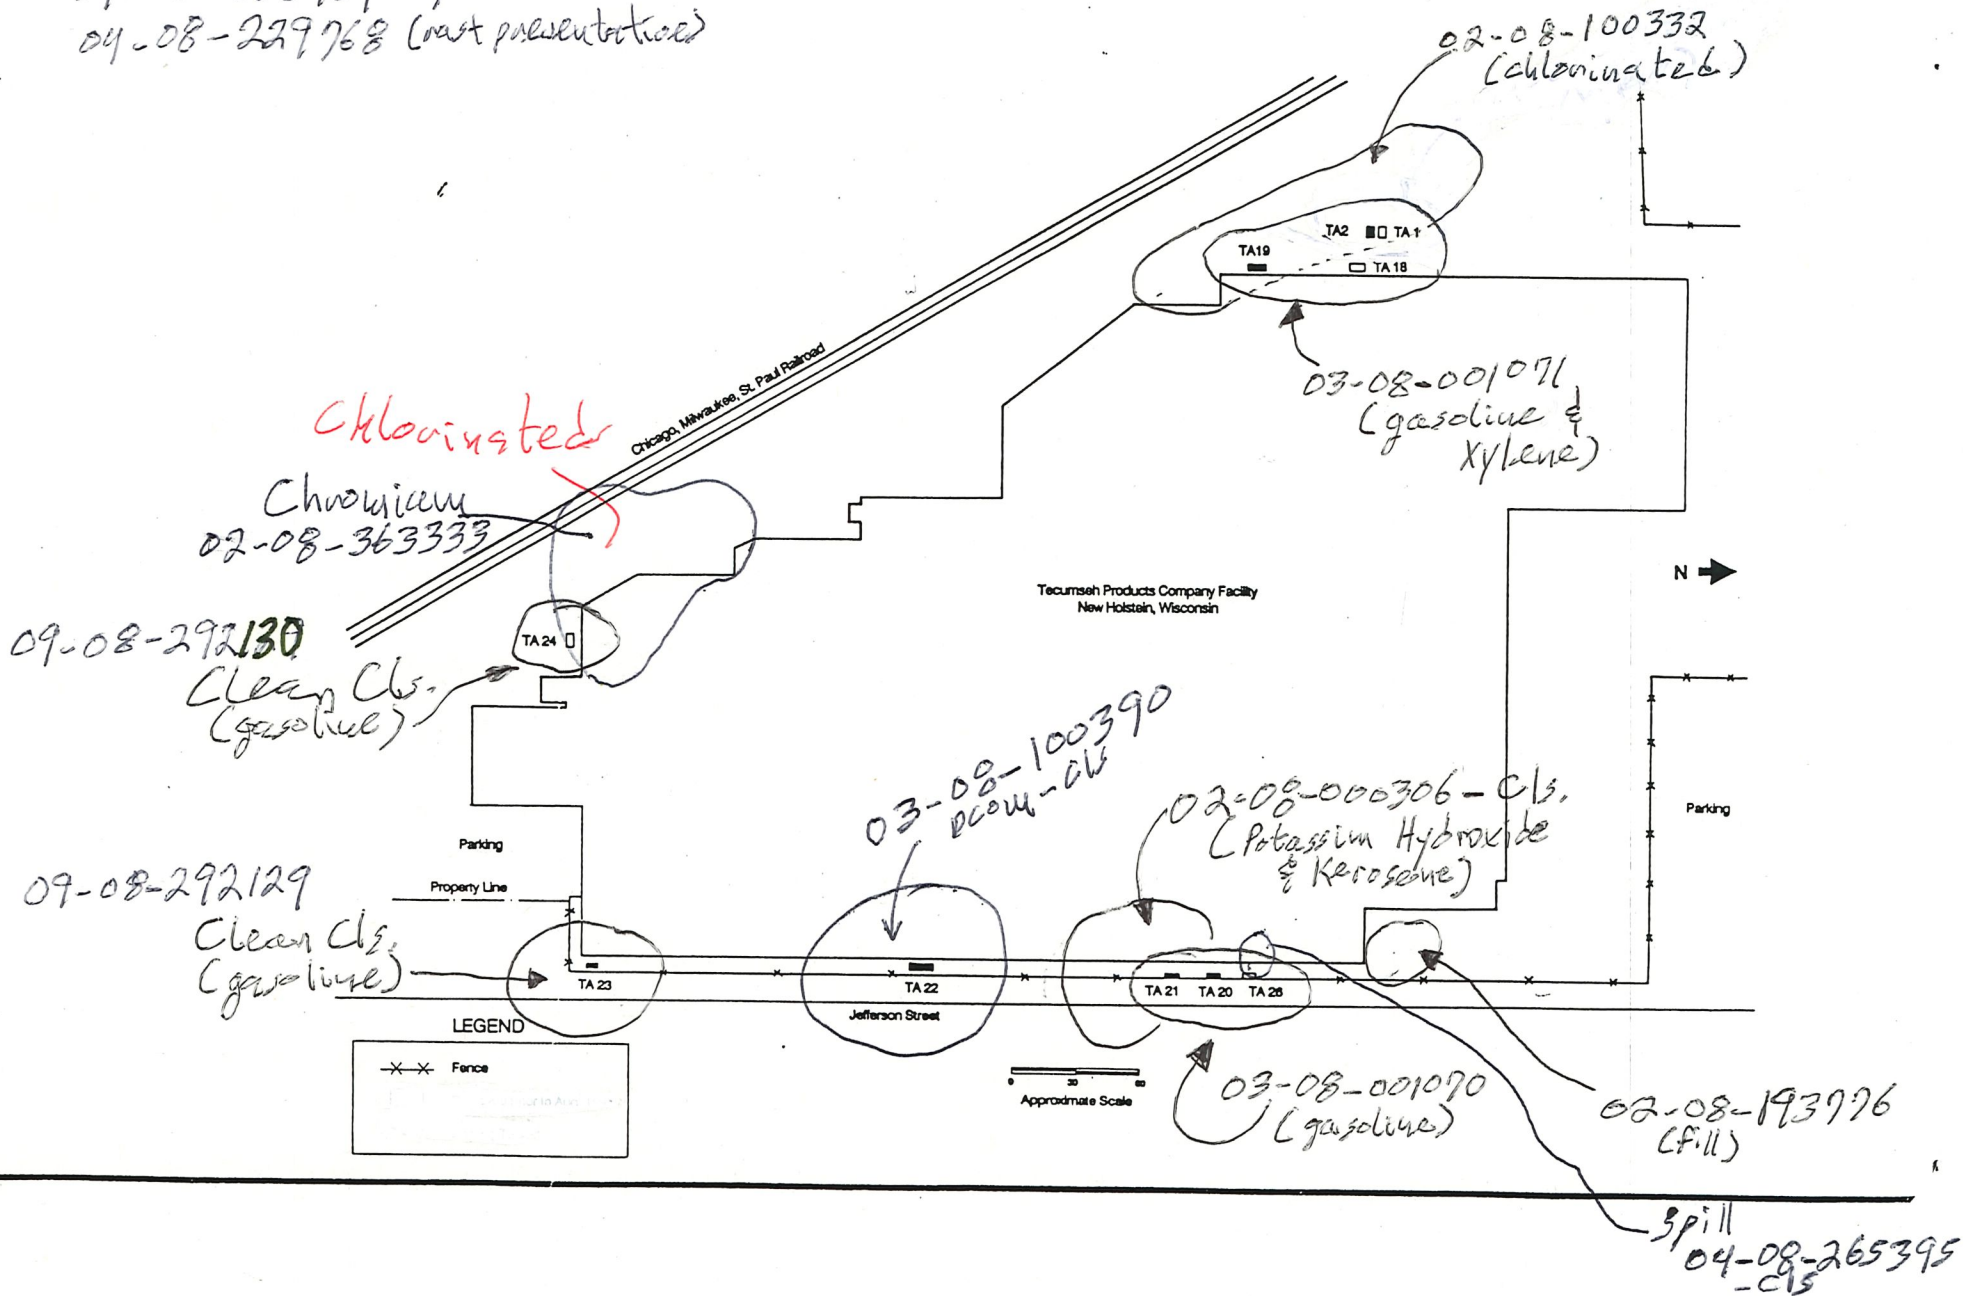

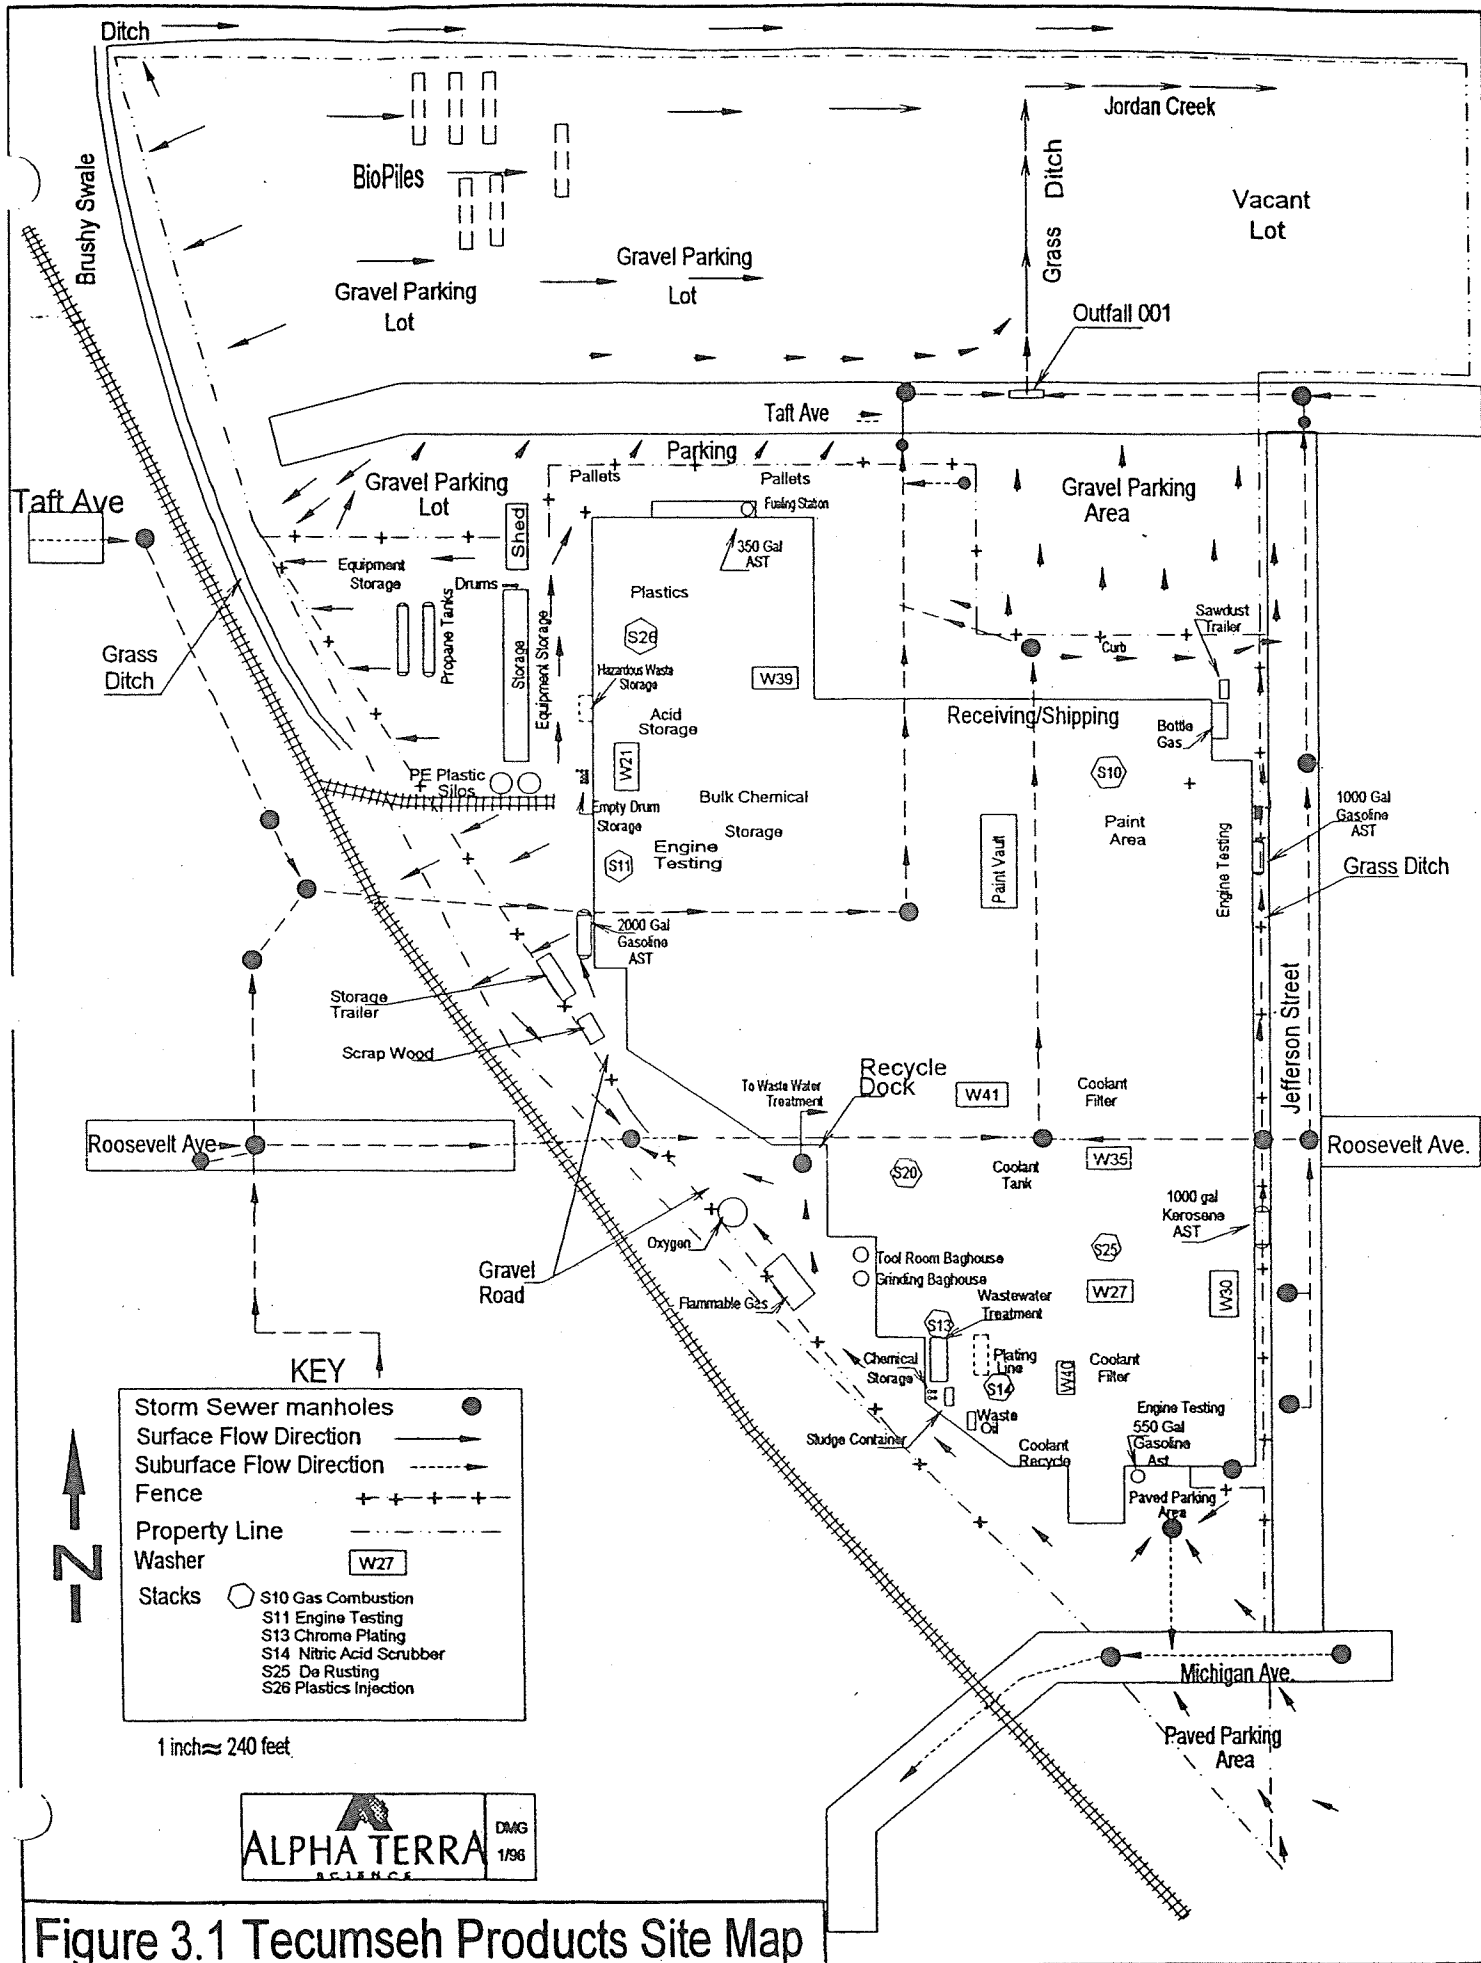

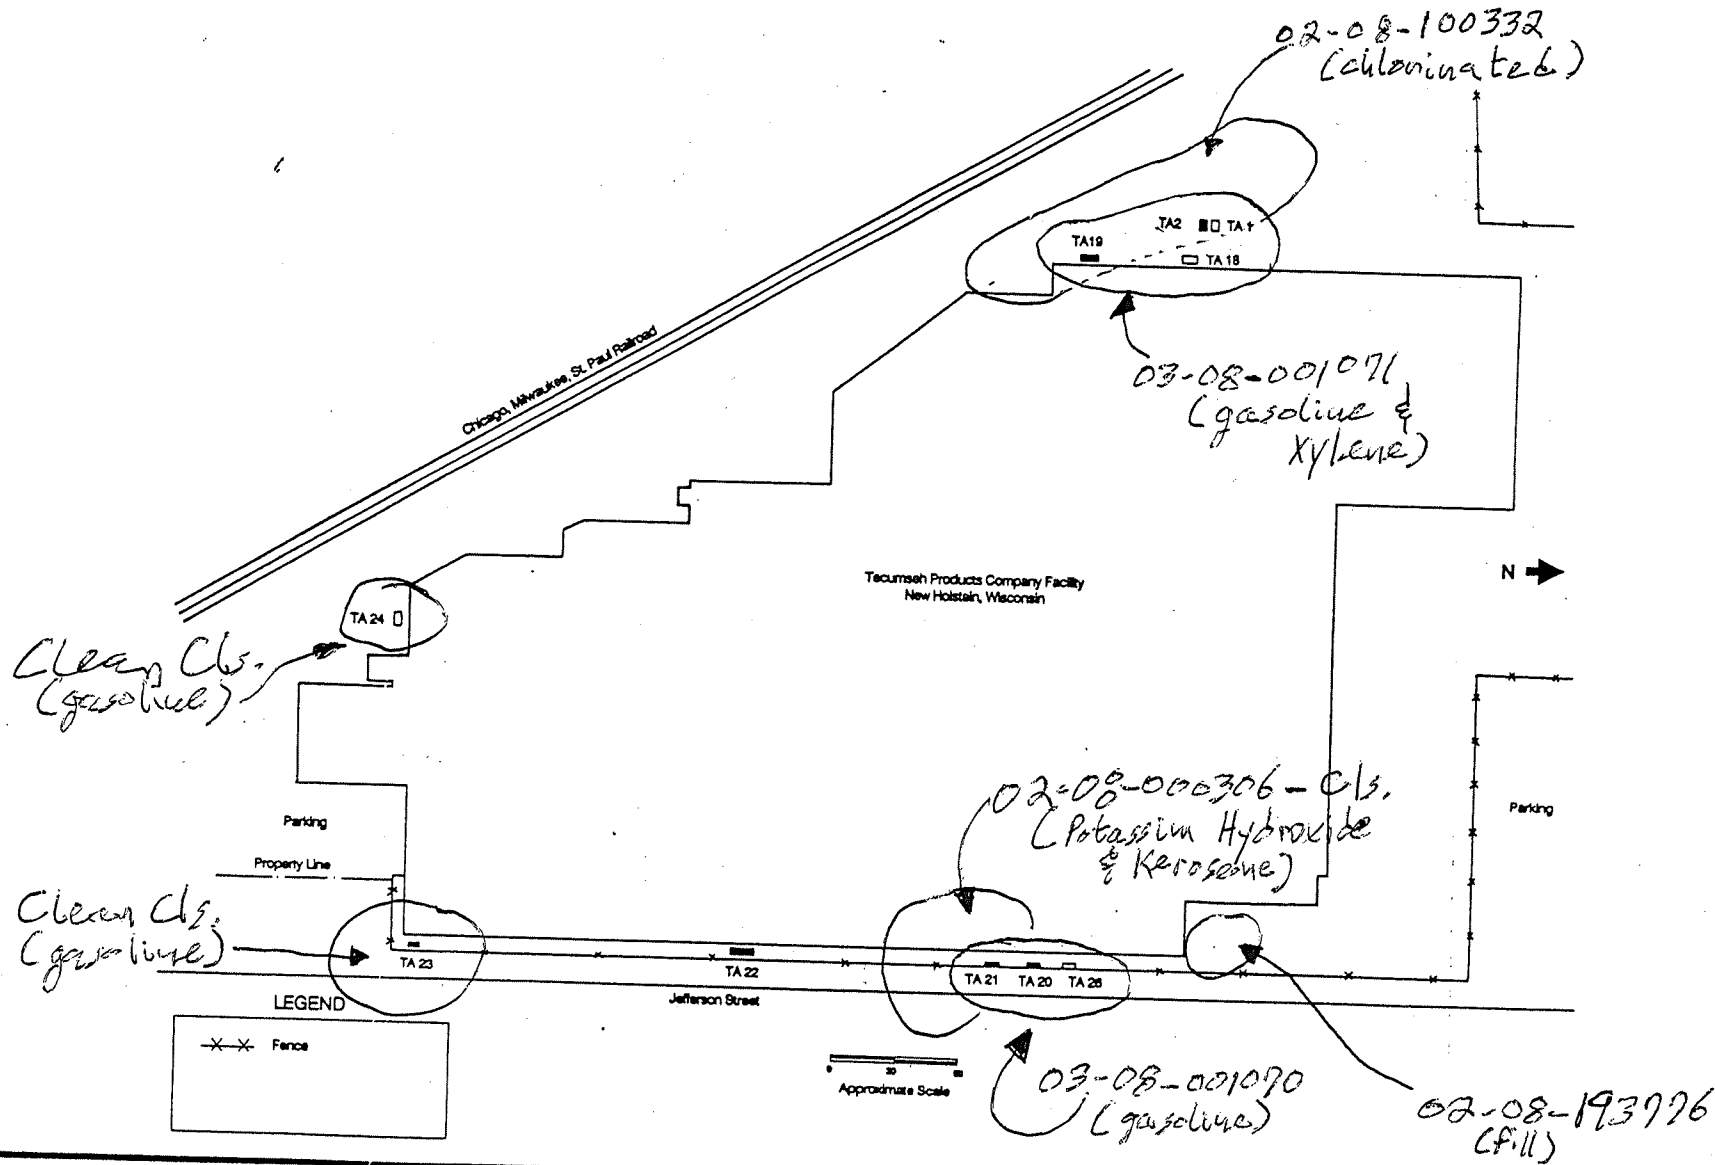


TABLE 1

UNDERGROUND STORAGE TANK IDENTIFICATION

TECUMSEH PRODUCTS CORPORATION
NEW HOLSTEIN, WISCONSIN

Tank Identification	Capacity	Product Contained	Date of Installation	Date of Removal
TA-1 <i>03-08-001071</i>	3,000 gallons	Xylene	1966	7/30/91
TA-2	3,000 gallons	Xylene (recycled solvent)	1966	<i>10/28/91</i>
TA-18	2,000 gallons	90% Unleaded Gasoline 10% Isopropyl Alcohol	~1966	7/30/91
TA-19 ¹	2,000 gallons	Unleaded Gasoline	~1966	
TA-20 ¹ <i>03-08-001070</i>	2,000 gallons	90% Unleaded Gasoline 10% Isopropyl Alcohol	~1967	<i>7/29/92</i>
TA-21	2,000 gallons	90% Unleaded Gasoline 10% Isopropyl Alcohol	~1967	<i>10/30/91</i>
TA-22 ¹	2,000 gallons	Kerosene	~1967	<i>7/29/92</i>
TA-23 <i>Clean Cls.</i>	1,000 gallons	Unleaded Gasoline	~1967	<i>7/31/92</i>
TA-24 <i>Clean Cls.</i>	1,000 gallons	Unleaded Gasoline	1956	~1989
TA-26 <i>03-08-001070</i>	300 gallons	Unleaded Gasoline	1967	7/30/91
¹ UST essential to operations at Tecumseh New Holstein facility.				