

QUARTERLY PROGRESS REPORT #35

April, May & June 2007

N.W. MAUTHE
GROUNDWATER TREATMENT SYSTEM
BRRTS I.D. #02-45-000127
Appleton, Wisconsin

Prepared For The
**WISCONSIN DEPARTMENT OF
NATURAL RESOURCES**

R + R - OSH
RECEIVED

AUG 01 2007


TRACKED 43
REVIEWED

McMAHON
ASSOCIATES

ENGINEERS | ARCHITECTS | SURVEYORS | PROJECT MANAGERS

July 30, 2007

McM. No. M0050-930746.26
SAB:car

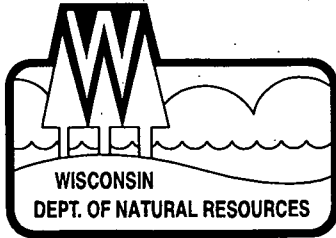

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Jim Doyle, Governor
Scott Hassett, Secretary
Ronald W. Kazmierczak, Regional Director

Oshkosh Service Center
625 East County Road Y, STE 700
Oshkosh, Wisconsin 54901-9731
TELEPHONE 920-424-3050
FAX 920-424-4404

August 3, 2007.

Mr. David Seely, RPM
U.S. EPA, HSRM-6J
77 W. Jackson Blvd.
Chicago, IL 60604-3590

SUBJECT: Quarterly Progress Report #35 (April, May & June 2007) for
N. W. Mauthe Superfund Site, 725 S. Outagamie St., Appleton, WI
WDNR BRRTS #:02-45-000127

Dear Mr. Seely:

Enclosed please find a copy of the *Quarterly Progress Report #35, April, May & June 2007*, for the N. W. Mauthe Superfund Site. The report was prepared by the operation and maintenance contractor, Midwest Contract Operations, Inc. (MCO). Please call me at the number below if you have any questions.

Sincerely,

Jennifer Borski
Hydrogeologist
Bureau for Remediation & Redevelopment
(920) 424-7887

Encl.



McMAHON ASSOCIATES

ENGINEERS | ARCHITECTS | SURVEYORS | PROJECT MANAGERS

July 30, 2007

Ms. Jennifer Borski
Wisconsin Department Of Natural Resources
625 East County Road "Y", Suite #700
Oshkosh, WI 54901-9731

Re: N.W. Mauthe Groundwater Treatment System
Appleton, Wisconsin
Quarterly Progress Report #35
BRRTS I.D. #02-45-000127
McM. No. M0050-930746.26

Dear Ms. Borski:

Enclosed, please find McMahon Associates, Inc.'s "Quarterly Progress Report #35" for the N.W. Mauthe Groundwater Treatment System, 725 South Outagamie Street, Appleton, Wisconsin.

The Progress Report includes a brief background of the site history, a summary of groundwater sampling results, compliance sampling, and groundwater extraction system performance. The Progress Report includes the months of April, May and June 2007.

If you have any questions or require additional information, feel free to contact me.

Very truly yours,

McMahon Associates, Inc.



Stuart A. Boerst
Senior Hydrogeologist, P.S., P.H.

SAB:car

cc: Jessica Garratt - City of Appleton
Paul Much - MCO

Enclosure: Quarterly Progress Report #35



Letter Of Transmittal

Ms. Jennifer Borski
WDNR
625 E. County Rd. "Y", Suite #700
Oshkosh, WI 54901-9731

Date: August 8, 2007

Subject: _____

McM No. _____

We are sending you the following: Attached, Via: _____ Under Separate Cover Via: _____

- Report / Study
- Land Survey Drawings
- Contract / Agreement
- Change Order
- Plans / Specifications
- Shop Drawings
- Calculations
- Check
- Other: _____

Quantity	Date/No.	Description

These Items Are Transmitted As Checked Below:

- For Distribution
- Reviewed
- Resubmit
- Copies / Review
- For Your Use
- Reviewed & Revised
- Submit
- Copies / Distribute
- As Requested
- Returned For Corrections
- Return
- Corrected Prints
- For Review & Comment
- Construction
- Examination & Approval
- Other: _____

Remarks:

Jennifer,

Attached are three copies of four revised pages for Mauthe Report #35. Have a good day.

Copy To:

Signed: 
Stuart Boerst

If Enclosures Are Not As Noted, Kindly Notify Us At Once

Table Of Contents (continued)

List Of Figures

- Figure #1 - Site Location Map
- Figure #2 - Collection Trench & Monitoring Well Locations
- Figure #3 - Groundwater Contours
- Figure #4 - Isoconcentration Map – Total Chromium (ug/l) In Groundwater

List Of Tables

- Table #1 - Groundwater Effluent Discharges/April, May & June 2007
- Table #2 - City Of Appleton Effluent Compliance Limits
- Table #3 - Effluent Point #001 Analytical Results
- Table #4 - Groundwater Elevations
- Table #5 - Groundwater Geochemical Parameters
- Table #6 - Groundwater Analytical Results / Selected Metals
- Table #7 - Groundwater Analytical Results / Volatile Organic Compounds (VOC's)
- Table #8 - Influent Hexavalent Chromium Results

List Of Appendices

- Appendix A - Laboratory Analytical Results

B. Groundwater Sampling Results

The collected groundwater samples were analyzed for one or more of the following: Total Dissolved Chromium, VOC's, zinc and cyanide. Field analysis was conducted at MW-103, MW-104, MW-107, MW-109, MW-110, MW-111, MW-112, and MW-113 for pH, temperature, specific conductivity, dissolved oxygen, Redox potential and ferrous iron. The field testing results are contained in Table #5. The laboratory analytical results are presented on Tables #6 and #7.

The laboratory analytical results indicate that levels of total chromium exceed the 1992 DNR NR 140.10 Groundwater PAL in monitoring wells MW-103 (90 ug/l), MW-104 (97 ug/l), MW-107 (2,800 ug/l), MW-109 (2,200 ug/l), MW-110 (32,000 ug/l), MW-111 (41 ug/l), MW-112 (100,000 ug/l) and MW-113 (21,000 ug/l). Additionally, two to five of the following VOC compounds (1,1-Dichloroethane, 1,1-Dichloroethene, cis-1,2-Dichloroethene, 1,1,2-Trichloroethane, 1,1,1-Trichloroethane and Trichloroethene) were detected in MW-107, MW-109, MW-110, MW-111, MW-112 and MW-113 at concentrations above the 1992 NR 140.10 PAL. An isoconcentration map for total chromium concentrations is shown on Figure #4. The Chain Of Custody Forms and laboratory analytical data are included in Appendix A.

A summary of the influent Hexavalent Chromium concentrations is contained in Table #8. The listed concentrations are based upon the weekly Hatch kit analysis of the treatment system influent.

VI. PUBLIC CONTACTS

There were no public contacts during this reporting period.

VII. CONCLUSIONS & RECOMMENDATIONS

The groundwater laboratory results from the 16 monitoring wells associated with the N.W. Mauthe groundwater treatment system indicate the groundwater plume is being controlled horizontally by the groundwater collection trenches.

The latest round (July 2007) of groundwater samples collected from eight of the monitoring wells, indicates residual chromium contamination above the 1992 DNR NR 140.10 PAL exists in monitoring wells MW-103, MW-104, MW-107, MW-109, MW-110, MW-111, MW-112, and MW-113. Additionally, two to five VOC compounds in excess of the 1992 NR 140.10 PAL were detected in MW-107, MW-109, MW-110, MW-111, MW-112 and MW-113.

A total of 215,183-gallons of impacted groundwater has been extracted during the months of April, May & June 2007, and discharged to the City of Appleton municipal

Table #4

GROUNDWATER ELEVATIONS
N.W. Mauthe Superfund Site - Appleton, Wisconsin
MCO No. M0050-930746.26

Well Name	Date Measured	Depth To Water (feet)	Reference Elevation (To Top PVC) (feet)	Groundwater Elevation (feet)
MW-108 (continued)	09/21/05	6.66		799.95
	12/14/05	6.68		799.93
	03/21/06	6.71		799.90
	06/28/06	6.82		799.79
	09/20/06	6.75		799.86
	12/19/06	6.90		799.71
	03/13/07	6.75		799.86
	07/03/07	7.53		799.08
MW-109	06/21/06	8.98	810.52	801.54
	09/20/06	8.90		801.62
	12/19/06	9.68		800.84
	03/13/07	9.32		801.20
	07/03/07	9.11		801.41
MW-110	06/21/06	10.39	809.81	799.42
	09/20/06	11.09		798.72
	12/19/06	11.06		798.75
	03/13/07	11.04		798.77
	07/03/07	10.60		799.21
MW-111	06/21/06	10.69	807.59	796.90
	09/20/06	13.45		794.14
	12/19/06	14.97		792.62
	03/13/07	9.63		797.96
MW-112	07/03/07	9.00		798.59
	06/21/06	15.70	808.14	792.44
	09/20/06	10.75		797.39
	12/19/06	11.93		796.21
MW-113	03/13/07	10.23		797.91
	07/03/07	8.91		799.23
	06/21/06	9.69	808.24	798.55
	09/20/06	10.27		797.97
	12/19/06	10.03		798.21
PZ-05	03/13/07	8.93		799.31
	07/03/07	9.75		798.49
	07/19/05	37.39	810.88	773.49
	09/21/05	28.56		782.32
PZ-06	12/19/06	27.98		782.90
	03/13/07	28.61		782.27
	07/03/07	28.00		782.88
	07/19/05	36.31	809.77	773.46
PZ-07	09/21/05	29.79		779.98
	12/19/06	29.49		780.28
	03/13/07	29.93		779.84
	07/03/07	30.03		779.74
	07/19/05	32.03	804.48	772.45
PZ-08	09/21/05	27.34		777.14
	12/19/06	29.37		775.11
	03/13/07	24.41		780.07
	07/03/07	23.74		780.74
PZ-08	07/19/05	32.07	804.35	772.28
	09/21/05	24.47		779.88
	12/19/06	28.16		776.19
	03/13/07	21.90		782.45
	07/03/07	23.19		781.16

* Casing for MW-107 was damaged. Groundwater elevation could not be determined.

** Reflects new elevation of MW-107 after repair to well casing.

*** Monitoring wells re-surveyed after casings were shortened.

**** New elevation after the PVC casing was shortened after the March 23, 2004 sampling event.

***** New elevation after the PVC casing was shortened after the March 21, 2006 sampling event.

***** New elevation after PVC casing was shortened after the December 19, 2006 sampling event.

Note: Omni Associates, Inc. collected water level readings from MW-109 to MW-113 on June 21, 2006 and September 20, 2006 and from PZ-5 to PZ-8 on July 19, 2005 and September 21, 2005.

Table Of Contents (continued)

List Of Figures

- Figure #1 - Site Location Map
- Figure #2 - Collection Trench & Monitoring Well Locations
- Figure #3 - Groundwater Contours
- Figure #4 - Isoconcentration Map – Total Chromium (ug/l) In Groundwater

List Of Tables

- Table #1 - Groundwater Effluent Discharges/April, May & June 2007
- Table #2 - City Of Appleton Effluent Compliance Limits
- Table #3 - Effluent Point #001 Analytical Results
- Table #4 - Groundwater Elevations
- Table #5 - Groundwater Geochemical Parameters
- Table #6 - Groundwater Analytical Results / Selected Metals
- Table #7 - Groundwater Analytical Results / Volatile Organic Compounds (VOC's)
- Table #8 - Influent Hexavalent Chromium Results

List Of Appendices

- Appendix A - Laboratory Analytical Results

B. Groundwater Sampling Results

The collected groundwater samples were analyzed for one or more of the following: Total Dissolved Chromium, VOC's, zinc and cyanide. Field analysis was conducted at MW-103, MW-104, MW-107, MW-109, MW-110, MW-111, MW-112, and MW-113 for pH, temperature, specific conductivity, dissolved oxygen, Redox potential and ferrous iron. The field testing results are contained in Table #5. The laboratory analytical results are presented on Tables #6 and #7.

The laboratory analytical results indicate that levels of total chromium exceed the 1992 DNR NR 140.10 Groundwater PAL in monitoring wells MW-103 (90 ug/l), MW-104 (97 ug/l), MW-107 (2,800 ug/l), MW-109 (2,200 ug/l), MW-110 (32,000 ug/l), MW-111 (41 ug/l), MW-112 (100,000 ug/l) and MW-113 (21,000 ug/l). Additionally, two to five of the following VOC compounds (1,1-Dichloroethane, 1,1-Dichloroethene, cis-1,2-Dichloroethene, 1,1,2-Trichloroethane, 1,1,1-Trichloroethane and Trichloroethene) were detected in MW-107, MW-109, MW-110, MW-111, MW-112 and MW-113 at concentrations above the 1992 NR 140.10 PAL. An isoconcentration map for total chromium concentrations is shown on Figure #4. The Chain Of Custody Forms and laboratory analytical data are included in Appendix A.

A summary of the influent Hexavalent Chromium concentrations is contained in Table #8. The listed concentrations are based upon the weekly Hatch kit analysis of the treatment system influent.

VI. PUBLIC CONTACTS

There were no public contacts during this reporting period.

VII. CONCLUSIONS & RECOMMENDATIONS

The groundwater laboratory results from the 16 monitoring wells associated with the N.W. Mauthe groundwater treatment system indicate the groundwater plume is being controlled horizontally by the groundwater collection trenches.

The latest round (July 2007) of groundwater samples collected from eight of the monitoring wells, indicates residual chromium contamination above the 1992 DNR NR 140.10 PAL exists in monitoring wells MW-103, MW-104, MW-107, MW-109, MW-110, MW-111, MW-112, and MW-113. Additionally, two to five VOC compounds in excess of the 1992 NR 140.10 PAL were detected in MW-107, MW-109, MW-110, MW-111, MW-112 and MW-113.

A total of 215,183-gallons of impacted groundwater has been extracted during the months of April, May & June 2007, and discharged to the City of Appleton municipal

Table #4

GROUNDWATER ELEVATIONS
N.W. Mauthe Superfund Site - Appleton, Wisconsin
MCO No. M0050-930746.26

Well Name	Date Measured	Depth To Water (feet)	Reference Elevation (To Top PVC) (feet)	Groundwater Elevation (feet)
MW-108 (continued)	09/21/05	6.66		799.95
	12/14/05	6.68		799.93
	03/21/06	6.71		799.90
	06/28/06	6.82		799.79
	09/20/06	6.75		799.86
	12/19/06	6.90		799.71
	03/13/07	6.75		799.86
	07/03/07	7.53		799.08
MW-109	06/21/06	8.98	810.52	801.54
	09/20/06	8.90		801.62
	12/19/06	9.68		800.84
	03/13/07	9.32		801.20
	07/03/07	9.11		801.41
MW-110	06/21/06	10.39	809.81	799.42
	09/20/06	11.09		798.72
	12/19/06	11.06		798.75
	03/13/07	11.04		798.77
	07/03/07	10.60		799.21
MW-111	06/21/06	10.69	807.59	796.90
	09/20/06	13.45		794.14
	12/19/06	14.97		792.62
	03/13/07	9.63		797.96
	07/03/07	9.00		798.59
MW-112	06/21/06	15.70	808.14	792.44
	09/20/06	10.75		797.39
	12/19/06	11.93		796.21
	03/13/07	10.23		797.91
	07/03/07	8.91		799.23
MW-113	06/21/06	9.69	808.24	798.55
	09/20/06	10.27		797.97
	12/19/06	10.03		798.21
	03/13/07	8.93		799.31
	07/03/07	9.75		798.49
PZ-05	07/19/05	37.39	810.88	773.49
	09/21/05	28.56		782.32
	12/19/06	27.98		782.90
	03/13/07	28.61		782.27
	07/03/07	28.00		782.88
PZ-06	07/19/05	36.31	809.77	773.46
	09/21/05	29.79		779.98
	12/19/06	29.49		780.28
	03/13/07	29.93		779.84
	07/03/07	30.03		779.74
PZ-07	07/19/05	32.03	804.48	772.45
	09/21/05	27.34		777.14
	12/19/06	29.37		775.11
	03/13/07	24.41		780.07
	07/03/07	23.74		780.74
PZ-08	07/19/05	32.07	804.35	772.28
	09/21/05	24.47		779.88
	12/19/06	28.16		776.19
	03/13/07	21.90		782.45
	07/03/07	23.19		781.16

* Casing for MW-107 was damaged. Groundwater elevation could not be determined.

** Reflects new elevation of MW-107 after repair to well casing.

*** Monitoring wells re-surveyed after casings were shortened.

**** New elevation after the PVC casing was shortened after the March 23, 2004 sampling event.

***** New elevation after the PVC casing was shortened after the March 21, 2006 sampling event.

***** New elevation after PVC casing was shortened after the December 19, 2006 sampling event.

Note: Omni Associates, Inc. collected water level readings from MW-109 to MW-113 on June 21, 2006 and September 20, 2006 and from PZ-5 to PZ-8 on July 19, 2005 and September 21, 2005.

Table #8

INFLUENT HEXAVALENT CHROMIUM RESULTS
N.W. Mauihe Superfund Site - Appleton, Wisconsin
MCO. No. M0050-930746.28

DATE	INFLUENT HEXAVALENT CHROMIUM* (ppm)	DATE	INFLUENT HEXAVALENT CHROMIUM* (ppm)	DATE	INFLUENT HEXAVALENT CHROMIUM* (ppm)	DATE	INFLUENT HEXAVALENT CHROMIUM* (ppm)	DATE	INFLUENT HEXAVALENT CHROMIUM* (ppm)	DATE	INFLUENT HEXAVALENT CHROMIUM* (ppm)	DATE	INFLUENT HEXAVALENT CHROMIUM* (ppm)
02/28/97	1.0	05/06/98	1.3	07/14/99	2.0	09/20/00	1.2	11/29/01	1.4	02/06/03	0.0	04/22/04	0.2
03/03/97	.8	05/13/98	1.3	07/21/99	1.8	09/27/00	1.4	12/06/01	1.5	02/14/03	0.0	04/29/04	0.7
03/06/97	1.0	05/20/98	1.3	07/28/99	1.2	10/03/00	1.3	12/14/01	2.0	02/20/03	0.0	05/06/04	0.5
03/10/97	1.5	05/27/98	1.4	08/04/99	1.5	10/17/00	1.3	12/20/01	2.0	02/27/03	0.3	05/13/04	1.2
03/23/97	.9	06/03/98	1.3	08/11/99	1.4	10/18/00	2.5	12/27/01	2.5	03/06/03	0.3	05/22/04	1.3
03/29/97	1.2	06/10/98	1.4	08/18/99	1.3	10/25/00	2.2	01/03/02	2.5	03/13/03	0.3	05/27/04	0.5
04/05/97	1.1	06/17/98	1.2	08/25/99	1.3	11/01/00	1.8	01/10/02	2.0	03/22/03	0.4	06/03/04	0.5
04/09/97	1.2	06/24/98	1.2	09/01/99	1.3	11/08/00	1.4	01/17/02	2.5	03/27/03	0.4	06/10/04	0.5
04/18/97	1.0	07/01/98	1.1	09/08/99	1.4	11/15/00	1.8	01/24/02	2.0	04/03/03	1.2	06/17/04	0.7
04/25/97	1.0	07/08/98	1.1	09/15/99	1.5	11/22/00	1.8	04/11/02	1.5	04/11/03	0.4	06/24/04	0.7
04/27/97	1.1	07/15/98	1.1	09/22/99	1.3	11/29/00	1.4	02/07/02	2.5	04/18/03	0.9	07/01/04	0.7
05/02/97	1.1	07/22/98	1.3	09/29/99	1.2	12/06/00	1.8	02/13/02	2.5	04/25/03	1.1	07/08/04	1.1
05/09/97	1.1	07/29/98	1.3	10/06/99	1.4	12/13/00	1.4	02/21/02	3.0	05/01/03	1.2	07/15/04	1.0
05/13/97	1.2	08/06/98	1.2	10/13/99	1.5	12/20/00	1.2	02/28/02	2.5	05/08/03	0.8	07/22/04	1.1
05/21/97	1.1	08/12/98	1.2	10/20/99	1.4	12/27/00	1.3	03/07/02	2.0	05/15/03	0.4	07/29/04	0.5
05/29/97	1.1	08/19/98	1.2	10/27/99	1.4	01/03/01	1.2	03/14/02	1.5	05/22/03	1.2	08/05/04	0.7
06/06/97	1.2	08/26/98	1.2	11/04/99	1.3	01/10/01	1.3	03/21/02	2.5	06/01/03	1.1	08/12/04	1.2
06/13/97	1.2	09/02/98	1.2	11/11/99	1.2	01/17/01	1.8	03/28/02	1.5	06/11/03	1.1	08/19/04	1.1
06/17/97	1.3	09/09/98	1.2	11/18/99	1.3	01/24/01	1.4	04/04/02	1.5	06/19/03	1.4	08/26/04	1.1
06/23/97	1.2	09/16/98	1.2	11/24/99	1.2	01/31/01	1.3	04/11/02	1.5	06/26/03	0.9	09/02/04	1.6
07/02/97	1.2	09/23/98	1.2	11/30/99	1.3	02/07/01	1.2	04/18/02	2.0	07/03/03	0.9	09/09/04	1.5
07/08/97	1.2	09/30/98	1.2	12/08/99	1.3	02/13/01	2.0	04/25/02	2.5	07/10/03	1.0	09/16/04	1.3
07/14/97	1.2	10/07/98	1.0	12/15/99	1.2	02/21/01	1.5	05/02/02	3.0	07/17/03	1.0	09/23/04	1.1
07/21/97	1.2	10/15/98	1.1	12/22/99	1.3	02/28/01	1.4	05/09/02	1.5	07/24/03	1.0	09/30/04	1.1
07/28/97	1.4	10/21/98	1.3	12/29/99	1.2	03/17/01	1.3	05/16/02	1.5	07/31/03	1.0	10/07/04	0.8
08/04/97	1.4	10/28/98	1.3	01/06/00	1.3	03/14/01	1.2	05/23/02	1.5	08/07/03	1.4	10/14/04	0.6
08/13/97	1.3	11/04/98	1.1	01/12/00	1.3	03/21/01	1.3	05/30/02	2.0	08/14/03	1.2	10/21/04	0.4
08/18/97	1.3	11/11/98	1.1	01/19/00	1.2	03/28/01	1.2	06/06/02	1.5	08/21/03	1.0	10/28/04	0.4
08/25/97	1.3	11/18/98	1.2	01/26/00	1.2	04/04/01	1.4	06/13/02	2.0	08/28/03	1.0	11/04/04	0.7
09/04/97	1.3	11/25/98	1.2	02/02/00	1.1	04/11/01	1.2	06/20/02	3.0	09/04/03	0.1	11/11/04	0.7
09/09/97	1.5	12/02/98	1.2	02/09/00	1.1	04/18/01	1.2	06/27/02	2.0	09/11/03	0.1	11/18/04	0.7
09/15/97	1.4	12/09/98	1.5	02/16/00	1.2	04/25/01	1.4	07/03/02	2.0	09/20/03	0.0	11/26/04	0.7
09/24/97	1.3	12/16/98	1.3	02/23/00	1.3	05/02/01	1.3	07/11/02	1.5	09/25/03	0.0	12/02/04	0.7
10/01/97	1.3	12/23/98	1.3	03/01/00	1.2	05/09/01	1.3	07/18/02	1.0	10/02/03	0.0	12/09/04	0.7
10/08/97	1.4	12/30/98	1.3	03/08/00	1.3	05/16/01	1.2	07/25/02	0.1	10/09/03	0.3	12/16/04	0.8
10/15/97	1.3	01/06/99	1.3	03/14/00	1.2	05/23/01	1.3	08/01/02	0.0	10/16/03	0.8	12/23/04	0.8
10/22/97	1.4	01/12/99	1.1	03/22/00	1.2	05/30/01	1.1	08/08/02	0.0	10/23/03	0.7	12/30/04	1.3
10/28/97	1.4	01/20/99	1.2	03/29/00	1.1	06/06/01	1.2	08/15/02	0.0	10/30/03	1.1	01/06/05	1.3
11/05/97	1.3	01/28/99	1.3	04/05/00	1.4	06/13/01	1.4	08/22/02	0.0	11/06/03	1.0	01/13/05	1.3
11/11/97	1.2	02/03/99	1.3	04/11/00	1.2	06/20/01	1.2	09/29/02	0.0	11/13/03	1.4	01/20/05	1.0
11/22/97	1.0	02/10/99	1.4	04/19/00	1.1	06/27/01	1.3	09/06/02	0.0	11/20/03	1.4	01/27/05	0.9
11/24/97	1.0	02/17/99	1.4	04/26/00	1.1	07/04/01	1.3	09/12/02	0.4	11/27/03	1.2	02/03/05	1.2
12/03/97	1.0	02/24/99	1.4	05/03/00	1.3	07/11/01	1.2	09/19/02	0.1	12/04/03	1.1	02/10/05	1.0
12/10/97	1.0	03/03/99	1.3	05/10/00	1.3	07/18/01	1.4	09/26/02	0.0	12/11/03	1.5	02/17/05	1.0
12/17/97	1.1	03/10/99	1.3	05/17/00	1.2	07/25/01	1.3	10/03/02	0.0	12/18/03	1.3	02/24/05	1.0
01/07/98	1.0	03/17/99	1.3	05/24/00	1.1	08/01/01	1.8	10/10/02	1.5	12/25/03	0.5	03/03/05	1.0
01/14/98	1.0	03/24/99	1.3	05/31/00	1.1	08/08/01	1.3	10/17/02	1.5	01/02/04	0.8	03/10/05	0.9
01/21/98	1.0	03/31/99	1.3	06/07/00	1.4	08/15/01	1.2	10/24/02	1.5	01/08/04	0.8	03/17/05	0.9
01/28/98	1.0	04/07/99	1.2	06/14/00	0.5	08/22/01	1.1	10/31/02	1.5	01/15/04	0.8	03/24/05	0.8
02/04/98	1.4	04/14/99	1.2	06/21/00	1.0	08/29/01	1.3	11/07/02	1.5	01/22/04	0.6	03/31/05	0.7
02/11/98	1.4	04/21/99	1.1	06/28/00	1.1	09/05/01	1.4	11/14/02	1.5	01/29/04	0.8	04/07/05	1.2
02/18/98	1.4	04/28/99	1.2	07/05/00	1.3	09/12/01	1.4	11/21/02	1.0	02/05/04	0.5	04/14/05	1.1
02/25/98	0.8	05/05/99	1.2	07/12/00	1.0	09/19/01	3.0	11/27/02	1.5	02/12/04	0.0	04/21/05	1.8
03/04/98	1.3	05/12/99	1.2	07/19/00	1.3	09/26/01	2.4	12/05/02	0.0	02/19/04	0.0	04/28/05	1.8
03/11/98	1.3	05/19/99	1.1	07/26/00	1.3	10/01/01	1.5	12/12/02	0.0	02/26/04	0.9	05/05/05	1.2
03/18/98	1.3	05/26/99	1.2	08/02/00	1.3	10/08/01	2.5	12/19/02	0.2	03/04/04	1.3	05/12/05	1.2
03/26/98	1.3	06/02/99	1.1	08/09/00	1.4	10/18/01	2.0	12/26/02	0.2	03/11/04	0.8	05/19/05	0.9
04/01/98	0.8	06/10/99	1.4	08/16/00	1.2	10/24/01	2.3	01/02/03	0.4	03/18/04	0.8	05/26/05	1.5
04/08/98	1.0	06/18/99	1.5	08/23/00	1.4	10/31/01	2.5	01/09/03	0.4	03/25/04	0.8	06/02/05	1.5
04/15/98	1.3	06/23/99	2.2	09/30/00	1.3	11/08/01	1.4	01/16/03	0.1	04/01/04	0.6	06/09/05	1.5
04/22/98	1.3	06/30/99	2.2	09/06/00	1.4	11/17/01	1.2	01/23/03	0.1	04/08/04	0.5	06/16/05	1.3
04/29/98	1.3	07/07/99	2.4	09/13/00	1.2	11/21/01	1.3	01/30/03	0.3	04/15/04	0.2	06/23/05	1.3
													09/19/06
													09/26/06
													10/03/06
													10/10/06
													10/17/06
													10/24/06
													10/31/06
													11/07/06
													12/06/06
													01/03/07
													02/03/07
													03/06/07
													04/03/07
													04/10/07
													04/17/07
													04/24/07
													05/01/07
													05/08/07
													05/15/07
													05/22/07
													05/29/07
													06/05/07
													06/12/07
													06/19/07
													06/26/07

Note: Beginning June 6, 2006, the hexavalent chromium results are based upon laboratory analysis. The prior results were based on testing using a Hach kit.

Table Of Contents (continued)

List Of Figures

- Figure #1 - Site Location Map
- Figure #2 - Collection Trench & Monitoring Well Locations
- Figure #3 - Groundwater Contours
- Figure #4 - Isoconcentration Map – Total Chromium (ug/l) In Groundwater

List Of Tables

- Table #1 - Groundwater Effluent Discharges/April, May & June 2007
- Table #2 - City Of Appleton Effluent Compliance Limits
- Table #3 - Effluent Point #001 Analytical Results
- Table #4 - Groundwater Elevations
- Table #5 - Groundwater Geochemical Parameters
- Table #6 - Groundwater Analytical Results / Selected Metals
- Table #7 - Groundwater Analytical Results / Volatile Organic Compounds (VOC's)
- Table #8 - Influent Hexavalent Chromium Results

List Of Appendices

- Appendix A - Laboratory Analytical Results

B. Groundwater Sampling Results

The collected groundwater samples were analyzed for one or more of the following: Total Dissolved Chromium, VOC's, zinc and cyanide. Field analysis was conducted at MW-103, MW-104, MW-107, MW-109, MW-110, MW-111, MW-112, and MW-113 for pH, temperature, specific conductivity, dissolved oxygen, Redox potential and ferrous iron. The field testing results are contained in Table #5. The laboratory analytical results are presented on Tables #6 and #7.

The laboratory analytical results indicate that levels of total chromium exceed the 1992 DNR NR 140.10 Groundwater PAL in monitoring wells MW-103 (90 ug/l), MW-104 (97 ug/l), MW-107 (2,800 ug/l), MW-109 (2,200 ug/l), MW-110 (32,000 ug/l), MW-111 (41 ug/l), MW-112 (100,000 ug/l) and MW-13 (21,000 ug/l). Additionally, two to five of the following VOC compounds (1,1-Dichloroethane, 1,1-Dichloroethene, cis-1,2,-Dichloroethene, 1,1,2-Trichloroethane, 1,1,1-Trichloroethane and Trichloroethene) were detected in MW-107, MW-109, MW-110, MW-111, MW-112 and MW-113 at concentrations above the 1992 NR 140.10 PAL. An isoconcentration map for total chromium concentrations is shown on Figure #4. The Chain Of Custody Forms and laboratory analytical data are included in Appendix A.

A summary of the influent Hexavalent Chromium concentrations is contained in Table #8. The listed concentrations are based upon the weekly Hatch kit analysis of the treatment system influent.

VI. PUBLIC CONTACTS

There were no public contacts during this reporting period.

VII. CONCLUSIONS & RECOMMENDATIONS

The groundwater laboratory results from the 16 monitoring wells associated with the N.W. Mauthe groundwater treatment system indicate the groundwater plume is being controlled horizontally by the groundwater collection trenches.

The latest round (July 2007) of groundwater samples collected from eight of the monitoring wells, indicates residual chromium contamination above the 1992 DNR NR 140.10 PAL exists in monitoring wells MW-103, MW-104, MW-107, MW-109, MW-110, MW-111, MW-112, and MW-113. Additionally, two to five VOC compounds in excess of the 1992 NR 140.10 PAL were detected in MW-107, MW-109, MW-110, MW-111, MW-112 and MW-113.

A total of 215,183-gallons of impacted groundwater has been extracted during the months of April, May & June 2007, and discharged to the City of Appleton municipal

Table #4

GROUNDWATER ELEVATIONS
N.W. Mauthe Superfund Site - Appleton, Wisconsin
MCO No. M0050-930746.26

Well Name	Date Measured	Depth To Water (feet)	Reference Elevation (To Top PVC) (feet)	Groundwater Elevation (feet)
MW-108 (continued)	09/21/05	6.66		799.95
	12/14/05	6.68		799.93
	03/21/06	6.71		799.90
	06/28/06	6.82		799.79
	09/20/06	6.75		799.86
	12/19/06	6.90		799.71
	03/13/07	6.75		799.86
	07/03/07	7.53		799.08
MW-109	06/21/06	8.98	810.52	801.54
	09/20/06	8.90		801.62
	12/19/06	9.68		800.84
	03/13/07	9.32		801.20
	07/03/07	9.11		801.41
MW-110	06/21/06	10.39	809.81	799.42
	09/20/06	11.09		798.72
	12/19/06	11.06		798.75
	03/13/07	11.04		798.77
	07/03/07	10.60		799.21
MW-111	06/21/06	10.69	807.59	796.90
	09/20/06	13.45		794.14
	12/19/06	14.97		792.62
	03/13/07	9.63		797.96
	07/03/07	9.00		798.59
MW-112	06/21/06	15.70	808.14	792.44
	09/20/06	10.75		797.39
	12/19/06	11.93		796.21
	03/13/07	10.23		797.91
	07/03/07	8.91		799.23
MW-113	06/21/06	9.69	808.24	798.55
	09/20/06	10.27		797.97
	12/19/06	10.03		798.21
	03/13/07	8.93		799.31
	07/03/07	9.75		798.49
PZ-05	07/19/05	37.39	810.88	773.49
	09/21/05	28.56		782.32
	12/19/06	27.98		782.90
	03/13/07	28.61		782.27
	07/03/07	28.00		782.88
PZ-06	07/19/05	36.31	809.77	773.46
	09/21/05	29.79		779.98
	12/19/06	29.49		780.28
	03/13/07	29.93		779.84
	07/03/07	30.03		779.74
PZ-07	07/19/05	32.03	804.48	772.45
	09/21/05	27.34		777.14
	12/19/06	29.37		775.11
	03/13/07	24.41		780.07
	07/03/07	23.74		780.74
PZ-08	07/19/05	32.07	804.35	772.28
	09/21/05	24.47		779.88
	12/19/06	28.16		776.19
	03/13/07	21.90		782.45
	07/03/07	23.19		781.16

* Casing for MW-107 was damaged. Groundwater elevation could not be determined.

** Reflects new elevation of MW-107 after repair to well casing.

*** Monitoring wells re-surveyed after casings were shortened.

**** New elevation after the PVC casing was shortened after the March 23, 2004 sampling event.


***** New elevation after the PVC casing was shortened after the March 21, 2006 sampling event.

***** New elevation after PVC casing was shortened after the December 19, 2006 sampling event.


Note: Omni Associates, Inc. collected water level readings from MW-109 to MW-113 on June 21, 2006 and September 20, 2006 and from PZ-5 to PZ-8 on July 19, 2005 and September 21, 2005.

Professional Qualifications Statement


"I, Thomas J. Kispert, hereby certify that I am a Registered Professional Engineer in the State of Wisconsin, registered in accordance with the requirements of ch. A-E 4, Wis. Adm. Code; that this document has been prepared in accordance with the Rules of Professional Conduct in ch. A-E 8, Wis. Adm. Code; and that, to the best of my knowledge, all information contained in this document is correct and the document was prepared in compliance with all applicable requirements in chs. 700 to 726, Wis. Adm. Code."


Thomas J. Kispert, P.E., C.C.S. / P.E. No. E-26225
Senior Project Engineer



7-30-07
Date

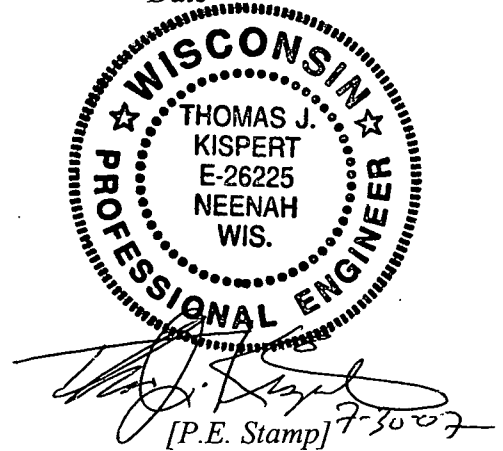

"I, Stuart A. Boerst, hereby certify that I am a Hydrogeologist, as the term is defined in s. NR 712.03(1), Wisconsin Administrative Code, and that, to the best of my knowledge, all of the information contained in this document is correct and the document was prepared in compliance with all applicable requirements in chs. NR 700 to 726, Wisconsin Administrative Code."


Stuart A. Boerst, P.S., P.H.
Hydrogeologist

07/30/07
Date

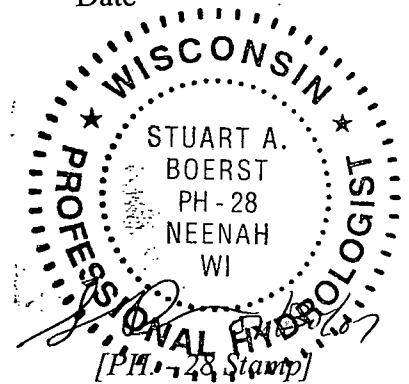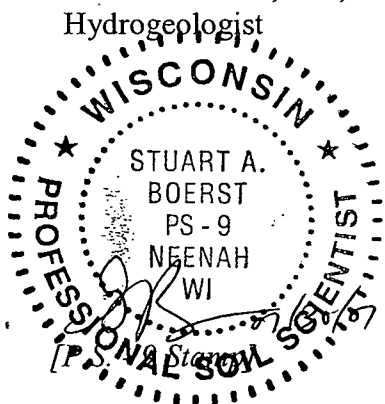

QUARTERLY PROGRESS REPORT #35

April, May & June 2007

N.W. MAUTHE
GROUNDWATER TREATMENT SYSTEM
BRRTS I.D. #02-45-000127
Appleton, Wisconsin

Prepared For The
WISCONSIN DEPARTMENT OF
NATURAL RESOURCES

Prepared By
McMahon Associates, Inc.
Neenah, Wisconsin
July 30, 2007
McM. No. M0050-930746.26

Table Of Contents

- I. SITE BACKGROUND
- II. GROUNDWATER EXTRACTION PROCESS
 - A. Groundwater Extraction System
 - B. Permit Monitoring & Reporting
 - 1. Monthly Reporting
 - 2. Quarterly & Semi-Annual Reporting
- III. GROUNDWATER COLLECTION SYSTEM
 - A. Collection Trenches
- IV. COMPLIANCE SAMPLING
- V. GROUNDWATER SAMPLING
 - A. Groundwater Sampling Procedures
 - B. Groundwater Sampling Results
- VI. PUBLIC CONTACTS
- VIII. CONCLUSIONS & RECOMMENDATIONS

Table Of Contents (continued)

List Of Figures

- Figure #1 - Site Location Map
- Figure #2 - Collection Trench & Monitoring Well Locations
- Figure #3 - Groundwater Contours
- Figure #4 - Isoconcentration Map – Total Chromium (ug/l) In Groundwater

List Of Tables

- Table #1 - Groundwater Effluent Discharges/April, May & June 2007
- Table #2 - City Of Appleton Effluent Compliance Limits
- Table #3 - Effluent Point #001 Analytical Results
- Table #4 - Groundwater Elevations
- Table #5 - Groundwater Geochemical Parameters
- Table #6 - Groundwater Analytical Results / Selected Metals
- Table #7 - Groundwater Analytical Results / Volatile Organic Compounds (VOC's)
- Table #8 - Weekly Influent Hexavalent Chromium Results

List Of Appendices

- Appendix A - Laboratory Analytical Results

QUARTERLY PROGRESS REPORT #35

April, May & June 2007

N.W. MAUTHE GROUNDWATER TREATMENT SYSTEM BRRTS I.D. #02-45-000127 Appleton, Wisconsin

Prepared For The

WISCONSIN DEPARTMENT OF NATURAL RESOURCES

Prepared By
McMahon Associates, Inc.
Neenah, Wisconsin
July 30, 2007
McM. No. M0050-930746.26

I. SITE BACKGROUND

The N.W. Mauthe site is a former electroplating facility, located at 725 South Outagamie Street, Appleton, Wisconsin (refer to Figure #1, Site Location Map). The property was used for a chrome plating company, from 1960 until 1976. Electroplating of zinc, cadmium and, possibly, copper and silver was conducted from 1978 to 1987 in an adjacent building on the same property. After 1987, all plating operations ceased on the property.

Concerns over sub-surface discharges to the surrounding environment led the Wisconsin Department of Natural Resources (DNR) and United States Environmental Protection Agency (USEPA) to conduct a remedial investigation and clean up of the N.W. Mauthe site and surrounding properties.

The investigation determined the N.W. Mauthe site was contaminated with zinc, cadmium, chromium and cyanide. Additionally, several volatile organic compounds (VOC's) were also present.

Based upon the findings of the remedial investigation, the following actions were taken to remediate the N.W. Mauthe site and adjacent properties of the sub-surface contamination.

- A. Demolition and removal of the buildings on the N.W. Mauthe property.
- B. Excavation and off-site treatment of soils with a total chromium concentration of greater than 500 mg/kg.

- C. Backfilling of the excavation with clean soils, capping the site with 2-feet of clay and topsoil, and the establishment of vegetative cover.
- D. Installation of groundwater collection trenches and construction and operation of a groundwater treatment facility to contain and/or control groundwater contamination with ultimate compliance with groundwater Applicable or Relevant and Appropriate Requirements (ARAR's).
- E. Improvement or installation of foundation drain systems and cleaning, painting or sealing of basement walls and floors, as needed, for homes or businesses in the area of the site, to prevent seepage of contaminated water into the buildings.

Midwest Contract Operations, Inc. (MCO) began operating the groundwater treatment system in February 1997. CH₂M Hill, the site engineer and project manager for the U.S. EPA, retained responsibility for the overall site operations and the groundwater monitoring wells associated with the treatment system.

In October 1998, after the first year of operation and maintenance of the remediation system, the Wisconsin DNR assumed the responsibility from the U.S. EPA for all operation and maintenance of the site. MCO was retained by the Wisconsin DNR for the operation and maintenance of the entire groundwater treatment system, including the groundwater monitoring wells. MCO performs groundwater sampling and maintenance of the system.

The groundwater collection trench system, the location of sump pump and drain connections, and the groundwater monitoring wells associated with the site are shown in Figure #2.

The groundwater extraction system is designed to capture groundwater containing contaminants at concentrations greater than the 1992 Chapter NR 140, Administrative Code Preventative Action Limits (PAL's). The system is designed using a coarse sand-filled trenches that influences groundwater flow. Groundwater will enter the trench, based upon the head differential between the local water table and the level maintained in the trench. Perforated drain pipe in the bottom of the trench drains water from the trench to one of two manholes, after which the groundwater is pumped to the sanitary sewer with no treatment.

The collection trench system consists of the west, central and southeast segments, which are approximately 200, 280 and 600 linear feet in length, respectively. The trenches, shown on Figure #2, are constructed of coarse sand with perforated pipe at the base. The trenches are sealed from a depth of 3 feet to the surface to prevent infiltration of surface water. In normal operation, the water level in the trenches is maintained at or near the bottom of the trench. The trenches are sloped to promote drainage to the manholes and, in most parts of the trench, the water level will be near

the bottom. As such, if the groundwater extraction system needs to be shutdown for repair or maintenance for a short period of time, the trenches will provide storage and will continue to act as a hydraulic barrier until the water in the trench rises to the level of the water table.

Four homes south of the facility have foundation drain systems that are connected to the groundwater collection system via gravity piping (801 South Outagamie Street; 1428 West Second Street, 1414 West Second Street and 1410 West Second Street). This piping includes a backwater valve to prevent back-up of groundwater into the foundation drain systems.

Groundwater collection in the west trench flows by gravity to Manhole #1, where the maximum depth of the trench extends about 32 feet below ground surface. Groundwater in the central and southeast trenches flows by gravity to Manhole #2, where the maximum depth of the trench extends about 31 feet below ground surface. The pumps in Manholes #1 and #2 pump groundwater to the treatment facility where it is discharged to the sanitary sewer.

In May 10, 2004, four piezometers (PZ-01, PZ-02, PZ-03 and PZ-04) were abandoned. The bottom of the piezometers were installed near the elevation of the collection trench piping and were within the trenches. The purpose of the piezometers were to determine whether the trenches were working properly. Therefore, since the trenches are functioning properly, the piezometers were abandoned.

In May 2006, five groundwater monitoring wells, MW-109 through MW-113, were installed by Omni Associates, Inc.

II. GROUNDWATER EXTRACTION PROCESS

A. Groundwater Extraction System

Beginning in February 1997 through April 18, 2006 the treatment system consisted of a batch process. As part of the remediation phase at the N.W. Mauthe site, a groundwater collection system was installed on and adjacent to the N.W. Mauthe property. Approximately 1,080 lineal feet of coarse sand filled trenching was installed to draw groundwater from the contaminated areas to two collection sumps. From the collection sumps, groundwater was pumped to a 9,000 gallon holding tank, located within the treatment building.

Each batch of groundwater to be treated was pumped from the storage tank to the reaction tank. The batch process treatment system utilized ferrous sulfate and caustic additions to treat the contaminated groundwater. Through chemical addition, mixing, aeration and settling, the chromium was removed from the groundwater. The fully automated process treated approximately 2,700 gallons

per batch (based on physical tank measurements) and is capable of treating four batches per day.

Treated groundwater decants from the reaction tank to the City of Appleton sanitary sewer system. The chromium containing sludge settles to the bottom of the reaction tank.

During each discharge, the effluent was tested for hexavalent chromium using a Hach Test kit. The pH is recorded off two meters, located in the reaction tank. The pH values from the two meters are recorded during discharge as the high and low pH values on a daily log sheet. The average of the two pH values was calculated. The effluent wastewater was tested quarterly for total chromium at a DNR approved environmental laboratory.

Beginning on April 18, 2006, the groundwater is directly discharged from the two sumps through a storage tank and into the City of Appleton sanitary sewer system with no treatment. The storage tank allows for sampling. An 8 week pilot project was conducted beginning on April 18, 2006.

For the months of April, May & June 2007, a total of 215,183-gallons of contaminated groundwater was extracted and discharged. The effluent flows are recorded based on the effluent meter reading. The average groundwater concentration was calculated by taking an average of the weekly influent chromium concentrations over the 3-month period. Using the average groundwater concentration of 1.20 mg/l hexavalent chromium, the calculated reduction in hexavalent chromium would be 2.15 pounds over the 3-month period.

A summary of continuous discharge of untreated groundwater, for the period of April through June 2007, is included in Table #1.

B. Permit Monitoring & Reporting

1. Monthly Reporting

The Wisconsin DNR is provided with a monthly report summarizing operations at the site. The monthly reports include MCO's operating invoice for the month, a copy of the City of Appleton monthly report, a list of invoices paid during the month, and a copy of the facility log. Also included in this report is a narrative of any alarm call-outs or non-routine occurrences at the site.

2. Quarterly & Semi-Annual Reporting

Quarterly reports are submitted to the Wisconsin DNR and the City of Appleton covering the time periods of October through December (first), January through March (second), April through June (third), and July through September (fourth).

The reports include total flows for the quarter, Hach kit hexavalent chromium concentrations, laboratory hexavalent chromium concentrations, and laboratory total chromium concentrations. A summary of the direct groundwater discharge meter readings, Hach kit results and laboratory results for this period are contained in Table #1. For the time period covered by this report, there were no exceedances of the effluent discharge limits.

Semi-annual reporting consists of submittal of Wisconsin DNR Form 4400-194 with the second and fourth Quarterly Progress Reports.

The quarterly reports include site background, a description of the groundwater extraction and discharge process and analytical results, groundwater sampling procedures and results, a discussion of public contacts, applicable operation and maintenance activities, and MCO's conclusions and recommendations.

The Semi-Annual Operation & Maintenance Report includes a summary of routine operation and maintenance activities at the site, groundwater monitoring results, groundwater extraction performance, conclusions and recommendations.

III. GROUNDWATER COLLECTION SYSTEM

A. Collection Trenches

The groundwater collection system utilizes approximately 1,080 linear feet of coarse sand filled trenching, which was installed to draw groundwater from the contaminated areas to two collection sumps. Collection Sump #1, designated Manhole #1 on the Site Map and located at the southwest corner of the property, collects flows from below the Miller Electric parking lot and the south end of the Mauthe property.

Collection Sump #2, designated Manhole #2 on the Site Map and located along Outagamie Street south of the railroad tracks, collects flow from the triangular area bounded by the railroad tracks, Outagamie Street and Second Street.

Groundwater flows from the Mauthe site tend to flow southward toward the collection trenches (Figure #3). South of the railroad tracks, groundwater flows towards the closest collection trench. The exact radius of influence of the trenches is not known. However, based upon the groundwater analytical results from the wells located around the perimeter of the plume, the plume appears to be controlled horizontally.

Foundation drains at 1410 and 1414 West Second Street and 801 South Outagamie Street are connected to the collection trench system. Additionally, the sump pump at 1428 West Second Street is connected to the system.

IV. COMPLIANCE SAMPLING

Compliance sampling of the treatment system effluent is conducted twice per year by the City of Appleton. The effluent is analyzed for all the parameters listed in Table #2. Process compliance samples are collected according to the following schedule. Total chromium is tested monthly. Hexavalent chromium is tested weekly for the months of April through October, and monthly from November through March. Flows and pH are recorded during the sampling events. The most recent process compliance sample was collected on April 2, 2007.

MCO collects one compliance sample from the outfall during the first quarter of each calendar year. Four quarterly process compliance samples per year are tested for one or more of the following: flow, pH, hexavalent chromium and total chromium. The sample collected for analysis by MCO was collected April 2, 2007. The Total Chromium concentration was 1.41 mg/l.

A summary of the compliance sampling results from Outfall 001 are contained in Table #3. The sampling results are presented in Appendix A. During the period from April through June 2007, there were no exceedances of the City of Appleton Industrial User Discharge Permit.

V. GROUNDWATER SAMPLING

A. Groundwater Sampling Procedures

A total of 16 groundwater monitoring wells and four piezometers are associated with the groundwater extraction system.

Groundwater levels are measured in the monitoring wells and piezometers, relative to the north side of the top of the well casing. A summary of the historical groundwater levels for the site is included in Table #4. The groundwater contours for groundwater monitoring wells, relative to the site are shown on Figure #3.

A reduction in sampling frequency and reduction or elimination of several sample parameters was approved by the United States EPA and Wisconsin DNR, effective with the June 2003 quarterly sampling.

The changes are summarized below:

1. Elimination of cadmium sampling at all 11 monitoring wells.
2. Reduction in sampling frequency from quarterly to annually for manganese. The annual sample will be collected during the March sampling events.
3. Reduction in sampling from quarterly to annually for chromium in all wells, except MW-103, MW-104 and MW-107. MW-103, MW-104 and MW-107 will continue to be monitored quarterly.
4. Elimination of VOC sampling from all wells, except MW-107. MW-107 will continue to be monitored quarterly.

Eight of the groundwater monitoring wells were sampled on July 3, 2007 for Total Chromium and/or VOC's and/or zinc and/or cyanide. A dedicated submersible pump is installed in each well. Water level measurements were collected from each monitoring well, prior to sampling. Each sampled well was slowly pumped dry and allowed to recharge. The wells were then pumped dry again, allowed to recharge and then sampled. Purge water from the wells was collected and dumped into the collection sumps. The pump water volumes collected from the groundwater wells and the field testing data are included in Table #5.

The sampling process utilized a flow through cell to read the pH, temperature, conductivity, redox potential and dissolved oxygen in each well. Flow through the cell was maintained at approximately 250 ml/min. utilizing a resistor to control pump flow. The same approximate flow rate was maintained for purging and sampling. Groundwater samples were collected after a well had been purged dry twice. The pH, conductivity, redox potential and dissolved oxygen readings for each monitoring well were recorded just prior to sampling. The groundwater samples were collected in the order of VOC vials first (if applicable) and metal samples second. The metal samples were field filtered with a 45 micron in-line filter. The laboratory containers supplied for metals analysis include nitric acid as preservative. The collected samples were submitted to Pace Analytical, Green Bay, Wisconsin. The collected samples were analyzed for selected metals and Volatile Organic Compounds (VOC's), as specified by the Wisconsin DNR. Ferrous iron testing was conducted using field Hach test kits.

B. Groundwater Sampling Results

The collected groundwater samples were analyzed for one or more of the following: Total Dissolved Chromium, VOC's, zinc and cyanide. Field analysis was conducted at MW-103, MW-104, MW-107, MW-109, MW-110, MW-111, MW-112, and MW-113 for pH, temperature, specific conductivity, dissolved oxygen, Redox potential and ferrous iron. The field testing results are contained in Table #5. The laboratory analytical results are presented on Tables #6 and #7.

The laboratory analytical results indicate that levels of total chromium exceed the 1992 DNR NR 140.10 Groundwater PAL in monitoring wells MW-103 (90 ug/l), MW-104 (97 ug/l), MW-107 (2,800 ug/l), MW-109 (2,200 ug/l), MW-110 (32,000 ug/l), MW-111 (41 ug/l), MW-112 (100,000 ug/l) and MW-113 (21,000 ug/l). Additionally, two to five of the following VOC compounds (1,1-Dichloroethane, 1,1-Dichloroethene, cis-1,2-Dichloroethene, 1,1,2-Trichloroethane, 1,1,1-Trichloroethane and Trichloroethene) were detected in MW-107, MW-109, MW-110, MW-111, MW-112 and MW-113 at concentrations above the 1992 NR 140.10 PAL. An isoconcentration map for total chromium concentrations is shown on Figure #4. The Chain Of Custody Forms and laboratory analytical data are included in Appendix A.

A summary of the weekly influent Hexavalent Chromium concentrations is contained in Table #8. The listed concentrations are based upon the weekly Hatch kit analysis of the treatment system influent.

VI. PUBLIC CONTACTS

There were no public contacts during this reporting period.

VII. CONCLUSIONS & RECOMMENDATIONS

The groundwater laboratory results from the 16 monitoring wells associated with the N.W. Mauthe groundwater treatment system indicate the groundwater plume is being controlled horizontally by the groundwater collection trenches.

The latest round (July 2007) of groundwater samples collected from eight of the monitoring wells, indicates residual chromium contamination above the 1992 DNR NR 140.10 PAL exists in monitoring wells MW-103, MW-104, MW-107, MW-109, MW-110, MW-111, MW-112, and MW-113. Additionally, two to five VOC compounds in excess of the 1992 NR 140.10 PAL were detected in MW-107, MW-109, MW-110, MW-111, MW-112 and MW-113.

A total of 215,183-gallons of impacted groundwater has been extracted during the months of April, May & June 2007, and discharged to the City of Appleton municipal

sanitary sewer system with no treatment. A total of 2.15-pounds of chromium was removed during the three month period. Analysis by MCO and the City of Appleton of the treatment system effluent did not indicate any exceedances of the local discharge permit limits for the site.

Based upon the July 2007 groundwater sampling results and the effluent process analytical results, McMahon Associates, Inc. recommends continued operation of the groundwater extraction and direct discharge system at the N.W. Mauthe groundwater remediation site.

Table #1

GROUNDWATER EFFLUENT DISCHARGES
April, May & June 2007
N.W. Mauthe Superfund Site - Appleton, Wisconsin
 MCO No. M0050-930746.26

Date	Flow Meter Reading	Gallons Discharged	pH	Discharge Hexavalent Chromium Concentration Hach Test Kit Mg/l	Discharge Hexavalent Chromium Concentration Lab Test Mg/l	Discharge Total Chromium Concentration Lab Test Mg/l
04/02/07	7950544	27,022				
04/03/07	7950544	0	7.8	0.90	1.50	1.10
04/09/07	7980454	29,910				
04/10/07	7980454	0	8.0	0.90	1.30	
04/16/07	8000465	20,011				
04/17/07	8000465	0	7.8	1.20	1.20	
04/23/07	8016592	16,127				
04/24/07	8016592	0	7.9	0.70	0.87	
04/30/07	8028630	12,038				

Total Monthly Discharge Gallons 105,108

Date	Flow Meter Reading	Gallons Discharged	pH	Discharge Hexavalent Chromium Concentration Hach Test Kit Mg/l	Discharge Hexavalent Chromium Concentration Lab Test Mg/l	Discharge Total Chromium Concentration Lab Test Mg/l
05/01/07	8028630	0	7.9	1.10	1.10	1.00
05/07/07	8055607	26,977				
05/08/07	8055607	0	7.8	0.70	0.80	
05/14/07	8067955	12,348				
05/15/07	8067955	0	7.8	0.70	0.76	
05/21/07	8078670	10,715				
05/22/07	8078670	0	7.8	0.90	0.96	
05/28/07	8088275	9,605				
05/29/07	8088275	0	7.8	0.90	0.98	

Total Monthly Discharge Gallons 59,645

Date	Flow Meter Reading	Gallons Discharged	pH	Discharge Hexavalent Chromium Concentration Hach Test Kit Mg/l	Discharge Hexavalent Chromium Concentration Lab Test Mg/l	Discharge Total Chromium Concentration Lab Test Mg/l
06/04/07	8100181	11,906				
06/05/07	8100181	0	7.8	1.50	1.80	2.00
06/11/07	8118890	18,709				
06/12/07	8118890	0	7.7	0.80	1.30	
06/18/07	8128790	9,900				
06/19/07	8128790	0	7.7	1.20	1.20	
06/25/07	8138705	9,915				
06/26/07	8138705	0	7.7	1.50	1.80	

Total Monthly Discharge Gallons 50,430

Table #2

CITY OF APPLETON EFFLUENT COMPLIANCE LIMITS
Effluent Point 001
N.W. Mauthe Superfund Site - Appleton, Wisconsin
MCO No. M0050-930746.26

	Aluminum (mg/l)	Arsenic (mg/l)	Cadmium (mg/l)	Chromium Total (mg/l)	Copper (mg/l)	Cyanide (mg/l)	Lead (mg/l)	Mercury (mg/l)	Nickel (mg/l)	Zinc (mg/l)	Hexavalent Chromium (mg/L)
Effluent Limits Permit #06-21	70	1.0	0.3	7.0	3.5	1.0	2.0	0.002	2.0	10.0	4.5

mg/l = milligram / liter
ug/l = microgram / liter

Note: Based upon City of Appleton Permit No. 06-21.

Table #3

EFFLUENT POINT #001 ANALYTICAL RESULTS
Effluent Point 001
N.W. Mauthe Superfund Site - Appleton, Wisconsin
MCO No. M0050-930746.26

Sample Name	Sample Date	Aluminum (mg/l)	Arsenic (mg/l)	Cadmium (mg/l)	Chromium Total (mg/l)	Copper (mg/l)	Cyanide (mg/l)	Lead (mg/l)	Mercury (mg/l)	Nickel (mg/l)	Zinc (mg/l)	Hexavalent Chromium (mg/L)
Outfall 001*	02/20/97	<.02	<.003	<.00050	0.0400	<.01	<.00001	<.005	<.0002	<.005	0.0051	<.01
Outfall 001*	05/27/97	NA	NA	NA	0.2600	NA	NA	NA	NA	NA	NA	NA
Outfall 001*	09/11/97	NA	NA	NA	0.5570	NA	NA	NA	NA	NA	NA	NA
Outfall 001*	12/12/97	NA	NA	NA	0.2790	NA	NA	NA	NA	NA	NA	NA
Outfall 001*	03/24/98	0.0152	<.002	<.00004	0.0637	<.0095	<.0017	<.0006	<.000015	<.0095	0.0046	0.1000
Outfall 001**	04/29/98	<.011	<.002	<.005	0.2200	<.05	0.0020	<.1	<.0002	<.04	<.005	NA
Outfall 001*	06/10/98	NA	NA	NA	0.0784	NA	NA	NA	NA	NA	NA	NA
Outfall 001**	10/07/98	<.011	<.002	0.0050	0.1700	<.05	<.001	<.1	<.0002	<.04	0.0250	NA
Outfall 001***	10/27/98	NA	NA	NA	0.0940	NA	NA	NA	NA	NA	NA	NA
Outfall 001***	02/09/99	NA	NA	NA	0.1600	NA	NA	NA	NA	NA	NA	NA
Outfall 001***	03/18/99	<.009	<.003	<.00031	NA	.00068****	<.000032	<.0024	<.00005	.00351****	<.012	<.0036
Outfall 001**	03/18/99	<.011	<.002	<.005	<.05	<.05	0.0010	0.1000	<.00005	0.0400	0.0180	NA
Outfall 001***	06/08/99	NA	NA	NA	0.1900	NA	NA	NA	NA	NA	NA	NA
Outfall 001***	09/13/99	NA	NA	NA	0.1700	NA	NA	NA	NA	NA	NA	NA
Outfall 001**	09/21/99	<.011	<.002	<.005	<.05	<.05	0.0030	<.1	<.00015	<.04	0.0080	NA
Outfall 001***	12/15/99	NA	NA	NA	0.0870	NA	NA	NA	NA	NA	NA	NA
Outfall 001**	02/15/00	<.015	<.0020	<.005	0.0900	<.05	<.001	<.1	<.00013	<.04	0.0280	NA
Outfall 001***	03/13/00	<.009	<.003	<.00031	0.1400	<.0006	<.0044	<.0024	<.00005	0.0012	<.012	NA
Outfall 001***	06/22/00	NA	NA	NA	0.2400	NA	NA	NA	NA	NA	NA	NA
Outfall 001***	09/27/00	NA	NA	NA	0.5100	NA	NA	NA	NA	NA	NA	NA
Outfall 001***	12/19/00	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
Outfall 001**	02/21/01	<.015	<.002	<.005	0.11	<.05	0.001	<.1	<.00013	<.04	0.042	NA
Outfall 001***	03/01/01	<.034	<.0027	.012 ****	0.25	.0088 ****	<.0033	<.17	<.00005	.036 ****	0.015	<.0036
Outfall 001***	06/19/01	NA	NA	NA	0.11	NA	NA	NA	NA	NA	NA	NA
Outfall 001***	09/24/01	NA	NA	NA	0.16	NA	NA	NA	NA	NA	NA	NA
Outfall 001**	10/02/01	0.016	<.002	<.005	0.14	<.05	<.001	<.1	<.00013	<.04	0.065	NA
Outfall 001***	12/05/01	NA	NA	NA	0.042	NA	NA	NA	NA	NA	NA	NA
Outfall 001***	03/19/02	<.034	<.0027	<.0075	0.36	<.0077	<.0027	<.17	<.00005	<.017	<.012	<.0036
Outfall 001**	05/02/02	<.049	<.012	<.014	0.362	<.015	<.0014	<.060	<.00011	<.011	<.009	NA
Outfall 001***	06/20/02	NA	NA	NA	0.67	NA	NA	NA	NA	NA	NA	NA
Outfall 001***	09/18/02	NA	NA	NA	0.11	NA	NA	NA	NA	NA	NA	NA
Outfall 001**	11/12/02	0.027	<.0082	<.00053	0.23	<.009	<.0007	<.00084	<.000028	0.0044	0.0081	NA
Outfall 001***	12/17/02	NA	NA	NA	0.0082	NA	NA	NA	NA	NA	NA	NA
Outfall 001**	02/11/03	<.027	<.0082	<.00053	0.086	<.0009	<.0014	<.0013	<.000028	0.0036	<.0025	NA
Outfall 001**	03/24/03	<.045	<.0027	<.0088	0.13	0.075	<.0050	<.16	<.000050	<.019	<.0044	<.0036
Outfall 001***	06/11/03	NA	NA	NA	<.019	NA	NA	NA	NA	NA	NA	NA
Outfall 001***	09/10/03	NA	NA	NA	<.019	NA	NA	NA	NA	NA	NA	NA
Outfall 001**	10/23/03	0.0045	0.0013	<.00001	0.221	<.00008	<.0005	<.00006	0.0002	<.025	<.010	NA
Outfall 001***	12/10/03	NA	NA	NA	<.019	NA	NA	NA	NA	NA	NA	NA

Table #3

EFFLUENT POINT #001 ANALYTICAL RESULTS
Effluent Point 001
N.W. Mauthe Superfund Site - Appleton, Wisconsin
MCO No. M0050-930746.26

Sample Name	Sample Date	Aluminum (mg/l)	Arsenic (mg/l)	Cadmium (mg/l)	Chromium Total (mg/l)	Copper (mg/l)	Cyanide (mg/l)	Lead (mg/l)	Mercury (mg/l)	Nickel (mg/l)	Zinc (mg/l)	Hexavalent Chromium (mg/L)
Outfall 001**	03/24/04	<0.050	<0.0026	<0.010	0.15	<0.0060	<0.0050	<0.16	<0.000025	<0.020	<0.010	NA
Outfall 001***	08/09/04	NA	NA	NA	0.055	NA	NA	NA	NA	NA	NA	NA
Outfall 001***	09/22/04	NA	NA	NA	0.15	NA	NA	NA	NA	NA	NA	NA
Outfall 001**	11/09/04	0.0071	<0.0012	<0.0001	0.04	0.0008	<0.005	<0.008	<0.0002	0.0013	<0.01	NA
Outfall 001***	12/09/04	NA	NA	NA	1.6	NA	NA	NA	NA	NA	NA	NA
Outfall 001***	03/29/05	NA	NA	NA	0.041	NA	NA	NA	NA	NA	NA	<0.0027
Outfall 001***	06/22/05	NA	NA	NA	0.065	NA	NA	NA	NA	NA	NA	NA
Outfall 001***	08/08/05	0.023	<0.0035	<0.0003	0.039	0.0019	<0.0037	<0.0011	<0.000026	<0.0044	0.0024	<0.005
Outfall 001***	09/21/05	NA	NA	NA	0.52	NA	NA	NA	NA	NA	NA	NA
Outfall 001**	11/05/06	0.0052	<0.0012	<0.0001	0.088	<0.0005	<0.005	<0.0008	<0.0002	0.0017	<0.010	NA
Outfall 001***	12/16/05	NA	NA	NA	0.095	NA	NA	NA	NA	NA	NA	NA
Outfall 001**	02/23/06	0.0021	<0.0012	<0.0001	0.08	<0.0005	<0.0005	<0.0008	<0.0002	0.0022	<0.010	NA
Outfall 001***	03/23/06	<0.20	<0.0076	<0.00074	0.32	0.0018	0.0043	<0.0034	<0.000026	0.0033	<0.020	NA
Outfall 001**	06/27/06	<0.200	<0.0076	<0.00074	0.700	0.0016	<0.0094	<0.0034	<0.000072	0.0021	<0.020	<0.350
Outfall 001***	09/20/06	NA	NA	NA	1.100	NA	NA	NA	NA	NA	NA	NA
Outfall 001**	10/05/06	0.037	<0.00011	<0.0001	4.575	0.0068	0.01	<0.001	<0.0002	0.0026	<0.010	NA
Outfall 001***	12/06/06	NA	NA	NA	2.0	NA	NA	NA	NA	NA	NA	2.40
Outfall 001***	04/02/07	0.0383	0.00024	0.000086	1.41	0.0041	<0.0094	0.00013	<0.000063	0.0035	0.009	NA
Effluent Limits Permit #06-21		70.0000	1.0000	0.3000	7.0000	3.5000	1.0000	2.0000	0.0020	2.0000	10.0000	4.5000

mg/l = milligram / liter

ug/l = microgram / liter

NA = not analyzed

* = Sampled by CH2M Hill

** = Sampled by the City of Appleton

*** = Sampled by MCO

**** = Detect of compound in area of less certain quantitation.

Table #4

GROUNDWATER ELEVATIONS
N.W. Mauthe Superfund Site - Appleton, Wisconsin
MCO No. M0050-930746.26

Well Name	Date Measured	Depth To Water (feet)	Reference Elevation (To Top PVC) (feet)	Groundwater Elevation (feet)
W-2	02/01/97	-		798.66
	05/01/97	-		801.01
	09/01/97	-		800.28
	12/01/97	-	804.66	797.69
	03/01/98	-		802.08
	06/01/98	-		799.38
	10/27/98	5.85		798.81
	02/08/99	4.50		800.16
	06/08/99	3.31		801.35
	09/13/99	5.78		798.88
	12/15/99	6.63		798.03
	03/13/00	1.60		803.06
	06/22/00	2.63		802.03
	09/27/00	3.28		801.38
	12/19/00	4.78		799.88
	03/01/01	5.93		798.73
	06/19/01	1.83		802.83
	09/24/01	5.94		798.72
	12/05/01	4.93		799.73
	03/19/02	1.08		803.58
	06/20/02	2.78		801.88
	09/18/02	6.38		798.28
	12/17/02	6.81		797.85
	03/24/03	4.31		800.35
	06/10/03	3.14		801.52
	09/10/03	6.11		798.55
	12/10/03	4.03		800.63
	03/24/04	1.26		803.40
	07/09/04	3.44		801.22
	09/21/04	6.79		797.87
	03/29/05	4.51		800.15
	06/20/05	4.83		799.83
	09/21/05	6.21		798.45
	12/14/05	5.51		799.15
	03/21/06	0.08		804.58
	06/28/06	6.02		798.64
	09/20/06	8.75		795.91
	12/09/06	6.20		798.46
	03/13/07	3.80		800.86
	07/03/07	6.16		798.50
W-8	02/01/97	-		797.22
	05/01/97	-		797.66
	09/01/97	-		798.01
	12/01/97	-	803.36	796.52
	03/01/98	-		798.16
	06/01/98	-		797.31
	10/27/98	6.41		796.95
	02/08/99	5.49		797.87
	06/08/99	4.38		798.98
	09/13/99	6.71		796.65
	12/15/99	6.91		796.45
	03/13/00	6.25		797.11
	06/22/00	6.42		797.34
	09/27/00	5.66		797.70
	12/19/00	6.80		796.56
	03/01/01	5.41		797.95
	06/19/01	5.02		798.34
	09/24/01	3.38		799.98
	12/05/01	7.02		796.34
	03/19/02	3.63		799.73
	06/20/02	5.66		797.70
	09/18/02	6.93		796.43
	12/17/02	9.00		794.36
	03/24/03	6.18		797.18
	06/10/03	6.11		797.25
	09/10/03	6.71		796.65
	12/10/03	6.62		796.74
	03/23/04	6.55		796.81
	07/09/04	6.11		797.25
	09/21/04	7.08		796.28
	03/29/05	6.24		797.12
	06/20/05	6.60		796.76

Table #4

GROUNDWATER ELEVATIONS
N.W. Mauthe Superfund Site - Appleton, Wisconsin
MCO No. M0050-930746.26

Well Name	Date Measured	Depth To Water (feet)	Reference Elevation (To Top PVC) (feet)	Groundwater Elevation (feet)
W-8 (continued)	09/21/05	6.84		796.52
	12/14/05	6.71		796.65
	03/21/06	6.57		796.79
	06/28/06	7.18		796.18
	09/20/06	7.07		796.29
	12/19/06	6.87		796.49
	03/13/07	6.48		796.88
	07/03/07	7.29		796.07
W-15	02/01/97	-		793.97
	05/01/97	-		796.92
	09/01/97	-		797.23
	12/01/97	-	803.76	795.52
	03/01/98	-		796.78
	06/01/98	-		796.32
	10/27/98	7.95		795.81
	02/08/99	9.19		794.57
	06/08/99	6.89		796.87
	09/13/99	7.85		795.91
	12/15/99	8.97		794.79
	03/13/00	7.80		795.96
	06/22/00	6.42		797.34
	09/27/00	6.30		797.46
	12/19/00	7.99		795.77
	03/01/01	9.52		794.24
	06/19/01	6.91		796.82
	09/24/01	6.65		797.11
	12/05/01	8.15		795.61
	03/19/02	7.22		796.54
	06/20/02	6.84		796.92
	09/18/02	7.28		796.48
	12/17/02	9.98		793.78
	03/24/03	9.77		793.99
	06/10/03	7.04		796.72
	09/10/03	7.06		796.70
	12/10/03	7.15		796.61
	03/23/04	6.58		797.18
	07/09/04	6.45	803.66 ****	797.21
	09/21/04	7.26		796.40
	03/29/05	7.50		796.16
	06/20/05	6.82		796.84
	09/21/05	7.05		796.61
	12/14/05	7.88		795.78
	03/21/06	6.95		796.71
	06/28/06	6.98	803.42 *****	796.44
	09/20/06	7.13		796.29
	12/19/06	8.02		795.40
	03/13/07	7.22		796.20
	07/03/07	7.00		796.42
MW-101	02/01/97	-		797.16
	05/01/97	-		799.99
	09/01/97	-		798.67
	12/01/97	-	807.59	798.21
	03/01/98	-		803.43
	06/01/98	-		800.48
	10/27/98	10.26		797.33
	02/08/99	11.91		795.68
	06/08/99	9.79		797.80
	09/13/99	10.35		797.24
	12/15/99	9.01		798.58
	03/13/00	12.67		794.92
	06/22/00	6.28		801.31
	09/27/00	10.41		797.18
	12/19/00	10.73		796.86
	03/01/01	12.61		794.98
	06/19/01	8.43		799.16
	09/24/01	10.50		797.09
	12/05/01	10.98		796.61
	03/19/02	8.10		799.49
	06/20/02	7.08		800.51
	09/18/02	10.23		797.36
	12/17/02	12.47		795.12
	03/24/03	10.00		797.59

Table #4

GROUNDWATER ELEVATIONS
N.W. Mauthe Superfund Site - Appleton, Wisconsin
MCO No. M0050-930746.26

Well Name	Date Measured	Depth To Water (feet)	Reference Elevation (To Top PVC) (feet)	Groundwater Elevation (feet)
MW-101 (continued)	06/10/03	7.41		800.18
	09/10/03	9.53		798.06
	12/10/03	8.31		799.28
	03/23/04	5.95		801.64
	07/09/04	7.84		799.75
	09/21/04	10.50		797.09
	03/29/05	9.00		798.59
	06/20/05	9.28		798.31
	09/21/05	9.64		797.95
	12/14/05	8.93		798.66
	03/21/06	8.10		799.49
	06/28/06	8.88		798.71
	09/20/06	8.90		798.69
	12/19/06	8.95		798.64
	03/13/07	8.73		798.86
	07/03/07	7.39		800.20
	MW-102	02/01/97	-	
05/01/97		-		780.89
09/01/97		-		780.79
12/01/97		-	804.45	780.95
03/01/98		-		780.47
06/01/98		-		780.72
10/27/98		24.11		780.34
02/08/99		23.84		780.61
06/08/99		23.59		780.86
09/13/99		23.70		780.75
12/15/99		24.27		780.18
03/13/00		24.00		780.45
06/22/00		23.69		780.76
09/27/00		23.65		780.80
12/19/00		24.06		780.39
03/01/01		26.01		778.44
06/19/01		23.35		781.10
09/24/01		23.88		780.57
12/05/01		24.08		780.37
03/19/02		23.75		780.70
06/20/02		23.05		781.40
09/18/02		24.50		779.95
12/17/03		25.30		779.15
03/24/03		23.80		780.65
06/10/03		23.09		781.36
09/10/03		23.98	804.37 ***	780.39
12/10/03		23.22		781.15
03/23/04		23.56		780.81
07/09/04		23.52		780.85
09/21/04		24.65		779.72
03/29/04		21.24		783.13
06/20/05		23.81		780.56
09/21/05		24.71		779.66
12/14/05	24.25		780.12	
03/21/06	23.39		780.98	
06/28/06	23.95		780.42	
09/20/06	25.15		779.22	
12/19/06	25.26		779.11	
03/13/07	24.41		779.96	
07/03/07	23.89		780.48	
MW-103	02/01/97	-		795.29
	05/01/97	-		791.83
	09/01/97	-		789.60
	12/01/97	-	803.74	787.78
	03/01/98	-		791.03
	06/01/98	-		789.13
	10/27/98	11.96		791.78
	02/08/99	10.24		793.50
	06/08/99	8.69		795.05
	09/13/99	9.79		793.95
	12/15/99	12.68		791.06
	03/13/00	9.63		794.07
	06/22/00	8.22		795.52
	09/27/00	7.76		795.98
	12/19/00	10.78		792.96
	03/01/01	9.15		794.59

Table #4

GROUNDWATER ELEVATIONS
 N.W. Mauthe Superfund Site - Appleton, Wisconsin
 MCO No. M0050-930746.26

Well Name	Date Measured	Depth To Water (feet)	Reference Elevation (To Top PVC) (feet)	Groundwater Elevation (feet)
MW-103 (continued)	06/19/01	5.52		798.22
	09/24/01	9.80		793.94
	12/05/01	11.13		792.61
	03/19/02	4.96		798.78
	06/20/02	7.42		796.32
	09/18/02	9.00		794.74
	12/17/02	13.01		790.73
	03/24/03	7.63		796.11
	06/10/03	7.77		795.97
	09/10/03	9.60		794.14
	12/10/03	8.09		795.65
	03/23/04	4.01		797.73
	07/09/04	12.91		790.83
	09/21/04	10.30		793.44
	03/29/05	NR		---
	06/20/05	9.55		794.19
	09/21/05	9.70		794.04
	12/14/05	10.40		793.34
	03/21/06	7.87		795.87
	06/28/06	9.75		793.99
	09/20/06	11.23		792.51
	12/20/06	10.36		793.38
	03/13/07	9.91		793.83
07/03/07	9.45		794.29	
MW-104	02/01/97	-		792.94
	05/01/97	-		789.91
	09/01/97	-		798.59
	12/01/97	-	807.28	795.70
	03/01/98	-		799.46
	06/01/98	-		796.60
	10/27/98	10.51		796.77
	02/08/99	9.04		798.24
	06/08/99	7.49		799.79
	09/13/99	10.28		797.00
	12/15/99	10.78		796.50
	03/13/00	9.51		797.77
	06/22/00	8.41		798.88
	09/27/00	8.61		798.67
	12/19/00	10.49		796.79
	03/01/01	8.44		798.84
	06/19/01	7.51		799.71
	09/24/01	10.39		796.89
	12/05/01	10.81		796.47
	03/19/02	7.82		799.46
	06/20/02	8.60		798.68
	09/18/02	12.05		795.23
	12/17/02	12.70		794.58
	03/24/03	12.60		794.68
	06/10/03	8.81		798.47
	09/10/03	11.17		796.11
	12/10/03	8.66		798.62
	03/23/04	7.44		799.84
	09/21/04	15.21		792.07
	03/29/05	11.09		796.19
	06/20/05	9.57		797.71
	09/21/05	18.95		788.33
	12/14/05	9.94		797.34
03/21/06	8.53		798.75	
06/28/06	11.23		796.05	
09/20/06	12.81		794.47	
12/20/06	24.46		782.82	
03/13/07	12.11		795.17	
07/03/07	13.04		794.24	
MW-105	02/01/97	-		793.74
	05/01/97	-		800.60
	09/01/97	-		800.37
	12/01/97	-	803.96	799.03
	03/01/98	-		800.08
	06/01/98	-		800.50
	10/27/98	5.41		798.55
	02/08/99	6.46		797.50
	06/08/99	3.04		800.92

Table #4

GROUNDWATER ELEVATIONS
N.W. Mauthe Superfund Site - Appleton, Wisconsin
MCO No. M0050-930746.26

Well Name	Date Measured	Depth To Water (feet)	Reference Elevation (To Top PVC) (feet)	Groundwater Elevation (feet)
MW-105 (continued)	09/13/99	4.60		799.36
	12/15/99	5.28		798.68
	03/13/00	4.97		798.99
	06/22/00	3.06		800.90
	09/27/00	3.38		800.58
	12/19/00	5.28		798.68
	03/01/01	7.24		796.72
	06/19/01	2.43		801.53
	09/24/01	3.87		800.09
	12/05/01	5.55		798.41
	03/19/02	3.94		800.02
	06/20/02	4.08		799.88
	09/18/02	5.40		798.56
	12/17/02	7.34		796.62
	03/24/03	6.81		797.15
	06/10/03	4.27		799.69
	09/10/03	4.88	803.84 ***	798.96
	12/10/03	4.36		799.24
	03/23/04	3.80		800.04
	07/09/04	3.61	803.74 ****	800.13
	09/21/04	4.92		798.82
	03/29/05	3.85		799.89
	06/20/05	4.15		799.59
	09/21/05	4.70		799.04
	12/14/05	5.25		798.49
	03/21/06	4.26		799.48
	06/28/06	4.81	803.54 *****	798.73
	09/20/06	4.51		799.03
	12/19/06	5.40		798.14
	03/13/07	6.46	803.46*****	797.08
	07/03/07	4.30		799.16
MW-106	02/01/97	-		794.75
	05/01/97	-		797.23
	09/01/97	-		796.91
	12/01/97	-	804.08	795.48
	03/01/98	-		797.37
	06/01/98	-		796.76
	10/27/98	8.12		795.96
	02/08/99	9.75		794.33
	06/08/99	6.72		797.36
	09/13/99	7.88		796.20
	12/15/99	8.71		795.37
	03/13/00	8.72		795.36
	06/22/00	6.87		797.21
	09/27/00	7.41		796.67
	12/19/00	8.55		795.53
	03/01/01	9.54		794.54
	06/19/01	6.30		797.78
	09/24/01	7.57		796.51
	12/05/01	8.72		795.36
	03/19/02	7.64		796.44
	06/20/02	7.21		796.87
	09/18/02	7.88		796.20
	12/17/02	10.49		793.59
	03/24/03	9.98		794.10
	06/10/03	7.54		796.54
	09/10/03	7.35	804.00 ***	796.65
	12/10/03	7.18		796.82
	03/23/04	7.54		796.46
	07/09/04	6.48	803.90 ****	797.42
	09/21/04	8.02		795.88
	03/29/05	8.26		795.64
	06/20/05	7.31		796.59
	09/21/05	7.85		796.05
	12/14/05	8.47		795.43
	03/21/06	7.41		796.49
	06/28/06	7.78	803.83 *****	796.05
	09/20/06	7.90		795.93
	12/19/06	8.39		795.44
	03/13/07	9.08		794.75
	07/03/07	7.35		796.48

Table #4

GROUNDWATER ELEVATIONS
N.W. Mauthe Superfund Site - Appleton, Wisconsin
MCO No. M0050-930746.26

Well Name	Date Measured	Depth To Water (feet)	Reference Elevation (To Top PVC) (feet)	Groundwater Elevation (feet)
MW-107	02/01/97	-		788.23
	05/01/97	-		796.60
	09/01/97	-		797.64
	12/01/97	-	809.01	796.49
	03/01/98	-		796.68
	06/01/98	-		796.31
	10/27/98	10.71		798.30
	02/08/99	11.11		797.90
	06/08/99	11.04		797.97
	09/13/99	11.55		797.46
	12/15/99	11.66		797.35
	03/13/00	11.13		797.88
	06/22/00	10.69		798.32
	09/27/00	12.36		796.65
	12/19/00	7.32		799.29
	03/01/01 *	-		-
	06/19/01	10.10	809.06 **	798.96
	09/24/01	11.23		797.88
	12/05/01	11.59		797.47
	03/19/02	9.79		799.27
	06/20/02	10.18		798.88
	09/18/02	11.16		797.90
	12/17/02	12.11		796.95
	03/24/03	12.46		796.60
	06/10/03	10.40		798.66
	09/10/03	11.34		797.72
	12/10/03	10.88		798.18
03/23/04	9.04		800.02	
07/09/04	11.53		797.53	
09/21/04	12.55		796.51	
03/29/05	10.48		798.58	
06/20/05	11.14		797.92	
09/21/05	11.69		797.37	
12/14/05	11.10		797.96	
03/21/06	10.09		798.97	
06/28/06	11.69		797.37	
09/20/06	12.14		796.92	
12/19/06	11.45		797.61	
03/13/07	10.95		798.11	
07/03/07	11.34		797.72	
MW-108	02/01/97	-		798.36
	05/01/97	-		793.32
	09/01/97	-		790.53
	12/01/97	-	806.61	788.65
	03/01/98	-		795.59
	06/01/98	-		789.30
	10/27/98	6.98		799.63
	02/08/99	6.72		799.89
	06/08/99	5.80		800.81
	09/13/99	6.68		799.93
	12/15/99	6.87		799.74
	03/13/00	6.84		799.77
	06/22/00	6.28		800.33
	09/27/00	6.31		800.30
	12/19/00	11.42		797.59
	03/01/01	7.04		799.57
	06/19/01	5.87		800.74
	09/24/01	6.52		800.09
	12/05/01	7.70		798.91
	03/19/02	6.25		800.36
	06/20/02	6.43		800.18
	09/18/02	6.72		799.89
	12/17/02	7.78		798.83
	03/24/03	8.69		797.96
	06/10/03	7.00		799.61
	09/10/03	6.91		799.70
	12/10/03	5.18		801.43
03/23/04	6.24		800.37	
07/09/04	6.12		800.49	
09/21/04	6.91		799.70	
03/29/05	6.64		799.97	
06/20/05	6.78		799.83	

Table #4

GROUNDWATER ELEVATIONS
N.W. Mauthe Superfund Site - Appleton, Wisconsin
MCO No. M0050-930746.26

Well Name	Date Measured	Depth To Water (feet)	Reference Elevation (To Top PVC) (feet)	Groundwater Elevation (feet)
MW-108 (continued)	09/21/05	6.66		799.95
	12/14/05	6.68		799.93
	03/21/06	6.71		799.90
	06/28/06	6.82		799.79
	09/20/06	6.75		799.86
	12/19/06	6.90		799.71
	03/13/07	6.75		799.86
	07/03/07	7.53		799.08
MW-109	06/21/06	8.98	810.52	801.54
	09/20/06	8.90		801.62
	12/19/06	9.68		800.84
	03/13/07	9.32		801.20
	07/03/07	9.11		801.41
MW-110	06/21/06	10.39	809.81	799.42
	09/20/06	11.09		798.72
	12/19/06	11.06		798.75
	03/13/07	11.04		798.77
	07/03/07	10.60		799.21
MW-111	06/21/06	10.69	807.59	796.90
	09/20/06	13.45		794.14
	12/19/06	14.97		792.62
	03/13/07	9.63		797.96
	07/03/07	9.00		798.59
MW-112	06/21/06	15.70	808.14	792.44
	09/20/06	10.75		797.39
	12/19/06	11.93		796.21
	03/13/07	10.23		797.91
	07/03/07	8.91		799.23
MW-113	06/21/06	9.69	808.24	798.55
	09/20/06	10.27		797.97
	12/19/06	10.03		798.21
	03/13/07	8.93		799.31
	07/03/07	9.75		798.49
PZ-05	07/19/05	37.39	810.88	773.49
	09/21/05	28.56		782.32
	12/19/06	27.98		782.90
	03/13/07	28.61		782.27
	07/03/07	28.00		782.88
PZ-06	07/19/05	36.31	809.77	773.46
	09/21/05	29.79		779.98
	12/19/06	29.49		780.28
	03/13/07	29.93		779.84
	07/03/07	30.03		779.74
PZ-07	07/19/05	32.03	804.48	772.45
	09/21/05	27.34		777.14
	12/19/06	29.37		775.11
	03/13/07	24.41		780.07
	07/03/07	23.74		780.74
PZ-08	07/19/05	32.07	804.35	772.28
	09/21/05	24.47		779.88
	12/19/06	28.16		776.19
	03/13/07	21.90		782.45
	07/03/07	23.19		781.16

* Casing for MW-107 was damaged. Groundwater elevation could not be determined.

** Reflects new elevation of MW-107 after repair to well casing.

*** Monitoring wells re-surveyed after casings were shortened.

**** New elevation after the PVC casing was shortened after the March 23, 2004 sampling event.

***** New elevation after the PVC casing was shortened after the March 21, 2006 sampling event.

***** New elevation after PVC casing was shortened after the December 19, 2006 sampling event.

Note: Omni Associates, Inc. collected water level readings from MW-109 to MW-113 on June 21, 2006 and from PZ-5 to PZ-8 on July 19, 2005 and September 21, 2005.

Table #5

GROUNDWATER GEOCHEMICAL PARAMETERS

N.W. Mauthe Superfund Site - Appleton, Wisconsin

MCO No. M0050-930746.26

Well Name	Sample Date	Purge* Volume (gallons)	pH (units)	Temperature (degree C)	Conductivity (units as shown)	Dissolved Oxygen (ppm)	Redox (mV)	Alkalinity (gpg)	Ferrous Iron (mg/l)
W-2	02/20/97	NR	8.00	6.00	750 us	NA	NA	NA	NA
	05/27/97	NR	7.74	10.10	NA	NA	NA	NA	NA
	09/18/97	NR	7.01	14.50	910 us	NA	NA	NA	NA
	12/12/97	NR	7.33	9.50	820 us	NA	NA	NA	NA
	03/25/98	NR	7.96	7.90	1235 us	NA	NA	NA	NA
	06/10/98	NR	6.59	10.20	1057 us	NA	NA	NA	NA
	10/27/98	4.00	7.93	14.80	1278 us	1.40	119.00	12.00	0.00
	02/09/99	4.00	8.47	9.50	1278 us	2.10	146.00	16.00	0.20
	06/08/99	4.00	7.20	14.60	1234 us	1.00	85.00	11.20	1.00
	09/13/99	5.10	7.34	15.00	1254 us	1.90	(136.00)	9.60	0.00
	12/15/99	4.80	7.77	11.80	1199 us	1.50	(231.00)	4.80	0.00
	03/13/00	7.00	6.17	8.90	1278 us	1.30	59.00	7.60	0.00
	06/22/00	4.40	7.86	12.10	1240 us	1.50	59.00	7.60	0.00
	09/27/00	6.60	6.39	16.40	1140 us	1.90	(187.00)	9.60	0.00
	12/19/00	5.00	7.66	9.50	1171 us	1.85	(161.00)	11.20	0.00
	03/01/01	3.50	7.42	10.50	1084 us	1.41	(222.00)	9.20	0.00
	06/19/01	7.00	7.81	15.60	1980 us	1.10	(18.00)	8.40	0.00
	09/24/01	5.00	7.48	13.40	1712 us	0.90	(38.00)	6.60	0.00
	12/05/01	5.00	7.51	10.20	1244 us	1.10	(71.00)	9.60	0.00
	03/19/02	6.00	7.51	10.60	977 us	1.10	(210.00)	13.20	0.00
	06/20/02	6.00	7.40	15.00	1870 us	0.80	(88.00)	8.80	0.00
	09/18/02	5.00	7.18	14.80	1138 us	1.00	(99.00)	10.40	0.00
	12/17/02	4.00	7.34	10.30	1187 us	1.00	(103.00)	9.60	0.00
	03/24/03	4.00	7.30	10.30	1077 us	1.00	(310.00)	10.00	0.00
	06/10/03	6.00	7.21	14.90	1620 us	1.00	(110.00)	12.80	0.00
	09/10/03	4.00	7.09	14.60	1210 us	0.80	(111.00)	8.80	0.00
	03/24/04	4.50	7.30	7.40	1210 us	EM	6.00	NA	0.00
	03/29/05	4.50	7.20	6.30	1182 us	3.40	85.00	NA	0.00
	03/23/06	7.00	6.60	10.50	2470 us	2.65	191.00	NA	0.03
	03/27/07	4.0	7.4	9.0	1240 us	8.0	243	NA	0.04
W-8	02/20/97	NR	8.20	7.50	1000 us	NA	NA	NA	NA
	05/27/97	NR	7.30	10.40	NA	NA	NA	NA	NA
	09/18/97	NR	7.07	17.00	1250 us	NA	NA	NA	NA
	12/12/97	NR	7.32	11.20	1090 us	NA	NA	NA	NA
	03/25/98	NR	7.34	7.90	1590 us	NA	NA	NA	NA
	06/10/98	NR	6.95	11.50	1407 us	NA	NA	NA	NA
	10/27/98	5.00	7.42	16.70	1459 us	1.30	97.00	14.40	0.20
	02/09/99	3.90	8.08	11.20	1386 us	1.30	21.00	8.00	2.40
	06/08/99	5.50	7.23	14.80	1283 us	1.80	85.00	14.00	5.60
	09/13/99	5.20	7.12	16.30	1363 us	1.70	(143.00)	14.40	1.60
	12/15/99	5.10	7.25	10.30	1375 us	0.90	(288.00)	14.40	1.20
	03/13/00	5.00	7.06	8.80	1277 us	1.10	(33.00)	8.40	1.00
	06/22/00	4.80	8.58	14.60	1177 us	1.97	(120.00)	6.80	0.00
	09/27/00	6.00	7.60	18.10	1098 us	1.50	(178.00)	10.00	0.00
	12/19/00	4.00	7.67	8.30	1227 us	1.14	(267.00)	11.60	0.00
	03/01/01	5.00	7.51	11.10	1175 us	1.20	(311.00)	11.20	0.00
	06/19/01	6.00	7.93	14.80	1310 us	0.80	(24.00)	6.20	0.00
	09/24/01	6.00	7.37	13.10	1177 us	0.40	4.00	6.40	0.00
	12/05/01	5.00	7.30	10.40	1288 us	1.00	(163.00)	12.40	0.00
	03/19/02	6.00	7.44	10.90	1044 us	1.30	(280.00)	11.20	0.00
	06/20/02	6.00	7.51	14.20	1240 us	0.80	(90.00)	6.20	0.00
	09/18/02	5.00	7.31	15.60	1221 us	1.30	(104.00)	14.60	1.00
	12/17/03	3.00	7.28	10.60	1,155	1.10	(172.00)	12.40	0.40
	03/24/03	5.00	7.18	10.60	1131 us	0.80	(342.00)	11.20	0.00
	06/10/03	4.00	7.30	15.00	1133 us	0.80	(121.00)	8.80	0.00
	09/10/03	5.00	7.22	15.00	1240 us	1.00	(175.00)	11.60	0.80
	03/24/04	4.30	7.40	7.80	755 us	EM	(47.00)	NA	0.00
	03/29/05	4.00	7.10	7.80	1743 us	3.43	87.00	NA	0.00
	03/23/06	4.00	7.20	8.30	2560 us	4.00	227.00	NA	0.00
	03/27/07	3.0	7.3	10.3	1438 us	6.71	237	NA	0.03

Table #5

GROUNDWATER GEOCHEMICAL PARAMETERS
 N.W. Mauthe Superfund Site - Appleton, Wisconsin
 MCO No. M0050-930746.26

Well Name	Sample Date	Purge* Volume (gallons)	pH (units)	Temperature (degree C)	Conductivity (units as shown)	Dissolved Oxygen (ppm)	Redox (mV)	Alkalinity (gpg)	Ferrous Iron (mg/l)
W-15	02/20/97	NR	8.15	9.00	920 us	NA	NA	NA	NA
	05/27/97	NR	7.66	10.00	NA	NA	NA	NA	NA
	09/18/97	NR	7.22	16.00	1300 us	NA	NA	NA	NA
	12/12/97	NR	7.18	10.40	1180 us	NA	NA	NA	NA
	03/25/98	NR	7.70	8.40	1450 us	NA	NA	NA	NA
	06/10/98	NR	6.46	11.60	1496 us	NA	NA	NA	NA
	10/27/98	4.00	7.27	16.00	1551 us	0.80	137.00	14.40	0.00
	02/09/99	2.60	8.07	10.00	1418 us	1.30	7.00	12.00	0.60
	06/08/99	4.50	7.54	16.70	1465 us	1.50	75.00	12.00	1.40
	09/13/99	3.60	7.18	17.60	1647 us	1.90	(137.00)	10.40	0.80
	12/15/99	3.30	7.52	11.70	1544 us	1.50	(281.00)	12.40	1.00
	03/13/00	4.00	7.14	8.90	1266 us	1.40	(19.00)	7.60	0.40
	06/22/00	3.00	8.22	14.90	1546 us	1.63	36.00	7.30	0.00
	09/27/00	5.00	5.43	17.40	1711 us	1.30	(41.00)	12.40	0.00
	12/19/00	3.00	7.55	8.90	1628 us	3.23	(305.00)	15.20	1.60
	03/01/01	4.00	7.43	10.90	1435 us	2.10	(381.00)	16.00	0.80
	06/19/01	5.00	8.18	14.80	1380 us	1.40	(64.00)	6.00	0.00
	09/24/01	5.00	7.22	12.60	1160 us	1.00	(49.00)	8.00	0.00
	12/05/01	3.00	7.28	9.90	1544 us	2.00	(280.00)	12.80	1.20
	03/19/02	5.00	7.58	10.30	1284 us	1.80	(318.00)	12.20	0.40
	06/20/02	5.00	8.00	14.60	1280 us	1.00	(180.00)	12.40	0.00
	09/18/02	5.00	7.20	16.30	1399 us	1.60	(152.00)	13.60	0.40
	12/17/02	3.00	7.18	10.00	1234 US	2.00	(220.00)	8.80	1.00
	03/24/03	3.00	7.22	10.60	1294 us	1.40	(330.00)	12.40	0.20
	06/10/03	5.00	7.76	14.80	1148 us	1.20	(174.00)	11.20	0.00
	09/10/03	5.00	7.18	15.40	1317 us	1.20	(170.00)	10.40	0.60
	03/24/04	3.70	7.30	8.40	1516 us	EM	(32.00)	NA	0.00
	03/29/05	3.00	7.00	8.20	2240 us	3.81	85.00	NA	0.00
	03/23/06	4.00	7.00	7.50	1952 us	4.40	236.00	NA	0.00
	03/28/07	3.0	7.3	9.0	1420 us	3.28	213	NA	0.01
MW-101	02/20/97	NR	7.12	8.00	1400 us	NA	NA	NA	NA
	05/27/97	NR	7.56	12.90	NA	NA	NA	NA	NA
	09/18/97	NR	6.54	14.00	1380 us	NA	NA	NA	NA
	12/12/97	NR	6.64	11.40	1390 us	NA	NA	NA	NA
	03/25/98	NR	7.58	10.50	2142 us	NA	NA	NA	NA
	06/10/98	NR	6.29	11.50	2116 us	NA	NA	NA	NA
	10/27/98	9.00	7.13	14.10	2.27 ms	0.50	116.00	12.00	0.00
	02/09/99	7.00	8.11	12.70	2.11 ms	1.10	165.00	8.80	0.20
	06/08/99	6.00	7.05	15.00	2.17 ms	0.70	161.00	8.00	0.20
	09/13/99	5.90	7.25	14.90	2.12 ms	0.90	(125.00)	13.60	0.00
	12/15/99	6.00	8.71	12.70	2.06 ms	1.00	(262.00)	8.80	0.00
	03/13/00	7.00	6.34	11.60	1939 us	1.10	44.00	8.00	0.00
	06/22/00	5.00	7.73	15.20	2.25 ms	0.96	50.00	8.00	0.00
	09/27/00	8.50	6.80	15.50	2.18 ms	0.70	3.00	12.80	0.00
	12/19/00	10.50	7.12	11.90	2.18 ms	1.48	(233.00)	14.40	0.00
	03/01/01	8.00	7.41	11.00	2.31 ms	1.32	(283.00)	12.20	0.00
	06/19/01	9.00	8.04	13.60	1265 us	1.00	10.00	7.20	0.00
	09/24/01	8.00	7.79	13.40	1304 us	1.00	(11.00)	11.20	0.00
	12/05/01	9.00	7.40	11.20	2240 us	1.20	(304.00)	8.40	0.00
	03/19/02	9.00	7.36	10.80	1984 us	1.40	(210.00)	12.20	0.00
	06/20/02	10.00	7.93	13.80	1190 us	0.80	(30.00)	14.00	0.00
	09/18/02	10.00	7.24	15.00	2248 us	0.80	(113.00)	8.80	0.00
	12/17/02	8.00	7.27	11.40	1988 us	1.60	(334.00)	8.40	0.00
	03/24/03	9.00	7.45	11.10	1033 us	0.60	(190.00)	11.20	0.00
	06/10/03	10.00	7.66	14.00	1121 us	1.00	(61.00)	13.20	0.00
	09/10/03	8.00	7.30	14.80	2104 us	0.80	(124.00)	7.20	0.00
	03/24/04	6.70	6.90	10.10	3160 us	EM	(69.00)	NA	0.00
	03/29/05	6.00	6.60	12.12	4730 us	1.27	83.00	NA	0.00
	03/23/06	7.00	6.60	10.50	2470 us	2.65	191.00	NA	0.03
	03/27/07	5	6.70	13.3	2440 us	3.64	187	NA	0.00

Table #5

GROUNDWATER GEOCHEMICAL PARAMETERS

N.W. Mauthe Superfund Site - Appleton, Wisconsin

MCO No. M0050-930746.26

Well Name	Sample Date	Purge* Volume (gallons)	pH (units)	Temperature (degree C)	Conductivity (units as shown)	Dissolved Oxygen (ppm)	Redox (mV)	Alkalinity (gpg)	Ferrous Iron (mg/l)
MW-102	02/20/97	NR	8.00	10.50	700 us	NA	NA	NA	NA
	05/27/97	NR	7.47	10.50	NA	NA	NA	NA	NA
	09/18/97	NR	6.99	13.00	810 us	NA	NA	NA	NA
	12/12/97	NR	7.23	8.50	690 us	NA	NA	NA	NA
	03/25/98	NR	7.68	10.20	1145 us	NA	NA	NA	NA
	06/10/98	NR	6.97	10.30	1046 us	NA	NA	NA	NA
	10/27/98	2.00	8.07	13.00	1197 us	1.50	103.00	17.60	0.40
	02/09/99	0.50	7.48	11.00	1164 us	1.00	0.33	14.40	0.00
	06/08/99	0.50	7.89	18.60	1226 us	1.00	151.00	4.80	0.80
	09/13/99	0.50	7.84	13.30	1208 us	1.20	(246.00)	10.00	1.20
	12/15/99	0.50	7.78	9.00	1152 us	1.60	(288.00)	10.80	1.00
	03/13/00	0.50	6.74	9.70	1096 us	1.20	(260.00)	6.80	0.00
	06/22/00	0.50	8.01	12.30	1233 us	0.53	(13.00)	6.00	0.00
	09/27/00	0.50	8.25	12.50	1182 us	1.90	(241.00)	9.20	0.00
	12/19/00	0.50	7.59	8.70	1126 us	1.27	(454.00)	11.60	0.00
	03/01/01	0.50	7.30	10.90	1321 us	1.02	(521.00)	9.20	0.00
	06/19/01	0.50	8.64	13.20	1944 us	0.60	35.00	6.40	0.00
	09/24/01	0.50	7.63	13.40	1622 us	0.80	18.00	7.20	0.00
	12/05/01	0.50	7.59	9.40	1233 us	0.80	(110.00)	12.40	0.00
	03/19/02	0.50	7.41	10.80	1143 us	0.90	(503.00)	9.20	0.50
	06/20/02	0.50	8.18	13.80	1720 us	0.40	4.00	9.60	0.00
	09/18/02	0.50	7.04	13.50	1318 us	1.00	(212.00)	10.80	1.00
	12/17/02	0.50	7.55	10.00	1186 us	0.60	(94.00)	11.20	0.00
	03/24/03	0.50	7.38	10.40	972 us	0.40	(621.00)	8.40	0.00
	06/10/03	0.50	8.01	13.80	1530 us	0.40	(18.00)	8.60	0.00
	09/10/03	0.50	7.10	14.00	1313 us	0.80	(211.00)	8.00	0.80
	03/24/04	2.70	7.20	12.80	1112 us	EM	(26.00)	NA	0.00
	03/29/05	3.00	7.10	12.70	1199 us	2.71	85.00	NA	0.00
	03/23/06	2.00	7.50	9.20	1234 us	5.06	283.00	NA	0.00
	03/27/07	2.0	7.2	12.5	1093 us	1.73	86	NA	0.29
MW-103	02/20/97	NR	6.30	6.00	700 us	NA	NA	NA	NA
	05/27/97	NR	7.67	11.60	NA	NA	NA	NA	NA
	09/18/97	NR	7.21	10.50	1030 us	NA	NA	NA	NA
	12/12/97	NR	7.43	9.00	970 us	NA	NA	NA	NA
	03/25/98	NR	7.82	9.40	1441 us	NA	NA	NA	NA
	06/10/98	NR	6.24	9.90	1356 us	NA	NA	NA	NA
	10/27/98	8.00	7.66	12.70	1566 us	0.70	147.00	12.00	0.20
	02/09/99	7.80	7.48	9.90	1443 us	1.40	53.00	11.20	0.80
	06/08/99	9.50	7.42	13.90	1350 us	0.70	109.00	7.20	0.00
	09/13/99	4.10	7.41	12.90	985 us	1.60	(165.00)	12.00	0.00
	12/15/99	4.60	7.82	10.60	2.58 ms	1.40	(294.00)	10.80	0.00
	03/13/00	4.00	6.57	9.40	1292 us	1.00	76.00	8.40	0.40
	06/22/00	4.00	8.43	11.50	1354 us	0.99	(90.00)	6.00	0.00
	09/27/00	11.00	7.48	13.70	1131 us	1.40	(302.00)	7.60	0.00
	12/19/00	9.00	7.90	6.60	1063 us	1.56	(344.00)	9.20	0.40
	03/01/01	8.50	7.68	11.20	1160 us	1.88	(374.00)	8.00	0.60
	06/19/01	13.00	7.81	14.10	1848 us	1.10	(28.00)	7.40	0.00
	09/24/01	2.00	7.32	12.70	1743 us	1.00	(47.00)	12.00	0.00
	12/05/01	11.00	7.18	9.00	1121 us	1.40	(291.00)	10.80	0.60
	03/19/02	11.00	7.60	11.40	1050 us	1.50	(311.00)	10.00	0.40
	06/20/02	12.00	7.47	14.40	1830 us	0.80	(62.00)	10.80	0.00
	09/18/02	10.00	7.18	13.00	748 us	1.40	(170.00)	11.20	0.00
	12/17/02	8.00	7.22	9.60	1134 us	1.20	(284.00)	10.00	0.40
	03/24/03	11.00	7.54	11.00	1262 us	1.20	(320.00)	10.00	0.60
	06/10/03	10.00	7.13	14.10	1644 us	0.60	(80.00)	10.00	0.20
	09/10/03	10.00	7.14	13.20	920 us	1.00	(165.00)	10.40	0.00
	12/10/03	10.00	7.28	10.40	1210 us	0.80	(310.00)	7.80	0.20
	03/24/04	8.60	7.30	10.20	656 us	EM	(126.00)	NA	0.00
	07/09/04	5.00	7.20	14.00	996 us	16.30	283.00	NA	0.00
	09/21/04	1.50	7.10	20.10	1004 us	EM	(19.00)	NA	0.00
	03/29/05	12.00	7.00	10.20	1164 us	1.16	84.00	NA	0.00
	06/21/05	7.00	7.10	13.30	1253 us	1.46	142.00	NA	0.00
	09/21/05	10.00	7.30	13.50	1233 us	3.40	225.00	NA	0.00
	12/14/05	7.00	7.20	9.90	1295 us	1.53	NA	NA	0.00

Table #5

GROUNDWATER GEOCHEMICAL PARAMETERS
 N.W. Mauthe Superfund Site - Appleton, Wisconsin
 MCO No. M0050-930746.26

Well Name	Sample Date	Purge* Volume (gallons)	pH (units)	Temperature (degree C)	Conductivity (units as shown)	Dissolved Oxygen (ppm)	Redox (mV)	Alkalinity (gpg)	Ferrous Iron (mg/l)
MW-103 (cont.)	03/23/06	7.00	7.00	11.50	1140 us	230.00	252.00	NA	0.00
	06/28/06	5.00	7.10	11.80	746 us	2.75	232.00	NA	0.00
	12/20/06	8.00	7.40	10.80	1207 us	2.89	241.00	NA	0.23
	03/28/07	8.0	7.2	10.8	1075 us	3.09	238.0	NA	0.05
	07/03/07	8.0	7.4	11.3	1154 us	3.54	126.0	NA	0.38
MW-104	02/20/97	NR	7.43	8.00	1000 us	NA	NA	NA	NA
	05/27/97	NR	8.00	12.00	NA	NA	NA	NA	NA
	09/18/97	NR	7.13	10.50	1030 us	NA	NA	NA	NA
	12/12/97	NR	7.10	9.60	1000 us	NA	NA	NA	NA
	03/25/98	NR	7.94	8.30	1378 us	NA	NA	NA	NA
	06/10/98	NR	6.53	9.70	1101 us	NA	NA	NA	NA
	10/27/98	8.00	7.84	13.20	1272 us	0.90	103.00	16.40	0.40
	02/09/99	9.50	7.66	10.10	1126 us	1.50	193.00	11.20	0.00
	06/08/99	13.00	6.80	15.60	1259 us	1.60	103.00	6.40	0.00
	09/13/99	13.80	7.08	13.90	1334 us	1.80	(146.00)	10.80	0.00
	12/15/99	11.20	7.68	10.80	1172 us	2.00	(232.00)	11.20	0.00
	03/13/00	16.50	6.91	10.20	1121 us	0.40	69.00	11.20	0.60
	06/22/00	11.00	8.65	11.60	1137 us	0.71	(211.00)	6.80	0.00
	09/27/00	8.00	7.24	12.90	1130 us	1.70	(123.00)	13.20	0.00
	12/19/00	8.00	7.75	8.20	1144 us	1.05	(240.00)	12.40	0.00
	03/01/01	9.50	7.72	10.60	1230 us	0.90	(220.00)	12.40	0.20
	06/19/01	13.00	7.91	12.90	1581 us	0.80	(110.00)	6.80	0.00
	09/24/01	8.00	7.18	12.40	1580 us	0.80	(99.00)	9.60	0.20
	12/05/01	7.00	7.22	9.90	1300 us	1.00	(311.00)	9.60	0.00
	03/19/02	10.00	7.70	10.60	1110 us	0.70	(210.00)	11.60	0.20
	06/20/02	10.00	7.53	13.00	1420 us	0.80	(174.00)	12.40	0.20
	09/18/02	9.00	7.03	14.60	1275 us	1.60	(148.00)	12.40	0.00
	12/17/02	8.00	7.31	10.00	1264 us	0.80	(294.00)	8.80	0.00
	03/24/03	8.00	7.61	10.40	1031 us	0.80	(240.00)	10.80	0.00
	06/10/03	10.00	7.40	15.00	1374 us	0.60	(91.00)	11.20	0.40
	09/10/03	9.00	7.08	14.20	1144 us	1.20	(151.00)	8.80	0.00
	12/01/03	8.00	7.35	10.10	1177 us	0.80	(280.00)	8.80	0.00
	03/24/04	13.60	7.30	9.90	1496 us	EM	(91.00)	NA	0.00
	07/09/04	5.00	7.00	12.00	1648 us	2.90	EM	NA	0.00
	09/21/04	1.00	7.00	13.10	1648 us	EM	1.00	NA	0.00
	03/29/05	6.00	7.00	10.20	1939 us	2.69	86.00	NA	0.00
	06/21/05	7.00	7.10	12.50	1999 us	3.50	125.00	NA	0.00
	09/21/05	7.00	7.10	13.80	1926 us	2.78	213.00	NA	0.00
	12/14/05	7.00	6.90	10.90	2320 us	2.11	253.00	NA	NA **
	03/23/06	10.00	6.90	10.60	2250 us	1.73	209.00	NA	0.00
	06/28/06	5.00	6.80	11.30	2290 us	1.40	215.00	NA	0.26
	12/20/06	8.00	7.10	11.90	2120 us	2.08	248.00	NA	0.00
	03/28/07	8.0	6.9	10.1	2450 us	3.80	226.0	NA	0.07
	07/03/07	6.0	7.1	11.5	2180 us	1.51	247.0	NA	0.61
MW-105	02/20/97	NR	7.70	7.00	1600 us	NA	NA	NA	NA
	05/27/97	NR	7.44	10.50	NA	NA	NA	NA	NA
	09/18/98	NR	6.89	16.00	2150 us	NA	NA	NA	NA
	12/12/97	NR	7.04	12.00	2050 us	NA	NA	NA	NA
	03/25/98	NR	7.35	6.70	2878 us	NA	NA	NA	NA
	06/10/98	NR	6.25	11.10	2695 us	NA	NA	NA	NA
	10/27/98	5.00	7.57	16.80	2.87 ms	0.10	121.00	13.60	0.00
	02/09/99	5.90	7.34	10.60	2.76 ms	0.90	281.00	16.80	1.80
	06/08/99	5.00	7.32	17.80	2.87 ms	0.70	90.00	9.60	0.20
	09/13/99	3.50	7.00	17.20	2.74 ms	1.70	(182.00)	13.20	1.40
	12/15/99	3.60	7.36	13.00	2.62 ms	1.60	(255.00)	8.80	1.20
	03/13/00	4.50	6.58	8.40	2430 us	1.30	23.00	9.60	0.80
	06/22/00	3.20	8.44	14.30	2.71 ms	0.88	(304.00)	6.40	0.00
	09/27/00	6.00	6.62	17.90	2.53 ms	1.10	(198.00)	12.80	0.00
	12/19/00	6.00	7.42	9.60	2.32 ms	2.27	(167.00)	12.40	0.00
	03/01/01	5.00	7.24	10.80	2.45 ms	1.89	(184.00)	11.60	0.00
	06/19/01	7.00	8.19	12.80	1877 us	0.60	(200.00)	6.80	0.00
	09/24/01	6.00	7.41	13.80	1809 us	0.80	(183.00)	7.20	0.00
	12/05/01	6.00	7.34	10.00	2148 us	1.80	(188.00)	11.20	0.20
	03/19/02	5.00	6.94	10.20	1984 us	1.80	(169.00)	9.60	0.00
	06/20/02	6.00	8.04	13.00	1400 us	1.00	(310.00)	10.80	0.00
	09/18/02	6.00	7.21	17.20	2800 us	1.60	(183.00)	10.80	1.60

Table #5

GROUNDWATER GEOCHEMICAL PARAMETERS
 N.W. Mauthe Supefund Site - Appleton, Wisconsin
 MCO No. M0050-930746.26

Well Name	Sample Date	Purge* Volume (gallons)	pH (units)	Temperature (degree C)	Conductivity (units as shown)	Dissolved Oxygen (ppm)	Redox (mV)	Alkalinity (gpg)	Ferrous Iron (mg/l)
MW-105 (cont.)	12/17/02	5.00	7.08	10.40	2008 us	1.40	(194.00)	13.20	0.40
	03/24/03	5.00	7.04	10.60	1477 us	1.40	(99.00)	14.00	0.00
	06/10/03	6.00	7.81	14.80	1344 us	1.20	(280.00)	8.60	0.00
	09/10/03	6.00	7.30	16.40	2626 us	1.20	(177.00)	10.00	1.20
	03/24/04	4.90	6.80	5.90	2220 us	EM	(78.00)	NA	0.00
	03/29/05	4.00	6.80	8.90	2300 us	2.12	87.00	NA	0.00
	03/23/06	4.00	6.90	8.60	2170 us	3.54	256.00	NA	0.22
	03/27/07	4.0	6.8	9.2	2180 us	3.37	296	NA	0.08
MW-106	02/20/97	NR	7.75	10.00	1000 us	NA	NA	NA	NA
	05/27/97	NR	7.47	10.10	NA	NA	NA	NA	NA
	09/18/97	NR	7.19	15.00	1310 us	NA	NA	NA	NA
	12/12/97	NR	7.06	11.50	1260 us	NA	NA	NA	NA
	03/25/98	NR	7.61	8.70	1716 us	NA	NA	NA	NA
	06/10/98	NR	7.11	11.60	1604 us	NA	NA	NA	NA
	10/27/98	4.00	7.31	16.80	1824 us	1.20	138.00	12.80	0.00
	02/09/99	2.50	7.33	10.20	1605 us	1.10	197.00	20.80	0.00
	06/08/99	3.50	7.15	15.40	1332 us	0.70	17.00	6.40	0.20
	09/13/99	2.30	7.02	17.40	1357 us	1.00	(168.00)	11.60	0.00
	12/15/99	2.00	8.41	12.10	1445 us	0.80	(266.00)	10.00	0.00
	03/13/00	2.50	6.92	9.10	1513 us	1.60	18.00	10.40	0.00
	06/22/00	1.50	8.18	14.50	1736 us	2.02	38.00	7.20	0.00
	09/27/00	6.00	6.84	19.10	1715 us	1.60	(8.00)	12.00	0.00
	12/19/00	4.00	7.48	10.70	1694 us	1.43	(218.00)	10.80	0.00
	03/01/01	4.00	7.33	10.80	1722 us	1.50	(210.00)	9.20	0.00
	06/19/01	4.00	8.28	13.00	1361 us	1.10	(210.00)	6.40	0.00
	09/24/01	6.00	7.66	14.00	1220 us	0.80	(104.00)	11.20	0.00
	12/05/01	4.00	7.60	10.40	1702 us	0.90	(217.00)	12.80	0.00
	03/19/02	5.00	7.13	10.40	1630 us	1.70	(235.00)	9.20	0.00
	06/20/02	5.00	8.08	12.80	1288 us	1.20	(240.00)	8.80	0.00
	09/18/02	5.00	7.30	17.80	1438 us	1.00	(141.00)	8.80	0.00
	12/17/02	3.00	7.15	10.20	1788 us	0.80	(220.00)	11.20	0.00
	03/24/03	3.00	7.22	10.80	1250 us	1.10	(193.00)	10.00	0.00
	06/10/03	5.00	7.84	13.80	1310 us	1.20	(230.00)	10.20	0.00
	09/10/03	5.00	7.24	16.60	1303 us	0.80	(140.00)	12.00	0.00
	03/24/04	1.80	7.10	8.00	1761 us	EM	(57.00)	NA	0.00
	03/29/05	2.50	6.90	9.00	1995 us	2.24	85.00	NA	0.00
	03/23/06	4.00	7.00	9.40	2160 us	4.14	249.00	NA	0.00
	03/27/07	2.00	7.0	8.5	1887 us	5.04	249	NA	0.00
MW-107	02/20/97	NR	7.46	9.00	650 us	NA	NA	NA	NA
	05/27/97	NR	7.12	10.80	NA	NA	NA	NA	NA
	09/18/97	NR	7.07	12.50	700 us	NA	NA	NA	NA
	12/12/97	NR	7.08	10.50	730 us	NA	NA	NA	NA
	03/25/98	NR	7.87	10.20	1081 us	NA	NA	NA	NA
	06/10/98	NR	7.17	10.60	1042 us	NA	NA	NA	NA
	10/27/98	10.00	7.41	12.10	1179 us	1.10	62.00	20.00	10.00
	02/09/99	9.00	8.10	12.00	1189 us	1.30	263.00	7.20	0.40
	06/08/99	9.00	7.48	15.60	1406 us	2.20	163.00	4.80	0.40
	09/13/99	8.00	7.30	12.90	1301 us	2.60	(114.00)	14.00	0.60
	12/15/99	10.00	7.63	11.30	1419 us	2.80	(42.00)	12.40	1.00
	03/13/00	14.50	5.76	10.90	1389 us	1.20	58.00	8.40	0.60
	06/22/00	10.00	8.75	12.40	1574 us	0.62	(120.00)	6.40	0.00
	09/27/00	10.00	7.42	14.20	1505 us	1.60	(114.00)	9.20	0.00
	12/19/00	13.00	7.69	9.50	1524 us	1.21	(38.00)	10.40	0.00
	03/01/01	16.00	7.81	9.90	1704 us	1.31	(93.00)	12.40	0.20
	06/19/01	15.00	7.64	13.40	1221 us	0.80	(80.00)	6.00	0.20
	09/24/01	9.00	7.04	12.40	977 us	0.60	(77.00)	12.00	0.40
	12/05/01	13.00	7.15	9.20	1611 us	0.80	(95.00)	8.40	0.00
	03/19/02	12.00	7.64	10.00	1730 us	1.30	8.00	9.60	0.20
	06/20/02	10.00	7.48	13.60	1304 us	0.60	(110.00)	9.60	0.40
	09/10/02	10.00	7.52	13.10	1403 us	2.00	(104.00)	12.40	0.40
	12/17/02	10.00	7.22	10.40	1593 us	0.80	(110.00)	7.80	0.00
	03/24/03	10.00	7.30	10.30	1362 us	1.00	(48.00)	10.80	0.00
	06/10/03	11.00	7.20	14.00	1277 us	0.80	(200.00)	9.20	1.00
	09/10/03	10.00	7.46	13.30	1121 us	1.30	(99.00)	8.00	0.20
	12/01/03	10.00	7.41	9.80	1360 us	1.00	(98.00)	8.40	0.00
	03/24/04	9.00	7.30	11.10	1704 us	EM	(109.00)	NA	0.00

Table #5

GROUNDWATER GEOCHEMICAL PARAMETERS
 N.W. Mauthe Superfund Site - Appleton, Wisconsin
 MCO No. M0050-930746.26

Well Name	Sample Date	Purge* Volume (gallons)	pH (units)	Temperature (degree C)	Conductivity (units as shown)	Dissolved Oxygen (ppm)	Redox (mV)	Alkalinity (gpg)	Ferrous Iron (mg/l)
MW-107 (cont.)	07/09/04	6.00	7.30	13.20	1704 us	4.59	166.00	NA	0.00
	09/21/04	3.00	7.10	14.30	1649 us	EM	7.00	NA	0.00
	03/29/05	9.00	7.20	11.50	1749 us	2.83	85.00	NA	0.00
	06/21/05	8.00	7.30	12.70	2010 us	1.85	119.00	NA	0.00
	09/21/05	8.00	7.50	15.20	1594 us	2.92	221.00	NA	0.00
	12/14/05	8.00	7.40	12.30	1708 us	1.80	250.00	NA	0.00
	03/27/06	10.00	7.30	11.90	1726 us	2.65	269.00	NA	0.00
	06/28/06	7.00	7.20	13.40	1696 us	3.76	212.00	NA	0.04
	12/20/06	8.00	7.20	11.80	1655 us	3.83	234.00	NA	0.08
	03/28/07	8.0	7.3	10.4	1599 us	7.14	240	NA	0.01
	07/03/07	7.0	7.5	11.8	1163 us	3.41	258	NA	0.00
MW-108	02/20/97	NR	8.10	10.00	100 us	NA	NA	NA	NA
	05/27/97	NR	6.02	11.40	NA	NA	NA	NA	NA
	09/18/97	NR	6.51	12.00	1160 us	NA	NA	NA	NA
	12/12/97	NR	6.98	10.40	1130 us	NA	NA	NA	NA
	03/25/98	NR	7.64	10.20	1568 us	NA	NA	NA	NA
	06/10/98	NR	6.54	10.70	1525 us	NA	NA	NA	NA
	10/27/98	10.00	7.95	14.30	1696 us	1.40	116.00	12.80	0.20
	02/09/99	8.10	7.51	11.00	1810 us	1.10	(65.00)	10.40	0.40
	06/08/99	12.50	7.60	15.00	1706 us	0.90	173.00	7.20	0.60
	09/13/99	13.50	7.29	13.60	1849 us	1.20	(180.00)	8.00	0.00
	12/15/99	12.80	7.68	11.80	1885 us	1.00	(286.00)	8.40	0.00
	03/13/00	14.00	6.25	10.20	1642 us	1.70	(4.00)	9.20	0.20
	06/22/00	11.50	7.62	14.10	1989 us	1.01	69.00	6.40	0.00
	09/27/00	12.00	7.43	13.10	1983 us	0.40	(73.00)	10.40	0.00
	12/19/00	10.50	7.60	10.10	2.01 ms	2.18	(184.00)	10.80	0.00
	03/01/01	9.00	7.49	11.20	2.38 ms	2.20	(211.00)	11.60	0.00
	06/19/01	8.00	8.20	13.80	1634 us	0.80	(90.00)	7.00	0.00
	09/24/01	9.00	7.59	14.20	1512 us	0.80	(83.00)	9.60	0.00
	12/05/01	10.00	7.49	10.50	2111 us	1.80	(199.00)	9.60	0.00
	03/19/02	12.00	7.30	10.80	2120 us	2.10	(170.00)	11.60	0.00
	06/20/02	12.00	7.92	14.00	1424 us	0.80	(120.00)	12.40	0.00
	09/18/02	12.00	7.13	13.40	1744 us	1.00	(132.00)	11.20	0.00
	12/17/02	10.00	7.36	10.40	1986 us	1.60	(174.00)	8.40	0.00
	03/24/03	10.00	7.31	10.40	2032 us	1.60	(190.00)	8.40	0.00
	06/10/03	11.00	7.64	14.60	1324 us	0.80	(144.00)	9.20	0.00
	09/10/03	11.00	7.15	13.30	1622 us	0.80	(124.00)	10.40	0.00
	03/24/04	10.00	7.70	12.30	1927 us	EM	(156.00)	NA	0.00
	03/29/05	9.00	7.30	10.80	2090 us	2.29	83.00	NA	0.00
	03/27/06	9.00	7.30	9.30	2880 us	1.72	2.69	NA	0.04
	03/27/07	9.0	7.2	12.9	3190 us	5.05	185	NA	0.04
MW-109	06/21/06	2.00	6.42	14.80	1497 us	-	-	-	-
	09/20/06	2.00	6.66	14.60	1429 us	-	-	-	-
	12/20/06	8.00	7.10	11.00	2120 us	2.39	213.00	NA	0.16
	03/29/07	10.0	6.9	9.6	2050 us	7.71	284	NA	***
	07/03/07	9.0	7.2	12.8	2350 us	1.53	192	NA	0.04
MW-110	06/21/06	2.00	6.91	12.70	1178 us	-	-	-	-
	09/20/06	2.00	7.00	14.40	1248 us	-	-	-	-
	12/20/06	10.00	7.20	10.60	1757 us	2.07	234.00	NA	0.00
	03/29/07	10.0	7.2	8.1	1806 us	7.03	255	NA	0.03
	07/03/07	8.0	8.3	12.1	1752 us	2.96	227	NA	0.13
MW-111	06/21/06	2.00	7.01	12.40	1311 us	-	-	-	-
	09/20/06	1.75	6.99	14.00	1164 us	-	-	-	-
	12/20/06	6.00	7.20	11.00	1478 us	3.95	243.00	NA	0.01
	03/29/07	10.0	7.4	9.2	1908 us	9.29	209	NA	0.01
	07/03/07	6.0	7.4	12.1	1855 us	1.63	263	NA	0.28
MW-112	06/21/06	2.00	7.21	12.40	1338 us	-	-	-	-
	09/20/06	2.00	7.28	14.60	1238 us	-	-	-	-
	12/20/06	8.00	7.50	10.70	1817 us	1.94	729.00	NA	0.00
	03/28/07	10.0	7.5	9.5	2050 us	7.93	228	NA	0.00
	07/03/07	9.0	7.6	13.7	1909 us	3.48	234	NA	0.28

Table #5

GROUNDWATER GEOCHEMICAL PARAMETERS
 N.W. Mauthe Superfund Site - Appleton, Wisconsin
 MCO No. M0050-930746.26

Well Name	Sample Date	Purge* Volume (gallons)	pH (units)	Temperature (degree C)	Conductivity (units as shown)	Dissolved Oxygen (ppm)	Redox (mV)	Alkalinity (gpg)	Ferrous Iron (mg/l)
MW-113	06/21/06	2.00	6.91	12.90	1020 us	-	-	-	-
	09/20/06	2.00	7.11	14.60	900 us	-	-	-	-
	12/20/06	8.00	7.20	10.60	1757 us	2.07	234.00	NA	0.00
	03/29/07	10.0	7.3	8.0	1508 us	9.52	235	NA	***
	07/03/07	7.0	7.6	10.9	1552 us	2.05	262	NA	0.13

ppm = parts per million
 us = microsiemens / centimeter
 mV = millivolts
 gpg = grains per gallon
 EM - Equipment malfunction.

ms = millisiemens / centimeter
 NA = not analyzed
 NR = not recorded
 () = Indicates a negative value.

* = Each monitoring well was purged dry twice prior to sampling
 The second purging was conducted approximately 3-hrs after initial purging. The volume of purge water collected represents the total of the two well purges. Purge volumes prior to 10/27/98 were not available.
 ** = Not analyzed due to poor water clarity from recent piezometer installation nearby.
 *** = Too cloudy for testing.

Note: A different meter was used to test ferrous iron beginning on the March 2006 sampling event.

Table #6

GROUNDWATER ANALYTICAL RESULTS / Selected Metals

N.W. Mauthe Superfund Site - Appleton, Wisconsin

MCO No. M0050-930746.26

Well Name	Sample Date	Cadmium (ug/l)	Chromium (ug/l)	Hexavalent Chromium (ug/l)	Copper (ug/l)	Cyanide (ug/l)	Manganese (ug/l)	Mercury (ug/l)	Zinc (ug/l)
W-2	02/20/97	NA	15	NA	26	NA	460.0	NA	49
	05/27/97	0.43	8.5	NA	<10	NA	170.0	<.2	30
	09/18/97	0.27	4.5**	NA	9.5**	3**	116.0	<.03	16.9
	12/12/97	.13*	6.2	NA	<9.7	<.8	133.0	.06*	20.4
	03/25/98	0.08	<3.9	NA	<9.5	<1.7	83.8	.007*	18.6
	06/10/98	.31*	16.4	NA	18.6**	<1.7	466.0	.027*	40.8
	10/27/98	.51*	3.60	NA	4.7*	<.0032	69.0	<.05	170
	02/09/99	.46*	<.62	NA	4.0	<.0032	240.0	<.05	23
	06/08/99	<.31	<.62	NA	1.8*	<.0032	290.0	<.05	<12
	09/13/99	<.31	2.00	NA	3.2	<.0032	240.0	<.05	<12
	12/15/99	<.31	.72*	NA	NA	NA	2.8	NA	NA
	03/13/00	<.31	.79*	NA	NA	NA	7.8	NA	NA
	06/22/00	<.31	<.62	NA	NA	NA	<.42	NA	NA
	09/27/00	2.70	1.1*	NA	NA	NA	17.0	NA	NA
	12/19/00	.24*	.91*	NA	NA	NA	8.0	NA	NA
	03/01/01	<.23	<.57	NA	NA	NA	<2.0	NA	NA
	06/19/01	<.17	.55*	NA	NA	NA	48.0	NA	NA
	09/24/01	<.17	<.34	NA	NA	NA	52	NA	NA
	12/05/01	<.23	<.57	NA	NA	NA	<2.0	NA	NA
	03/19/02	.27*	<.57	NA	NA	NA	<2.0	NA	NA
	06/20/02	<.23	<.44	NA	NA	NA	61.0	NA	NA
	09/18/02	<.23	<.44	NA	NA	NA	110.0	NA	NA
	12/17/02	<.23	<.44	NA	NA	NA	150.0	NA	NA
	03/24/03	<0.17	<0.43	NA	NA	NA	8.5	NA	NA
	03/24/04	NA	<0.45	5.0	NA	NA	<1.0	NA	NA
	03/29/05	NA	1.2	<2.7	NA	NA	1.3	NA	NA
	03/23/06	NA	0.52	<5.0	NA	NA	4.1	NA	NA
	03/27/07	NA	<1.9	NA	NA	NA	4.7	NA	NA
W-8	02/20/97	NA	17	NA	22	NA	320.0	NA	34
	05/27/97	1.6	37	NA	27	NA	670.0	<.2	54
	09/18/97	0.45	14.4	NA	14.6**	1**	338.0	.11**	31.8
	12/12/97	0.5*	5.7	NA	<9.7	<.8	147.0	.07*	17.1
	03/25/98	0.43	10.1	NA	15**	<1.7	205.0	.007*	21
	06/10/98	0.54	9.9	NA	12.6**	<1.7	264.0	.016*	21.6
	10/27/98	0.80	3.90	NA	4.8*	<.0032	64.0	<.05	85
	02/09/99	<.31	<.62	NA	<60	<.0032	850.0	<.05	12
	06/08/99	<.31	<.62	NA	2.6	<.0032	50.0	<.05	<12
	09/13/99	<.31	1.90	NA	2.7	<.0032	98.0	<.05	29
	12/15/99	<.31	2.80	NA	NA	NA	180.0	NA	NA
	03/13/00	<.31	1.4*	NA	NA	NA	65.0	NA	NA
	06/22/00	<.31	3.10	NA	NA	NA	74.0	NA	NA
	09/27/00	.27*	.75*	NA	NA	NA	26.0	NA	NA
	12/19/00	<.23	.66*	NA	NA	NA	40.0	NA	NA
	03/01/01	<.23	<.57	NA	NA	NA	23.0	NA	NA
	06/19/01	<.17	1*	NA	NA	NA	100.0	NA	NA
	09/24/01	<.17	<.34	NA	NA	NA	380.0	NA	NA
	12/25/01	<.23	<.57	NA	NA	NA	<2.0	NA	NA
	03/19/02	<.23	<.57	NA	NA	NA	21.0	NA	NA
	06/20/02	<.23	.47*	NA	NA	NA	1400.0	NA	NA
	09/18/02	<.23	<.44	NA	NA	NA	620.0	NA	NA
	12/17/02	<.23	<.44	NA	NA	NA	34.0	NA	NA
	03/24/03	<.17	<.43	NA	NA	NA	27.0	NA	NA
	03/24/04	NA	0.76*	3.8	NA	NA	1.7*	NA	NA
	03/29/05	NA	<0.52	<2.7	NA	NA	9.7	NA	NA
	03/23/06	NA	<0.4	<5.0	NA	NA	5.5	NA	NA
	03/27/07	NA	<1.9	NA	NA	NA	6.0	NA	NA
W-15	02/20/97	NA	32	NA	52	NA	430.0	NA	88
	05/27/97	0.27	5.9	NA	15	NA	97.0	<.2	39
	09/18/97	0.31	13.9	NA	18.8**	<.78	325.0	<.03	35.5
	12/12/97	.12*	5.7	NA	9.7**	<.8	80.9	.03*	18.5
	03/25/98	.04*	<3.9	NA	<9.5	<1.7	85.7	.038*	13.7
	06/10/98	.11*	10	NA	13.2**	<1.7	147.0	.016*	18.8
	10/27/98	.41*	6.80	NA	7.40	<.0032	110.0	<.05	100
	02/09/99	<.31	<.62	NA	<.60	<.0032	320.0	<.05	<12
	06/08/99	<.31	2.40	NA	14.00	<.0032	130.0	<.05	66
	09/13/99	<.31	5.30	NA	6.40	<.0032	130.0	<.05	16

Table #6

GROUNDWATER ANALYTICAL RESULTS / Selected Metals
 N.W. Mauthe Superfund Site - Appleton, Wisconsin
 MCO No. M0050-930746.26

Well Name	Sample Date	Cadmium (ug/l)	Chromium (ug/l)	Hexavalent Chromium (ug/l)	Copper (ug/l)	Cyanide (ug/l)	Manganese (ug/l)	Mercury (ug/l)	Zinc (ug/l)
W-15 (continued)	12/15/99	<.31	5.00	NA	NA	NA	90.0	NA	NA
	03/13/00	<.31	7.00	NA	NA	NA	130.0	NA	NA
	06/22/00	<.31	1.80	NA	NA	NA	11.0	NA	NA
	09/27/00	<.23	4.20	NA	NA	NA	24.0	NA	NA
	12/19/00	<.23	1.4*	NA	NA	NA	930.0	NA	NA
	03/01/01	<.23	<.57	NA	NA	NA	<2.0	NA	NA
	06/19/01	<.17	<.34	NA	NA	NA	<2	NA	NA
	09/24/01	<.17	<.34	NA	NA	NA	290.0	NA	NA
	12/05/01	<.23	<.57	NA	NA	NA	2.5	NA	NA
	03/19/02	<.23	<.57	NA	NA	NA	22.0	NA	NA
	06/20/02	.36*	.47*	NA	NA	NA	3.1	NA	NA
	09/18/02	<.23	<.44	NA	NA	NA	110.0	NA	NA
	12/17/02	<.23	<.44	NA	NA	NA	31.0	NA	NA
	03/24/03	<0.17	0.47*	NA	NA	NA	27.0	NA	NA
	03/24/04	NA	1.80	3.8	NA	NA	1.1*	NA	NA
	03/29/05	NA	0.98	<2.7	NA	NA	24.0	NA	NA
	03/23/06	NA	1.60	<5.0	NA	NA	8.0	NA	NA
03/28/07	NA	<1.9	NA	NA	NA	13	NA	NA	
MW-101	02/20/97	NA	36	NA	41	NA	820.0	NA	49
	05/27/97	<.2	410	NA	11	NA	170.0	<.03	18
	09/18/97	.06**	11.9	NA	10.7**	1**	145.0	<.05	18.2
	12/12/97	.06*	12.8	NA	<9.7	<.8	176.0	.05*	20.7
	03/25/98	.04*	20.9	NA	21.6**	<1.7	239.0	.007*	32.7
	06/10/98	.27*	48.2	NA	46.8	<1.7	604.0	.044*	75.9
	10/27/98	<.16	3.20	NA	4.2*	<.0032	24.0	<.05	54
	02/09/99	<.31	<.62	NA	<.60	<.0032	1900.0	<.05	14
	06/08/99	<.31	1.80	NA	8.2	<.0032	380.0	<.05	39
	09/13/99	<.31	2.90	NA	5.1	<.0032	331.0	<.05	<12
	12/15/99	<.31	2.50	NA	NA	NA	9.1	NA	NA
	03/13/00	<.31	2.30	NA	NA	NA	100.0	NA	NA
	06/22/00	<.31	1.4*	NA	NA	NA	<4.2	NA	NA
	09/27/00	<.23	19.00	NA	NA	NA	37.0	NA	NA
	12/19/00	<.23	7.20	NA	NA	NA	18.0	NA	NA
	03/01/01	<.23	<.57	NA	NA	NA	13.0	NA	NA
	06/19/01	<.17	8.50	NA	NA	NA	9.1	NA	NA
	09/24/01	<.17	.55*	NA	NA	NA	<2.0	NA	NA
	12/05/01	<.23	.90*	NA	NA	NA	<2.0	NA	NA
	03/19/02	<.23	.66*	NA	NA	NA	<2.0	NA	NA
	06/20/02	<.23	.58*	NA	NA	NA	2.2	NA	NA
09/18/02	<.23	<.44	NA	NA	NA	13.0	NA	NA	
12/17/02	<.23	<.44	NA	NA	NA	33.0	NA	NA	
03/24/03	<.17	.50*	NA	NA	NA	8.3	NA	NA	
03/24/04	NA	0.79*	<3.6	NA	NA	<1.0	NA	NA	
03/29/05	NA	1.10	<2.7	NA	NA	16.0	NA	NA	
03/23/06	NA	0.55	<5.0	NA	NA	45.0	NA	NA	
03/27/07	NA	<1.9	NA	NA	NA	14.0	NA	NA	
MW-102	02/20/97	NA	26	NA	38	NA	570.0	NA	34
	05/27/97	0.21	148	NA	77	NA	920.0	<.2	73
	09/18/97	.08**	<3.92	NA	6.9**	2**	302.0	<.03	8.7
	12/12/97	.04*	<3.9	NA	<9.7	<.8	387.0	.04*	10.9
	03/25/98	.11*	<3.9	NA	9.5**	<1.7	302.0	.007*	7.4*
	06/10/98	.04*	<3.9	NA	<9.8	<1.7	318.0	.018*	9.5
	10/27/98	.27*	.98*	NA	3.2*	<.0032	340.0	<.05	24
	02/09/99	<.31	.73*	NA	<.60	<.0032	670.0	<.05	20
	06/08/99	<.31	1.2*	NA	5.8	<.0032	140.0	<.05	36
	09/13/99	<.31	4.00	NA	15.0	<.0032	160.0	<.05	73
	12/15/99	<.31	1.2*	NA	NA	NA	550.0	NA	NA
	03/13/00	<.31	1.70	NA	NA	NA	580.0	NA	NA
	06/22/00	<.31	<.62	NA	NA	NA	310.0	NA	NA
	09/27/00	<.23	2.10	NA	NA	NA	130.0	NA	NA
	12/19/00	.33*	2.90	NA	NA	NA	110.0	NA	NA
	03/01/01	<.23	<.57	NA	NA	NA	<2.0	NA	NA
	06/19/01	<.17	<.34	NA	NA	NA	<2	NA	NA
09/24/01	.48*	1.40	NA	NA	NA	46.0	NA	NA	
12/05/01	<.23	<.57	NA	NA	NA	100.0	NA	NA	

Table #6

GROUNDWATER ANALYTICAL RESULTS / Selected Metals
 N.W. Mauthe Superfund Site - Appleton, Wisconsin
 MCO No. M0050-930746.26

Well Name	Sample Date	Cadmium (ug/l)	Chromium (ug/l)	Hexavalent Chromium (ug/l)	Copper (ug/l)	Cyanide (ug/l)	Manganese (ug/l)	Mercury (ug/l)	Zinc (ug/l)
MW-102 (continued)	03/19/02	<.23	<.57	NA	NA	NA	87.0	NA	NA
	06/20/02	<.17	1.80	NA	NA	NA	44.0	NA	NA
	09/18/02	<.23	1.4*	NA	NA	NA	<2.0	NA	NA
	12/17/02	<.23	<.44	NA	NA	NA	38.0	NA	NA
	03/24/03	0.21*	<0.43	NA	NA	NA	3.5	NA	NA
	03/24/04	NA	<0.45	<3.6	NA	NA	65.0	NA	NA
	03/29/05	NA	0.71	<2.7	NA	NA	190.0	NA	NA
	03/23/06	NA	<0.40	<5.0	NA	NA	100.0	NA	NA
	03/27/07	NA	<1.9	NA	NA	NA	230.0	NA	NA
MW-103	02/20/97	NA	300	NA	47	NA	600.0	NA	27
	05/27/97	<.2	160.0	NA	31	NA	900.0	<.2	29
	09/18/97	.06**	35.2	NA	13.5**	3**	287.0	<.03	13.7
	12/12/97	.04*	16.3	NA	<9.7	<.8	284.3	.09*	21.4
	03/25/98	.04*	15.5	NA	<9.5	<1.7	283.0	.007*	7.5*
	06/10/98	.15*	57.6	NA	27.5	<1.7	417.0	.02*	33.7
	10/27/98	<.16	6.30	NA	2.3*	<.0032	127.0	<.05	30.0
	06/08/99	<.31	87.00	NA	3.5	<.0032	181.00	<.05	30
	09/13/99	<.31	72.00	NA	5.9	<.0032	83.0	<.05	15
	12/15/99	<.31	260.0	NA	NA	NA	160.0	NA	NA
	03/13/00	<.31	600.0	NA	NA	NA	79.0	NA	NA
	06/22/00	<.31	130.0	NA	NA	NA	180.0	NA	NA
	09/27/00	<.23	280.0	NA	NA	NA	230.0	NA	NA
	12/19/00	<.23	180.0	NA	NA	NA	170.0	NA	NA
	03/01/01	<.23	49.0	NA	NA	NA	240.0	NA	NA
	06/19/01	<.17	11.0	NA	NA	NA	350.0	NA	NA
	09/24/01	<.17	12.0	NA	NA	NA	280.0	NA	NA
	12/05/01	<.23	2.9	NA	NA	NA	230.0	NA	NA
	03/19/02	<.23	73.0	NA	NA	NA	7.9	NA	NA
	06/20/02	<.23	14.0	NA	NA	NA	1630.0	NA	NA
	09/18/02	<.23	6.5	NA	NA	NA	560.0	NA	NA
	12/17/02	<.23	16.2	NA	NA	NA	3.7	NA	NA
	03/24/03	.26*	350.0	NA	NA	NA	48.0	NA	NA
	06/10/03	NA	150.0	NA	NA	NA	NA	NA	NA
	09/10/03	NA	91.0	NA	NA	NA	NA	NA	NA
	12/10/03	NA	77.0	NA	NA	NA	NA	NA	NA
	12/15/03	NA	NA	<3.6	NA	NA	NA	NA	NA
	03/24/04	NA	5.60	6.3	NA	NA	7.6	NA	NA
	07/09/04	NA	11.00	16.0	NA	NA	NA	NA	NA
	12/09/04	NA	1.20	<3.6	NA	NA	NA	NA	NA
	03/29/05	NA	220.0	350.0	NA	NA	82.0	NA	NA
	06/22/05	NA	240.0	250.0	NA	NA	NA	NA	NA
	09/21/05	NA	110.0	69.0	NA	NA	NA	NA	NA
	12/15/05	NA	120.0	150.0	NA	NA	NA	NA	NA
	03/23/06	NA	16.0	270.0	NA	NA	8.4	NA	NA
	06/28/06	NA	40.0	29.0	NA	NA	NA	NA	NA
	09/20/06	NA	45.0	35.0	NA	NA	NA	NA	NA
	12/20/06	NA	15.0	NA	NA	NA	NA	NA	NA
	03/28/07	NA	33.1	NA	NA	NA	38	NA	NA
	07/03/07	NA	90	NA	NA	NA	NA	NA	NA
MW-104	02/20/97	NA	59	NA	15	NA	550.0	NA	6.9
	05/27/97	<.02	6.9	NA	11	NA	470.0	<.2	5.2
	09/18/97	<.04	35.6	NA	5**	3**	235.0	<.03	4.74
	12/12/97	.04*	61.8	NA	9.8**	<.8	279.0	.05*	14
	03/25/98	.04*	66.8	NA	<9.5	<1.7	273.6	.008*	7.4*
	06/10/98	.04*	129.0	NA	<9.8	<1.7	107.0	.016*	12.8
	10/27/98	.29*	150.0	NA	2.3*	<.0032	25.0	<.05	30
	02/09/99	<.31	94.0	NA	1.4*	<.0032	1000.0	<.05	<12
	06/08/99	1*	62.0	NA	12.0	<.0032	620.0	<.05	17
	09/13/99	<.31	80.0	NA	3.2	<.0032	9.2	<.05	<12
	12/15/99	<.31	170.0	NA	NA	NA	1.6	NA	NA
	03/13/00	<.31	300.0	NA	NA	NA	13.0	NA	NA
	06/22/00	<.31	210.0	NA	NA	NA	41.0	NA	NA
	09/27/00	<.23	510.0	NA	NA	NA	3.9	NA	NA
	12/19/00	<.23	790.0	NA	NA	NA	<2	NA	NA
	03/01/01	<.23	840.0	NA	NA	NA	<2	NA	NA
	06/19/01	<.17	680.0	NA	NA	NA	2.3	NA	NA

Table #6

GROUNDWATER ANALYTICAL RESULTS / Selected Metals
 N.W. Mauthe Superfund Site - Appleton, Wisconsin
 MCO No. M0050-930746.26

Well Name	Sample Date	Cadmium (ug/l)	Chromium (ug/l)	Hexavalent Chromium (ug/l)	Copper (ug/l)	Cyanide (ug/l)	Manganese (ug/l)	Mercury (ug/l)	Zinc (ug/l)
MW-104 (continued)	09/24/01	<.17	310.0	NA	NA	NA	17.0	NA	NA
	12/05/02	<.23	390.0	NA	NA	NA	2.2	NA	NA
	03/19/02	<.23	430.0	NA	NA	NA	<2.0	NA	NA
	06/20/02	<.23	490.0	NA	NA	NA	14.0	NA	NA
	09/18/02	<.23	410.0	NA	NA	NA	27.0	NA	NA
	12/17/02	<.23	240.0	NA	NA	NA	8.9	NA	NA
	03/24/03	<.17	180.0	NA	NA	NA	4.2	NA	NA
	06/10/03	NA	420.0	NA	NA	NA	NA	NA	NA
	09/10/03	NA	1200.0	NA	NA	NA	NA	NA	NA
	12/10/03	NA	790.0	NA	NA	NA	NA	NA	NA
	12/15/03	NA	NA	700.0	NA	NA	NA	NA	NA
	03/24/04	NA	550.0	580.0	NA	NA	<1.0	NA	NA
	07/09/04	NA	370.0	380.0	NA	NA	NA	NA	NA
	09/22/04	NA	787.0	33.0	NA	NA	NA	NA	NA
	12/09/04	NA	56.0	57.0	NA	NA	NA	NA	NA
	03/29/05	NA	260.0	260.0	NA	NA	1.0	NA	NA
	06/22/05	NA	280.0	230.0	NA	NA	NA	NA	NA
	09/21/05	NA	17.0	25.0	NA	NA	NA	NA	NA
	12/15/05	NA	95.0	110.0	NA	NA	NA	NA	NA
	03/23/06	NA	366.0	200.0	NA	NA	6.3	NA	NA
	06/28/06	NA	76.0	58.0	NA	NA	NA	NA	NA
	09/20/06	NA	2.8	<6.8	NA	NA	NA	NA	NA
	12/20/06	NA	8.4	NA	NA	NA	NA	NA	NA
	03/28/07	NA	160	NA	NA	NA	130	NA	NA
	07/03/07	NA	97	NA	NA	NA	NA	NA	NA
MW-105	02/20/97	NA	21	NA	22	NA	1100.0	NA	23
	05/27/97	<.2	75	NA	<10	NA	120.0	<.2	12
	09/18/97	.14**	29.5	NA	28.3	1**	532.0	<.03	46
	12/12/97	.36*	15.8	NA	12.5**	<.8	297.0	.03*	27.1
	03/25/98	.04*	30.8	NA	27.6	<1.7	518.0	.064*	44
	06/10/98	.048*	13.7	NA	15.3**	<1.7	217.0	.016*	22.1
	10/27/98	.29*	8.80	NA	8.20	<.0032	150.0	<.05	70
	02/09/99	<.31	1.3*	NA	4.30	<.0032	2000.0	<.05	19
	06/08/99	<.31	1*	NA	18.00	<.0032	1300.0	<.05	66
	09/13/99	<.31	.64*	NA	24.00	<.0032	1700.0	<.05	30
	12/15/99	<.31	<.62	NA	NA	NA	860.0	NA	NA
	03/13/00	<.31	4.80	NA	NA	NA	660.0	NA	NA
	06/22/00	<.31	1.0*	NA	NA	NA	600.0	NA	NA
	09/27/00	<.23	1.2*	NA	NA	NA	700.0	NA	NA
	12/19/00	<.23	<.4	NA	NA	NA	230.0	NA	NA
	03/01/01	<.23	<.57	NA	NA	NA	43.0	NA	NA
	06/19/01	<.17	.75*	NA	NA	NA	230.0	NA	NA
	09/24/01	<.17	.73*	NA	NA	NA	530.0	NA	NA
	12/05/01	<.23	<.57	NA	NA	NA	<2.0	NA	NA
	03/19/02	<.23	<.57	NA	NA	NA	22.0	NA	NA
	06/20/02	<.23	.60*	NA	NA	NA	1400.0	NA	NA
	09/18/02	<.23	<.44	NA	NA	NA	600.0	NA	NA
	12/17/02	<.23	<.44	NA	NA	NA	58.0	NA	NA
	03/24/03	.21*	<.43	NA	NA	NA	86.0	NA	NA
	03/24/04	NA	3.80	6.3	NA	NA	89.0	NA	NA
	03/29/05	NA	<.052	<2.7	NA	NA	82.0	NA	NA
	03/23/06	NA	0.42	<5.0	NA	NA	43.0	NA	NA
	03/27/07	NA	<1.9	NA	NA	NA	23	NA	NA
MW-106	02/20/97	NA	21	NA	24	NA	320.0	NA	26
	05/27/97	<.02	40	NA	35	NA	590.0	<.2	68
	09/18/97	.05**	5.5	NA	6.2**	1**	5619	<.03	35.6
	12/12/97	.04*	29.2	NA	9.7**	<.08	155.0	.03*	18.4
	03/25/98	NA	13.40	NA	14.4**	<1.7	150.0	.007*	18.5
	06/10/98	.04*	<.39	NA	10.2**	<1.7	10.0	.016*	10.9
	10/27/98	.27*	3.20	NA	4.3*	<.0032	738.0	<.05	88
	02/09/99	<.31	<.62	NA	1.1*	<.0032	760.0	<.05	22
	06/08/99	<.31	.79*	NA	2.3	<.0032	3900.0	<.05	<12
	09/13/99	<.31	1.80	NA	4.7	<.0032	1100.0	<.05	30
	12/15/99	<.31	1.3*	NA	NA	NA	130.0	NA	NA
	03/31/00	<.31	2.30	NA	NA	NA	270.0	NA	NA
	06/22/00	<.31	.73*	NA	NA	NA	<4.2	NA	NA

Table #6

GROUNDWATER ANALYTICAL RESULTS / Selected Metals
 N.W. Mauthe Superfund Site - Appleton, Wisconsin
 MCO No. M0050-930746.26

Well Name	Sample Date	Cadmium (ug/l)	Chromium (ug/l)	Hexavalent Chromium (ug/l)	Copper (ug/l)	Cyanide (ug/l)	Manganese (ug/l)	Mercury (ug/l)	Zinc (ug/l)
MW-106 (continued)	09/27/00	<.23	.88*	NA	NA	NA	50.0	NA	NA
	12/19/00	<.23	.77*	NA	NA	NA	22.0	NA	NA
	03/01/01	<.23	<.57	NA	NA	NA	45.0	NA	NA
	06/19/01	.21*	.39*	NA	NA	NA	57.0	NA	NA
	09/24/01	<.17	<.34	NA	NA	NA	85.0	NA	NA
	12/05/01	<.23	<.57	NA	NA	NA	31.0	NA	NA
	03/19/02	<.23	<.57	NA	NA	NA	92.0	NA	NA
	06/20/02	<.23	<.44	NA	NA	NA	27.0	NA	NA
	09/18/02	<.23	<.44	NA	NA	NA	42.0	NA	NA
	12/17/02	<.23	<.44	NA	NA	NA	41.0	NA	NA
	03/24/03	<0.17	<.43	NA	NA	NA	2.1	NA	NA
	03/24/04	NA	<0.45	3.8	NA	NA	19.0	NA	NA
	03/29/05	NA	1.10	<2.7	NA	NA	15.0	NA	NA
	03/23/06	NA	0.45	<5.0	NA	NA	30.0	NA	NA
	03/27/07	NA	<1.9	NA	NA	NA	15	NA	NA
MW-107	02/20/97	NA	2.000	NA	13	NA	19.0	NA	6.9
	05/27/97	<.2	3.600	NA	<10	NA	9.1	<.2	10
	09/18/97	<.04	2.670	NA	<8.1	1*	59.3	<.03	33.5
	12/12/97	.04*	2.310	NA	<9.7	<.8	48.4	.1*	6.7
	03/25/98	.04*	1.1200	NA	12.1**	<1.7	68.2	.041*	9.3*
	06/10/98	.11*	2.6240	NA	13.8**	<1.7	161.0	.027*	17.3*
	10/27/98	<.16	7.100	NA	1.2*	<.0032	28.0	<.05	94
	02/09/99	<.31	3.200	NA	1.9*	<.0032	49.0	<.05	<12
	06/08/99	<.31	5.800	NA	3.0	<.0032	25.0	<.05	<12
	09/13/99	<.31	4.000	NA	1.9*	<.0032	18.0	<.05	<12
	12/15/99	<.31	14.000	NA	NA	NA	.83*	NA	NA
	03/13/00	<.31	8.100	NA	NA	NA	22.0	NA	NA
	06/22/00	<.31	14.000	NA	NA	NA	<42	NA	NA
	09/27/00	<.23	11.000	NA	NA	NA	4.9	NA	NA
	12/19/00	<.23	10.000	NA	NA	NA	2.4	NA	NA
	03/01/01	<.23	9.5000	NA	NA	NA	2.2	NA	NA
	06/19/01	<.17	8.200	NA	NA	NA	<2	NA	NA
	09/24/01	<.17	5.300	NA	NA	NA	27.0	NA	NA
	12/05/01	<.23	6.200	NA	NA	NA	10.0	NA	NA
	03/19/02	<.23	7.000	NA	NA	NA	<20	NA	NA
	06/20/02	<.23	7.000	NA	NA	NA	<20	NA	NA
	09/18/02	<.17	4.300	NA	NA	NA	24.0	NA	NA
	12/17/02	<.17	3.700	NA	NA	NA	15.0	NA	NA
	03/24/03	<.10	3.800	NA	NA	NA	7.7	NA	NA
	06/10/03	NA	5.900	NA	NA	NA	NA	NA	NA
	09/10/03	NA	5.200	NA	NA	NA	NA	NA	NA
	12/10/03	NA	5.200	NA	NA	NA	NA	NA	NA
	12/15/03	NA	NA	15.500	NA	NA	NA	NA	NA
	03/24/04	NA	3.900	4.100	NA	NA	1.2*	NA	NA
	07/09/04	NA	3.400	5.000	NA	NA	NA	NA	NA
	09/22/04	NA	4.100	4.400	NA	NA	NA	NA	NA
	12/14/04	NA	6.300	5.800	NA	NA	NA	NA	NA
	03/29/05	NA	3.600	4.100	NA	NA	1.9	NA	NA
	06/22/05	NA	3.300	2.900	NA	NA	NA	NA	NA
	09/21/05	NA	2.500	2.500	NA	NA	NA	NA	NA
	12/15/05	NA	2.400	2.700	NA	NA	NA	NA	NA
	03/23/06	NA	3.200	3.600	NA	NA	1.90	NA	NA
	06/28/06	NA	3.600	3.000	NA	NA	NA	NA	NA
	09/20/06	NA	4.100	4.200	NA	NA	NA	NA	NA
	12/19/06	NA	2.700	NA	NA	NA	NA	NA	NA
	03/28/07	NA	4.200	NA	NA	NA	1.7	NA	NA
	07/03/07	NA	2.800	NA	NA	NA	NA	NA	NA

Table #6

GROUNDWATER ANALYTICAL RESULTS / Selected Metals
 N.W. Mauthe Superfund Site - Appleton, Wisconsin
 MCO No. M0050-930746.26

Well Name	Sample Date	Cadmium (ug/l)	Chromium (ug/l)	Hexavalent Chromium (ug/l)	Copper (ug/l)	Cyanide (ug/l)	Manganese (ug/l)	Mercury (ug/l)	Zinc (ug/l)
MW-108	02/20/97	NA	25	NA	23	NA	490.0	NA	31
	05/27/97	<2	11	NA	13	NA	210.0	<2	15
	09/18/97	.14**	27.4	NA	22.4**	1**	462.0	<.03	36.6
	12/12/97	.04*	5.6	NA	<9.7	<.8	74.8	.03*	27.9
	03/25/98	.04*	9.4	NA	10.4**	<1.7	142.0	.007*	13.8
	06/10/98	.14*	28.4	NA	25.5	<1.7	478.0	.021*	40.5
	10/27/98	.26*	8.90	NA	7.40	<.0032	88.0	<.05	44
	02/09/99	<.31	1.70	NA	3.90	<.0032	560.0	<.05	30
	06/08/99	<.31	3.10	NA	1.4*	<.0032	450.0	<.05	54
	09/13/99	<.31	4.50	NA	5.30	<.0032	100.0	<.05	<12
	12/15/99	<.31	16.10	NA	NA	NA	79.0	NA	NA
	03/13/00	<.31	3.6	NA	NA	NA	41.0	NA	NA
	06/22/00	<.31	6.5	NA	NA	NA	<4.2	NA	NA
	09/27/00	<.23	2.9	NA	NA	NA	29.0	NA	NA
	12/19/00	<.23	3.0	NA	NA	NA	22.0	NA	NA
	03/01/01	<.23	<.57	NA	NA	NA	<2.0	NA	NA
	06/19/01	<.17	2.40	NA	NA	NA	110.0	NA	NA
	09/24/01	<.17	<.34	NA	NA	NA	40.0	NA	NA
	12/05/01	<.23	<.57	NA	NA	NA	7.4	NA	NA
	03/19/02	<.23	<.57	NA	NA	NA	3.4	NA	NA
	06/20/02	<.23	.85*	NA	NA	NA	39.0	NA	NA
	09/18/02	<.23	<.44	NA	NA	NA	150.0	NA	NA
	12/17/02	<.23	.67*	NA	NA	NA	34.0	NA	NA
	03/24/03	<.17	.67*	NA	NA	NA	3.3	NA	NA
	03/24/04	NA	0.79*	<.36	NA	NA	63.0	NA	NA
	03/29/05	NA	0.65	<.27	NA	NA	2.6	NA	NA
	03/27/06	NA	<.040	<.50	NA	NA	6.2	NA	NA
	03/27/07	NA	<.19	NA	NA	NA	1.4	NA	NA
MW-109	6/21/06****	<.092	1,300	1,400	2.4*	<.94	480.0	<.072	<20
	9/20/06****	NA	450	NA	-	<.94	430.0	NA	<20
	12/19/06	NA	550	NA	NA	NA	NA	NA	NA
	03/29/07	NA	2,700	NA	NA	0.94	15	NA	<20
	07/03/07	NA	2,200	NA	NA	NA	NA	NA	NA
MW-110	6/21/06****	<.092	24,000	26,000	2.9*	40	290.0	<.072	<20
	9/20/06****	NA	15,000	NA	NA	41	260.0	NA	<20
	12/19/06	NA	15,000	NA	NA	53	NA	NA	NA
	03/29/07	NA	47,000	NA	NA	6.6	84	NA	<20
	07/03/07	NA	3,200	NA	NA	79	NA	NA	NA
MW-111	6/21/06****	<.092	1,400	1,400	3.3*	27	190.0	<.072	<20
	9/20/06****	NA	22	NA	-	20*	210.0	NA	<20
	12/19/06	NA	6.7	NA	NA	NA	NA	NA	NA
	03/29/07	NA	2,300	NA	NA	31	11	NA	<20
	07/03/07	NA	741	NA	NA	NA	NA	NA	NA
MW-112	6/21/06****	<.092	130,000	140,000	5.3	140	180.0	<.072	34,000
	9/20/06****	NA	69,000	NA	NA	84	130.0	NA	<20
	12/19/06	NA	55,000	NA	NA	88	NA	NA	<200
	03/28/07	NA	140,000	NA	NA	450	110	NA	<20
	07/03/07	NA	100,000	NA	NA	35	NA	NA	<200
MW-113	6/21/06****	<.092	25,000	26,000	3.4*	11	170.0	<.072	<20
	9/20/06****	NA	31,000	NA	NA	12*	185.0	NA	<20
	12/19/06	NA	21,000	NA	NA	NA	NA	NA	NA
	03/29/07	NA	11,000	NA	NA	<.94	3.2	NA	<20
	07/03/07	NA	21,000	NA	NA	NA	NA	NA	NA

Table #6

GROUNDWATER ANALYTICAL RESULTS / Selected Metals

N.W. Mauthe Superfund Site - Appleton, Wisconsin
MCO No. M0050-930746.26

Well Name	Sample Date	Cadmium (ug/l)	Chromium (ug/l)	Hexavalent Chromium (ug/l)	Copper (ug/l)	Cyanide (ug/l)	Manganese (ug/l)	Mercury (ug/l)	Zinc (ug/l)
PZ-5	07/19/05****	NA	1.3*	<5.0	NA	NA	NA	NA	NA
	09/21/05****	NA	0.41*	<5.0	NA	NA	NA	NA	NA
PZ-6	07/19/05****	NA	1.2*	<5.0	NA	NA	NA	NA	NA
	09/21/05****	NA	<0.40	<5.0	NA	NA	NA	NA	NA
PZ-7	07/19/05****	NA	<0.52	<5.0	NA	NA	NA	NA	NA
	09/21/05****	NA	0.55*	<5.0	NA	NA	NA	NA	NA
PZ-8	07/19/05****	NA	1.1*	<5.0	NA	NA	NA	NA	NA
	09/21/05****	NA	<0.40	<5.0	NA	NA	NA	NA	NA
Maximum Contaminant Level (MCL)		5	100	100***	100	200	50.0	2	5,000
1992 Enforcement Standard Chapter NR 140.10		10	50	50	1,000	200	50.0	2	5,000
1992 Preventive Action Limit Chapter NR 140.10		1.0	5	5***	500	40	25.0	0.2	2,500

EXPLANATION:

Samples collected prior to 10/27/98 were collected by CH2M Hill.

* = Analyte detected between limit of detection and limit of quantitation.

** = Compound was found in sample and blank.

*** = Standard is for Total Chromium.

**** = Omni Associates, Inc. collected groundwater samples from PZ-5 to PZ-8 on July 19, 2005 and September 21, 2005 and MW-109 to MW-113 on June 21, 2006 and September 20, 2006 using a peristaltic pump and dedicated tubing.


ND = Not detected above the analytical laboratories method detection limit

NA = Not Analyzed

MW-104 = Was tested for Aluminum, Nickel, Arsenic & Lead. No quantifiable detections were noted for any of the analytes.

ug/L = Microgram/Liter

mg/L = Milligram / Liter

 Indicates an exceedance of the 1992 NR 140 Groundwater Quality Enforcement Standard (ES)

 Indicates Exceedance of the 1992 NR 140 Groundwater Preventive Action Limit (PAL)

NOTE: The EPA Record of Decision establishes the 1992 PALS as the cleanup goals for the site.

Table #7

GROUNDWATER ANALYTICAL RESULTS
Volatile Organic Compounds (VOC's)
 N.W. Mauthe Superfund Site - Appleton, Wisconsin
 MCO No. M0050-930746.26

Well Name	Sample Date	Benzene (ug/l)	Chloroform (ug/l)	1,1-Dichloroethane (ug/l)	1,1-Dichloroethene (ug/l)	cis-1,2-Dichloroethene (ug/l)	Trans-1,2-Dichloroethene (ug/l)	Ortho-Xylene (ug/l)	Toluene (ug/l)	1,1,1-Trichloroethane (ug/l)	1,1,2-Trichloroethane (ug/l)	Trichloroethene (ug/l)	Meta, para Xylene (ug/l)	Total Xylenes (ug/l)
W-2	02/20/97	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5
	05/27/97	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5
	09/18/97	<.5	<.6	<85	<.7	<.7	<.7	<124	<68	<40	<.5	<.5	<.5	<124
	12/12/97	<.5	<.6	<85	<.7	<.7	<.7	<120	<68	<40	<.5	<.5	<.5	<120
	03/25/98	<.5	<.6	<85	<.7	<.7	<.7	<.4	<68	<40	<.5	<.5	<.5	<120
	06/10/98	<.5	<.6	<85	<.7	<.7	<.7	<120	<68	<40	<.5	<.5	<.5	<120
	10/27/98	<.24	<.23	<.27	<.28	<.27	<.26	<.17	<.21	<.26	<.23	<.29	<.36	<.36
	02/09/99	.15*	<.15	<.14	<.15	<.16	<.17	***	<.13	<.14	<.15	<.14	***	<.37
	06/08/99	<.13	<.15	<.14	<.15	<.16	<.17	***	<.13	<.14	<.15	<.14	***	<.37
	09/13/99	<.13	<.15	<.14	<.15	<.16	<.17	***	.13*	<.14	<.15	<.14	***	<.37
	03/13/00	<.32	<.28	<.36	<.35	<.15	<.39	***	<.37	<.33	<.11	<.34	***	<.71
	03/01/01	<.12	<.15	<.64	<.13	<.28	<.13	***	<.17	<.17	<.25	<.13	***	<.56
	03/19/02	<.12	<.15	<.64	<.13	<.28	<.13	***	<.17	<.17	<.25	<.13	***	<.56
	03/24/03	<.35	<.35	<.35	<.39	<.39	<.37	***	<.37	<.42	<.32	<.42	***	<.43
W-8	02/20/97	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
	05/27/97	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5
	09/18/97	<.5	<.6	<85	<40	<.7	<.7	<124	<68	<40	<.5	<.5	<.5	<124
	12/12/97	<.5	<.6	<85	<40	<.7	<.7	<.4	<68	<40	<.5	<.5	<.5	<124
	03/25/98	<.5	<.6	<85	<40	<.7	<.7	<.3	<68	<40	<.5	<.5	<.5	<120
	06/10/98	<.5	<.6	<85	<40	<.7	<.7	<120	<68	<40	<.5	<.5	<.5	<120
	10/27/98	<.24	<.23	<.27	<.28	<.27	<.26	<.17	<.21	<.26	<.23	<.29	<.36	<.36
	02/09/99	.19*	<.15	<.15	<.15	<.16	<.17	***	.15*	<.14	<.15	<.15	***	<.37
	06/08/99	<.13	<.15	<.14	<.15	<.16	<.17	***	0.13	<.14	<.15	<.14	***	<.37
	09/13/99	<.13	<.15	<.14	<.15	<.16	<.17	***	<.13	<.14	<.15	<.14	***	<.37
	03/13/00	<.32	<.28	<.36	<.35	<.15	<.39	***	<.37	<.33	<.11	<.34	***	<.71
	03/01/01	<.12	<.15	<.64	<.13	<.28	<.13	***	<.17	<.17	<.25	<.13	***	<.56
	03/19/02	<.12	<.15	<.64	<.13	<.28	<.13	***	<.17	<.17	<.25	<.13	***	<.56
	03/24/03	<.35	<.35	<.35	<.39	<.39	<.37	***	<.37	<.42	<.32	<.42	***	<.43
W-15	02/20/97	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5
	05/27/97	<.5	0.22	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5
	09/18/97	<.5	<.6	<85	<.7	<.7	<.7	<124	<68	<40	<.5	<.5	<.5	<124
	12/12/97	<.5	<.6	<85	<.7	<.7	<.7	<120	<68	<40	<.5	<.5	<.5	<120
	03/25/98	<.5	<.6	<85	<.7	<.7	<.7	<.4	<68	<40	<.5	<.5	<.5	<120
	06/10/98	<.5	<.6	<85	<.7	<.7	<.7	<120	<68	<40	<.5	<.5	<.5	<120
	10/27/98	<.24	<.23	<.27	<.28	<.27	<.26	<.17	<.21	<.26	<.23	<.29	<.36	<.36
	02/09/99	<.13	<.15	<.14	<.15	<.16	<.17	***	<.13	<.14	<.15	<.14	***	<.37
	06/08/99	.16*	<.15	<.14	<.15	<.16	<.17	***	<.13	<.14	<.15	<.14	***	<.37
	09/13/99	<.13	<.15	<.14	<.15	<.16	<.17	***	<.13	<.14	<.15	<.14	***	<.37
	03/13/00	<.32	<.28	<.36	<.35	<.15	<.39	***	<.37	<.33	<.11	<.34	***	<.71
	03/01/01	<.12	<.15	<.64	<.13	<.28	<.13	***	<.17	<.17	<.25	<.13	***	<.56
	03/19/02	<.12	<.15	<.64	<.13	<.28	<.13	***	<.17	<.17	<.25	<.13	***	<.56
	03/24/03	<.35	<.35	<.35	<.39	<.39	<.37	***	<.50*	<.42	<.32	<.42	***	<.43

Table #7

GROUNDWATER ANALYTICAL RESULTS
Volatile Organic Compounds (VOC's)
 N.W. Mauthe Superfund Site - Appleton, Wisconsin
 MCO No. M0050-930746.26

Well Name	Sample Date	Benzene (ug/l)	Chloroform (ug/l)	1,1-Dichloroethane (ug/l)	1,1-Dichloroethene (ug/l)	cis-1,2-Dichloroethene (ug/l)	Trans-1,2-Dichloroethene (ug/l)	Ortho-Xylene (ug/l)	Toluene (ug/l)	1,1,1-Trichloroethane (ug/l)	1,1,2-Trichloroethane (ug/l)	Trichloroethene (ug/l)	Meta, para Xylene (ug/l)	Total Xylenes (ug/l)
MW-101	02/20/97	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	-
	05/27/97	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	-
	09/18/97	<.5	<.6	.491*	353*	<.7	<.7	<124	<68	3.03	<.5	3.31	<124	-
	12/12/97	<.5	<.6	<85	<.7	<.7	<.7	<120	<68	<40	<.5	<.5	<120	-
	03/25/98	<.5	<.6	<85	<.7	<.7	<.7	<120	<68	<40	<.5	<.5	<120	-
	06/10/98	<.5	<.6	<85	<.7	<.7	<.7	<120	<68	<40	<.5	<.5	<120	-
	10/27/98	<.24	<.23	<.27	<.28	<.27	<.26	<.17	<.21	<.26	<.23	<.29	<.36	-
	02/09/99	<.13	<.15	<.14	<.15	<.16	<.17	***	0.91	<.14	<.15	<.14	***	<.37
	06/08/99	<.13	<.15	<.14	<.15	<.16	<.17	***	<.13	<.14	<.15	<.14	***	<.37
	03/13/00	<.32	<.28	<.36	<.35	<.15	<.39	***	<.37	<.33	<.11	<.34	***	<.71
	03/01/01	<.12	<.15	<.64	<.13	<.28	<.13	***	<.17	<.17	<.25	<.13	***	<.56
	03/19/02	<.12	<.15	<.64	<.13	<.28	<.13	***	<.17	<.17	<.25	<.13	***	<.56
	03/24/03	<.35	<.35	<.35	<.39	<.39	<.37	***	<.40*	<.42	<.32	<.42	***	<.43
MW-102	02/20/97	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	-
	05/27/97	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	-
	09/18/97	<.5	<.6	<85	<85	<.7	<.7	<124	<68	<40	<.5	<.5	<124	-
	12/12/97	<.5	<.6	<85	<85	<.7	<.7	<120	<68	<40	<.5	<.5	<120	-
	03/25/98	<.5	<.6	<85	<85	<.7	<.7	<.4	<68	<40	<.5	<.5	.4*	-
	06/10/98	<.5	<.6	<85	<85	<.7	<.7	<120	<68	<40	<.5	<.5	<120	-
	10/27/98	<.24	<.23	<.27	<.28	<.27	<.26	<.17	<.21	<.26	<.23	<.29	<.36	-
	02/09/99	<.13	<.15	<.14	<.15	<.16	<.17	***	0.65	<.14	<.15	<.14	***	<.37
	06/08/99	<.13	<.15	<.14	<.15	<.16	<.17	***	.21*	<.14	<.15	<.14	***	<.37
	09/13/99	<.13	<.15	<.14	<.15	<.16	<.17	***	<.13	<.14	<.15	<.14	***	<.37
	03/13/00	<.32	<.28	<.36	<.35	<.15	<.39	***	<.37	<.33	<.11	<.34	***	<.71
	03/01/01	<.12	<.15	<.64	<.13	<.28	<.13	***	<.17	<.17	<.25	<.13	***	<.56
	03/19/02	<.12	<.15	<.64	<.13	<.28	<.13	***	<.17	<.17	<.25	<.13	***	<.56
	03/24/03	<.35	<.35	<.35	<.39	<.39	<.37	***	<.37	<.42	<.32	<.42	***	<.43
MW-103	02/20/97	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	-
	05/27/97	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	-
	09/18/97	<.5	<.6	<85	<.7	<.7	<.7	<124	<68	<40	<.5	<.5	<124	-
	12/12/97	<.5	<.6	<85	<.7	<.7	<.7	<120	<68	<40	<.5	<.5	<120	-
	03/25/98	<.5	<.6	<85	<.7	<.7	<.7	<120	<68	<40	<.5	<.5	<120	-
	06/10/98	<.5	<.6	<85	<.7	<.7	<.7	<120	<68	<40	<.5	<.5	<120	-
	10/27/98	<.24	<.23	<.27	<.28	<.27	<.26	<.17	<.21	<.26	<.23	<.29	<.36	-
	02/09/99	<.13	<.15	<.14	<.15	<.16	<.17	***	.15*	<.14	<.15	<.14	***	<.37
	06/08/99	<.13	<.15	<.14	<.15	<.16	<.17	***	<.13	<.14	<.15	<.14	***	<.37
	09/13/99	<.13	<.15	<.14	<.15	<.16	<.17	***	<.13	<.14	<.15	<.14	***	<.37
	03/13/00	<.32	<.28	<.36	<.35	<.15	<.39	***	<.37	<.33	<.11	<.34	***	<.71
	03/01/01	<.12	<.15	<.64	<.13	<.28	<.13	***	<.17	<.17	<.25	<.13	***	<.56
	03/19/02	<.12	<.15	<.64	<.13	<.28	<.13	***	<.17	<.17	<.25	<.13	***	<.56
	03/24/03	<.35	<.35	<.35	<.39	<.39	<.37	***	<.37	<.42	<.32	<.42	***	<.42

Table #7

GROUNDWATER ANALYTICAL RESULTS
Volatile Organic Compounds (VOC's)
 N.W. Mauthe Superfund Site - Appleton, Wisconsin
 MCO No. M0050-930746.26

Well Name	Sample Date	Benzene (ug/l)	Chloroform (ug/l)	1,1-Dichloroethane (ug/l)	1,1-Dichloroethene (ug/l)	cis-1,2-Dichloroethene (ug/l)	Trans-1,2-Dichloroethene (ug/l)	Ortho-Xylene (ug/l)	Toluene (ug/l)	1,1,1-Trichloroethane (ug/l)	1,1,2-Trichloroethane (ug/l)	Trichloroethene (ug/l)	Meta, para Xylene (ug/l)	Total Xylenes (ug/l)
MW-104	02/20/97	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	-
	05/27/97	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	-
	09/18/97	<.5	<.6	<85	<.7	<.7	<.7	<124	<68	.324*	<.5	<.5	<124	-
	12/12/97	<.5	<.6	0.4	<.7	<.7	<.7	<120	<68	1*	<.5	0.9	<120	-
	03/25/98	<.5	<.6	<85	<.7	<.7	<.7	<120	<68	.8*	<.5	<.5	<120	-
	06/10/98	<.5	<.6	<85	<.7	<.7	<.7	<120	<68	2*	<.5	<.5	<120	-
	10/27/98	<.24	<.23	.35*	<.28	<.27	<.26	<.17	<.21	1.8	<.23	<.29	<.36	-
	02/09/99	<.13	<.15	.38*	<.15	<.16	<.17	***	.17*	1.5	<.15	<.14	***	<.37
	06/08/99	<.13	<.15	.34*	<.15	<.16	<.17	***	.14*	1.4	<.15	<.14	***	<.37
	09/13/99	<.13	<.15	.38*	<.15	<.16	<.17	***	.27*	1.6	<.15	<.14	***	<.37
	03/13/00	<.32	<.28	.38*	<.35	<.15	<.39	***	<.37	1.6	<.11	<.34	***	<.71
	03/01/01	<.12	<.15	<.64	<.13	<.28	<.13	***	<.17	2.8	<.25	<.13	***	<.56
	03/19/02	<.12	<.15	<.64	<.13	<.28	<.13	***	<.17	2.4	<.25	<.23	***	<.56
	03/24/03	<.35	<.35	<.35	<.39	<.39	<.37	***	<.37	1.3*	<.32	<.42	***	<.43
MW-105	02/20/97	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	-
	05/27/97	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	-
	09/18/97	<.5	<.6	<85	<.7	<.7	<.7	<124	<68	<40	<.5	<.5	<124	-
	12/12/97	<.5	<.6	<85	<.7	<.7	<.7	<120	<68	<40	<.5	<.5	<120	-
	03/25/98	<.5	<.6	<85	<.7	<.7	<.7	<.4	<68	<40	<.5	<.5	.4*	-
	06/10/98	<.5	<.6	<85	<.7	<.7	<.7	<120	<68	<40	<.5	<.5	<120	-
	10/27/98	<.24	<.23	<.27	<.28	<.27	<.26	<.17	<.21	<.26	<.23	<.29	<.36	-
	02/09/99	.16*	<.15	<.14	<.15	<.16	<.17	***	.3*	<.14	<.15	<.14	***	<.37
	06/08/99	<.13	<.15	<.14	<.15	<.16	<.17	***	<.13*	<.14	<.15	<.14	***	<.37
	09/13/99	<.13	<.15	<.14	<.15	<.16	<.17	***	<.13	<.14	<.15	<.14	***	<.37
	03/13/00	<.32	<.28	<.36	<.35	<.15	<.39	***	<.37	<.33	<.11	<.34	***	<.71
	03/01/01	<.12	<.15	<.64	<.13	<.28	<.13	***	<.17	<.17	<.25	<.13	***	<.56
	03/19/02	<.12	<.15	<.64	<.13	<.28	<.13	***	<.17	<.17	<.25	<.13	***	<.56
	03/24/03	<.35	<.35	<.35	<.39	<.39	<.37	***	0.64*	<.42	<.32	<.42	***	<.43
MW-106	02/20/97	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	-
	05/27/97	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	-
	09/18/97	<.5	<.6	<85	<.7	<.7	<.7	<124	<68	2.73*	<.5	<.5	<124	-
	12/12/97	<.5	<.6	<85	<.7	<.7	<.7	<120	<68	<40	<.5	<.5	<120	-
	03/25/98	<.5	<.6	<85	<.7	<.7	<.7	<120	<68	<40	<.5	<.5	<120	-
	06/10/98	<.5	<.6	<85	<.7	<.7	<.7	<120	<68	<40	<.5	<.5	<120	-
	10/27/98	<.24	<.23	<.27	<.28	<.27	<.26	<.17	<.21	<.26	<.23	<.29	<.36	-
	02/09/99	.18*	<.15	<.14	<.15	<.16	<.17	***	<.17	<.14	<.15	<.14	***	<.37
	06/08/99	<.13	<.15	<.14	<.15	<.16	<.17	***	<.13	<.14	<.15	<.14	***	<.37
	09/13/99	<.13	<.15	<.14	<.15	<.16	<.17	***	<.13	<.14	<.15	<.14	***	<.37
	03/13/00	<.32	<.28	<.36	<.35	<.15	0.39	***	<.37	<.33	<.11	<.34	***	<.71
	03/01/01	<.12	<.15	<.64	<.13	<.28	<.13	***	<.17	<.17	<.25	<.13	***	<.56
	03/19/02	<.12	<.15	<.64	<.13	<.28	<.13	***	<.17	<.17	<.25	<.13	***	<.56
	03/24/03	<.35	<.35	<.35	<.39	<.39	<.37	***	5.7	<.42	<.32	<.42	***	<.43

Table #7

GROUNDWATER ANALYTICAL RESULTS
Volatile Organic Compounds (VOC's)
 N.W. Mauthe Superfund Site - Appleton, Wisconsin
 MCO No. M0050-930746.26

Well Name	Sample Date	Benzene (ug/l)	Chloroform (ug/l)	1,1-Dichloroethane (ug/l)	1,1-Dichloroethene (ug/l)	cis-1,2-Dichloroethene (ug/l)	Trans-1,2-Dichloroethene (ug/l)	Ortho-Xylene (ug/l)	Toluene (ug/l)	1,1,1-Trichloroethane (ug/l)	1,1,2-Trichloroethane (ug/l)	Trichloroethene (ug/l)	Meta, para Xylene (ug/l)	Total Xylenes (ug/l)
MW-107	02/20/97	<5	0.3	11	8.4	0.7	<7	<5	<5	81	0.6	50	<5	-
	05/27/97	0.09	1.10	36	40	3.1	<3.1	<5	0.34	390	3.5	420	<5	-
	09/18/97	<10	<12	47.6*	22.1	2.61*	<2.61	<2480	<68	265*	2.83	295	<2480	-
	12/12/97	<10	<12	56*	23	3*	<3	<2500	<68	280	3	290	<2500	-
	03/25/98	<25	<30	61*	69	5*	<5	<17	<68	720	5	620	17*	-
	06/10/98	<12	<15	59*	58	<3	<3	<3100	63*	340*	4*	390	<3100	-
	10/27/98	<24	1.4	62	46*	3.6	51*	<1.7	<2.1	550	4.9	640	<3.6	-
	02/09/99	<3.2	<3.8	48	24	<4.0	<4.2	***	<3.2	220	<3.8	250	***	<9.2
	06/08/99	<2.6	<3.0	42	20	<3.2	<3.4	***	<2.6	200	<3.0	310	***	<7.4
	09/13/99	<2.6	<3.0	34	19	<3.2	<3.4	***	<2.6	180	<3.0	320	***	<7.4
	12/15/99	<3.2	<3.8	37	56	4.6*	<4.2	***	<3.2	570	4.5*	680	***	<9.2
	03/13/00	<26	<23	50*	32*	<12	<31	***	<30	340	<9.0	630	***	<57
	06/22/00	<26	<23	<29	50	<12	<31	***	<30	540	<9	850	***	<57
	09/27/00	<26	<23	35*	54*	<12	<31	***	<30	560	<9	870	***	<57
	12/19/00	<6.4	<5.6	36	53	4.5*	<7.8	***	<7.5	480	4.1*	790	***	<20
	03/01/01	<6.0	<7.4	<32	<6.7	<14	<6.5	***	<8.7	420	<13	760	***	<28
	06/25/01	<6.5	<15	26	35	<9	<6.1	***	<6.2	360	<6.5	620	***	<32
	09/24/01	<6.5	<15	36	50	<9	<6.1	***	<6.2	480	<6.5	760	***	<32
	12/05/01	<6.5	<15	40	50	<9	<6.1	***	<6.2	500	<6.5	810	***	<32
	03/19/02	<6.0	<7.5	37*	43	<14	<6.5	***	<8.7	440	<13	740	***	<28
	06/20/02	<7.9	<11	31	39	<7.2	<8.9	***	<7.6	410	<6.8	690	***	<14
	09/18/02	<7.9	<11	34	39	<7.2	<8.9	***	<7.6	430	<6.8	710	***	<14
	12/17/02	<7.9	<11	40	43	<7.2	<8.9	***	<7.6	470	<6.8	850	***	<14
	03/24/03	<17	<18	33*	37*	<19	<19	***	<19	390	<16	640	***	<22
	06/10/03	<5.7	<8.0	<5.3	39	<11	<8.2	***	<7.2	400	<9.0	680	***	<17
	09/10/03	<17	<18	36*	41*	<19	<19	***	<19	430	<16	730	***	<22
	12/10/03	<17	<18	25*	31*	<19	<19	***	<19	380	<16	740	***	<22
	03/24/04	<7.5	<7.0	<7.1	22	<6.8	<6.0	***	<7.6	220	<8.1	370	***	<19
	07/29/04	<2.0	<1.8	29	25	<4.1	<4.4	***	<3.4	310	<3.4	510	***	<13.1
	09/22/04	<7.5	<7.0	28	34	<6.8	<6.0	***	<7.6	270	<8.1	570	***	<19
	12/14/04	<7.5	<7.0	33	40	<6.8	<6.0	***	<7.6	410	<8.1	800	***	<19
	03/29/05	<2.0	<1.8	39	20	<4.1	<4.4	***	<3.4	200	0.21	330	***	<13.1
	06/22/05	<1.0	<0.92	18	8.2	<2.1	<2.2	***	<1.7	182	<1.0	160	***	<6.6
	09/21/05	<2.0	<1.8	39	18.0	<4.1	<4.4	***	<3.4	220	<2.1	470	***	<13.1
	12/15/05	<2.0	<1.8	42	26.0	<4.1	<4.4	***	<3.4	250	<2.1	490	***	<13.1
	03/23/06	<2.0	<1.8	31	16.0	<4.1	<4.4	***	<3.4	150	<2.1	330	***	<13.1
	06/28/06	<2.0	<1.8	37	28.0	<4.1	<4.4	***	<3.4	270	<2.1	550	***	<13.1
	09/20/06	<4.1	<3.7	32	31.0	<8.3	<8.9	***	<6.7	330	<4.2	700	***	<26.3
	12/19/06	<2.0	<1.8	52	30	<4.1	<4.4	***	<3.4	280	3.3*	580	***	<13.1
	03/28/07	<0.82	<0.74	19	18	2.1	<1.8	***	<1.3	190	1.7*	340	***	<5.3
	07/03/07	<1.0	<0.92	30	15	2.3	<2.2	***	<1.7	160	1.5*	350	***	<6.6

Table #7

GROUNDWATER ANALYTICAL RESULTS
Volatile Organic Compounds (VOC's)
 N.W. Mauthe Superfund Site - Appleton, Wisconsin
 MCO No. M0050-930746.26

Well Name	Sample Date	Benzene (ug/l)	Chloroform (ug/l)	1,1-Dichloroethane (ug/l)	1,1-Dichloroethene (ug/l)	cis-1,2-Dichloroethene (ug/l)	Trans-1,2-Dichloroethene (ug/l)	Ortho-Xylene (ug/l)	Toluene (ug/l)	1,1,1-Trichloroethane (ug/l)	1,1,2-Trichloroethane (ug/l)	Trichloroethene (ug/l)	Meta, para Xylene (ug/l)	Total Xylenes (ug/l)
MW-108	02/20/97	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	-
	05/27/97	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	<.5	-
	09/18/97	<.5	<.6	<85	<.7	<.7	<.7	<124	<68	<40	<.5	<.5	<124	-
	12/12/97	<.5	<.6	<85	<.7	<.7	<.7	<120	<68	<40	<.5	<.5	<120	-
	03/25/98	<.5	<.6	<85	<.7	<.7	<.7	<120	<68	<40	<.5	<.5	<120	-
	06/10/98	<.5	<.6	<85	<.7	<.7	<.7	<120	<68	<44	<.5	<.5	<120	-
	10/27/98	<.24	<.23	<.22	<.28	<.28	<.26	<.17	<.21	<.26	<.23	<.29	<.36	-
	02/09/99	<.13	<.15	<.14	<.15	<.16	<.17	***	0.83	<.14	<.15	<.14	***	<.37
	06/08/99	<.13	<.15	<.14	<.15	<.16	<.17	***	.15*	<.14	<.15	<.14	***	<.37
	09/13/99	<.13	<.15	<.14	<.15	<.16	<.17	***	0.84	<.14	<.15	<.14	***	<.32
	03/13/00	<.32	<.28	<.36	<.35	<.15	<.39	***	<.37	<.33	<.11	<.36	***	<.71
	03/31/01	<.12	<.15	<.64	<.13	<.28	<.13	***	<.17	<.17	<.25	<.13	***	<.56
	03/19/02	<.12	<.15	<.64	<.13	<.28	<.13	***	<.17	<.17	<.25	<.13	***	<.56
	03/24/03	<.35	<.35	<.35	<.39	<.39	<.37	***	<.37	<.42	<.32	<.42	***	<.43
MW-109	06/21/06	-	0.40*	1.3*	1.9	<0.83	<0.89	-	-	37	0.45*	.46	-	-
	09/20/06	-	0.39*	1.7*	2.2	<0.83	<0.89	-	-	37	0.45*	.51	-	-
	12/19/06	<0.41	0.44*	2.7	1.1*	<0.83	<0.89	-	-	33	0.52*	.42	-	<2.63
	03/29/07	<0.41	<0.37	0.85	1.3	<0.83	<0.89	-	<13	27	<0.42	.37	-	<2.63
	07/03/07	<0.41	0.38*	1.7	1.3	<0.83	<0.89	-	<0.67	34	0.54*	.47	-	<2.63
MW-110	06/21/06	-	<3.7	310	340	56	19	-	-	1,500	<4.2	27	-	-
	09/20/06	-	<3.7	260	300	57	28*	-	-	1,100	<4.2	30	-	-
	12/19/06	<4.1	<3.7	230	240	55	16*	-	<6.7	910	<4.2	23	-	<2.63
	03/29/07	<8.2	<7.4	250	340	59	24	-	<13	1,500	<8.4	32	-	<53
	07/03/07	<8.2	<7.4	270	230	59	18	-	<13	1,300	<8.4	26	-	<53
MW-111	06/21/06	-	0.59*	2.7	1.1	<0.83	<0.89	-	-	78	0.71*	180	-	-
	09/20/06	-	<0.37	3.2	7.7	<0.83	<0.89	-	-	36	<0.42	97	-	-
	12/19/06	<0.41	<0.37	2.0*	1.5*	<0.83	<0.89	-	<0.67	7.9	<0.42	21	-	<2.63
	03/29/07	<0.41	0.77	1.7	7.3	<0.83	<0.89	-	<0.67	52	<0.42	120	-	<2.63
	07/03/07	<0.41	<0.37	<0.36	1.8	<0.83	<0.89	-	<0.67	14	<0.42	37	-	<2.63
MW-112	06/21/06	-	<1.8	<3.7	<3.8	<4.1	<4.4	-	-	7.9*	<2.1	450	-	-
	09/20/06	-	<0.37	<7.5	<5.7	<8.3	<8.9	-	-	<9.0	<4.2	540	-	-
	12/19/06	<2.0	<1.8	<3.8	<2.8	<4.1	<4.4	-	<3.4	<4.5	<2.1	240	-	<13.1
	03/29/07	<4.1	<3.7	<7.5	<5.7	<8.3	<8.9	-	<6.7	20	<4.2	940	-	<26.3
	07/03/07	<2.0	<1.8	<3.8	<2.8	<4.1	<4.4	-	<3.4	11	<2.1	750	-	<13.1
MW-113	06/21/06	-	<0.74	37	44	4.4*	<1.8	-	-	240	<0.84	92	-	-
	09/20/06	-	<0.37	22	19	3.6	1.3*	-	-	120	0.82*	81	-	-
	12/19/06	<2.0	<1.8	28	16	5.2*	<4.4	-	<3.4	120	<2.1	91	-	<13.1
	03/29/07	<0.41	<0.37	10	11	1.6	<0.89	-	<0.67	77	<0.42	46	-	<2.63
	07/03/07	<2.0	<1.8	21	8.1	4.9	<4.4	-	<13.1	79	<2.1	61	-	<13.1

Table #7

GROUNDWATER ANALYTICAL RESULTS
Volatile Organic Compounds (VOC's)
 N.W. Mauthe Superfund Site - Appleton, Wisconsin
 MCO No. M0050-930746.26

Well Name	Sample Date	Benzene (ug/l)	Chloroform (ug/l)	1,1-Dichloroethane (ug/l)	1,1-Dichloroethene (ug/l)	cis-1,2,-Dichloroethene (ug/l)	Trans-1,2,-Dichloroethene (ug/l)	Ortho-Xylene (ug/l)	Toluene (ug/l)	1,1,1-Trichloroethane (ug/l)	1,1,2-Trichloroethane (ug/l)	Trichloroethene (ug/l)	Meta, para Xylene (ug/l)	Total Xylenes (ug/l)
PZ-5	07/19/05	<0.37	<0.75	<0.57	<0.83	<0.89	NA	NA	1.7*	<0.42	<0.48	NA	NA	N
	09/21/05	<0.37	<0.75	<0.57	<0.83	<0.89	NA	NA	<0.90	<0.42	<0.48	NA	NA	NA
PZ-6	07/19/05	<0.37	<0.75	<0.57	<0.83	<0.89	NA	NA	<0.90	<0.42	<0.48	NA	NA	NA
	09/21/05	<0.37	<0.75	<0.57	<0.83	<0.89	NA	NA	<0.90	<0.42	<0.48	NA	NA	NA
1992 US EPA MCL		5.0	100	-	7.0	70	100	10,000	1,000	200	5.0	5.0	10,000**	10,000
1992 Enforcement Standards (ES) 140.10		5	6	850	7	100	100	620**	343	200	0.6	5	620**	620
1992 Preventive Action Plan (PAL) 140.10		0.067	0.6	85	0.024	10	20	124**	68.6	40	0.06	0.18	124**	124

EXPLANATION:

Results prior to 10/27/98 for cis-1,2,-Dichloroethene and Trans-1,2 Dichloroethene were listed as Total Dichloroethene and were placed in this table under the heading cis-1,2,-Dichlo
 Results prior to 10/27/98 for Ortho Xylene and Meta, para Xylene were listed as Total Xylenes and were placed in this table under the heading Meta, para Xylene.

- * = Analyte detected between limit of detection and limit of quantitation.
- ** = Standard includes Ortho-, Meta, para-Xylenes
- *** = As of 02/09/99 Xylene results are listed as "Total Xylenes".

WM Equipment Malfunction, no accurate measurement.

NOTE: The EPA Record of Decision establishes the 1992 PAL's as the clean-up goals for the site.

- ND = Not Detected
- NA = Not Analyzed
- MCL = Maximum Contaminant Levels
- ug/l = Microgram/Liter



 = Indicates an exceedance of the 1992 NR 140 Groundwater Quality Enforcement Standards (ES)
 = Indicates an exceedance of the 1992 NR 140 Groundwater Quality Preventive Action Limits (PAL)


Table #8

WEEKLY INFLUENT HEXAVALENT CHROMIUM RESULTS
 N.W. Mauth Superfund Site - Appleton, Wisconsin
 MCO. No. M0050-930748.28

DATE	INFLUENT HEXAVALENT CHROMIUM* (ppm)	DATE	INFLUENT HEXAVALENT CHROMIUM* (ppm)	DATE	INFLUENT HEXAVALENT CHROMIUM* (ppm)	DATE	INFLUENT HEXAVALENT CHROMIUM* (ppm)	DATE	INFLUENT HEXAVALENT CHROMIUM* (ppm)	DATE	INFLUENT HEXAVALENT CHROMIUM* (ppm)	DATE	INFLUENT HEXAVALENT CHROMIUM* (ppm)
02/26/97	1.0	05/08/98	1.3	07/14/99	2.0	09/20/00	1.2	11/29/01	1.4	02/08/03	0.0	04/22/04	0.2
03/03/97	8	05/13/98	1.3	07/21/99	1.6	09/27/00	1.4	12/08/01	1.5	02/14/03	0.0	04/28/04	0.7
03/06/97	1.0	05/20/98	1.3	07/28/99	1.2	10/03/00	1.3	12/14/01	2.0	02/20/03	0.0	05/06/04	0.5
03/10/97	1.5	05/27/98	1.4	08/04/99	1.5	10/11/00	1.3	12/20/01	2.0	02/27/03	0.3	05/13/04	1.2
03/23/97	.9	06/03/98	1.3	08/11/99	1.4	10/18/00	2.5	12/27/01	2.5	03/06/03	0.3	05/22/04	1.3
03/28/97	1.2	06/10/98	1.4	08/18/99	1.3	10/25/00	2.2	01/03/02	2.5	03/13/03	0.3	05/27/04	0.5
04/06/97	1.1	06/17/98	1.2	08/25/99	1.3	11/01/00	1.8	01/10/02	2.0	03/22/03	0.4	06/03/04	0.5
04/09/97	1.2	06/24/98	1.2	09/01/99	1.3	11/08/00	1.4	01/17/02	2.5	03/27/03	0.4	06/10/04	0.5
04/18/97	1.0	07/01/98	1.1	09/08/99	1.4	11/15/00	1.8	01/24/02	2.0	04/03/03	1.2	06/17/04	0.7
04/25/97	1.0	07/08/98	1.1	09/15/99	1.5	11/22/00	1.6	01/31/02	1.5	04/11/03	1.4	06/24/04	0.7
04/27/97	1.1	07/15/98	1.1	09/22/99	1.3	11/29/00	1.4	02/07/02	2.5	04/18/03	0.8	07/01/04	0.7
05/02/97	1.1	07/23/98	1.3	09/29/99	1.2	12/06/00	1.6	02/13/02	2.5	04/25/03	1.1	07/08/04	1.1
05/08/97	1.1	07/29/98	1.3	10/06/99	1.4	12/13/00	1.4	02/21/02	3.0	05/01/03	1.2	07/15/04	1.0
05/13/97	1.1	08/05/98	1.2	10/13/99	1.5	12/20/00	1.2	02/28/02	2.5	05/08/03	0.8	07/22/04	1.1
05/21/97	1.2	08/12/98	1.2	10/20/99	1.4	12/27/00	1.3	03/07/02	2.0	05/15/03	0.4	07/29/04	0.5
05/28/97	1.1	08/19/98	1.2	10/27/99	1.4	01/03/01	1.2	03/14/02	1.5	05/22/03	1.2	08/05/04	0.7
06/06/97	1.2	08/26/98	1.2	11/04/99	1.3	01/10/01	1.4	03/21/02	2.5	06/01/03	1.1	08/12/04	1.2
06/13/97	1.2	09/02/98	1.2	11/10/99	1.2	01/17/01	1.6	03/28/02	1.5	06/11/03	1.1	08/19/04	1.1
06/17/97	1.3	09/09/98	1.2	11/18/99	1.3	01/24/01	1.4	04/04/02	1.5	06/18/03	1.4	08/26/04	1.1
06/23/97	1.2	09/16/98	1.2	11/24/99	1.2	01/31/01	1.3	04/11/02	1.5	06/26/03	0.8	09/02/04	1.8
07/02/97	1.2	09/23/98	1.2	11/30/99	1.3	02/07/01	1.2	04/18/02	2.0	07/03/03	0.9	09/09/04	1.5
07/09/97	1.2	09/30/98	1.2	12/08/99	1.3	02/13/01	2.0	04/25/02	2.5	07/10/03	1.0	09/16/04	1.3
07/14/97	1.2	10/07/98	1.0	12/15/99	1.2	02/21/01	1.5	05/02/02	3.0	07/17/03	1.0	09/23/04	1.1
07/21/97	1.2	10/15/98	1.1	12/22/99	1.3	02/28/01	1.4	05/09/02	1.5	07/24/03	1.0	09/30/04	1.1
07/28/97	1.4	10/21/98	1.3	12/29/99	1.2	03/17/01	1.3	05/16/02	1.5	07/31/03	1.0	10/07/04	0.8
08/03/97	1.4	10/28/98	1.3	01/05/00	1.3	03/14/01	1.2	05/23/02	1.5	08/07/03	1.4	10/14/04	0.8
08/13/97	1.3	11/04/98	1.1	01/12/00	1.3	03/21/01	1.3	05/30/02	2.0	08/14/03	1.2	10/21/04	0.4
08/18/97	1.3	11/11/98	1.1	01/19/00	1.2	03/28/01	1.2	06/06/02	1.5	08/21/03	1.0	10/28/04	0.4
08/25/97	1.3	11/18/98	1.2	01/26/00	1.2	04/04/01	1.4	06/13/02	2.0	08/28/03	1.0	11/04/04	0.7
09/04/97	1.3	11/25/98	1.2	02/02/00	1.1	04/11/01	1.2	06/20/02	3.0	09/04/03	0.1	11/11/04	0.7
09/08/97	1.5	12/02/98	1.2	02/09/00	1.1	04/18/01	1.2	06/27/02	2.0	09/11/03	0.1	11/18/04	0.7
09/15/97	1.4	12/09/98	1.5	02/16/00	1.2	04/25/01	1.4	07/03/02	2.0	09/18/03	0.0	11/25/04	0.7
09/24/97	1.3	12/16/98	1.3	02/23/00	1.3	05/02/01	1.3	07/11/02	1.5	09/25/03	0.0	12/02/04	0.7
10/01/97	1.3	12/23/98	1.3	03/01/00	1.2	05/09/01	1.3	07/18/02	1.0	10/02/03	0.0	12/09/04	0.7
10/08/97	1.4	12/30/98	1.3	03/08/00	1.3	05/16/01	1.2	07/25/02	0.1	10/09/03	0.3	12/16/04	0.8
10/15/97	1.3	01/06/99	1.3	03/14/00	1.2	05/23/01	1.3	08/01/02	0.0	10/16/03	0.3	12/23/04	0.8
10/22/97	1.4	01/12/99	1.1	03/22/00	1.2	05/30/01	1.1	08/08/02	0.0	10/23/03	0.7	12/30/04	1.3
10/29/97	1.4	01/20/99	1.2	03/29/00	1.1	06/06/01	1.2	08/15/02	0.0	10/30/03	1.1	01/06/05	1.3
11/05/97	1.3	01/27/99	1.3	04/05/00	1.4	06/13/01	1.4	08/22/02	0.0	11/06/03	1.0	01/13/05	1.3
11/11/97	1.2	02/03/99	1.3	04/11/00	1.1	06/20/01	1.2	08/29/02	0.0	11/13/03	1.4	01/20/05	1.0
11/22/97	1.0	02/10/99	1.4	04/18/00	1.1	06/27/01	1.3	09/05/02	0.0	11/20/03	1.4	01/27/05	0.9
11/24/97	1.0	02/17/99	1.4	04/26/00	1.1	07/04/01	1.3	08/12/02	0.4	11/27/03	1.2	02/03/05	1.2
12/03/97	1.0	02/24/99	1.4	05/03/00	1.3	07/11/01	1.2	08/19/02	0.1	12/04/03	1.1	02/10/05	1.0
12/10/97	1.0	03/03/99	1.3	05/10/00	1.1	07/18/01	1.4	08/26/02	0.0	12/11/03	1.5	02/17/05	1.0
12/17/97	1.1	03/10/99	1.3	05/17/00	1.2	07/25/01	1.3	10/03/02	0.0	12/18/03	1.3	02/24/05	1.0
01/07/98	1.0	03/17/99	1.3	05/24/00	1.1	08/01/01	1.6	10/10/02	1.5	12/25/03	0.5	03/03/05	1.0
01/14/98	1.0	03/24/99	1.3	05/31/00	1.1	08/08/01	1.3	10/17/02	1.5	01/02/04	0.8	03/10/05	0.9
01/21/98	1.0	03/31/99	1.3	06/07/00	1.4	08/15/01	1.2	10/24/02	1.5	01/08/04	0.8	03/17/05	0.8
01/28/98	1.0	04/07/99	1.2	06/14/00	0.5	08/22/01	1.1	10/31/02	1.5	01/15/04	0.8	03/24/05	0.8
02/04/98	1.4	04/14/99	1.2	06/21/00	1.0	08/29/01	1.3	11/07/02	1.5	01/22/04	0.8	03/31/05	0.7
02/11/98	1.4	04/21/99	1.1	06/28/00	1.1	09/05/01	1.4	11/14/02	1.5	01/29/04	0.6	04/07/05	1.2
02/18/98	1.4	04/28/99	1.2	07/05/00	1.3	09/12/01	1.4	11/21/02	1.0	02/05/04	0.5	04/14/05	1.1
02/25/98	0.8	05/05/99	1.2	07/12/00	1.2	09/19/01	3.0	11/27/02	1.5	02/12/04	0.0	04/21/05	1.8
03/04/98	1.3	05/12/99	1.2	07/19/00	1.3	09/26/01	2.4	12/05/02	0.0	02/19/04	0.0	04/28/05	1.9
03/11/98	1.3	05/19/99	1.1	07/26/00	1.3	10/01/01	1.5	12/12/02	0.0	02/26/04	0.9	05/05/05	1.2
03/18/98	1.3	05/26/99	1.2	08/02/00	1.3	10/08/01	2.5	12/19/02	0.2	03/04/04	1.3	05/12/05	1.2
03/26/98	1.3	06/02/99	1.1	08/09/00	1.4	10/15/01	2.0	12/26/02	0.2	03/11/04	0.8	05/19/05	0.9
04/01/98	0.8	06/09/99	1.4	08/16/00	1.2	10/22/01	2.3	01/02/03	0.4	03/18/04	0.8	05/26/05	1.5
04/08/98	1.0	06/16/99	1.5	08/23/00	1.4	10/31/01	2.5	01/09/03	0.4	03/25/04	0.8	06/02/05	1.5
04/15/98	1.3	06/23/99	2.2	08/30/00	1.3	11/07/01	1.4	01/16/03	0.0	04/01/04	0.8	06/09/05	1.5
04/23/98	1.3	06/30/99	2.2	09/06/00	1.4	11/17/01	1.2	01/23/03	0.1	04/08/04	0.5	06/16/05	1.3
04/29/98	1.3	07/07/99	2.4	09/13/00	1.2	11/21/01	1.3	01/30/03	0.3	04/15/04	0.2	06/23/05	1.3

Note: Beginning June 6, 2006, the hexavalent chromium results are based upon laboratory analysis. The prior results were based on testing using a Hach kit.

08/19/06	1.10
09/26/06	1.20
10/03/06	1.8
10/10/06	1.8
10/17/06	1.8
10/24/06	2.1
10/31/06	1.7
11/07/06	1.5
12/06/06	2.4
01/03/07	1.6
02/08/07	1.8
03/06/07	2.1
04/03/07	1.5
04/10/07	1.3
04/17/07	1.2
04/24/07	0.87
05/01/07	1.1
05/08/07	0.8
05/15/07	0.78
05/22/07	0.98
05/29/07	0.88
06/05/07	1.8
06/12/07	1.3
06/19/07	1.2
06/26/07	1.8

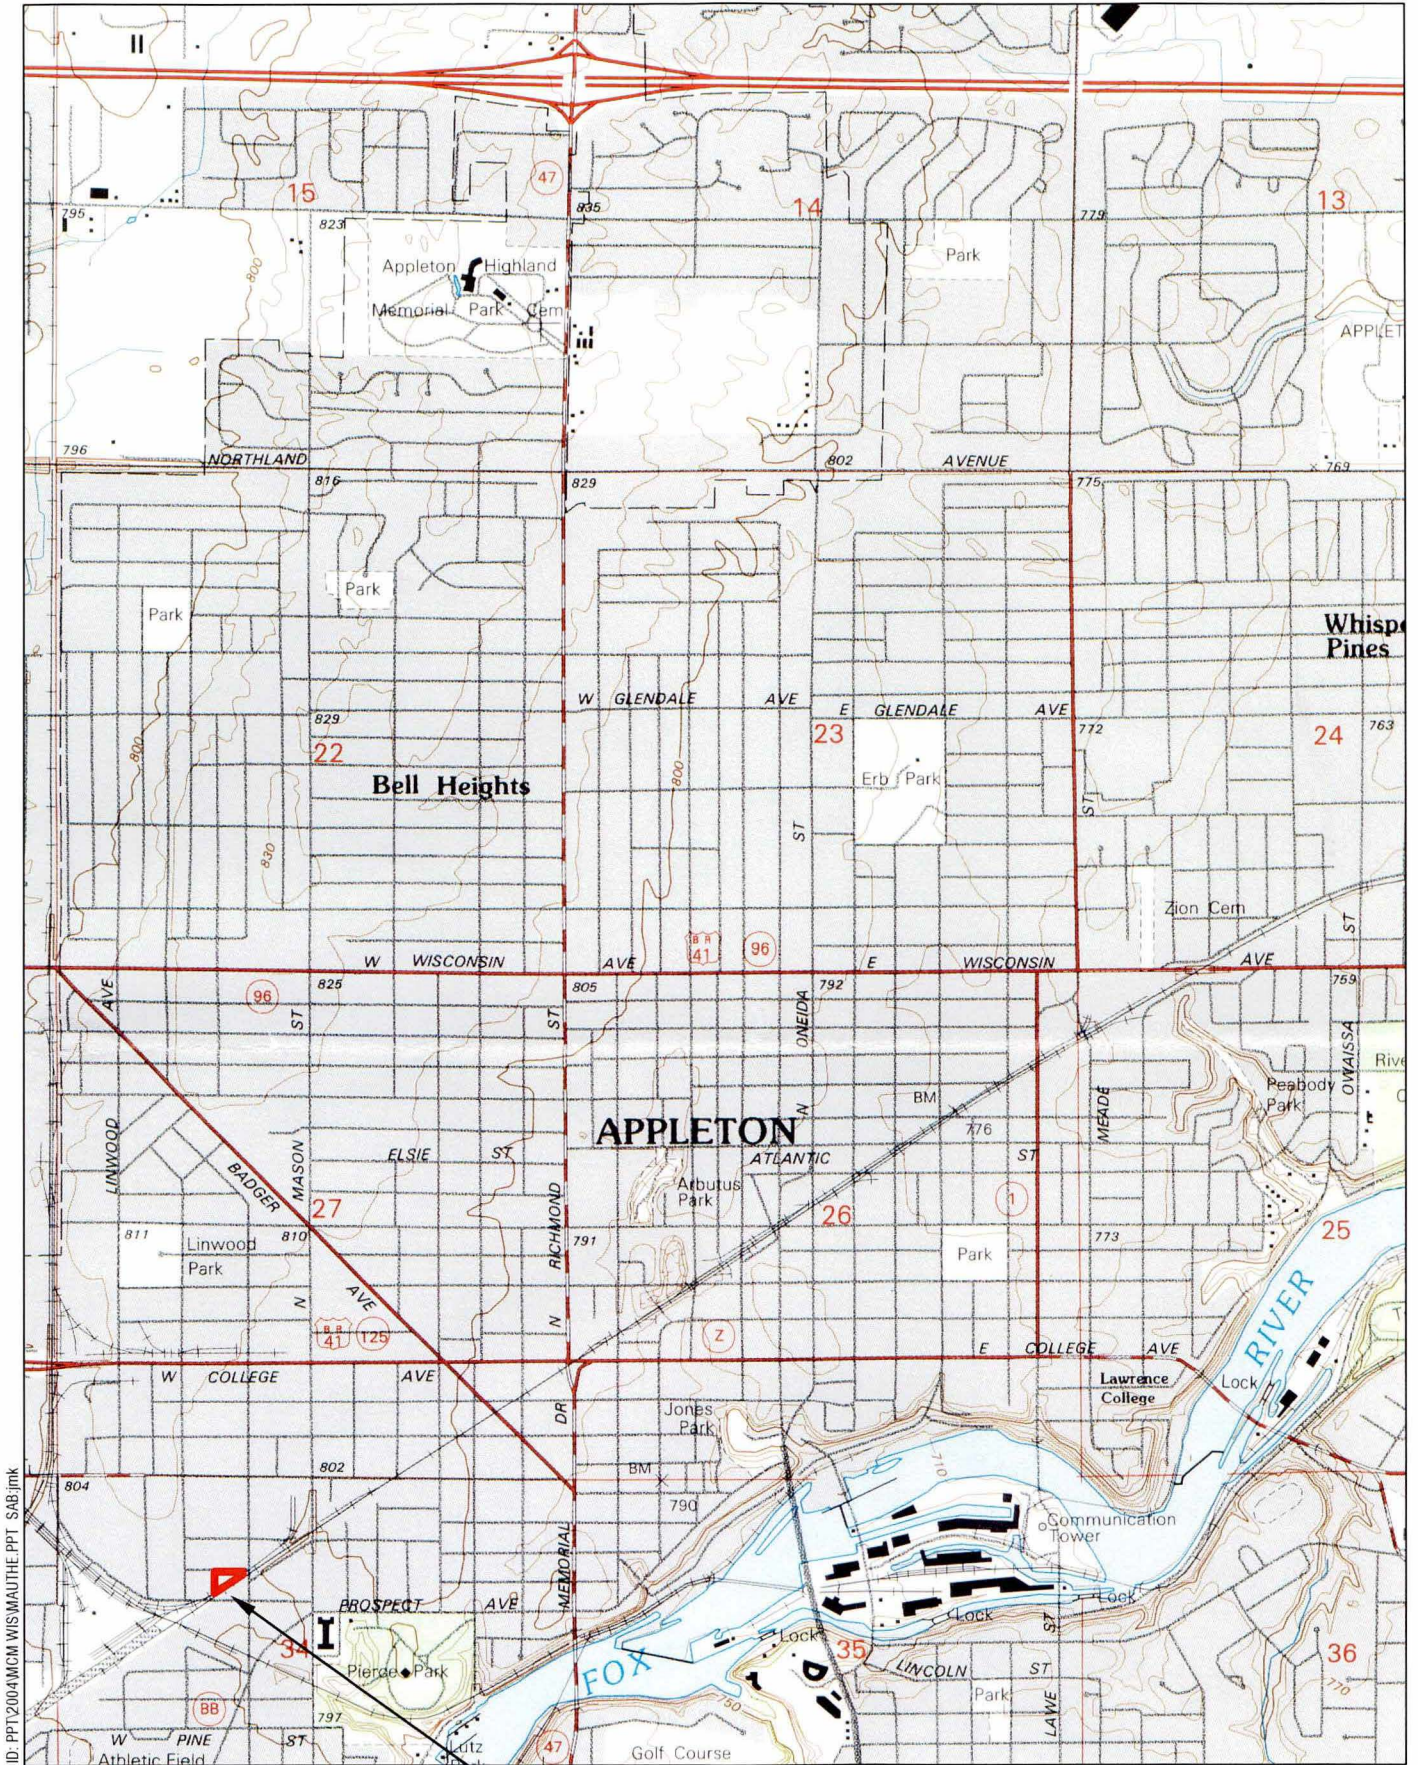

ID: PPT2004\MCM WISMAUTHE.PPT SAB:jmk



McMAHON
ASSOCIATES
ENGINEERS | ARCHITECTS | SURVEYORS | PROJECT MANAGERS

NORTH
SCALE: 1" = 2000'

SITE LOCATION

Figure 1
SITE LOCATION MAP

N.W. MAUTHE SUPERFUND SITE - APPLETON, WI
McM #M0050-930746.26 8/11/04

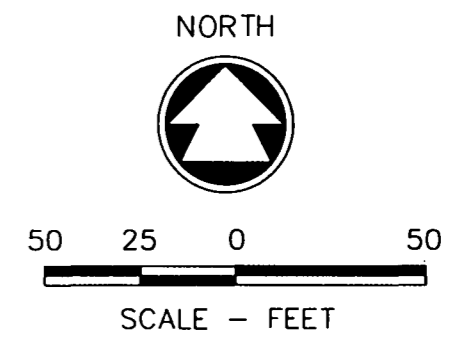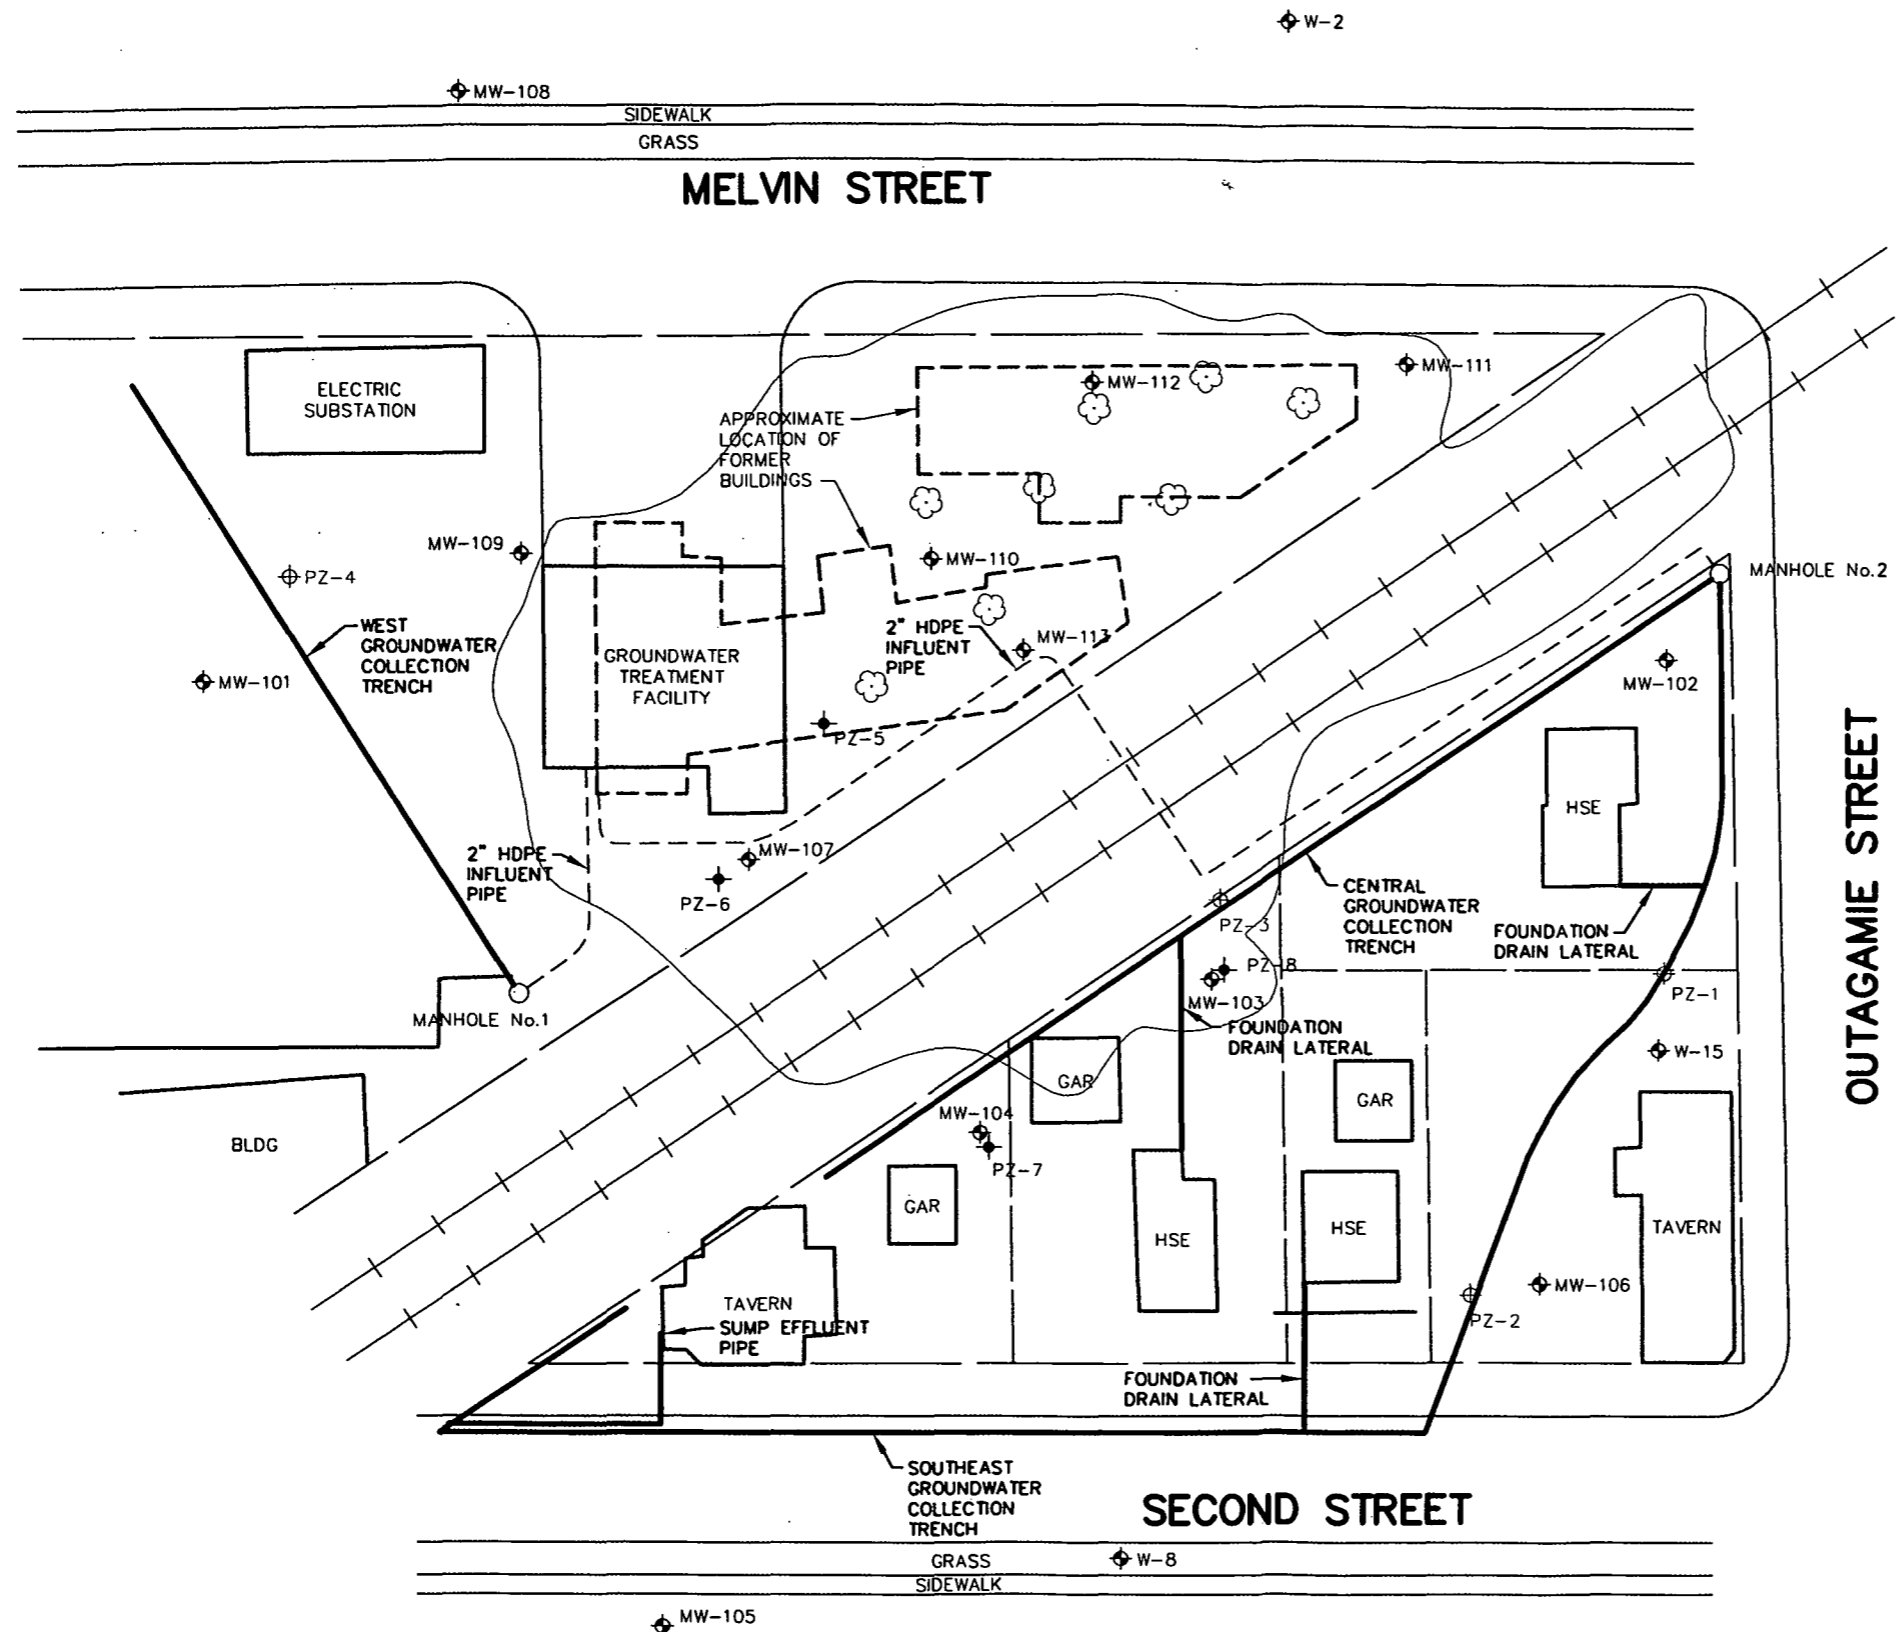

LEGEND


- ◆ MW-101 MONITORING WELL
 - ◆ PZ-8 PIEZOMETER (Installed by Omni Associates, Inc. in 2005)
 - ⊕ PZ-1 ABANDONED PIEZOMETER
 - APPROXIMATE SOIL REMEDIATION EXCAVATION LIMITS JULY 11 - OCTOBER 27, 1995 (10,834 TONS)
- Note:**
Monitoring wells MW-109 through MW-113 were installed by Omni Associates, Inc. in May, 2006.

FIGURE 2
COLLECTION TRENCH AND
MONITORING WELL LOCATIONS
N.W. MAUTHE SUPERFUND SITE

APPLETON, WISCONSIN
McM# M0050-930746.26 JUNE 2007

c:\clemens W:\DWG\M0050\930746\26\20070705\Fig-02.dwg 07/27/07 4:37 PM

c:\clemens w:\DWG\M0050\930746\26\20070705\Fig-03.dwg 07/27/07 5:04 PM

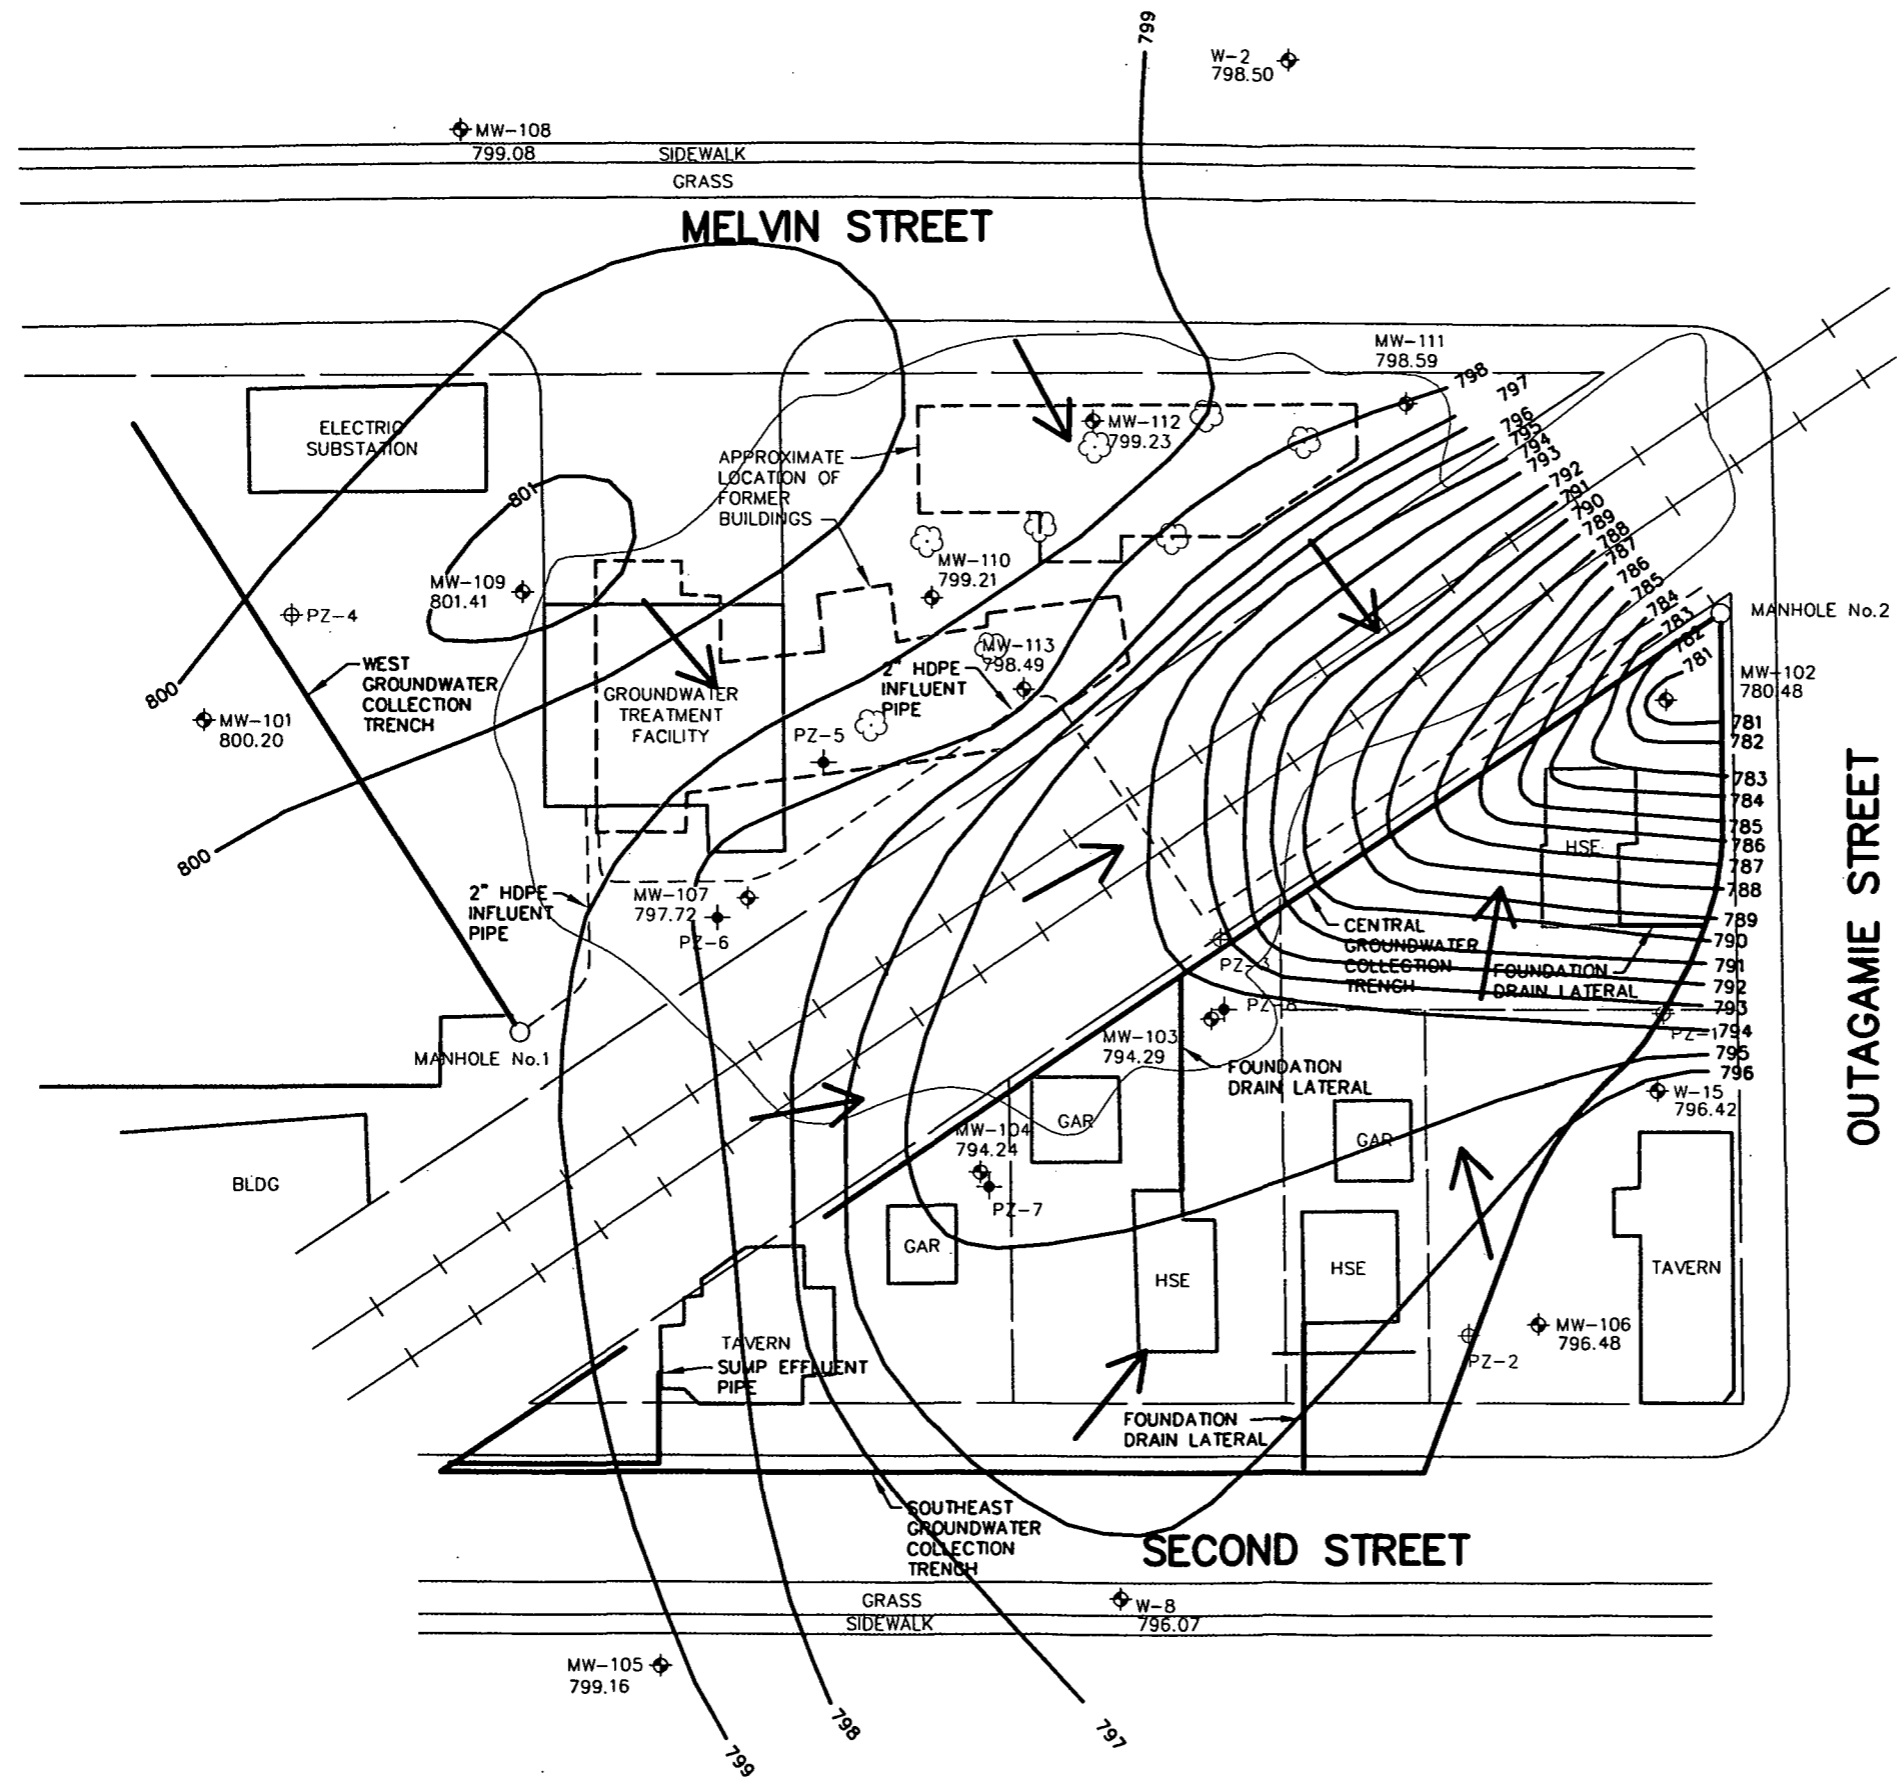

LEGEND



- ⊕ MW-101 MONITORING WELL
- ⊕ PZ-8 PIEZOMETER (Installed by Omni Associates, Inc. in 2005)
- ⊕ PZ-1 ABANDONED PIEZOMETER
- APPROXIMATE SOIL REMEDIATION EXCAVATION LIMITS JULY 11 - OCTOBER 27, 1995 (10,834 TONS)
- ⊕ W-2 804.58 MONITORING WELL & GROUNDWATER ELEVATION
- GROUNDWATER FLOW DIRECTION
- 797 — GROUNDWATER CONTOUR

NOTE:
THE GROUNDWATER CONTOURS WERE DRAWN ASSUMING NO INFLUENCE BY THE GROUNDWATER COLLECTION SYSTEM, WHICH IS NOT THE CASE.

Note:
Monitoring wells MW-109 through MW-113 were installed by Omni Associates, Inc. in Moy, 2006.

FIGURE 3
GROUNDWATER CONTOURS
JULY 5, 2007
N.W. MAUTHE SUPERFUND SITE

APPLETON, WISCONSIN
McM# M0050-930746.26

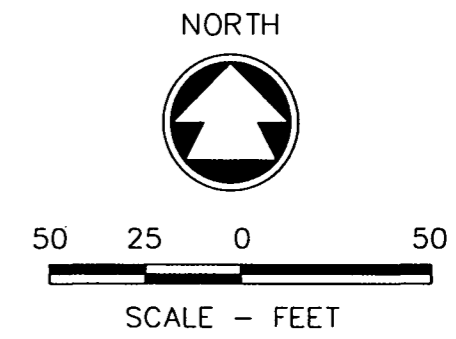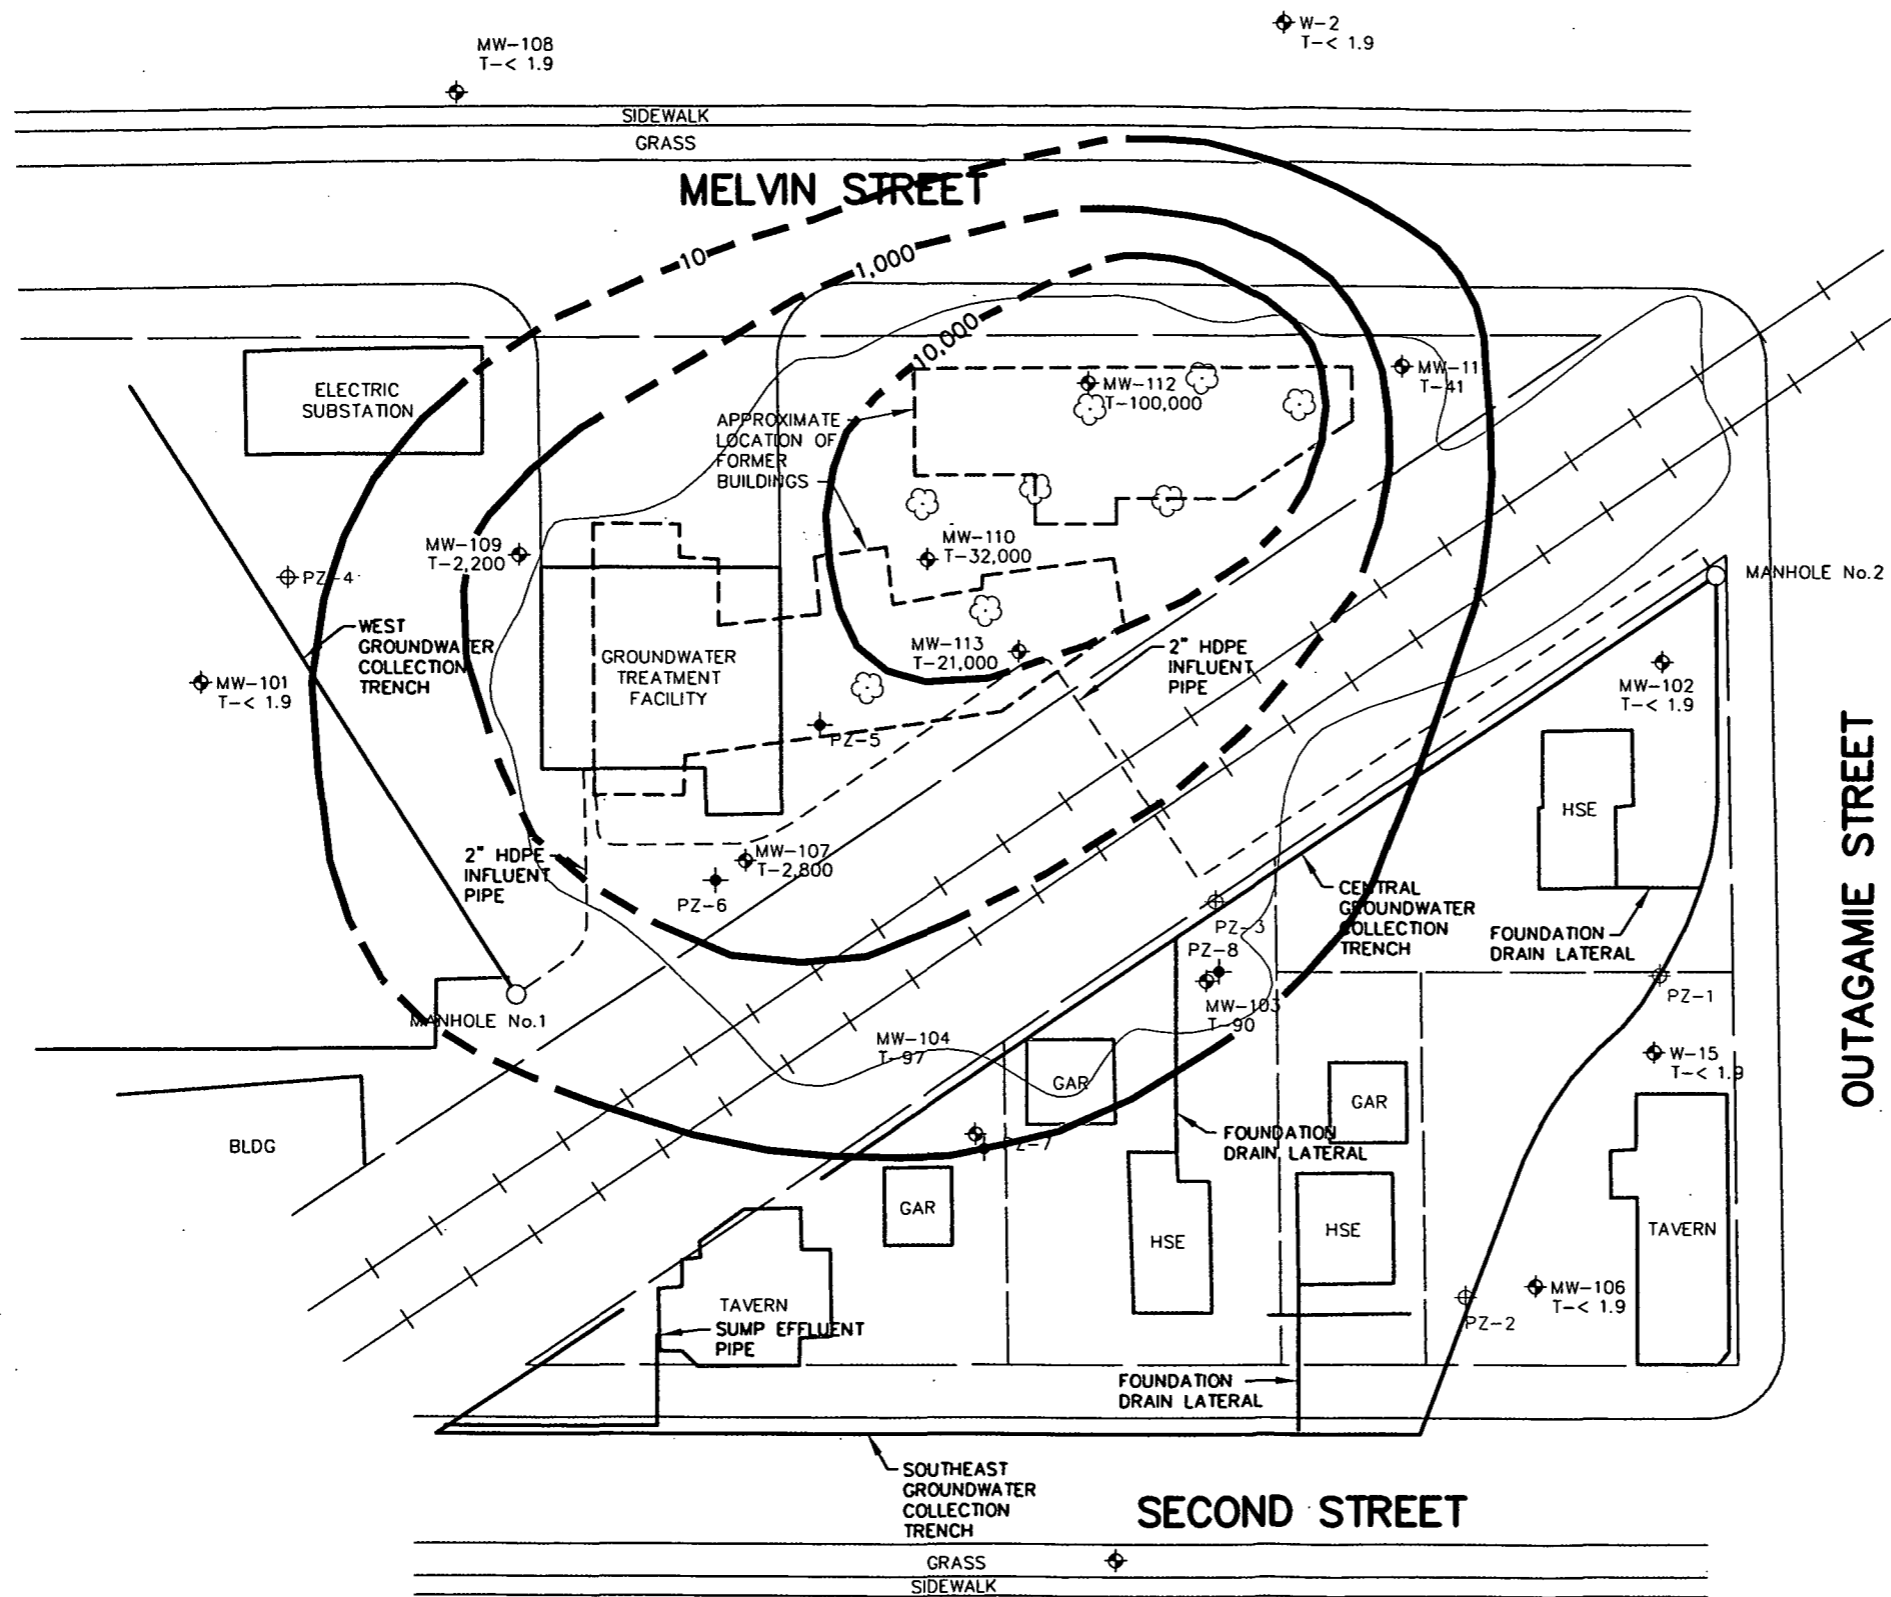

OUTAGAMIE STREET

LEGEND

- ◆ MW-101 MONITORING WELL
- ◆ PZ-8 PIEZOMETER (Installed by Omni Associates, Inc. in 2005)
- ⊕ PZ-1 ABANDONED PIEZOMETER
- APPROXIMATE SOIL REMEDIATION EXCAVATION LIMITS JULY 11 - OCTOBER 27, 1995 (10,834 TONS)
- 10 ISOCONCENTRATION OF TOTAL CHROMIUM (ESTIMATED) (dashed where inferred)
- < LESS THAN THE DETECTION LIMIT
- ug/L MICROGRAM/LITER
- T TOTAL CHROMIUM CONCENTRATION (ug/L) IN THE GROUNDWATER
- H HEXAVALENT CHROMIUM CONCENTRATION (ug/L) IN THE GROUNDWATER
- ANALYTE DETECTED IN THE AREA OF LESS CERTAIN QUANTITATION

NOTE:
DATA SHOWN FROM MONITORING WELLS W-2, W-8, W-15, MW-101, MW-102, MW-105, MW-106 AND MW-108 ARE FROM THE MOST RECENT ANNUAL SAMPLING EVENT. SEE TABLE 6 FOR DATE.

Note:
Monitoring wells MW-109 through MW-113 were installed by Omni Associates, Inc. in May, 2006.

FIGURE 4
ISOCONCENTRATION MAP
TOTAL CHROMIUM ug/L In Groundwater
JULY 6, 2007
N.W. MAUTHE SUPERFUND SITE
 APPLETON, WISCONSIN
 McM# M0050-930746.26

c:\clemens\w\DWG\M0050\930746\26\20070705\Fig-04.dwg 07/30/07 8:33 AM

APPENDIX A

LABORATORY ANALYTICAL RESULTS

Company Name: **MCO**
 Branch/Location: **Menasha**
 Project Contact: **Stuart Boerst**
 Phone: **920-751-4200**
 Project Number:
 Project Name: **Mauthe**
 Project State: **WF**
 Sampled By (Print): **Paul Much**
 Sampled By (Sign): **Paul Much**
 PO #:
 Regulatory Program:

CHAIN OF CUSTODY

*Preservation Codes
 A=None B=HCL C=H2SO4 D=HNO3 E=DI Water F=Methanol G=NaOH
 H=Sodium Bisulfate Solution I=Sodium Thiosulfate J=Other

FILTERED? (YES/NO)	Y	N	Y	Y					
PRESERVATION (CODE)*	D	B	D	G					

Quote #:
 Mail To Contact: **Stuart Boerst**
 Mail To Company: **McMahon**
 Mail To Address: **Neenah**
 Invoice To Contact: **Randy Much**
 Invoice To Company: **MCO**
 Invoice To Address: **Menasha**
 Invoice To Phone: **920-751-4760**
 CLIENT COMMENTS
 LAB COMMENTS (Lab Use Only)
 Profile #

Data Package Options (billable)
 EPA Level III
 EPA Level IV
 MS/MSD
 On your sample (billable)
 NOT needed on your sample
 Matrix Codes
 A = Air W = Water
 B = Biota DW = Drinking Water
 C = Charcoal GW = Ground Water
 O = Oil SW = Surface Water
 S = Soil WW = Waste Water
 Sl = Sludge WP = Wipe

PACE LAB #	CLIENT FIELD ID	COLLECTION		MATRIX	Analyses Requested	Y	N	Y	Y
		DATE	TIME						
001	MW-103	4/3		GW	Total chrome VOC Zinc Cyanide	X			
002	MW-104	4/3		GW		X			
003	MW-107	4/3		GW		X	X		
004	MW-109	4/3		GW		X	X		
005	MW-110	4/3		GW		X	X		
006	MW-111	4/3		GW		X	X		
007	MW-112	4/3		GW		X	X	X	X
008	MW-112d	4/3		GW		X	X	X	X
009	MW-113	4/3		GW		X	X		
010	Trip Blank								

250 mL D
 ↓
 250 mL D 340 mL HCl
 ↓
 (2) Not Needed per PM
 ↓
 250 mL D, G 340 mL HCl
 ↓
 250 mL D 340 mL HCl
 240 mL HCl
 (1) Collected 7-3-07 per PM 7-9-07

Rush Turnaround Time Requested - Prelims (Rush TAT subject to approval/surcharge)
 Date Needed:
 Transmit Prelim Rush Results by (complete what you want):
 Email #1:
 Email #2:
 Telephone:
 Fax:
 Samples on HOLD are subject to special pricing and release of liability

Relinquished By: Paul Much Date/Time: 4/3/07	Received By: D. Kemper Date/Time: 7/5/07 1105	PACE Project No. 885708 Receipt Temp = 101 °C Sample Receipt pH OK / Adjusted Cooler Custody Seal Present / Not Present Intact / Not Intact
Relinquished By: D. Kemper Date/Time: 7/5/07 1445	Received By: Mark W. Janke Date/Time: 7-5-07 1445	
Relinquished By:	Received By:	
Relinquished By:	Received By:	



1241 Bellevue Street, Suite 9
 Green Bay, WI 54302
 920-469-2436, Fax: 920-469-8827

Analytical Report Number: 885708

Client: MIDWEST CONTRACT OPERATIONS, INC.

Lab Contact: Brian Basten

Project Name: MAUTHE

Project Number:

Lab Sample Number	Field ID	Matrix	Collection Date
885708-001	MW-103	WATER	07/03/07
885708-002	MW-104	WATER	07/03/07
885708-003	MW-107	WATER	07/03/07
885708-004	MW-109	WATER	07/03/07
885708-005	MW-110	WATER	07/03/07
885708-006	MW-111	WATER	07/03/07
885708-007	MW-112	WATER	07/03/07
885708-008	MW-112D	WATER	07/03/07
885708-009	MW-113	WATER	07/03/07
885708-010	TRIP BLANK	WATER	07/03/07

I certify that the data contained in this Final Report has been generated and reviewed in accordance with approved methods and Laboratory Standard Operating Procedure. Exceptions, if any, are discussed in the accompanying sample comments. Release of this final report is authorized by Laboratory management, as is verified by the following signature. This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, Inc. The sample results relate only to the analytes of interest tested.

Results reported herein conform to the most current NELAC standards, where applicable, unless otherwise narrated in the body of the report.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, Inc..



[Handwritten Signature]
 Approval Signature

7-16-07
 Date

Client : MIDWEST CONTRACT OPERATIONS, INC.

Matrix Type : WATER

Project Name : MAUTHE

Collection Date : 07/03/07

Project Number :

Report Date : 07/13/07

Field ID : MW-103

Lab Sample Number : 885708-001

INORGANICS

Test	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
Chromium - Dissolved	90	0.67	2.2		1	ug/L		07/11/07 02:58 PM	SW846 6010B	SW846 6010B
								Prep Date/Time: 07/11/07	Anl By: DLB	

Client : MIDWEST CONTRACT OPERATIONS, INC.

Project Name : MAUTHE

Project Number :

Field ID : MW-104

Matrix Type : WATER

Collection Date : 07/03/07

Report Date : 07/13/07

Lab Sample Number : 885708-002

INORGANICS

Test	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
Chromium - Dissolved	97	0.67	2.2		1	ug/L		07/11/07 03:03 PM	SW846 6010B	SW846 6010B
								Prep Date/Time: 07/11/07	Anl By: DLB	

Client : MIDWEST CONTRACT OPERATIONS, INC.

Project Name : MAUTHE

Project Number :

Field ID : MW-107

Matrix Type : WATER

Collection Date : 07/03/07

Report Date : 07/13/07

Lab Sample Number : 885708-003

INORGANICS

Test	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
Chromium - Dissolved	2800	0.67	2.2		1	ug/L		07/11/07 03:07 PM	SW846 6010B	SW846 6010B
								Prep Date/Time: 07/11/07	Anl By: DLB	

VOLATILES

Analyte	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
Prep Date/Time: 07/10/07 9:23 AM Anl By: SMT										
1,1,1,2-Tetrachloroethane	< 2.3	2.3	7.7		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
1,1,1-Trichloroethane	160	2.2	7.5		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
1,1,2,2-Tetrachloroethane	< 0.50	0.50	1.7		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
1,1,2-Trichloroethane	1.5	1.0	3.5		2.5	ug/L	Q	07/10/07 9:23 AM	SW846 5030B	SW846 8260B
1,1-Dichloroethane	30	1.9	6.2		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
1,1-Dichloroethene	15	1.4	4.7		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
1,1-Dichloropropene	< 1.9	1.9	6.2		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
1,2,3-Trichlorobenzene	< 1.8	1.8	6.2		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
1,2,3-Trichloropropane	< 2.5	2.5	8.2		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
1,2,4-Trichlorobenzene	< 2.4	2.4	8.1		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
1,2,4-Trimethylbenzene	< 2.4	2.4	8.1		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
1,2-Dibromo-3-chloropropane	< 2.2	2.2	7.2		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
1,2-Dibromoethane	< 1.4	1.4	4.7		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
1,2-Dichlorobenzene	< 2.1	2.1	6.9		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
1,2-Dichloroethane	< 0.90	0.90	3.0		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
1,2-Dichloropropane	< 1.2	1.2	3.8		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
1,3,5-Trimethylbenzene	< 2.1	2.1	6.9		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
1,3-Dichlorobenzene	< 2.2	2.2	7.2		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
1,3-Dichloropropane	< 1.5	1.5	5.1		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
1,4-Dichlorobenzene	< 2.4	2.4	7.9		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
2,2-Dichloropropane	< 1.6	1.6	5.2		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
2-Chlorotoluene	< 2.1	2.1	7.1		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
4-Chlorotoluene	< 1.8	1.8	6.2		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Benzene	< 1.0	1.0	3.4		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Bromobenzene	< 2.0	2.0	6.8		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Bromochloromethane	< 2.4	2.4	8.1		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Bromodichloromethane	< 1.4	1.4	4.7		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Bromoform	< 2.3	2.3	7.8		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Bromomethane	< 2.3	2.3	7.6		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Carbon Tetrachloride	< 1.2	1.2	4.1		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Chlorobenzene	< 1.0	1.0	3.4		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Chlorodibromomethane	< 2.0	2.0	6.8		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Chloroethane	< 2.4	2.4	8.1		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Chloroform	< 0.92	0.92	3.1		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Chloromethane	< 0.60	0.60	2.0		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
cis-1,2-Dichloroethene	2.3	2.1	6.9		2.5	ug/L	Q	07/10/07 9:23 AM	SW846 5030B	SW846 8260B
cis-1,3-Dichloropropene	< 0.48	0.48	1.6		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Dibromomethane	< 1.5	1.5	5.0		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Dichlorodifluoromethane	< 2.5	2.5	8.2		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Diisopropyl Ether	< 1.9	1.9	6.3		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Ethylbenzene	< 1.4	1.4	4.5		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Fluorotrichloromethane	< 2.0	2.0	6.6		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Hexachlorobutadiene	< 1.7	1.7	5.6		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B

Client : MIDWEST CONTRACT OPERATIONS, INC.

Matrix Type : WATER

Project Name : MAUTHE

Collection Date : 07/03/07

Project Number :

Report Date : 07/13/07

Field ID : MW-107

Lab Sample Number : 885708-003

VOLATILES

Prep Date/Time: 07/10/07 9:23 AM Anl By: SMT

Analyte	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
Isopropylbenzene	< 1.5	1.5	4.9		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Methylene Chloride	< 1.1	1.1	3.6		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Methyl-tert-butyl-ether	< 1.5	1.5	5.1		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Naphthalene	< 1.8	1.8	6.2		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
n-Butylbenzene	< 2.3	2.3	7.8		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
n-Propylbenzene	< 2.0	2.0	6.8		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
p-Isopropyltoluene	< 1.7	1.7	5.6		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
s-Butylbenzene	< 2.2	2.2	7.4		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Styrene	< 2.2	2.2	7.2		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
t-Butylbenzene	< 2.4	2.4	8.1		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Tetrachloroethene	< 1.1	1.1	3.8		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Toluene	< 1.7	1.7	5.6		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
trans-1,2-Dichloroethene	< 2.2	2.2	7.4		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
trans-1,3-Dichloropropene	< 0.48	0.48	1.6		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Trichloroethene	350	1.2	4.0		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Vinyl Chloride	< 0.45	0.45	1.5		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Xylene, m + p	< 4.5	4.5	15		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Xylene, o	< 2.1	2.1	6.9		2.5	ug/L		07/10/07 9:23 AM	SW846 5030B	SW846 8260B
Surrogate		LCL	UCL							
4-Bromofluorobenzene	106	64	132		2.5	%		07/10/07	SW846 5030B	SW846 8260B
Toluene-d8	111	73	127		2.5	%		07/10/07	SW846 5030B	SW846 8260B
Dibromofluoromethane	104	68	122		2.5	%		07/10/07	SW846 5030B	SW846 8260B

Client : MIDWEST CONTRACT OPERATIONS, INC.

Matrix Type : WATER

Project Name : MAUTHE

Collection Date : 07/03/07

Project Number :

Report Date : 07/13/07

Field ID : MW-109

Lab Sample Number : 885708-004

INORGANICS

Test	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
Chromium - Dissolved	2200	0.67	2.2		1	ug/L		07/11/07 03:11 PM	SW846 6010B	SW846 6010B
								Prep Date/Time: 07/11/07	Anl By: DLB	

VOLATILES

Analyte	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
Prep Date/Time: 07/09/07 4:17 PM Anl By: SMT										
1,1,1,2-Tetrachloroethane	< 0.92	0.92	3.1		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
1,1,1-Trichloroethane	34	0.90	3.0		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
1,1,2,2-Tetrachloroethane	< 0.20	0.20	0.67		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
1,1,2-Trichloroethane	0.54	0.42	1.4		1	ug/L	Q	07/09/07 4:17 PM	SW846 5030B	SW846 8260B
1,1-Dichloroethane	1.7	0.75	2.5		1	ug/L	Q	07/09/07 4:17 PM	SW846 5030B	SW846 8260B
1,1-Dichloroethene	1.3	0.57	1.9		1	ug/L	Q	07/09/07 4:17 PM	SW846 5030B	SW846 8260B
1,1-Dichloropropene	< 0.75	0.75	2.5		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
1,2,3-Trichlorobenzene	< 0.74	0.74	2.5		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
1,2,3-Trichloropropane	< 0.99	0.99	3.3		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
1,2,4-Trichlorobenzene	< 0.97	0.97	3.2		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
1,2,4-Trimethylbenzene	< 0.97	0.97	3.2		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
1,2-Dibromo-3-chloropropane	< 0.87	0.87	2.9		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
1,2-Dibromoethane	< 0.56	0.56	1.9		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
1,2-Dichlorobenzene	< 0.83	0.83	2.8		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
1,2-Dichloroethane	< 0.36	0.36	1.2		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
1,2-Dichloropropane	< 0.46	0.46	1.5		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
1,3,5-Trimethylbenzene	< 0.83	0.83	2.8		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
1,3-Dichlorobenzene	< 0.87	0.87	2.9		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
1,3-Dichloropropane	< 0.61	0.61	2.0		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
1,4-Dichlorobenzene	< 0.95	0.95	3.2		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
2,2-Dichloropropane	< 0.62	0.62	2.1		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
2-Chlorotoluene	< 0.85	0.85	2.8		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
4-Chlorotoluene	< 0.74	0.74	2.5		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Benzene	< 0.41	0.41	1.4		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Bromobenzene	< 0.82	0.82	2.7		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Bromochloromethane	< 0.97	0.97	3.2		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Bromodichloromethane	< 0.56	0.56	1.9		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Bromoform	< 0.94	0.94	3.1		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Bromomethane	< 0.91	0.91	3.0		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Carbon Tetrachloride	< 0.49	0.49	1.6		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Chlorobenzene	< 0.41	0.41	1.4		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Chlorodibromomethane	< 0.81	0.81	2.7		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Chloroethane	< 0.97	0.97	3.2		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Chloroform	0.38	0.37	1.2		1	ug/L	Q	07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Chloromethane	< 0.24	0.24	0.80		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
cis-1,2-Dichloroethene	< 0.83	0.83	2.8		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
cis-1,3-Dichloropropene	< 0.19	0.19	0.63		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Dibromomethane	< 0.60	0.60	2.0		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Dichlorodifluoromethane	< 0.99	0.99	3.3		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Diisopropyl Ether	< 0.76	0.76	2.5		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Ethylbenzene	< 0.54	0.54	1.8		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Fluorotrichloromethane	< 0.79	0.79	2.6		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Hexachlorobutadiene	< 0.67	0.67	2.2		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B

Client : MIDWEST CONTRACT OPERATIONS, INC.

Matrix Type : WATER

Project Name : MAUTHE

Collection Date : 07/03/07

Project Number :

Report Date : 07/13/07

Field ID : MW-109

Lab Sample Number : 885708-004

VOLATILES

Prep Date/Time: 07/09/07 4:17 PM Anl By: SMT

Analyte	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
Isopropylbenzene	< 0.59	0.59	2.0		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Methylene Chloride	< 0.43	0.43	1.4		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Methyl-tert-butyl-ether	< 0.61	0.61	2.0		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Naphthalene	< 0.74	0.74	2.5		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
n-Butylbenzene	< 0.93	0.93	3.1		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
n-Propylbenzene	< 0.81	0.81	2.7		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
p-Isopropyltoluene	< 0.67	0.67	2.2		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
s-Butylbenzene	< 0.89	0.89	3.0		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Styrene	< 0.86	0.86	2.9		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
t-Butylbenzene	< 0.97	0.97	3.2		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Tetrachloroethene	< 0.45	0.45	1.5		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Toluene	< 0.67	0.67	2.2		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
trans-1,2-Dichloroethene	< 0.89	0.89	3.0		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
trans-1,3-Dichloropropene	< 0.19	0.19	0.63		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Trichloroethene	47	0.48	1.6		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Vinyl Chloride	< 0.18	0.18	0.60		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Xylene, m + p	< 1.8	1.8	6.0		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Xylene, o	< 0.83	0.83	2.8		1	ug/L		07/09/07 4:17 PM	SW846 5030B	SW846 8260B
Surrogate		LCL	UCL							
4-Bromofluorobenzene	107	64	132		1	%		07/09/07	SW846 5030B	SW846 8260B
Toluene-d8	110	73	127		1	%		07/09/07	SW846 5030B	SW846 8260B
Dibromofluoromethane	109	68	122		1	%		07/09/07	SW846 5030B	SW846 8260B

Client : MIDWEST CONTRACT OPERATIONS, INC.

Matrix Type : WATER

Project Name : MAUTHE

Collection Date : 07/03/07

Project Number :

Report Date : 07/13/07

Field ID : MW-110

Lab Sample Number : 885708-005

INORGANICS

Test	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
Chromium - Dissolved	32000	6.7	22		10	ug/L		07/11/07 03:15 PM	SW846 6010B	SW846 6010B
								Prep Date/Time: 07/11/07	Anl By: DLB	

VOLATILES

Analyte	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
Prep Date/Time: 07/10/07 9:46 AM Anl By: SMT										
1,1,1,2-Tetrachloroethane	< 18	18	61		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
1,1,1-Trichloroethane	1300	18	60		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
1,1,2,2-Tetrachloroethane	< 4.0	4.0	13		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
1,1,2-Trichloroethane	< 8.4	8.4	28		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
1,1-Dichloroethane	270	.15	50		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
1,1-Dichloroethene	230	11	38		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
1,1-Dichloropropene	< 15	15	50		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
1,2,3-Trichlorobenzene	< 15	15	49		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
1,2,3-Trichloropropane	< 20	20	66		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
1,2,4-Trichlorobenzene	< 19	19	65		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
1,2,4-Trimethylbenzene	< 19	19	65		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
1,2-Dibromo-3-chloropropane	< 17	17	58		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
1,2-Dibromoethane	< 11	11	37		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
1,2-Dichlorobenzene	< 17	17	55		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
1,2-Dichloroethane	< 7.2	7.2	24		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
1,2-Dichloropropane	< 9.2	9.2	31		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
1,3,5-Trimethylbenzene	< 17	17	55		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
1,3-Dichlorobenzene	< 17	17	58		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
1,3-Dichloropropane	< 12	12	41		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
1,4-Dichlorobenzene	< 19	19	63		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
2,2-Dichloropropane	< 12	12	41		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
2-Chlorotoluene	< 17	17	57		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
4-Chlorotoluene	< 15	15	49		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Benzene	< 8.2	8.2	27		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Bromobenzene	< 16	16	55		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Bromochloromethane	< 19	19	65		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Bromodichloromethane	< 11	11	37		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Bromoform	< 19	19	63		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Bromomethane	< 18	18	61		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Carbon Tetrachloride	< 9.8	9.8	33		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Chlorobenzene	< 8.2	8.2	27		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Chlorodibromomethane	< 16	16	54		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Chloroethane	< 19	19	65		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Chloroform	< 7.4	7.4	25		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Chloromethane	< 4.8	4.8	16		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
cis-1,2-Dichloroethene	59	17	55		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
cis-1,3-Dichloropropene	< 3.8	3.8	13		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Dibromomethane	< 12	12	40		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Dichlorodifluoromethane	< 20	20	66		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Diisopropyl Ether	< 15	15	51		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Ethylbenzene	< 11	11	36		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Fluorotrichloromethane	< 16	16	53		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Hexachlorobutadiene	< 13	13	45		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B

Client : MIDWEST CONTRACT OPERATIONS, INC.

Matrix Type : WATER

Project Name : MAUTHE

Collection Date : 07/03/07

Project Number :

Report Date : 07/13/07

Field ID : MW-110

Lab Sample Number : 885708-005

VOLATILES

Prep Date/Time: 07/10/07 9:46 AM Anl By: SMT

Analyte	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
Isopropylbenzene	< 12	12	39		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Methylene Chloride	< 8.6	8.6	29		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Methyl-tert-butyl-ether	< 12	12	41		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Naphthalene	< 15	15	49		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
n-Butylbenzene	< 19	19	62		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
n-Propylbenzene	< 16	16	54		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
p-Isopropyltoluene	< 13	13	45		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
s-Butylbenzene	< 18	18	59		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Styrene	< 17	17	57		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
t-Butylbenzene	< 19	19	65		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Tetrachloroethene	< 9.0	9.0	30		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Toluene	< 13	13	45		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
trans-1,2-Dichloroethene	18	18	59		20	ug/L	Q	07/10/07 9:46 AM	SW846 5030B	SW846 8260B
trans-1,3-Dichloropropene	< 3.8	3.8	13		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Trichloroethene	26	9.6	32		20	ug/L	Q	07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Vinyl Chloride	< 3.6	3.6	12		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Xylene, m + p	< 36	36	120		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Xylene, o	< 17	17	55		20	ug/L		07/10/07 9:46 AM	SW846 5030B	SW846 8260B
Surrogate		LCL	UCL							
4-Bromofluorobenzene	106	64	132		20	%		07/10/07	SW846 5030B	SW846 8260B
Toluene-d8	113	73	127		20	%		07/10/07	SW846 5030B	SW846 8260B
Dibromofluoromethane	104	68	122		20	%		07/10/07	SW846 5030B	SW846 8260B

Client : MIDWEST CONTRACT OPERATIONS, INC.

Matrix Type : WATER

Project Name : MAUTHE

Collection Date : 07/03/07

Project Number :

Report Date : 07/13/07

Field ID : MW-111

Lab Sample Number : 885708-006

INORGANICS

Test	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
Chromium - Dissolved	41	0.67	2.2		1	ug/L		07/12/07 03:12 PM	SW846 6010B	SW846 6010B
								Prep Date/Time: 07/11/07	Anl By: DLB	

VOLATILES

Analyte	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
Prep Date/Time: 07/09/07 4:40 PM Anl By: SMT										
1,1,1,2-Tetrachloroethane	< 0.92	0.92	3.1		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
1,1,1-Trichloroethane	14	0.90	3.0		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
1,1,2,2-Tetrachloroethane	< 0.20	0.20	0.67		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
1,1,2-Trichloroethane	< 0.42	0.42	1.4		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
1,1-Dichloroethane	1.5	0.75	2.5		1	ug/L	Q	07/09/07 4:40 PM	SW846 5030B	SW846 8260B
1,1-Dichloroethene	1.8	0.57	1.9		1	ug/L	Q	07/09/07 4:40 PM	SW846 5030B	SW846 8260B
1,1-Dichloropropene	< 0.75	0.75	2.5		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
1,2,3-Trichlorobenzene	< 0.74	0.74	2.5		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
1,2,3-Trichloropropane	< 0.99	0.99	3.3		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
1,2,4-Trichlorobenzene	< 0.97	0.97	3.2		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
1,2,4-Trimethylbenzene	< 0.97	0.97	3.2		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
1,2-Dibromo-3-chloropropane	< 0.87	0.87	2.9		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
1,2-Dibromoethane	< 0.56	0.56	1.9		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
1,2-Dichlorobenzene	< 0.83	0.83	2.8		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
1,2-Dichloroethane	< 0.36	0.36	1.2		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
1,2-Dichloropropane	< 0.46	0.46	1.5		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
1,3,5-Trimethylbenzene	< 0.83	0.83	2.8		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
1,3-Dichlorobenzene	< 0.87	0.87	2.9		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
1,3-Dichloropropane	< 0.61	0.61	2.0		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
1,4-Dichlorobenzene	< 0.95	0.95	3.2		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
2,2-Dichloropropane	< 0.62	0.62	2.1		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
2-Chlorotoluene	< 0.85	0.85	2.8		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
4-Chlorotoluene	< 0.74	0.74	2.5		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Benzene	< 0.41	0.41	1.4		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Bromobenzene	< 0.82	0.82	2.7		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Bromochloromethane	< 0.97	0.97	3.2		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Bromodichloromethane	< 0.56	0.56	1.9		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Bromoform	< 0.94	0.94	3.1		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Bromomethane	< 0.91	0.91	3.0		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Carbon Tetrachloride	< 0.49	0.49	1.6		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Chlorobenzene	< 0.41	0.41	1.4		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Chlorodibromomethane	< 0.81	0.81	2.7		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Chloroethane	< 0.97	0.97	3.2		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Chloroform	< 0.37	0.37	1.2		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Chloromethane	< 0.24	0.24	0.80		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
cis-1,2-Dichloroethene	< 0.83	0.83	2.8		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
cis-1,3-Dichloropropene	< 0.19	0.19	0.63		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Dibromomethane	< 0.60	0.60	2.0		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Dichlorodifluoromethane	< 0.99	0.99	3.3		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Diisopropyl Ether	< 0.76	0.76	2.5		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Ethylbenzene	< 0.54	0.54	1.8		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Fluorotrichloromethane	< 0.79	0.79	2.6		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Hexachlorobutadiene	< 0.67	0.67	2.2		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B

Client : MIDWEST CONTRACT OPERATIONS, INC.

Matrix Type : WATER

Project Name : MAUTHE

Collection Date : 07/03/07

Project Number :

Report Date : 07/13/07

Field ID : MW-111

Lab Sample Number : 885708-006

VOLATILES

Prep Date/Time: 07/09/07 4:40 PM Anl By: SMT

Analyte	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
Isopropylbenzene	< 0.59	0.59	2.0		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Methylene Chloride	< 0.43	0.43	1.4		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Methyl-tert-butyl-ether	< 0.61	0.61	2.0		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Naphthalene	< 0.74	0.74	2.5		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
n-Butylbenzene	< 0.93	0.93	3.1		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
n-Propylbenzene	< 0.81	0.81	2.7		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
p-Isopropyltoluene	< 0.67	0.67	2.2		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
s-Butylbenzene	< 0.89	0.89	3.0		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Styrene	< 0.86	0.86	2.9		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
t-Butylbenzene	< 0.97	0.97	3.2		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Tetrachloroethene	< 0.45	0.45	1.5		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Toluene	< 0.67	0.67	2.2		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
trans-1,2-Dichloroethene	< 0.89	0.89	3.0		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
trans-1,3-Dichloropropene	< 0.19	0.19	0.63		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Trichloroethene	37	0.48	1.6		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Vinyl Chloride	< 0.18	0.18	0.60		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Xylene, m + p	< 1.8	1.8	6.0		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Xylene, o	< 0.83	0.83	2.8		1	ug/L		07/09/07 4:40 PM	SW846 5030B	SW846 8260B
Surrogate		LCL	UCL							
4-Bromofluorobenzene	106	64	132		1	%		07/09/07	SW846 5030B	SW846 8260B
Toluene-d8	110	73	127		1	%		07/09/07	SW846 5030B	SW846 8260B
Dibromofluoromethane	106	68	122		1	%		07/09/07	SW846 5030B	SW846 8260B

Client : MIDWEST CONTRACT OPERATIONS, INC.

Matrix Type : WATER

Project Name : MAUTHE

Collection Date : 07/03/07

Project Number :

Report Date : 07/13/07

Field ID : MW-112

Lab Sample Number : 885708-007

INORGANICS

Test	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
Chromium - Dissolved	100000	6.7	22		10	ug/L		07/11/07 03:24 PM	SW846 6010B	SW846 6010B
								Prep Date/Time: 07/11/07	Anl By: DLB	
Zinc - Dissolved	< 200	200	670		10	ug/L	C	07/11/07 03:24 PM	SW846 6010B	SW846 6010B
								Prep Date/Time: 07/11/07	Anl By: DLB	
Cyanide, Total - Dissolved	0.35	0.0060	0.020		1	mg/L		07/10/07 04:38 PM	EPA 335.4	EPA 335.4
								Prep Date/Time: 07/10/07 11:28 AM	Anl By: DAW	

VOLATILES

Analyte	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
1,1,1,2-Tetrachloroethane	< 4.6	4.6	15		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
1,1,1-Trichloroethane	11	4.5	15		5	ug/L	Q	07/10/07 10:09 AM	SW846 5030B	SW846 8260B
1,1,2,2-Tetrachloroethane	< 1.0	1.0	3.3		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
1,1,2-Trichloroethane	< 2.1	2.1	7.0		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
1,1-Dichloroethane	< 3.8	3.8	12		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
1,1-Dichloroethene	< 2.8	2.8	9.5		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
1,1-Dichloropropene	< 3.8	3.8	12		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
1,2,3-Trichlorobenzene	< 3.7	3.7	12		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
1,2,3-Trichloropropane	< 5.0	5.0	16		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
1,2,4-Trichlorobenzene	< 4.8	4.8	16		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
1,2,4-Trimethylbenzene	< 4.8	4.8	16		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
1,2-Dibromo-3-chloropropane	< 4.4	4.4	14		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
1,2-Dibromoethane	< 2.8	2.8	9.3		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
1,2-Dichlorobenzene	< 4.1	4.1	14		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
1,2-Dichloroethane	< 1.8	1.8	6.0		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
1,2-Dichloropropane	< 2.3	2.3	7.7		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
1,3,5-Trimethylbenzene	< 4.1	4.1	14		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
1,3-Dichlorobenzene	< 4.4	4.4	14		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
1,3-Dichloropropane	< 3.0	3.0	10		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
1,4-Dichlorobenzene	< 4.8	4.8	16		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
2,2-Dichloropropane	< 3.1	3.1	10		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
2-Chlorotoluene	< 4.2	4.2	14		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
4-Chlorotoluene	< 3.7	3.7	12		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Benzene	< 2.0	2.0	6.8		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Bromobenzene	< 4.1	4.1	14		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Bromochloromethane	< 4.8	4.8	16		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Bromodichloromethane	< 2.8	2.8	9.3		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Bromoform	< 4.7	4.7	16		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Bromomethane	< 4.6	4.6	15		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Carbon Tetrachloride	< 2.4	2.4	8.2		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Chlorobenzene	< 2.0	2.0	6.8		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Chlorodibromomethane	< 4.1	4.1	14		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Chloroethane	< 4.8	4.8	16		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Chloroform	< 1.8	1.8	6.2		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Chloromethane	< 1.2	1.2	4.0		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
cis-1,2-Dichloroethene	< 4.1	4.1	14		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
cis-1,3-Dichloropropene	< 0.95	0.95	3.2		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Dibromomethane	< 3.0	3.0	10		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Dichlorodifluoromethane	< 5.0	5.0	16		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B

Client : MIDWEST CONTRACT OPERATIONS, INC.

Project Name : MAUTHE

Project Number :

Field ID : MW-112

Matrix Type : WATER

Collection Date : 07/03/07

Report Date : 07/13/07

Lab Sample Number : 885708-007

VOLATILES

Prep Date/Time: 07/10/07 10:09 AM Anl By: SMT

Analyte	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
Diisopropyl Ether	< 3.8	3.8	13		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Ethylbenzene	< 2.7	2.7	9.0		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Fluorotrichloromethane	< 4.0	4.0	13		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Hexachlorobutadiene	< 3.4	3.4	11		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Isopropylbenzene	< 2.9	2.9	9.8		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Methylene Chloride	< 2.2	2.2	7.2		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Methyl-tert-butyl-ether	< 3.0	3.0	10		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Naphthalene	< 3.7	3.7	12		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
n-Butylbenzene	< 4.6	4.6	16		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
n-Propylbenzene	< 4.1	4.1	14		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
p-Isopropyltoluene	< 3.4	3.4	11		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
s-Butylbenzene	< 4.4	4.4	15		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Styrene	< 4.3	4.3	14		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
t-Butylbenzene	< 4.8	4.8	16		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Tetrachloroethene	< 2.2	2.2	7.5		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Toluene	< 3.4	3.4	11		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
trans-1,2-Dichloroethene	< 4.4	4.4	15		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
trans-1,3-Dichloropropene	< 0.95	0.95	3.2		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Trichloroethene	750	2.4	8.0		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Vinyl Chloride	< 0.90	0.90	3.0		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Xylene, m + p	< 9.0	9.0	30		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Xylene, o	< 4.1	4.1	14		5	ug/L		07/10/07 10:09 AM	SW846 5030B	SW846 8260B
Surrogate		LCL	UCL							
4-Bromofluorobenzene	107	64	132		5	%		07/10/07	SW846 5030B	SW846 8260B
Toluene-d8	111	73	127		5	%		07/10/07	SW846 5030B	SW846 8260B
Dibromofluoromethane	107	68	122		5	%		07/10/07	SW846 5030B	SW846 8260B

Client : MIDWEST CONTRACT OPERATIONS, INC.

Matrix Type : WATER

Project Name : MAUTHE

Collection Date : 07/03/07

Project Number :

Report Date : 07/13/07

Field ID : MW-112D

Lab Sample Number : 885708-008

INORGANICS

Test	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
Chromium - Dissolved	100000	6.7	22		10	ug/L		07/11/07 03:28 PM	SW846 6010B	SW846 6010B
								Prep Date/Time: 07/11/07		Anl By: DLB
Zinc - Dissolved	< 200	200	670		10	ug/L	C	07/11/07 03:28 PM	SW846 6010B	SW846 6010B
								Prep Date/Time: 07/11/07		Anl By: DLB
Cyanide, Total - Dissolved	0.30	0.030	0.09		5	mg/L	N	07/10/07 04:49 PM	EPA 335.4	EPA 335.4
								Prep Date/Time: 07/10/07 11:29 AM		Anl By: DAW

VOLATILES

Analyte	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
1,1,1,2-Tetrachloroethane	< 4.6	4.6	15		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
1,1,1-Trichloroethane	13	4.5	15		5	ug/L	QC	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
1,1,2,2-Tetrachloroethane	< 1.0	1.0	3.3		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
1,1,2-Trichloroethane	< 2.1	2.1	7.0		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
1,1-Dichloroethane	< 3.8	3.8	12		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
1,1-Dichloroethene	< 2.8	2.8	9.5		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
1,1-Dichloropropene	< 3.8	3.8	12		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
1,2,3-Trichlorobenzene	< 3.7	3.7	12		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
1,2,3-Trichloropropane	< 5.0	5.0	16		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
1,2,4-Trichlorobenzene	< 4.8	4.8	16		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
1,2,4-Trimethylbenzene	< 4.8	4.8	16		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
1,2-Dibromo-3-chloropropane	< 4.4	4.4	14		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
1,2-Dibromoethane	< 2.8	2.8	9.3		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
1,2-Dichlorobenzene	< 4.1	4.1	14		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
1,2-Dichloroethane	< 1.8	1.8	6.0		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
1,2-Dichloropropane	< 2.3	2.3	7.7		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
1,3,5-Trimethylbenzene	< 4.1	4.1	14		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
1,3-Dichlorobenzene	< 4.4	4.4	14		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
1,3-Dichloropropane	< 3.0	3.0	10		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
1,4-Dichlorobenzene	< 4.8	4.8	16		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
2,2-Dichloropropane	< 3.1	3.1	10		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
2-Chlorotoluene	< 4.2	4.2	14		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
4-Chlorotoluene	< 3.7	3.7	12		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Benzene	< 2.0	2.0	6.8		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Bromobenzene	< 4.1	4.1	14		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Bromochloromethane	< 4.8	4.8	16		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Bromodichloromethane	< 2.8	2.8	9.3		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Bromoform	< 4.7	4.7	16		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Bromomethane	< 4.6	4.6	15		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Carbon Tetrachloride	< 2.4	2.4	8.2		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Chlorobenzene	< 2.0	2.0	6.8		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Chlorodibromomethane	< 4.1	4.1	14		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Chloroethane	< 4.8	4.8	16		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Chloroform	< 1.8	1.8	6.2		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Chloromethane	< 1.2	1.2	4.0		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
cis-1,2-Dichloroethene	< 4.1	4.1	14		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
cis-1,3-Dichloropropene	< 0.95	0.95	3.2		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Dibromomethane	< 3.0	3.0	10		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Dichlorodifluoromethane	< 5.0	5.0	16		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B

Client : MIDWEST CONTRACT OPERATIONS, INC.

Matrix Type : WATER

Project Name : MAUTHE

Collection Date : 07/03/07

Project Number :

Report Date : 07/13/07

Field ID : MW-112D

Lab Sample Number : 885708-008

VOLATILES

Prep Date/Time: 07/10/07 10:31 AM Anl By: SMT

Analyte	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
Diisopropyl Ether	< 3.8	3.8	13		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Ethylbenzene	< 2.7	2.7	9.0		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Fluorotrichloromethane	< 4.0	4.0	13		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Hexachlorobutadiene	< 3.4	3.4	11		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Isopropylbenzene	< 2.9	2.9	9.8		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Methylene Chloride	< 2.2	2.2	7.2		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Methyl-tert-butyl-ether	< 3.0	3.0	10		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Naphthalene	< 3.7	3.7	12		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
n-Butylbenzene	< 4.6	4.6	16		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
n-Propylbenzene	< 4.1	4.1	14		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
p-Isopropyltoluene	< 3.4	3.4	11		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
s-Butylbenzene	< 4.4	4.4	15		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Styrene	< 4.3	4.3	14		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
t-Butylbenzene	< 4.8	4.8	16		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Tetrachloroethene	< 2.2	2.2	7.5		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Toluene	< 3.4	3.4	11		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
trans-1,2-Dichloroethene	< 4.4	4.4	15		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
trans-1,3-Dichloropropene	< 0.95	0.95	3.2		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Trichloroethene	770	2.4	8.0		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Vinyl Chloride	< 0.90	0.90	3.0		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Xylene, m + p	< 9.0	9.0	30		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Xylene, o	< 4.1	4.1	14		5	ug/L	C	07/10/07 10:31 AM	SW846 5030B	SW846 8260B
Surrogate		LCL	UCL							
4-Bromofluorobenzene	105	64	132		5	%		07/10/07	SW846 5030B	SW846 8260B
Toluene-d8	112	73	127		5	%		07/10/07	SW846 5030B	SW846 8260B
Dibromofluoromethane	109	68	122		5	%		07/10/07	SW846 5030B	SW846 8260B

Client : MIDWEST CONTRACT OPERATIONS, INC.

Project Name : MAUTHE

Project Number :

Field ID : MW-113

Matrix Type : WATER

Collection Date : 07/03/07

Report Date : 07/13/07

Lab Sample Number : 885708-009

INORGANICS

Test	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
Chromium - Dissolved	21000	6.7	22		10	ug/L		07/11/07 03:33 PM	SW846 6010B	SW846 6010B
								Prep Date/Time: 07/11/07	Anl By: DLB	

VOLATILES

Analyte	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
Prep Date/Time: 07/11/07 9:46 AM Anl By: SMT										
1,1,1,2-Tetrachloroethane	< 4.6	4.6	15		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
1,1,1-Trichloroethane	79	4.5	15		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
1,1,2,2-Tetrachloroethane	< 1.0	1.0	3.3		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
1,1,2-Trichloroethane	< 2.1	2.1	7.0		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
1,1-Dichloroethane	21	3.8	12		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
1,1-Dichloroethene	8.1	2.8	9.5		5	ug/L	QC	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
1,1-Dichloropropene	< 3.8	3.8	12		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
1,2,3-Trichlorobenzene	< 3.7	3.7	12		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
1,2,3-Trichloropropane	< 5.0	5.0	16		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
1,2,4-Trichlorobenzene	< 4.8	4.8	16		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
1,2,4-Trimethylbenzene	< 4.8	4.8	16		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
1,2-Dibromo-3-chloropropane	< 4.4	4.4	14		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
1,2-Dibromoethane	< 2.8	2.8	9.3		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
1,2-Dichlorobenzene	< 4.1	4.1	14		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
1,2-Dichloroethane	< 1.8	1.8	6.0		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
1,2-Dichloropropane	< 2.3	2.3	7.7		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
1,3,5-Trimethylbenzene	< 4.1	4.1	14		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
1,3-Dichlorobenzene	< 4.4	4.4	14		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
1,3-Dichloropropane	< 3.0	3.0	10		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
1,4-Dichlorobenzene	< 4.8	4.8	16		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
2,2-Dichloropropane	< 3.1	3.1	10		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
2-Chlorotoluene	< 4.2	4.2	14		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
4-Chlorotoluene	< 3.7	3.7	12		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Benzene	< 2.0	2.0	6.8		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Bromobenzene	< 4.1	4.1	14		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Bromochloromethane	< 4.8	4.8	16		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Bromodichloromethane	< 2.8	2.8	9.3		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Bromoform	< 4.7	4.7	16		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Bromomethane	< 4.6	4.6	15		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Carbon Tetrachloride	< 2.4	2.4	8.2		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Chlorobenzene	< 2.0	2.0	6.8		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Chlorodibromomethane	< 4.1	4.1	14		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Chloroethane	< 4.8	4.8	16		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Chloroform	< 1.8	1.8	6.2		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Chloromethane	< 1.2	1.2	4.0		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
cis-1,2-Dichloroethene	4.9	4.1	14		5	ug/L	QC	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
cis-1,3-Dichloropropene	< 0.95	0.95	3.2		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Dibromomethane	< 3.0	3.0	10		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Dichlorodifluoromethane	< 5.0	5.0	16		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Diisopropyl Ether	< 3.8	3.8	13		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Ethylbenzene	< 2.7	2.7	9.0		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Fluorotrichloromethane	< 4.0	4.0	13		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Hexachlorobutadiene	< 3.4	3.4	11		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B

Client : MIDWEST CONTRACT OPERATIONS, INC.

Matrix Type : WATER

Project Name : MAUTHE

Collection Date : 07/03/07

Project Number :

Report Date : 07/13/07

Field ID : MW-113

Lab Sample Number : 885708-009

VOLATILES

Prep Date/Time: 07/11/07 9:46 AM Anl By: SMT

Analyte	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
Isopropylbenzene	< 2.9	2.9	9.8		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Methylene Chloride	< 2.2	2.2	7.2		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Methyl-tert-butyl-ether	< 3.0	3.0	10		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Naphthalene	< 3.7	3.7	12		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
n-Butylbenzene	< 4.6	4.6	16		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
n-Propylbenzene	< 4.1	4.1	14		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
p-Isopropyltoluene	< 3.4	3.4	11		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
s-Butylbenzene	< 4.4	4.4	15		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Styrene	< 4.3	4.3	14		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
t-Butylbenzene	< 4.8	4.8	16		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Tetrachloroethene	< 2.2	2.2	7.5		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Toluene	< 3.4	3.4	11		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
trans-1,2-Dichloroethene	< 4.4	4.4	15		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
trans-1,3-Dichloropropene	< 0.95	0.95	3.2		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Trichloroethene	61	2.4	8.0		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Vinyl Chloride	< 0.90	0.90	3.0		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Xylene, m + p	< 9.0	9.0	30		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Xylene, o	< 4.1	4.1	14		5	ug/L	C	07/11/07 9:46 AM	SW846 5030B	SW846 8260B
Surrogate		LCL	UCL							
4-Bromofluorobenzene	108	64	132		5	%		07/11/07	SW846 5030B	SW846 8260B
Toluene-d8	110	73	127		5	%		07/11/07	SW846 5030B	SW846 8260B
Dibromofluoromethane	101	68	122		5	%		07/11/07	SW846 5030B	SW846 8260B

Client : MIDWEST CONTRACT OPERATIONS, INC.

Matrix Type : WATER

Project Name : MAUTHE

Collection Date : 07/03/07

Project Number :

Report Date : 07/13/07

Field ID : TRIP BLANK

Lab Sample Number : 885708-010

VOLATILES

Prep Date/Time: 07/10/07 2:53 PM Anl By: SMT

Analyte	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
1,1,1,2-Tetrachloroethane	< 0.92	0.92	3.1		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
1,1,1-Trichloroethane	< 0.90	0.90	3.0		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
1,1,2,2-Tetrachloroethane	< 0.20	0.20	0.67		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
1,1,2-Trichloroethane	< 0.42	0.42	1.4		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
1,1-Dichloroethane	< 0.75	0.75	2.5		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
1,1-Dichloroethene	< 0.57	0.57	1.9		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
1,1-Dichloropropene	< 0.75	0.75	2.5		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
1,2,3-Trichlorobenzene	< 0.74	0.74	2.5		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
1,2,3-Trichloropropane	< 0.99	0.99	3.3		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
1,2,4-Trichlorobenzene	< 0.97	0.97	3.2		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
1,2,4-Trimethylbenzene	< 0.97	0.97	3.2		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
1,2-Dibromo-3-chloropropane	< 0.87	0.87	2.9		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
1,2-Dibromoethane	< 0.56	0.56	1.9		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
1,2-Dichlorobenzene	< 0.83	0.83	2.8		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
1,2-Dichloroethane	< 0.36	0.36	1.2		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
1,2-Dichloropropane	< 0.46	0.46	1.5		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
1,3,5-Trimethylbenzene	< 0.83	0.83	2.8		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
1,3-Dichlorobenzene	< 0.87	0.87	2.9		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
1,3-Dichloropropane	< 0.61	0.61	2.0		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
1,4-Dichlorobenzene	< 0.95	0.95	3.2		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
2,2-Dichloropropane	< 0.62	0.62	2.1		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
2-Chlorotoluene	< 0.85	0.85	2.8		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
4-Chlorotoluene	< 0.74	0.74	2.5		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Benzene	< 0.41	0.41	1.4		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Bromobenzene	< 0.82	0.82	2.7		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Bromochloromethane	< 0.97	0.97	3.2		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Bromodichloromethane	< 0.56	0.56	1.9		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Bromoform	< 0.94	0.94	3.1		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Bromomethane	< 0.91	0.91	3.0		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Carbon Tetrachloride	< 0.49	0.49	1.6		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Chlorobenzene	< 0.41	0.41	1.4		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Chlorodibromomethane	< 0.81	0.81	2.7		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Chloroethane	< 0.97	0.97	3.2		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Chloroform	< 0.37	0.37	1.2		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Chloromethane	< 0.24	0.24	0.80		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
cis-1,2-Dichloroethene	< 0.83	0.83	2.8		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
cis-1,3-Dichloropropene	< 0.19	0.19	0.63		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Dibromomethane	< 0.60	0.60	2.0		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Dichlorodifluoromethane	< 0.99	0.99	3.3		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Diisopropyl Ether	< 0.76	0.76	2.5		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Ethylbenzene	< 0.54	0.54	1.8		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Fluorotrichloromethane	< 0.79	0.79	2.6		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Hexachlorobutadiene	< 0.67	0.67	2.2		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Isopropylbenzene	< 0.59	0.59	2.0		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Methylene Chloride	1.3	0.43	1.4		1	ug/L	Q	07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Methyl-tert-butyl-ether	< 0.61	0.61	2.0		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Naphthalene	< 0.74	0.74	2.5		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
n-Butylbenzene	< 0.93	0.93	3.1		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B

Client : MIDWEST CONTRACT OPERATIONS, INC.

Matrix Type : WATER

Project Name : MAUTHE

Collection Date : 07/03/07

Project Number :

Report Date : 07/13/07

Field ID : TRIP BLANK

Lab Sample Number : 885708-010

VOLATILES

Prep Date/Time: 07/10/07 2:53 PM Anl By: SMT

Analyte	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
n-Propylbenzene	< 0.81	0.81	2.7		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
p-Isopropyltoluene	< 0.67	0.67	2.2		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
s-Butylbenzene	< 0.89	0.89	3.0		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Styrene	< 0.86	0.86	2.9		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
t-Butylbenzene	< 0.97	0.97	3.2		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Tetrachloroethene	< 0.45	0.45	1.5		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Toluene	< 0.67	0.67	2.2		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
trans-1,2-Dichloroethene	< 0.89	0.89	3.0		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
trans-1,3-Dichloropropene	< 0.19	0.19	0.63		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Trichloroethene	< 0.48	0.48	1.6		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Vinyl Chloride	< 0.18	0.18	0.60		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Xylene, m + p	< 1.8	1.8	6.0		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Xylene, o	< 0.83	0.83	2.8		1	ug/L		07/10/07 2:53 PM	SW846 5030B	SW846 8260B
Surrogate		LCL	UCL							
4-Bromofluorobenzene	108	64	132		1	%		07/10/07	SW846 5030B	SW846 8260B
Toluene-d8	110	73	127		1	%		07/10/07	SW846 5030B	SW846 8260B
Dibromofluoromethane	104	68	122		1	%		07/10/07	SW846 5030B	SW846 8260B

Lab Number	TestGroupID	Field ID	Comment
885708-	M-ZN-D	All Samples	C - Elevated detection limit due to matrix effect. The samples are high in chromium.
885708-009	8260+-W	MW-113	C - Elevated detection limit due to hostile matrix.

Qualifier Codes

Flag Applies To Explanation

Flag	Applies To	Explanation
A	Inorganic	Analyte is detected in the method blank. Method blank criteria is evaluated to the laboratory method detection limit. Additionally, method blank acceptance may be based on project specific criteria or determined from analyte concentrations in the sample and are evaluated on a sample by sample basis.
B	Inorganic	The analyte has been detected between the method detection limit and the reporting limit.
B	Organic	Analyte is present in the method blank. Method blank criteria is evaluated to the laboratory method detection limit. Additionally, method blank acceptance may be based on project specific criteria or determined from analyte concentrations in the sample and are evaluated on a sample by sample basis.
C	All	Elevated detection limit.
D	All	Analyte value from diluted analysis or surrogate result not applicable due to sample dilution.
E	Inorganic	Estimated concentration due to matrix interferences. During the metals analysis the serial dilution failed to meet the established control limits of 0-10%. The sample concentration is greater than 50 times the IDL for analysis done on the ICP or 100 times the IDL for analysis done on the ICP-MS. The result was flagged with the E qualifier to indicate that a physical interference was observed.
E	Organic	Analyte concentration exceeds calibration range.
F	Inorganic	Due to potential interferences for this analysis by Inductively Coupled Plasma techniques (SW-846 Method 6010), this analyte has been confirmed by and reported from an alternate method.
F	Organic	Surrogate results outside control criteria.
G	All	The result is estimated because the concentration is less than the lowest calibration standard concentration utilized in the initial calibration. The method detection limit is less than the reporting limit specified for this project.
H	All	Preservation, extraction or analysis performed past holding time.
HF	Inorganic	This test is considered a field parameter, and the recommended holding time is 15 minutes from collection. The analysis was performed in the laboratory beyond the recommended holding time.
J	All	Concentration detected equal to or greater than the method detection limit but less than the reporting limit.
K	Organic	Detection limit may be elevated due to the presence of an unrequested analyte.
L	All	Elevated detection limit due to low sample volume.
M	Organic	Sample pH was greater than 2
N	All	Spiked sample recovery not within control limits.
O	Organic	Sample received overweight.
P	Organic	The relative percent difference between the two columns for detected concentrations was greater than 40%.
Q	All	The analyte has been detected between the limit of detection (LOD) and limit of quantitation (LOQ). The results are qualified due to the uncertainty of analyte concentrations within this range.
S	Organic	The relative percent difference between quantitation and confirmation columns exceeds internal quality control criteria. Because the result is unconfirmed, it has been reported as a non-detect with an elevated detection limit.
U	All	The analyte was not detected at or above the reporting limit.
V	All	Sample received with headspace.
W	All	A second aliquot of sample was analyzed from a container with headspace.
X	All	See Sample Narrative.
Z	Organics	This compound was separated in the CCV standard but it did not meet the resolution criteria as set forth in SW846.
&	All	Laboratory Control Spike recovery not within control limits.
*	All	Precision not within control limits.
+	Inorganic	The sample result is greater than four times the spike level; therefore, the percent recovery is not evaluated.
<	All	The analyte was not detected at or above the reporting limit.
1	Inorganic	Dissolved analyte or filtered analyte greater than total analyte; analyses passed QC based on precision criteria.
2	Inorganic	Dissolved analyte or filtered analyte greater than total analyte; analyses failed QC based on precision criteria.
3	Inorganic	BOD result is estimated due to the BOD blank exceeding the allowable oxygen depletion.
4	Inorganic	BOD duplicate precision not within control limits. Due to the 48 hour holding time for this test, it is not practical to reanalyze and try to correct the deficiency.
5	Inorganic	BOD result is estimated due to insufficient oxygen depletion. Due to the 48 hour holding time for this test, it is not practical to reanalyze and try to correct the deficiency.
6	Inorganic	BOD laboratory control sample not within control limits. Due to the 48 hour holding time for this test, it is not practical to reanalyze and try to correct the deficiency.
7	Inorganic	BOD result is estimated due to complete oxygen depletion. Due to the 48 hour holding time for this test, it is not practical to reanalyze and try to correct the deficiency.
8	Inorganic	Sample was received unpreserved. Sample was preserved either at the time of receipt or at the time of sample preparation.
9	Inorganic	Sample was received with insufficient preservation. Acid was added either at the time of receipt or at the time of sample preparation.

Test Group Name	885708-001	885708-002	885708-003	885708-004	885708-005	885708-006	885708-007	885708-008	885708-009	885708-010
CHROMIUM - DISSOLVED	B	B	B	B	B	B	B	B	B	B
CYANIDE, TOTAL - DISSOLVED								B	B	
VOLATILES			G	G	G	G	G	G	G	G
ZINC - DISSOLVED								B	B	

Code	WI Certification
B	405132750 / DATCP: 105-444
G	405132750



Sample Condition Upon Receipt

Client Name: MCO Project # 885 708

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: _____

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other _____

Thermometer Used NA

Type of Ice: Wet Blue None Samples on ice, cooling process has begun

Cooler Temperature ROI

Biological Tissue Is Frozen: Yes No

Date and Initials of person examining contents: 7-5-07 MWY
U7/S/02

Temp should be above freezing to 6°C

Comments:

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	11.
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.
-Includes date/time/ID/Analysis Matrix: <u>W</u>		
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Initial when completed <u>MWY</u> Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	14.
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	15.
Trip Blank Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	16.
Trip Blank Custody Seals Present	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Pace Trip Blank Lot # (if purchased):		

Client Notification/ Resolution:

Field Data Required? Y / N

Person Contacted: _____ Date/Time: _____

Comments/ Resolution: #005 - requesting CN, no volume rec'd. U7/10/07

Project Manager Review: [Signature]

Date: 7-9-07

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)



REVISED

1241 Bellevue Street, Suite 9
Green Bay, WI 54302
920-469-2436, Fax: 920-469-8827

Analytical Report Number: 885775

Client: MIDWEST CONTRACT OPERATIONS, INC.

Lab Contact: Brian Basten

Project Name: MAUTHE

Project Number:

Lab Sample Number	Field ID	Matrix	Collection Date
885775-001	MW-110	WATER	07/06/07

I certify that the data contained in this Final Report has been generated and reviewed in accordance with approved methods and Laboratory Standard Operating Procedure. Exceptions, if any, are discussed in the accompanying sample comments. Release of this final report is authorized by Laboratory management, as is verified by the following signature. This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services; Inc. The sample results relate only to the analytes of interest tested.

Results reported herein conform to the most current NELAC standards, where applicable, unless otherwise narrated in the body of the report.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, Inc..



[Signature]
Approval Signature

7-23-07
Date

Client : MIDWEST CONTRACT OPERATIONS, INC.

Project Name : MAUTHE

Project Number :

Field ID : MW-110

REVISED

Matrix Type : WATER

Collection Date : 07/06/07

Report Date : 07/23/07

Lab Sample Number : 885775-001

INORGANICS

Test	Result	LOD	LOQ	EQL	Dil.	Units	Code	Anl Date/Time	Prep Method	Anl Method
Cyanide, Total	0.079	0.0060	0.020		1	mg/L		07/10/07 04:33 PM	EPA 335.4	EPA 335.4
								Prep Date/Time:	07/10/07 11:29 AM	Anl By: DAW

Qualifier Codes

Flag Applies To Explanation

Flag	Applies To	Explanation
A	Inorganic	Analyte is detected in the method blank. Method blank criteria is evaluated to the laboratory method detection limit. Additionally, method blank acceptance may be based on project specific criteria or determined from analyte concentrations in the sample and are evaluated on a sample by sample basis.
B	Inorganic	The analyte has been detected between the method detection limit and the reporting limit.
B	Organic	Analyte is present in the method blank. Method blank criteria is evaluated to the laboratory method detection limit. Additionally, method blank acceptance may be based on project specific criteria or determined from analyte concentrations in the sample and are evaluated on a sample by sample basis.
C	All	Elevated detection limit.
D	All	Analyte value from diluted analysis or surrogate result not applicable due to sample dilution.
E	Inorganic	Estimated concentration due to matrix interferences. During the metals analysis the serial dilution failed to meet the established control limits of 0-10%. The sample concentration is greater than 50 times the IDL for analysis done on the ICP or 100 times the IDL for analysis done on the ICP-MS. The result was flagged with the E qualifier to indicate that a physical interference was observed.
E	Organic	Analyte concentration exceeds calibration range.
F	Inorganic	Due to potential interferences for this analysis by Inductively Coupled Plasma techniques (SW-846 Method 6010), this analyte has been confirmed by and reported from an alternate method.
F	Organic	Surrogate results outside control criteria.
G	All	The result is estimated because the concentration is less than the lowest calibration standard concentration utilized in the initial calibration. The method detection limit is less than the reporting limit specified for this project.
H	All	Preservation, extraction or analysis performed past holding time.
HF	Inorganic	This test is considered a field parameter, and the recommended holding time is 15 minutes from collection. The analysis was performed in the laboratory beyond the recommended holding time.
J	All	Concentration detected equal to or greater than the method detection limit but less than the reporting limit.
K	Organic	Detection limit may be elevated due to the presence of an unrequested analyte.
L	All	Elevated detection limit due to low sample volume.
M	Organic	Sample pH was greater than 2
N	All	Spiked sample recovery not within control limits.
O	Organic	Sample received overweight.
P	Organic	The relative percent difference between the two columns for detected concentrations was greater than 40%.
Q	All	The analyte has been detected between the limit of detection (LOD) and limit of quantitation (LOQ). The results are qualified due to the uncertainty of analyte concentrations within this range.
S	Organic	The relative percent difference between quantitation and confirmation columns exceeds internal quality control criteria. Because the result is unconfirmed, it has been reported as a non-detect with an elevated detection limit.
U	All	The analyte was not detected at or above the reporting limit.
V	All	Sample received with headspace.
W	All	A second aliquot of sample was analyzed from a container with headspace.
X	All	See Sample Narrative.
Z	Organics	This compound was separated in the CCV standard but it did not meet the resolution criteria as set forth in SW846.
&	All	Laboratory Control Spike recovery not within control limits.
*	All	Precision not within control limits.
+	Inorganic	The sample result is greater than four times the spike level; therefore, the percent recovery is not evaluated.
<	All	The analyte was not detected at or above the reporting limit.
1	Inorganic	Dissolved analyte or filtered analyte greater than total analyte; analyses passed QC based on precision criteria.
2	Inorganic	Dissolved analyte or filtered analyte greater than total analyte; analyses failed QC based on precision criteria.
3	Inorganic	BOD result is estimated due to the BOD blank exceeding the allowable oxygen depletion.
4	Inorganic	BOD duplicate precision not within control limits. Due to the 48 hour holding time for this test, it is not practical to reanalyze and try to correct the deficiency.
5	Inorganic	BOD result is estimated due to insufficient oxygen depletion. Due to the 48 hour holding time for this test, it is not practical to reanalyze and try to correct the deficiency.
6	Inorganic	BOD laboratory control sample not within control limits. Due to the 48 hour holding time for this test, it is not practical to reanalyze and try to correct the deficiency.
7	Inorganic	BOD result is estimated due to complete oxygen depletion. Due to the 48 hour holding time for this test, it is not practical to reanalyze and try to correct the deficiency.
8	Inorganic	Sample was received unpreserved. Sample was preserved either at the time of receipt or at the time of sample preparation.
9	Inorganic	Sample was received with insufficient preservation. Acid was added either at the time of receipt or at the time of sample preparation.

885775-001

Test Group Name

CYANIDE, TOTAL

B

Code	WI Certification
------	------------------

B	405132750 / DATCP: 105-444
---	----------------------------

Batch: 885775
Lab Section: WETCHEM
QC Batch Number: 22700
Prep Method: EPA 335.4
Analytical Method: EPA 335.4

REVISED

QC Type	Client Sample ID	Lab Sample ID
MB	WCG2244-036MB	WCG2244-036MB
LCS	WCG2244-036MBLCS	WCG2244-036MBLCS
MS	885708-008MS	885708-008MS
MS	885638-001MS	885638-001MS
MSD	885708-008MSD	885708-008MSD
MSD	885638-001MSD	885638-001MSD

Client Sample ID Lab Sample ID MB ID
MW-110 885775-001 MB

Client Sample ID Lab Sample ID MB ID

Test Name	Method Blank Result Conc	LCS Spiked Conc	LCS Recovery			LCS Spiked Conc	LCS Recovery			LCS/ LCS RPD % C	LCS/LCSD Control Limits			Parent Sample Number	Parent Result Conc	MS Spiked Conc	MS Recovery			MSD Spiked Conc	MSD Recovery			MS/ MSD RPD % C	MS/MSD Control Limits		
			Conc	%	C		Conc	%	C		LCL	UCL	RPD				Conc	%	C		Conc	%	C		LCL	UCL	RPD
			%	%	%		%	%	%		%	%	%				%	%	%		%	%	%		%	%	%
Cyanide, Total	<	0.006	0.10	0.11	107.7	---	---	---	---	90	110	20	885838-001	0.012	0.10	0.14	123.0	N	0.10	0.14	123.6	N	0.4	90	110	20	

Conc = mg/L unless otherwise noted

C = QC Code, see Qualifier Sheet

Parent Result is reported down to MDL in order to allow Validation of this worksheet

The %R and RPD results are calculated from raw data values with more significant figures than are reported on this form.

Report Date: 7/23/2007

QC Batch Number: 22700



Sample Condition Upon Receipt

Client Name: MCO Project # 885775

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: _____

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other _____

Thermometer Used N/A Type of Ice: Wet Blue None Samples on ice, cooling process has begun

Cooler Temperature PCI Biological Tissue Is Frozen: Yes No

Temp should be above freezing to 6°C

Date and Initials of person examining contents: AG 7/6/07

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.
Short Hold Time Analysis (<72hr):	<input checked="" type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.
-Includes date/time/ID/Analysis Matrix:	<u>W</u>	
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	13.
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	
exceptions: VOA, coliform, TOC, O&G, W-DRO (water)	<input type="checkbox"/> Yes <input type="checkbox"/> No	Initial when completed
		Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.
Trip Blank Present:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	16.
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	
Pace Trip Blank Lot # (if purchased):		

Client Notification/ Resolution: _____ Field Data Required? Y I N

Person Contacted: _____ Date/Time: _____
Comments/ Resolution: We say, collect date 4/6/07. No date on label. need correct date. u 7/6/07 Collected 7-6-07 pm 7-9-07

Project Manager Review: [Signature] Date: 7-9-07

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)



Company Name: MCO
Branch/Location: Menasha
Project Contact: Stuart Boerst
Phone: 920-751-4200
Project Number:
Project Name: Mouthe
Project State: WI
Sampled By (Print): Paul Much
Sampled By (Sign): [Signature]
PO #: Regulatory Program:

CHAIN OF CUSTODY

***Preservation Codes**
A=None B=HCL C=H2SO4 D=HNO3 E=DI Water F=Methanol G=NaOH
H=Sodium Bisulfate Solution I=Sodium Thiosulfate J=Other

Quote #:
Mail To Contact: Stuart Boerst
Mail To Company: McMahon
Mail To Address: Neenah
Invoice To Contact: Randy Much
Invoice To Company: MCO
Invoice To Address: Menasha
Invoice To Phone: 920-751-4760
CLIENT COMMENTS:
LAB COMMENTS (Lab Use Only): 250 mL Poly
Profile #:

Data Package Options (billable)
 EPA Level III
 EPA Level IV
MS/MSD
 On your sample (billable)
 NOT needed on your sample
Matrix Codes
A=Air W=Water
B=Biota DW=Drinking Water
C=Charcoal GW=Ground Water
O=Oil SW=Surface Water
S=Soil WW=Waste Water
SI=Sludge WP=Wipe

PACE LAB #	CLIENT FIELD ID	COLLECTION		MATRIX	Y/N	Pick Letter	Analyses Requested
		DATE	TIME				
001	MW-110	4/6		GW	Y	G	Cyanide Total

Rush Turnaround Time Requested - Prelims
(Rush TAT subject to approval/surcharge)
Date Needed:
Transmit Prelim Rush Results by (complete what you want):
Email #1:
Email #2:
Telephone:
Fax:

Relinquished By: [Signature]	Date/Time: 4-6-07	Received By: [Signature]	Date/Time: 7/6/07 12:35
Relinquished By: [Signature]	Date/Time: 7/6/07 14:05	Received By: [Signature]	Date/Time: 7/6/07 14:05
Relinquished By:	Date/Time:	Received By:	Date/Time:
Relinquished By:	Date/Time:	Received By:	Date/Time:
Relinquished By:	Date/Time:	Received By:	Date/Time:

PACE Project No. 885775
Receipt Temp = 20.1°C
Sample Receipt pH
OK / Adjusted
Cooler Custody Seal
Present / Not Present
Intact / Not Intact

Samples on HOLD are subject to special pricing and release of liability