



GANNETT FLEMING, INC.
8025 Excelsior Drive
Madison, WI 53717-1900

Office: (608) 836-1500
Fax: (608) 831-3337
www.gannettfleming.com

Prepared For
NATIONAL PRESTO INDUSTRIES, INC.
EAU CLAIRE, WISCONSIN

ANNUAL INTERIM REMEDIAL ACTION
STATUS REPORT - 2010

PROJECT #34283.000
MARCH 2011



Office Location:

GANNETT FLEMING, INC.
8025 Excelsior Drive
Madison, Wisconsin 53717-1900

Office Contact:

David J. Olig, P.G.
Dennis F. Kugle
(608) 836-1500



GANNETT FLEMING, INC.
8025 Excelsior Drive
Madison, WI 53717-1900
Office: (608) 836-1500
Fax: (608) 831-3337
www.gannettfleming.com

March 23, 2011
File #34283.000

Mr. Howard Caine
Remedial Project Manager
United States Environmental Protection Agency
Waste Management Division
Region 5
77 West Jackson Blvd., 6th Floor
Chicago, IL 60604-3590

Ms. Mae Willkom
Wisconsin Department of Natural Resources
Remediation and Redevelopment Program
West 1300 Clairemont Avenue
P.O. Box 4001
Eau Claire, WI 54701

Re: Annual Remedial Action Status Report - 2010
National Presto Industries, Inc., Eau Claire, Wisconsin

Dear Mr. Caine and Ms. Willkom:

At your request, we are submitting the subject report that provides information on the interim and final remedial actions at the Southwest Corner (Plume 1/2), Melby Road Disposal Site (Former Plume 3/4), and East Disposal Site (Former Plume 5) and the status of groundwater quality associated with the National Presto Industries, Inc. (NPI) site in Eau Claire, Wisconsin, as well as associated off-site areas downgradient of the NPI site. The report documents the effectiveness of the past and ongoing active groundwater remediation at the site and documents recent investigations. In addition, this report provides analytical data for the City of Eau Claire municipal production wells that were sampled during 2010, along with a brief summary of the history of the supplemental remedial activities and sampling in the Southwest Corner. The report also provides conclusions based on the data and lists activities to be completed in 2011.

Executive Summary

In 2010, NPI continued to monitor groundwater and soil vapor extraction wells in accordance with approved sampling plans. With the approval of the U.S. Environmental Protection Agency (USEPA) and the Wisconsin Department of Natural Resources (WDNR), six additional monitoring wells and two extraction well were abandoned in the Southwest Corner. Cascade aerator #2 was also removed and replaced at another location in the Southwest Corner.

L:\CLERICAL\projects\34200\34283\reports\djo\Annual Report 2010\R34283_010.doc

A Tradition of Excellence



Gunnett Fleming

Mr. Howard Caine
U.S. Environmental Protection Agency
Ms. Mae Willkom
Wisconsin Department of Natural Resources
March 23, 2011

-2-

As a follow-up to the 2009 Geoprobe investigation in the Southwest Corner, additional investigation was conducted within the NPI building to identify the source of TCE in groundwater west of the building. That investigation was unsuccessful. However, the data show that TCE concentrations at NPI's west property boundary are below the ES/MCL. Two new well nests were installed to monitor groundwater quality in that area and assist in determining whether extraction well EW-4 needs to be replaced.

Soil confirmation samples in the MW-34/70 Area document that with the exception of one small area, TCE in soil no longer poses a risk to groundwater quality. The SVE system will continue to be operated to continue to protect groundwater quality.

The data for 2010 confirmed that there continue to be no remaining detectable concentrations of VOCs in the groundwater at the East Disposal Site (EDS) area and that VOCs are not present in the on-site wells beneath the cap at the Melby Road Disposal Site (MRDS), following the shutdown of extraction wells EW-1R and EW-2 in October and one round of sampling. Based on the long-term absence of VOCs in groundwater at/near the EDS, we recommend abandonment of the monitoring wells associated with this area of the site.

In summary, VOC concentrations in virtually all the wells used to monitor the original plumes associated with the NPI site are stable or decreasing, and a significant number of wells no longer contain detectable concentrations of TCE. The only remaining plume with TCE concentrations above the NR140 ES/MCL is Plume 1/2, and based on the data, it is limited to a narrow, off-site, deeper portion of the alluvial aquifer and a small on-site area near the west side of the NPI building. There is no evidence that groundwater leaving the NPI site contains TCE at concentrations above the ES/MCL.

Introduction

The calendar year 2010 interim remedial action status report for this project includes the available historical groundwater quality data from all wells monitored for this project, both on and off site. It also provides graphs of the concentrations of trichloroethylene (TCE) over time in these wells. Complete historical analytical data for all wells are also provided on the enclosed CD in Appendix A. The CD in Appendix A also contains the laboratory reports for all quarterly samples collected in 2010. In addition, this report provides information about the volume of water that has been pumped from the on-site groundwater extraction wells and discusses the effectiveness of the cascade aerator treatment system.

Gannett Fleming

Mr. Howard Caine
U.S. Environmental Protection Agency
Ms. Mae Willkom
Wisconsin Department of Natural Resources
March 23, 2011

-3-

The report also discusses the supplemental soil, soil gas, and groundwater investigation done in the Southwest Corner Area in 2010, provides an update on the status of the Restrictive Use Covenant required for the MRDS, contains information on confirmation soil samples collected in the MW-34/70 area, and proposes a new groundwater sampling schedule for the site.

Hydrogeologic Setting

Sands and gravels underlie the NPI site. Pre-glacial sandstone bedrock valleys are buried beneath these unconsolidated deposits. These valleys, which trend westerly toward the Chippewa River (Plume 1/2) and northwesterly toward Lake Hallie (Plumes 3/4 and 5), control the direction of groundwater flow in the area. The average groundwater flow velocity in the area is approximately 12.5 feet/day, with a gradient of about 0.015 in Plume 1/2, between the NPI site and the City of Eau Claire's well field.

General Groundwater Monitoring Information

Groundwater samples were collected at least once from a total of 68 monitoring wells, 4 on-site extraction wells, and 5 city production wells during the four routine quarterly sampling rounds completed in 2010. In addition to collecting samples from the above wells, samples were also collected from the combined pumpage from the production wells in the city's north well field, both before and after the air stripper and following chlorination. This data is used to evaluate the impact of blending the water from several wells on the TCE concentration and the efficiency of the air stripper in removing TCE from the pumped water.

Figure 1 is a 24-inch x 36-inch area-wide map showing the locations of all the groundwater monitoring points that have been sampled during the life of this project. The figure also shows the location of Plume 1/2 and the former locations of Plume 3/4 and Plume 5, all as defined in 1993. Table 1 is a summary of the construction information for all monitoring and extraction wells associated with this site. This summary table also identifies with which plume/former plume each well is/was associated and provides the grid coordinates for each well shown on Figure 1.

Ms. Marcia A. Kuehl, M.A. Kuehl Company, Green Bay, Wisconsin, validated the data from each of the four quarterly sampling rounds in 2010.

On the first day of each quarterly round of groundwater sampling in 2010, water level measurements were made in all on- and off-site wells to be sampled in that round. This included all on-site wells, regardless of whether or not they were scheduled to be sampled.

Gannett Fleming

Mr. Howard Caine
U.S. Environmental Protection Agency
Ms. Mae Willkom
Wisconsin Department of Natural Resources
March 23, 2011

-4-

Table 2 lists the water level measurements for all four 2010 sampling rounds. Figure 2 is a 24-inch x 36-inch area-wide groundwater flow map from the October 2010 sampling round. Figure 3 is an 11-inch x 17-inch on-site groundwater flow map. Both figures are based on the water level measurements made during the October 2010 sampling round, when a relatively large number of wells were measured to provide a more complete groundwater flow map.

Sampling Protocols

Passive Diffusion Bags

In May 2009, the USEPA conditionally approved the long-term use of passive diffusion bags (PDBs) for the NPI site. Since then, samples have been collected for analysis using PDBs whenever possible, and they have been shown to produce data quality comparable to the past sampling protocols. However, the physical properties of the bags preclude their use to collect samples for cadmium analysis, so samples for cadmium analysis are collected using either low-flow sampling methods or bailers, depending on the depth of water in the well. Bailers or low-flow sampling methods also continue to be used to collect samples for VOC analysis in instances where the depth of water in a well is insufficient to use a PDB.

The bags are deployed at the time of the previous quarterly sampling round and are in place for approximately three months. There has only been one instance where a slight film was noticed on a bag at the time of sampling. In general, we have found that the analytical results from samples collected with PDBs are very similar to those collected in the past using bailers and low-flow sampling methods. The use of PDBs is included in the groundwater monitoring plan as one of the potential means of collecting groundwater samples.

TCE Investigations and Remediation – Southwest Corner

MW-34/70 Area

In November and December 2002, 24 Geoprobe borings were advanced in the southwest corner of the NPI property in response to increasing TCE concentrations in several monitoring wells in that area of the site. The analytical results of samples from these borings documented the presence of a previously unknown source area west of former Lagoon #1 and east-southeast of well nest MW-34. The material encountered was identified as TCE degreaser sludge from a former operation (circa 1940s/50s) at NPI. This was in contrast to 1,1,1-trichloroethane (TCA), which was the primary contaminant of the forge compound in former Lagoon #1. Because TCE, not TCA, is the primary contaminant found in the degreaser sludge area, this has been considered a separate source area from

Gannett Fleming

Mr. Howard Caine
U.S. Environmental Protection Agency
Ms. Mae Willkom
Wisconsin Department of Natural Resources
March 23, 2011

-5-

Lagoon #1, where the primary contaminant was TCA. Figures 1, 3, 4, 7, and 8 show the location of this TCE source area.

To address impacts to soil and groundwater from this newly identified source area, two deep soil vapor extraction (SVE) wells (VW-1D and 2D) and one shallow SVE well (VW-1S) were installed in July 2003 to provide a vapor barrier to vertical migration of TCE to the groundwater in this source area. Only the deep wells were operated in 2003. This system had an immediate positive effect on both the prevention of vertical migration of TCE to the groundwater and the remediation of TCE in the vadose zone in this newly discovered source area. Significant decreases in the TCE concentrations were observed in monitoring wells MW-34A, MW-70A, and MW-67A, all located immediately downgradient from this source area. Figure 4 shows the locations of all the SVE wells and monitoring points associated with this interim remedial action.

In June 2004, the shallow SVE well was connected to the blower to remove TCE from the shallow soil. Three additional shallow SVE wells (VW-2S to VW-4S) and a second blower were added in August 2004, as was a deep monitoring point (MP-4).

To augment the two-level SVE system, a third blower was added in April 2005, and monitoring point MP-4 was converted to a deep SVE well. The previous "deep" SVE wells (VW-1D and VW-2D) in essence became mid-depth SVE wells. To minimize the confusion of renaming the two original "deep" wells, their designations were not changed, and MP-4 was renamed VW-1BR as it is screened in the top 5 feet of the sandstone bedrock. With the addition of VW-1BR, this became a three-level SVE system.

The seven-well SVE system is operated during the warmer months, generally from late March or early April until mid-November. Because the lateral piping is above ground, it must be shut down for the winter to avoid the buildup of freezing condensation. Since the ground is frozen during the period of system down time, there is very little, if any, vertical migration and thus little chance of adverse impacts to groundwater from any residual TCE in the vadose zone. In July 2009, we began pulsing the system during the warm weather months, turning it on for three days and off for four days on a weekly basis. This schedule was designed so that it would result in the exchange of a minimum of one pore volume of soil vapor per week.

In 2010, all the SVE wells were turned on April 1. The deep well was turned off on May 20 and was not re-started. The shallow and mid-depth wells were operated continuously until they were turned off on November 18th. During 2010, approximately 20 pounds of TCE and just over 22 pounds of total VOCs were removed from the soil in the source area, bringing the total amount of TCE removed since August 2003 to about 137 pounds and the total amount of VOCs to about 304 pounds.

Gannett Fleming

Mr. Howard Caine
U.S. Environmental Protection Agency
Ms. Mae Willkom
Wisconsin Department of Natural Resources
March 23, 2011

-6-

More specific information on this system will be provided in our MW-34/70 Area SVE system status report for 2010.

The analytical data from sampling the monitoring wells in nests MW-34 and MW-70 continue to demonstrate the effectiveness of the SVE system in providing a barrier to vertical contaminant migration and thus groundwater contamination. In addition, air emission sampling had indicated that the TCE concentrations in this area were relatively low.

In September 2010, a Geoprobe was used to collect soil confirmation samples in the MW-34/70 area to determine the actual TCE concentrations remaining in the soil. The results of these samples documented that the SVE system had been very effective in removing TCE from the native soil and areas with smaller masses of degreaser sludge. However, there were four samples where TCE concentrations remained relatively unchanged from the 2002 samples. These samples with elevated TCE concentrations all contained degreaser sludge. It appears that SVE removal has not been as effective in those areas where the TCE is more tightly bound to the oily matrix of the degreaser sludge and the surface area to volume ratio is lower. Table 4 contains the results of the soil confirmation samples.

To better evaluate the potential impact of these areas of residual TCE on groundwater quality, subsequent soil samples were collected from these four locations (CB-1 L, CB-2 L, CB-4 L, and CB-7 L) using a hand auger. The samples were submitted for synthetic precipitation leaching procedure (SPLP) and total organic carbon (TOC) analyses. Two samples outside the impacted area (NS-1 and NS-2) were also collected and analyzed for TOC to provide background data. Figure 4 shows the locations of these samples.

As described in the WDNR's *Guidance on the Use of Leaching Tests for Unsaturated Contaminated Soils to Determine Groundwater Contamination Potential* (RR-523-03, October 7, 2003), leaching tests are one of the methods identified in NR 720.19(4)(b), Wisconsin Administrative Code, as a methodology to evaluate the impact of residual soil impacts for the protection of groundwater. A leaching test is used to determine the potential of residual soil contamination to desorb from the soil and impact the groundwater at a concentration that may exceed a groundwater standard. As described in WDNR's leaching test guidance document, the SPLP test (EPA Method 1312) is the recommended test procedure.

Table 4 includes the SPLP leachate and TOC results. With the exception of CB-7 L, all SPLP leachate samples had concentrations of the site contaminants of concern below applicable NR 140 ESs. Sample CB7-L had a TCE leachate concentration of 115 micrograms per liter ($\mu\text{g}/\ell$), above its NR 140 ES of 5 $\mu\text{g}/\ell$. Leachate concentrations of chloroform (CB1-L) and methylene chloride (CB-

Gannett Fleming

Mr. Howard Caine
U.S. Environmental Protection Agency
Ms. Mae Willkom
Wisconsin Department of Natural Resources
March 23, 2011

-7-

1 L, CB-2 L, and CB-4L) were above their applicable NR 140 ES; however, none of these soil samples had detectable concentrations of these compounds. Both compounds are common laboratory contaminants; therefore, we believe both compounds are laboratory-derived contaminants. These compounds are not shown in the table.

In general, the SPLP leachate sample results agree with the September 2010 soil sample results; the residual VOCs found in the soil impacted by the degreaser sludge are not significantly leachable. As shown in Table 4, even though soil samples CB2 and CB4 contained degreaser sludge and had relatively high TCE concentrations, neither of the SPLP samples contained detectable concentrations of TCE. Soil sample CB7 also contained degreaser sludge; however, since the TCE concentration was an order of magnitude greater than the concentrations measured in CB2 and CB4, we believe there is a sufficient amount of residual TCE in CB7 to result in an exceedance of the ES. Because of this, NPI will continue to seasonally operate the shallow and mid-depth blowers of the SVE system. Appendix A contains a CD with the laboratory reports and chain of custody records for the soil confirmation and SPLP analytical results.

Building 105 - Additional Investigation

While below the ES, TCE concentrations in the two extraction wells (EW-5 and former EW-4) and a number of the monitoring wells (MW-4B, MW-68B, MW-23A&B, and RW-2A,B,&C) in and immediately downgradient from the Southwest Corner have remained steady. The installation of the SVE system at the former degreaser sludge area has removed a significant mass of TCE, but the data from the above wells suggested the possibility of another TCE source area in the Southwest Corner.

In June and October 2009, a Geoprobe investigation identified the likely presence of an additional TCE source area in the general vicinity of Loading Docks 11 and 12 on the west side of the NPI building. After reviewing groundwater contour maps and drawings of the various additions to the building, a location off the end of a former loading dock attached to the southwest corner of Building 105 was considered the most likely location for a former release of TCE-containing materials. This area is now covered by Building 105 C.

In September 2010, a Geoprobe was used to collect soil and soil gas samples under NPI Building 105 in an attempt to identify the source of TCE-impacting groundwater in the above noted wells. The results of the sampling did not identify another TCE source area. See our November 12, 2010, update letter for more detailed information. Based on the results of that investigation and the direction of groundwater flow in that area of the site, the source area would now seem to be either immediately west of the building or beneath the building east of the area of the initial investigation. Figure 5 shows the locations of soil borings associated with the investigations in 2009 and 2010. An

Gannett Fleming

Mr. Howard Caine
U.S. Environmental Protection Agency
Ms. Mae Willkom
Wisconsin Department of Natural Resources
March 23, 2011

-8-

additional investigation was done along the west side of Building 105 in February 2011. The results will be provided under separate cover as soon as they are available.

Installation of Additional Monitoring Wells

In September 2010, two additional nests of groundwater monitoring wells (MW-76 and MW-77) were installed and developed west of the general location of the apparent newly discovered source area. The purpose of these nests is to provide additional information on TCE concentrations in groundwater west of the building and north of well nest MW-4 and better assess the impacts on groundwater quality from the apparent newly discovered TCE source area. See our November 12, 2010, update letter for additional information. Two rounds of groundwater samples have been collected from these wells, and the results are similar to the data from the Geoprobe investigation. The locations of these new wells are shown on Figures 1 through 3. The specific results from these wells will be discussed below.

NPI Building Expansion

NPI is in the process of planning for an approximately 68,000-square-foot expansion to its building. The expansion will be located at the southwest corner of the building and will be used for product storage and shipping of final products. The footprint of the proposed expansion covers monitoring well nest MW-67 and extraction wells EW-3 and EW-4. MW-67A had one detected concentration of TCE (0.50J) since 2004. MW-67B has not had a detected concentration of TCE since 2003. EW-3 has been out of service since 2003, when its pump failed. These nest/wells were abandoned on September 22, June 24, and October 14, 2010, respectively. The abandonments were done with your approval and in accordance with NR 141. The abandonment forms were submitted to both agencies. Because the addition would also affect existing underground piping from the Southwest Corner extraction wells to Cascade Aerator #2, the aerator was also removed on October 18. A replacement cascade aerator was constructed approximately 200 feet south of EW-5 and began operating on November 9.

Regarding EW-4, as we have discussed, it is our intent to evaluate several rounds of groundwater results from new well nests MW-76 and MW-77 and the other wells in the Southwest Corner area before deciding whether to replace EW-4, and if so, where its replacement should be located. Figure 6 shows the approximate locations of the proposed building addition and the affected wells and cascade aerators.

Gonnett Fleming

Mr. Howard Caine
U.S. Environmental Protection Agency
Ms. Mae Willkom
Wisconsin Department of Natural Resources
March 23, 2011

-9-

Operation of the Interim and Final Remedial Systems

There are groundwater pump and treat remediation systems (interim remedial actions) in the Southwest Corner and at the MRDS. There is also a multi-layer cap and an SVE system (final remedy) at the MRDS. The SVE system is designed to operate continuously. In 2010, the SVE system at the MRDS operated continuously. Extraction well EW-1R at the MRDS operated continuously, with the exception of the period from September 22 through September 27, when all the wells were turned off to allow work to be done on the oil/water separator in the Southwest Corner. It was then shut off on October 6 as part of the 18-month trial shutdown of the MRDS extraction wells. Extraction well EW-2 had pump problems early in the year and did not operate from January 1 through February 21. After it was re-started on February 22, it operated on the same schedule as EW-1.

Extraction well EW-4 in the Southwest Corner operated from January 1 until April 30, when its pump was turned off because of low groundwater levels; these levels didn't provide enough head for the pump to operate efficiently. The pump in EW-4 was turned back on and ran on May 3 and 4, but was turned off again due to low groundwater levels. On June 24 the pump in EW-4 was lowered within the well and was turned back on until the September shutdown to work on the oil/water separator. The pump was re-started on September 27 and ran continuously until October 13. Well EW-4 was abandoned on October 14.

Extraction well EW-5 operated continuously in 2010 with the exception of about three hours on July 6, when the pump was lowered, the five-day shutdown in September, and the period from October 18 to November 9, while the new cascade aerator in the Southwest Corner was under construction and a new electrical service was being installed.

Southwest Corner and Off-Property (Plume 1/2)

Volatile Organic Compounds

Figure 7 is a groundwater flow map for the Southwest Corner that was prepared using the groundwater elevations measured in the water table wells in this area of the site in October 2010. The groundwater contours show the area of influence of extraction wells EW-4 and EW-5. Table 2 contains all of the 2010 groundwater elevations.

Table 3 contains all the historical analytical results for samples collected from the on-site monitoring wells in the Southwest Corner area of the site, as well as off-site, downgradient monitoring wells in Plume 1/2. In addition to the tables provided in this report, comprehensive historical data for the

Gannett Fleming

Mr. Howard Caine
U.S. Environmental Protection Agency
Ms. Mae Willkom
Wisconsin Department of Natural Resources
March 23, 2011

-10-

wells in Plume 1/2 and all other project wells are provided on a CD in Appendix A of this report. The CD in Appendix A also contains all the laboratory reports and chain of custody records from the quarterly sampling done in 2010.

It is normal for contaminant concentrations in a monitoring well to vary somewhat over time, but it's the long-term trend that is most important. In 2010, only groundwater samples from six monitoring wells (MW-38B, MW-51B, MW-76A, RW-3C, RW-15, and RW-16B) in Plume 1/2 had TCE concentrations above the ES in one or more sampling round. All of these wells, with the exception of newly installed MW-76A, are located off site. With minor exceptions, the concentration of TCE in 2010 was steady or decreasing in the monitoring wells in this plume. This continues an encouraging trend in Plume 1/2 and is a directly attributable to the remedial efforts that have taken place on site. Appendix B contains TCE concentration versus time graphs for all the Plume 1/2 wells. These graphs provide a quick visual depiction of the overall trends of TCE concentrations in the Plume 1/2 wells.

Figure 8, a TCE concentration map for the Southwest Corner area, was created using the most recent 2010 data for each well. In October 2003, there were three on-site wells in the Southwest Corner area in which groundwater samples contained TCE at concentrations above the 5.0 µg/l ES. During the last six years, no groundwater samples from monitoring or extraction wells in the Southwest Corner have had TCE concentrations above the ES. The persistence of TCE at low concentrations in several of the monitoring wells and the two extraction wells in the Southwest Corner and immediately downgradient resulted in the additional investigation for a possible source(s) as described above.

The results of samples from the two new well nests (MW-76 and MW-77) in the Southwest Corner were similar to those from the 2009 Geoprobe investigation. They confirm that there is another TCE source somewhere southeast of nest MW-76, but TCE concentrations in groundwater leaving the NPI property are well below the ES/MCL. The analytical results of additional groundwater samples will be evaluated before determining whether extraction well EW-4 needs to be replaced, and if so, where it should be located.

Four of the remaining five City of Eau Claire monitoring wells (EC wells) were sampled in 2010. EC-1 and EC-2 were sampled four times. The TCE concentrations in the samples from these wells were steady, compared to the results from the last several years. The TCE concentrations in the samples from EC-2 were all below the laboratory detection limit. The other two wells (EC-5 and EC-6) were each sampled once. TCE concentrations in the samples from both of these wells also continued to be below the laboratory detection limit and therefore continue to help define the width of the TCE plume as it nears the city well field.

Gannett Fleming

Mr. Howard Caine
U.S. Environmental Protection Agency
Ms. Mae Willkom
Wisconsin Department of Natural Resources
March 23, 2011

-11-

On a monthly basis during 2010, the City of Eau Claire collected and analyzed water samples for VOCs from five of its production wells (CW-11, CW-15 to CW-17, and CW-19) in the north well field. The City splits samples with Gannett Fleming during our quarterly sampling rounds. The City uses USEPA Method 8260, which is not the drinking water analytical method. Gannett Fleming's split samples are analyzed using USEPA Method 524.2, the approved method for drinking water. This method provides a detection limit below that of the City's and provides more accurate data. This was very important when the clean-up standard was the PAL. Now given the relatively low TCE concentrations in the samples from these wells and the fact that the clean-up standard has been changed to the ES, which is a health-based standard at both the state and federal level, the analytical method used is not as critical. However, NPI will continue to use the drinking water method to analyze the samples from these wells to provide more accurate data.

Table 5 contains all historical analytical results of the raw water samples collected by both the City and Gannett Fleming from the individual city production wells; the commingled untreated raw water prior to the stripping towers; the commingled treated water after each of the towers, but before chlorination; and the commingled, treated water after chlorination. All of the monthly samples from CW-11 and CW-15 to CW-17 that were analyzed by the City in 2010 had TCE concentrations below their 0.7 µg/ℓ laboratory detection limit, with the exception of a 1.2 µg/ℓ result in the October sample from CW-16. The split samples analyzed by Gannett Fleming from these wells all had TCE concentrations below the 0.40 µg/ℓ laboratory detection limit, with the exception of the March sample from CW-11, which had a TCE concentration of 0.96 µg/ℓ. This is the first time a sample from this well has contained a TCE concentration above the laboratory detection limit. The cause/validity of this result is not known. However, both concentrations are well below the 5.0 µg/ℓ federal and state drinking water standard. The fact that the TCE concentration in the Gannett Fleming split sample from CW-16 in October was below the 0.40 µg/ℓ detection limit raises a question about the accuracy of the City's result.

Well CW-19 is the northern-most city well. Based on the data, it is believed that this well intercepts all the TCE in Plume 1/2 that reaches the city well field. The TCE concentrations from the City's analyses of samples from CW-19 in 2010 were all well below the 5.0 µg/ℓ ES/MCL, ranging from 1.90 to 2.80 µg/ℓ. The four split samples analyzed by the laboratory used by Gannett Fleming provided similar results that ranged from 2.09 to 2.49 µg/ℓ and were similar to the results from the previous two years.

Since at least March 2001 when Gannett Fleming began having our split samples analyzed using USEPA Method 524.2, the TCE concentrations in the commingled, untreated raw water from the city production wells have consistently been substantially less than the 5.0 µg/ℓ health-based ES/MCL,

Gannett Fleming

Mr. Howard Caine
U.S. Environmental Protection Agency
Ms. Mae Willkom
Wisconsin Department of Natural Resources
March 23, 2011

-12-

ranging from 0.57J to 1.09 µg/ℓ. In 2010, as in the past, the TCE concentrations in the commingled water following stripping are below the limit of detection.

Table 6 lists all the analytical results for the samples collected from the two Southwest Corner extraction wells (EW-4 and EW-5) that operated in 2010. EW-5 was placed into operation in January 2004 to provide better capture of TCE coming from the western boundary of the then newly discovered MW-34/70 TCE source area. The pump in extraction well EW-3 failed in August 2003. It was determined that a decision to replace the pump in EW-3 would not be made until sufficient information from the combined operation of EW-4 and EW-5 was available so that an assessment could be made as to whether operation of EW-3 was still required to contain any residual contaminants that might be coming from former Lagoon #1 and from the newly discovered MW-34/70 TCE source area. Based on capture zone modeling and the initial year of groundwater data, Gannett Fleming determined that extraction wells EW-4 and EW-5 alone provided adequate capture of groundwater flowing beneath former Lagoon #1 and the newly discovered TCE source area. Therefore, extraction well EW-3 has since been left idle. As noted above, due to a proposed building expansion, extraction wells EW-3 and EW-4, along with MW-67A&B, were abandoned during 2010.

Extraction wells EW-4 and EW-5 were sampled three and four times, respectively, in 2010. The TCE concentrations in these wells ranged from 0.47J to 1.33J µg/ℓ. These concentrations are similar to those in the 2009 samples from these wells. Concentrations of TCA, the primary compound of concern in the forge compound in Lagoon #1, ranged from 2.46 to 4.65 µg/ℓ in samples from EW-4 in 2010. This continues a downward trend, is an order of magnitude below concentrations in the mid-1990s, and is well below the 200 µg/ℓ ES. TCA concentrations in samples from EW-5 in 2010 were below the limit of detection in three of the four samples and 1.76 µg/ℓ in the other. These data confirm the fact that the source removal activities and operation of the SVE system at Lagoon #1 and operation the SVE system associated with the MW-34/70 Area have been successful. Table 6 contains all historical results from the Southwest Corner extraction wells.

Cadmium

Monitoring for dissolved cadmium continues at several monitoring wells in the Southwest Corner. At least one groundwater sample was collected from monitoring wells MW-10A&B, MW-11A, and MW-34A&B in 2010 and analyzed for dissolved cadmium. Table 7 contains all historical cadmium analytical results for the wells in the Southwest Corner that have historically been sampled for cadmium.

Gonnett Fleming

Mr. Howard Caine
U.S. Environmental Protection Agency
Ms. Mae Willkom
Wisconsin Department of Natural Resources
March 23, 2011

-13-

All four of the 2010 groundwater samples from MW-10A, both samples from MW-34A, and one of two samples from MW-10B had dissolved cadmium concentrations above its 5.0 $\mu\text{g}/\ell$ ES. Monitoring well MW-10A continued to have the highest dissolved cadmium concentrations, ranging from 24.1 to 29.8 $\mu\text{g}/\ell$. Wells MW-10B and MW-34A each had one sample above the ES. Metals are relatively immobile in the subsurface. However, historically it was assumed that the extraction wells would intercept and remove any cadmium that might migrate downgradient within the aquifer.

With the abandonment of EW-4, which would have likely captured any cadmium that may have migrated downgradient from the area of the MW-10 nest, it is appropriate to further evaluate cadmium concentrations in this area of the site. The cadmium concentration in the December 2010 sample from Manhole #18, which is now only receiving water from EW-5, was 0.23 $\mu\text{g}/\ell$. This would indicate that cadmium is likely not migrating downgradient within the aquifer. However, based on the location of the MW-10 well nest and the direction of groundwater flow, NPI is proposing to sample monitoring wells MW-4A&B twice each in 2011 to determine whether cadmium is migrating within the aquifer north of the capture zone of extraction well EW-5. See Figure 7 for a groundwater flow map of the Southwest Corner.

Melby Road Disposal Site (Former Plume 3/4)

The installation and operation of the groundwater extraction wells (EW-1 and EW-2) at the MRDS in March 1994 was an interim action that was implemented until the final remedy was developed and implemented. The final remedy was the engineered multi-level cap over the MRDS and the SVE system that was installed beneath the cap. As far back as the 2000 Annual Report, it was noted that the groundwater data from this area, since the installation of the final remedy in 1998, document that the final remedy has been successful and that the operation of the interim action (EW-1, its replacement EW-1R, and EW-2) is no longer needed because none of the on-site wells under the cap have contained detectable concentrations of TCE.

In 2010, NPI prepared and submitted a draft Restrictive Use Covenant (RUC) for the MRDS as requested by the USEPA. Although internal issues between the USEPA and WDNR needed to be resolved regarding the RUC, the agencies agreed that the RUC was substantially complete and on August 25, 2010, the USEPA issued its approval of an 18-month trial shutdown of the MRDS extraction wells. The shutdown requires quarterly monitoring of all on- and off-site wells near the MRDS and the submittal of quarterly reports evaluating the data. In the event that TCE concentrations increase to pre-agreed levels, the extraction wells will be turned back on. NPI periodically turns on the two wells for short-time intervals to keep them operational in the event they need to be turned back on due to results from the quarterly monitoring program.

Gannett Fleming

Mr. Howard Caine
U.S. Environmental Protection Agency
Ms. Mae Willkom
Wisconsin Department of Natural Resources
March 23, 2011

-14-

In October 2010, the initial round of groundwater samples supporting the shutdown was collected during the third quarter sampling round, and the MRDS extraction wells were turned off to begin the 18-month trial shutdown. The initial quarterly report containing the results of the samples was sent to the agencies on November 5, 2010. The second quarterly report was submitted on January 19, 2011. Both reports documented that the TCE concentrations in the samples collected from the monitoring wells at and near the MRDS were consistent with historical data and recommended continuation of the trial shutdown. Please refer to the above referenced reports or Table 8 of this report for the specific analytical data.

The groundwater contours at and near the MRDS are shown on Figures 2, 3, and 9 and represent groundwater elevations measured in the monitoring wells in October 2010.

Table 8 contains the historical analytical results for the groundwater monitoring wells at the MRDS and downgradient monitoring wells in former Plume 3/4. VOC concentrations continue to be stable or declining in all wells monitored in this area of the site. VOC concentrations in most of the wells in this area have been below the detection limit for all VOCs of concern for many years. There were no exceedances of the TCE ES in 2010 groundwater samples from any of the former Plume 3/4 wells, and none of the wells showed an increasing trend in TCE concentration.

Table 9 contains all the historical analytical results for the groundwater samples collected from the two MRDS extraction wells (EW-1R and EW-2). Both wells were sampled four times, three times before the shutdown and once after. None of the samples collected from these two wells in 2010 contained detectable concentrations of any of the VOCs of concern and haven't since 2001.

Figure 10 is a TCE concentration map that was prepared using the most recent 2010 monitoring data from the groundwater monitoring and extraction wells in the Melby Road area. It visually demonstrates the absence of TCE in all of the on-site wells beneath the MRDS cap, including the extraction wells.

Appendix C contains TCE concentration versus time graphs for all monitoring wells in the MRDS area, both on- and off-property. The graphs include all data collected since February 1994 when the extraction wells began operating. These graphs present a visual representation of the VOC concentrations over time and provide further evidence that TCE concentrations in groundwater in the Melby Road area are well below the ES and that the trend in those wells that do have detectable TCE concentrations is stable or decreasing.

Gannett Fleming

Mr. Howard Caine
U.S. Environmental Protection Agency
Ms. Mae Willkom
Wisconsin Department of Natural Resources
March 23, 2011

-15-

As noted above, the SVE system beneath the cap at the MRDS operated continuously during 2009. Additional information on the operation of the SVE system can be found in the progress reports that are submitted monthly and in the MDRS SVE system annual status report that will be submitted for 2010 documenting the operation and effectiveness of the SVE system at the MRDS.

East Disposal Site (Former Plume 5)

Figure 11 is a groundwater flow map for the EDS area that was prepared using the groundwater elevations measured in the water table wells at the EDS during the October 2010 sampling round. The groundwater contours illustrate that groundwater beneath this area of the property flows west-northwesterly in the general direction of the MRDS extraction wells. The direction of groundwater flow is likely controlled by the bedrock topography beneath the site.

Table 10 contains the historical analytical results from the EDS area monitoring wells, including the off-property private wells that were monitored for many years. Figure 12 is a TCE concentration map displaying the results of the most recent sampling round for each of the former Plume 5 monitoring wells that were sampled in 2010. As can be seen on the figure and in the table, none of the target VOCs was detected in any of the EDS monitoring wells in 2010. None of the samples from any of these wells has exceeded the PAL in over six years and none has contained a detectable concentration of TCE in over three years. Appendix D contains the TCE concentration versus time graphs for all of the EDS area wells.

Groundwater Sampling, QA/QC, and Data Validation Procedures

The procedures used to collect groundwater samples from monitoring wells, city monitoring wells, and city production wells during the 2010 sampling rounds; the QA/QC procedures used during the sampling rounds; and the data validation protocols are presented in our February 24, 2009, *Final Revised Groundwater Monitoring Plan*. Please refer to that document for information on the various protocols used. Most of the samples collected from monitoring wells were collected using PDBs. The plan will be revised to incorporate the use of PDBs. The data tables now identify the sampling method used for collecting each sample.

As noted previously in the report, Marcia Kuehl of the MAKuehl Co. validated all analytical data from all four rounds of sampling in 2010. Ms. Kuehl used the EPA guidance documents *National Functional Guidelines for Organic Data Review*, dated October 1999, EPA-540/R99/008, and the EPA Region V *Standard Operating Procedure for Validation of CLP Organic Data*, April 1991, Revised August 25, 1993. The reviews were based on Level II data packages supplied by the

Gannett Fleming

Mr. Howard Caine
U.S. Environmental Protection Agency
Ms. Mae Willkom
Wisconsin Department of Natural Resources
March 23, 2011

-16-

analytical laboratory. All the VOC data reported for 2010 were determined to be usable for assessing groundwater quality. Appendix E contains copies of the text of the data validation reports for 2010.

Extraction Well Pumping Volumes and Cascade Aerator Removal Efficiencies

Extraction wells EW-1R and EW-2 at the Melby Road area and EW-4 and EW-5 in the Southwest Corner area were part of the interim remedial action for groundwater, as described in the September 30, 1991, Record of Decision (ROD). The extraction wells have been used since 1994 to remove contaminated groundwater and provide hydraulic gradient control in these two areas of the site. Groundwater pumped from the Melby Road and Southwest Corner areas is directed to cascade aerators #1 and #2, respectively. The goal of the cascade aerators is to remove, by volatilization, a minimum of 25 percent of the VOCs from the pumped groundwater before it is discharged to a storm sewer that in turn discharges to the Chippewa River.

As described above, extraction wells EW-1R and EW-5 operated with minimal down time in 2010. EW-2 was off for several weeks in January and February for pump repairs, and EW-4 was pumping at a reduced rate in March and April and off most of May and June due to low groundwater levels. All extraction wells were off from September 22 to the 27 to allow work to be done on the oil/water separator located in the Southwest Corner. On October 6, EW-1R and EW-2 were turned off for the trial shutdown. From October 18 to November 9, EW-5 was off during the construction of Cascade Aerator #2R and re-routing of the electrical service in the Southwest Corner.

Samples of the groundwater pumped from the extraction wells were collected four times in 2010 prior to the groundwater's discharge to each of the cascade aerators. As required by the WPDES permit for this discharge, four samples were also collected of the treated effluent from the cascade aerators in 2010. The laboratory reports and chain of custody records for these samples are included on the CD in Appendix A of this report.

Table 11 provides the annual volume of groundwater pumped from the Melby Road extraction wells (EW-1R and EW-2) to cascade aerator CAS-1, the volume from the Southwest Corner extraction wells (EW-4, and EW-5) to cascade aerator CAS-2, and the cumulative volume of treated groundwater discharged to the storm sewer from the inception of the system through 2010. Due to a continued decrease in the groundwater elevation, the pumps in EW-4 and EW-5 were lowered in June and July, respectively. This resulted in substantially increased flow rates for both wells. In 2010, the total volume of treated groundwater discharged to the storm sewer was 163.13 million gallons. The volume discharged from the system since March 1994 now totals over 3.4 billion gallons.

Gannett Fleming

Mr. Howard Caine
U.S. Environmental Protection Agency
Ms. Mae Willkom
Wisconsin Department of Natural Resources
March 23, 2011

-17-

Tables 12 and 13 list the concentrations of TCA and TCE, respectively, in the groundwater pumped from the extraction wells. The tables also include all historical TCA and TCE effluent concentrations for each of the cascade aerators, the aerators' removal efficiencies, and the combined effluent concentration being discharged from the cascade aerators. Because there were no detectable concentrations of either TCA or TCE in the discharges from extraction wells EW-1R and EW-2, there is no need to calculate the removal efficiency for cascade aerator #1. Table 12 shows that the TCA removal efficiency of cascade aerator #2 in 2010 ranged from 30 to 35 percent. Table 13 shows that the TCE removal efficiency of cascade aerator #2 in 2010 ranged from 30 to 48 percent. The removal efficiency for both cascade aerators exceeded the minimum 25 percent target removal efficiency in each quarter.

The discharge from both cascade aerators flows to Manhole #18 in the southwest corner of the NPI property and from there to the City of Eau Claire storm sewer system, which in turn discharges to the Chippewa River. The discharge from the cascade aerators is regulated by the WDNR at Manhole #18. Sampling of the discharge occurs quarterly for the chlorinated compounds of concern and annually for several metals, pH, hardness, and PAHs. Every five years, more comprehensive sampling is done, similar to priority pollutant sampling done by primary industries. Discharge monitoring reporting forms are submitted to the WDNR on a quarterly basis, and an annual summary report is also submitted to the agencies. Table 14 is a compilation of that data containing the analytical results of all the Manhole 18 samples collected during the last four years. There have never been any exceedances of the limitations on this discharge. The DMRs for the discharge to Manhole #18 are submitted to the WDNR manager of the Superfund program rather than the manager of the wastewater program, in accordance with a March 12, 2008, decision made by the WDNR.

Well Abandonment

In addition to the wells abandoned in the Southwest Corner as a result of the building expansion, monitoring wells MW-21A&B and MW-33A&B were also abandoned in 2010. The former nest was previously approved for abandonment, but had not yet been abandoned. The latter nest was in the path of a new interceptor sewer being installed by the City of Eau Claire, and the agencies approved its abandonment following a review of the historical monitoring data from those wells. Abandonment forms were provided to both the WDNR and USEPA for all NPI wells that were abandoned in 2010.

Gannett Fleming

Mr. Howard Caine
U.S. Environmental Protection Agency
Ms. Mae Willkom
Wisconsin Department of Natural Resources
March 23, 2011

-18-

Groundwater Monitoring Program

Past annual reports have provided a sampling schedule for the coming year. Table 15 is the proposed new groundwater sampling schedule for the site. It takes into account the results of the additional wells that were re-sampled in 2008 and the revised monitoring schedule for the MRDS wells. We will continue to collect samples in accordance with the current sampling schedule, but would appreciate an expeditious review and approval of this proposed plan so that it can be implemented as soon as possible in 2011. It is our intent to review the schedule annually and propose adjustments as needed.

Findings and Conclusions

Operation of the SVE system in the MW-34/70 TCE source area has removed a substantial mass of TCE. The residual TCE in virtually all areas has been shown to be immobile. However, in one area the TCE is somewhat more mobile and poses a potential risk to groundwater quality. Therefore, the SVE system there should continue to be operated seasonally until future confirmation samples show it no longer poses a risk or until the source area of concern is removed or isolated through an engineered solution.

The supplemental investigation in the Building 105 area did not identify a TCE source area. Two additional nests of groundwater monitoring wells were installed and sampled in 2010. The data from these wells, other area wells, and the 2009 Geoprobe investigation point to a likely TCE source area, but also demonstrates that groundwater quality at the property boundary is well below the TCE ES/MCL. As stated above, an additional investigation was done in February 2011. The results will be provided under separate cover when they are available.

In 2010, NPI proposed an expansion to the southwest corner of its building. The footprint of the expansion required the abandonment of monitoring well nest MW-67 and extraction wells EW-3 and EW-4. In addition, cascade aerator #2 was also removed and replaced by cascade aerator #2R at a different location. A decision on replacing EW-4 will be made following review of analytical results from several rounds of samples from the new well nests and others in the area.

Within Plume 1/2, which extends from the Southwest Corner to the City of Eau Claire's municipal well field, 68 monitoring wells, 4 extraction wells, and 5 city water supply wells were sampled at least once in 2010 for VOCs (see Tables 3, 5, and 6). Thirty of these wells contained TCE at a concentration above the 0.5 µg/ℓ PAL in one or more of the samples collected in 2010. Six off-site wells (RW-15, RW-16B, MW-38B, MW-51B, and RW-3C) and one new on-site well (MW-76A) contained TCE at or above the 5.0 µg/ℓ ES/MCL. The maximum TCE concentrations in the off-site

Gannett Fleming

Mr. Howard Caine
U.S. Environmental Protection Agency
Ms. Mae Willkom
Wisconsin Department of Natural Resources
March 23, 2011

-19-

wells ranged from 5.07 to 5.78 $\mu\text{g}/\ell$, with an average concentration of 5.32 $\mu\text{g}/\ell$. The TCE concentrations in the new on-site water table well (MW-76A) ranged from 9.28 to 29.1 $\mu\text{g}/\ell$.

Of the four City of Eau Claire monitoring wells and six city production wells that were sampled in 2010, only samples from monitoring well EC-1 and production wells CW-11 and CW-19 contained TCE concentrations above the PAL in one or more samples. None of the samples from these wells has had a TCE concentration above the 5.0 $\mu\text{g}/\ell$ ES/MCL in at least the last nine years (see Tables 3 and 5).

Monitoring wells MW-10A&B, which are only monitored for dissolved cadmium, and well MW-34A contained cadmium concentrations above the 5.0 $\mu\text{g}/\ell$ ES/MCL in one or more of the samples collected from them in 2010 (see Table 7). With the abandonment of EW-4, two rounds of samples from well nest MW-4 are recommended to assess the potential for downgradient migration of cadmium.

There are no wells in either of former Plumes 3/4 (MRDS) or 5 (EDS) that have samples that contain TCE concentrations above the ES of 5 $\mu\text{g}/\ell$. There haven't been ES exceedances in samples from any of the former Plume 3/4 wells in over 16 years. In 2010, there were again only six wells in former Plume 3/4 (all off-site) that contained TCE at concentrations above the PAL, and none exceeded 1.00 $\mu\text{g}/\ell$ (see Tables 8 and 9). In former Plume 5, none of the samples from wells in this former plume contained a detectable concentration of TCE in 2010, and there hasn't been a detectable concentration of TCE in any of the former Plume 5 wells in over six years (see Table 10). Based on the data, we believe that the monitoring wells associated with the EDS are no longer needed and request approval to abandon them.

Samples from the Southwest Corner extraction wells EW-4 and EW-5 contained TCE concentrations of less than and slightly above 1.0 $\mu\text{g}/\ell$, respectively, all well below the ES. At the MRDS, samples from EW-4 and EW-5 have not contained detectable concentrations of TCE in over nine years (see Tables 6 and 9, respectively). The two cascade aerators continue to provide a minimum of 25% removal of TCE and TCA in 2010.

In summary, VOC concentrations in virtually all the wells used to monitor the original plumes associated with the NPI site continue to be stable or decreasing, and a significant number of wells no longer contain detectable concentrations of TCE. The only remaining plume is Plume 1/2. There are only six wells in this plume with TCE concentrations above the ES, and all but one of them is located off site.

Gannett Fleming

Mr. Howard Caine
U.S. Environmental Protection Agency
Ms. Mae Willkom
Wisconsin Department of Natural Resources
March 23, 2011

-20-

The initial two rounds of analytical data from the five new wells located between the NPI building and NPI's west property boundary show that while there appears to be a newly identified source of TCE in the area, TCE concentrations leaving the NPI property are not above the ES.

The data for 2010 continued to show that VOCs are not present in the on-site wells beneath the cap at the MRDS, and the initial data show that shutdown of extraction wells EW-1R and EW-2 has not resulted in any change in groundwater quality in the MRDS area. The data also confirm that there continue to be no remaining detectable concentrations of VOCs in the groundwater at the East Disposal Site area and support the abandonment of the monitoring wells in that area of the site.

Several additional monitoring wells and extraction wells in and near Plume 1/2 were abandoned with USEPA and/or WDNR approval in 2010.

Groundwater data for all wells have been reviewed, including the wells that were re-sampled in 2008. That data, the new groundwater clean-up standard for the site, and the revised sampling schedule for the MRDS wells were considered in preparation of a proposed new groundwater sampling schedule for the site.

Planned Work - 2011

NPI has planned the following work for 2011:

- Continue to conduct routine sampling of the groundwater monitoring wells, cascade aerator(s), and SVE well systems at the MRDS and the MW-34/70 area in accordance with the approved groundwater sampling schedule and monitoring plans.
- Evaluate groundwater data from on- and off-site wells downgradient from the newly identified Building 105 TCE source area to assist in determining whether extraction well EW-4 should be replaced, and if so, where it should be located.
- Additional soil and groundwater investigation will be done along the west side of Building 105 in an attempt to locate the source of TCE detected in groundwater in that area of the site.
- Continue to operate the SVE system (at least the shallow and mid-depth wells) in the MW-34/70 Area to remove additional TCE and protect groundwater quality.
- Analyze two rounds of samples from well nest MW-4 for dissolved cadmium.
- Continue to operate Cascade Aerator #2R and, if the MRDS extraction wells are operating, Cascade Aerator #1.

Gannett Fleming

Mr. Howard Caine
U.S. Environmental Protection Agency
Ms. Mae Willkom
Wisconsin Department of Natural Resources
March 23, 2011

-21-

- Continue to implement the enhanced sampling schedule for wells at and near the MRDS when extraction wells EW-1R and EW-2 are turned off, and submit quarterly updates with recommendations to either continue the trial shutdown or turn the extraction wells back on.
- As appropriate, abandon additional monitoring wells following approval by the agencies.

If you have any questions during your review of the report, please call.

Sincerely,

GANNETT FLEMING, INC.



David J. Olig, P.G.
Senior Project Manager

DJO/jec
Enc.

cc: Derrick Paul (NPI)
Megan McLaughlin (Larson Construction Co.)
Electronic cc: Mark Wichman (USACOE)
Jeff Pippinger (City of Eau Claire)
LeAnne Addy (Village of Lake Hallie)

FIGURES


<u>No.</u>	<u>Description</u>
1	24" x 36" Area-wide Site Plan With Wells and Plumes Shown
2	24" x 36" Area-wide Groundwater Flow Map
3	11" x 17" On-site Groundwater Flow Map
4	8.5" x 11" MW-34/70 Area SVE System Layout
5	8.5" x 11" Building 105 Geoprobe Boring Location Map
6	8.5" x 11" Proposed Building Expansion
7	11" x 17" Southwest Corner Groundwater Flow Map (October 2010)
8	11" x 17" Southwest Corner TCE Concentration Map (2010)
9	11" x 17" MRDS Groundwater Flow Map (October 2010)
10	11" x 17" MRDS TCE Concentration Map (2010)
11	11" x 17" EDS Groundwater Flow Map (October 2010)
12	11" x 17" EDS TCE Concentration Map (2010)

TABLES

<u>No.</u>	<u>Description</u>
1	Well Construction Information
2	Water Level Measurements
3	Analytical Results from Plume 1/2 Monitoring Wells
4	MW-34/70 Area Soil Confirmation Analytical Results
5	Analytical Results from City of Eau Claire Production Wells
6	Analytical Results from the Southwest Corner Extraction Well Samples
7	Dissolved Cadmium Analytical Results
8	Analytical Results from Plume 3/4 Wells
9	Analytical Results from Melby Road Extraction Wells
10	Analytical Results from EDS Monitoring Wells
11	Annual Pumpage from Extraction Wells
12	1,1,1-TCA Concentrations in Extraction Wells and Discharge from Cascade Aerators
13	TCE Concentrations in Extraction Wells and Discharge from Cascade Aerators
14	Results from Manhole 18 Sampling
15	Proposed Groundwater Sampling Schedule

APPENDICES

A	CD Containing Historical Analytical Data, 2010 Laboratory Reports, and MW-34/70 Soil Confirmation & SPLP Data
B	TCE Time vs Concentration Graphs (Plume 1/2)
C	TCE Time vs Concentration Graphs (Plume 3/4)
D	TCE Time vs Concentration Graphs (Plume 5)
E	Data Validation Reports for 2010

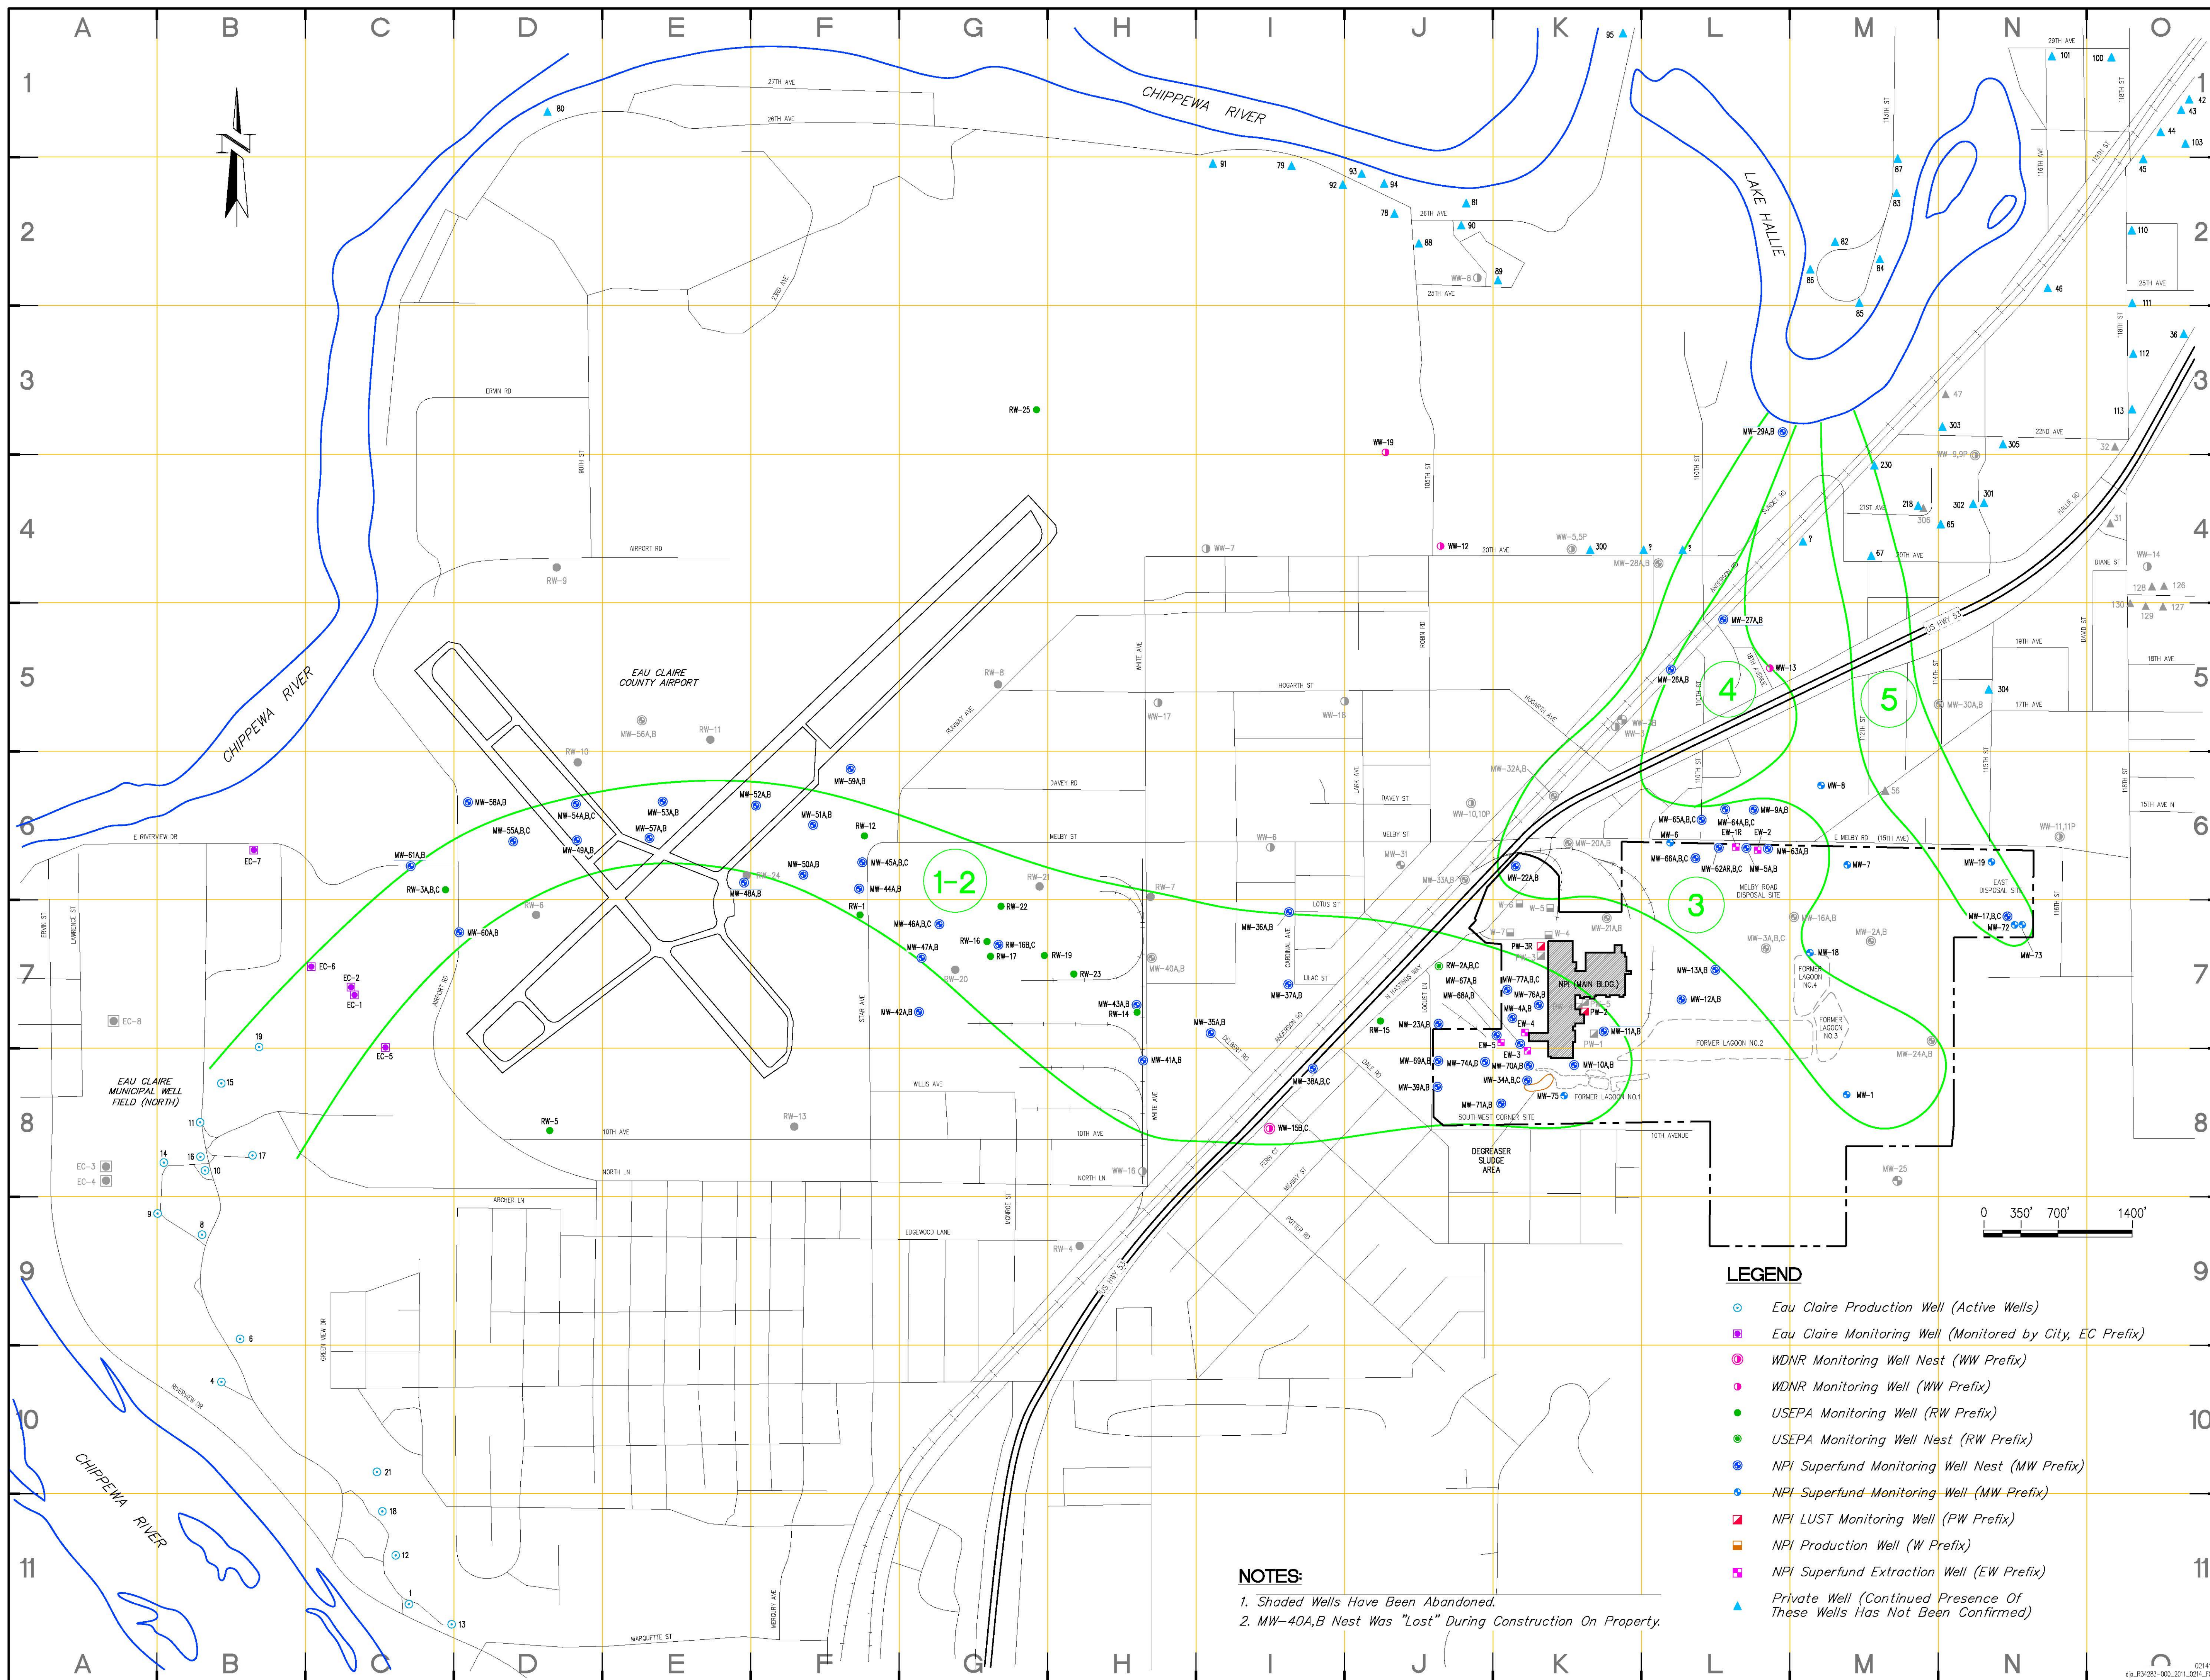

NOTES:
 1. Shaded Wells Have Been Abandoned.
 2. MW-40A,B Nest Was "Lost" During Construction On Property.

- LEGEND**
- Eau Claire Production Well (Active Wells)
 - Eau Claire Monitoring Well (Monitored by City, EC Prefix)
 - WDNR Monitoring Well Nest (WW Prefix)
 - WDNR Monitoring Well (WW Prefix)
 - USEPA Monitoring Well (RW Prefix)
 - USEPA Monitoring Well Nest (RW Prefix)
 - NPI Superfund Monitoring Well Nest (MW Prefix)
 - NPI Superfund Monitoring Well (MW Prefix)
 - NPI LUST Monitoring Well (PW Prefix)
 - NPI Production Well (W Prefix)
 - NPI Superfund Extraction Well (EW Prefix)
 - Private Well (Continued Presence Of These Wells Has Not Been Confirmed)

No.	REVISIONS	DATE	BY

AREA SITE PLAN WITH WELL AND 1993 PLUME LOCATIONS
NATIONAL PRESTO INDUSTRIES, INC. AND EAU CLAIRE MUNICIPAL WELL FIELD
 EAU CLAIRE, WISCONSIN



HARRISBURG, PENNSYLVANIA MADISON, WISCONSIN

THIS DRAWING IS AND SHALL REMAIN THE PROPERTY OF GANNETT FLEMING ENGINEERS AND PLANNERS. REUSE ON PROJECT EXTENSIONS OR ANY OTHER PROJECT, OR ALTERATIONS OR ADDITIONS TO THIS PROJECT SHALL BE AT THE USER'S SOLE RISK, AND WITHOUT LIABILITY TO GANNETT FLEMING ENGINEERS AND PLANNERS.


PROJECT
 2010 ANNUAL REPORT
 NATIONAL PRESTO INDUSTRIES, INC.
 EAU CLAIRE, WISCONSIN

TITLE
AREA SITE PLAN WITH WELL LOCATIONS AND 1993 PLUME LOCATIONS



HARRISBURG, PENNSYLVANIA		MADISON, WISCONSIN	
DRAWN BY	PS	SCALE	1" = 700'
DESIGNED BY	DJO	PROJECT No.	34283.000
APPROVED BY	-	DRAWING No.	1
DATE	FEBRUARY 2011		

02/11
 4P_234283-000_2011_02/11.DWG

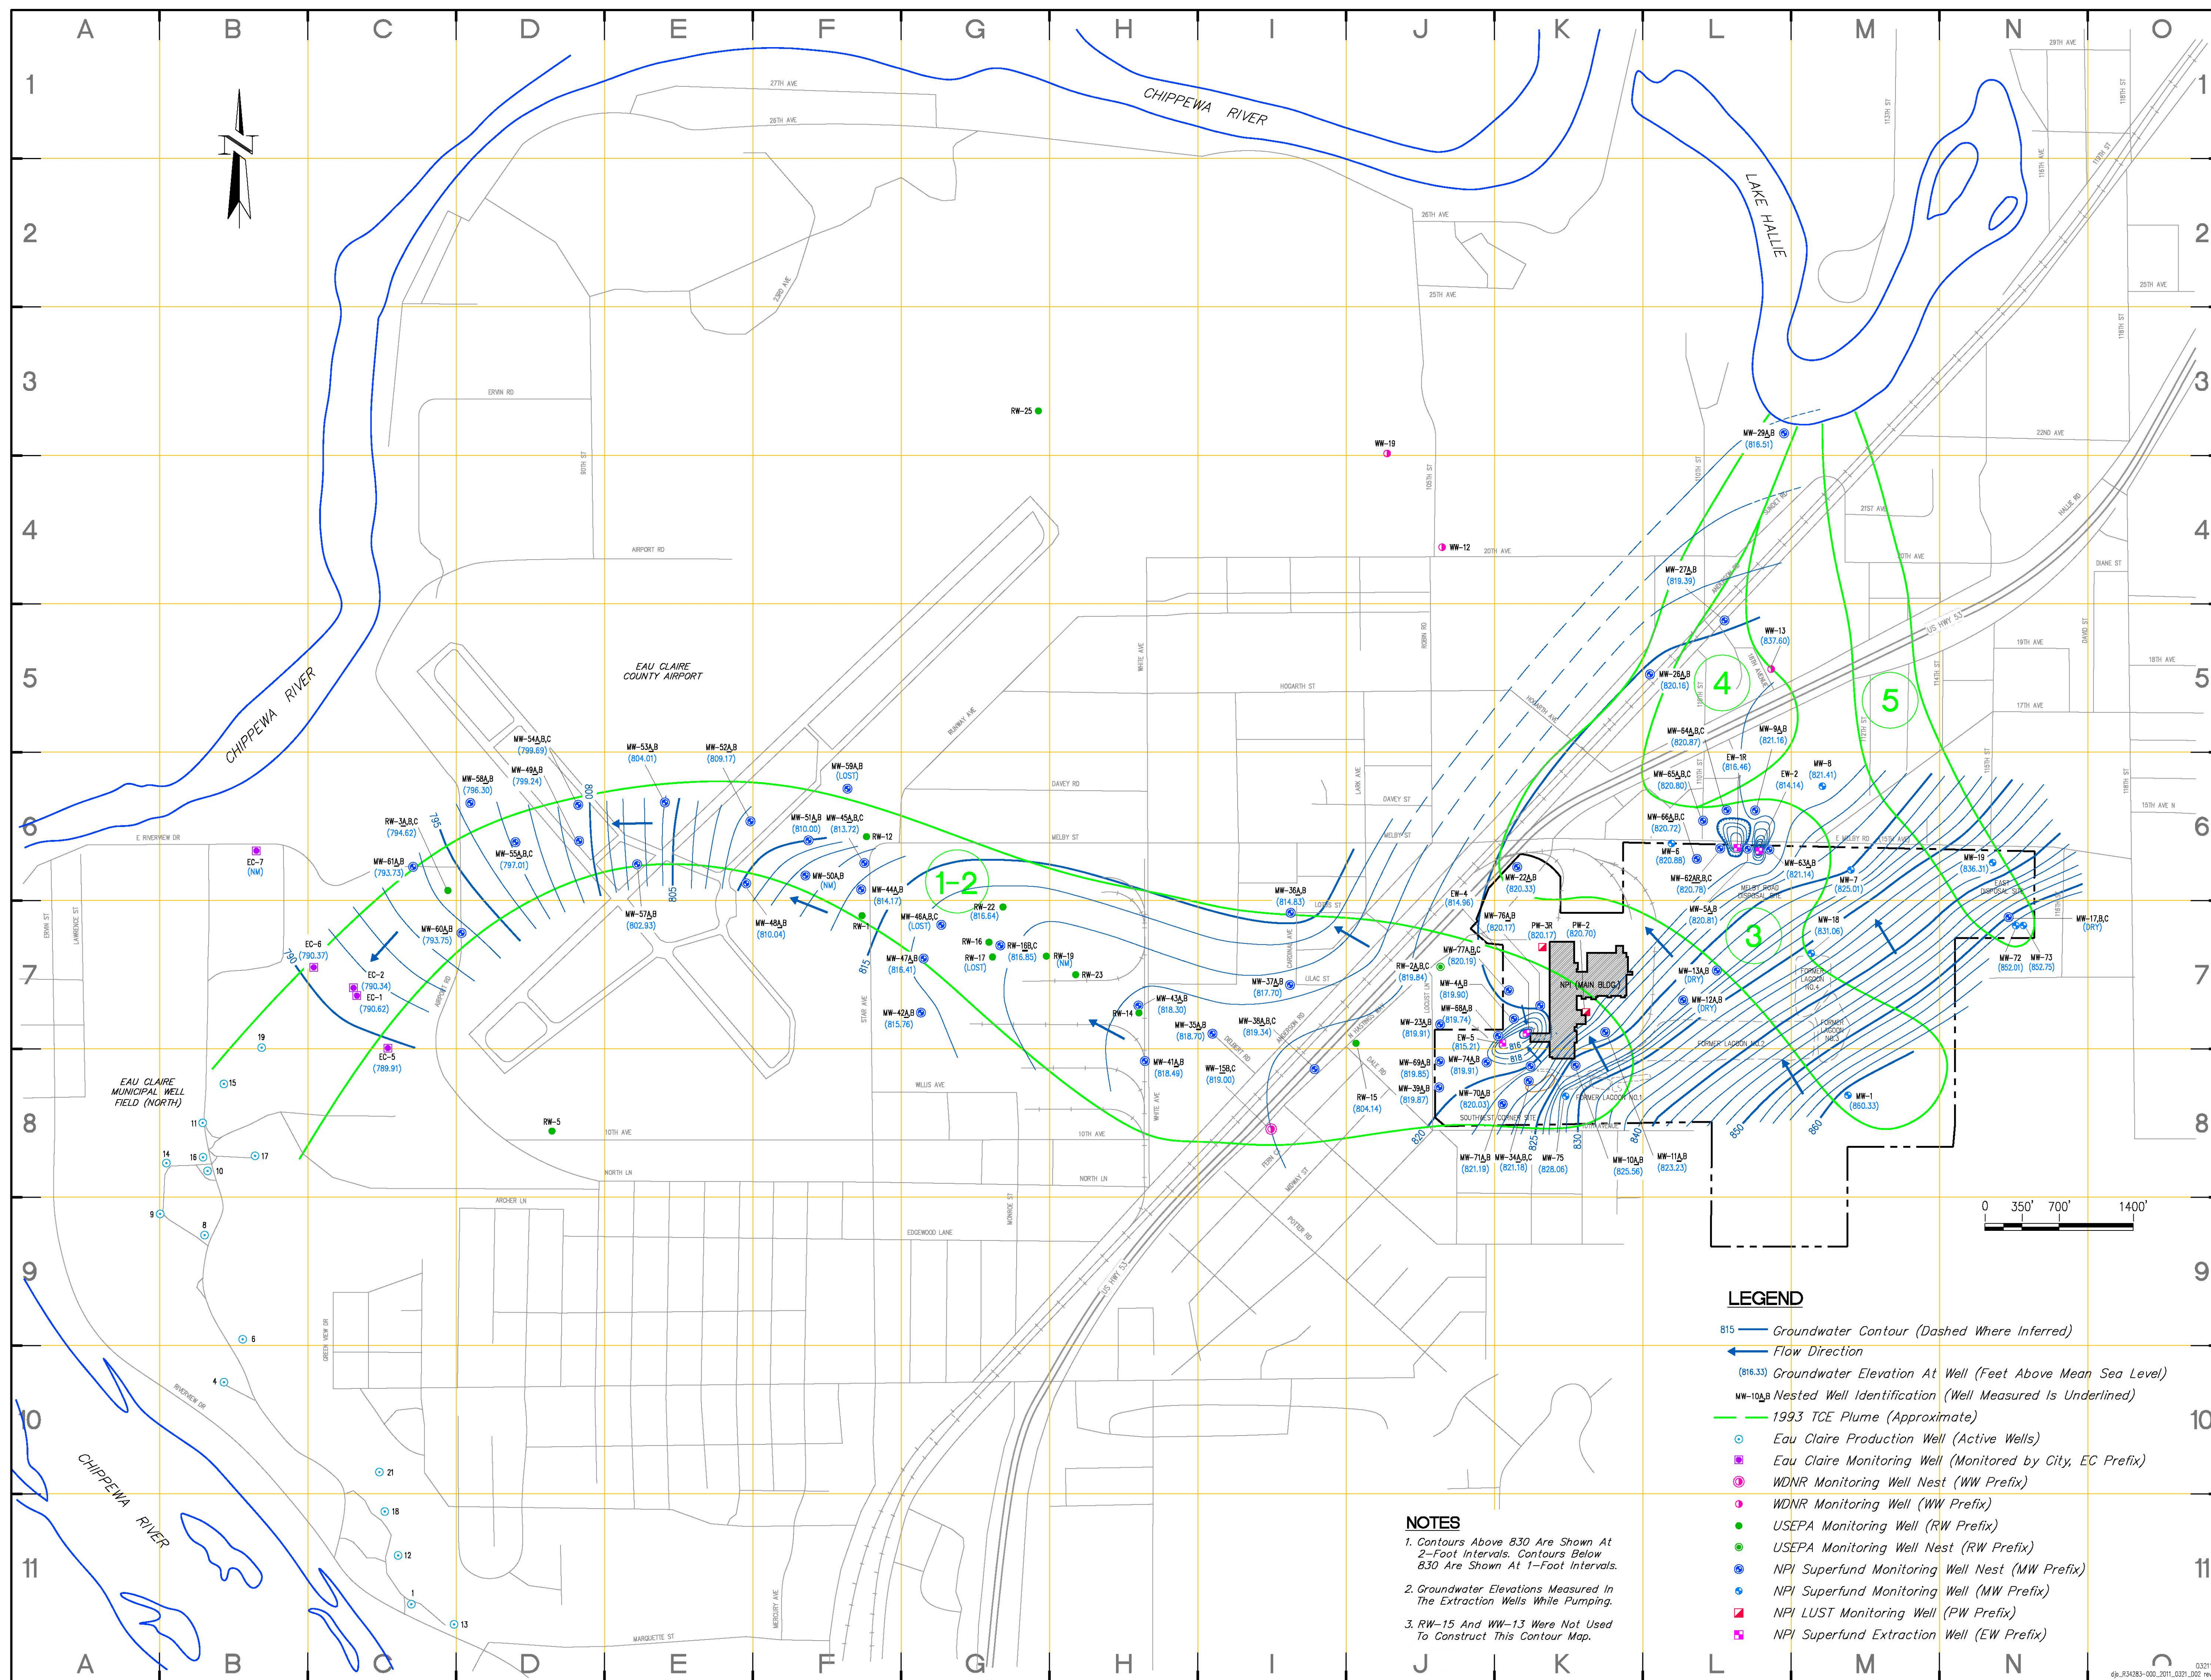

No.	REVISIONS	DATE	BY
1	GROUNDWATER CONTOUR NO. 820 REVISED.	3/9/11	JKK
2	CONTOURS NOS. 820-815 AT EW-4 REVISED.	3/21/11	DJO

AREA SITE PLAN WITH WELL AND 1993 PLUME LOCATIONS
NATIONAL PRESTO INDUSTRIES, INC. AND
EAU CLAIRE MUNICIPAL WELL FIELD
 EAU CLAIRE, WISCONSIN

Gannett Fleming
 HARRISBURG, PENNSYLVANIA
 MADISON, WISCONSIN

THIS DRAWING IS AND SHALL REMAIN THE PROPERTY OF GANNETT FLEMING ENGINEERS AND PLANNERS. REUSE ON PROJECT EXTENSIONS OR ANY OTHER PROJECT, OR ALTERATIONS OR ADDITIONS TO THIS PROJECT SHALL BE AT THE USER'S SOLE RISK, AND WITHOUT LIABILITY TO GANNETT FLEMING ENGINEERS AND PLANNERS.

PROJECT
 2010 ANNUAL REPORT
 NATIONAL PRESTO INDUSTRIES, INC.
 EAU CLAIRE, WISCONSIN

TITLE
SURFACE GROUNDWATER CONTOUR MAP (OCT. 2010) WITH 1993 PLUME LOCATIONS


Gannett Fleming	
HARRISBURG, PENNSYLVANIA	MADISON, WISCONSIN
DRAWN BY PS	SCALE 1" = 700'
DESIGNED BY DJO	PROJECT No. 34283.000
APPROVED BY -	DRAWING NO. 2
DATE MARCH 2011	

LEGEND

- 815 — Groundwater Contour (Dashed Where Inferred)
- Flow Direction
- (816.33) Groundwater Elevation At Well (Feet Above Mean Sea Level)
- MW-10A,B Nested Well Identification (Well Measured Is Underlined)
- 1993 TCE Plume (Approximate)
- Eau Claire Production Well (Active Wells)
- Eau Claire Monitoring Well (Monitored by City, EC Prefix)
- WDNR Monitoring Well Nest (WW Prefix)
- WDNR Monitoring Well (WW Prefix)
- USEPA Monitoring Well (RW Prefix)
- USEPA Monitoring Well Nest (RW Prefix)
- NPI Superfund Monitoring Well Nest (MW Prefix)
- NPI Superfund Monitoring Well (MW Prefix)
- NPI LUST Monitoring Well (PW Prefix)
- NPI Superfund Extraction Well (EW Prefix)

NOTES

1. Contours Above 830 Are Shown At 2-Foot Intervals. Contours Below 830 Are Shown At 1-Foot Intervals.
2. Groundwater Elevations Measured In The Extraction Wells While Pumping.
3. RW-15 And WW-13 Were Not Used To Construct This Contour Map.

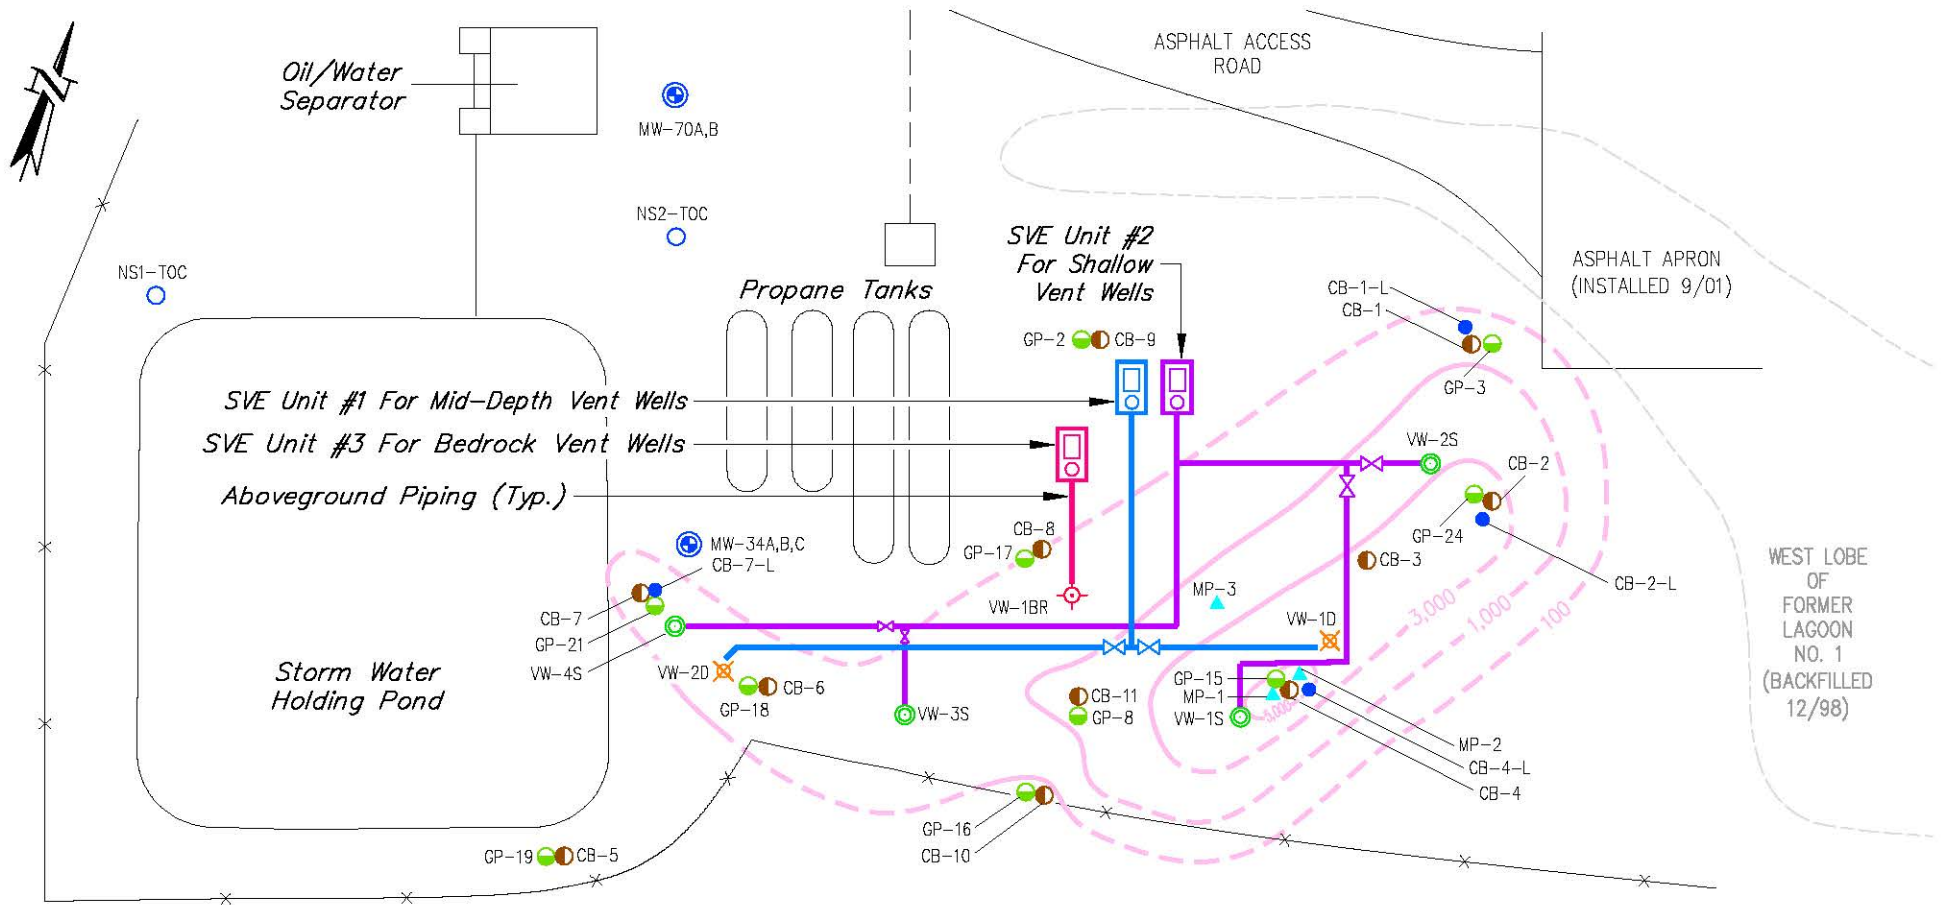


LEGEND

- Soil Sample For TOC Analysis
- Soil Sample For SPLP And TOC Analysis
- Soil Boring Location (9/10)
- Soil Boring Location (11-12/02)
- Shallow SVE Vent Well (VW Prefix)
- ⊗ Mid-Depth SVE Vent Well (VW Prefix)
- ⊕ Bedrock SVE Vent Well (VW Prefix)
- ▲ Soil Gas Monitoring Point (MP Prefix)
- ⊙ NPI Monitoring Well Nest (MW Prefix)
- 2002 TCE Soil Isoconcentration Contour ug/kg 0-4' (Dashed Where Inferred)
- ⊗ Gate Valve
- Chain-Link Fence



MW-34/70 AREA SVE SYSTEM LAYOUT

2010 ANNUAL REPORT
 NATIONAL PRESTO INDUSTRIES, INC.
 EAU CLAIRE, WISCONSIN

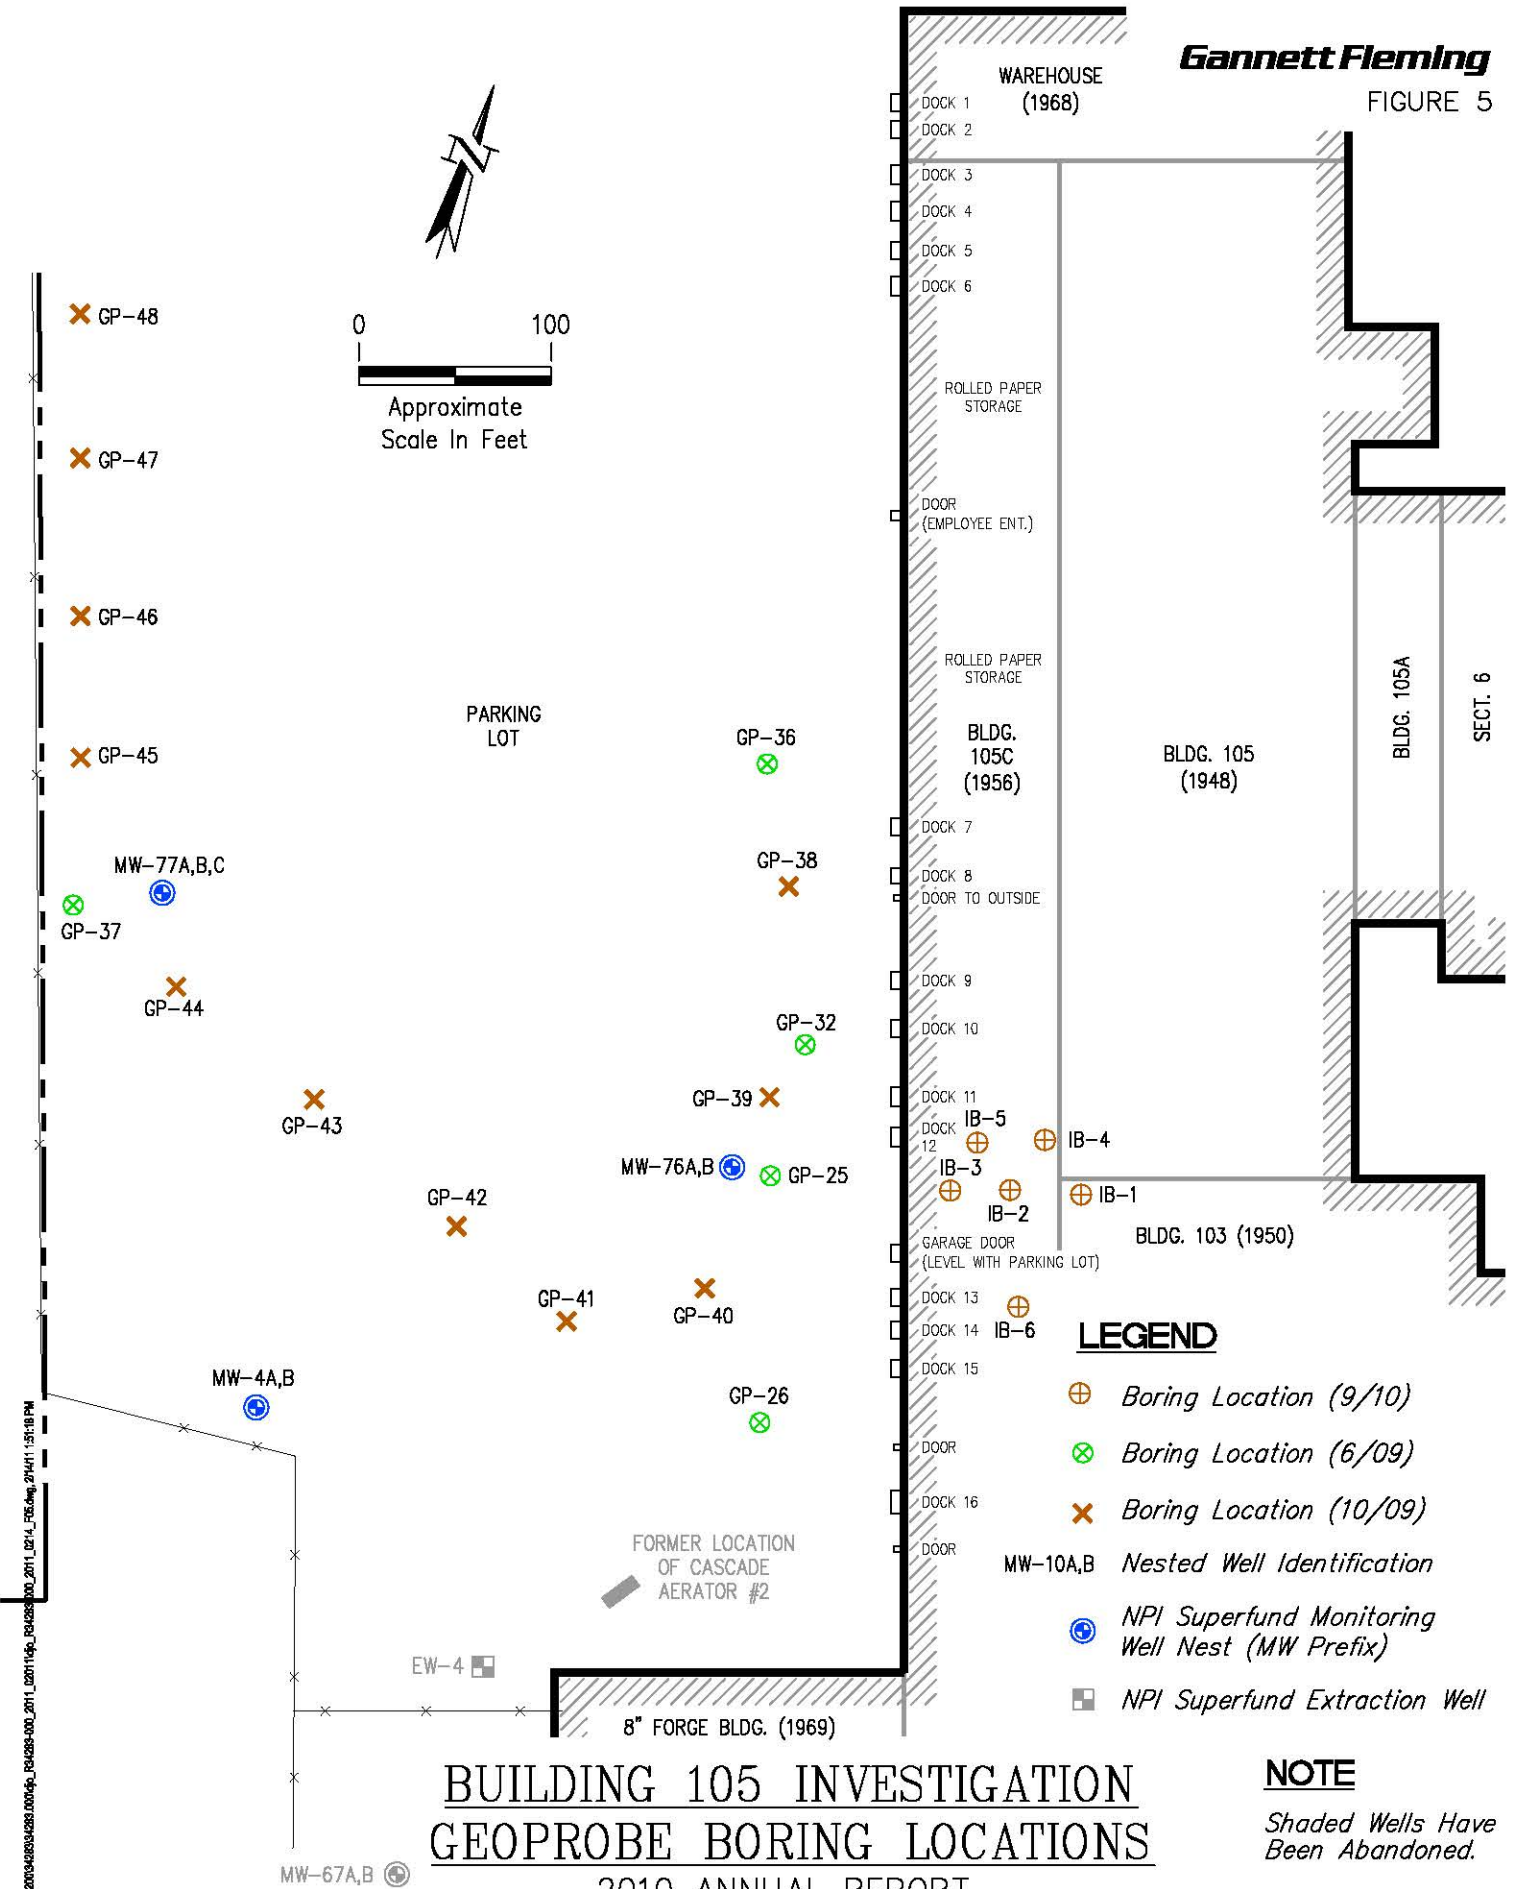


BUILDING 105 INVESTIGATION GEOPROBE BORING LOCATIONS

2010 ANNUAL REPORT
NATIONAL PRESTO INDUSTRIES, INC.
EAU CLAIRE, WISCONSIN

NOTE



Shaded Wells Have
Been Abandoned.

L:\DATA\2010\034283\000\F05_034283_000\F05_034283_000_2011_0214_F05.dwg, 2/14/11 1:51:18 PM



Approximate Scale In Feet

LEGEND

- MW-10A,B *Nested Well Identification*
-  *NPI Superfund Monitoring Well Nest (MW Prefix)*
-  *NPI Superfund Extraction Well (EW Prefix)*

MW-74A,B


LOCATION OF CASCADE AERATOR #2R


NOTE

Shaded Wells And Structures Have Been Abandoned.

PROPOSED BUILDING EXPANSION

2010 ANNUAL REPORT
NATIONAL PRESTO INDUSTRIES, INC.
EAU CLAIRE, WISCONSIN

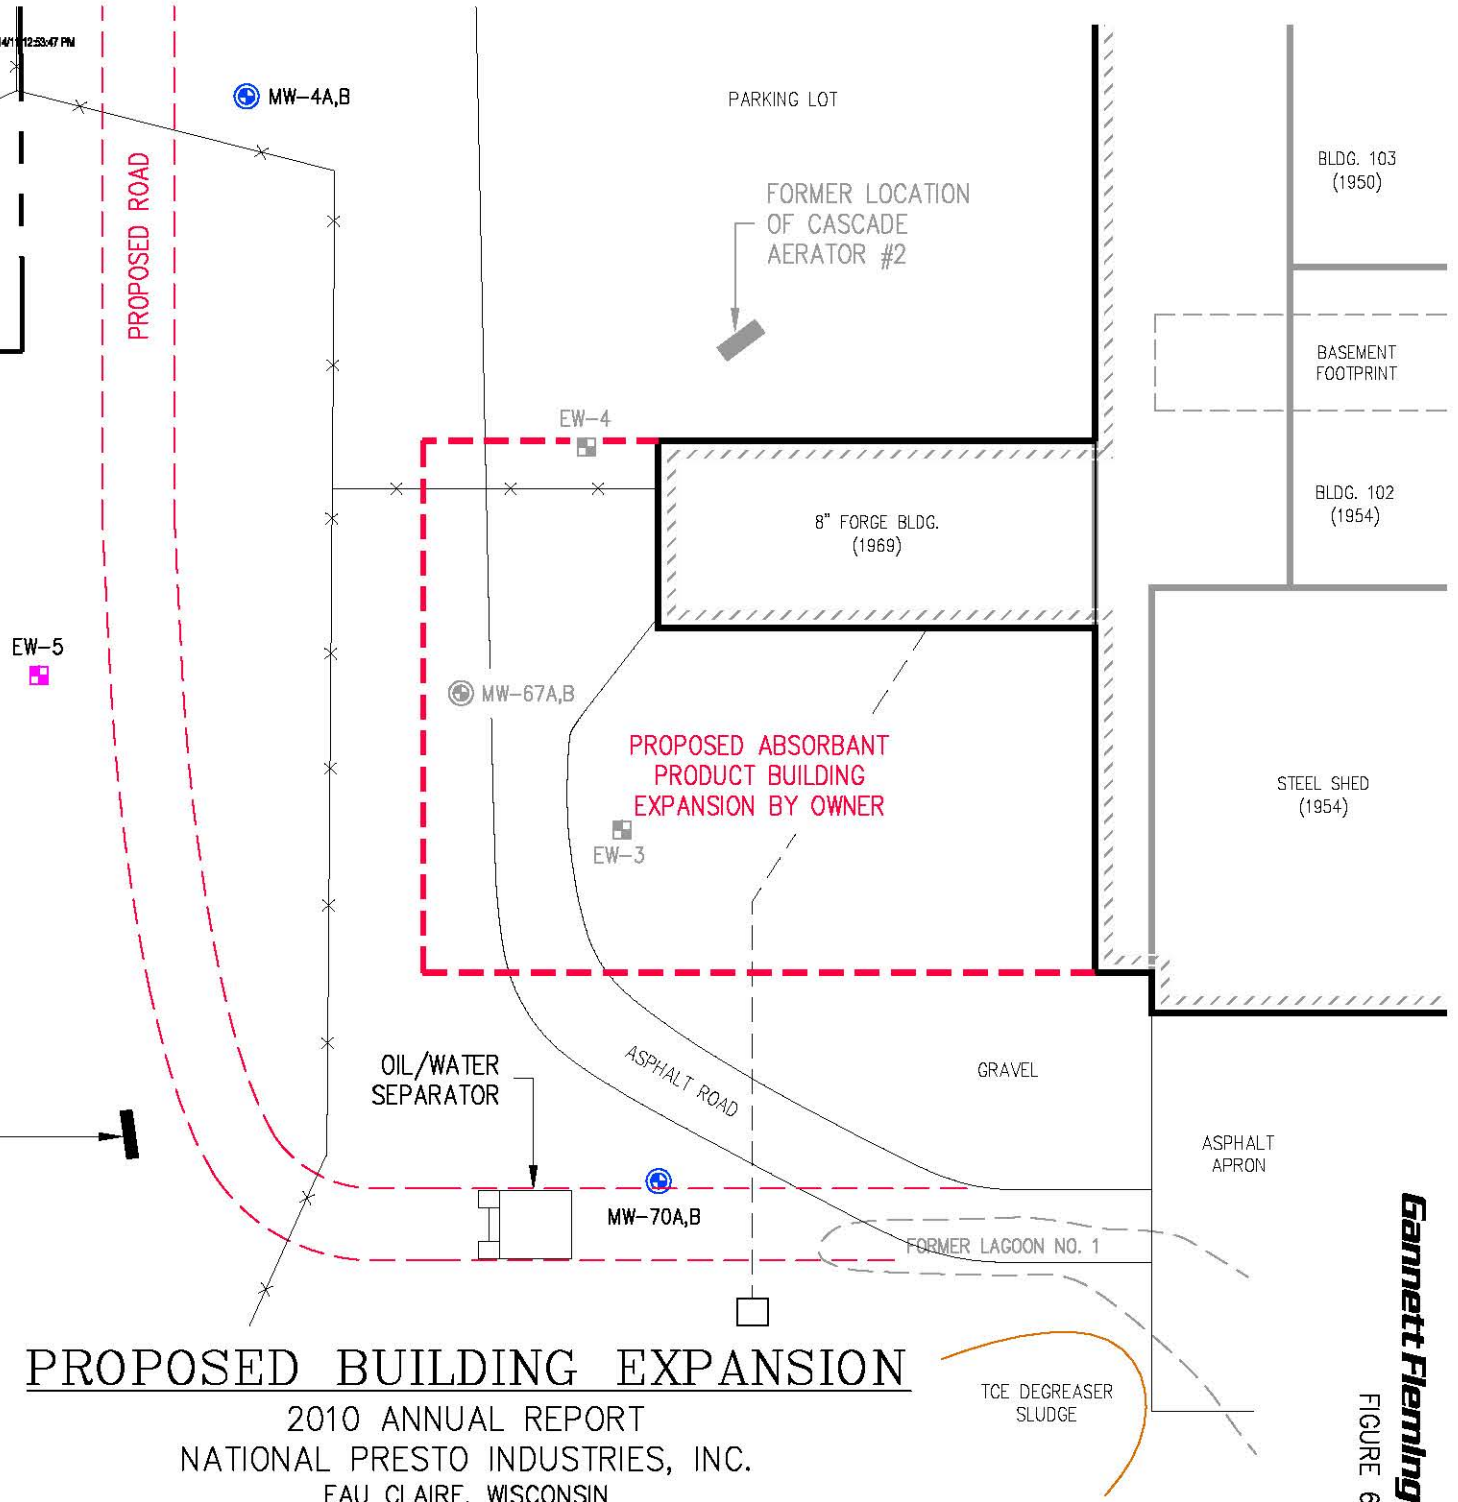

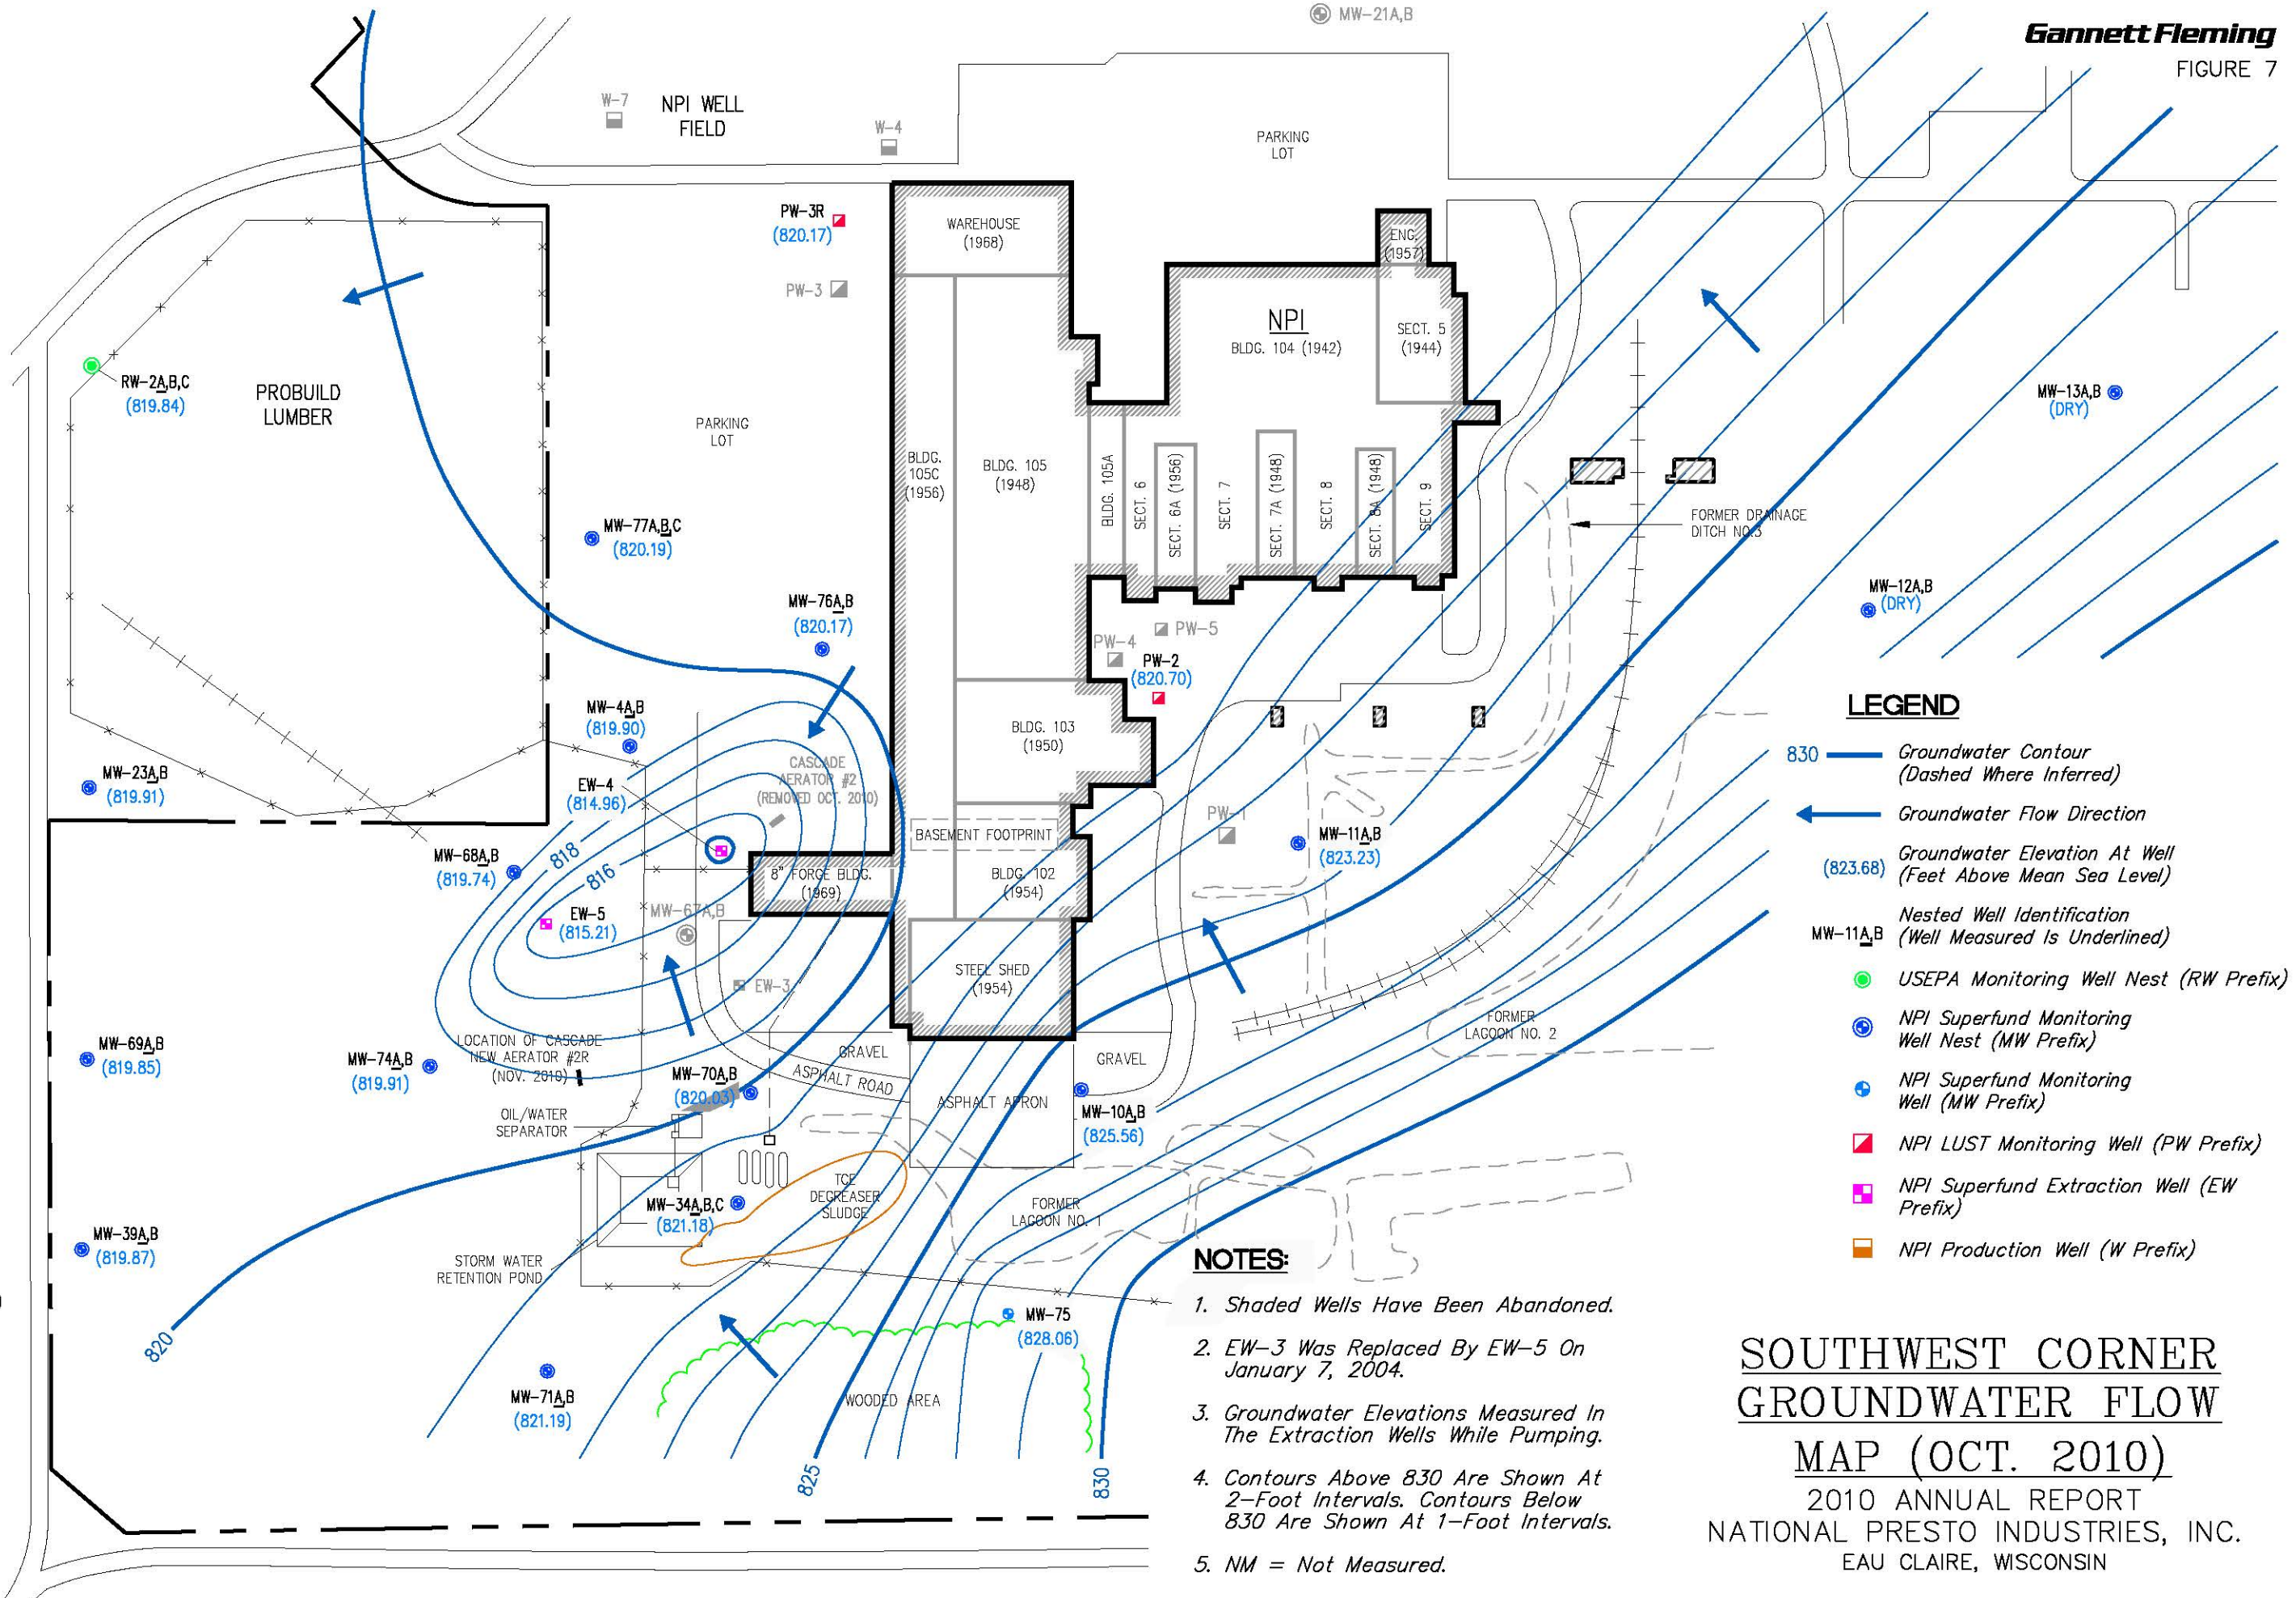


LEGEND

- 830 — Groundwater Contour (Dashed Where Inferred)
- ← Groundwater Flow Direction
- (823.68) — Groundwater Elevation At Well (Feet Above Mean Sea Level)
- MW-11A,B — Nested Well Identification (Well Measured Is Underlined)
- — USEPA Monitoring Well Nest (RW Prefix)
- ⊙ — NPI Superfund Monitoring Well Nest (MW Prefix)
- ⊕ — NPI Superfund Monitoring Well (MW Prefix)
- ▣ — NPI LUST Monitoring Well (PW Prefix)
- ⊞ — NPI Superfund Extraction Well (EW Prefix)
- — NPI Production Well (W Prefix)


NOTES:

1. Shaded Wells Have Been Abandoned.
2. EW-3 Was Replaced By EW-5 On January 7, 2004.
3. Groundwater Elevations Measured In The Extraction Wells While Pumping.
4. Contours Above 830 Are Shown At 2-Foot Intervals. Contours Below 830 Are Shown At 1-Foot Intervals.
5. NM = Not Measured.

**SOUTHWEST CORNER
GROUNDWATER FLOW
MAP (OCT. 2010)**
2010 ANNUAL REPORT
NATIONAL PRESTO INDUSTRIES, INC.
EAU CLAIRE, WISCONSIN



REVISION: GROUNDWATER
CONTOUR NO. 820
THROUGH 815 AT EW-4
REVISED ON 3/21/11.

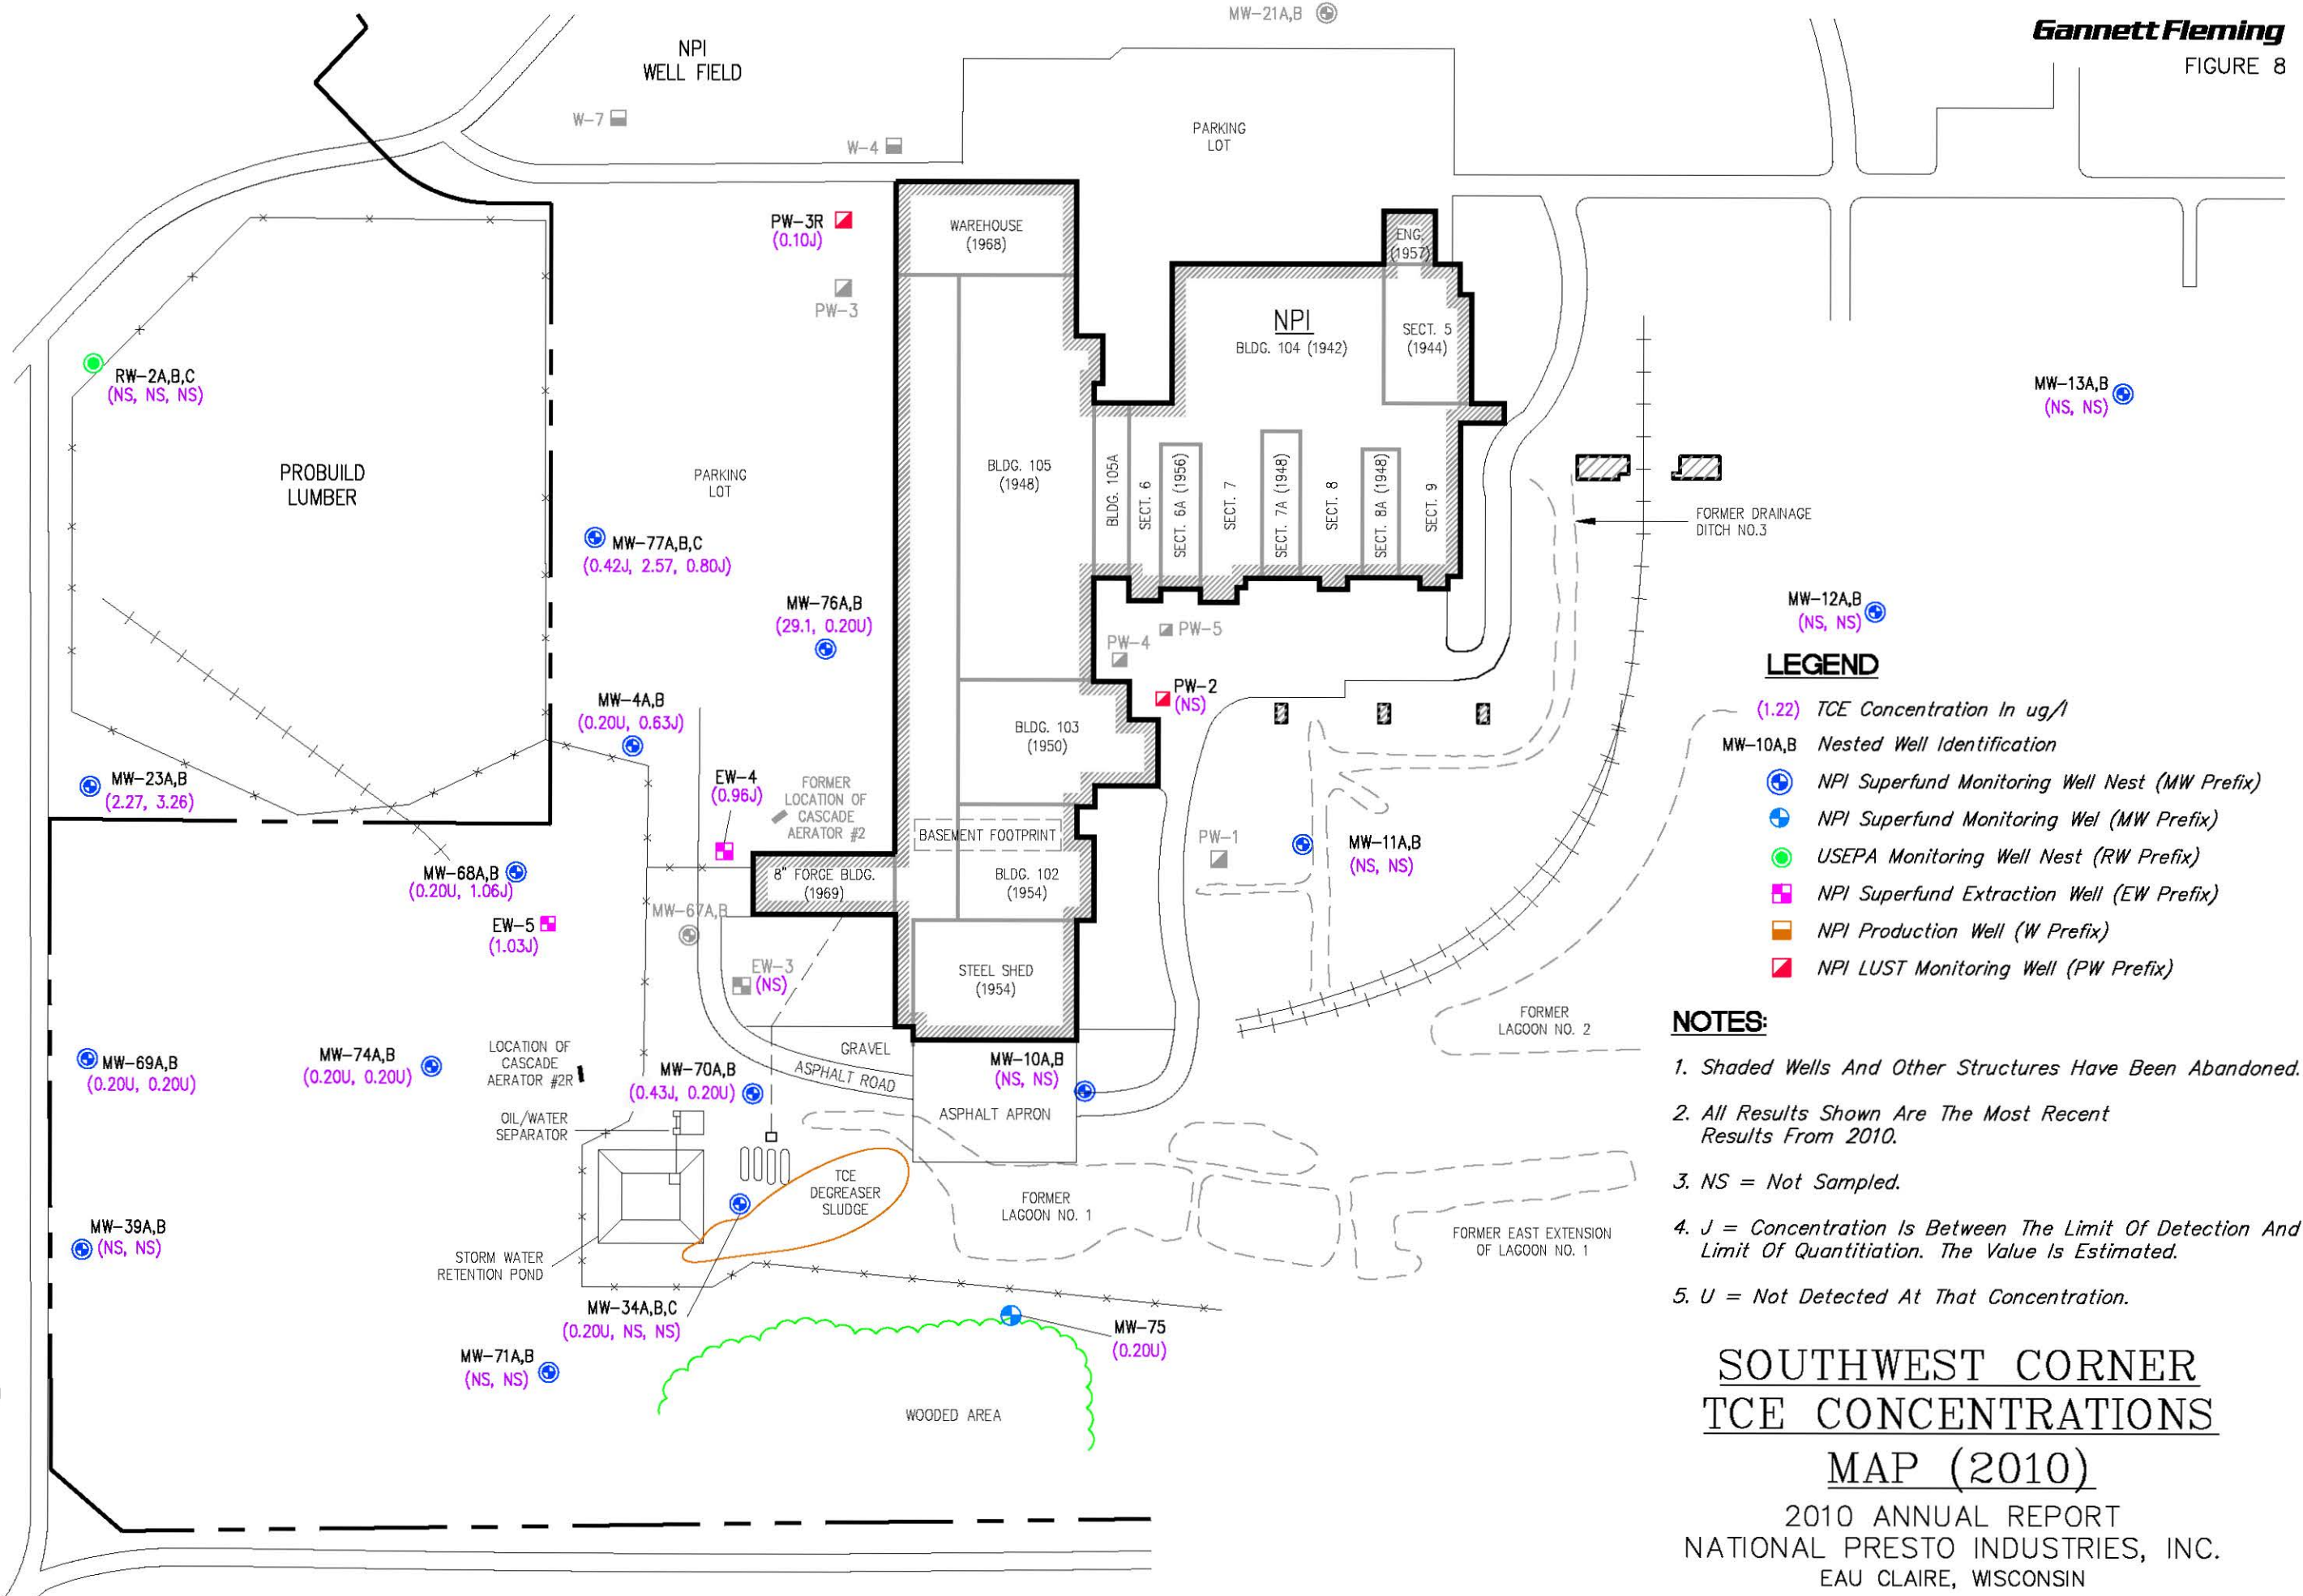

LEGEND


- (1.22) TCE Concentration In ug/l
- MW-10A,B Nested Well Identification
- ⊕ NPI Superfund Monitoring Well Nest (MW Prefix)
- ⊕ NPI Superfund Monitoring Wel (MW Prefix)
- USEPA Monitoring Well Nest (RW Prefix)
- NPI Superfund Extraction Well (EW Prefix)
- NPI Production Well (W Prefix)
- NPI LUST Monitoring Well (PW Prefix)

NOTES:

1. Shaded Wells And Other Structures Have Been Abandoned.
2. All Results Shown Are The Most Recent Results From 2010.
3. NS = Not Sampled.
4. J = Concentration Is Between The Limit Of Detection And Limit Of Quantitation. The Value Is Estimated.
5. U = Not Detected At That Concentration.

**SOUTHWEST CORNER
TCE CONCENTRATIONS
MAP (2010)**

2010 ANNUAL REPORT
NATIONAL PRESTO INDUSTRIES, INC.
EAU CLAIRE, WISCONSIN




021411
 djp_R34283-000_2011_0214_F08



NOTES:


1. Shaded Wells Have Been Abandoned.
2. All Results Shown Are The Most Recent Results From 2010.
3. NS = Not Sampled.
4. J = Concentration Is Between The Limit Of Detection And Limit Of Quantitation. The Value Is Estimated.
5. U = Not Detected At That Concentration.

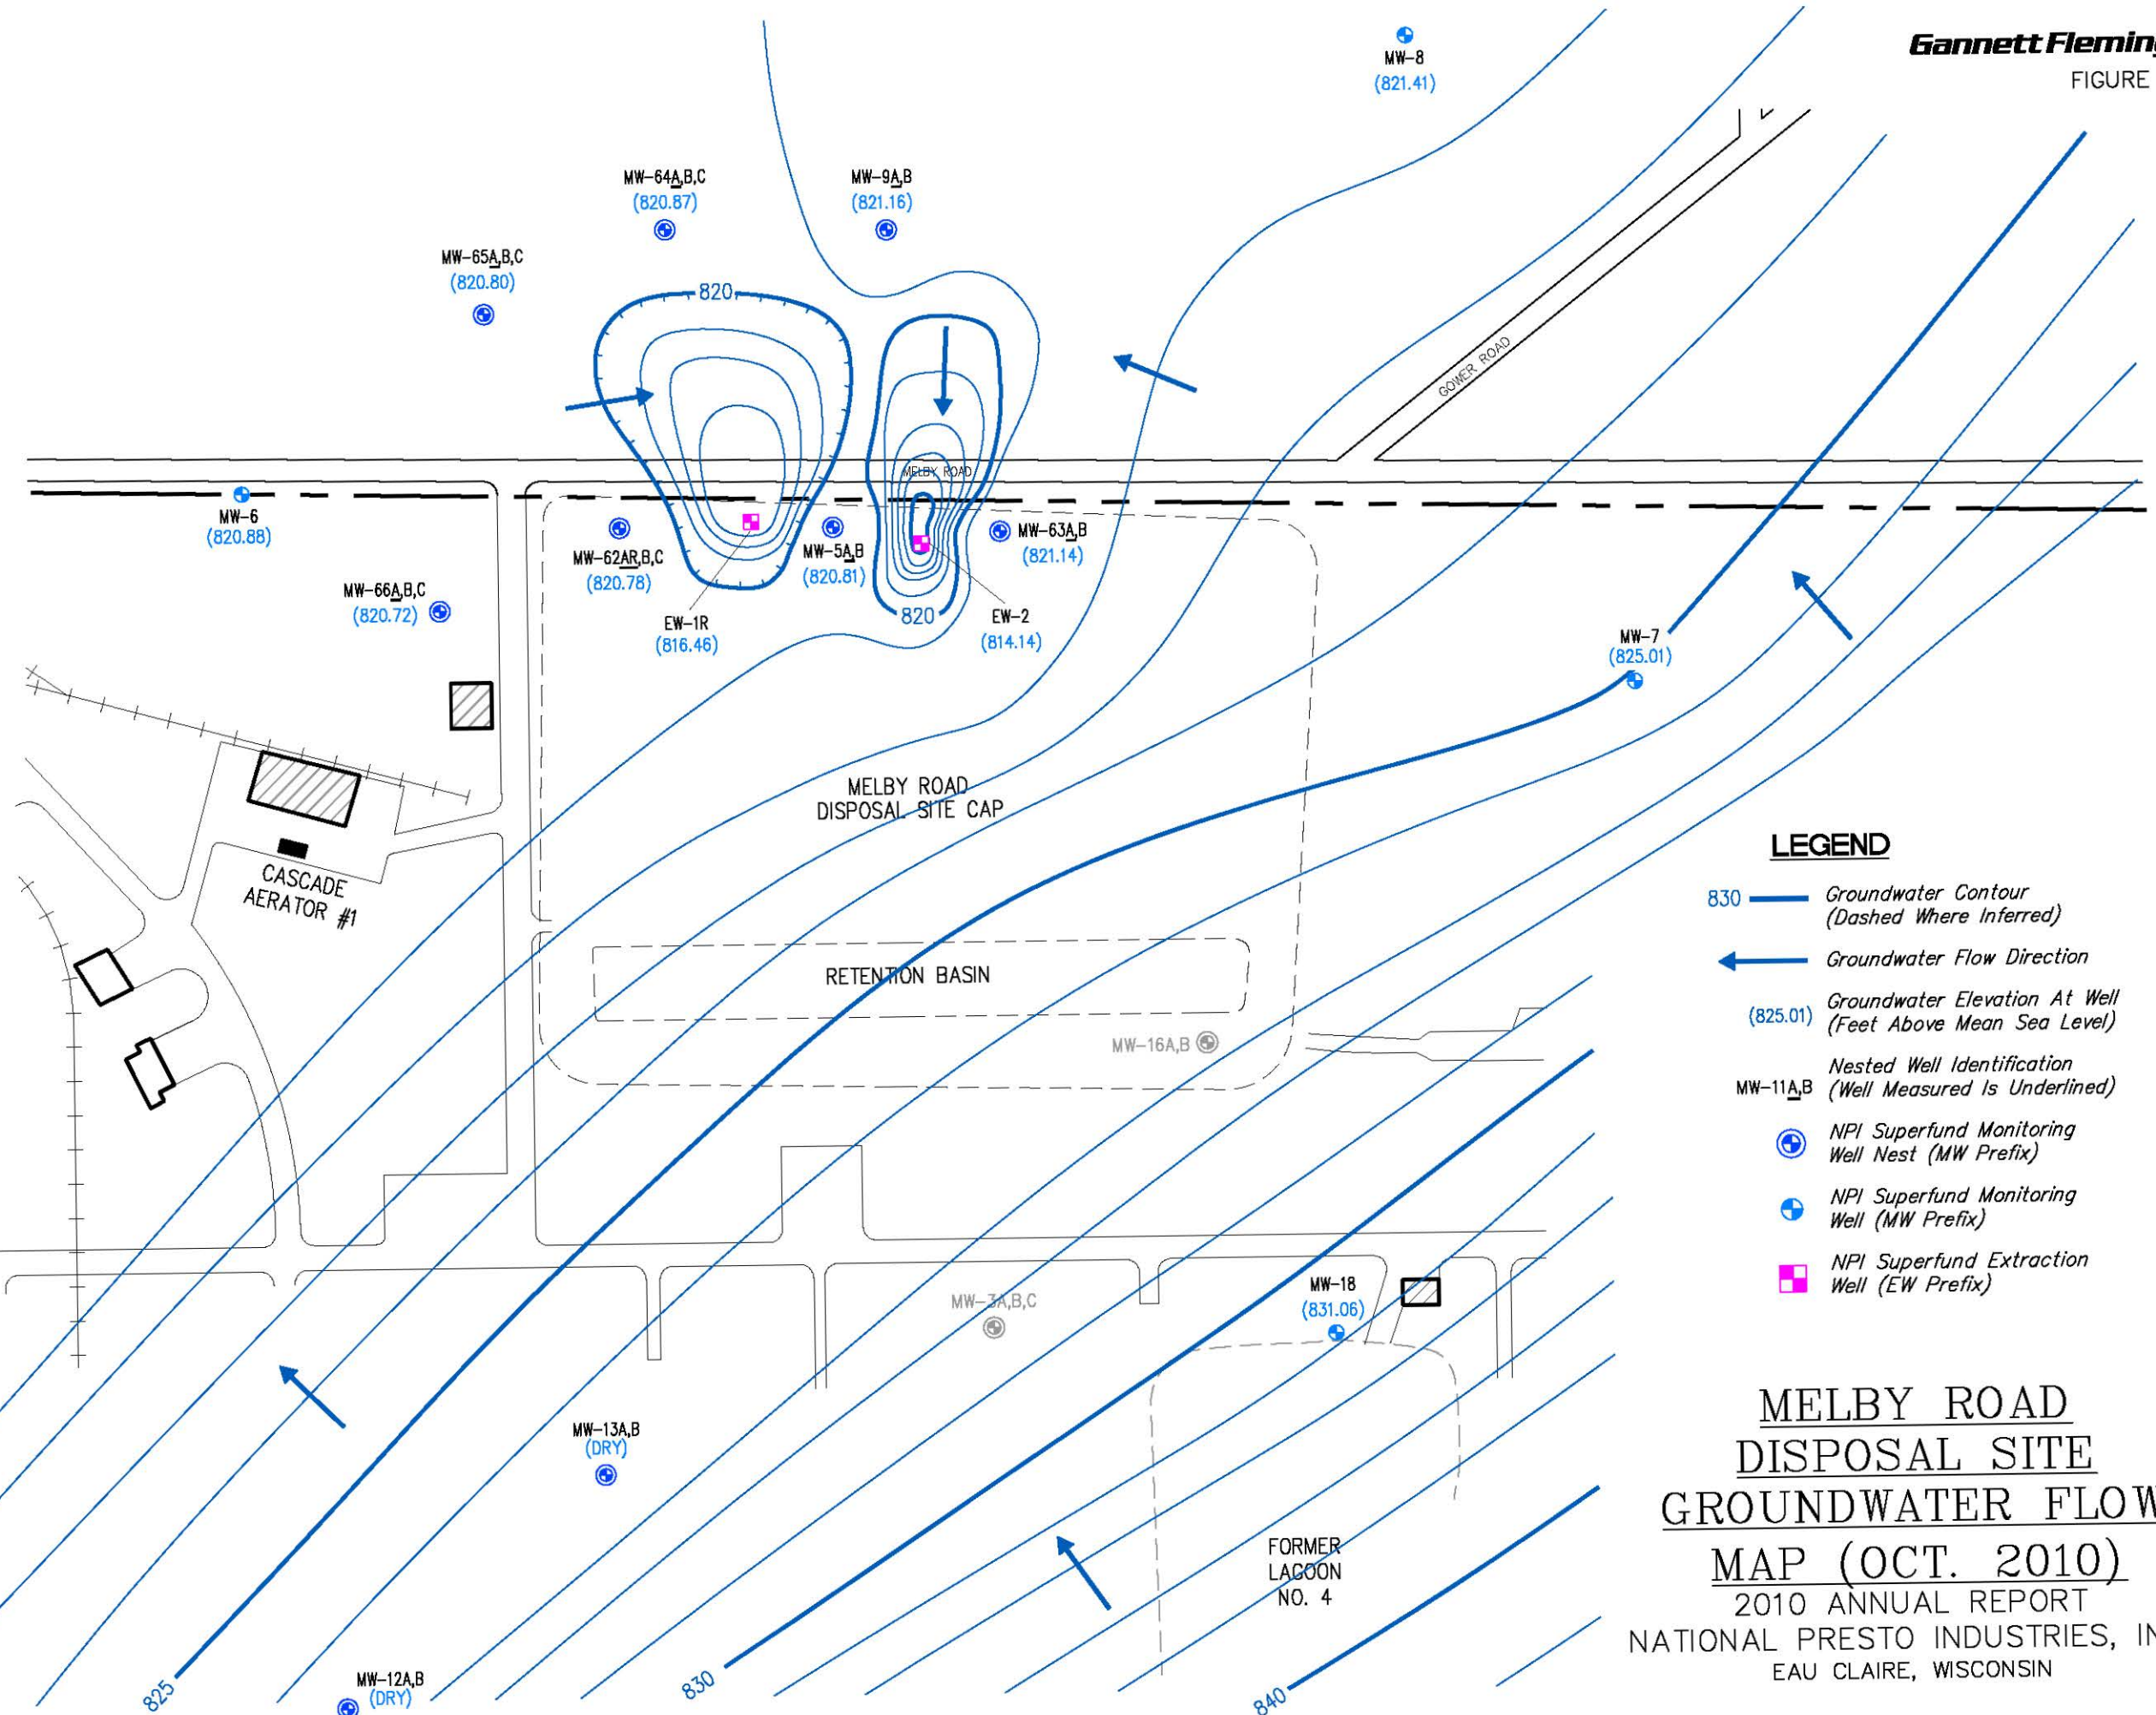


LEGEND

- 830 — Groundwater Contour (Dashed Where Inferred)
- ← Groundwater Flow Direction
- (825.01) — Groundwater Elevation At Well (Feet Above Mean Sea Level)
- MW-11A,B — Nested Well Identification (Well Measured Is Underlined)
- ⊕ — NPI Superfund Monitoring Well Nest (MW Prefix)
- ⊕ — NPI Superfund Monitoring Well (MW Prefix)
- ⊕ — NPI Superfund Extraction Well (EW Prefix)

**MELBY ROAD
 DISPOSAL SITE
 GROUNDWATER FLOW
 MAP (OCT. 2010)**
 2010 ANNUAL REPORT
 NATIONAL PRESTO INDUSTRIES, INC.
 EAU CLAIRE, WISCONSIN



L:\NPI\GIS\2010AnnualReport\2010_0211_F09.dwg, 2/14/11 11:50:07 AM
 021111
 djp_R34283-000_2011_0211_F09

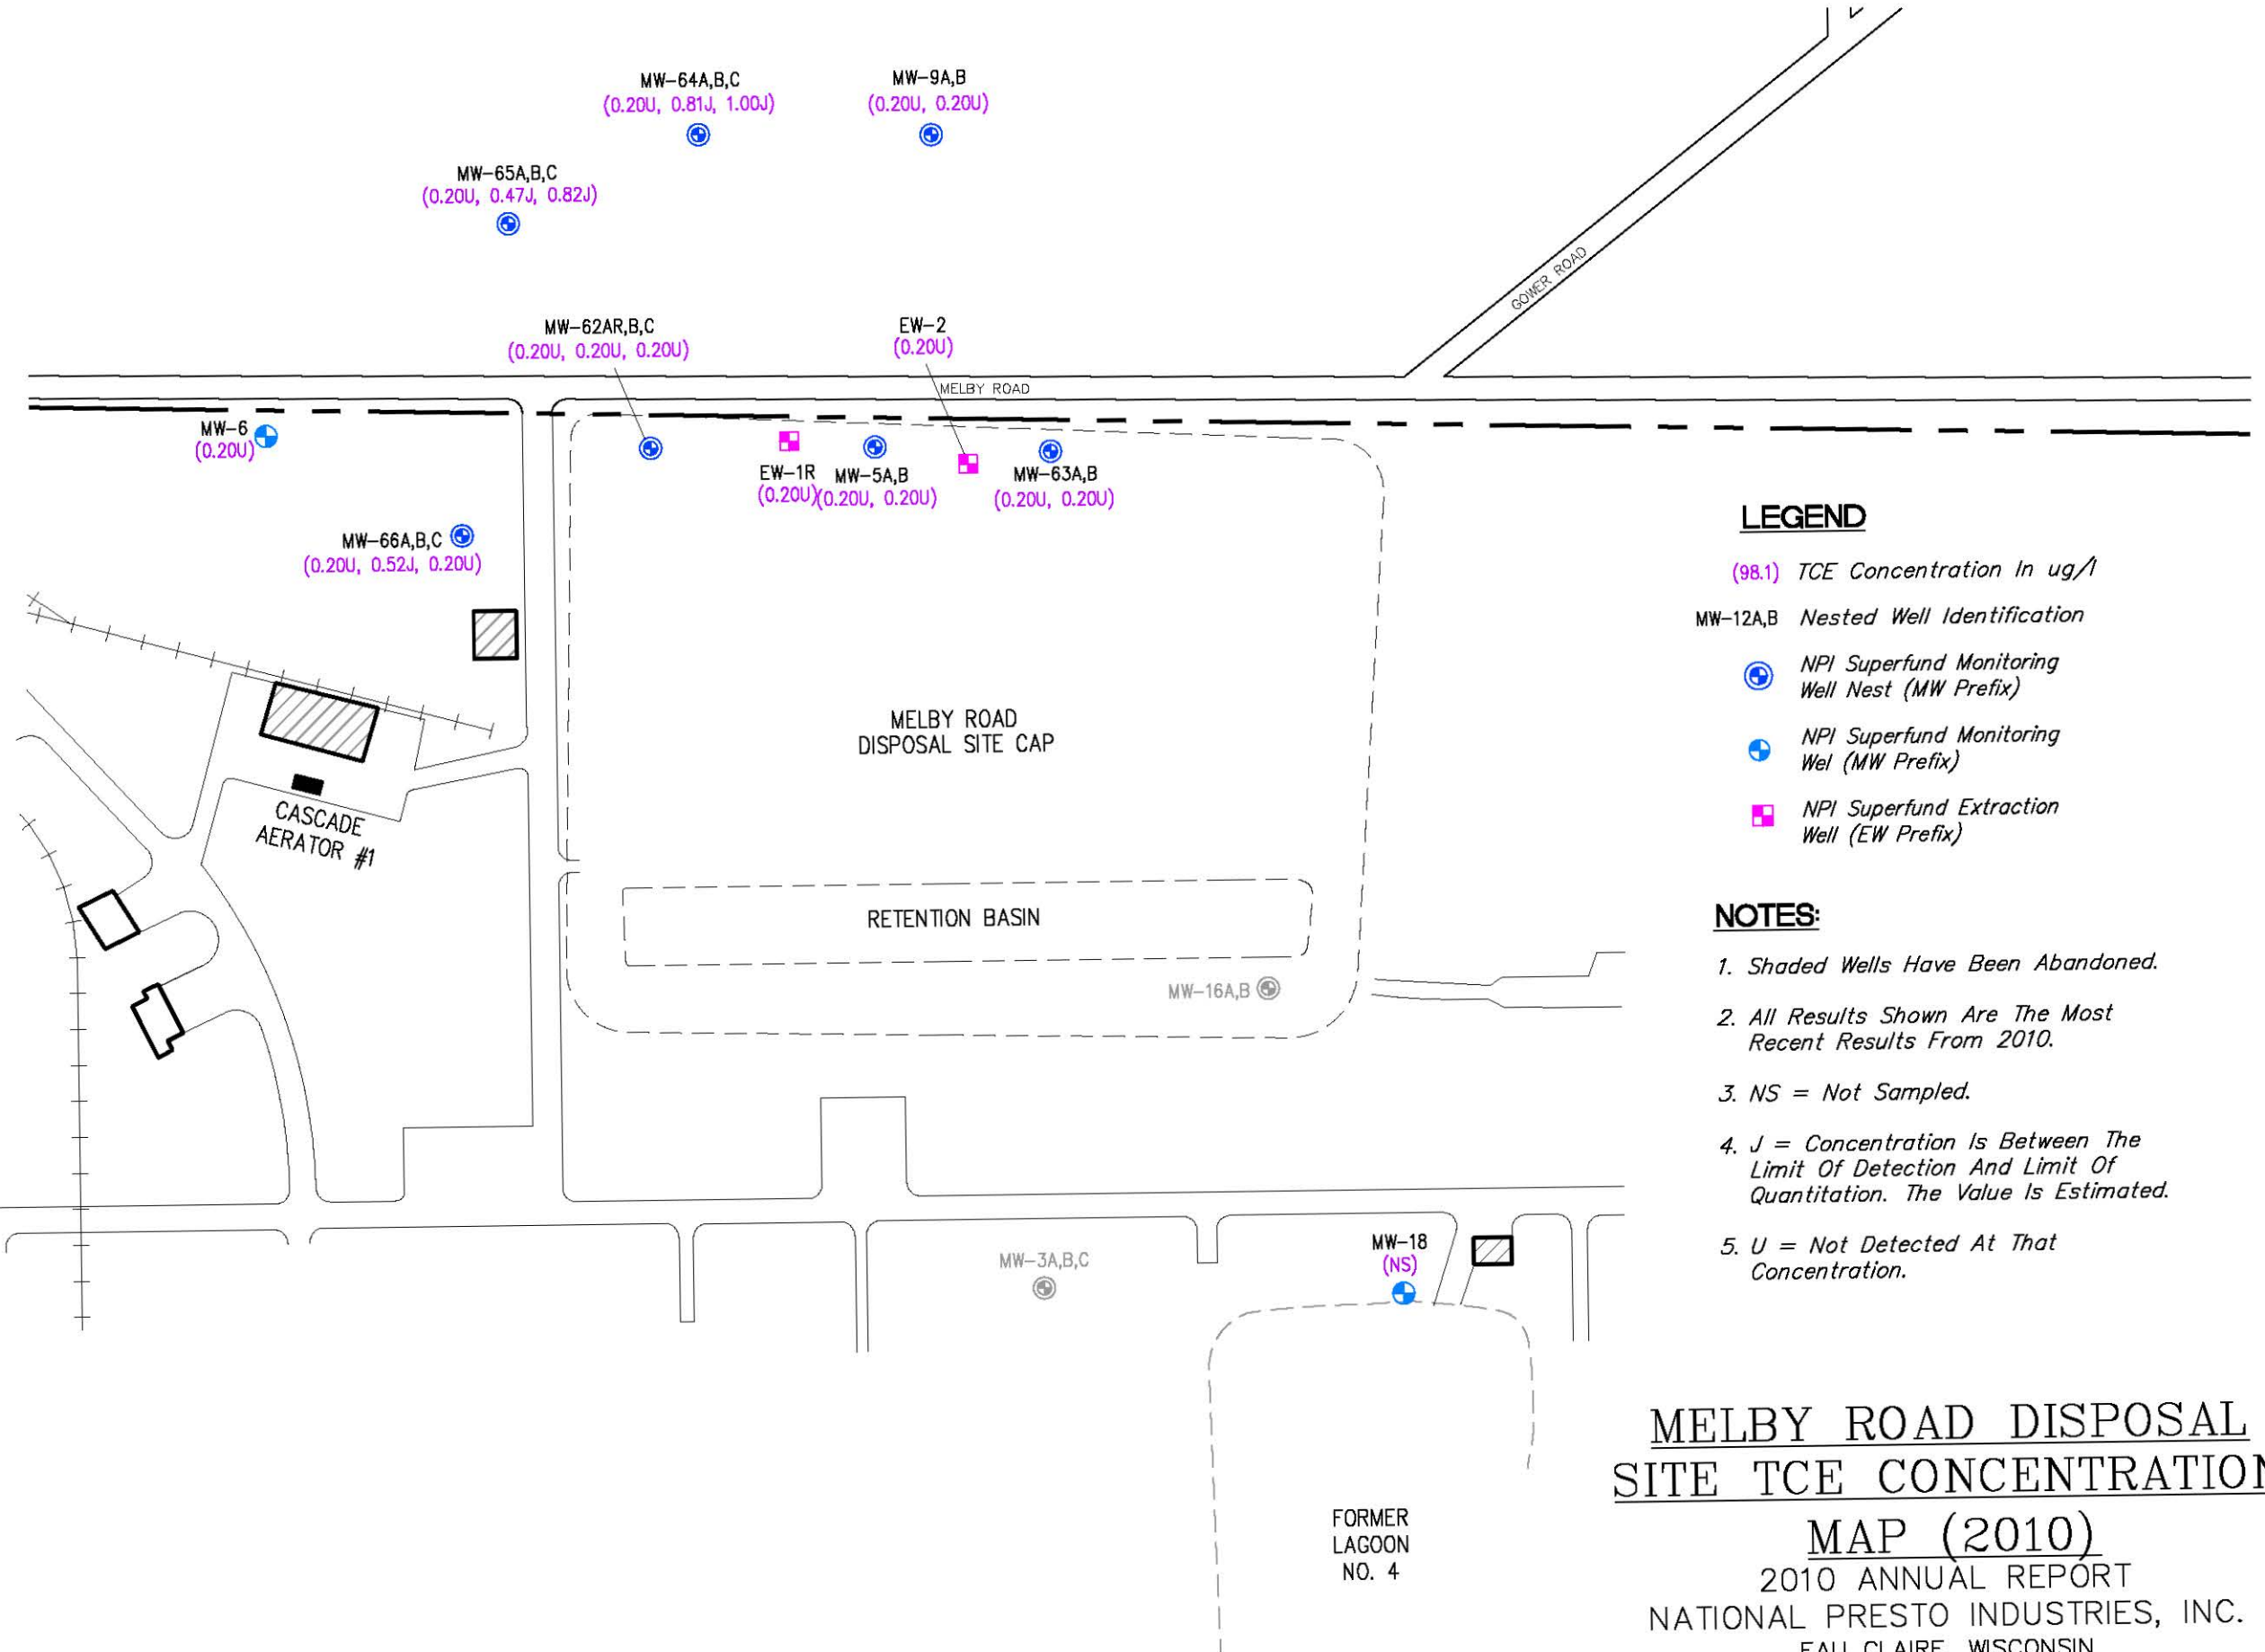

LEGEND



- (98.1) TCE Concentration In ug/l
- MW-12A,B Nested Well Identification
- ⊕ NPI Superfund Monitoring Well Nest (MW Prefix)
- ⊕ NPI Superfund Monitoring Well (MW Prefix)
- ⊕ NPI Superfund Extraction Well (EW Prefix)

NOTES:

1. Shaded Wells Have Been Abandoned.
2. All Results Shown Are The Most Recent Results From 2010.
3. NS = Not Sampled.
4. J = Concentration Is Between The Limit Of Detection And Limit Of Quantitation. The Value Is Estimated.
5. U = Not Detected At That Concentration.

MELBY ROAD DISPOSAL SITE TCE CONCENTRATION

MAP (2010)
 2010 ANNUAL REPORT
 NATIONAL PRESTO INDUSTRIES, INC.
 EAU CLAIRE, WISCONSIN

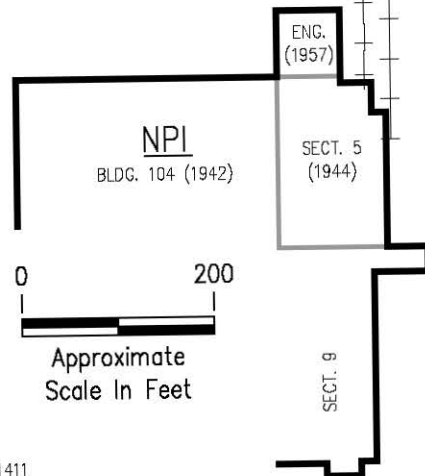

L:\NPI\FIGS\040000\040000_000_2011_0214_F10.dwg, 2/14/11 11:43:21 PM




LEGEND

- 820 — Groundwater Contour (Dashed Where Inferred)
- ← Groundwater Flow Direction
- (816.33) — Groundwater Elevation At Well (Feet Above Mean Sea Level)
- MW-17,B,C — Nested Well Identification (Well Measured Is Underlined)
- — WDNR Monitoring Well (WW Prefix)
- ⊕ — NPI Superfund Monitoring Well Nest (MW Prefix)
- ⊕ — NPI Superfund Monitoring Well (MW Prefix)

NOTES:


1. Shaded Wells Have Been Abandoned.
2. Groundwater Elevations Measured In October 2010.
3. Contours Above 830 Are Shown At 2-Foot Intervals. Contours Below 830 Are Shown At 1-Foot Intervals.

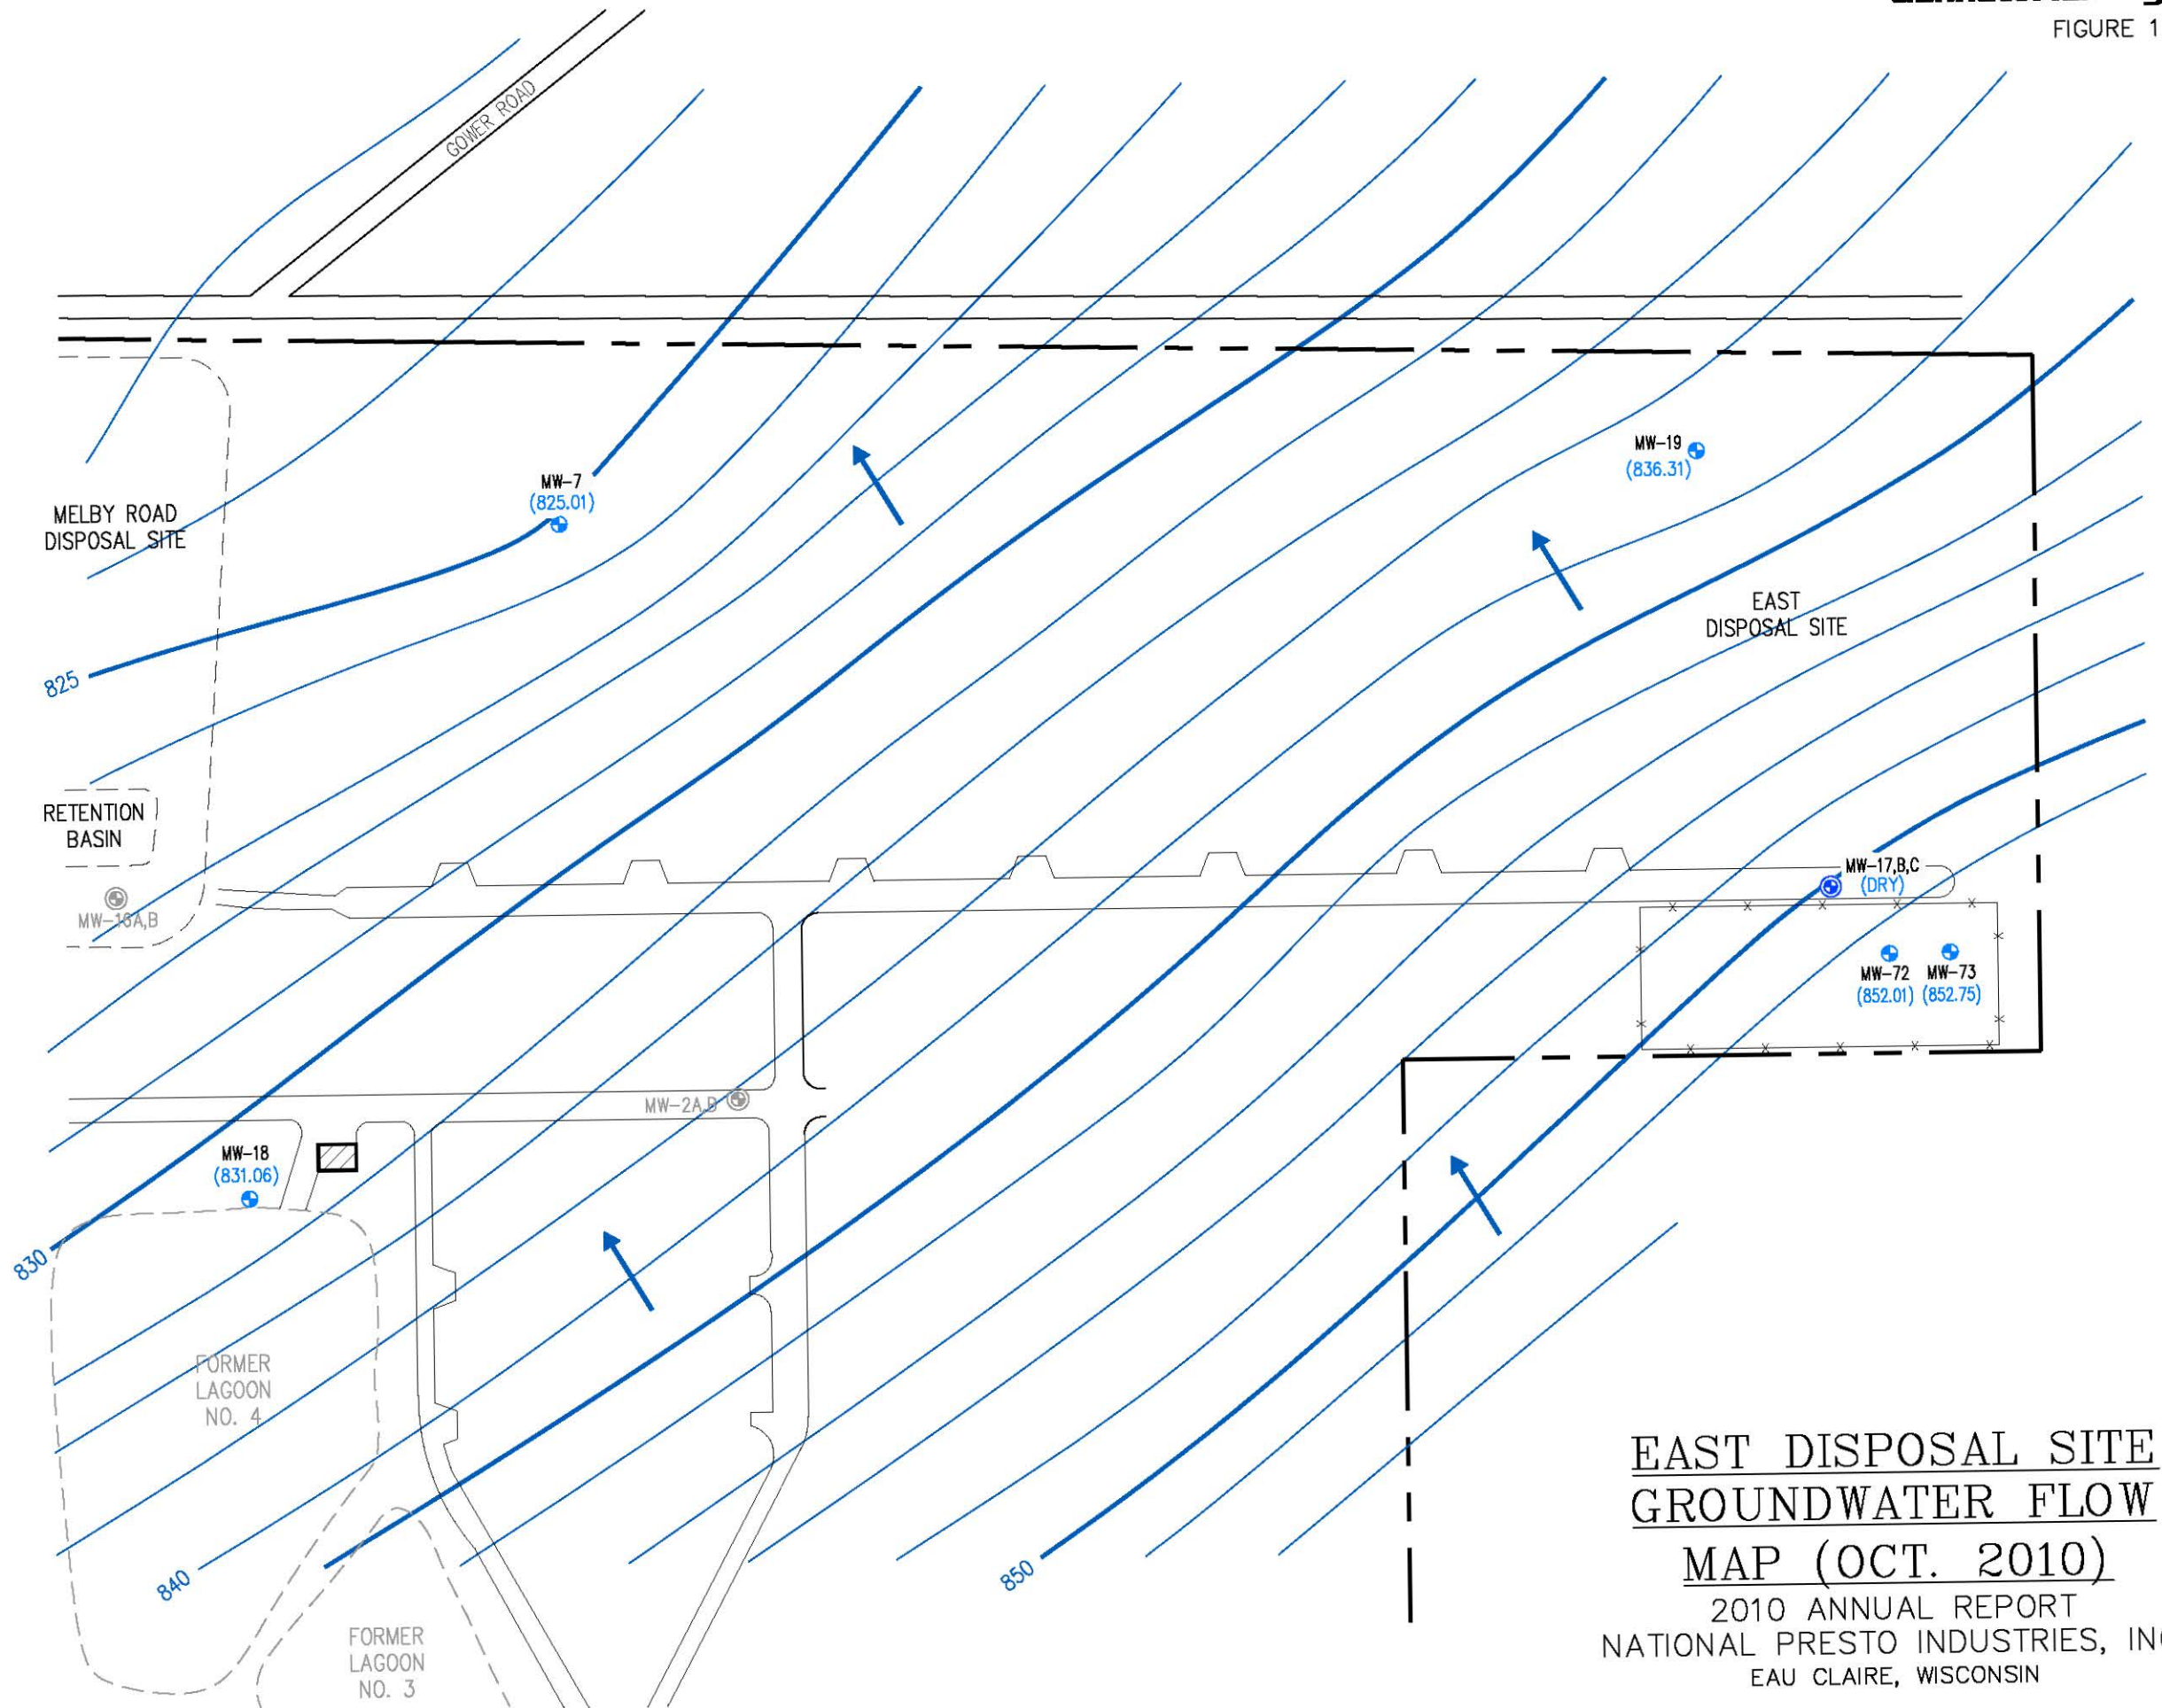

**EAST DISPOSAL SITE
GROUNDWATER FLOW**



MAP (OCT. 2010)

2010 ANNUAL REPORT
NATIONAL PRESTO INDUSTRIES, INC.
EAU CLAIRE, WISCONSIN






LEGEND

- (0.369) TCE Concentration In ug/l
- MW-17,B,C Nested Well Identification
-  NPI Superfund Monitoring Well Nest (MW Prefix)
-  NPI Superfund Monitoring Well (MW Prefix)

NOTES:

1. Shaded Wells Have Been Abandoned.
2. All Results Shown Are The Most Recent Results From 2010.
3. NS = Not Sampled.
4. U = Not Detected At That Concentration.

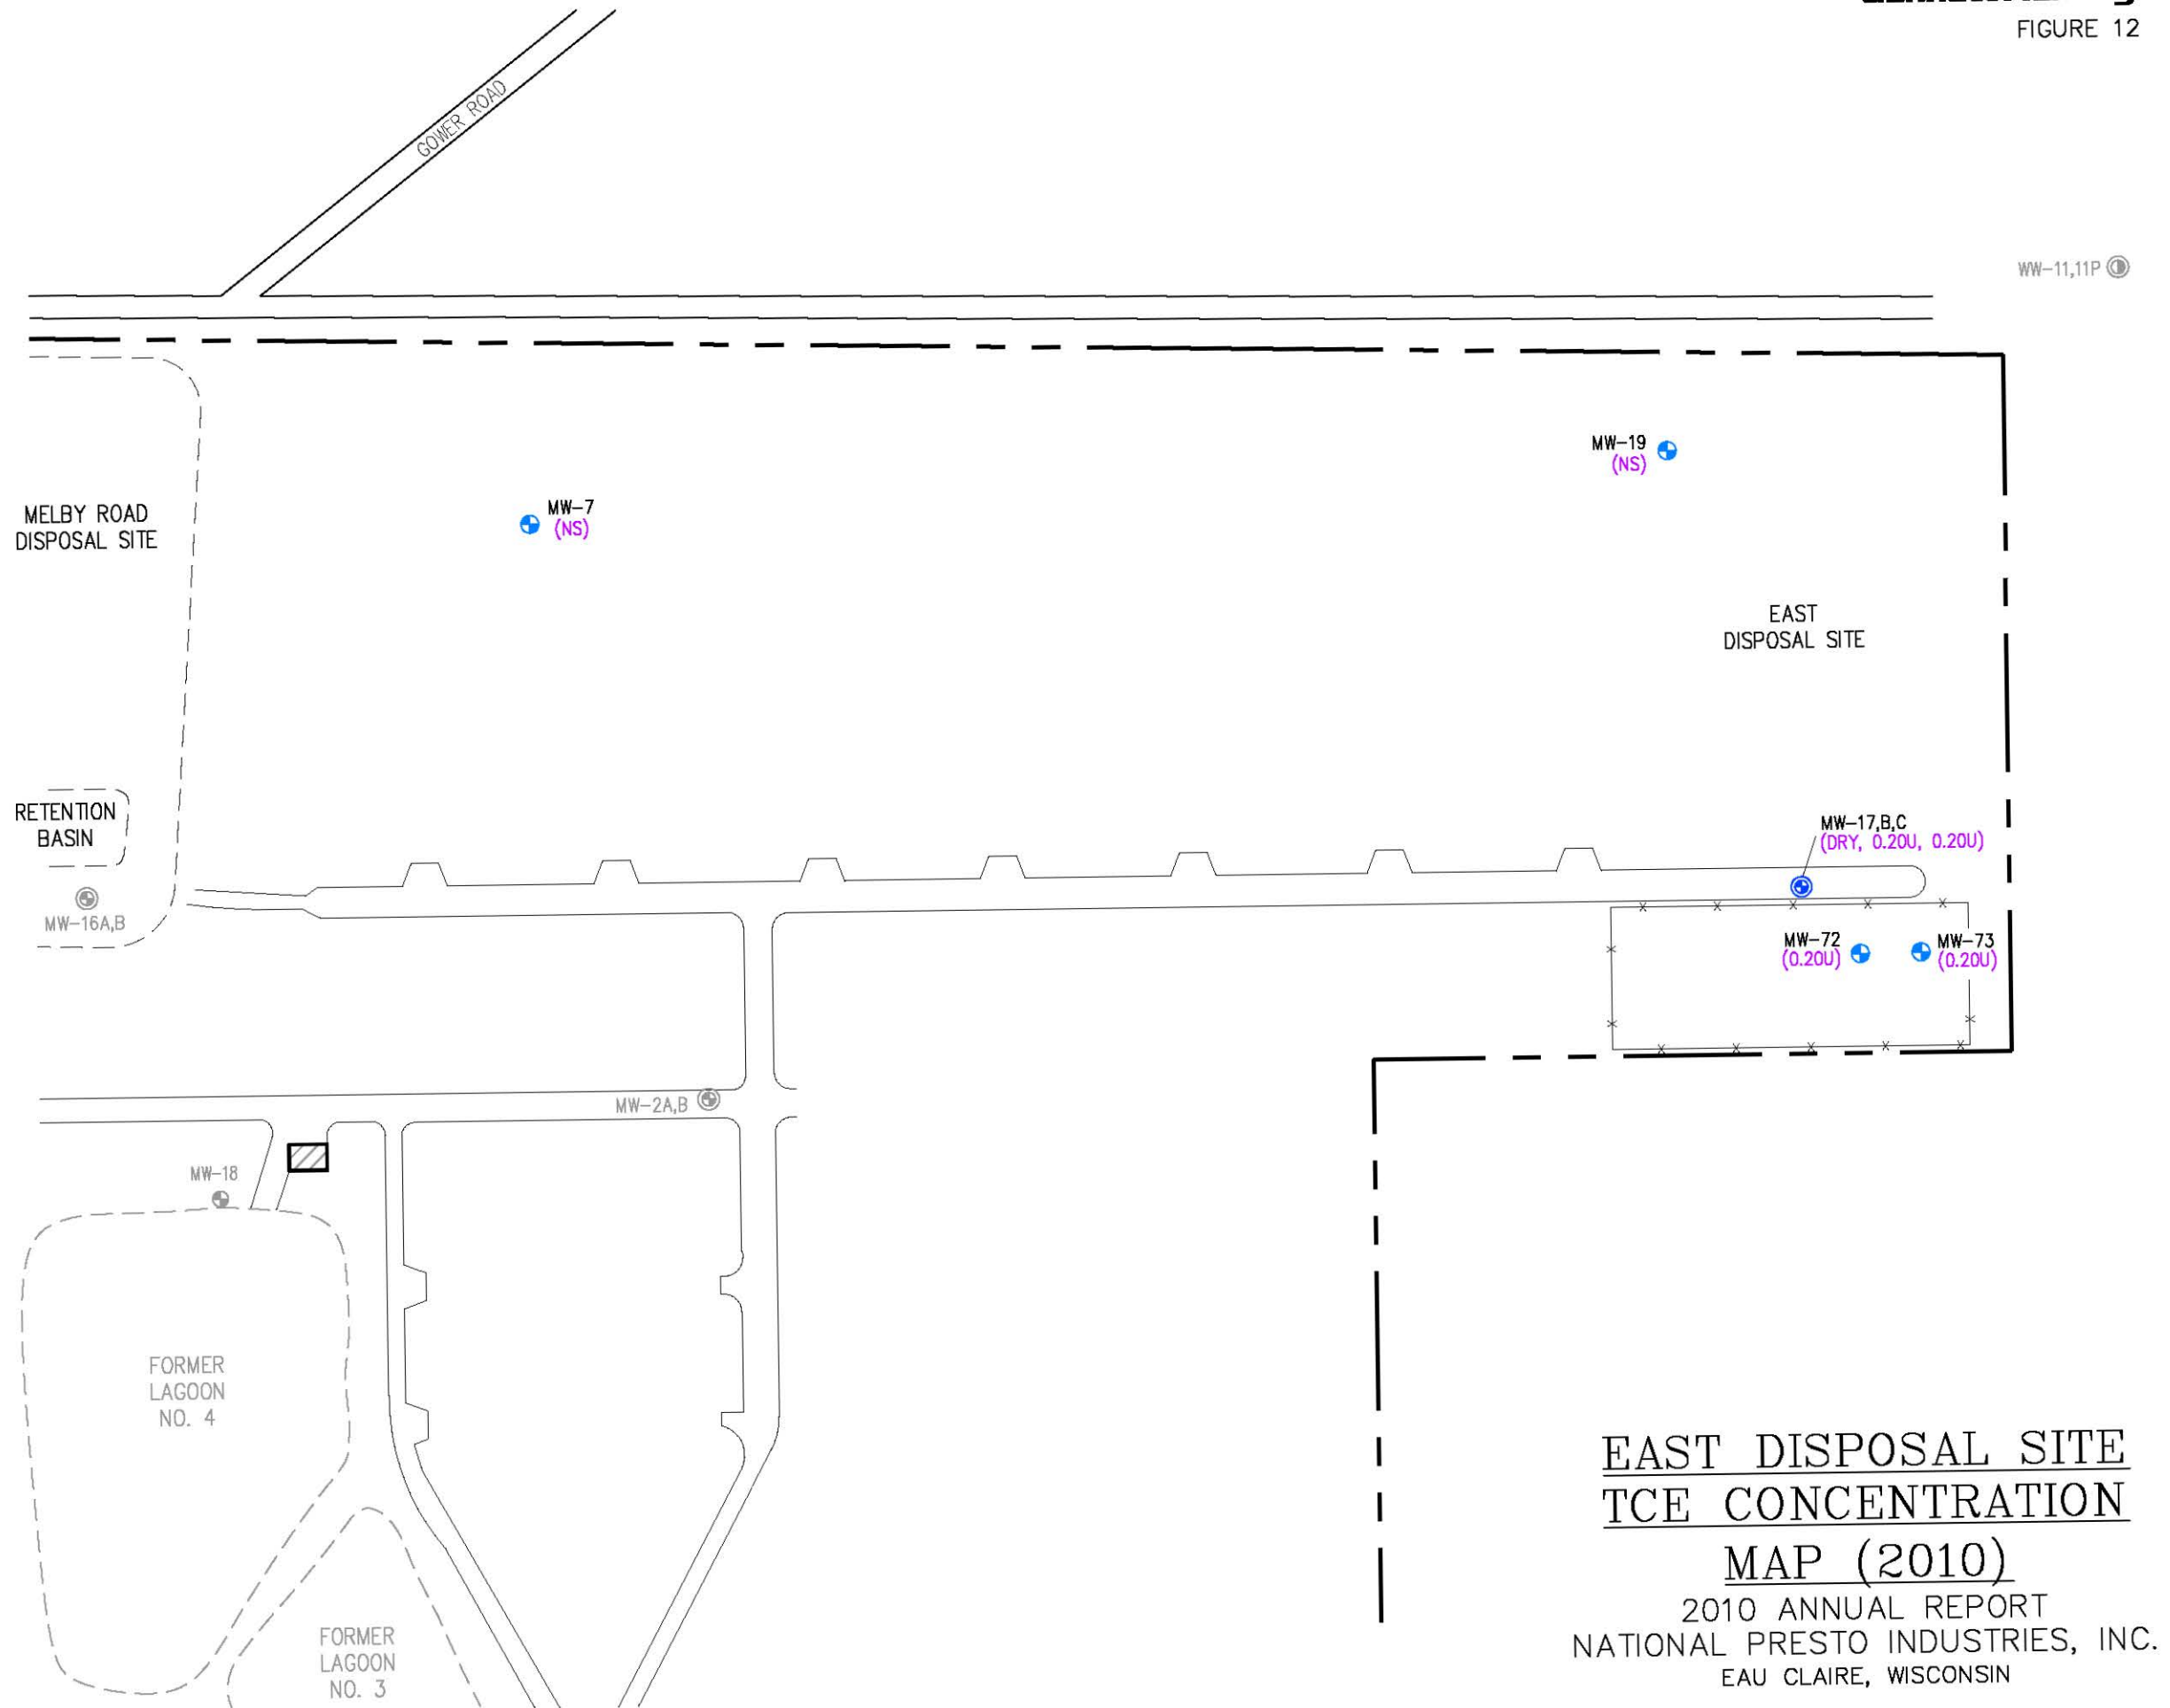

**EAST DISPOSAL SITE
TCE CONCENTRATION
MAP (2010)**
2010 ANNUAL REPORT
NATIONAL PRESTO INDUSTRIES, INC.
EAU CLAIRE, WISCONSIN

012111
djp_R34283-000_2011_0211_F12

APPENDIX A

CD CONTAINING HISTORICAL ANALYTICAL DATA,
2010 LABORATORY REPORTS, AND
MW-34/70 SOIL CONFIRMATION & SPLP DATA

SIEMENS

March 22, 2010

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

Attn: Cliff Wright

RECEIVED
GANNETT FLEMING-MADISON, WI
FILE NO: 34283 (three ring binder)
MAR 24 2010
REVIEWED BY: CW
DATE: 3/28/10
ROUTE TO: JEC, 3-ring binder

REPORT NO.: 1003313

PROJECT NO.: 34283 Natl Presto, 1st Qrt 2010


Please find enclosed the analytical report, including the Sample Summary, Sample Narrative and Chain of Custody for your sample set received March 18, 2010.

All analyses were performed in accordance with NELAC Standards using approved methods as indicated on this report.

If you have any questions about the results, please call. Thank you for using Siemens Water Technologies for your analytical needs.

Sincerely,

Siemens Water Technologies

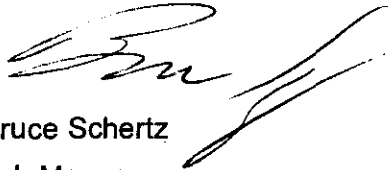

Bruce Schertz

Lab Manager

Enviroscan Analytical™ Services

I certify that the data contained in this report has been generated and reviewed in accordance with the Siemens Water Technologies Quality Assurance Program. Exceptions, if any, are discussed in the sample narrative. Samples will be retained for 30 days from the date of this report, then disposed in an appropriate manner. Siemens Water Technologies Corp. reserves the right to return samples identified as hazardous. Release of this Final Report is authorized as verified by the following signature. The contents of this report apply to the sample(s) analyzed. No duplication of this report is allowed except in its entirety.

Reviewed by: Cliff Wright

Certifications:

Wisconsin 737053130
Minnesota 055-999-302
Illinois 100317



Siemens Water Technologies Corp.

301 West Military Road
Rothschild, WI 54474

Tel: 800-338-7226
Fax: 715-355-3221

www.siemens.com/enviroscan

SIEMENS

SAMPLE SUMMARY

<u>Lab Id</u>	<u>Client</u>	<u>Sample Id</u>	<u>Date/Time</u>	<u>Matrix</u>
1003313-01	MH #18		03/15/10 11:05	Ground Water
1003313-02	CAS-1		03/15/10 13:45	Ground Water
1003313-03	CAS-2		03/15/10 12:00	Ground Water
1003313-04	EW-1		03/15/10 12:01	Ground Water
1003313-05	EW-2		03/15/10 12:10	Ground Water
1003313-06	EW-4		03/15/10 11:50	Ground Water
1003313-07	EW-5		03/15/10 11:35	Ground Water

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283 Natl Presto, 1st Qrt 2010
REPORT NO. : 1003313
DATE REC'D: 03/18/10 15:25
REPORT DATE : 03/22/10 12:10
PREPARED BY : BMS

Attn: Cliff Wright
Sample ID: MH #18

Matrix: Ground Water Sample Date/Time: 03/15/10 11:05 Lab No. : 1003313-01

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	0.51	ug/L	0.50	1.70	1	J	03/19/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/19/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Trichloroethene	0.45	ug/L	0.40	1.30	1	J	03/19/10	MPM

Sample ID: CAS-1

Matrix: Ground Water Sample Date/Time: 03/15/10 13:45 Lab No. : 1003313-02

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		03/19/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/19/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		03/19/10	MPM

Sample ID: CAS-2

Matrix: Ground Water Sample Date/Time: 03/15/10 12:00 Lab No. : 1003313-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	0.96	ug/L	0.50	1.70	1	J	03/19/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/19/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Trichloroethene	0.82	ug/L	0.40	1.30	1	J	03/19/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283 Natl Presto, 1st Qrt 2010
REPORT NO. : 1003313
DATE REC'D: 03/18/10 15:25
REPORT DATE : 03/22/10 12:10
PREPARED BY : BMS

Attn: Cliff Wright
Sample ID: EW-1

Matrix: Ground Water

Sample Date/Time: 03/15/10 12:01

Lab No. : 1003313-04

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		03/19/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/19/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		03/19/10	MPM

Sample ID: EW-2

Matrix: Ground Water

Sample Date/Time: 03/15/10 12:10

Lab No. : 1003313-05

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		03/19/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/19/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		03/19/10	MPM

Sample ID: EW-4

Matrix: Ground Water

Sample Date/Time: 03/15/10 11:50

Lab No. : 1003313-06

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	4.65	ug/L	0.50	1.70	1		03/19/10	MPM
1,1-Dichloroethane	1.06	ug/L	0.40	1.30	1	J	03/19/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Trichloroethene	0.98	ug/L	0.40	1.30	1	J	03/19/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283 Natl Presto, 1st Qrt 2010
REPORT NO. : 1003313
DATE REC'D: 03/18/10 15:25
REPORT DATE : 03/22/10 12:10
PREPARED BY : BMS

Attn: Cliff Wright
Sample ID: EW-5

Matrix: Ground Water

Sample Date/Time: 03/15/10 11:35

Lab No. : 1003313-07

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		03/19/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/19/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Trichloroethene	1.13	ug/L	0.40	1.30	1	J	03/19/10	MPM

SIEMENS

Qualifier Descriptions

J Estimated concentration below laboratory quantitation level.

Definitions

LOD = Limit of Detection (Dilution Corrected)
LOQ = Limit of Quantitation (Dilution Corrected)
Reporting Limit = LOQ (Dilution Corrected)
ND = Not Detected
COMP = Complete
SUBCON = Subcontracted analysis
mv = millivolts
pci/L = picocuries per Liter
mL/L = milliliters per Liter
mg = milligram

When the word "dry" follows the units on the result page the sample results are dry weight corrected.

LODs and LOQs are dry weight corrected for all soils except WI GRO and EPA 8021 methanol and WI DNR methylene chloride preserved soils.

ug/l = Micrograms per Liter = parts per billion (ppb)
ug/kg = Micrograms per kilogram = parts per billion (ppb)
mg/l = Milligrams per liter = parts per million (ppm)
mg/kg = Milligrams per kilogram = parts per million (ppm)
NOT PRES = Not Present
ppth = Parts per thousand
* = Result outside established limits.
mg/m³ = Milligrams per meter cubed
ng/L = Nanograms per Liter = Parts per trillion (ppt)
> = Greater Than

Methanol Soils for WI GRO and EPA 8021 are reported to the LOQ.

LABORATORY'S QUALITY VERIFICATION STATEMENT

Laboratory must provide a signed copy of this form with each deliverable specified in the Work Order or the deliverable will not be accepted. Laboratory must provide Gannett Fleming with a true copy of its internal QA/QC review and approval forms related to the deliverable.

This form must be signed by the Laboratory's Quality Control/Quality Assurance Officer

Project Name: National Presto Inds.

Gannett Fleming Project Number: 34283

Deliverable Description: Analytical Report

I, Cindy Varga, warrant and represent that the project deliverable described above and attached to this form was developed in accordance with the project scope of work and that all elements relating to the quality of the deliverable were verified in accordance with the requirements of my firm's internal quality management/quality assurance system. This deliverable satisfies all requirements of our Contract with Gannett Fleming.

Signature: Cindy K Varga
(by Laboratory's QC/QA Officer)

Date: 3/23/10

Laboratory: Siemens Water Technologies

'Deliverable' shall mean all aspects of design including, without limitation, drawings, calculations, maps, materials and specifications, reports, data bases, logs and other information developed from wells, borings and cores, laboratory data, materials schedules, instrument calibration data and all other items developed, prepared and delivered to Gannett Fleming by Contractor as specified in the Scope of Work in any media.

bw 10.2.09

Company Name NATIONAL PESTO INDS.		Project 34283	
Report Mailing Address CLIFF WRIGHT - Greenleaf - Fleming 8025 EXCELSIOR DR. MADISON, WI 53717 <i>Dave G.</i>		Contact Name, Phone, Fax, Email 1-608-836-1500	
Invoice Address DERRICK PAUL 3925 No HASTINGS Way EAU CLAIRE, WI 54703		Purchase Order # N-1064	Invoice Contact and Phone No. 1-715-839-2141

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: _____
(If Yes, please specify Agency or Regulation) Agency/Reg.: _____

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. **1003313**

Analyses Requested										Lab Use Only		
VOCS										Delivered by:	Walk-in	Courier
										Ship. Cont. OK?	<input checked="" type="checkbox"/> Y	N NA
										Samples Leaking?	<input type="checkbox"/> Y	<input checked="" type="checkbox"/> N NA
										Seals OK?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N NA
										Rec'd on Ice?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N NA
										Sample Receiving Comments: 3.8		

Lab Use Only	Sample		No. of Containers		Sample ID							Comments
	Date	Time	Comp	Grab								
-1	3-15-10	1105		3	M.W. #10	3						3 vials HCL
-2		1345		3	CAS-1	3						↓
-3		1200		3	CAS-2	3						1 vial HCL (2 vials rec'd broken)
-4		1201		3	EW-1	3						3 vials HCL
-5		1210		3	EW-2	3						↓
-6		1150		3	EW-4	3						↓
-7		1135		3	EW-5	3						↓
					Waterbury - 540							
					R.H.							

Chain of Custody Record

Relinquished By:	Date	Time	Received By:
<i>Marcus Kobliska</i>	3-12-10	0900	
	3-18-10	1525	<i>Steve Haden</i>

SIEMENS

March 26, 2010

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

Attn: Dave Olig

RECEIVED	
GANNETT FLEMING-MADISON, WI	
FILE NO:	34283.000 3 King Bunder
MAR 29 2010	
REVIEWED BY:	DJO
DATE:	3/29/10
ROUTE TO:	Jec

REPORT NO.: 1003314

PROJECT NO.: 34283.000 DW March 2010


Please find enclosed the analytical report, including the Sample Summary, Sample Narrative and Chain of Custody for your sample set received March 18, 2010.

All analyses were performed in accordance with NELAC Standards using approved methods as indicated on this report.

If you have any questions about the results, please call. Thank you for using Siemens Water Technologies for your analytical needs.

Sincerely,


Siemens Water Technologies

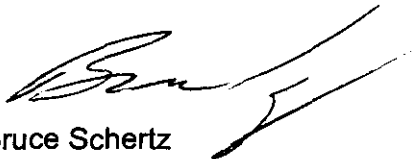

Bruce Schertz
Lab Manager
Enviroscan Analytical™ Services

I certify that the data contained in this report has been generated and reviewed in accordance with the Siemens Water Technologies Quality Assurance Program. Exceptions, if any, are discussed in the sample narrative. Samples will be retained for 30 days from the date of this report, then disposed in an appropriate manner. Siemens Water Technologies Corp. reserves the right to return samples identified as hazardous. Release of this Final Report is authorized as verified by the following signature. The contents of this report apply to the sample(s) analyzed. No duplication of this report is allowed except in its entirety.

Reviewed by:



Certifications:

Wisconsin 737053130
Minnesota 055-999-302
Illinois 100317



Siemens Water Technologies Corp.

301 West Military Road
Rothschild, WI 54474

Tel: 800-338-7226
Fax: 715-355-3221

www.siemens.com/enviroscan

SAMPLE SUMMARY

<u>Lab Id</u>	<u>Client</u> <u>Sample Id</u>	<u>Date/Time</u>	<u>Matrix</u>
1003314-01	CW-11	03/16/10 09:10	Drinking Water
1003314-02	CW-15	03/16/10 09:20	Drinking Water
1003314-03	CW-16	03/16/10 09:30	Drinking Water
1003314-04	CW-17	03/16/10 09:40	Drinking Water
1003314-05	CW-19	03/16/10 09:50	Drinking Water
1003314-06	Towers A	03/16/10 10:00	Drinking Water
1003314-07	Towers B	03/16/10 10:10	Drinking Water
1003314-08	Raw	03/16/10 10:20	Drinking Water
1003314-09	Finish Product	03/16/10 10:30	Drinking Water

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW March 2010
REPORT NO. : 1003314
DATE REC'D 03/18/10 15:40
REPORT DATE : 03/26/10 13:44
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-11

Matrix: Drinking Water

Sample Date/Time: 03/16/10 9:10

Lab No. : 1003314-01

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		03/25/10	MPM
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		03/25/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		03/25/10	MPM
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		03/25/10	MPM
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		03/25/10	MPM
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		03/25/10	MPM
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Benzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Bromobenzene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Bromodichloromethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Bromoform	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Bromomethane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Chlorobenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Chloroethane	ND	ug/L	0.70	2.30	1		03/25/10	MPM
Chloroform	0.61	ug/L	0.20	0.67	1	J	03/25/10	MPM
Chloromethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Dibromochloromethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Dibromomethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Ethylbenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Styrene	ND	ug/L	0.10	0.50	1		03/25/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/25/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW March 2010
REPORT NO. : 1003314
DATE REC'D : 03/18/10 15:40
REPORT DATE : 03/26/10 13:44
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-11

Matrix: Drinking Water

Sample Date/Time: 03/16/10 9:10

Lab No. : 1003314-01

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		03/25/10	MPM
Trichloroethene	0.96	ug/L	0.40	1.30	1	J	03/25/10	MPM
Vinyl chloride	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		03/25/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW March 2010
REPORT NO. : 1003314
DATE REC'D 03/18/10 15:40
REPORT DATE : 03/26/10 13:44
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-15

Matrix: Drinking Water

Sample Date/Time: 03/16/10 9:20

Lab No. : 1003314-02

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	t		03/25/10	MPM
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		03/25/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		03/25/10	MPM
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		03/25/10	MPM
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		03/25/10	MPM
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		03/25/10	MPM
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Benzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Bromobenzene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Bromodichloromethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Bromoform	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Bromomethane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Chlorobenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Chloroethane	ND	ug/L	0.70	2.30	1		03/25/10	MPM
Chloroform	0.68	ug/L	0.20	0.67	1		03/25/10	MPM
Chloromethane	ND	ug/L	0.40	1.30	t		03/25/10	MPM
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Dibromochloromethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Dibromomethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Ethylbenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Styrene	ND	ug/L	0.10	0.50	1		03/25/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/25/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW March 2010
REPORT NO. : 1003314
DATE REC'D : 03/18/10 15:40
REPORT DATE : 03/26/10 13:44
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-15

Matrix: Drinking Water

Sample Date/Time: 03/16/10 9:20

Lab No. : 1003314-02

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		03/25/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Vinyl chloride	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		03/25/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW March 2010
REPORT NO. : 1003314
DATE REC'D : 03/18/10 15:40
REPORT DATE : 03/26/10 13:44
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-16

Matrix: Drinking Water

Sample Date/Time: 03/16/10 9:30

Lab No. : 1003314-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		03/25/10	MPM
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		03/25/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		03/25/10	MPM
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		03/25/10	MPM
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		03/25/10	MPM
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		03/25/10	MPM
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Benzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Bromobenzene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Bromodichloromethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Bromoform	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Bromomethane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Chlorobenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Chloroethane	ND	ug/L	0.70	2.30	1		03/25/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Chloromethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Dibromochloromethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Dibromomethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Ethylbenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Styrene	ND	ug/L	0.10	0.50	1		03/25/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/25/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW March 2010
REPORT NO. : 1003314
DATE REC'D : 03/18/10 15:40
REPORT DATE : 03/26/10 13:44
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-16

Matrix: Drinking Water

Sample Date/Time: 03/16/10 9:30

Lab No. : 1003314-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		03/25/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Vinyl chloride	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		03/25/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW March 2010
REPORT NO. : 1003314
DATE REC'D 03/18/10 15:40
REPORT DATE : 03/26/10 13:44
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-17 Matrix: Drinking Water Sample Date/Time: 03/16/10 9:40 Lab No. : 1003314-04

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		03/25/10	MPM
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		03/25/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		03/25/10	MPM
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		03/25/10	MPM
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		03/25/10	MPM
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		03/25/10	MPM
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Benzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Bromobenzene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Bromodichloromethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Bromoform	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Bromomethane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Chlorobenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Chloroethane	ND	ug/L	0.70	2.30	1		03/25/10	MPM
Chloroform	0.53	ug/L	0.20	0.67	1	J	03/25/10	MPM
Chloromethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Dibromochloromethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Dibromomethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Ethylbenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Styrene	ND	ug/L	0.10	0.50	1		03/25/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/25/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW March 2010
REPORT NO. : 1003314
DATE REC'D : 03/18/10 15:40
REPORT DATE : 03/26/10 13:44
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-17

Matrix: Drinking Water

Sample Date/Time: 03/16/10 9:40

Lab No. : 1003314-04

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		03/25/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Vinyl chloride	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		03/25/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW March 2010
REPORT NO. : 1003314
DATE REC'D 03/18/10 15:40
REPORT DATE : 03/26/10 13:44
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-19 Matrix: Drinking Water Sample Date/Time: 03/16/10 9:50 Lab No. : 1003314-05

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		03/25/10	MPM
1, t, t-Trichloroethane	0.50	ug/L	0.50	1.70	1	J	03/25/10	MPM
t,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		03/25/10	MPM
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		03/25/10	MPM
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		03/25/10	MPM
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		03/25/10	MPM
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Benzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Bromobenzene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Bromodichloromethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Bromoform	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Bromomethane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Chlorobenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Chloroethane	ND	ug/L	0.70	2.30	1		03/25/10	MPM
Chloroform	0.82	ug/L	0.20	0.67	1		03/25/10	MPM
Chloromethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
cis- t,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Dibromochloromethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Dibromomethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Ethylbenzene	ND	ug/L	0.20	0.67	t		03/25/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Styrene	ND	ug/L	0.10	0.50	1		03/25/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/25/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW March 2010
REPORT NO. : 1003314
DATE REC'D 03/18/10 15:40
REPORT DATE : 03/26/10 13:44
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-19

Matrix: Drinking Water

Sample Date/Time: 03/16/10 9:50

Lab No. : 1003314-05

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		03/25/10	MPM
Trichloroethene	2.09	ug/L	0.40	1.30	1		03/25/10	MPM
Vinyl chloride	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		03/25/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW March 2010
REPORT NO. : 1003314
DATE REC'D : 03/18/10 15:40
REPORT DATE : 03/26/10 13:44
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Towers A Matrix: Drinking Water Sample Date/Time: 03/16/10 10:00 Lab No. : 1003314-06

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		03/25/10	MPM
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		03/25/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		03/25/10	MPM
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		03/25/10	MPM
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		03/25/10	MPM
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		03/25/10	MPM
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Benzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Bromobenzene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Bromodichloromethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Bromoform	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Bromomethane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Chlorobenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Chloroethane	ND	ug/L	0.70	2.30	1		03/25/10	MPM
Chloroform	0.38	ug/L	0.20	0.67	1	J	03/25/10	MPM
Chloromethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Dibromochloromethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Dibromomethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Ethylbenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Styrene	ND	ug/L	0.10	0.50	1		03/25/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/25/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW March 2010
REPORT NO. : 1003314
DATE REC'D : 03/18/10 15:40
REPORT DATE : 03/26/10 13:44
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Towers A

Matrix: Drinking Water

Sample Date/Time: 03/16/10 10:00

Lab No. : 1003314-06

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		03/25/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Vinyl chloride	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		03/25/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW March 2010
REPORT NO. : 1003314
DATE REC'D 03/18/10 15:40
REPORT DATE : 03/26/10 13:44
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Towers B

Matrix: Drinking Water

Sample Date/Time: 03/18/10 10:10

Lab No. : 1003314-07

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		03/25/10	MPM
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		03/25/10	MPM
1,1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		03/25/10	MPM
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		03/25/10	MPM
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		03/25/10	MPM
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		03/25/10	MPM
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Benzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Bromobenzene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Bromodichloromethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Bromoform	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Bromomethane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Chlorobenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Chloroethane	ND	ug/L	0.70	2.30	1		03/25/10	MPM
Chloroform	0.26	ug/L	0.20	0.67	1	J	03/25/10	MPM
Chloromethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Dibromochloromethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Dibromomethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Ethylbenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Styrene	ND	ug/L	0.10	0.50	1		03/25/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/25/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW March 2010
REPORT NO. : 1003314
DATE REC'D : 03/18/10 15:40
REPORT DATE : 03/26/10 13:44
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Towers B

Matrix: Drinking Water

Sample Date/Time: 03/16/10 10:10

Lab No. : 1003314-07

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		03/25/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Vinyl chloride	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		03/25/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW March 2010
REPORT NO. : 1003314
DATE REC'D : 03/18/10 15:40
REPORT DATE : 03/26/10 13:44
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Raw Matrix: Drinking Water Sample Date/Time: 03/16/10 10:20 Lab No. : 1003314-08

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		03/25/10	MPM
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		03/25/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		03/25/10	MPM
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		03/25/10	MPM
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		03/25/10	MPM
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		03/25/10	MPM
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Benzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Bromobenzene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Bromodichloromethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Bromoform	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Bromomethane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Chlorobenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Chloroethane	ND	ug/L	0.70	2.30	1		03/25/10	MPM
Chloroform	0.79	ug/L	0.20	0.67	1		03/25/10	MPM
Chloromethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Dibromochloromethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Dibromomethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Ethylbenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Styrene	ND	ug/L	0.10	0.50	1		03/25/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/25/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW March 2010
REPORT NO. : 1003314
DATE REC'D : 03/18/10 15:40
REPORT DATE : 03/26/10 13:44
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Raw

Matrix: Drinking Water

Sample Date/Time: 03/16/10 10:20

Lab No. : 1003314-08

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		03/25/10	MPM
Trichloroethene	0.75	ug/L	0.40	1.30	1	J	03/25/10	MPM
Vinyl chloride	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		03/25/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW March 2010
REPORT NO. : 1003314
DATE REC'D 03/18/10 15:40
REPORT DATE : 03/26/10 13:44
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Finish Product Matrix: Drinking Water Sample Date/Time: 03/16/10 10:30 Lab No. : 1003314-09

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		03/25/10	MPM
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		03/25/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		03/25/10	MPM
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		03/25/10	MPM
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		03/25/10	MPM
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		03/25/10	MPM
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		03/25/10	MPM
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Benzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Bromobenzene	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Bromodichloromethane	2.54	ug/L	0.40	1.30	1		03/25/10	MPM
Bromoform	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Bromomethane	ND	ug/L	1.00	3.30	1		03/25/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		03/25/10	MPM
Chlorobenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Chloroethane	ND	ug/L	0.70	2.30	1		03/25/10	MPM
Chloroform	23.0	ug/L	0.20	0.67	1		03/25/10	MPM
Chloromethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Dibromochloromethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Dibromomethane	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Ethylbenzene	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Styrene	ND	ug/L	0.10	0.50	1		03/25/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/25/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW March 2010
REPORT NO. : 1003314
DATE REC'D : 03/18/10 15:40
REPORT DATE : 03/26/10 13:44
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Finish Product

Matrix: Drinking Water

Sample Date/Time: 03/16/10 10:30

Lab No. : 1003314-09

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		03/25/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		03/25/10	MPM
Vinyl chloride	ND	ug/L	0.20	0.67	1		03/25/10	MPM
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		03/25/10	MPM

SIEMENS

Qualifier Descriptions

J Estimated concentration below laboratory quantitation level.

Definitions

LOD = Limit of Detection (Dilution Corrected)
LOQ = Limit of Quantitation (Dilution Corrected)
Reporting Limit = LOQ (Dilution Corrected)
ND = Not Detected
COMP = Complete
SUBCON = Subcontracted analysis
mv = millivolts
pci/L = picocuries per Liter
mL/L = milliliters per Liter
mg = milligram

When the word "dry" follows the units on the result page the sample results are dry weight corrected.

LODs and LOQs are dry weight corrected for all soils except WI GRO, EPA 8021 and WI DNR/EPA 8260B methanol and WI DNR methylene chloride preserved soils being reported to the State of Wisconsin.

ug/l = Micrograms per Liter = parts per billion (ppb)
ug/kg = Micrograms per kilogram = parts per billion (ppb)
mg/l = Milligrams per liter = parts per million (ppm)
mg/kg = Milligrams per kilogram = parts per million (ppm)
NOT PRES = Not Present
ppth = Parts per thousand
* = Result outside established limits.
mg/m3 = Milligrams per meter cubed
ng/L = Nanograms per Liter = Parts per trillion(ppt)
> = Greater Than

State of Wisconsin Methanol Soils for WI GRO, WI DNR/EPA 8260B and EPA 8021 are reported to the LOQ.

LABORATORY'S QUALITY VERIFICATION STATEMENT

Laboratory must provide a signed copy of this form with each deliverable specified in the Work Order or the deliverable will not be accepted. Laboratory must provide Gannett Fleming with a true copy of its internal QA/QC review and approval forms related to the deliverable.

This form must be signed by the Laboratory's Quality Control/Quality Assurance Officer

Project Name:

Gannett Fleming Project Number: 34283.000

Deliverable Description: Analytical Report

I, Cindy Varga, warrant and represent that the project deliverable described above and attached to this form was developed in accordance with the project scope of work and that all elements relating to the quality of the deliverable were verified in accordance with the requirements of my firm's internal quality management/quality assurance system. This deliverable satisfies all requirements of our Contract with Gannett Fleming.

Signature: Cindy Varga
(by Laboratory's QC/QA Officer)

Date: 3/26/10

Laboratory: Siemens Water Technologies

'Deliverable' shall mean all aspects of design including, without limitation, drawings, calculations, maps, materials and specifications, reports, data bases, logs and other information developed from wells, borings and cores, laboratory data, materials schedules, instrument calibration data and all other items developed, prepared and delivered to Gannett Fleming by Contractor as specified in the Scope of Work in any media.

bw 10.2.09

SIEMENS

Company Name <i>Guannett Filtration</i>	Project <i>34283000</i>	
Report Mailing Address <i>8025 Excelsior Dr. Madison, WI 53717</i>	Contact Name, Phone, Fax, Email <i>DAVE OLIG 608-836-1500, 608-836-1337 DOLIG@fact.com</i>	
Invoice Address <i>6025 Excelsior Dr. Madison, WI 53717</i>	Purchase Order # <i>Tier 1, Per Siemens General Price Quote 2010</i>	Invoice Contact and Phone No. <i>DAVE OLIG 608-836-1500</i>

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: WI
(If Yes, please specify Agency or Regulation) Agency/Reg.: DNR

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1003314

Analyses Requested	Lab Use Only		
	Delivered by	Walk-in	Courier
Drinking H ₂ O 529.2	Ship. Cont. OK?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N NA
	Samples Leaking?	<input type="checkbox"/> Y	<input checked="" type="checkbox"/> N NA
	Seals OK?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N NA
	Rec'd on Ice?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N NA
	Sample Receiving Comments: <i>3-8</i>		
	Comments		
	<i>30.05 file</i>		

Lab Use Only	Sample		No. of Containers		Sample ID
	Date	Time	Comp	Grab	
-1				3	CW-11
-2				3	CW-15
-3				3	CW-16
-4				3	CW-17
-5				3	CW-19
-6				3	Tower A
-7				3	Tower B
-8				3	Raw
-9				3	Finish Product

Relinquished By:	Date	Time	Received By:
<i>[Signature]</i>	3/17	7:15	
	3-18701540		<i>[Signature]</i>

Chain of Custody
Record

SIEMENS

March 25, 2010

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

Attn: Dave Olig

RECEIVED	
GANNETT FLEMING-MADISON, WI	
FILE NO:	<u>34283.000 3 Ring Binder</u>
MAR 29 2010	
REVIEWED BY:	<u>DJO</u>
DATE:	<u>3/29/10</u>
ROUTE TO:	<u>JOC</u>

REPORT NO.: 1003315

PROJECT NO.: 34283.000, March 2010


Please find enclosed the analytical report, including the Sample Summary, Sample Narrative and Chain of Custody for your sample set received March 18, 2010.

All analyses were performed in accordance with NELAC Standards using approved methods as indicated on this report.


If you have any questions about the results, please call. Thank you for using Siemens Water Technologies for your analytical needs.

Sincerely,

Siemens Water Technologies


Bruce Schertz
Lab Manager
Enviroscan Analytical™ Services

I certify that the data contained in this report has been generated and reviewed in accordance with the Siemens Water Technologies Quality Assurance Program. Exceptions, if any, are discussed in the sample narrative. Samples will be retained for 30 days from the date of this report, then disposed in an appropriate manner. Siemens Water Technologies Corp. reserves the right to return samples identified as hazardous. Release of this Final Report is authorized as verified by the following signature. The contents of this report apply to the sample(s) analyzed. No duplication of this report is allowed except in its entirety.

Reviewed by: 

Certifications:

Wisconsin 737053130
Minnesota 055-999-302
Illinois 100317



Siemens Water Technologies Corp.

301 West Military Road
Rothschild, WI 54474
www.siemens.com/enviroscan

Tel: 800-338-7226
Fax: 715-355-3221

SIEMENS

SAMPLE SUMMARY

<u>Lab Id</u>	<u>Client Sample Id</u>	<u>Date/Time</u>	<u>Matrix</u>
1003315-01	MW-72	03/15/10 11:30	Ground Water
1003315-02	MW-72 MS	03/15/10 11:40	Ground Water
1003315-03	MW-72 MSD	03/15/10 11:50	Ground Water
1003315-04	MW-5B	03/15/10 12:00	Ground Water
1003315-05	MW-68B	03/15/10 12:10	Ground Water
1003315-06	MW-68B MS	03/15/10 12:10	Ground Water
1003315-07	MW-68B MSD	03/15/10 12:10	Ground Water
1003315-08	MW-70A	03/15/10 12:20	Ground Water
1003315-09	MW-23A	03/15/10 12:30	Ground Water
1003315-10	MW-23B	03/15/10 12:40	Ground Water
1003315-11	MW-69B	03/15/10 12:50	Ground Water
1003315-12	MW-38B	03/15/10 13:00	Ground Water
1003315-13	MW-38B Dup	03/15/10 13:10	Ground Water
1003315-14	RW-16B	03/16/10 07:10	Ground Water
1003315-15	EC-1	03/16/10 07:20	Ground Water
1003315-16	EC-2	03/16/10 07:30	Ground Water
1003315-17	RW-3C	03/16/10 07:40	Ground Water
1003315-18	RW-3B	03/16/10 07:50	Ground Water
1003315-19	MW-10B	03/16/10 12:10	Ground Water
1003315-20	MW-10A	03/16/10 12:30	Ground Water
1003315-21	Equipment Blank	03/16/10 16:05	Ground Water

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, March 2010
REPORT NO. : 1003315
DATE REC'D: 03/18/10 15:54
REPORT DATE : 03/25/10 15:02
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: MW-72

Matrix: Ground Water

Sample Date/Time: 03/15/10 11:30

Lab No. : 1003315-01

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		03/19/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/19/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		03/19/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		03/19/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		03/19/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Toluene	ND	ug/L	0.40	1.30	1	DUP	03/19/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		03/19/10	MPM

Sample ID: MW-72 MS

Matrix: Ground Water

Sample Date/Time: 03/15/10 11:40

Lab No. : 1003315-02

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	91.7	%	0.50	1.70	1		03/19/10	MPM
1,1-Dichloroethane	88.0	%	0.40	1.30	1		03/19/10	MPM
1,1-Dichloroethylene	85.5	%	0.40	1.30	1		03/19/10	MPM
Carbon Tetrachloride	95.3	%	0.30	1.00	1		03/19/10	MPM
Chloroform	90.3	%	0.20	0.67	1		03/19/10	MPM
m,p-Xylenes	112	%	0.40	1.30	1		03/19/10	MPM
Methylene Chloride	81.3	%	0.40	1.30	1		03/19/10	MPM
o-Xylene	113	%	0.20	0.67	1		03/19/10	MPM
Tetrachloroethene	97.4	%	0.30	1.00	1		03/19/10	MPM
Toluene	85.8	%	0.40	1.30	1	DUP	03/19/10	MPM
Trichloroethene	90.0	%	0.40	1.30	1		03/19/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, March 2010
REPORT NO. : 1003315
DATE REC'D: 03/18/10 15:54
REPORT DATE : 03/25/10 15:02
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: MW-72 MSD

Matrix: Ground Water

Sample Date/Time: 03/15/10 11:50

Lab No. : 1003315-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	90.9	%	0.50	1.70	1		03/19/10	MPM
1,1-Dichloroethane	85.4	%	0.40	1.30	1		03/19/10	MPM
1,1-Dichloroethylene	80.7	%	0.40	1.30	1		03/19/10	MPM
Carbon Tetrachloride	88.7	%	0.30	1.00	1		03/19/10	MPM
Chloroform	87.6	%	0.20	0.67	1		03/19/10	MPM
m,p-Xylenes	106	%	0.40	1.30	1		03/19/10	MPM
Methylene Chloride	78.0	%	0.40	1.30	1		03/19/10	MPM
o-Xylene	108	%	0.20	0.67	1		03/19/10	MPM
Tetrachloroethene	93.3	%	0.30	1.00	1		03/19/10	MPM
Toluene	91.0	%	0.40	1.30	1	DUP	03/19/10	MPM
Trichloroethene	89.2	%	0.40	1.30	1		03/19/10	MPM

Sample ID: MW-5B

Matrix: Ground Water

Sample Date/Time: 03/15/10 12:00

Lab No. : 1003315-04

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		03/19/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/19/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Chloroform	0.24	ug/L	0.20	0.67	1	J	03/19/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		03/19/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		03/19/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		03/19/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, March 2010
REPORT NO. : 1003315
DATE REC'D: 03/18/10 15:54
REPORT DATE : 03/25/10 15:02
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: **MW-68B**

Matrix: **Ground Water**

Sample Date/Time: **03/15/10 12:10**

Lab No. : **1003315-05**

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		03/24/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1	S1H, S2H	03/24/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1	S1H, S2H	03/24/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		03/24/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		03/24/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		03/24/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1	S1H, S2H	03/24/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		03/24/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/24/10	MPM
Toluene	ND	ug/L	0.40	1.30	1	S1H, S2H	03/24/10	MPM
Trichloroethene	1.57	ug/L	0.40	1.30	1		03/24/10	MPM

Sample ID: **MW-68B MS**

Matrix: **Ground Water**

Sample Date/Time: **03/15/10 12:10**

Lab No. : **1003315-06**

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	129	%	0.50	1.70	1		03/24/10	MPM
1,1-Dichloroethane	135	%	0.40	1.30	1	S1H	03/24/10	MPM
1,1-Dichloroethylene	155	%	0.40	1.30	1	S1H	03/24/10	MPM
Carbon Tetrachloride	127	%	0.30	1.00	1		03/24/10	MPM
Chloroform	135	%	0.20	0.67	1		03/24/10	MPM
m,p-Xylenes	93.0	%	0.40	1.30	1		03/24/10	MPM
Methylene Chloride	139	%	0.40	1.30	1	S1H	03/24/10	MPM
o-Xylene	91.8	%	0.20	0.67	1		03/24/10	MPM
Tetrachloroethene	124	%	0.30	1.00	1		03/24/10	MPM
Toluene	131	%	0.40	1.30	1	S1H	03/24/10	MPM
Trichloroethene	111	%	0.40	1.30	1		03/24/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, March 2010
REPORT NO. : 1003315
DATE REC'D: 03/18/10 15:54
REPORT DATE : 03/25/10 15:02
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: MW-68B MSD

Matrix: Ground Water

Sample Date/Time: 03/15/10 12:10

Lab No. : 1003315-07

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	131	%	0.50	1.70	1		03/24/10	MPM
1,1-Dichloroethane	139	%	0.40	1.30	1	S2H	03/24/10	MPM
1,1-Dichloroethylene	155	%	0.40	1.30	1	S2H	03/24/10	MPM
Carbon Tetrachloride	130	%	0.30	1.00	1		03/24/10	MPM
Chloroform	137	%	0.20	0.67	1		03/24/10	MPM
m,p-Xylenes	90.8	%	0.40	1.30	1		03/24/10	MPM
Methylene Chloride	141	%	0.40	1.30	1	S2H	03/24/10	MPM
o-Xylene	91.2	%	0.20	0.67	1		03/24/10	MPM
Tetrachloroethene	130	%	0.30	1.00	1		03/24/10	MPM
Toluene	134	%	0.40	1.30	1	S2H	03/24/10	MPM
Trichloroethene	112	%	0.40	1.30	1		03/24/10	MPM

Sample ID: MW-70A

Matrix: Ground Water

Sample Date/Time: 03/15/10 12:20

Lab No. : 1003315-08

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		03/19/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/19/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		03/19/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		03/19/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		03/19/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		03/19/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, March 2010
REPORT NO. : 1003315
DATE REC'D: 03/18/10 15:54
REPORT DATE : 03/25/10 15:02
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: MW-23A

Matrix: Ground Water

Sample Date/Time: 03/15/10 12:30

Lab No. : 1003315-09

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		03/19/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/19/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		03/19/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		03/19/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		03/19/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Trichloroethene	1.43	ug/L	0.40	1.30	1		03/19/10	MPM

Sample ID: MW-23B

Matrix: Ground Water

Sample Date/Time: 03/15/10 12:40

Lab No. : 1003315-10

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	0.59	ug/L	0.50	1.70	1	J	03/19/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/19/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		03/19/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		03/19/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		03/19/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Trichloroethene	2.55	ug/L	0.40	1.30	1		03/19/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, March 2010
REPORT NO. : 1003315
DATE REC'D: 03/18/10 15:54
REPORT DATE : 03/25/10 15:02
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: **MW-69B**

Matrix: **Ground Water**

Sample Date/Time: **03/15/10 12:50**

Lab No. : **1003315-11**

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		03/19/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/19/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Chloroform	1.17	ug/L	0.20	0.67	1		03/19/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		03/19/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		03/19/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		03/19/10	MPM

Sample ID: **MW-38B**

Matrix: **Ground Water**

Sample Date/Time: **03/15/10 13:00**

Lab No. : **1003315-12**

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	0.81	ug/L	0.50	1.70	1	J	03/19/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/19/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		03/19/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		03/19/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		03/19/10	MPM
Tetrachloroethene	0.37	ug/L	0.30	1.00	1	J	03/19/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Trichloroethene	3.84	ug/L	0.40	1.30	1		03/19/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, March 2010
REPORT NO. : 1003315
DATE REC'D: 03/18/10 15:54
REPORT DATE : 03/25/10 15:02
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: MW-38B Dup

Matrix: Ground Water

Sample Date/Time: 03/15/10 13:10

Lab No. : 1003315-13

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	0.82	ug/L	0.50	1.70	1	J	03/19/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/19/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		03/19/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		03/19/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		03/19/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Trichloroethene	3.91	ug/L	0.40	1.30	1		03/19/10	MPM

Sample ID: RW-16B

Matrix: Ground Water

Sample Date/Time: 03/16/10 7:10

Lab No. : 1003315-14

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		03/19/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/19/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		03/19/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		03/19/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		03/19/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		03/19/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, March 2010
REPORT NO. : 1003315
DATE REC'D: 03/18/10 15:54
REPORT DATE : 03/25/10 15:02
PREPARED BY : BMS

Attn: Dave Olig
Sample ID: EC-1

Matrix: Ground Water

Sample Date/Time: 03/16/10 7:20

Lab No. : 1003315-15

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		03/19/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/19/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		03/19/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		03/19/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		03/19/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Trichloroethene	0.52	ug/L	0.40	1.30	1	J	03/19/10	MPM

Sample ID: EC-2

Matrix: Ground Water

Sample Date/Time: 03/16/10 7:30

Lab No. : 1003315-16

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		03/19/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/19/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		03/19/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		03/19/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		03/19/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		03/19/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, March 2010
REPORT NO. : 1003315
DATE REC'D: 03/18/10 15:54
REPORT DATE : 03/25/10 15:02
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: RW-3C

Matrix: Ground Water

Sample Date/Time: 03/16/10 7:40

Lab No. : 1003315-17

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	0.83	ug/L	0.50	1.70	1	J	03/19/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/19/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Chloroform	0.35	ug/L	0.20	0.67	1	J	03/19/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		03/19/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		03/19/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Trichloroethene	5.19	ug/L	0.40	1.30	1		03/19/10	MPM

Sample ID: RW-3B

Matrix: Ground Water

Sample Date/Time: 03/16/10 7:50

Lab No. : 1003315-18

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	0.89	ug/L	0.50	1.70	1	J	03/19/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/19/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Chloroform	0.28	ug/L	0.20	0.67	1	J	03/19/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		03/19/10	MPM
o-Xylene	ND	ug/L	0.20	0.87	1		03/19/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Trichloroethene	4.23	ug/L	0.40	1.30	1		03/19/10	MPM

Sample ID: MW-10B

Matrix: Ground Water

Sample Date/Time: 03/16/10 12:10

Lab No. : 1003315-19

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 6020 - Diss.								
Dissolved Cadmium	4.81	ug/L	0.20	2.00	1		03/22/10	JCH

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, March 2010
REPORT NO. : 1003315
DATE REC'D: 03/18/10 15:54
REPORT DATE : 03/25/10 15:02
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: MW-10A

Matrix: Ground Water

Sample Date/Time: 03/16/10 12:30

Lab No. : 1003315-20

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 6020 - Diss.</u>								
Dissolved Cadmium	28.6	ug/L	0.20	2.00	1		03/22/10	JCH

Sample ID: Equipment Blank

Matrix: Ground Water

Sample Date/Time: 03/16/10 16:05

Lab No. : 1003315-21

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		03/19/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		03/19/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		03/19/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		03/19/10	MPM
m,p-Xylenes	0.77	ug/L	0.40	1.30	1	J	03/19/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		03/19/10	MPM
o-Xylene	0.34	ug/L	0.20	0.67	1	J	03/19/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		03/19/10	MPM
Toluene	1.02	ug/L	0.40	1.30	1	J	03/19/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		03/19/10	MPM

SIEMENS

Qualifier Descriptions

S2H	Second sample matrix spike recovery was high.
S1H	First sample matrix spike recovery was high.
J	Estimated concentration below laboratory quantitation level.
DUP	Result of duplicate analysis in this quality assurance batch exceeds the limits for precision.

Definitions

LOD = Limit of Detection (Dilution Corrected)
LOQ = Limit of Quantitation (Dilution Corrected)
Reporting Limit = LOQ (Dilution Corrected)
ND = Not Detected
COMP = Complete
SUBCON = Subcontracted analysis
mv = millivolts
pci/L = picocuries per Liter
mL/L = milliliters per Liter
mg = milligram

When the word "dry" follows the units on the result page the sample results are dry weight corrected.

LODs and LOQs are dry weight corrected for all soils except WI GRO and EPA 8021 methanol and WI DNR methylene chloride preserved soils.

ug/l = Micrograms per Liter = parts per billion (ppb)
ug/kg = Micrograms per kilogram = parts per billion (ppb)
mg/l = Milligrams per liter = parts per million (ppm)
mg/kg = Milligrams per kilogram = parts per million (ppm)
NOT PRES = Not Present
ppth = Parts per thousand
* = Result outside established limits.
mg/m³ = Milligrams per meter cubed
ng/L = Nanograms per Liter = Parts per trillion (ppt)
> = Greater Than

Methanol Soils for WI GRO and EPA 8021 are reported to the LOQ.

LABORATORY'S QUALITY VERIFICATION STATEMENT

Laboratory must provide a signed copy of this form with each deliverable specified in the Work Order or the deliverable will not be accepted. Laboratory must provide Gannett Fleming with a true copy of its internal QA/QC review and approval forms related to the deliverable.


This form must be signed by the Laboratory's Quality Control/Quality Assurance Officer

Project Name:

Gannett Fleming Project Number: 34283.000

Deliverable Description: Analytical Report

I, Cindy Varga, warrant and represent that the project deliverable described above and attached to this form was developed in accordance with the project scope of work and that all elements relating to the quality of the deliverable were verified in accordance with the requirements of my firm's internal quality management/quality assurance system. This deliverable satisfies all requirements of our Contract with Gannett Fleming.

Signature: 
(by Laboratory's QC/QA Officer)

Date: 3/26/10

Laboratory: Siemens Water Technologies

'Deliverable' shall mean all aspects of design including, without limitation, drawings, calculations, maps, materials and specifications, reports, data bases, logs and other information developed from wells, borings and cores, laboratory data, materials schedules, instrument calibration data and all other items developed, prepared and delivered to Gannett Fleming by Contractor as specified in the Scope of Work in any media.

bw 10.2.09

SIEMENS

Company Name <i>Geacnet Fleming</i>	Project <i>34283000</i>	
Report Mailing Address <i>8025 Excelsior Dr. Madison, WI 53717</i>	Contact Name, Phone, Fax, Email <i>Dave Olig dog@stinet.com 608-830-1500 / 608-831-3337</i>	
Invoice Address <i>National Pesto/Industries 3425 N. Harding Way Eau Claire, WI 53703</i> <i>8025 Excelsior Dr. Madison, WI 53717</i>	Purchase Order # <i>Per 2000 Siemens Price Quote (Ties 1)</i>	Invoice Contact and Phone No. <i>Rick Pahl</i> <i>Dave Olig 1-800-877-0441 608-8361500</i>

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: WI
(If Yes, please specify Agency or Regulation) Agency/Reg.: DNR

Turnaround Request: [Normal (10 Bus. Days)
] [Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1003315

Analyses Requested										Lab Use Only			
VOC NRI Short List										Delivered by	Walk-in	<u>Courier</u>	
										Ship. Cont. OK?	<input checked="" type="checkbox"/>	N NA	
										Samples Leaking?	Y <input checked="" type="checkbox"/>	NA NA	
										Seals OK?	<input checked="" type="checkbox"/>	N NA	
										Rec'd on Ice?	<input checked="" type="checkbox"/>	N NA	
	Sample Receiving Comments:										3-8		
	Comments										3-21-10 HCR		

Lab Use Only	Sample		No. of Containers		Sample ID
	Date	Time	Comp	Grab	
-1	3/17	11:30		3	MW 7L
-2		11:30		3	MW 72MS
-3		11:30		3	MW 72MS(D)
-4		11:30		3	MW 51B
-5		12:10		3	MW 68B
-6		12:10		3	MW 68BMS
-7		12:10		3	MW 68BMS(D)
-8		12:10		3	MW 70A
-9		12:50		3	MW 23A
-10	3/18	13:10		3	MW-23B

Relinquished By:	Date	Time	Received By:
<i>[Signature]</i>	3/17	7:15	
	3/18/10	1554	<i>[Signature]</i>

Chain of Custody Record

SIEMENS

Company Name <i>Conrad H. Fleming</i>	% <i>Museu A Kuehl</i> <i>Data Validation</i>	Project <i>34283.000</i>
Report Mailing Address <i>6025 Excelsior Dr</i> <i>Madison, WI 53717</i>	<i>M.A. Kuehl Company</i> <i>3470 Charlevoix Court</i> <i>Green Bay, WI</i>	Contact Name, Phone, Fax, Email <i>Dave Olig</i> <i>608-836-1500 / 608-831-3337</i> <i>DD: d.og@east.com</i>
Invoice Address <i>National Pest Industries</i> <i>3925 W. Hastings Way</i> <i>EAU CLAIRE, WI 53703</i>	<i>6025 Excelsior Dr.</i> <i>Madison, WI 53717</i>	Purchase Order # <i>Tier 1</i> <i>Per 2000</i> <i>Siemens</i> <i>General Price</i>
		Invoice Contact and Phone No. <i>Dave Olig</i> <i>608-836-1500</i>

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: WI
(If Yes, please specify Agency or Regulation) Agency/Reg.: DNR

Turnaround Request: () Normal (10 Bus. Days)
() Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1003315

Analyses Requested										Lab Use Only				
use NPE Shortlist	dis. Col										Delivered by	Walk-in	<u>Courier</u>	
												Ship. Cont. Ok?	<input checked="" type="checkbox"/>	N NA
												Samples Leaking?	<input checked="" type="checkbox"/>	Y NA
												Seals OK?	<input checked="" type="checkbox"/>	N NA
												Rec'd on Ice?	<input checked="" type="checkbox"/>	N NA
		Sample Receiving Comments:												
		3.8												
		Comments												
		3 seals HCl												
		↓												
1.250g (HNO3)														
↓														

Lab Use Only	Sample		No. of Containers		Sample ID
	Date	Time	Comp	Grab	
-11	3/17	12:30		3	MW-69B
-12	3/17	1:00		3	MW-34B
-13	3/17	1:10		3	MW-38B DP
-14	3/17	7:10		3	Rw-16B
-15		1:30		2	EC-1
-16		7:40		2	EC-2
-17		7:50		3	Rw-30C
-18		7:50		3	Rw-33B
-19		12:10		1	MW-10B
-20		12:30		1	MW-10A

Relinquished By:	Date	Time	Received By:
<i>[Signature]</i>	3/17	7:5	
	3:18:10	1554	<i>[Signature]</i>

Chain of Custody Record

SIEMENS

Company Name <i>Gunnatt Fleming</i>	% <i>Marcia A Kuehl</i> <i>Data Validation</i>	Project <i>34283.000</i>
Report Mailing Address <i>8025 Excelsior Dr Madison, WI 53717</i>	<i>M.A. Kuehl Company 3470 Charlotte x Coast Green Bay, WI</i>	Contact Name, Phone, Fax, Email <i>Dave Olig 608-536-1500 608-531-3337 dolig@gnfnet.com</i>
Invoice Address <i>National Resto Industries 3425 N. Hastings Way Eau Claire, WI 53703</i>	<i>8025 Excelsior Dr. Madison, WI 53717</i>	Purchase Order # <i>T151</i> <i>Per 200 Siemens</i> General Price <i>Quote</i>
		Invoice Contact and Phone No. <i>Derrick Post Dave Olig 1-800-977-2011 608-536-1500</i>

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: WI
(If Yes, please specify Agency or Regulation) Agency/Reg.: DNR

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1003315

Analyses Requested										Lab Use Only				
vec NPA Short List										Delivered by	Walk-in	<u>Courier</u>		
										Shp. Cont. OK?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N	NA	
										Samples Leaking?	<input type="checkbox"/> Y	<input checked="" type="checkbox"/> N	NA	
										Seals OK?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N	NA	
										Rec'd on Ice?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N	NA	
	Sample Receiving Comments:										3-8			
	Comments										3/25 HCC			

Lab Use Only	Sample		No. of Containers		Sample ID
	Date	Time	Comp	Grab	
-21	3/16	4:25		3	Equipment Blank

Relinquished By:	Date	Time	Received By:
<i>[Signature]</i>	3/17	7:15	
	3/18	1554	<i>[Signature]</i>

Chain of Custody Record

SIEMENS

jec 8/2/10

July 19, 2010

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

Attn: Cliff Wright

REPORT NO.: 1007050

PROJECT NO.: 34283 Natl Presto, 2nd Qrt 2010

Please find enclosed the analytical report, including the Sample Summary, Sample Narrative and Chain of Custody for your sample set received July 2, 2010.

All analyses were performed in accordance with NELAC Standards using approved methods as indicated on this report.

If you have any questions about the results, please call. Thank you for using Siemens Water Technologies for your analytical needs.

Sincerely,

Siemens Water Technologies



James Salkowski
Lab Director
Enviroscan Analytical™ Services

I certify that the data contained in this report has been generated and reviewed in accordance with the Siemens Water Technologies Quality Assurance Program. Exceptions, if any, are discussed in the sample narrative. Samples will be retained for 30 days from the date of this report, then disposed in an appropriate manner. Siemens Water Technologies Corp. reserves the right to return samples identified as hazardous. Release of this Final Report is authorized as verified by the following signature. The contents of this report apply to the sample(s) analyzed. No duplication of this report is allowed except in its entirety.

Reviewed by: 

Certifications:

Wisconsin 737053130
Minnesota 055-999-302
Illinois 100317



Siemens Water Technologies Corp.

301 West Military Road
Rothschild, WI 54474

Tel: 800-338-7226
Fax: 715-355-322 t
www.siemens.com/enviroscan

The total number of pages in this report, including this page is 12.

LABORATORY'S QUALITY VERIFICATION STATEMENT

Laboratory must provide a signed copy of this form with each deliverable specified in the Work Order or the deliverable will not be accepted. Laboratory must provide Gannett Fleming with a true copy of its internal QA/QC review and approval forms related to the deliverable.

This form must be signed by the Laboratory's Quality Control/Quality Assurance Officer

Project Name: National Presto Industries

Gannett Fleming Project Number: 34283

Deliverable Description: Analytical Report

I, Cindy Varga, warrant and represent that the project deliverable described above and attached to this form was developed in accordance with the project scope of work and that all elements relating to the quality of the deliverable were verified in accordance with the requirements of my firm's internal quality management/quality assurance system. This deliverable satisfies all requirements of our Contract with Gannett Fleming.

Signature: Cindy Varga
(by Laboratory's QC/QA Officer)

Date: 7/20/10

Laboratory: Siemens Water Technologies

'Deliverable' shall mean all aspects of design including, without limitation, drawings, calculations, maps, materials and specifications, reports, data bases, logs and other information developed from wells, borings and cores, laboratory data, materials schedules, instrument calibration data and all other items developed, prepared and delivered to Gannett Fleming by Contractor as specified in the Scope of Work in any media.

bw 10.2.09

SIEMENS

SAMPLE SUMMARY

<u>Lab Id</u>	<u>Client</u>	<u>Sample Id</u>	<u>Date/Time</u>	<u>Matrix</u>
1007050-01	MH #18		06/28/10 11:00	Ground Water
1007050-02	CAS-1		06/28/10 11:10	Ground Water
1007050-03	CAS-2		06/28/10 10:50	Ground Water
1007050-04	EW-1		06/28/10 11:15	Ground Water
1007050-05	EW-2		06/28/10 11:25	Ground Water
1007050-06	EW-4		06/28/10 10:40	Ground Water
1007050-07	EW-5		06/28/10 10:10	Ground Water
1007050-08	Trip Blank		06/28/10 00:00	Water

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283 Natl Presto, 2nd Qrt 2010
REPORT NO. : 1007050
DATE REC'D 07/02/10 13:52
REPORT DATE : 07/19/10 09:06
PREPARED BY : JRS

Attn: Cliff Wright

Sample ID: MH #18

Matrix: Ground Water

Sample Date/Time: 06/28/10 11:00

Lab No. : 1007050-01

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	0.91	ug/L	0.50	1.70	1	J	07/06/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		07/06/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283 Natl Presto, 2nd Qrt 2010
REPORT NO. : 1007050
DATE REC'D 07/02/10 13:52
REPORT DATE : 07/19/10 09:06
PREPARED BY : JRS

Attn: Cliff Wright

Sample ID: CAS-1

Matrix: Ground Water

Sample Date/Time: 06/28/10 11:10

Lab No. : 1007050-02

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/06/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		07/06/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283 Natl Presto, 2nd Qrt 2010
REPORT NO. : 1007050
DATE REC'D 07/02/10 13:52
REPORT DATE : 07/19/10 09:06
PREPARED BY : JRS

Attn: Cliff Wright

Sample ID: CAS-2

Matrix: Ground Water

Sample Date/Time: 06/28/10 10:50

Lab No. : 1007050-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	1.32	ug/L	0.50	1.70	1	J	07/06/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Trichloroethene	0.42	ug/L	0.40	1.30	1	J	07/06/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283 Natl Presto, 2nd Qrt 2010
REPORT NO. : 1007050
DATE REC'D : 07/02/10 13:52
REPORT DATE : 07/19/10 09:06
PREPARED BY : JRS

Attn: Cliff Wright

Sample ID: EW-1

Matrix: Ground Water

Sample Date/Time: 06/28/10 11:15

Lab No. : 1007050-04

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/06/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		07/06/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283 Natl Presto, 2nd Qrt 2010
REPORT NO. : 1007050
DATE REC'D 07/02/10 13:52
REPORT DATE : 07/19/10 09:06
PREPARED BY : JRS

Attn: Cliff Wright

Sample ID: EW-2

Matrix: Ground Water

Sample Date/Time: 06/28/10 11:25

Lab No. : 1007050-05

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/06/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		07/06/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283 Natl Presto, 2nd Qrt 2010
REPORT NO. : 1007050
DATE REC'D 07/02/10 13:52
REPORT DATE : 07/19/10 09:06
PREPARED BY : JRS

Attn: Cliff Wright

Sample ID: EW-4

Matrix: Ground Water

Sample Date/Time: 06/28/10 10:40

Lab No. : 1007050-06

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	2.60	ug/L	0.50	1.70	1		07/06/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Trichloroethene	0.47	ug/L	0.40	1.30	1	J	07/06/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283 Natl Presto, 2nd Qrt 2010
REPORT NO. : 1007050
DATE REC'D 07/02/10 13:52
REPORT DATE : 07/19/10 09:06
PREPARED BY : JRS

Attn: Cliff Wright

Sample ID: EW-5

Matrix: Ground Water

Sample Date/Time: 06/28/10 10:10

Lab No. : 1007050-07

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	1.76	ug/L	0.50	1.70	1		07/06/10	MPM
1,1-Dichloroethane	0.57	ug/L	0.40	1.30	1	J	07/06/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Trichloroethene	0.96	ug/L	0.40	1.30	1	J	07/06/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283 Natl Presto, 2nd Qrt 2010
REPORT NO. : 1007050
DATE REC'D 07/02/10 13:52
REPORT DATE : 07/19/10 09:06
PREPARED BY : JRS

Attn: Cliff Wright

Sample ID: Trip Blank

Matrix: Water

Sample Date/Time: 06/28/10 0:00

Lab No. : 1007050-08

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/06/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		07/06/10	MPM

SIEMENS

Qualifier Descriptions

J Estimated concentration below laboratory quantitation level.

Definitions

LOD = Limit of Detection (Dilution Corrected)
LOQ = Limit of Quantitation (Dilution Corrected)
Reporting Limit = LOQ (Dilution Corrected)
ND = Not Detected
COMP = Complete
SUBCON = Subcontracted analysis
mv = millivolts
pci/L = picocuries per Liter
mL/L = milliliters per Liter
mg = milligram

When the word "dry" follows the units on the result page the sample results are dry weight corrected.

LODs and LOQs are dry weight corrected for all soils except WI GRO, EPA 8021 and WI DNR/EPA 8260B methanol and WI DNR methylene chloride preserved soils being reported to the State of Wisconsin.

ug/l = Micrograms per Liter = parts per billion (ppb)
ug/kg = Micrograms per kilogram = parts per billion (ppb)
mg/l = Milligrams per liter = parts per million (ppm)
mg/kg = Milligrams per kilogram = parts per million (ppm)
NOT PRES = Not Present
ppth = Parts per thousand
* = Result outside established limits.
mg/m³ = Milligrams per meter cubed
ng/L = Nanograms per Liter = Parts per trillion (ppt)
> = Greater Than

State of Wisconsin Methanol Soils for WI GRO, WI DNR/EPA 8260B and EPA 8021 are reported to the LOQ.

SIEMENS

Company Name NATIONAL TESTS LTD		Project 34203
Report Mailing Address CLIFF WRIGHT - SPINNETT FLEMING 8025 EXCELISOR DE MADISON, WI. 53717		Contact Name, Phone, Fax, Email 1-608-836-1500
Invoice Address DERRICK PAUL 3925 N. HASTINGS WAY EAU CLAIRE, WI 54703	Purchase Order # N-1064	Invoice Contact and Phone No. 1-715-839-2141

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: _____
(If Yes, please specify Agency or Regulation) Agency/Reg.: _____

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. **1007050**

Analyses Requested						Lab Use Only		
Voc's						Delivered by:	Walk-in	Cooler
						Ship. Cont. OK?	<input checked="" type="checkbox"/> N	NA
						Samples Leaking?	<input checked="" type="checkbox"/> N	NA
						Seals OK?	<input checked="" type="checkbox"/> N	NA
						Rec'd on ice?	<input checked="" type="checkbox"/> N	NA
						Sample Receiving Comments: 4°C		

Dunham

Lab Use Only	Sample		No. of Containers		Sample ID	Comments
	Date	Time	Comp	Grab		
-1	6-28-10	1000		3	M.H. #18	3 vials HCL ↓ TB #157 ST610
-2		1110		3	CAS-1	
-3		1050		3	CAS-2	
-4		1115		3	EW-1	
-5		1125		3	EW-2	
-6		1040		3	EW-4	
-7		1010		3	EW-5	
-8					Trip Blank P.H. = 7.8 TEMP = 52°	

Chain of Custody Record

Relinquished By:	Date	Time	Received By:
<i>Marcus J. Kall...</i>	6-30-10	1300	
	7-2-10	1352	<i>[Signature]</i>

SIEMENS

July 07, 2010

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

Attn: Dave Olig

RECEIVED	
GANNETT FLEMING-MADISON, WI	
FILE NO:	<u>34283.000</u> (NPI)
JUL 08 2010	
REVIEWED BY:	<u>djo</u>
DATE:	<u>7/8/10</u>
ROUTE TO:	<u>jes 8/2/10</u>

REPORT NO.: 1007051

PROJECT NO.: 34283.000 DW June 2010

Please find enclosed the analytical report, including the Sample Summary, Sample Narrative and Chain of Custody for your sample set received July 2, 2010.

All analyses were performed in accordance with NELAC Standards using approved methods as indicated on this report.

If you have any questions about the results, please call. Thank you for using Siemens Water Technologies for your analytical needs.

Sincerely,

Siemens Water Technologies


Bruce Schertz
Lab Manager
Enviroscan Analytical™ Services

I certify that the data contained in this report has been generated and reviewed in accordance with the Siemens Water Technologies Quality Assurance Program. Exceptions, if any, are discussed in the sample narrative. Samples will be retained for 30 days from the date of this report, then disposed in an appropriate manner. Siemens Water Technologies Corp. reserves the right to return samples identified as hazardous. Release of this Final Report is authorized as verified by the following signature. The contents of this report apply to the sample(s) analyzed. No duplication of this report is allowed except in its entirety.

Reviewed by: 

Certifications:

Wisconsin 737053130
Minnesota 055-999-302
Illinois 100317



Siemens Water Technologies Corp.

301 West Military Road
Rothschild, WI 54474

Tel: 800-338-7226
Fax: 715-355-3221
www.siemens.com/enviroscan

LABORATORY'S QUALITY VERIFICATION STATEMENT

Laboratory must provide a signed copy of this form with each deliverable specified in the Work Order or the deliverable will not be accepted. Laboratory must provide Gannett Fleming with a true copy of its internal QA/QC review and approval forms related to the deliverable.

This form must be signed by the Laboratory's Quality Control/Quality Assurance Officer

Project Name: National Presto Ind

Gannett Fleming Project Number: 34283-000

Deliverable Description: Analytical Report

I, Cindy Varga, warrant and represent that the project deliverable described above and attached to this form was developed in accordance with the project scope of work and that all elements relating to the quality of the deliverable were verified in accordance with the requirements of my firm's internal quality management/quality assurance system. This deliverable satisfies all requirements of our Contract with Gannett Fleming.

Signature: Cindy K Varga
(by Laboratory's QC/QA Officer)

Date: 7/7/10

Laboratory: Siemens Water Technologies

'Deliverable' shall mean all aspects of design including, without limitation, drawings, calculations, maps, materials and specifications, reports, data bases, logs and other information developed from wells, borings and cores, laboratory data, materials schedules, instrument calibration data and all other items developed, prepared and delivered to Gannett Fleming by Contractor as specified in the Scope of Work in any media.

bw 10.2.09

SIEMENS

SAMPLE SUMMARY

<u>Lab Id</u>	<u>Client</u> <u>Sample Id</u>	<u>Date/Time</u>	<u>Matrix</u>
1007051-01	CW-11	06/30/10 00:00	Drinking Water
1007051-02	CW-15	06/30/10 00:00	Drinking Water
1007051-03	CW-16	06/30/10 00:00	Drinking Water
1007051-04	CW-17	06/30/10 00:00	Drinking Water
1007051-05	CW-19	06/30/10 00:00	Drinking Water
1007051-06	Tower A	06/30/10 00:00	Drinking Water
1007051-07	Tower B	06/30/10 00:00	Drinking Water
1007051-08	Raw	06/30/10 00:00	Drinking Water
1007051-09	Finish Product	06/30/10 00:00	Drinking Water
1007051-10	Trip Blank	06/30/10 00:00	Water

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW June 2010
REPORT NO. : 1007051
DATE REC'D : 07/02/10 14:08
REPORT DATE : 07/07/10 10:15
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-11

Matrix: Drinking Water

Sample Date/Time: 06/30/10 0:00

Lab No. : 1007051-01

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		07/06/10	MRD
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/06/10	MRD
1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		07/06/10	MRD
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		07/06/10	MRD
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		07/06/10	MRD
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		07/06/10	MRD
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Benzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Bromobenzene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Bromodichloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Bromoform	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Bromomethane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Chlorobenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Chloroethane	ND	ug/L	0.70	2.30	1		07/06/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Chloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Dibromochloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Dibromomethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Ethylbenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Styrene	ND	ug/L	0.10	0.50	1		07/06/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW June 2010
REPORT NO. : 1007051
DATE REC'D : 07/02/10 14:08
REPORT DATE : 07/07/10 10:15
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-11

Matrix: Drinking Water

Sample Date/Time: 06/30/10 0:00

Lab No. : 1007051-01

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
trans- t,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		07/06/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Vinyl chloride	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		07/06/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW June 2010
REPORT NO. : 1007051
DATE REC'D 07/02/10 14:08
REPORT DATE : 07/07/10 10:15
PREPARED BY : BMS

Attn: Dave Ollg

Sample ID: CW-15

Matrix: Drinking Water

Sample Date/Time: 06/30/10 0:00

Lab No. : 1007051-02

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		07/06/10	MRD
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/06/10	MRD
1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		07/06/10	MRD
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		07/06/10	MRD
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		07/06/10	MRD
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		07/06/10	MRD
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Benzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Bromobenzene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Bromodichloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Bromoform	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Bromomethane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Chlorobenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Chloroethane	ND	ug/L	0.70	2.30	1		07/06/10	MRD
Chloroform	0.80	ug/L	0.20	0.67	1		07/06/10	MRD
Chloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Dibromochloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Dibromomethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Ethylbenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Styrene	ND	ug/L	0.10	0.50	1		07/06/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW June 2010
REPORT NO. : 1007051
DATE REC'D 07/02/10 14:08
REPORT DATE : 07/07/10 10:15
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-15

Matrix: Drinking Water

Sample Date/Time: 06/30/10 0:00

Lab No. : 1007051-02

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		07/06/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Vinyl chloride	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		07/06/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW June 2010
REPORT NO. : 1007051
DATE REC'D 07/02/10 14:08
REPORT DATE : 07/07/10 10:15
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-16

Matrix: Drinking Water

Sample Date/Time: 06/30/10 0:00

Lab No. : 1007051-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		07/06/10	MRD
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/06/10	MRD
1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		07/06/10	MRD
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		07/06/10	MRD
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		07/06/10	MRD
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		07/06/10	MRD
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Benzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Bromobenzene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Bromodichloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Bromoform	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Bromomethane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Chlorobenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Chloroethane	ND	ug/L	0.70	2.30	1		07/06/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Chloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Dibromochloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Dibromomethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Ethylbenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Styrene	ND	ug/L	0.10	0.50	1		07/06/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW June 2010
REPORT NO. : 1007051
DATE REC'D 07/02/10 14:08
REPORT DATE : 07/07/10 10:15
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-16

Matrix: Drinking Water

Sample Date/Time: 06/30/10 0:00

Lab No. : 1007051-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		07/06/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Vinyl chloride	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		07/06/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW June 2010
REPORT NO. : 1007051
DATE REC'D 07/02/10 14:08
REPORT DATE : 07/07/10 10:15
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-17

Matrix: Drinking Water

Sample Date/Time: 06/30/10 0:00

Lab No. : 1007051-04

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		07/06/10	MRD
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/06/10	MRD
1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		07/06/10	MRD
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		07/06/10	MRD
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		07/06/10	MRD
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		07/06/10	MRD
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Benzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Bromobenzene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Bromodichloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Bromoform	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Bromomethane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	t		07/06/10	MRD
Chlorobenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Chloroethane	ND	ug/L	0.70	2.30	t		07/06/10	MRD
Chloroform	0.62	ug/L	0.20	0.67	1	J	07/06/10	MRD
Chloromethane	ND	ug/L	0.40	1.30	t		07/06/10	MRD
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	t		07/06/10	MRD
Dibromochloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Dibromomethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Ethylbenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Styrene	ND	ug/L	0.10	0.50	1		07/06/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW June 2010
REPORT NO. : 1007051
DATE REC'D : 07/02/10 14:08
REPORT DATE : 07/07/10 10:15
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-17

Matrix: Drinking Water

Sample Date/Time: 06/30/10 0:00

Lab No. : 1007051-04

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		07/06/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Vinyl chloride	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		07/06/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW June 2010
REPORT NO. : 1007051
DATE REC'D 07/02/10 14:08
REPORT DATE : 07/07/10 10:15
PREPARED BY : BMS

Attn: Dave Ollg

Sample ID: CW-19

Matrix: Drinking Water

Sample Date/Time: 06/30/10 0:00

Lab No. : 1007051-05

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		07/06/10	MRD
1,1,1-Trichloroethane	0.51	ug/L	0.50	1.70	1	J	07/06/10	MRD
1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		07/06/10	MRD
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		07/06/10	MRD
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		07/06/10	MRD
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		07/06/10	MRD
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Benzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Bromobenzene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Bromodichloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Bromoform	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Bromomethane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Chlorobenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Chloroethane	ND	ug/L	0.70	2.30	1		07/06/10	MRD
Chloroform	0.76	ug/L	0.20	0.67	1		07/06/10	MRD
Chloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Dibromochloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Dibromomethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Ethylbenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Styrene	ND	ug/L	0.10	0.50	1		07/06/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW June 2010
REPORT NO. : 1007051
DATE REC'D 07/02/10 14:08
REPORT DATE : 07/07/10 10:15
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-19

Matrix: Drinking Water

Sample Date/Time: 06/30/10 0:00

Lab No. : 1007051-05

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		07/06/10	MRD
Trichloroethene	2.21	ug/L	0.40	1.30	1		07/06/10	MRD
Vinyl chloride	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		07/06/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW June 2010
REPORT NO. : 1007051
DATE REC'D 07/02/10 14:08
REPORT DATE : 07/07/10 10:15
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Tower A

Matrix: Drinking Water

Sample Date/Time: 06/30/10 0:00

Lab No. : 1007051-06

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		07/06/10	MRD
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/06/10	MRD
1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		07/06/10	MRD
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		07/06/10	MRD
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		07/06/10	MRD
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		07/06/10	MRD
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Benzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Bromobenzene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Bromodichloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Bromoform	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Bromomethane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Chlorobenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Chloroethane	ND	ug/L	0.70	2.30	1		07/06/10	MRD
Chloroform	0.22	ug/L	0.20	0.67	1	J	07/06/10	MRD
Chloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Dibromochloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Dibromomethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Ethylbenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Styrene	ND	ug/L	0.10	0.50	1		07/06/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW June 2010
REPORT NO. : 1007051
DATE REC'D 07/02/10 14:08
REPORT DATE : 07/07/10 10:15
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Tower A

Matrix: Drinking Water

Sample Date/Time: 06/30/10 0:00

Lab No. : 1007051-06

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		07/06/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Vinyl chloride	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		07/06/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW June 2010
REPORT NO. : 1007051
DATE REC'D 07/02/10 14:08
REPORT DATE : 07/07/10 10:15
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Tower B

Matrix: Drinking Water

Sample Date/Time: 06/30/10 0:00

Lab No. : 1007051-07

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		07/06/10	MRD
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/06/10	MRD
1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		07/06/10	MRD
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		07/06/10	MRD
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		07/06/10	MRD
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		07/06/10	MRD
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Benzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Bromobenzene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Bromodichloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Bromoform	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Bromomethane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Chlorobenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Chloroethane	ND	ug/L	0.70	2.30	1		07/06/10	MRD
Chloroform	0.27	ug/L	0.20	0.67	1	J	07/06/10	MRD
Chloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Dibromochloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Dibromomethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Ethylbenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Styrene	ND	ug/L	0.10	0.50	1		07/06/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW June 2010
REPORT NO. : 1007051
DATE REC'D : 07/02/10 14:08
REPORT DATE : 07/07/10 10:15
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Tower B

Matrix: Drinking Water

Sample Date/Time: 06/30/10 0:00

Lab No. : 1007051-07

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		07/06/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Vinyl chloride	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		07/06/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW June 2010
REPORT NO. : 1007051
DATE REC'D 07/02/10 14:08
REPORT DATE : 07/07/10 10:15
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Raw

Matrix: Drinking Water

Sample Date/Time: 06/30/10 0:00

Lab No. : 1007051-08

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		07/06/10	MRD
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/06/10	MRD
1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		07/06/10	MRD
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		07/06/10	MRD
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		07/06/10	MRD
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		07/06/10	MRD
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Benzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Bromobenzene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Bromodichloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Bromoform	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Bromomethane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Chlorobenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Chloroethane	ND	ug/L	0.70	2.30	1		07/06/10	MRD
Chloroform	0.68	ug/L	0.20	0.67	1		07/06/10	MRD
Chloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Dibromochloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Dibromomethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Ethylbenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Styrene	ND	ug/L	0.10	0.50	1		07/06/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW June 2010
REPORT NO. : 1007051
DATE REC'D 07/02/10 14:08
REPORT DATE : 07/07/10 10:15
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Raw

Matrix: Drinking Water

Sample Date/Time: 06/30/10 0:00

Lab No. : 1007051-08

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		07/06/10	MRD
Trichloroethene	0.74	ug/L	0.40	1.30	1	J	07/06/10	MRD
Vinyl chloride	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		07/06/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW June 2010
REPORT NO. : 1007051
DATE REC'D 07/02/10 14:08
REPORT DATE : 07/07/10 10:15
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Finish Product Matrix: Drinking Water Sample Date/Time: 06/30/10 0:00 Lab No. : 1007051-09

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		07/06/10	MRD
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/06/10	MRD
1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		07/06/10	MRD
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		07/06/10	MRD
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		07/06/10	MRD
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		07/06/10	MRD
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Benzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Bromobenzene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Bromodichloromethane	1.43	ug/L	0.40	1.30	1		07/06/10	MRD
Bromofom	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Bromomethane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Chlorobenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Chloroethane	ND	ug/L	0.70	2.30	1		07/06/10	MRD
Chloroform	21.3	ug/L	0.20	0.67	1		07/06/10	MRD
Chloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Dibromochloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Dibromomethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Ethylbenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Styrene	ND	ug/L	0.10	0.50	1		07/06/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW June 2010
REPORT NO. : 1007051
DATE REC'D : 07/02/10 14:08
REPORT DATE : 07/07/10 10:15
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Finish Product

Matrix: Drinking Water

Sample Date/Time: 06/30/10 0:00

Lab No. : 1007051-09

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		07/06/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Vinyl chloride	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		07/06/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW June 2010
REPORT NO. : 1007051
DATE REC'D 07/02/10 14:08
REPORT DATE : 07/07/10 10:15
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Trip Blank

Matrix: Water

Sample Date/Time: 06/30/10 0:00

Lab No. : 1007051-10

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		07/06/10	MRD
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/06/10	MRD
1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		07/06/10	MRD
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		07/06/10	MRD
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		07/06/10	MRD
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		07/06/10	MRD
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		07/06/10	MRD
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Benzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Bromobenzene	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Bromodichloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Bromoform	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Bromomethane	ND	ug/L	1.00	3.30	1		07/06/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/06/10	MRD
Chlorobenzene	ND	ug/L	0.20	0.87	1		07/06/10	MRD
Chloroethane	ND	ug/L	0.70	2.30	1		07/06/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Chloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Dibromochloromethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Dibromomethane	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Ethylbenzene	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Styrene	ND	ug/L	0.10	0.50	1		07/06/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 DW June 2010
REPORT NO. : 1007051
DATE REC'D 07/02/10 14:08
REPORT DATE : 07/07/10 10:15
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Trip Blank

Matrix: Water

Sample Date/Time: 06/30/10 0:00

Lab No. : 1007051-10

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		07/06/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		07/06/10	MRD
Vinyl chloride	ND	ug/L	0.20	0.67	1		07/06/10	MRD
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		07/06/10	MRD

SIEMENS

Qualifier Descriptions

J Estimated concentration below laboratory quantitation level.

Definitions

LOD = Limit of Detection (Dilution Corrected)
LOQ = Limit of Quantitation (Dilution Corrected)
Reporting Limit = LOQ (Dilution Corrected)
ND = Not Detected
COMP = Complete
SUBCON = Subcontracted analysis
mv = millivolts
pci/L = picocuries per Liter
mL/L = milliliters per Liter
mg = milligram

When the word "dry" follows the units on the result
page the sample results are dry weight corrected.

LODs and LOQs are dry weight corrected for all soils
except WI GRO, EPA 8021 and WI DNR/EPA 8260B
methanol and WI DNR methylene chloride preserved
soils being reported to the State of Wisconsin.

ug/l = Micrograms per Liter = parts per billion (ppb)
ug/kg = Micrograms per kilogram = parts per billion (ppb)
mg/l = Milligrams per liter = parts per million (ppm)
mg/kg = Milligrams per kilogram = parts per million (ppm)
NOT PRES = Not Present
ppth = Parts per thousand
* = Result outside established limits.
mg/m3 = Milligrams per meter cubed
ng/L = Nanograms per Liter = Parts per trillion (ppt)
> = Greater Than

State of Wisconsin Methanol Soils for WI GRO, WI
DNR/EPA 8260B and EPA 8021 are reported to the LOQ.

SIEMENS

Company Name Gannett Fleming	Project National Presto Ind, 3A283-000
Report Mailing Address 8025 Excelsior Dr Madison, WI 53717	Contact Name, Phone, Fax, Email P-608-836-1500 F-608-831-3337 E-Dave.Olig@gnf.com
Invoice Address 8025 Excelsior Dr Madison, WI 53717	Purchase Order # Tier 1, Per Siemens General Proc. Inv.
	Invoice Contact and Phone No. Dave Olig 608-836-1500

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes NO

For Compliance Monitoring? Yes No State: WI
(If Yes, please specify Agency or Regulation) Agency/Reg.: DNR

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1007057

Analyses Requested	Lab Use Only		
	Delivered by	Walk-in	Courier
Drinking Water	Shp. Cont. OK?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N
	Samples Leaking?	<input checked="" type="checkbox"/> Y	<input checked="" type="checkbox"/> N
	Seals OK?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N
	Rec'd on Ice?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N
	Sample Receiving Comments: 4°C		
	Comments		
	3 vials HCL		
	TB# 157 5/16/10		

Dunham

Lab Use Only	Sample		No. of Containers		Sample ID
	Date	Time	Comp	Grab	
-1	6-30	AM		3	CW-11
-2	}			3	CW-15
-3				3	CW-16
-4				3	CW-17
-5				3	CW-19
-6				3	Tower A
-7				3	Tower B
-8				3	Raw
-9				3	Finish Product
-10					

Relinquished By:	Date	Time	Received By:
<i>Dave Olig</i>	6-30-10	1:00	
	7-2-10	1408	<i>Jan Arden</i>

Chain of Custody Record

Reviewed djo 9/10/10

SIEMENS

July 19, 2010

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

Attn: Dave Olig

REPORT NO.: 1007052

PROJECT NO.: 34283.000, June 2010


Please find enclosed the analytical report, including the Sample Summary, Sample Narrative and Chain of Custody for your sample set received July 2, 2010.

All analyses were performed in accordance with NELAC Standards using approved methods as indicated on this report.

If you have any questions about the results, please call. Thank you for using Siemens Water Technologies for your analytical needs.

Sincerely,


Siemens Water Technologies



James Salkowski
Lab Director
Enviroscan Analytical™ Services

I certify that the data contained in this report has been generated and reviewed in accordance with the Siemens Water Technologies Quality Assurance Program. Exceptions, if any, are discussed in the sample narrative. Samples will be retained for 30 days from the date of this report, then disposed in an appropriate manner. Siemens Water Technologies Corp. reserves the right to return samples identified as hazardous. Release of this Final Report is authorized as verified by the following signature. The contents of this report apply to the sample(s) analyzed. No duplication of this report is allowed except in its entirety.

Reviewed by: _____



Certifications:

Wisconsin 737053130
Minnesota 055-999-302
Illinois 100317



Siemens Water Technologies Corp.

301 West Military Road
Rothschild, WI 54474

Tel: 800-338-7226
Fax: 715-355-3221
www.siemens.com/enviroscan

LABORATORY'S QUALITY VERIFICATION STATEMENT

Laboratory must provide a signed copy of this form with each deliverable specified in the Work Order or the deliverable will not be accepted. Laboratory must provide Gannett Fleming with a true copy of its internal QA/QC review and approval forms related to the deliverable.


This form must be signed by the Laboratory's Quality Control/Quality Assurance Officer

Project Name: National Presto Industries

Gannett Fleming Project Number: 34283-000

Deliverable Description: Analytical Report

I, Cindy Varga, warrant and represent that the project deliverable described above and attached to this form was developed in accordance with the project scope of work and that all elements relating to the quality of the deliverable were verified in accordance with the requirements of my firm's internal quality management/quality assurance system. This deliverable satisfies all requirements of our Contract with Gannett Fleming.

Signature: 
(by Laboratory's QC/QA Officer)

Date: 7/19/12

Laboratory: Siemens Water Technologies

'Deliverable' shall mean all aspects of design including, without limitation, drawings, calculations, maps, materials and specifications, reports, data bases, logs and other information developed from wells, borings and cores, laboratory data, materials schedules, instrument calibration data and all other items developed, prepared and delivered to Gannett Fleming by Contractor as specified in the Scope of Work in any media.

bw 10.2.09

SIEMENS

SAMPLE SUMMARY

<u>Lab Id</u>	<u>Client Sample Id</u>	<u>Date/Time</u>	<u>Matrix</u>
1007052-01	MW-66B	06/29/10 08:35	Ground Water
1007052-02	MW-65C	06/29/10 08:40	Ground Water
1007052-03	MW-65B	06/29/10 08:45	Ground Water
1007052-04	MW-64B	06/29/10 09:00	Ground Water
1007052-05	MW-64C	06/29/10 08:55	Ground Water
1007052-06	MW-70A	06/29/10 09:30	Ground Water
1007052-07	MW-68A	06/29/10 10:00	Ground Water
1007052-08	MW-68B	06/29/10 09:50	Ground Water
1007052-09	MW-4B	06/29/10 10:30	Ground Water
1007052-10	PW-3R	06/29/10 10:40	Ground Water
1007052-11	MW-23A	06/29/10 11:05	Ground Water
1007052-12	MW-23B	06/29/10 10:55	Ground Water
1007052-13	MW-23BDup	06/29/10 10:55	Ground Water
1007052-14	MW-23B MS	06/29/10 10:55	Ground Water
1007052-15	MW-23B MSD	06/29/10 10:55	Ground Water
1007052-16	RW-15	06/29/10 12:50	Ground Water
1007052-17	MW-38A	06/29/10 13:00	Ground Water
1007052-18	MW-38B	06/29/10 13:10	Ground Water
1007052-19	MW-38C	06/29/10 13:05	Ground Water
1007052-20	MW-29B	06/29/10 13:25	Ground Water
1007052-21	MW-43A	06/29/10 13:45	Ground Water
1007052-22	MW-43B	06/29/10 13:40	Ground Water
1007052-23	MW-41A	06/29/10 14:00	Ground Water
1007052-24	MW-41B	06/29/10 13:55	Ground Water
1007052-25	RW-16	06/29/10 14:15	Ground Water
1007052-26	RW-16C	06/29/10 14:10	Ground Water
1007052-27	RW-16C Dup	06/29/10 14:10	Ground Water
1007052-28	MW-45A	06/29/10 14:45	Ground Water
1007052-29	MW-45B	06/29/10 14:55	Ground Water
1007052-30	MW-45C	06/29/10 14:50	Ground Water
1007052-31	RW-16B	06/29/10 14:25	Ground Water
1007052-32	RW-16B Dup	06/29/10 14:25	Ground Water
1007052-33	RW-16B MS	06/29/10 14:25	Ground Water
1007052-34	RW-16B MSD	06/29/10 14:25	Ground Water
1007052-35	RW-3A	06/30/10 07:10	Ground Water
1007052-36	RW-3B	06/30/10 07:15	Ground Water
1007052-37	RW-3C	06/30/10 07:25	Ground Water
1007052-38	RW-3C Dup	06/30/10 07:25	Ground Water

SIEMENS

SAMPLE SUMMARY

<u>Lab Id</u>	<u>Client Sample Id</u>	<u>Date/Time</u>	<u>Matrix</u>
1007052-39	MW-53A	06/30/10 08:00	Ground Water
1007052-40	MW-53B	06/30/10 08:10	Ground Water
1007052-41	MW-53B Dup	06/30/10 08:10	Ground Water
1007052-42	EC-1	06/30/10 08:40	Ground Water
1007052-43	EC-2	06/30/10 08:55	Ground Water
1007052-44	MW-10A	06/30/10 12:00	Ground Water
1007052-45	MW-10B	06/30/10 12:15	Ground Water
1007052-46	MW-34B	06/30/10 12:45	Ground Water
1007052-47	EB	06/30/10 13:00	Ground Water
1007052-48	Trip Blank	06/30/10 00:00	Water

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-66B

Matrix: Ground Water

Sample Date/Time: 06/29/10 8:35

Lab No. : 1007052-01

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	1.12	ug/L	0.50	1.70	1	J	07/06/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/06/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/06/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/06/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		07/06/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-65C

Matrix: Ground Water

Sample Date/Time: 06/29/10 8:40

Lab No. : 1007052-02

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/06/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/06/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/06/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/06/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Trichloroethene	0.91	ug/L	0.40	1.30	1	J	07/06/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-65B

Matrix: Ground Water

Sample Date/Time: 06/29/10 8:45

Lab No. : 1007052-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/06/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/06/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/06/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/06/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Trichloroethene	0.52	ug/L	0.40	1.30	1	J	07/06/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-64B

Matrix: Ground Water

Sample Date/Time: 06/29/10 9:00

Lab No. : 1007052-04

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/06/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/06/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/06/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/06/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Trichloroethene	0.86	ug/L	0.40	1.30	1	J	07/06/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-64C

Matrix: Ground Water

Sample Date/Time: 06/29/10 8:55

Lab No. : 1007052-05

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/06/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/06/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/06/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/06/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Trichloroethene	0.76	ug/L	0.40	1.30	1	J	07/06/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-70A

Matrix: Ground Water

Sample Date/Time: 06/29/10 9:30

Lab No. : 1007052-06

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/06/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/06/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/06/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/06/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		07/06/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-68A

Matrix: Ground Water

Sample Date/Time: 06/29/10 10:00

Lab No. : 1007052-07

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/06/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/06/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/06/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/06/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		07/06/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-68B

Matrix: Ground Water

Sample Date/Time: 06/29/10 9:50

Lab No. : 1007052-08

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/06/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/06/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/06/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/06/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Trichloroethene	1.47	ug/L	0.40	1.30	1		07/06/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D : 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-4B

Matrix: Ground Water

Sample Date/Time: 06/29/10 10:30

Lab No. : 1007052-09

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	7.51	ug/L	0.50	1.70	1		07/06/10	MPM
1,1-Dichloroethane	2.28	ug/L	0.40	1.30	1		07/06/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/06/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/06/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/06/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Trichloroethene	0.91	ug/L	0.40	1.30	1	J	07/06/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: PW-3R

Matrix: Ground Water

Sample Date/Time: 06/29/10 10:40

Lab No. : 1007052-10

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/06/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/06/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/06/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/06/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		07/06/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-23A

Matrix: Ground Water

Sample Date/Time: 06/29/10 11:05

Lab No. : 1007052-11

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	0.52	ug/L	0.50	1.70	1	J	07/06/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/06/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/06/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/06/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Trichloroethene	2.59	ug/L	0.40	1.30	1		07/06/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-23B

Matrix: Ground Water

Sample Date/Time: 06/29/10 10:55

Lab No. : 1007052-12

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	0.62	ug/L	0.50	1.70	1	J	07/06/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/06/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/06/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/06/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Trichloroethene	3.28	ug/L	0.40	1.30	1		07/06/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-23BDup

Matrix: Ground Water

Sample Date/Time: 06/29/10 10:55

Lab No. : 1007052-13

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	0.65	ug/L	0.50	1.70	1	J	07/06/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/06/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/06/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/06/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/06/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/06/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/06/10	MPM
Trichloroethene	3.46	ug/L	0.40	1.30	1		07/06/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-23B MS

Matrix: Ground Water

Sample Date/Time: 06/29/10 10:55

Lab No. : 1007052-14

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	117	%	0.50	1.70	1		07/06/10	MPM
1,1-Dichloroethane	120	%	0.40	1.30	1		07/06/10	MPM
1,1-Dichloroethylene	122	%	0.40	1.30	1		07/06/10	MPM
Carbon Tetrachloride	106	%	0.30	1.00	1		07/06/10	MPM
Chloroform	117	%	0.20	0.67	1		07/06/10	MPM
m,p-Xylenes	102	%	0.40	1.30	1		07/06/10	MPM
Methylene Chloride	107	%	0.40	1.30	1		07/06/10	MPM
o-Xylene	100	%	0.20	0.67	1		07/06/10	MPM
Tetrachloroethene	106	%	0.30	1.00	1		07/06/10	MPM
Toluene	104	%	0.40	1.30	1		07/06/10	MPM
Trichloroethene	115	%	0.40	1.30	1		07/06/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D : 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-23B MSD

Matrix: Ground Water

Sample Date/Time: 06/29/10 10:55

Lab No. : 1007052-15

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	119	%	0.50	1.70	1		07/06/10	MPM
1,1-Dichloroethane	121	%	0.40	1.30	1		07/06/10	MPM
1,1-Dichloroethylene	122	%	0.40	1.30	1		07/06/10	MPM
Carbon Tetrachloride	102	%	0.30	1.00	1		07/06/10	MPM
Chloroform	119	%	0.20	0.67	1		07/06/10	MPM
m,p-Xylenes	101	%	0.40	1.30	1		07/06/10	MPM
Methylene Chloride	107	%	0.40	1.30	1		07/06/10	MPM
o-Xylene	97.4	%	0.20	0.67	1		07/06/10	MPM
Tetrachloroethene	105	%	0.30	1.00	1		07/06/10	MPM
Toluene	101	%	0.40	1.30	1		07/06/10	MPM
Trichloroethene	115	%	0.40	1.30	1		07/06/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Ollg

Sample ID: RW-15

Matrix: Ground Water

Sample Date/Time: 06/29/10 12:50

Lab No. : 1007052-16

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	0.68	ug/L	0.50	1.70	1	J	07/07/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/07/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/07/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/07/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Trichloroethene	5.24	ug/L	0.40	1.30	1		07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D : 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-38A

Matrix: Ground Water

Sample Date/Time: 06/29/10 13:00

Lab No. : 1007052-17

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/07/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/07/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/07/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/07/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Trichloroethene	1.21	ug/L	0.40	1.30	1	J	07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-38B

Matrix: Ground Water

Sample Date/Time: 06/29/10 13:10

Lab No. : 1007052-18

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	1.07	ug/L	0.50	1.70	1	J	07/07/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/07/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/07/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/07/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	0.30	ug/L	0.30	1.00	1	J	07/07/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Trichloroethene	4.93	ug/L	0.40	1.30	1		07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D : 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-38C

Matrix: Ground Water

Sample Date/Time: 06/29/10 13:05

Lab No. : 1007052-19

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/07/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/07/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/07/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/07/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Trichloroethene	2.59	ug/L	0.40	1.30	1		07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Ollg

Sample ID: MW-29B

Matrix: Ground Water

Sample Date/Time: 06/29/10 13:25

Lab No. : 1007052-20

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/07/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/07/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/07/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/07/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Trichloroethene	0.47	ug/L	0.40	1.30	1	J	07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D : 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-43A

Matrix: Ground Water

Sample Date/Time: 06/29/10 13:45

Lab No. : 1007052-21

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	1.43	ug/L	0.50	1.70	1	J	07/07/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/07/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Chloroform	0.35	ug/L	0.20	0.67	1	J	07/07/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/07/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Trichloroethene	4.80	ug/L	0.40	1.30	1		07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-43B

Matrix: Ground Water

Sample Date/Time: 06/29/10 13:40

Lab No. : 1007052-22

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	1.50	ug/L	0.50	1.70	1	J	07/07/10	MPM
1,1-Dichloroethane	0.47	ug/L	0.40	1.30	1	J	07/07/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	0.30	ug/L	0.30	1.00	1	J	07/07/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/07/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/07/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Trichloroethene	2.95	ug/L	0.40	1.30	1		07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-41A

Matrix: Ground Water

Sample Date/Time: 06/29/10 14:00

Lab No. : 1007052-23

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/07/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/07/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/07/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/07/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Trichloroethene	2.84	ug/L	0.40	1.30	1		07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-41B

Matrix: Ground Water

Sample Date/Time: 06/29/10 13:55

Lab No. : 1007052-24

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	0.58	ug/L	0.50	1.70	1	J	07/07/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/07/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/07/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/07/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Trichloroethene	3.77	ug/L	0.40	1.30	1		07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: RW-16

Matrix: Ground Water

Sample Date/Time: 06/29/10 14:15

Lab No. : 1007052-25

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/07/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/07/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/07/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/07/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Trichloroethene	1.56	ug/L	0.40	1.30	1		07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D : 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: RW-16C

Matrix: Ground Water

Sample Date/Time: 06/29/10 14:10

Lab No. : 1007052-28

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	0.51	ug/L	0.50	1.70	1	J	07/07/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/07/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/07/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/07/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Trichloroethene	3.86	ug/L	0.40	1.30	1		07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: RW-16C Dup

Matrix: Ground Water

Sample Date/Time: 06/29/10 14:10

Lab No. : 1007052-27

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	0.50	ug/L	0.50	1.70	1	J	07/07/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/07/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/07/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/07/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Trichloroethene	3.91	ug/L	0.40	1.30	1		07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-45A

Matrix: Ground Water

Sample Date/Time: 06/29/10 14:45

Lab No. : 1007052-28

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/07/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/07/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/07/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/07/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Trichloroethene	0.57	ug/L	0.40	1.30	1	J	07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-45B

Matrix: Ground Water

Sample Date/Time: 06/29/10 14:55

Lab No. : 1007052-29

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	0.58	ug/L	0.50	1.70	1	J	07/07/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/07/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Chloroform	0.53	ug/L	0.20	0.67	1	J	07/07/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/07/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Trichloroethene	4.09	ug/L	0.40	1.30	1		07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D : 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-45C

Matrix: Ground Water

Sample Date/Time: 06/29/10 14:50

Lab No. : 1007052-30

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	0.54	ug/L	0.50	1.70	1	J	07/07/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/07/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Chloroform	0.39	ug/L	0.20	0.67	1	J	07/07/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/07/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Trichloroethene	3.64	ug/L	0.40	1.30	1		07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: RW-16B

Matrix: Ground Water

Sample Date/Time: 06/29/10 14:25

Lab No. : 1007052-31

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	0.78	ug/L	0.50	1.70	1	J	07/07/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1	S2H, S1H	07/07/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/07/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/07/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	t		07/07/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Trichloroethene	4.94	ug/L	0.40	1.30	1		07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D : 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: RW-16B Dup

Matrix: Ground Water

Sample Date/Time: 06/29/10 14:25

Lab No. : 1007052-32

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	0.69	ug/L	0.50	1.70	1	J	07/07/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/07/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/07/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/07/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Trichloroethene	4.88	ug/L	0.40	1.30	1		07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: RW-16B MS

Matrix: Ground Water

Sample Date/Time: 06/29/10 14:25

Lab No. : 1007052-33

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	128	%	0.50	1.70	1		07/07/10	MPM
1,1-Dichloroethane	131	%	0.40	1.30	1	S1H	07/07/10	MPM
1,1-Dichloroethylene	131	%	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	108	%	0.30	1.00	1		07/07/10	MPM
Chloroform	129	%	0.20	0.67	1		07/07/10	MPM
m,p-Xylenes	97.4	%	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	120	%	0.40	1.30	1		07/07/10	MPM
o-Xylene	94.1	%	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	108	%	0.30	1.00	1		07/07/10	MPM
Toluene	106	%	0.40	1.30	1		07/07/10	MPM
Trichloroethene	115	%	0.40	1.30	1		07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attrn: Dave Ollg

Sample ID: RW-16B MSD

Matrix: Ground Water

Sample Date/Time: 06/29/10 14:25

Lab No. : 1007052-34

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	128	%	0.50	1.70	1		07/07/10	MPM
1,1-Dichloroethane	131	%	0.40	1.30	1	S2H	07/07/10	MPM
1,1-Dichloroethylene	131	%	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	109	%	0.30	1.00	1		07/07/10	MPM
Chloroform	130	%	0.20	0.67	1		07/07/10	MPM
m,p-Xylenes	96.8	%	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	117	%	0.40	1.30	1		07/07/10	MPM
o-Xylene	94.4	%	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	114	%	0.30	1.00	1		07/07/10	MPM
Toluene	109	%	0.40	1.30	1		07/07/10	MPM
Trichloroethene	112	%	0.40	1.30	1		07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: RW-3A

Matrix: Ground Water

Sample Date/Time: 06/30/10 7:10

Lab No. : 1007052-35

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/07/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/07/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Chloroform	0.72	ug/L	0.20	0.67	1		07/07/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/07/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Trichloroethene	2.73	ug/L	0.40	1.30	1		07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D : 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: RW-3B

Matrix: Ground Water

Sample Date/Time: 06/30/10 7:15

Lab No. : 1007052-36

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	0.76	ug/L	0.50	1.70	1	J	07/07/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/07/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Chloroform	0.42	ug/L	0.20	0.67	1	J	07/07/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/07/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Toluene	ND	ug/L	0.40	1.30	t		07/07/10	MPM
Trichloroethene	5.18	ug/L	0.40	1.30	1		07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: RW-3C

Matrix: Ground Water

Sample Date/Time: 06/30/10 7:25

Lab No. : 1007052-37

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	0.88	ug/L	0.50	1.70	1	J	07/07/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/07/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Chloroform	0.37	ug/L	0.20	0.67	1	J	07/07/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/07/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Trichloroethene	6.05	ug/L	0.40	1.30	1		07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D : 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: RW-3C Dup

Matrix: Ground Water

Sample Date/Time: 06/30/10 7:25

Lab No. : 1007052-38

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	0.91	ug/L	0.50	1.70	1	J	07/07/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/07/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Chloroform	0.39	ug/L	0.20	0.67	1	J	07/07/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/07/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Trichloroethene	5.96	ug/L	0.40	1.30	1		07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D : 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-53A

Matrix: Ground Water

Sample Date/Time: 06/30/10 8:00

Lab No. : 1007052-39

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/07/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/07/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Chloroform	0.33	ug/L	0.20	0.67	1	J	07/07/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/07/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	0.30	ug/L	0.30	1.00	1	J	07/07/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Trichloroethene	2.95	ug/L	0.40	1.30	1		07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D : 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-53B

Matrix: Ground Water

Sample Date/Time: 06/30/10 8:10

Lab No. : 1007052-40

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	0.52	ug/L	0.50	1.70	1	J	07/07/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/07/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Chloroform	0.51	ug/L	0.20	0.67	1	J	07/07/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/07/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Trichloroethene	3.93	ug/L	0.40	1.30	1		07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D : 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-53B Dup

Matrix: Ground Water

Sample Date/Time: 06/30/10 8:10

Lab No. : 1007052-41

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	0.57	ug/L	0.50	1.70	1	J	07/07/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/07/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Chloroform	0.53	ug/L	0.20	0.67	1	J	07/07/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/07/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Trichloroethene	3.83	ug/L	0.40	1.30	1		07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D : 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: EC-1

Matrix: Ground Water

Sample Date/Time: 06/30/10 8:40

Lab No. : 1007052-42

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/07/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/07/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Chloroform	0.52	ug/L	0.20	0.67	1	J	07/07/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/07/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/07/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/07/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/07/10	MPM
Trichloroethene	2.11	ug/L	0.40	1.30	1		07/07/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: EC-2

Matrix: Ground Water

Sample Date/Time: 06/30/10 8:55

Lab No. : 1007052-43

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/08/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/08/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/08/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/08/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/08/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/08/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/08/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/08/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/08/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/08/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		07/08/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D : 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-10A

Matrix: Ground Water

Sample Date/Time: 06/30/10 12:00

Lab No. : 1007052-44

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 6020 - Diss.</u> Dissolved Cadmium	29.8	ug/L	0.20	2.00	1		07/09/10	JCH

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D : 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-10B

Matrix: Ground Water

Sample Date/Time: 06/30/10 12:15

Lab No. : 1007052-45

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 6020 - Diss.</u> Dissolved Cadmium	18.3	ug/L	0.20	2.00	1		07/09/10	JCH

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-34B

Matrix: Ground Water

Sample Date/Time: 06/30/10 12:45

Lab No. : 1007052-46

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 6020 - Diss.</u> Dissolved Cadmium	1.62	ug/L	0.20	2.00	1	J	07/09/10	JCH

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: EB

Matrix: Ground Water

Sample Date/Time: 06/30/10 13:00

Lab No. : 1007052-47

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/08/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/08/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/08/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/08/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/08/10	MPM
m,p-Xylenes	2.92	ug/L	0.40	1.30	1		07/08/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/08/10	MPM
o-Xylene	1.58	ug/L	0.20	0.67	1		07/08/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/08/10	MPM
Toluene	4.41	ug/L	0.40	1.30	1		07/08/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		07/08/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000, June 2010
REPORT NO. : 1007052
DATE REC'D 07/02/10 14:19
REPORT DATE : 07/19/10 09:17
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: Trip Blank

Matrix: Water

Sample Date/Time: 06/30/10 0:00

Lab No. : 1007052-48

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		07/08/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		07/08/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		07/08/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		07/08/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		07/08/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		07/08/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		07/08/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		07/08/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		07/08/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		07/08/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		07/08/10	MPM

SIEMENS

Qualifier Descriptions

S2H	Second sample matrix spike recovery was high.
S1H	First sample matrix spike recovery was high.
J	Estimated concentration below laboratory quantitation level.

Definitions

LOD = Limit of Detection (Dilution Corrected)
LOQ = Limit of Quantitation (Dilution Corrected)
Reporting Limit = LOQ (Dilution Corrected)
ND = Not Detected
COMP = Complete
SUBCON = Subcontracted analysis
mv = millivolts
pci/L = picocuries per Liter
mL/L = milliliters per Liter
mg = milligram

When the word "dry" follows the units on the result page the sample results are dry weight corrected.

LODs and LOQs are dry weight corrected for all soils except WI GRO, EPA 8021 and WI DNR/EPA 8260B methanol and WI DNR methylene chloride preserved soils being reported to the State of Wisconsin.

ug/l = Micrograms per Liter = parts per billion (ppb)
ug/kg = Micrograms per kilogram = parts per billion (ppb)
mg/l = Milligrams per liter = parts per million (ppm)
mg/kg = Milligrams per kilogram = parts per million (ppm)
NOT PRES = Not Present
ppth = Parts per thousand
* = Result outside established limits.
mg/m³ = Milligrams per meter cubed
ng/L = Nanograms per Liter = Parts per trillion (ppt)
> = Greater Than

State of Wisconsin Methanol Soils for WI GRO, WI DNR/EPA 8260B and EPA 8021 are reported to the LOQ.

Company Name Gannett Fleming	% Marcia A Kuehl (Data Validation)	Project National Prosto Ind 34283-000
Report Mailing Address 8025 Excelsior Dr Madison, WI 53774	M A Kuehl Co. 3470 Charlevonix Ct Green Bay, WI	Contact Name, Phone, Fax, Email Dave Otig P. 608-836-1500 F 608-831-3337 E D.Otig@gnnet.com
Invoice Address Same as Report to		Purchase Order # Per 2010 Siemens Price Quote
		Invoice Contact and Phone No. See Contact

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: WI
(If Yes, please specify Agency or Regulation) Agency/Reg.: WIND

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1007052

Analyses Requested										Lab Use Only			
VOCs NPI Short List											Delivered by	Walk-in	<u>Courier</u>
											Ship. Cont. Ok?	<u>Y</u>	N NA
											Samples Leaking?	<u>Y</u>	N NA
											Seals OK?	<u>Y</u>	N NA
											Rec'd on Ice?	<u>Y</u>	N NA
	Sample Receiving Comments:										4°C		
	Comments												

Dunham

Lab Use Only	Sample		No. of Containers		Sample ID	VOCs NPI	Short List												
	Date	Time	Comp	Grab															
-1	6/24/10	8:35		3	MW-66B	X													3 vials HCL
-2	}	8:40		3	MW-65C	X													
-3		8:45		3	MW-65B	X													
-4		9:00		3	MW-64B	X													
-5		8:55		3	MW-64C	X													
-6		9:30		3	MW-70A	X													
-7		10:00		3	MW-68A	X													
-8		9:50		3	MW-68B	X													
-9		10:30		3	MW-4B	X													
-10		10:40		3	PW-3R	X													

Chain of Custody Record

Relinquished By:	Date	Time	Received By:
<u>David Dell</u>	6/30/10	1100	
	7-210	1419	<u>Jim Fisher</u>

Company Name <i>See Page 1</i>		Project <i>34283-000</i>	
Report Mailing Address		Contact Name, Phone, Fax, Email	
Invoice Address	Purchase Order #	Invoice Contact and Phone No.	

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: WI
 (If Yes, please specify Agency or Regulation) Agency/Reg.: WDNR

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
 Date Needed: _____

WO No. 1007052

Analyses Requested		Lab Use Only		
(VOC, NPI Short List) Lab Not Performed		Delivered by	Walk-in	<u>Courier</u>
		Ship. Cont. OK?	<input checked="" type="checkbox"/>	N <input type="checkbox"/> NA <input type="checkbox"/>
		Samples Leaking?	<input checked="" type="checkbox"/>	N <input type="checkbox"/> NA <input type="checkbox"/>
		Seals OK?	<input checked="" type="checkbox"/>	N <input type="checkbox"/> NA <input type="checkbox"/>
		Rec'd on Ice?	<input type="checkbox"/>	N <input type="checkbox"/> NA <input type="checkbox"/>
		Sample Receiving Comments: <i>4°C</i>		

Dunham

Lab Use Only	Sample		No. of Containers		Sample ID	Comments
	Date	Time	Comp	Grab		
-11	6:40	11:05		3	MW-23A	3 vials HCl
-12		10:55		3	MW-23B	
-13		10:55		3	MW-23B DW	
-14		10:55		2	MW-23B MS	2 vials HCl
-15		10:55		2	MW-23B MSD	
-16		12:50		3	RW-15	3 vials
-17		1:00		3	MW-38A	3 vials
-18		1:10		3	MW-38B	
-19		1:05		3	MW-38C	
-20		1:25		3	MW-24B	

Relinquished By:	Date	Time	Received By:
<i>David D. Dull</i>	6-30-10	1:00	
	7-2-10	1419	<i>Steve Fisher</i>

Chain of Custody Record

Company Name Garnett Fleming		Project 34283-000	
Report Mailing Address See Page 1		Contact Name, Phone, Fax, Email	
Invoice Address		Purchase Order #	Invoice Contact and Phone No.

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to UAC? Yes No

For Compliance Monitoring? Yes No State: WI
(If Yes, please specify Agency or Regulation) Agency/Reg.: WDR

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1007052

Analyses Requested						Lab Use Only		
VOCs CMT Short List						Delivered by	Walk-in	<u>Courier</u>
						Ship. Cont. Ok?	<u>Y</u>	N NA
						Samples Leaking?	<u>Y</u>	<u>N</u> NA
						Seals OK?	<u>Y</u>	N NA
						Rec'd on Ice?	<u>Y</u>	N NA
Sample Receiving Comments: 4°C								
Comments								

Lab Use Only	Sample		No. of Containers		Sample ID	VOCs CMT Short List							
	Date	Time	Comp	Grab									
-21	6/21/10	1:45		3	MW-43A	X							3 vials HCL
-22		1:40		3	MW-43B	X							
-23		2:00		3	MW-41A	X							
-24		1:55		3	MW-41B	X							
-25		2:15		3	Rw-1b	X							
-26		2:10		3	Rw-1bC	X							
-27		2:10		3	Rw-1bC DUP	X							
-28		2:45		3	MW-45A	X							
-29		2:55		3	MW-45B	X							
-30		2:50		3	MW-45C	X							

Relinquished By:	Date	Time	Received By:
Donald Dull	6-30-10	1:00	
	7-2-10	1419	Seem Anderson

Chain of Custody Record

Company Name Gannett Fleming		Project 34283-000	
Report Mailing Address See Page 1		Contact Name, Phone, Fax, Email	
Invoice Address ↓		Purchase Order #	Invoice Contact and Phone No.

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: WI
(If Yes, please specify Agency or Regulation) Agency/Reg.: LDNR

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1007052

Analyses Requested		Lab Use Only		
VOCs NPI Short List		Delivered by	Walk-in	<u>Courier</u> <i>Dunham</i>
		Ship. Cont. Ok?	<input checked="" type="radio"/> Y	<input type="radio"/> N NA
		Samples Leaking?	<input type="radio"/> Y	<input checked="" type="radio"/> N NA
		Seals OK?	<input checked="" type="radio"/> Y	<input type="radio"/> N NA
		Rec'd on Ice?	<input checked="" type="radio"/> Y	<input type="radio"/> N NA
		Sample Receiving Comments: 4°C		

Lab Use Only	Sample		No. of Containers		Sample ID	Comments
	Date	Time	Comp	Grab		
-31	6:20	2:25		3	Rw-16B	3 vials HCL
-32		2:25		3	Rw-16B DUP	
-33		2:25		2	Rw-16B MS	
-34		2:25		2	Rw-16B MSD	
-35	6:30	7:10		3	Rw-3A	
-36		7:15		3	Rw-3B	
-37		7:25		3	Rw-3C	
-38		7:25		3	Rw-3C DUP	
-39		8:00		3	MW-53A	
-40		8:10		3	MW-53B	

Relinquished By:	Date	Time	Received By:
<i>Daniel Dull</i>	6-30	11:00	
	6-21	14:19	<i>Jim Ad...</i>

Chain of Custody Record

Company Name Garnett Flaming		Project 34283-000	
Report Mailing Address See Page 1		Contact Name, Phone, Fax, Email	
Invoice Address A		Purchase Order #	Invoice Contact and Phone No.

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wts. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: WI
(If Yes, please specify Agency or Regulation) Agency/Reg.: CDMR

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1007052

Analyses Requested						Lab Use Only		
VCS WFS Dissolved Cadmium						Delivered by	Walk-in	Courier
						Shp. Cont. OK?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
						Samples Leaking?	<input type="checkbox"/>	<input checked="" type="checkbox"/>
						Seals OK?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
						Rec'd on Ice?	<input type="checkbox"/>	<input type="checkbox"/>
						Sample Receiving Comments:		
						42		
						Comments		

Lab Use Only	Sample		No. of Containers		Sample ID
	Date	Time	Comp	Grab	
-41	6-30-10	8:10		3	MW-53B DUP
-42	}	8:40		3	EC-1
-43		8:55		3	EC-2
-44		12:00		1	MW-10A
-45		12:15		1	MW-10B
-46		12:45		1	MW-34B
-47	↓	1:00		3	EB
-48					Trip Blank

Relinquished By:	Date	Time	Received By:
<i>David Dool</i>	6-30-10	1:00	
	7-2-10	1419	<i>Jessie Arden</i>

Chain of Custody Record

SIEMENS

October 18, 2010

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

Attn: Dave Olig

RECEIVED	
GANNETT FLEMING-MADISON, WI	
FILE NO:	34283.000 (NPI)
OCT 21 2010	
REVIEWED BY:	<i>[Signature]</i>
DATE:	10/21/10
ROUTE TO:	<i>[Signature]</i>

REPORT NO.: 1010132

PROJECT NO.: 34283.000


Please find enclosed the analytical report, including the Sample Summary, Sample Narrative and Chain of Custody for your sample set received October 7, 2010.

All analyses were performed in accordance with NELAC Standards using approved methods as indicated on this report.

If you have any questions about the results, please call. Thank you for using Siemens Water Technologies for your analytical needs.

Sincerely,


Siemens Water Technologies



James Salkowski
Lab Director
Enviroscan Analytical™ Services
Cc: Marcla Kuehl - MA Kuehl Co.

I certify that the data contained in this report has been generated and reviewed in accordance with the Siemens Water Technologies Quality Assurance Program. Exceptions, if any, are discussed in the sample narrative. Samples will be retained for 30 days from the date of this report, then disposed in an appropriate manner. Siemens Water Technologies Corp. reserves the right to return samples identified as hazardous. Release of this Final Report is authorized as verified by the following signature. The contents of this report apply to the sample(s) analyzed. No duplication of this report is allowed except in its entirety.

Reviewed by:



Certifications:

Wisconsin 737053130
Minnesota 055-999-302
Illinois 100317



Siemens Water Technologies Corp.

301 West Military Road
Rothschild, WI 54474
www.siemens.com/enviroscan

Tel: 800-338-7226
Fax: 715-355-3221

LABORATORY'S QUALITY VERIFICATION STATEMENT

Laboratory must provide a signed copy of this form with each deliverable specified in the Work Order or the deliverable will not be accepted. Laboratory must provide Gannett Fleming with a true copy of its internal QA/QC review and approval forms related to the deliverable.


This form must be signed by the Laboratory's Quality Control/Quality Assurance Officer

Project Name: NPI

Gannett Fleming Project Number: 34283.000

Deliverable Description: Analytical Report

I, Cindy Varga, warrant and represent that the project deliverable described above and attached to this form was developed in accordance with the project scope of work and that all elements relating to the quality of the deliverable were verified in accordance with the requirements of my firm's internal quality management/quality assurance system. This deliverable satisfies all requirements of our Contract with Gannett Fleming.

Signature: 
(by Laboratory's QC/QA Officer)

Date: 10/18/0

Laboratory: Siemens Water Technologies

'Deliverable' shall mean all aspects of design including, without limitation, drawings, calculations, maps, materials and specifications, reports, data bases, logs and other information developed from wells, borings and cores, laboratory data, materials schedules, instrument calibration data and all other items developed, prepared and delivered to Gannett Fleming by Contractor as specified in the Scope of Work in any media.

bw 10.2.09

SIEMENS

SAMPLE SUMMARY

<u>Lab Id</u>	<u>Client Sample Id</u>	<u>Date/Time</u>	<u>Matrix</u>
1010132-01	MW-17B	10/04/10 12:20	Ground Water
1010132-02	MW-17C	10/04/10 12:25	Ground Water
1010132-03	MW-72	10/04/10 12:30	Ground Water
1010132-04	MW-73	10/04/10 12:35	Ground Water
1010132-05	MW-6	10/04/10 13:10	Ground Water
1010132-06	MW-66A	10/04/10 13:30	Ground Water
1010132-07	MW-66B	10/04/10 13:45	Ground Water
1010132-08	MW-66C	10/04/10 13:40	Ground Water
1010132-09	MW-62A	10/04/10 14:10	Ground Water
1010132-10	MW-62A Dup	10/04/10 14:15	Ground Water
1010132-11	MW-62B	10/04/10 14:25	Ground Water
1010132-12	MW-62C	10/04/10 14:30	Ground Water
1010132-13	MW-5A	10/04/10 14:35	Ground Water
1010132-14	MW-5B	10/04/10 14:40	Ground Water
1010132-15	MW-63A	10/04/10 14:55	Ground Water
1010132-16	MW-63A MS	10/04/10 15:00	Ground Water
1010132-17	MW-63A MSD	10/04/10 15:00	Ground Water
1010132-18	MW-63B	10/04/10 15:05	Ground Water
1010132-19	MW-65A	10/04/10 15:15	Ground Water
1010132-20	MW-65B	10/04/10 15:25	Ground Water
1010132-21	MW-65C	10/04/10 15:30	Ground Water
1010132-22	MW-64A	10/04/10 15:45	Ground Water
1010132-23	MW-64B	10/04/10 15:50	Ground Water
1010132-24	MW-64C	10/04/10 15:55	Ground Water
1010132-25	MW-76A	10/04/10 10:30	Ground Water
1010132-26	MW-76B	10/04/10 10:35	Ground Water
1010132-27	MW-77A	10/04/10 10:40	Ground Water
1010132-28	MW-77B	10/04/10 10:42	Ground Water
1010132-29	MW-77C	10/04/10 10:45	Ground Water
1010132-30	MW-76A Dup	10/04/10 10:30	Ground Water
1010132-31	MW-9A	10/04/10 16:20	Ground Water
1010132-32	MW-9B	10/04/10 16:25	Ground Water
1010132-33	MW-68B	10/05/10 08:10	Ground Water
1010132-34	MW-74A	10/05/10 08:20	Ground Water
1010132-35	MW-23A	10/05/10 08:55	Ground Water
1010132-36	MW-23B	10/05/10 09:00	Ground Water
1010132-37	MW-69A	10/05/10 09:10	Ground Water
1010132-38	MW-69B	10/05/10 09:15	Ground Water

SAMPLE SUMMARY

<u>Lab Id</u>	<u>Client Sample Id</u>	<u>Date/Time</u>	<u>Matrix</u>
1010132-39	MW-38B	10/05/10 09:40	Ground Water
1010132-40	Trip Blank	10/04/10 00:00	Water
1010132-41	RW-16B	10/05/10 13:00	Ground Water
1010132-42	RW-16B Dup	10/05/10 13:05	Ground Water
1010132-43	MW-52B	10/05/10 14:30	Ground Water
1010132-44	MW-52B MS	10/05/10 14:35	Ground Water
1010132-45	MW-52B MSD	10/05/10 14:40	Ground Water
1010132-46	MW-51B	10/05/10 14:50	Ground Water
1010132-47	RW-3B	10/05/10 15:15	Ground Water
1010132-48	RW-3C	10/05/10 15:25	Ground Water
1010132-49	EC-1	10/05/10 16:00	Ground Water
1010132-50	Trip Blank	10/05/10 00:00	Water
1010132-51	EC-2	10/05/10 16:05	Ground Water
1010132-52	EC-5	10/05/10 16:10	Ground Water
1010132-53	EC-6	10/05/10 15:50	Ground Water
1010132-54	MW-10A	10/06/10 07:45	Ground Water
1010132-55	MW-10B	10/06/10 07:55	Ground Water
1010132-56	MW-11A	10/06/10 08:00	Ground Water
1010132-57	MW-34A	10/06/10 08:10	Ground Water
1010132-58	Trip Blank	10/06/10 00:00	Water
1010132-59	MW-77C MS	10/04/10 10:45	Ground Water
1010132-60	MW-77C MSD	10/04/10 10:45	Ground Water

SIEMENS

(net Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-17B

Matrix: Ground Water

Sample Date/Time: 10/04/10 12:20

Lab No. : 1010132-01

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1	CSH	10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1	CSH	10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

net Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-17C

Matrix: Ground Water

Sample Date/Time: 10/04/10 12:25

Lab No. : 1010132-02

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1	CSH	10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1	CSH	10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

Nett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-72

Matrix: Ground Water

Sample Date/Time: 10/04/10 12:30

Lab No. : 1010132-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1	CSH	10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1	CSH	10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

() nnett Fleming, Inc.
 8025 Excelsior Drive
 Madison, WI 53717

PROJECT NO. : 34283.000
 REPORT NO. : 1010132
 DATE REC'D 10/07/10 15:23
 REPORT DATE : 10/18/10 08:37
 PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-73

Matrix: Ground Water

Sample Date/Time: 10/04/10 12:35

Lab No. : 1010132-04

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
t,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1	CSH	10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	0.46	ug/L	0.30	1.00	1	CSH, J	10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

W. H. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-6

Matrix: Ground Water

Sample Date/Time: 10/04/10 13:10

Lab No. : 1010132-05

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1	CSH	10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1	CSH	10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

W. J. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-66A

Matrix: Ground Water

Sample Date/Time: 10/04/10 13:30

Lab No. : 1010132-06

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1	CSH	10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1	CSH	10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

() ett Fleming, Inc.
 8025 Excelsior Drive
 Madison, WI 53717

PROJECT NO. : 34283.000
 REPORT NO. : 1010132
 DATE REC'D 10/07/10 15:23
 REPORT DATE : 10/18/10 08:37
 PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-66B

Matrix: Ground Water

Sample Date/Time: 10/04/10 13:45

Lab No. : 1010132-07

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	0.81	ug/L	0.50	1.70	1	J	10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1	CSH	10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1	CSH	10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	0.49	ug/L	0.40	1.30	1	J	10/08/10	MRD

SIEMENS

Robert Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-66C

Matrix: Ground Water

Sample Date/Time: 10/04/10 13:40

Lab No. : 1010132-08

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1	CSH	10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1	CSH	10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

Watt Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-62A

Matrix: Ground Water

Sample Date/Time: 10/04/10 14:10

Lab No. : 1010132-09

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	1.33	ug/L	0.50	1.70	1	J	10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
t,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1	CSH	10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1	CSH	10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

W. H. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-62A Dup

Matrix: Ground Water

Sample Date/Time: 10/04/10 14:15

Lab No. : 1010132-10

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	1.17	ug/L	0.50	1.70	1	J	10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1	CSH	10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1	CSH	10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

W. H. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-62B

Matrix: Ground Water

Sample Date/Time: 10/04/10 14:25

Lab No. : 1010132-11

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1	CSH	10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1	CSH	10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

Wett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-62C

Matrix: Ground Water

Sample Date/Time: 10/04/10 14:30

Lab No. : 1010132-12

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

W. H. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-5A

Matrix: Ground Water

Sample Date/Time: 10/04/10 14:35

Lab No. : 1010132-13

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	2.09	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

W. H. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-5B

Matrix: Ground Water

Sample Date/Time: 10/04/10 14:40

Lab No. : 1010132-14

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

W. H. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-63A

Matrix: Ground Water

Sample Date/Time: 10/04/10 14:55

Lab No. : 1010132-15

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1	S1H, S2H	10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1	S1H, S2H	10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1	DUP	10/08/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

Jeff Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-63A MS

Matrix: Ground Water

Sample Date/Time: 10/04/10 15:00

Lab No. : 1010132-16

	<u>Results</u>	<u>Recovery</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	128	%	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	118	%	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	138	%	0.40	1.30	1	S1H	10/08/10	MRD
Carbon Tetrachloride	126	%	0.30	1.00	1		10/08/10	MRD
Chloroform	120	%	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	92.2	%	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	130	%	0.40	1.30	1	CSH, S1H	10/08/10	MRD
o-Xylene	90.0	%	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	126	%	0.30	1.00	1	CSH	10/08/10	MRD
Toluene	106	%	0.40	1.30	1	DUP	10/08/10	MRD
Trichloroethene	110	%	0.40	1.30	1		10/08/10	MRD

SIEMENS

W. R. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-63A MSD

Matrix: Ground Water

Sample Date/Time: 10/04/10 15:00

Lab No. : 1010132-17

	<u>Results</u>	<u>Recovery</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	134	%	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	124	%	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	146	%	0.40	1.30	1	S2H	10/08/10	MRD
Carbon Tetrachloride	132	%	0.30	1.00	1		10/08/10	MRD
Chloroform	124	%	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	97.2	%	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	131	%	0.40	1.30	1	CSH, S2H	10/08/10	MRD
o-Xylene	94.0	%	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	134	%	0.30	1.00	1	CSH	10/08/10	MRD
Toluene	114	%	0.40	1.30	1	DUP	10/08/10	MRD
Trichloroethene	114	%	0.40	1.30	1		10/08/10	MRD

SIEMENS

Metz Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-63B

Matrix: Ground Water

Sample Date/Time: 10/04/10 15:05

Lab No. : 1010132-18

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

nett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-65A

Matrix: Ground Water

Sample Date/Time: 10/04/10 15:15

Lab No. : 1010132-19

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

W. H. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-65B

Matrix: Ground Water

Sample Date/Time: 10/04/10 15:25

Lab No. : 1010132-20

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	0.41	ug/L	0.40	1.30	1	J	10/08/10	MRD

SIEMENS

Nett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-65C

Matrix: Ground Water

Sample Date/Time: 10/04/10 15:30

Lab No. : 1010132-21

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	0.74	ug/L	0.40	1.30	1	J	10/08/10	MRD

SIEMENS

() nett Fleming, Inc.
 8025 Excelsior Drive
 Madison, WI 53717

PROJECT NO. : 34283.000
 REPORT NO. : 1010132
 DATE REC'D : 10/07/10 15:23
 REPORT DATE : 10/18/10 08:37
 PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-64A

Matrix: Ground Water

Sample Date/Time: 10/04/10 15:45

Lab No. : 1010132-22

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

nettt Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-64B

Matrix: Ground Water

Sample Date/Time: 10/04/10 15:50

Lab No. : 1010132-23

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	0.63	ug/L	0.40	1.30	1	J	10/08/10	MRD

SIEMENS

() nett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-64C

Matrix: Ground Water

Sample Date/Time: 10/04/10 15:55

Lab No. : 1010132-24

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	0.71	ug/L	0.40	1.30	1	J	10/08/10	MRD

SIEMENS

W. H. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-76A

Matrix: Ground Water

Sample Date/Time: 10/04/10 10:30

Lab No. : 1010132-25

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	15.1	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	0.63	ug/L	0.20	0.67	1	J	10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/08/10	MRD
o-Xylene	1.29	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	9.28	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

W. J. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-76B

Matrix: Ground Water

Sample Date/Time: 10/04/10 10:35

Lab No. : 1010132-26

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	1.54	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

Wett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-77A

Matrix: Ground Water

Sample Date/Time: 10/04/10 10:40

Lab No. : 1010132-27

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	0.21	ug/L	0.20	0.67	1	J	10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

W. H. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-77B

Matrix: Ground Water

Sample Date/Time: 10/04/10 10:42

Lab No. : 1010132-28

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
t,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	0.26	ug/L	0.20	0.67	1	J	10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	1.53	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

W. H. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-77C

Matrix: Ground Water

Sample Date/Time: 10/04/10 10:45

Lab No. : 1010132-29

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	0.53	ug/L	0.40	1.30	1	J	10/08/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/25/10 08:46
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-76A Dup

Matrix: Ground Water

Sample Date/Time: 10/04/10 10:30

Lab No. : 1010132-30

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	17.0	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	0.57	ug/L	0.20	0.67	1	J	10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/08/10	MRD
o-Xylene	1.61	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	0.39	ug/L	0.30	1.00	1	J	10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	10.4	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

W. J. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-9A

Matrix: Ground Water

Sample Date/Time: 10/04/10 16:20

Lab No. : 1010132-31

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

W. H. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-9B

Matrix: Ground Water

Sample Date/Time: 10/04/10 16:25

Lab No. : 1010132-32

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

Watt Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-68B

Matrix: Ground Water

Sample Date/Time: 10/05/10 8:10

Lab No. : 1010132-33

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/08/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/08/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/08/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Trichloroethene	1.48	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

()ett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-74A

Matrix: Ground Water

Sample Date/Time: 10/05/10 8:20

Lab No. : 1010132-34

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/11/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/11/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/11/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/11/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/11/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/11/10	MRD

SIEMENS

W. H. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-23A

Matrix: Ground Water

Sample Date/Time: 10/05/10 8:55

Lab No. : 1010132-35

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/11/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/11/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/11/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/11/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/11/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Trichloroethene	2.36	ug/L	0.40	1.30	1		10/11/10	MRD

SIEMENS

Flett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-23B

Matrix: Ground Water

Sample Date/Time: 10/05/10 9:00

Lab No. : 1010132-36

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	0.62	ug/L	0.50	1.70	1	J	10/11/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/11/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/11/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/11/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/11/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Trichloroethene	2.93	ug/L	0.40	1.30	1		10/11/10	MRD

SIEMENS

W. J. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-69A

Matrix: Ground Water

Sample Date/Time: 10/05/10 9:10

Lab No. : 1010132-37

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/11/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/11/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Chloroform	0.54	ug/L	0.20	0.67	1	J	10/11/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/11/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/11/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/11/10	MRD

SIEMENS

W. J. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-69B

Matrix: Ground Water

Sample Date/Time: 10/05/10 9:15

Lab No. : 1010132-38

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/11/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/11/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Chloroform	1.04	ug/L	0.20	0.67	1		10/11/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/11/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/11/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/11/10	MRD

SIEMENS

W. H. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-38B

Matrix: Ground Water

Sample Date/Time: 10/05/10 9:40

Lab No. : 1010132-39

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	1.04	ug/L	0.50	1.70	1	J	10/11/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/11/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/11/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/11/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/11/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Trichloroethene	4.73	ug/L	0.40	1.30	1		10/11/10	MRD

SIEMENS

Nett Fleming, Inc.
8000 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: Trip Blank

Matrix: Water

Sample Date/Time: 10/04/10 0:00

Lab No. : 1010132-40

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/11/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/11/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/11/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/11/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/11/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/11/10	MRD

SIEMENS

C. J. Fleming, Inc.
 8025 Excelsior Drive
 Madison, WI 53717

PROJECT NO. : 34283.000
 REPORT NO. : 1010132
 DATE REC'D : 10/07/10 15:23
 REPORT DATE : 10/18/10 08:37
 PREPARED BY : JRS

Attn: Dave Olig

Sample ID: RW-16B

Matrix: Ground Water

Sample Date/Time: 10/05/10 13:00

Lab No. : 1010132-41

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	0.85	ug/L	0.50	1.70	1	J	10/11/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/11/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/11/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/11/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/11/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Trichloroethene	4.57	ug/L	0.40	1.30	1		10/11/10	MRD

SIEMENS

Nett Fleming, Inc.
8000 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: RW-16B Dup

Matrix: Ground Water

Sample Date/Time: 10/05/10 13:05

Lab No. : 1010132-42

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	0.66	ug/L	0.50	1.70	1	J	10/11/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/11/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/11/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/11/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/11/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Trichloroethene	4.11	ug/L	0.40	1.30	1		10/11/10	MRD

SIEMENS

Wetzel Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-52B

Matrix: Ground Water

Sample Date/Time: 10/05/10 14:30

Lab No. : 1010132-43

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1	S1H, S2H, DUP	10/11/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1	S1H, S2H, DUP	10/11/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1	S2H, DUP	10/11/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1	S2H, DUP	10/11/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1	S2H, DUP	10/11/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1	S2H, DUP	10/11/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/11/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1	S2H, DUP	10/11/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Trichloroethene	1.29	ug/L	0.40	1.30	1	S1H, S2H, DUP, J	10/11/10	MRD

SIEMENS

Bennett Fleming, Inc.
 600 Excelsior Drive
 Madison, WI 53717

PROJECT NO. : 34283.000
 REPORT NO. : 1010132
 DATE REC'D : 10/07/10 15:23
 REPORT DATE : 10/18/10 08:37
 PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-52B MS

Matrix: Ground Water

Sample Date/Time: 10/05/10 14:35

Lab No. : 1010132-44

	<u>Results</u>	<u>Recovery</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	148	%	0.50	1.70	1	S1H, DUP	10/08/10	MRD
1,1-Dichloroethane	134	%	0.40	1.30	1	S1H, DUP	10/08/10	MRD
1,1-Dichloroethylene	130	%	0.40	1.30	1	DUP	10/08/10	MRD
Carbon Tetrachloride	146	%	0.30	1.00	1	DUP	10/08/10	MRD
Chloroform	136	%	0.20	0.67	1	DUP	10/08/10	MRD
m,p-Xylenes	104	%	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	115	%	0.40	1.30	1	DUP	10/08/10	MRD
o-Xylene	103	%	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	132	%	0.30	1.00	1	DUP	10/08/10	MRD
Toluene	84.0	%	0.40	1.30	1		10/08/10	MRD
Trichloroethene	148	%	0.40	1.30	1	S1H, DUP	10/08/10	MRD

SIEMENS

W. J. Fleming, Inc.
 8025 Excelsior Drive
 Madison, WI 53717

PROJECT NO. : 34283.000
 REPORT NO. : 1010132
 DATE REC'D 10/07/10 15:23
 REPORT DATE : 10/18/10 08:37
 PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-52B MSD

Matrix: Ground Water

Sample Date/Time: 10/05/10 14:40

Lab No. : 1010132-45

	<u>Results</u>	<u>Recovery</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	202	%	0.50	1.70	1	S2H, DUP	10/08/10	MRD
1,1-Dichloroethane	178	%	0.40	1.30	1	S2H, DUP	10/08/10	MRD
1,1-Dichloroethylene	180	%	0.40	1.30	1	S2H, DUP	10/08/10	MRD
Carbon Tetrachloride	208	%	0.30	1.00	1	S2H, DUP	10/08/10	MRD
Chloroform	182	%	0.20	0.67	1	S2H, DUP	10/08/10	MRD
m,p-Xylenes	110	%	0.40	1.30	1		10/08/10	MRD
Methylene Chloride	162	%	0.40	1.30	1	S2H, DUP	10/08/10	MRD
o-Xylene	108	%	0.20	0.67	1		10/08/10	MRD
Tetrachloroethene	184	%	0.30	1.00	1	S2H, DUP	10/08/10	MRD
Toluene	87.0	%	0.40	1.30	1		10/08/10	MRD
Trichloroethene	200	%	0.40	1.30	1	S2H, DUP	10/08/10	MRD

SIEMENS

Watt Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-51B

Matrix: Ground Water

Sample Date/Time: 10/05/10 14:50

Lab No. : 1010132-46

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	0.84	ug/L	0.50	1.70	1	J	10/11/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/11/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Chloroform	0.23	ug/L	0.20	0.67	1	J	10/11/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/11/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/11/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Trichloroethene	5.23	ug/L	0.40	1.30	1		10/11/10	MRD

SIEMENS

()ett Fleming, Inc.
 8025 Excelsior Drive
 Madison, WI 53717

PROJECT NO. : 34283.000
 REPORT NO. : 1010132
 DATE REC'D 10/07/10 15:23
 REPORT DATE : 10/18/10 08:37
 PREPARED BY : JRS

Attn: Dave Olig

Sample ID: RW-3B

Matrix: Ground Water

Sample Date/Time: 10/05/10 15:15

Lab No. : 1010132-47

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	0.63	ug/L	0.50	1.70	1	J	10/11/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/11/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Chloroform	0.33	ug/L	0.20	0.67	1	J	10/11/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/11/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/11/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Trichloroethene	4.37	ug/L	0.40	1.30	1		10/11/10	MRD

SIEMENS

W. J. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: RW-3C

Matrix: Ground Water

Sample Date/Time: 10/05/10 15:25

Lab No. : 1010132-48

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	0.74	ug/L	0.50	1.70	1	J	10/11/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/11/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Chloroform	0.26	ug/L	0.20	0.67	1	J	10/11/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/11/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/11/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Trichloroethene	4.94	ug/L	0.40	1.30	1		10/11/10	MRD

SIEMENS

W. R. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: EC-1

Matrix: Ground Water

Sample Date/Time: 10/05/10 16:00

Lab No. : 1010132-49

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/11/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/11/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Chloroform	0.52	ug/L	0.20	0.67	1	J	10/11/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/11/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/11/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Trichloroethene	2.61	ug/L	0.40	1.30	1		10/11/10	MRD

SIEMENS

W. J. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: Trip Blank

Matrix: Water

Sample Date/Time: 10/05/10 0:00

Lab No. : 1010132-50

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/11/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/11/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/11/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/11/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/11/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/11/10	MRD

SIEMENS

() ett Fleming, Inc.
 8025 Excelsior Drive
 Madison, WI 53717

PROJECT NO. : 34283.000
 REPORT NO. : 1010132
 DATE REC'D 10/07/10 15:23
 REPORT DATE : 10/18/10 08:37
 PREPARED BY : JRS

Attn: Dave Olig

Sample ID: EC-2

Matrix: Ground Water

Sample Date/Time: 10/05/10 16:05

Lab No. : 1010132-51

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/11/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/11/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/11/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/11/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/11/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/11/10	MRD

SIEMENS

() ett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: EC-5

Matrix: Ground Water

Sample Date/Time: 10/05/10 16:10

Lab No. : 1010132-52

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/11/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/11/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/11/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/11/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/11/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/11/10	MRD

SIEMENS

C. H. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: EC-6

Matrix: Ground Water

Sample Date/Time: 10/05/10 15:50

Lab No. : 1010132-53

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/11/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/11/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/11/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/11/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/11/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/11/10	MRD

SIEMENS

() ett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-10A

Matrix: Ground Water

Sample Date/Time: 10/06/10 7:45

Lab No. : 1010132-54

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 6020 - Diss.</u> Dissolved Cadmium	27.5	ug/L	0.20	2.00	1		10/14/10	JCH

SIEMENS

Connett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: **MW-10B**

Matrix: **Ground Water**

Sample Date/Time: **10/06/10 7:55**

Lab No. : **1010132-55**

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 6020 - Diss.</u> Dissolved Cadmium	4.97	ug/L	0.20	2.00	1		10/14/10	JCH

SIEMENS

W. J. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-11A

Matrix: Ground Water

Sample Date/Time: 10/06/10 8:00

Lab No. : 1010132-56

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 6020 - Diss.</u> Dissolved Cadmium	ND	ug/L	0.20	2.00	1		10/14/10	JCH

SIEMENS

W. H. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D : 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-34A

Matrix: Ground Water

Sample Date/Time: 10/06/10 8:10

Lab No. : 1010132-57

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 6020 - Diss.</u> Dissolved Cadmium	17.2	ug/L	0.20	2.00	1		10/14/10	JCH

SIEMENS

() ett Fleming, Inc.
 8025 Excelsior Drive
 Madison, WI 53717

PROJECT NO. : 34283.000
 REPORT NO. : 1010132
 DATE REC'D 10/07/10 15:23
 REPORT DATE : 10/18/10 08:37
 PREPARED BY : JRS

Attn: Dave Olig

Sample ID: Trip Blank

Matrix: Water

Sample Date/Time: 10/06/10 0:00

Lab No. : 1010132-58

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/11/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/11/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/11/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Methylene Chloride	0.52	ug/L	0.40	1.30	1	J	10/11/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		10/11/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/11/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		10/11/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/11/10	MRD

SIEMENS

W. H. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-77C MS

Matrix: Ground Water

Sample Date/Time: 10/04/10 10:45

Lab No. : 1010132-59

	<u>Results</u>	<u>Recovery</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	102	%	0.50	1.70	1		10/11/10	MRD
1,1-Dichloroethane	90.0	%	0.40	1.30	1		10/11/10	MRD
1,1-Dichloroethylene	87.5	%	0.40	1.30	1		10/11/10	MRD
Carbon Tetrachloride	104	%	0.30	1.00	1		10/11/10	MRD
Chloroform	90.5	%	0.20	0.87	1		10/11/10	MRD
m,p-Xylenes	108	%	0.40	1.30	1		10/11/10	MRD
Methylene Chloride	78.5	%	0.40	1.30	1		10/11/10	MRD
o-Xylene	106	%	0.20	0.87	1		10/11/10	MRD
Tetrachloroethene	92.0	%	0.30	1.00	1		10/11/10	MRD
Toluene	84.5	%	0.40	1.30	1		10/11/10	MRD
Trichloroethene	100	%	0.40	1.30	1		10/11/10	MRD

SIEMENS

() ett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010132
DATE REC'D 10/07/10 15:23
REPORT DATE : 10/18/10 08:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-77C MSD

Matrix: Ground Water

Sample Date/Time: 10/04/10 10:45

Lab No. : 1010132-60

	<u>Results</u>	<u>Recovery</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	98.0	%	0.50	1.70	1		10/11/10	MRD
1,1-Dichloroethane	91.0	%	0.40	1.30	1		10/11/10	MRD
1,1-Dichloroethylene	86.5	%	0.40	1.30	1		10/11/10	MRD
Carbon Tetrachloride	100	%	0.30	1.00	1		10/11/10	MRD
Chloroform	91.0	%	0.20	0.67	1		10/11/10	MRD
m,p-Xylenes	110	%	0.40	1.30	1		10/11/10	MRD
Methylene Chloride	79.0	%	0.40	1.30	1		10/11/10	MRD
o-Xylene	110	%	0.20	0.67	1		10/11/10	MRD
Tetrachloroethene	88.0	%	0.30	1.00	1		10/11/10	MRD
Toluene	87.0	%	0.40	1.30	1		10/11/10	MRD
Trichloroethene	99.8	%	0.40	1.30	1		10/11/10	MRD

SIEMENS

Qualifier Descriptions

S2H	Second sample matrix spike recovery was high.
S1H	First sample matrix spike recovery was high.
J	Estimated concentration below laboratory quantitation level.
DUP	Result of duplicate analysis in this quality assurance batch exceeds the limits for precision.
CSH	Check standard for this analyte exhibited a high bias. Sample results may also be biased high.

Definitions

LOD = Limit of Detection (Dilution Corrected)
LOQ = Limit of Quantitation (Dilution Corrected)
Reporting Limit = LOQ (Dilution Corrected)
ND = Not Detected
COMP = Complete
SUBCON = Subcontracted analysis
mv = millivolts
pci/L = picocuries per Liter
mL/L = milliliters per Liter
mg = milligram

When the word "dry" follows the units on the result page the sample results are dry weight corrected.

LODs and LOQs are dry weight corrected for all soils except WI GRO, EPA 8021 and WI DNR/EPA 8260B methanol and WI DNR methylene chloride preserved soils being reported to the State of Wisconsin.

ug/l = Micrograms per Liter = parts per billion (ppb)
ug/kg = Micrograms per kilogram = parts per billion (ppb)
mg/l = Milligrams per liter = parts per million (ppm)
mg/kg = Milligrams per kilogram = parts per million (ppm)
NOT PRES = Not Present
ppth = Parts per thousand
* = Result outside established limits.
mg/m³ = Milligrams per meter cubed
ng/L = Nanograms per Liter = Parts per trillion (ppt)
> = Greater Than

State of Wisconsin Methanol Soils for WI GRO, WI DNR/EPA 8260B and EPA 8021 are reported to the LOQ.

Company Name <i>Grannett Fleming</i>	<i>Marcia A Kuehl Data Validation</i>	Project <i>34293.000</i>
Report Mailing Address <i>8025 Excelsior Dr. Madison, WI 53717</i>	<i>MA Kuehl Co. 3470 Charlevoix Ct Green Bay, WI</i>	Contact Name, Phone, Fax, Email <i>Dave Olig P 608-836-1500 DOlig@gfnet.com F-608-831-3337</i>
Invoice Address <i>8025 Excelsior Dr. Madison, WI 53717</i>		Purchase Order # <i>Tier 1 Per Siemens General Price Quote 2010</i>
		Invoice Contact and Phone No. <i>Dave Olig 608-836-1500</i>

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: WI
(If Yes, please specify Agency or Regulation) Agency/Reg.: DNR

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1010132

Analyses Requested										Lab Use Only			
VOC's NPI's dis cd										Delivered by	Walk-in	<u>Courier</u>	
										Ship. Cont. Ok?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N NA	
										Samples Leaking?	<input type="checkbox"/> Y	<input checked="" type="checkbox"/> N NA	
										Seals OK?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N NA	
										Rec'd on Ice?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N NA	
	Sample Receiving Comments:										3.0		
	Comments												
	3.05 HCE												

Lab Use Only	Sample		No. of Containers		Sample ID
	Date	Time	Comp	Grab	
-1	10/4/2010	12:20		3	MW-17B
-2		12:25		3	MW-17C
-3		12:30		3	MW-72
-4		12:35		3	MW-73
-5		1:10		3	MW-6
-6		1:30		3	MW-66A
-7		1:45		3	MW-66B
-8		1:40		3	MW-66C
-9		2:10		3	MW-62A
-10	✓	2:15		3	MW-62A Dup

Relinquished By:	Date	Time	Received By:
<i>[Signature]</i>	10/6/10	11A	
	10/7/10	5:23	<i>[Signature]</i>

Chain of Custody Record

Company Name Gannett Fleming	Marcia A Kuehl Data Validation	Project 34283.000
Report Mailing Address 8025 Excelsior Dr. Madison WI 53717	MA Kuehl, Co. 2470 Charlevoix Ct Green Bay, WI	Contact Name, Phone, Fax, Email Dave Olig 608-836-1500
Invoice Address Same		Purchase Order # Tier 1 Price Siemens General Price Quote 2010
		Invoice Contact and Phone No. Dave Olig

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: WI
(If Yes, please specify Agency or Regulation) Agency/Reg.: DNR

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1010132

Lab Use Only	Sample				No. of Containers		Sample ID	Analyses Requested	Lab Use Only		
	Date	Time	Comp	Grab	Delivered by	Walk-in			Counter		
-11	10/4/10	2:25		3		MW-62B					
-12		2:30		3		MW-62C					
-13		2:35		3		MW-5A					
-14		2:40		3		MW-5B					
-15		2:55		3		MW-63A MS					
-16		3:00		3		MW-63A MS-					
-17		3:00		2		MW-63A MSD					
-18		3:05		3		MW-63B					
-19		3:15		3		MW-65A					
-20		3:25		3		MW-65B					

Delivered by Walk-in Counter
 Ship. Cont. Ok? N NA
 Samples Leaking? Y N NA
 Seals OK? N NA
 Rec'd on Ice? N NA

Sample Receiving Comments:
3.0

Comments

3 grabs HCE

2 grabs HCE

Relinquished By:	Date	Time	Received By:
<i>[Signature]</i>	10/6/10	11 A	
	10-7-10	1:23	<i>[Signature]</i>

Chain of Custody
Record

Company Name Gannett Fleming	Martha A Kuehl Data Validation	Project 34283.000
Report Mailing Address 8025 Excelsior Dr. Madison WI 53717	MA Kuehl Co. 3470 Chamberlain Ct Green Bay	Contact Name, Phone, Fax, Email Dave Olig 608-836-1500
Invoice Address Same as above		Purchase Order # Her Per Siemens General Price Quote 2010
		Invoice Contact and Phone No. Dave Olig 608-836-1500

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: WI
(If Yes, please specify Agency or Regulation) Agency/Reg.: DNR

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1010132

Lab Use Only	Analyses Requested						Lab Use Only		
	Date	Time	Comp	Grab	Sample ID	Delivered by	Walk-in	Courier	
-21	10/4/10	3:30		3	MW-65C				
-22		3:45		3	MW-64A				
-23		3:50		3	MW-64B				
-24	↓	3:55		3	MW-64C				
-25	10/10/10	10:30		3	MW-76A				
-26		10:35		3	MW-76B				
-27		10:40		3	MW-77A				
-28		10:42		3	MW-77B				
-29		10:45		3	MW-77C				
-30	↓	10:30		3	MW-76A Dup				

USE NPI Strip List

3.0

Comments: 311:215 HCP

see 59 = MS WO = MSD

Chain of Custody Record

Relinquished By:	Date	Time	Received By:
<i>Martha Kuehl</i>	10/6/10	11A	
	10-7-10	1523	<i>John Anderson</i>

Company Name <i>Gannett Fleming</i>	<i>Marcia A Kuehl</i> <i>Data Validation</i>	Project <i>342E3.000</i>
Report Mailing Address <i>8025 Exelsior Dr</i> <i>Madison, WI 53717</i>	<i>MA Kuehl C/o</i> <i>3470 Charlevoix Ct</i> <i>Green Bay, WI</i>	Contact Name, Phone, Fax, Email <i>Dave Olig</i> <i>P 608-836-1500</i> <i>F 608-831-3337</i> <i>DOlig@gfnet.com</i>
Invoice Address <i>8025 Exelsior Dr</i> <i>Madison, WI 53717</i>		Purchase Order # <i>Tier 1 Per Siemens</i> <i>General Price Quote</i> <i>7010</i>
		Invoice Contact and Phone No. <i>Dave Olig</i> <i>608-836-1500</i>

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wts. PECSA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: WI
(If Yes, please specify Agency or Regulation) Agency/Reg.: DNR

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1010132

Analyses Requested										Lab Use Only					
VOC's (NPI's Short List)	dis Cd										Delivered by	Walk-in	<u>Courier</u>		
												Shp. Cont. Ok?	<input checked="" type="checkbox"/>	N	NA
												Samples Leaking?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	NA
												Seals OK?	<input checked="" type="checkbox"/>	N	NA
												Rec'd on Ice?	<input checked="" type="checkbox"/>	N	NA
		Sample Receiving Comments:													
		3.0													
		Comments													
		3.0													
		2/12/10 HEC 7-29-10													

Lab Use Only	Sample		No. of Containers		Sample ID
	Date	Time	Comp	Grab	
-31	10/4/10	4:20		3	MW-9A
-32	↓	4:25		3	MW-9B
-33	10/5/10	8:10		3	MW-68B
-34		8:20		3	MW-74A
-35		8:55		3	MW-23A
-36		9:00		3	MW-23B
-37		9:10		3	MW-69A
-38		9:15		3	MW-69B
-39		9:40		3	MW-38B
-40	10/4/10			2	Trip Blank

Relinquished By: _____ Date _____ Time _____ Received By: _____ 7/13/10

Chain of Custody Record

<i>[Signature]</i>	10/6/10	12N	
	10-7-10	1523	<i>[Signature]</i>

Company Name <u>Grannett Fleming</u>	<u>Marcia A Kuehl</u> <u>Data Validation</u>	Project <u>Marcia A Kuehl</u> <u>D.</u> <u>34203.000</u>
Report Mailing Address <u>8025 Excelsior Dr.</u> <u>Madison, WI 53717</u>	<u>MA Kuehlo</u> <u>3470 Charlevoix Ct</u> <u>Green Bay</u>	Contact Name, Phone, Fax, Email <u>Dave Olg</u> <u>P-608-836-1500</u> <u>F-608-831-3337</u> <u>Dave@gfnet.com</u>
Invoice Address <u>8025 Excelsior Dr.</u> <u>Madison, WI 53717</u>		Purchase Order # <u>Tier 1 Per Siemens</u> <u>General Price</u> <u>Quote</u>
		Invoice Contact and Phone No. <u>Dave Olg</u> <u>608-836-1500</u>

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes

For Compliance Monitoring? No State: _____
(If Yes, please specify Agency or Regulation) Agency/Reg.: _____

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1010132

Analyses Requested								Lab Use Only			
(TST) - MS EAP(S), MS MS EAP(S), MS								Delivered by	Walk-in	<u>Courier</u>	
								Ship. Cont. Ok?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N NA	
								Samples Leaking?	<input checked="" type="checkbox"/> Y	<input checked="" type="checkbox"/> N NA	
								Seals OK?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N NA	
								Rec'd on Ice?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N NA	
	Sample Receiving Comments:								3.0		
	Comments								3.0		

Lab Use Only	Sample		No. of Containers		Sample ID									
	Date	Time	Comp	Grab										
-51	10/5/10	4:05		3	EC-2	X								3.0
-52		4:10		3	EC-5	X								
-53		3:50		3	EC-6	X								
-54	10/6/10	7:45		1	MW-10A		X							1.2 scope HNO3
-55		7:55		1	MW-10B		X							
-56		8:00		1	MW-11A		X							
-57		8:10		1	MW-34A		X							
-58	10/6/10			2	Trip	X								1.2 scope HNO3 729-10 7.8.09
-59	10/6/10	10:45		3	MW-77CMS	X								3.0
-60		10:45		2	MW-77CMSD	X								2.0

Chain of Custody Record

Relinquished By:	Date	Time	Received By:
<u>[Signature]</u>	10/6/10	12N	
	10/7/10	1523	<u>[Signature]</u>

SIEMENS

6.18
0

Company Name <i>Gannett Fleming</i>	<i>Marcia A Kuehl Data Validation</i>	Project <i>00 34293.000</i>	
Report Mailing Address <i>5025 Excelsior Dr. Madison, WI 53717</i>	<i>MA Kuehl Co 3470 Chateaufort Green Bay</i>	Contact Name, Phone, Fax, Email <i>Dave Olig 608-836-1300 608-831-3337 Dolig@atnet.com</i>	
Invoice Address <i>8025 Excelsior Dr Madison, WI 53717</i>		Purchase Order # <i>Tier 1 Per Siemens General Price Quote 2010</i>	Invoice Contact and Phone No. <i>Dave</i>

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: WI
(If Yes, please specify Agency or Regulation) Agency/Reg.: DNR

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1010132

Analyses Requested							Lab Use Only			
VOC's (NPE Short List)	dis Cd						Delivered by	Walk-in	Courier	
							Samples Leaking?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	NA
							Seals OK?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	NA
							Rec'd on Ice?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	NA
Sample Receiving Comments:							3.0			
Comments							3.0			

Lab Use Only	Sample		No. of Containers		Sample ID						
	Date	Time	Comp	Grab							
-41	6/5/10	1 pm		3	RW-16B	X					
-42		1:05		3	RW-16B dup	X					
-43		2:30		3	MW-52B	X					
-44		2:35		3	MW-52B MS	X					
-45		2:40		3	MW-52B MSD	X					
-46		2:50		3	MW-51B	X					
-47		3:15		3	RW-3B	X					
-48		3:25		3	RW-3C	X					
-49		4:00		3	EC-1	X					
-50					Trip Blank	X					

Relinquished By:	Date	Time	Received By:
<i>Matt Adler</i>	6/6/10	12N	
	6/7/10	1523	<i>Matt Adler</i>

Chain of Custody Record

SIEMENS

October 13, 2010

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

Attn: Dave Olig

REPORT NO.: 1010133

PROJECT NO.: 34283.000


Please find enclosed the analytical report, including the Sample Summary, Sample Narrative and Chain of Custody for your sample set received October 7, 2010.

All analyses were performed in accordance with NELAC Standards using approved methods as indicated on this report.

If you have any questions about the results, please call. Thank you for using Siemens Water Technologies for your analytical needs.

Sincerely,

Siemens Water Technologies

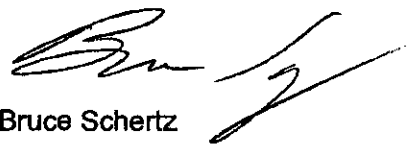


Bruce Schertz

Lab Manager
Enviroscan Analytical™ Services

I certify that the data contained in this report has been generated and reviewed in accordance with the Siemens Water Technologies Quality Assurance Program. Exceptions, if any, are discussed in the sample narrative. Samples will be retained for 30 days from the date of this report, then disposed in an appropriate manner. Siemens Water Technologies Corp. reserves the right to return samples identified as hazardous. Release of this Final Report is authorized as verified by the following signature. The contents of this report apply to the sample(s) analyzed. No duplication of this report is allowed except in its entirety.

Reviewed by: _____



Certifications:

Wisconsin 737053130
Minnesota 055-999-302
Illinois 100317



Siemens Water Technologies Corp.

301 West Military Road
Rothschild, WI 54474

Tel: 800-338-7226
Fax: 715-355-3221
www.siemens.com/enviroscan

LABORATORY'S QUALITY VERIFICATION STATEMENT

Laboratory must provide a signed copy of this form with each deliverable specified in the Work Order or the deliverable will not be accepted. Laboratory must provide Gannett Fleming with a true copy of its internal QA/QC review and approval forms related to the deliverable.

This form must be signed by the Laboratory's Quality Control/Quality Assurance Officer.

Project Name:

Gannett Fleming Project Number: 34283.000

Deliverable Description: Analytical Report

I, Cindy Varga, warrant and represent that the project deliverable described above and attached to this form was developed in accordance with the project scope of work and that all elements relating to the quality of the deliverable were verified in accordance with the requirements of my firm's internal quality management/quality assurance system. This deliverable satisfies all requirements of our Contract with Gannett Fleming.

Signature: Cindy Varga
(by Laboratory's QC/QA Officer)

Date: 10/13/10

Laboratory: Siemens Water Technologies

'Deliverable' shall mean all aspects of design including, without limitation, drawings, calculations, maps, materials and specifications, reports, data bases, logs and other information developed from wells, borings and cores, laboratory data, materials schedules, instrument calibration data and all other items developed, prepared and delivered to Gannett Fleming by Contractor as specified in the Scope of Work in any media.

bw 10.2.09

SIEMENS

SAMPLE SUMMARY

<u>Lab Id</u>	<u>Client</u>	<u>Sample Id</u>	<u>Date/Time</u>	<u>Matrix</u>
1010133-01	CW-11		10/06/10 09:10	Drinking Water
1010133-02	CW-16		10/06/10 09:22	Drinking Water
1010133-03	CW-19		10/06/10 09:15	Drinking Water
1010133-04	Tower A		10/06/10 09:30	Drinking Water
1010133-05	Tower B		10/06/10 09:33	Drinking Water
1010133-06	Raw		10/06/10 09:32	Drinking Water
1010133-07	Finish		10/06/10 09:45	Drinking Water
1010133-08	Trip Blank		10/06/10 00:00	Water

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010133
DATE REC'D. 10/07/10 16:36
REPORT DATE : 10/13/10 10:52
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-11

Matrix: Drinking Water

Sample Date/Time: 10/06/10 9:10

Lab No. : 1010133-01

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		10/12/10	MRD
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/12/10	MRD
1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		10/12/10	MRD
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		10/12/10	MRD
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		10/12/10	MRD
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		10/12/10	MRD
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		10/12/10	MRD
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		10/12/10	MRD
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		10/12/10	MRD
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		10/12/10	MRD
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		10/12/10	MRD
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		10/12/10	MRD
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		10/12/10	MRD
Benzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Bromobenzene	ND	ug/L	0.30	1.00	1		10/12/10	MRD
Bromodichloromethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Bromoform	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Bromomethane	ND	ug/L	1.00	3.30	1		10/12/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/12/10	MRD
Chlorobenzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Chloroethane	ND	ug/L	0.70	2.30	1		10/12/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Chloromethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Dibromochloromethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Dibromomethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Ethylbenzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Styrene	ND	ug/L	0.10	0.50	1		10/12/10	MRD
Tetrachloroethane	ND	ug/L	0.30	1.00	1		10/12/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010133
DATE REC'D 10/07/10 16:36
REPORT DATE : 10/13/10 10:52
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-11

Matrix: Drinking Water

Sample Date/Time: 10/08/10 9:10

Lab No. : 1010133-01

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		10/12/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Vinyl chloride	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		10/12/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010133
DATE REC'D 10/07/10 16:36
REPORT DATE : 10/13/10 10:52
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-16

Matrix: Drinking Water

Sample Date/Time: 10/06/10 9:22

Lab No. : 1010133-02

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		10/12/10	MRD
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/12/10	MRD
1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		10/12/10	MRD
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		10/12/10	MRD
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		10/12/10	MRD
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		10/12/10	MRD
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		10/12/10	MRD
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		10/12/10	MRD
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		10/12/10	MRD
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		10/12/10	MRD
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		10/12/10	MRD
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		10/12/10	MRD
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		10/12/10	MRD
Benzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Bromobenzene	ND	ug/L	0.30	1.00	1		10/12/10	MRD
Bromodichloromethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Bromoform	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Bromomethane	ND	ug/L	1.00	3.30	1		10/12/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/12/10	MRD
Chlorobenzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Chloroethane	ND	ug/L	0.70	2.30	1		10/12/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Chloromethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Dibromochloromethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Dibromomethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Ethylbenzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Styrene	ND	ug/L	0.10	0.50	1		10/12/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/12/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010133
DATE REC'D : 10/07/10 16:36
REPORT DATE : 10/13/10 10:52
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-16

Matrix: Drinking Water

Sample Date/Time: 10/06/10 9:22

Lab No. : 1010133-02

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		10/12/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Vinyl chloride	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		10/12/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010133
DATE REC'D 10/07/10 16:36
REPORT DATE : 10/13/10 10:52
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-19

Matrix: Drinking Water

Sample Date/Time: 10/06/10 9:15

Lab No. : 1010133-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		10/12/10	MRD
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/12/10	MRD
1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		10/12/10	MRD
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		10/12/10	MRD
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		10/12/10	MRD
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		10/12/10	MRD
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		10/12/10	MRD
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		10/12/10	MRD
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		10/12/10	MRD
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		10/12/10	MRD
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		10/12/10	MRD
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		10/12/10	MRD
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		10/12/10	MRD
Benzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Bromobenzene	ND	ug/L	0.30	1.00	1		10/12/10	MRD
Bromodichloromethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Bromoform	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Bromomethane	ND	ug/L	1.00	3.30	1		10/12/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/12/10	MRD
Chlorobenzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Chloroethane	ND	ug/L	0.70	2.30	1		10/12/10	MRD
Chloroform	0.75	ug/L	0.20	0.67	1		10/12/10	MRD
Chloromethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Dibromochloromethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Dibromomethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Ethylbenzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Styrene	ND	ug/L	0.10	0.50	1		10/12/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/12/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010133
DATE REC'D : 10/07/10 16:36
REPORT DATE : 10/13/10 10:52
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-19

Matrix: Drinking Water

Sample Date/Time: 10/06/10 9:15

Lab No. : 1010133-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		10/12/10	MRD
Trichloroethene	2.08	ug/L	0.40	1.30	1		10/12/10	MRD
Vinyl chloride	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		10/12/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010133
DATE REC'D 10/07/10 16:36
REPORT DATE : 10/13/10 10:52
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Tower A

Matrix: Drinking Water

Sample Date/Time: 10/06/10 9:30

Lab No. : 1010133-04

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		10/12/10	MRD
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/12/10	MRD
1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		10/12/10	MRD
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		10/12/10	MRD
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		10/12/10	MRD
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		10/12/10	MRD
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		10/12/10	MRD
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		10/12/10	MRD
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		10/12/10	MRD
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		10/12/10	MRD
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		10/12/10	MRD
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		10/12/10	MRD
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		10/12/10	MRD
Benzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Bromobenzene	ND	ug/L	0.30	1.00	1		10/12/10	MRD
Bromodichloromethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Bromoform	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Bromomethane	ND	ug/L	1.00	3.30	1		10/12/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/12/10	MRD
Chlorobenzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Chloroethane	ND	ug/L	0.70	2.30	1		10/12/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Chloromethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Dibromochloromethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Dibromomethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Ethylbenzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Styrene	ND	ug/L	0.10	0.50	1		10/12/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/12/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010133
DATE REC'D 10/07/10 16:36
REPORT DATE : 10/13/10 10:52
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Tower A

Matrix: Drinking Water

Sample Date/Time: 10/06/10 9:30

Lab No. : 1010133-04

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		10/12/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Vinyl chloride	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		10/12/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010133
DATE REC'D 10/07/10 16:36
REPORT DATE : 10/13/10 10:52
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Tower B Matrix: Drinking Water Sample Date/Time: 10/06/10 9:33 Lab No. : 1010133-05

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		10/12/10	MRD
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/12/10	MRD
1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		10/12/10	MRD
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		10/12/10	MRD
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		10/12/10	MRD
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		10/12/10	MRD
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		10/12/10	MRD
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		10/12/10	MRD
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		10/12/10	MRD
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		10/12/10	MRD
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		10/12/10	MRD
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		10/12/10	MRD
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		10/12/10	MRD
Benzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Bromobenzene	ND	ug/L	0.30	1.00	1		10/12/10	MRD
Bromodichloromethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Bromoform	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Bromomethane	ND	ug/L	1.00	3.30	1		10/12/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/12/10	MRD
Chlorobenzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Chloroethane	ND	ug/L	0.70	2.30	1		10/12/10	MRD
Chloroform	0.22	ug/L	0.20	0.87	1	J	10/12/10	MRD
Chloromethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Dibromochloromethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Dibromomethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Ethylbenzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Styrene	ND	ug/L	0.10	0.50	1		10/12/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/12/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010133
DATE REC'D : 10/07/10 16:36
REPORT DATE : 10/13/10 10:52
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Tower B

Matrix: Drinking Water

Sample Date/Time: 10/08/10 9:33

Lab No. : 1010133-05

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		10/12/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Vinyl chloride	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		10/12/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010133
DATE REC'D : 10/07/10 16:36
REPORT DATE : 10/13/10 10:52
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Raw Matrix: Drinking Water Sample Date/Time: 10/06/10 9:32 Lab No.: 1010133-06

	Results	Units	LOD	LOQ	Dilution Factor	Qualifiers	Date	Analyst
							Analyzed	
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		10/12/10	MRD
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/12/10	MRD
1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		10/12/10	MRD
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		10/12/10	MRD
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		10/12/10	MRD
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		10/12/10	MRD
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		10/12/10	MRD
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		10/12/10	MRD
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		10/12/10	MRD
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		10/12/10	MRD
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		10/12/10	MRD
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		10/12/10	MRD
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		10/12/10	MRD
Benzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Bromobenzene	ND	ug/L	0.30	1.00	1		10/12/10	MRD
Bromodichloromethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Bromoform	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Bromomethane	ND	ug/L	1.00	3.30	1		10/12/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/12/10	MRD
Chlorobenzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Chloroethane	ND	ug/L	0.70	2.30	1		10/12/10	MRD
Chloroform	0.52	ug/L	0.20	0.67	1	J	10/12/10	MRD
Chloromethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Dibromochloromethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Dibromomethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Ethylbenzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Styrene	ND	ug/L	0.10	0.50	1		10/12/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/12/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010133
DATE REC'D : 10/07/10 16:36
REPORT DATE : 10/13/10 10:52
PREPARED BY : BMS

Attr: Dave Olig

Sample ID: Raw

Matrix: Drinking Water

Sample Date/Time: 10/06/10 9:32

Lab No. : 1010133-06

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		10/12/10	MRD
Trichloroethene	0.60	ug/L	0.40	1.30	1	J	10/12/10	MRD
Vinyl chloride	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		10/12/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010133
DATE REC'D 10/07/10 16:36
REPORT DATE : 10/13/10 10:52
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Finish

Matrix: Drinking Water

Sample Date/Time: 10/06/10 9:45

Lab No. : 1010133-07

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u>	<u>Analyst</u>
							<u>Analyzed</u>	
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		10/12/10	MRD
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/12/10	MRD
1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		10/12/10	MRD
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		10/12/10	MRD
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		10/12/10	MRD
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		10/12/10	MRD
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		10/12/10	MRD
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		10/12/10	MRD
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		10/12/10	MRD
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		10/12/10	MRD
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		10/12/10	MRD
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		10/12/10	MRD
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		10/12/10	MRD
Benzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Bromobenzene	ND	ug/L	0.30	1.00	1		10/12/10	MRD
Bromodichloromethane	1.34	ug/L	0.40	1.30	1		10/12/10	MRD
Bromoform	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Bromomethane	ND	ug/L	1.00	3.30	1		10/12/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/12/10	MRD
Chlorobenzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Chloroethane	ND	ug/L	0.70	2.30	1		10/12/10	MRD
Chloroform	19.1	ug/L	0.20	0.67	1		10/12/10	MRD
Chloromethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Dibromochloromethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Dibromomethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Ethylbenzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Styrene	ND	ug/L	0.10	0.50	1		10/12/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/12/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010133
DATE REC'D : 10/07/10 16:36
REPORT DATE : 10/13/10 10:52
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Finish

Matrix: Drinking Water

Sample Date/Time: 10/06/10 9:45

Lab No. : 1010133-07

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		10/12/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Vinyl chloride	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		10/12/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010133
DATE REC'D 10/07/10 16:36
REPORT DATE : 10/13/10 10:52
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Trip Blank

Matrix: Water

Sample Date/Time: 10/06/10 0:00

Lab No. : 1010133-08

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 524.2								
1,1,1,2-Tetrachloroethane	ND	ug/L	0.30	1.00	1		10/12/10	MRD
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/12/10	MRD
1,1,2,2-Tetrachloroethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1,2-Trichloroethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,1-Dichloropropylene	ND	ug/L	0.80	2.70	1		10/12/10	MRD
1,2,3-Trichloropropane	ND	ug/L	1.00	3.30	1		10/12/10	MRD
1,2,4-Trichlorobenzene	ND	ug/L	0.50	1.70	1		10/12/10	MRD
1,2-Dichlorobenzene	ND	ug/L	0.80	2.70	1		10/12/10	MRD
1,2-Dichloroethane	ND	ug/L	0.30	1.00	1		10/12/10	MRD
1,2-Dichloropropane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
1,3-Dichlorobenzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
1,3-Dichloropropane	ND	ug/L	0.20	0.67	1		10/12/10	MRD
1,3-Dichloropropylene (Total)	ND	ug/L	0.40	1.33	1		10/12/10	MRD
1,4-Dichlorobenzene	ND	ug/L	0.80	2.70	1		10/12/10	MRD
2,2-Dichloropropane	ND	ug/L	1.00	3.30	1		10/12/10	MRD
2-Chlorotoluene	ND	ug/L	0.30	1.00	1		10/12/10	MRD
4-Chlorotoluene	ND	ug/L	0.30	1.00	1		10/12/10	MRD
Benzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Bromobenzene	ND	ug/L	0.30	1.00	1		10/12/10	MRD
Bromodichloromethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Bromoform	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Bromomethane	ND	ug/L	1.00	3.30	1		10/12/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		10/12/10	MRD
Chlorobenzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Chloroethane	ND	ug/L	0.70	2.30	1		10/12/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Chloromethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
cis-1,2-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Dibromochloromethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Dibromomethane	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Ethylbenzene	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Styrene	ND	ug/L	0.10	0.50	1		10/12/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		10/12/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010133
DATE REC'D 10/07/10 16:36
REPORT DATE : 10/13/10 10:52
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Trip Blank

Matrix: Water

Sample Date/Time: 10/06/10 0:00

Lab No. : 1010133-08

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 524.2 Continued</u>								
Toluene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
trans-1,2-Dichloroethylene	ND	ug/L	0.50	1.70	1		10/12/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/12/10	MRD
Vinyl chloride	ND	ug/L	0.20	0.67	1		10/12/10	MRD
Xylenes, (Total)	ND	ug/L	1.00	1.00	1		10/12/10	MRD

SIEMENS

Qualifier Descriptions

J Estimated concentration below laboratory quantitation level.

Definitions

LOD = Limit of Detection (Dilution Corrected)
LOQ = Limit of Quantitation (Dilution Corrected)
Reporting Limit = LOQ (Dilution Corrected)
ND = Not Detected
COMP = Complete
SUBCON = Subcontracted analysis
mv = millivolts
pci/L = picocuries per Liter
mL/L = milliliters per Liter
mg = milligram

When the word "dry" follows the units on the result page the sample results are dry weight corrected.

LODs and LOQs are dry weight corrected for all soils except WI GRO, EPA 8021 and WI DNR/EPA 8260B methanol and WI DNR methylene chloride preserved soils being reported to the State of Wisconsin.

ug/l = Micrograms per Liter = parts per billion (ppb)
ug/kg = Micrograms per kilogram = parts per billion (ppb)
mg/l = Milligrams per liter = parts per million (ppm)
mg/kg = Milligrams per kilogram = parts per million (ppm)
NOT PRES = Not Present
ppth = Parts per thousand
* = Result outside established limits.
mg/m³ = Milligrams per meter cubed
ng/L = Nanograms per Liter = Parts per trillion (ppt)
> = Greater Than

State of Wisconsin Methanol Soils for WI GRO, WI DNR/EPA 8260B and EPA 8021 are reported to the LOQ.

Company Name Gannett Fleming	Maria A Kuehl Data Validation M.A. Kuehl Co 3470 Charlevoix Ct Green Bay, WI	Project 34283.000
Report Mailing Address 8025 Excelsior Dr Madison, WI 53717		Contact Name, Phone, Fax, Email Dave Olig P 608-836-1500 F 608-831-3337 dolig@gfnet.com
Invoice Address 8025 Excelsior Dr. Madison, WI 53717		Purchase Order # Tier 1 Per Siemens General Price Quote 2010
		Invoice Contact and Phone No. Dave Olig 608-836-1500

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: WI
(if Yes, please specify Agency or Regulation) Agency/Reg.: WDNR

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1010133

Analyses Requested						Lab Use Only			
SW 524						Delivered by	Walk-in	Cooler	
						Ship. Cont. Ok?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N	<input type="checkbox"/> NA
						Samples Leaking?	<input type="checkbox"/> Y	<input checked="" type="checkbox"/> N	<input type="checkbox"/> NA
						Seals OK?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N	<input type="checkbox"/> NA
						Rec'd on ice?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N	<input type="checkbox"/> NA
Sample Receiving Comments:						3.0			

Lab Use Only	Sample		No. of Containers		Sample ID						Comments
	Date	Time	Comp	Grab							
-1	10/6/20	9:10		3	CW-11	<input checked="" type="checkbox"/>					3 trials HCL
		9:19		3	CW-15	<input checked="" type="checkbox"/>					not used Mr. Olig informed / Chris Barton informed
-2		9:22		3	CW-16	<input checked="" type="checkbox"/>					
				3	CW-17	<input checked="" type="checkbox"/>					Well Down - Not Operating
-3		9:15		3	CW-19	<input checked="" type="checkbox"/>					
-4		9:30		3	Tower A	<input checked="" type="checkbox"/>					
-5		9:33		3	Tower B	<input checked="" type="checkbox"/>					
-6		9:32		3	Raw	<input checked="" type="checkbox"/>					
-7		9:45		3	Finished	<input checked="" type="checkbox"/>					
-8											Initial HCL 7-29-10

Relinquished By:	Date	Time	Received By:	
<i>Matthew Miller</i>	10/6/10	10 AM		78159
	10-7-10	1036	<i>Steve Arde</i>	

Chain of Custody Record

SIEMENS

October 11, 2010

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

Attn: Dave Olig

RECEIVED	
GANNETT FLEMING-MADISON, WI	
FILE NO:	34283.000 (NPI)
OCT 14 2010	
REVIEWED BY:	<i>[Signature]</i>
DATE:	10/19/10
ROUTE TO:	jee ✓

REPORT NO.: 1010134

PROJECT NO.: 34283.000


Please find enclosed the analytical report, including the Sample Summary, Sample Narrative and Chain of Custody for your sample set received October 7, 2010.

All analyses were performed in accordance with NELAC Standards using approved methods as indicated on this report.

If you have any questions about the results, please call. Thank you for using Siemens Water Technologies for your analytical needs.

Sincerely,

Siemens Water Technologies



James Salkowski
Lab Director
Enviroscan Analytical™ Services

I certify that the data contained in this report has been generated and reviewed in accordance with the Siemens Water Technologies Quality Assurance Program. Exceptions, if any, are discussed in the sample narrative. Samples will be retained for 30 days from the date of this report, then disposed in an appropriate manner. Siemens Water Technologies Corp. reserves the right to return samples identified as hazardous. Release of this Final Report is authorized as verified by the following signature. The contents of this report apply to the sample(s) analyzed. No duplication of this report is allowed except in its entirety.

Reviewed by: *[Signature]*

Certifications:

Wisconsin 737053130
Minnesota 055-999-302
Illinois 100317



Siemens Water Technologies Corp.

301 West Military Road
Rolhschild, WI 54474

Tel: 800-338-7226
Fax: 715-355-3221

www.siemens.com/enviroscan

LABORATORY'S QUALITY VERIFICATION STATEMENT

Laboratory must provide a signed copy of this form with each deliverable specified in the Work Order or the deliverable will not be accepted. Laboratory must provide Gannett Fleming with a true copy of its internal QA/QC review and approval forms related to the deliverable.

This form must be signed by the Laboratory's Quality Control/Quality Assurance Officer

Project Name: National Presto

Gannett Fleming Project Number: 34283.000

Deliverable Description: Analytical Report

I, Cindy Varga, warrant and represent that the project deliverable described above and attached to this form was developed in accordance with the project scope of work and that all elements relating to the quality of the deliverable were verified in accordance with the requirements of my firm's internal quality management/quality assurance system. This deliverable satisfies all requirements of our Contract with Gannett Fleming.

Signature: _____

(by Laboratory's QC/QA Officer)

Date: _____

10/11/10

Laboratory: Siemens Water Technologies

'Deliverable' shall mean all aspects of design including, without limitation, drawings, calculations, maps, materials and specifications, reports, data bases, logs and other information developed from wells, borings and cores, laboratory data, materials schedules, instrument calibration data and all other items developed, prepared and delivered to Gannett Fleming by Contractor as specified in the Scope of Work in any media.

bw 10.2.09

SIEMENS

SAMPLE SUMMARY

<u>Lab Id</u>	<u>Client Sample Id</u>	<u>Date/Time</u>	<u>Matrix</u>
1010134-01	M.H. #18	10/04/10 09:00	Ground Water
1010134-02	CAS-1	10/04/10 10:40	Ground Water
1010134-03	CAS-2	10/04/10 09:40	Ground Water
1010134-04	EW-1	10/04/10 10:30	Ground Water
1010134-05	EW-2	10/04/10 10:15	Ground Water
1010134-06	EW-4	10/04/10 09:25	Ground Water
1010134-07	EW-5	10/04/10 09:10	Ground Water
1010134-08	Equipment Blank	10/06/10 11:00	Ground Water
1010134-09	Trip Blank	10/06/10 00:00	Water

SIEMENS

W. H. Fleming, Inc.
6025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010134
DATE REC'D : 10/07/10 17:01
REPORT DATE : 10/11/10 11:50
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: M.H. #18

Matrix: Ground Water

Sample Date/Time: 10/04/10 9:00

Lab No. : 1010134-01

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	0.61	ug/L	0.50	1.70	1	J	10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1	CSH	10/08/10	MRD
Trichloroethene	0.57	ug/L	0.40	1.30	1	J	10/08/10	MRD

SIEMENS

Nett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010134
DATE REC'D 10/07/10 17:01
REPORT DATE : 10/11/10 11:50
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: CAS-1

Matrix: Ground Water

Sample Date/Time: 10/04/10 10:40

Lab No. : 1010134-02

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1	CSH	10/08/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

Connett Fleming, Inc.
8005 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010134
DATE REC'D : 10/07/10 17:01
REPORT DATE : 10/11/10 11:50
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: CAS-2

Matrix: Ground Water

Sample Date/Time: 10/04/10 9:40

Lab No. : 1010134-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	0.84	ug/L	0.50	1.70	1	J	10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
t,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1	CSH	10/08/10	MRD
Trichloroethene	0.77	ug/L	0.40	1.30	1	J	10/08/10	MRD

SIEMENS

Connett Fleming, Inc.
6005 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010134
DATE REC'D : 10/07/10 17:01
REPORT DATE : 10/11/10 11:50
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: EW-1

Matrix: Ground Water

Sample Date/Time: 10/04/10 10:30

Lab No. : 1010134-04

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1	CSH	10/08/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

W. H. Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010134
DATE REC'D : 10/07/10 17:01
REPORT DATE : 10/11/10 11:50
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: EW-2

Matrix: Ground Water

Sample Date/Time: 10/04/10 10:15

Lab No. : 1010134-05

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1	CSH	10/08/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

Connett Fleming, Inc.
6005 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010134
DATE REC'D : 10/07/10 17:01
REPORT DATE : 10/11/10 11:50
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: EW-4

Matrix: Ground Water

Sample Date/Time: 10/04/10 9:25

Lab No. : 1010134-06

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	2.46	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	0.59	ug/L	0.40	1.30	1	J	10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1	CSH	10/08/10	MRD
Trichloroethene	0.96	ug/L	0.40	1.30	1	J	10/08/10	MRD

SIEMENS

Connett Fleming, Inc.
 8025 Excelsior Drive
 Madison, WI 53717

PROJECT NO. : 34283.000
 REPORT NO. : 1010134
 DATE REC'D : 10/07/10 17:01
 REPORT DATE : 10/11/10 11:50
 PREPARED BY : JRS

Attn: Dave Olig

Sample ID: EW-5

Matrix: Ground Water

Sample Date/Time: 10/04/10 9:10

Lab No. : 1010134-07

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1	CSH	10/08/10	MRD
Trichloroethene	1.33	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

Connett Fleming, Inc.
6025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010134
DATE REC'D 10/07/10 17:01
REPORT DATE : 10/11/10 11:50
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: Equipment Blank

Matrix: Ground Water

Sample Date/Time: 10/06/10 11:00

Lab No. : 1010134-08

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1	CSH	10/08/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

Connett Fleming, Inc.
6005 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1010134
DATE REC'D 10/07/10 17:01
REPORT DATE : 10/11/10 11:50
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: Trip Blank

Matrix: Water

Sample Date/Time: 10/06/10 0:00

Lab No. : 1010134-09

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		10/08/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		10/08/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		10/08/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1	CSH	10/08/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		10/08/10	MRD

SIEMENS

Qualifier Descriptions

J	Estimated concentration below laboratory quantitation level.
CSH	Check standard for this analyte exhibited a high bias. Sample results may also be biased high.

Definitions

LOD = Limit of Detection (Dilution Corrected)
LOQ = Limit of Quantitation (Dilution Corrected)
Reporting Limit = LOQ (Dilution Corrected)
ND = Not Detected
COMP = Complete
SUBCON = Subcontracted analysis
mv = millivolts
pci/L = picocuries per Liter
mL/L = milliliters per Liter
mg = milligram

When the word "dry" follows the units on the result page the sample results are dry weight corrected.

LODs and LOQs are dry weight corrected for all soils except WI GRO, EPA 8021 and WI DNR/EPA 8260B methanol and WI DNR methylene chloride preserved soils being reported to the State of Wisconsin.

ug/l = Micrograms per Liter = parts per billion (ppb)
ug/kg = Micrograms per kilogram = parts per billion (ppb)
mg/l = Milligrams per liter = parts per million (ppm)
mg/kg = Milligrams per kilogram = parts per million (ppm)
NOT PRES = Not Present
ppth = Parts per thousand
* = Result outside established limits.
mg/m³ = Milligrams per meter cubed
ng/L = Nanograms per Liter = Parts per trillion (ppt)
> = Greater Than

State of Wisconsin Methanol Soils for WI GRO, WI DNR/EPA 8260B and EPA 8021 are reported to the LOQ.

SIL MENS

7 of 8

Company Name Gannett Fleming	Marcia A Kuehl Data Validation	Project 34283000
Report Mailing Address 8025 Excelsior Dr Madison, WI 53717	MA Kuehle Co. 3470 Charlevoix Ct Green Bay, WI	Contact Name, Phone, Fax, Email Dave Olig 608-836-1500
Invoice Address Same as above		Purchase Order # Tier 1 Per Siemens General Price Quote N-1064 210
		Invoice Contact and Phone No. Dave Olig

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? No State: WI
(If Yes, please specify Agency or Regulation) Agency/Reg.: DNR

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1010134

Analyses Requested										Lab Use Only			
VOC's NPE short list										Delivered by	Walk-in	Sealer	
										Ship. Cont. OK?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N	NA
										Samples Leaking?	<input type="checkbox"/> Y	<input checked="" type="checkbox"/> N	NA
										Seals OK?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N	NA
										Rec'd on Ice?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N	NA
	Sample Receiving Comments:										3.0		
	Comments												
	3 vials HCC												
	Temp. - 53°												

Lab Use Only	Sample		No. of Containers		Sample ID
	Date	Time	Comp	Grab	
-1	10-4	0900		3	M.H. #10
-2	"	1040		3	CAS-1
-3	"	0940		3	CAS-2
-4	"	1030		3	EW-1
-5	"	1015		3	EW-2
-6	"	0925		3	EW-4
-7	"	0910		3	EW-5
-8	10-6-10	11:00		3	Equipment Blank
					P.H. - 6.8
					Temp. - 53°

Relinquished By: TR (vial HCC) Date: 10-6-10 Time: 1400 Received By: 72910 TE 159

Chain of Custody Record

<u>Marcus J. Kubiak</u>	<u>10-6-10</u>	<u>1400</u>	
	<u>10-7-10</u>	<u>1701</u>	<u>Steve Anderson</u>

SIEMENS

December 27, 2010

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

Attn: Dave Olig

REPORT NO.: 1012301

PROJECT NO.: 34283.000 National Presto


Please find enclosed the analytical report, including the Sample Summary, Sample Narrative and Chain of Custody for your sample set received December 17, 2010.

All analyses were performed in accordance with NELAC Standards using approved methods as indicated on this report.

If you have any questions about the results, please call. Thank you for using Siemens Water Technologies for your analytical needs.

Sincerely,

Siemens Water Technologies

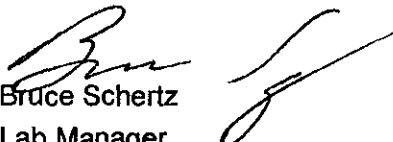
Bruce Schertz
Lab Manager
Enviroscan Analytical™ Services

I certify that the data contained in this report has been generated and reviewed in accordance with the Siemens Water Technologies Quality Assurance Program. Exceptions, if any, are discussed in the sample narrative. Samples will be retained for 30 days from the date of this report, then disposed in an appropriate manner. Siemens Water Technologies Corp. reserves the right to return samples identified as hazardous. Release of this Final Report is authorized as verified by the following signature. The contents of this report apply to the sample(s) analyzed. No duplication of this report is allowed except in its entirety.

Reviewed by: 

Certifications:

Wisconsin 737053130
Minnesota 055-999-302
Illinois 100317



Siemens Water Technologies Corp.

301 West Military Road
Rothschild, WI 54474

Tel: 800-338-7226
Fax: 715-355-3221
www.siemens.com/enviroscan

LABORATORY'S QUALITY VERIFICATION STATEMENT

Laboratory must provide a signed copy of this form with each deliverable specified in the Work Order or the deliverable will not be accepted. Laboratory must provide Gannett Fleming with a true copy of its internal QA/QC review and approval forms related to the deliverable.


This form must be signed by the Laboratory's Quality Control/Quality Assurance Officer

Project Name:

Gannett Fleming Project Number: 34283.000

Deliverable Description: Analytical Report

I, Cindy Varga, warrant and represent that the project deliverable described above and attached to this form was developed in accordance with the project scope of work and that all elements relating to the quality of the deliverable were verified in accordance with the requirements of my firm's internal quality management/quality assurance system. This deliverable satisfies all requirements of our Contract with Gannett Fleming.

Signature: 
(by Laboratory's QC/QA Officer)

Date: 12/25/10

Laboratory: Siemens Water Technologies

'Deliverable' shall mean all aspects of design including, without limitation, drawings, calculations, maps, materials and specifications, reports, data bases, logs and other information developed from wells, borings and cores, laboratory data, materials schedules, instrument calibration data and all other items developed, prepared and delivered to Gannett Fleming by Contractor as specified in the Scope of Work in any media.

bw 10.2.09

SIEMENS

SAMPLE SUMMARY

<u>Lab Id</u>	<u>Client</u>	<u>Sample Id</u>	<u>Date/Time</u>	<u>Matrix</u>
1012301-01	EW-5		12/16/10 14:00	Ground Water
1012301-02	M.H. #18		12/16/10 13:50	Ground Water
1012301-03	Trip Blank		12/16/10 00:00	Water

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 National Presto
REPORT NO. : 1012301
DATE REC'D : 12/17/10 10:51
REPORT DATE : 12/27/10 13:27
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: EW-5

Matrix: Ground Water

Sample Date/Time: 12/16/10 14:00

Lab No. : 1012301-01

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/22/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/22/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/22/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/22/10	MPM
Trichloroethene	1.03	ug/L	0.40	1.30	1	J	12/22/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 National Presto
REPORT NO. : 1012301
DATE REC'D 12/17/10 10:51
REPORT DATE : 12/27/10 13:27
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: M.H. #18

Matrix: Ground Water

Sample Date/Time: 12/16/10 13:50

Lab No. : 1012301-02

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
Calculated								
Trivalent Chromium	2.13	ug/L	1.60	1.60	1		12/22/10	BMS
EPA 150.1								
pH	6.79	pH Units			1		12/20/10 9:35	JJP
EPA 200.8/6020								
ICPMS Liquid Metal Prep	Completed	N/A			1		12/21/10	JCH
EPA 6020 - Total								
Total Arsenic	ND	ug/L	0.60	2.00	1		12/21/10	JCH
Total Cadmium	0.23	ug/L	0.20	2.00	1	J	12/21/10	JCH
Total Chromium	2.13	ug/L	1.60	5.00	1	J	12/21/10	JCH
Total Copper	2.33	ug/L	0.60	2.00	1		12/21/10	JCH
Total Lead	ND	ug/L	0.30	2.00	1		12/21/10	JCH
Total Nickel	34.7	ug/L	0.30	2.00	1		12/21/10	JCH
Total Zinc	39.7	ug/L	2.00	5.00	1		12/21/10	JCH
EPA 7196A								
Hexavalent Chromium	ND	mg/L	0.004	0.020	1	HT	12/21/10 11:45	BMS
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/22/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/22/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/22/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/22/10	MPM
Trichloroethene	0.72	ug/L	0.40	1.30	1	J	12/22/10	MPM
EPA 8310								
<i>Prep Method: Method 3510C Liquid Extraction</i>			<i>By: KAM</i>			<i>Date Prepared: 12/21/10</i>		
1-Methylnaphthalene	ND	ug/L	0.080	0.260	1		12/21/10	LMP
2-Methylnaphthalene	ND	ug/L	0.110	0.370	1		12/21/10	LMP
Acenaphthene	ND	ug/L	0.120	0.400	1		12/21/10	LMP
Acenaphthylene	ND	ug/L	0.120	0.400	1		12/21/10	LMP
Anthracene	ND	ug/L	0.090	0.300	1		12/21/10	LMP
Benzo(a)anthracene	ND	ug/L	0.100	0.330	1		12/21/10	LMP
Benzo(a)pyrene	ND	ug/L	0.020	0.100	1		12/21/10	LMP

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 National Presto
REPORT NO. : 1012301
DATE REC'D : 12/17/10 10:51
REPORT DATE : 12/27/10 13:27
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: M.H. #18 Matrix: Ground Water Sample Date/Time: 12/16/10 13:50 Lab No. : 1012301-02

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8310 Continued</u>								
<i>Prep Method: Method 3510C Liquid Extraction</i>	<i>By: KAM</i>		<i>Date Prepared: 12/21/10</i>					
Benzo(b)fluoranthene	ND	ug/L	0.040	0.130	1		12/21/10	LMP
Benzo(g,h,i)perylene	ND	ug/L	0.060	0.200	1		12/21/10	LMP
Benzo(k)fluoranthene	ND	ug/L	0.070	0.233	1		12/21/10	LMP
Chrysene	ND	ug/L	0.030	0.110	1		12/21/10	LMP
Dibenzo(a,h)anthracene	ND	ug/L	0.110	0.370	1		12/21/10	LMP
Fluoranthene	ND	ug/L	0.120	0.400	1		12/21/10	LMP
Fluorene	ND	ug/L	0.120	0.400	1		12/21/10	LMP
Indeno(1,2,3-cd)pyrene	ND	ug/L	0.120	0.400	1		12/21/10	LMP
Naphthalene	ND	ug/L	0.110	0.370	1		12/21/10	LMP
Phenanthrene	ND	ug/L	0.110	0.370	1		12/21/10	LMP
Pyrene	ND	ug/L	0.100	0.330	1		12/21/10	LMP
<u>SM 2340B - Total</u>								
Total Hardness as CaCO3	52.8	mg/L	0.660	0.660	1		12/21/10	DJB

SIEMENS

Gannett Fleming, Inc.
8025 Excelstor Drive
Madison, WI 53717

PROJECT NO. : 34283.000 National Presto
REPORT NO. : 1012301
DATE REC'D : 12/17/10 10:51
REPORT DATE : 12/27/10 13:27
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Trip Blank

Matrix: Water

Sample Date/Time: 12/16/10 0:00

Lab No. : 1012301-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/22/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/22/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/22/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/22/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		12/22/10	MPM

SIEMENS

Qualifier Descriptions

J	Estimated concentration below laboratory quantitation level.
HT	This result was analyzed outside of the EPA recommended holding time.
COMP	Completed

Definitions

LOD = Limit of Detection (Dilution Corrected)
LOQ = Limit of Quantitation (Dilution Corrected)
Reporting Limit = LOQ (Dilution Corrected)
ND = Not Detected
COMP = Complete
SUBCON = Subcontracted analysis
mv = millivolts
pCi/L = picocuries per Liter
mL/L = milliliters per Liter
mg = milligram

When the word "dry" follows the units on the result page the sample results are dry weight corrected.

LODs and LOQs are dry weight corrected for all soils except WI GRO, EPA 8021 and WI DNR/EPA 8260B methanol and WI DNR methylene chloride preserved soils being reported to the State of Wisconsin.

ug/l = Micrograms per Liter = parts per billion (ppb)
ug/kg = Micrograms per kilogram = parts per billion (ppb)
mg/l = Milligrams per liter = parts per million (ppm)
mg/kg = Milligrams per kilogram = parts per million (ppm)
NOT PRES = Not Present
ppt = Parts per thousand
* = Result outside established limits.
mg/m³ = Milligrams per meter cubed
ng/L = Nanograms per Liter = Parts per trillion (ppt)
> = Greater Than

State of Wisconsin Methanol Soils for WI GRO, WI DNR/EPA 8260B and EPA 8021 are reported to the LOQ.

SIEMENS

Company Name GRANITE-FLEMING	MARCIA A. KUEHL DATA VALIDATIONS	Project 34283000
Report Mailing Address 8025 EXCELSTOR DR. MADISON, WI 53717	3470 CHARLEBOIS CT. GREEN BAY, WI	Contact Name, Phone, Fax, Email DAVE OLIG 608-836-1500 / 608-831-3337
Invoice Address SAME		Purchase Order # TEER 1 PER SIEMENS GENERAL PETEE QUOTE 2010
		Invoice Contact and Phone No. DAVE OLIG 608-836-1500

Matrix: Drinking Water Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No
(If Yes, please specify Agency or Regulation) State: WI
Agency/Reg.: WDNR

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1012301

Analyses Requested							Lab Use Only		
As	Cd	Cu	Cr	Pb	Other	Quantity	Delivered by:	Walk-in	Courier
							Ship. Cont. OK?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
							Samples Leaking?	<input type="checkbox"/>	<input checked="" type="checkbox"/>
							Seals OK?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
							Rec'd on Ice?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
							Sample Receiving Comments:		
							Comments		

Lab Use Only	Sample		No. of Containers		Sample ID	VOCs	PH TEST	METALS	PAH	As, Cd, Cu, Cr, Pb, Ni, Zn, Mn, Fe	Other	Quantity	
	Date	Time	Comp	Grab									
-01	12-16-10	1400	3		EW-5	X							3 x 40 mL HCL
		1350	3		M.H. #19	X							3 x 40 mL HCL
-02		?	1		M.H. #19		X						1 x 125 NP
		?	1		M.H. #18			X					1 x 500 HNO3
			3		M.H. #18				X				3 x 1000 Hg NP
			2		TRIP BLANK								2 x 40 mL HCL TB 160, B 5-1910113

Chain of Custody Record

Relinquished By:	Date	Time	Received By:
<i>M. J. Kellerman</i>	12/16/10	1500	
	12/17/10	1040	<i>J. R. Saltzman</i>

Siemens - QC Report

Work Order : 1012301

LabNumber	SampleName	Analyte	Batch	Result	FinalUnits	Dilution	LOD	LOQ	% Recovery	% Difference	LCL (%)	UCL (%)	Dup Control Limit (%)	Analyzed	Analyst	Instrument	SourceID	SourceResult	TrueValue	Qualifier
1012301-02	M.H. #18	pH	0122009	6.79	pH Units	1								12/20/2010	JJP	PH5				
0122009-DUP1	Duplicate	pH	0122009	6.80	pH Units	1				0.147			5.00				1012301-02	8.79		
1012301-02	M.H. #18	1-Methylnaphthalene - UV 220	0122028	0.00	ug/L	1	0.080	0.260						12/21/2010	LMP	HPLC3				
0122028-BLK1	Blank	1-Methylnaphthalene - UV 220	0122028	0.00	ug/L	1	0.080	0.260						12/21/2010	LMP	HPLC3				
0122028-BS1	LCS	1-Methylnaphthalene - UV 220	0122028	3.02	ug/L	1	0.080	0.260	75.5		40.90	100.00		12/21/2010	LMP	HPLC3			4.00	
0122028-BSD1	LCS Dup	1-Methylnaphthalene - UV 220	0122028	3.32	ug/L	1	0.080	0.260	83.0	9.46	40.90	100.00	25.80	12/21/2010	LMP	HPLC3			4.00	
0122028-CCV1	Calibration Check	1-Methylnaphthalene - UV 220	0122028	1040	ug/L	1			104		85.00	115.00		12/21/2010	LMP	HPLC3			1000	
0122028-CCV2	Calibration Check	1-Methylnaphthalene - UV 220	0122028	1050	ug/L	1			105		85.00	115.00		12/21/2010	LMP	HPLC3			1000	
1012301-02	M.H. #18	2-Methylnaphthalene - UV 220	0122028	0.00	ug/L	1	0.110	0.370						12/21/2010	LMP	HPLC3				
0122028-BLK1	Blank	2-Methylnaphthalene - UV 220	0122028	0.00	ug/L	1	0.110	0.370						12/21/2010	LMP	HPLC3				
0122028-BS1	LCS	2-Methylnaphthalene - UV 220	0122028	3.09	ug/L	1	0.110	0.370	77.2		38.50	100.00		12/21/2010	LMP	HPLC3			4.00	
0122028-BSD1	LCS Dup	2-Methylnaphthalene - UV 220	0122028	3.36	ug/L	1	0.110	0.370	84.0	8.37	38.50	100.00	26.00	12/21/2010	LMP	HPLC3			4.00	
0122028-CCV1	Calibration Check	2-Methylnaphthalene - UV 220	0122028	1050	ug/L	1			105		85.00	115.00		12/21/2010	LMP	HPLC3			1000	
0122028-CCV2	Calibration Check	2-Methylnaphthalene - UV 220	0122028	1060	ug/L	1			106		85.00	115.00		12/21/2010	LMP	HPLC3			1000	
Note : 9,10-Diphenylanthracene - Surrogate																				
1012301-02	M.H. #18	9,10-Diphenylanthracene - UV 220	0122028	2.04	ug/L	1			52.0		37.00	120.80		12/21/2010	LMP	HPLC3			3.92	
0122028-BLK1	Blank	9,10-Diphenylanthracene - UV 220	0122028	1.74	ug/L	1			44.4		37.00	120.80		12/21/2010	LMP	HPLC3			3.92	
0122028-BS1	LCS	9,10-Diphenylanthracene - UV 220	0122028	1.56	ug/L	1			39.8		37.00	120.80		12/21/2010	LMP	HPLC3			3.92	
0122028-BSD1	LCS Dup	9,10-Diphenylanthracene - UV 220	0122028	1.14	ug/L	1			29.1		37.00	120.80		12/21/2010	LMP	HPLC3			3.92	
0122028-CCV1	Calibration Check	9,10-Diphenylanthracene - UV 220	0122028	1000	ug/L	1			102		37.00	120.80		12/21/2010	LMP	HPLC3			980	
0122028-CCV2	Calibration Check	9,10-Diphenylanthracene - UV 220	0122028	1000	ug/L	1			102		37.00	120.80		12/21/2010	LMP	HPLC3			980	
1012301-02	M.H. #18	9,10-Diphenylanthracene - UV 254	0122028	2.06	ug/L	1			52.6		30.00	126.70		12/21/2010	LMP	HPLC3			3.92	
0122028-BLK1	Blank	9,10-Diphenylanthracene - UV 254	0122028	1.66	ug/L	1			42.3		30.00	126.70		12/21/2010	LMP	HPLC3			3.92	
0122028-BS1	LCS	9,10-Diphenylanthracene - UV 254	0122028	1.54	ug/L	1			39.3		30.00	126.70		12/21/2010	LMP	HPLC3			3.92	
0122028-BSD1	LCS Dup	9,10-Diphenylanthracene - UV 254	0122028	1.13	ug/L	1			28.8		30.00	126.70		12/21/2010	LMP	HPLC3			3.92	
0122028-CCV1	Calibration Check	9,10-Diphenylanthracene - UV 254	0122028	1000	ug/L	1			102		30.00	126.70		12/21/2010	LMP	HPLC3			980	
0122028-CCV2	Calibration Check	9,10-Diphenylanthracene - UV 254	0122028	1010	ug/L	1			103		30.00	126.70		12/21/2010	LMP	HPLC3			980	
1012301-02	M.H. #18	Acenaphthene - UV 220	0122028	0.00	ug/L	1	0.120	0.400						12/21/2010	LMP	HPLC3				
0122028-BLK1	Blank	Acenaphthene - UV 220	0122028	0.00	ug/L	1	0.120	0.400						12/21/2010	LMP	HPLC3				
0122028-BS1	LCS	Acenaphthene - UV 220	0122028	3.30	ug/L	1	0.120	0.400	82.5		38.30	100.00		12/21/2010	LMP	HPLC3			4.00	
0122028-BSD1	LCS Dup	Acenaphthene - UV 220	0122028	3.84	ug/L	1	0.120	0.400	91.0	9.80	38.30	100.00	25.90	12/21/2010	LMP	HPLC3			4.00	
0122028-CCV1	Calibration Check	Acenaphthene - UV 220	0122028	1090	ug/L	1			108		85.00	115.00		12/21/2010	LMP	HPLC3			1000	
0122028-CCV2	Calibration Check	Acenaphthene - UV 220	0122028	1090	ug/L	1			109		85.00	115.00		12/21/2010	LMP	HPLC3			1000	
1012301-02	M.H. #18	Acenaphthylene - UV 220	0122028	0.00	ug/L	1	0.120	0.400						12/21/2010	LMP	HPLC3				
0122028-BLK1	Blank	Acenaphthylene - UV 220	0122028	0.00	ug/L	1	0.120	0.400						12/21/2010	LMP	HPLC3				
0122028-BS1	LCS	Acenaphthylene - UV 220	0122028	3.09	ug/L	1	0.120	0.400	77.2		54.40	101.50		12/21/2010	LMP	HPLC3			4.00	
0122028-BSD1	LCS Dup	Acenaphthylene - UV 220	0122028	3.43	ug/L	1	0.120	0.400	85.8	10.4	54.40	101.50	28.10	12/21/2010	LMP	HPLC3			4.00	
0122028-CCV1	Calibration Check	Acenaphthylene - UV 220	0122028	1020	ug/L	1			102		0.00	200.00		12/21/2010	LMP	HPLC3			1000	
0122028-CCV2	Calibration Check	Acenaphthylene - UV 220	0122028	1030	ug/L	1			103		0.00	200.00		12/21/2010	LMP	HPLC3			1000	
1012301-02	M.H. #18	Anthracene - UV 254	0122028	0.00	ug/L	1	0.090	0.300						12/21/2010	LMP	HPLC3				
0122028-BLK1	Blank	Anthracene - UV 254	0122028	0.00	ug/L	1	0.090	0.300						12/21/2010	LMP	HPLC3				
0122028-BS1	LCS	Anthracene - UV 254	0122028	3.20	ug/L	1	0.090	0.300	80.0		74.30	104.20		12/21/2010	LMP	HPLC3			4.00	
0122028-BSD1	LCS Dup	Anthracene - UV 254	0122028	3.43	ug/L	1	0.090	0.300	85.6	6.94	74.30	104.20	16.90	12/21/2010	LMP	HPLC3			4.00	
0122028-CCV1	Calibration Check	Anthracene - UV 254	0122028	1100	ug/L	1			110		85.00	115.00		12/21/2010	LMP	HPLC3			1000	
0122028-CCV2	Calibration Check	Anthracene - UV 254	0122028	1110	ug/L	1			111		85.00	115.00		12/21/2010	LMP	HPLC3			1000	
1012301-02	M.H. #18	Benzo(a)anthracene - UV 254	0122028	0.00	ug/L	1	0.100	0.330						12/21/2010	LMP	HPLC3				
0122028-BLK1	Blank	Benzo(a)anthracene - UV 254	0122028	0.00	ug/L	1	0.100	0.330						12/21/2010	LMP	HPLC3				
0122028-BS1	LCS	Benzo(a)anthracene - UV 254	0122028	3.82	ug/L	1	0.100	0.330	95.5		74.20	106.50		12/21/2010	LMP	HPLC3			4.00	
0122028-BSD1	LCS Dup	Benzo(a)anthracene - UV 254	0122028	3.93	ug/L	1	0.100	0.330	96.2	2.84	74.20	106.50	15.30	12/21/2010	LMP	HPLC3			4.00	
0122028-CCV1	Calibration Check	Benzo(a)anthracene - UV 254	0122028	1010	ug/L	1			101		85.00	115.00		12/21/2010	LMP	HPLC3			1000	

SIEMENS

December 29, 2010

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

Attn: Dave Ollg

RECEIVED	
GANNETT FLEMING-MADISON, WI	
FILE NO.:	<u>34283.000 NPI</u>
JAN 06 2011	
REVIEWED BY:	<u>djo</u>
DATE:	<u>1/6/11</u>
ROUTE TO:	_____

REPORT NO.: 1012327

PROJECT NO.: 34283.00 National Presto

Please find enclosed the analytical report, including the Sample Summary, Sample Narrative and Chain of Custody for your sample set received December 17, 2010.

All analyses were performed in accordance with NELAC Standards using approved methods as indicated on this report.

If you have any questions about the results, please call. Thank you for using Siemens Water Technologies for your analytical needs.

Sincerely,

Siemens Water Technologies



James Salkowski
Lab Director
Enviroscan Analytical™ Services

Cc: Marcla Kuehl, MA Kuehl

I certify that the data contained in this report has been generated and reviewed in accordance with the Siemens Water Technologies Quality Assurance Program. Exceptions, if any, are discussed in the sample narrative. Samples will be retained for 30 days from the date of this report, then disposed in an appropriate manner. Siemens Water Technologies Corp. reserves the right to return samples identified as hazardous. Release of this Final Report is authorized as verified by the following signature. The contents of this report apply to the sample(s) analyzed. No duplication of this report is allowed except in its entirety.

Reviewed by: _____

Certifications:

Wisconsin 737053130
Minnesota 055-999-302
Illinois 100317



Siemens Water Technologies Corp.

301 West Military Road
Rothschild, WI 54474
www.siemens.com/enviroscan

Tel: 800-338-7228
Fax: 716-355-3221

The total number of pages in this report, including this page is 60.

LABORATORY'S QUALITY VERIFICATION STATEMENT

Laboratory must provide a signed copy of this form with each deliverable specified in the Work Order or the deliverable will not be accepted. Laboratory must provide Gannett Fleming with a true copy of its internal QA/QC review and approval forms related to the deliverable.

This form must be signed by the Laboratory's Quality Control/Quality Assurance Officer

Project Name: National Presto

Gannett Fleming Project Number: 34283.00

Deliverable Description: Analytical Report

I, Cindy Varga, warrant and represent that the project deliverable described above and attached to this form was developed in accordance with the project scope of work and that all elements relating to the quality of the deliverable were verified in accordance with the requirements of my firm's internal quality management/quality assurance system. This deliverable satisfies all requirements of our Contract with Gannett Fleming.

Signature: Cindy Varga
(by Laboratory's QC/QA Officer)

Date: 1/4/11

Laboratory: Siemens Water Technologies

'Deliverable' shall mean all aspects of design including, without limitation, drawings, calculations, maps, materials and specifications, reports, data bases, logs and other information developed from wells, borings and cores, laboratory data, materials schedules, instrument calibration data and all other items developed, prepared and delivered to Gannett Fleming by Contractor as specified in the Scope of Work in any media.

bw 10.2.09

SIEMENS

SAMPLE SUMMARY

<u>Lab Id</u>	<u>Client Sample Id</u>	<u>Date/Time</u>	<u>Matrix</u>
1012327-01	MW-77A	12/15/10 10:15	Ground Water
1012327-02	MW-77B	12/15/10 10:20	Ground Water
1012327-03	MW-77C	12/15/10 10:30	Ground Water
1012327-04	MW-77C DUP	12/15/10 10:30	Ground Water
1012327-05	MW-76A	12/15/10 10:50	Ground Water
1012327-06	MW-76B	12/15/10 10:55	Ground Water
1012327-07	MW-62A	12/15/10 11:00	Ground Water
1012327-08	MW-62B	12/15/10 11:05	Ground Water
1012327-09	MW-62C	12/15/10 11:15	Ground Water
1012327-10	MW-5A	12/15/10 11:35	Ground Water
1012327-11	MW-5B	12/15/10 11:45	Ground Water
1012327-12	MW-63A	12/15/10 11:55	Ground Water
1012327-13	MW-63B	12/15/10 12:05	Ground Water
1012327-14	MW-73	12/15/10 13:30	Ground Water
1012327-15	MW-66A	12/15/10 13:50	Ground Water
1012327-16	MW-66B	12/15/10 14:00	Ground Water
1012327-17	MW-66C	12/15/10 14:10	Ground Water
1012327-18	MW-6	12/15/10 14:20	Ground Water
1012327-19	MW-65A	12/15/10 14:45	Ground Water
1012327-20	MW-65C	12/15/10 15:00	Ground Water
1012327-21	MW-65B	12/15/10 14:50	Ground Water
1012327-22	MW-65B MS	12/15/10 14:50	Ground Water
1012327-23	MW-65B MSD	12/15/10 14:50	Ground Water
1012327-24	MW-64A	12/15/10 15:40	Ground Water
1012327-25	MW-64B	12/15/10 15:45	Ground Water
1012327-26	MW-64C	12/15/10 15:55	Ground Water
1012327-27	EW-1	12/15/10 15:20	Ground Water
1012327-28	EW-2	12/15/10 15:20	Ground Water
1012327-29	Trip Blank	12/15/10 00:00	Water
1012327-30	MW-9A	12/16/10 09:45	Ground Water
1012327-31	MW-9B	12/16/10 09:55	Ground Water
1012327-32	MW-75	12/16/10 10:30	Ground Water
1012327-33	MW-70B	12/16/10 10:45	Ground Water
1012327-34	MW-68B	12/16/10 10:55	Ground Water
1012327-35	MW-74B	12/16/10 11:15	Ground Water
1012327-36	MW-4A	12/16/10 11:25	Ground Water
1012327-37	MW-4B	12/16/10 11:35	Ground Water
1012327-38	MW-74A	12/16/10 11:45	Ground Water

SIEMENS

SAMPLE SUMMARY

<u>Lab Id</u>	<u>Client Sample Id</u>	<u>Date/Time</u>	<u>Matrix</u>
1012327-39	MW-74A MS	12/16/10 11:45	Ground Water
1012327-40	MW-74A MSD	12/16/10 11:45	Ground Water
1012327-41	MW-74B	12/16/10 11:50	Ground Water
1012327-42	RW-15	12/16/10 13:05	Ground Water
1012327-43	MW-38A	12/16/10 13:15	Ground Water
1012327-44	MW-38A MS	12/16/10 13:15	Ground Water
1012327-45	MW-38A MSD	12/16/10 13:15	Ground Water
1012327-46	MW-38B	12/16/10 13:25	Ground Water
1012327-47	MW-38C	12/16/10 13:35	Ground Water
1012327-48	MW-38C DUP	12/16/10 13:35	Ground Water
1012327-49	MW-29 B	12/16/10 13:50	Ground Water
1012327-50	EQB	12/16/10 15:00	Ground Water
1012327-51	Trip Blank	12/16/10 00:00	Water

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-77A

Matrix: Ground Water

Sample Date/Time: 12/15/10 10:15

Lab No. : 1012327-01

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/20/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/20/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/20/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/20/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/20/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Trichloroethene	0.42	ug/L	0.40	1.30	1	J	12/20/10	MRD

SIEMENS

Gannett Fleming, inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-77B

Matrix: Ground Water

Sample Date/Time: 12/15/10 10:20

Lab No. : 1012327-02

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/20/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/20/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/20/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/20/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/20/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Trichloroethene	2.57	ug/L	0.40	1.30	1		12/20/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-77C

Matrix: Ground Water

Sample Date/Time: 12/15/10 10:30

Lab No. : 1012327-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/20/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/20/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/20/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/20/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/20/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Toluene	0.45	ug/L	0.40	1.30	1	J	12/20/10	MRD
Trichloroethene	0.80	ug/L	0.40	1.30	1	J	12/20/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Ollg

Sample ID: MW-77C DUP

Matrix: Ground Water

Sample Date/Time: 12/15/10 10:30

Lab No. : 1012327-04

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/20/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/20/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/20/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/20/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/20/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Trichloroethene	0.92	ug/L	0.40	1.30	1	J	12/20/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-76A

Matrix: Ground Water

Sample Date/Time: 12/15/10 10:50

Lab No. : 1012327-05

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	49.2	ug/L	0.50	1.70	1		12/20/10	MRD
1,1-Dichloroethane	0.90	ug/L	0.40	1.30	1	J	12/20/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Carbon Tetrachloride	8.99	ug/L	0.30	1.00	1		12/20/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/20/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/20/10	MRD
o-Xylene	8.53	ug/L	0.20	0.67	1		12/20/10	MRD
Tetrachloroethane	1.56	ug/L	0.30	1.00	1		12/20/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Trichloroethene	29.1	ug/L	0.40	1.30	1		12/20/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-76B

Matrix: Ground Water

Sample Date/Time: 12/15/10 10:55

Lab No. : 1012327-06

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/20/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/20/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/20/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/20/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/20/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		12/20/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-62A

Matrix: Ground Water

Sample Date/Time: 12/15/10 11:00

Lab No. : 1012327-07

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	1.02	ug/L	0.50	1.70	1	J	12/20/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/20/10	MRD
1,1-Dichloroethylene	0.48	ug/L	0.40	1.30	1	J	12/20/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/20/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/20/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/20/10	MRD
Tetrachloroethane	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		12/20/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Ollg

Sample ID: MW-62B

Matrix: Ground Water

Sample Date/Time: 12/15/10 11:05

Lab No. : 1012327-08

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/20/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/20/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/20/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/20/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/20/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		12/20/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-62C

Matrix: Ground Water

Sample Date/Time: 12/15/10 11:15

Lab No. : 1012327-09

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/20/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/20/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/20/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/20/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/20/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		12/20/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-5A

Matrix: Ground Water

Sample Date/Time: 12/15/10 11:35

Lab No. : 1012327-10

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/20/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/20/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/20/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/20/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/20/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		12/20/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-5B

Matrix: Ground Water

Sample Date/Time: 12/15/10 11:45

Lab No. : 1012327-11

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/20/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/20/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Chloroform	0.48	ug/L	0.20	0.67	1	J	12/20/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/20/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/20/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		12/20/10	MRD

SIEMENS

Gannell Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Ollg

Sample ID: MW-63A

Matrix: Ground Water

Sample Date/Time: 12/15/10 11:55

Lab No. : 1012327-12

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/20/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/20/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Chloroform	0.21	ug/L	0.20	0.67	1	J	12/20/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/20/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/20/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		12/20/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-63B

Matrix: Ground Water

Sample Date/Time: 12/15/10 12:05

Lab No. : 1012327-13

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/21/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/21/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/21/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/21/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/21/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		12/21/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-73

Matrix: Ground Water

Sample Date/Time: 12/15/10 13:30

Lab No. : 1012327-14

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/21/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/21/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/21/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/21/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/21/10	MRD
Tetrachloroethene	0.39	ug/L	0.30	1.00	1	J	12/21/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		12/21/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-66A

Matrix: Ground Water

Sample Date/Time: 12/15/10 13:50

Lab No. : 1012327-15

	<u>Results</u>	<u>Units</u>	<u>LQD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/21/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/21/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/21/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/21/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/21/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		12/21/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-66B

Matrix: Ground Water

Sample Date/Time: 12/15/10 14:00

Lab No. : 1012327-16

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	1.07	ug/L	0.50	1.70	1	J	12/21/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/21/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/21/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/21/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/21/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Trichloroethene	0.52	ug/L	0.40	1.30	1	J	12/21/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-66C

Matrix: Ground Water

Sample Date/Time: 12/15/10 14:10

Lab No. : 1012327-17

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/21/10	MRD
t,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/21/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/21/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/21/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/21/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		12/21/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-8

Matrix: Ground Water

Sample Date/Time: 12/15/10 14:20

Lab No. : 1012327-18

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/21/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/21/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Chloroform	ND	ug/L	0.20	0.87	1		12/21/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/21/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/21/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		12/21/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-65A

Matrix: Ground Water

Sample Date/Time: 12/15/10 14:45

Lab No. : 1012327-19

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/21/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/21/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/21/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/21/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/21/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		12/21/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-65C

Matrix: Ground Water

Sample Date/Time: 12/15/10 15:00

Lab No. : 1012327-20

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/21/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/21/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/21/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/21/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/21/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Trichloroethene	0.82	ug/L	0.40	1.30	1	J	12/21/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelstor Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-65B

Matrix: Ground Water

Sample Date/Time: 12/15/10 14:50

Lab No. : 1012327-21

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/20/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/20/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/20/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/20/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/20/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Trichloroethene	0.47	ug/L	0.40	1.30	1	J	12/20/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Alln: Dave Olig

Sample ID: MW-85B MS

Matrix: Ground Water

Sample Date/Time: 12/15/10 14:50

Lab No. : 1012327-22

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	118	%	0.50	1.70	1		12/20/10	MRD
1,1-Dichloroethane	114	%	0.40	1.30	1		12/20/10	MRD
1,1-Dichloroethylene	111	%	0.40	1.30	1		12/20/10	MRD
Carbon Tetrachloride	120	%	0.30	1.00	1		12/20/10	MRD
Chloroform	114	%	0.20	0.67	1		12/20/10	MRD
m,p-Xylenes	105	%	0.40	1.30	1		12/20/10	MRD
Methylene Chloride	109	%	0.40	1.30	1		12/20/10	MRD
o-Xylene	103	%	0.20	0.67	1		12/20/10	MRD
Tetrachloroethene	120	%	0.30	1.00	1		12/20/10	MRD
Toluene	110	%	0.40	1.30	1		12/20/10	MRD
Trichloroethene	112	%	0.40	1.30	1		12/20/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-65B MSD

Matrix: Ground Water

Sample Date/Time: 12/15/10 14:50

Lab No. : 1012327-23

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	122	%	0.50	1.70	1		12/20/10	MRD
1,1-Dichloroethane	116	%	0.40	1.30	1		12/20/10	MRD
1,1-Dichloroethylene	114	%	0.40	1.30	1		12/20/10	MRD
Carbon Tetrachloride	126	%	0.30	1.00	1		12/20/10	MRD
Chloroform	116	%	0.20	0.67	1		12/20/10	MRD
m,p-Xylenes	104	%	0.40	1.30	1		12/20/10	MRD
Methylene Chloride	111	%	0.40	1.30	1		12/20/10	MRD
o-Xylene	104	%	0.20	0.67	1		12/20/10	MRD
Tetrachloroethene	124	%	0.30	1.00	1		12/20/10	MRD
Toluene	111	%	0.40	1.30	1		12/20/10	MRD
Trichloroethene	116	%	0.40	1.30	1		12/20/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-84A

Matrix: Ground Water

Sample Date/Time: 12/15/10 15:40

Lab No. : 1012327-24

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/21/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/21/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/21/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/21/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/21/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		12/21/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-64B

Matrix: Ground Water

Sample Date/Time: 12/15/10 15:45

Lab No. : 1012327-25

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/21/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/21/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/21/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/21/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/21/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Trichloroethene	0.81	ug/L	0.40	1.30	1	J	12/21/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-64C

Matrix: Ground Water

Sample Date/Time: 12/15/10 15:55

Lab No. : 1012327-26

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/21/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/21/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/21/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/21/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/21/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Trichloroethene	1.00	ug/L	0.40	1.30	1	J	12/21/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: EW-1

Matrix: Ground Water

Sample Date/Time: 12/15/10 15:20

Lab No. : 1012327-27

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/21/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/21/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Chloroform	2.81	ug/L	0.20	0.67	1		12/21/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/21/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/21/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		12/21/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Ollg

Sample ID: EW-2

Matrix: Ground Water

Sample Date/Time: 12/15/10 15:20

Lab No. : 1012327-28

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethene	ND	ug/L	0.50	1.70	1		12/21/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/21/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/21/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/21/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/21/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		12/21/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: Trip Blank

Matrix: Water

Sample Date/Time: 12/15/10 0:00

Lab No. : 1012327-29

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/21/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/21/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/21/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/21/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/21/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		12/21/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Ollg

Sample ID: MW-9A

Matrix: Ground Water

Sample Date/Time: 12/16/10 9:45

Lab No. : 1012327-30

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/21/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/21/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/21/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/21/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/21/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Trichloroethane	ND	ug/L	0.40	1.30	1		12/21/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-9B

Matrix: Ground Water

Sample Date/Time: 12/16/10 9:55

Lab No. : 1012327-31

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/21/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/21/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/21/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/21/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/21/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Trichloroethane	ND	ug/L	0.40	1.30	1		12/21/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-75

Matrix: Ground Water

Sample Date/Time: 12/16/10 10:30

Lab No. : 1012327-32

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/21/10	MRD
1,1-Dichloroethane	1.00	ug/L	0.40	1.30	1	J	12/21/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/21/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/21/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/21/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		12/21/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-70B

Matrix: Ground Water

Sample Date/Time: 12/16/10 10:45

Lab No. : 1012327-33

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/21/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/21/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/21/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/21/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/21/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		12/21/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Exceisior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Oilg

Sample ID: MW-68B

Matrix: Ground Water

Sample Date/Time: 12/16/10 10:55

Lab No. : 1012327-34

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethene	ND	ug/L	0.50	1.70	1		12/21/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/21/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/21/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/21/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/21/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Trichloroethene	1.06	ug/L	0.40	1.30	1	J	12/21/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Ollg

Sample ID: MW-74B

Matrix: Ground Water

Sample Date/Time: 12/16/10 11:15

Lab No. : 1012327-35

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/21/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/21/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Chloroform	0.50	ug/L	0.20	0.67	1	J	12/21/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/21/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/21/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		12/21/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-4A

Matrix: Ground Water

Sample Date/Time: 12/16/10 11:25

Lab No. : 1012327-36

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/22/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/22/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/22/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/22/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		12/22/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/22/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/22/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		12/22/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/22/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		12/22/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		12/22/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-4B

Matrix: Ground Water

Sample Date/Time: 12/16/10 11:35

Lab No. : 1012327-37

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	1.82	ug/L	0.50	1.70	1		12/22/10	MPM
1,1-Dichloroethane	1.20	ug/L	0.40	1.30	1	J	12/22/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/22/10	MPM
Carbon Tetrachloride	0.39	ug/L	0.30	1.00	1	J	12/22/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		12/22/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/22/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/22/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		12/22/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/22/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		12/22/10	MPM
Trichloroethene	0.63	ug/L	0.40	1.30	1	J	12/22/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-74A

Matrix: Ground Water

Sample Date/Time: 12/16/10 11:45

Lab No. : 1012327-38

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/21/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/21/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/21/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/21/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/21/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/21/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/21/10	MRD
Trichloroethene	2.27	ug/L	0.40	1.30	1		12/21/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Ollg

Sample ID: MW-74A MS

Matrix: Ground Water

Sample Date/Time: 12/16/10 11:46

Lab No. : 1012327-39

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	128	%	0.50	1.70	1		12/21/10	MRD
1,1-Dichloroethane	120	%	0.40	1.30	1		12/21/10	MRD
1,1-Dichloroethylene	117	%	0.40	1.30	1		12/21/10	MRD
Carbon Tetrachloride	134	%	0.30	1.00	1		12/21/10	MRD
Chloroform	120	%	0.20	0.67	1		12/21/10	MRD
m,p-Xylenes	106	%	0.40	1.30	1		12/21/10	MRD
Methylene Chloride	113	%	0.40	1.30	1		12/21/10	MRD
o-Xylene	106	%	0.20	0.67	1		12/21/10	MRD
Tetrachloroethene	127	%	0.30	1.00	1		12/21/10	MRD
Toluene	114	%	0.40	1.30	1		12/21/10	MRD
Trichloroethene	118	%	0.40	1.30	1		12/21/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-74A MSD

Matrix: Ground Water

Sample Date/Time: 12/18/10 11:45

Lab No. : 1012327-40

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	122	%	0.50	1.70	1		12/21/10	MRD
1,1-Dichloroethane	118	%	0.40	1.30	1		12/21/10	MRD
1,1-Dichloroethylene	113	%	0.40	1.30	1		12/21/10	MRD
Carbon Tetrachloride	128	%	0.30	1.00	1		12/21/10	MRD
Chloroform	118	%	0.20	0.87	1		12/21/10	MRD
m,p-Xylenes	103	%	0.40	1.30	1		12/21/10	MRD
Methylene Chloride	110	%	0.40	1.30	1		12/21/10	MRD
o-Xylene	102	%	0.20	0.87	1		12/21/10	MRD
Tetrachloroethene	122	%	0.30	1.00	1		12/21/10	MRD
Toluene	108	%	0.40	1.30	1		12/21/10	MRD
Trichloroethene	115	%	0.40	1.30	1		12/21/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-74B

Matrix: Ground Water

Sample Date/Time: 12/16/10 11:50

Lab No. : 1012327-41

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	0.63	ug/L	0.50	1.70	1	J	12/22/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/22/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/22/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/22/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		12/22/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/22/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/22/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		12/22/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/22/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		12/22/10	MPM
Trichloroethene	3.26	ug/L	0.40	1.30	1		12/22/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olg

Sample ID: RW-15

Matrix: Ground Water

Sample Date/Time: 12/16/10 13:05

Lab No. : 1012327-42

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	0.80	ug/L	0.50	1.70	1	J	12/22/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/22/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/22/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/22/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		12/22/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/22/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/22/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		12/22/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/22/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		12/22/10	MPM
Trichloroethene	5.78	ug/L	0.40	1.30	1		12/22/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-38A

Matrix: Ground Water

Sample Date/Time: 12/16/10 13:15

Lab No. : 1012327-43

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/27/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/27/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/27/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		12/27/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/27/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		12/27/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/27/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Trichloroethene	1.33	ug/L	0.40	1.30	1		12/27/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olg

Sample ID: MW-38A MS

Matrix: Ground Water

Sample Date/Time: 12/16/10 13:16

Lab No. : 1012327-44

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	131	%	0.50	1.70	1		12/27/10	MPM
1,1-Dichloroethane	125	%	0.40	1.30	1		12/27/10	MPM
1,1-Dichloroethylene	117	%	0.40	1.30	1		12/27/10	MPM
Carbon Tetrachloride	130	%	0.30	1.00	1		12/27/10	MPM
Chloroform	128	%	0.20	0.87	1		12/27/10	MPM
m,p-Xylenes	97.8	%	0.40	1.30	1		12/27/10	MPM
Methylene Chloride	120	%	0.40	1.30	1		12/27/10	MPM
o-Xylene	97.5	%	0.20	0.87	1		12/27/10	MPM
Tetrachloroethene	119	%	0.30	1.00	1		12/27/10	MPM
Toluene	108	%	0.40	1.30	1		12/27/10	MPM
Trichloroethene	111	%	0.40	1.30	1		12/27/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-38A MSD

Matrix: Ground Water

Sample Date/Time: 12/18/10 13:15

Lab No. : 1012327-45

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethene	149	%	0.50	1.70	1	S2H, DUP	12/27/10	MPM
1,1-Dichloroethane	148	%	0.40	1.30	1	S2H, DUP	12/27/10	MPM
1,1-Dichloroethylene	130	%	0.40	1.30	1	DUP	12/27/10	MPM
Carbon Tetrachloride	148	%	0.30	1.00	1	DUP	12/27/10	MPM
Chloroform	150	%	0.20	0.67	1	S2H, DUP	12/27/10	MPM
m,p-Xylenes	101	%	0.40	1.30	1		12/27/10	MPM
Methylene Chloride	138	%	0.40	1.30	1	S2H, DUP	12/27/10	MPM
o-Xylene	102	%	0.20	0.67	1		12/27/10	MPM
Tetrachloroethene	154	%	0.30	1.00	1	S2H, DUP	12/27/10	MPM
Toluene	118	%	0.40	1.30	1	S2H, DUP	12/27/10	MPM
Trichloroethene	145	%	0.40	1.30	1	S2H, DUP	12/27/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-38B

Matrix: Ground Water

Sample Date/Time: 12/16/10 13:25

Lab No. : 1012327-46

	<u>Results</u>	<u>Units</u>	<u>LDD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	1.06	ug/L	0.50	1.70	1	J	12/22/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/22/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/22/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/22/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		12/22/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/22/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/22/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		12/22/10	MPM
Tetrachloroethene	0.30	ug/L	0.30	1.00	1	J	12/22/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		12/22/10	MPM
Trichloroethene	5.22	ug/L	0.40	1.30	1		12/22/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Ollg

Sample ID: MW-38C

Matrix: Ground Water

Sample Date/Time: 12/16/10 13:35

Lab No. : 1012327-47

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/28/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/28/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/28/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Tetrachloroethane	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Trichloroethene	2.56	ug/L	0.40	1.30	1		12/28/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: MW-38C DUP

Matrix: Ground Water

Sample Date/Time: 12/16/10 13:35

Lab No. : 1012327-48

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/28/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/28/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/28/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Trichloroethene	3.24	ug/L	0.40	1.30	1		12/28/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Ollg

Sample ID: MW-29 B

Matrix: Ground Water

Sample Date/Time: 12/16/10 13:50

Lab No. : 1012327-49

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/28/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/28/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/28/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Tetrachloroethane	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		12/28/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D : 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Olig

Sample ID: EQB

Matrix: Ground Water

Sample Date/Time: 12/16/10 15:00

Lab No. : 1012327-50

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/28/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/28/10	MRD
m,p-Xylenes	0.44	ug/L	0.40	1.30	1	J	12/28/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/28/10	MRD
o-Xylene	0.23	ug/L	0.20	0.67	1	J	12/28/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Toluene	0.42	ug/L	0.40	1.30	1	J	12/28/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		12/28/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.00 National Presto
REPORT NO. : 1012327
DATE REC'D 12/17/10 16:40
REPORT DATE : 12/29/10 10:37
PREPARED BY : JRS

Attn: Dave Ollg

Sample ID: Trip Blank

Matrix: Water

Sample Date/Time: 12/16/10 0:00

Lab No. : 1012327-51

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/20/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/20/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/20/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/20/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/20/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/20/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/20/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		12/20/10	MRD

SIEMENS

Qualifier Descriptions

S2H	Second sample matrix spike recovery was high.
J	Estimated concentration below laboratory quantitation level.
DUP	Result of duplicate analysis in this quality assurance batch exceeds the limits for precision.

Definitions

LOD = Limit of Detection (Dilution Corrected)
LOQ = Limit of Quantitation (Dilution Corrected)
Reporting Limit = LOQ (Dilution Corrected)
ND = Not Detected
COMP = Complete
SUBCON = Subcontracted analysis
mv = millivolts
pci/L = picocuries per Liter
mL/L = milliliters per Liter
mg = milligram

When the word "dry" follows the units on the result page the sample results are dry weight corrected.

LODs and LOQs are dry weight corrected for all soils except WI GRO, EPA 8021 and WI DNR/EPA 8260B methanol and WI DNR methylene chloride preserved soils being reported to the State of Wisconsin.

ug/l = Micrograms per Liter = parts per billion (ppb)
ug/kg = Micrograms per kilogram = parts per billion (ppb)
mg/l = Milligrams per liter = parts per million (ppm)
mg/kg = Milligrams per kilogram = parts per million (ppm)
NOT PRES = Not Present
ppth = Parts per thousand
* = Result outside established limits.
mg/m³ = Milligrams per meter cubed
ng/L = Nanograms per Liter = Parts per trillion (ppt)
> = Greater Than

State of Wisconsin Methanol Soils for WI GRO, WI DNR/EPA 8260B and EPA 8021 are reported to the LOQ.

100

Company Name <i>Gannett Fleming</i>	<i>Marcia A Kuehl</i> Data Validation	Project <i>34283.000</i>	
Report Mailing Address <i>9025 Executive Dr Madison, WI 53717</i>	<i>MA Kuehl</i> <i>3470 Charlevoix Ct Green Bay, WI</i>	Contact Name, Phone, Fax, Email <i>Dave O'g</i> <i>608-256-1500/608-551-3337</i> <i>Data@gnf.net.com</i>	
Invoice Address <i>SAME</i>		Purchase Order # <i>Tier 1 Siemens General Price Quote 2016</i>	Invoice Contact and Phone No.

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No
(If Yes, please specify Agency or Regulation) State: WI
Agency/Reg.: DNR

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1012327

Analyses Requested										Lab Use Only		
										Delivered by	Walk-in	Courier
										Ship. Cont. Ok?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N
										Samples Leaking?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N
										Seals OK?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N
										Rec'd on Ice?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N
										Sample Receiving Comments:		
										Comments		

Lab Use Only	Sample		No. of Containers		Sample ID	VOC NPI	SIS CH				
	Date	Time	Comp	Grab							
-01	12-15-10	10:15		3	MW-77A	X					3 vials HCL
-02		10:20			MW-77B	X					
-03		10:30			MW-77C	X					
-04		10:30			MW-77C DUP	X					
-05		10:50			MW-76A	X					
-06		10:55			MW-76B	X					
-07		11:00			MW-62A	X					
-08		11:05			MW-62B	X					
-09		11:15			MW-62C	X					
-10	X	11:35			MW-5A	X					

Relinquished By:	Date	Time	Received By:
<i>Daniel Dole</i>	12-16-10	3:00	
	12/17/10	16:40	<i>JRS</i>

Chain of Custody Record

SIEMENS

2010

Company Name <i>Grannett Fleming</i>	<i>Marcia A Kuehl</i> Data Validation	Project <i>34253.000</i>
Report Mailing Address <i>5025 Excellence Dr Madison, WI 53717</i>	<i>MA Kuehl</i> <i>3470 Charlevoix Ct Green Bay, WI</i>	Contact Name, Phone, Fax, Email <i>Dave Olg</i> <i>608-836-1500/608-831-3337</i> <i>Dolg@grfnat.com</i>
Invoice Address <i>SAME</i>		Purchase Order # <i>Tied For Siemens</i> <i>General Price Quote</i> <i>2010</i>
		Invoice Contact and Phone No. <i>Dave Olg</i> <i>608-836-1500</i>

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: WI
(If Yes, please specify Agency or Regulation) Agency/Reg.: DNR

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Data Needed: _____

WO No. 1012327

Analyses Requested										Lab Use Only		
										Delivered by	Walk-in	Courier
										Ship. Cont. OK?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N
										Samples Leaking?	<input type="checkbox"/> Y	<input checked="" type="checkbox"/> N
										Seals OK?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N
										Rec'd on ice?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N
										Sample Receiving Comments: <i>4</i>		

Lab Use Only	Sample		No. of Containers		Sample ID	Use VPI	Use Col						Comments	
	Date	Time	Comp	Grab										
-11	12/5/10	11:45		3	MW-5B	X							3 vials HCL	
-12	}	11:55		}	MW-63A	X								
-13		12:05			MW-63B	X								
-14		11:30			MW-73	X								
-15		1:50			MW-66A	X								
-16		2:00			MW-66B	X								
-17		2:10			MW-66C	X								
-18		2:20			MW-6	X								
-19		2:45			MW-65A	X								
-20		3:00			MW-65C	X								

Chain of Custody Record

Relinquished By:	Date	Time	Received By:
<i>D. D. Dill</i>	12/16/10	3:20	
	12/17/10	16:40	<i>K. Salkowski</i>

Company Name <i>Gannett Fleming</i>	Marcia A Kuehl Data Validation	Project 34263.000	
Report Mailing Address 8425 Excelsior Dr. Madison, WI 53717	MA Kuehl 3470 Cherokee Ct Green Bay, WI	Contact Name, Phone, Fax, Email Dave Clig 608-436-3500 / 608-431-3337 Dave.Clig@siemens.com	
Invoice Address <i>SAME</i>		Purchase Order # Tier 1 Per Siemens General Price Guide 2010	Invoice Contact and Phone No. Dave Clig 608-436-1500

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____
 Wis. PECFA Project subject to U&C? Yes No
 For Compliance Monitoring? No State: WI
 (If Yes, please specify Agency or Regulation) Agency/Reg.: DNR

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
 Date Needed: _____

WO No. 1012327

Analyses Requested										Lab Use Only					
Voc MPF	dis. cel										Delivered by	Walk-in	Courier		
												Ship. Cont. OK?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N	
												Samples Leaking?	<input type="checkbox"/> Y	<input checked="" type="checkbox"/> N	
												Seals OK?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N	
												Rec'd on Ice?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N	
		Sample Receiving Comments:													
		Comments													

Lab Use Only	Sample		No. of Containers		Sample ID
	Date	Time	Comp	Grab	
-21	12/15/10	2:50		3	MW-65B
-22		2:50		}	MW-65B MS
-23		2:50			MW-65B MSD
-24		3:40			MW-64A
-25		3:45			MW-64B
-26		3:55			MW-64C
-27		3:20			EW-1
-28		3:20			EW-2
-29	12/15			2	Trip Blank

Chain of Custody Record

Relinquished By:	Date	Time	Received By:
<i>[Signature]</i>	12/16/10	3:00	
	12/16/10	1640	<i>[Signature]</i>

Company Name <i>Granett Fleming</i>	Marcia A Kuehl Data Validation	Project 34263 000	
Report Mailing Address 8025 Excelsior Dr. Madison, WI 53717	MA Kuehl 3470 Charlevoix Ct Green Bay, WI	Contact Name, Phone, Fax, Email Dave Olg 608-836-7500 / 608-831-3337 DO1:a@gfnet.com	
Invoice Address <i>same</i>		Purchase Order # Tier 1 Per Siemens General Price Quote 2010	Invoice Contact and Phone No. Dave Olg 608-836-7500

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes NO

For Compliance Monitoring? Yes No State: WI
(If Yes, please specify Agency or Regulation) Agency/Reg.: WDNR

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1012327

Analyses Requested						Lab Use Only		
VOC MPF	dvs cd					Delivered by	Walk-in	<u>Courier</u>
						Ship. Cont. Ok?	<input checked="" type="radio"/>	<input checked="" type="radio"/> NA
						Samples Leaking?	<input checked="" type="radio"/>	<input checked="" type="radio"/> NA
						Seals OK?	<input checked="" type="radio"/>	<input checked="" type="radio"/> NA
						Rec'd on Ice?	<input checked="" type="radio"/>	<input checked="" type="radio"/> NA
						Sample Receiving Comments:		

Lab Use Only	Sample		No. of Containers		Sample ID	VOC MPF	dvs cd						Comments
	Date	Time	Comp	Grab									
-30	12-16-10	9:45		3	MW-9A	X							
-31		9:55		}	MW-9B	X							
-32		10:30			MW-95	X							
-33		10:45			MW-70B	X							
-34		10:55			MW-68B	X							
-35		11:15			MW-74B	X							
-36		11:25			MW-4A	X							
-37		11:35			MW-4B	X							
-38		11:45			MW-74A	X							
-39		11:45			2	MW-74AMS	X						

Chain of Custody Record

Relinquished By:	Date	Time	Received By:
<i>[Signature]</i>	12/16/10	3:00	
	12/16/10	16:40	<i>[Signature]</i>

Company Name Grannett Fleming	Marcia A Kuehl Data Validation	Project 34283.000
Report Mailing Address 3025 Excelsior Dr Madison, WI 53717	MA Kuehl Co 3470 Cherokee Ct Green Bay, WI	Contact Name, Phone, Fax, Email Dave Oly 608-636-1500 / 608-631-3337 DOLA@df.net.com
Invoice Address same		Purchase Order # Trevl Per Siemens General Price Quote 2010
		Invoice Contact and Phone No. Dave Oly 608-636-1500

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No
(If Yes, please specify Agency or Regulation) State: WI
Agency/Reg.: DNR

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1012327

Analyses Requested										Lab Use Only		
										Delivered by	Walk-in	<u>Courier</u>
										Ship. Cont. OK?	<input checked="" type="checkbox"/>	N
										Samples Leaking?	Y	<input checked="" type="checkbox"/>
										Seals OK?	<input checked="" type="checkbox"/>	N
										Rec'd on Ice?	<input checked="" type="checkbox"/>	N
										Sample Receiving Comments:		

Lab Use Only	Sample		No. of Containers		Sample ID	VOC NPF	Cl's Cd						Comments
	Date	Time	Comp	Grab									
-40	12-16-10	11:45		2	MW-74A MSD	X							
-41	}	11:50		3	MW-74B	X							
-42		1:05			2W-15	X							
-43		1:15			MW-38A	X							
-44		1:15			MW-38A MSD	X							
-45		1:15			MW-38A MSD	X							
-46		1:25			MW-38B	X							
-47		1:35			MW-38C	X							
-48		1:35			MW-38C DUP	X							
-49		X 1:50			MW-29 DUP	X							
-50		12/16	3:00		3	Field Blank	X						

-51 12/16 Trip Blank
Chain of Custody Record

<i>[Signature]</i>	12-16-10	3:00	
	12/16/10	1646	<i>[Signature]</i>

jee - 1/12/2011

SIEMENS

January 04, 2011

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

Attn: Dave Olig

REPORT NO.: 1012381

PROJECT NO.: 34283.000


Please find enclosed the analytical report, including the Sample Summary, Sample Narrative and Chain of Custody for your sample set received December 22, 2010.

All analyses were performed in accordance with NELAC Standards using approved methods as indicated on this report.

If you have any questions about the results, please call. Thank you for using Siemens Water Technologies for your analytical needs.


Sincerely,

Siemens Water Technologies

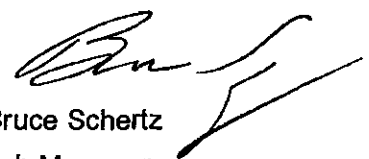

Bruce Schertz
Lab Manager
Enviroscan Analytical™ Services

I certify that the data contained in this report has been generated and reviewed in accordance with the Siemens Water Technologies Quality Assurance Program. Exceptions, if any, are discussed in the sample narrative. Samples will be retained for 30 days from the date of this report, then disposed in an appropriate manner. Siemens Water Technologies Corp. reserves the right to return samples identified as hazardous. Release of this Final Report is authorized as verified by the following signature. The contents of this report apply to the sample(s) analyzed. No duplication of this report is allowed except in its entirety.

Reviewed by:  _____

Certifications:
Wisconsin 737053130
Minnesota 055-999-302
Illinois 100317



Siemens Water Technologies Corp.

301 West Military Road
Rothschild, WI 54474

Tel: 800-338-7226
Fax: 715-355-3221
www.siemens.com/enviroscan

LABORATORY'S QUALITY VERIFICATION STATEMENT

Laboratory must provide a signed copy of this form with each deliverable specified in the Work Order or the deliverable will not be accepted. Laboratory must provide Gannett Fleming with a true copy of its internal QA/QC review and approval forms related to the deliverable.

This form must be signed by the Laboratory's Quality Control/Quality Assurance Officer

Project Name:

Gannett Fleming Project Number: 34283.000

Deliverable Description: Analytical Report

I, Cindy Varga, warrant and represent that the project deliverable described above and attached to this form was developed in accordance with the project scope of work and that all elements relating to the quality of the deliverable were verified in accordance with the requirements of my firm's internal quality management/quality assurance system. This deliverable satisfies all requirements of our Contract with Gannett Fleming.

Signature: Cindy Varga
(by Laboratory's QC/QA Officer)

Date: 1/5/11

Laboratory: Siemens Water Technologies

'Deliverable' shall mean all aspects of design including, without limitation, drawings, calculations, maps, materials and specifications, reports, data bases, logs and other information developed from wells, borings and cores, laboratory data, materials schedules, instrument calibration data and all other items developed, prepared and delivered to Gannett Fleming by Contractor as specified in the Scope of Work in any media.

bw 10.2.09

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1012381
DATE REC'D : 12/22/10 12:27
REPORT DATE : 01/04/11 10:55
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-11

Matrix: Drinking Water

Sample Date/Time: 12/21/10 9:00

Lab No. : 1012381-01

	USEPA	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u>	<u>Qualifiers</u>	<u>Date</u>	<u>Analyst</u>
	MCL ()								
EPA 524.2									
1,1,1,2-Tetrachloroethane	-	ND	ug/L	0.30	1.00	1		12/28/10	MRD
1,1,1-Trichloroethane	(200)	ND	ug/L	0.50	1.70	1		12/28/10	MRD
1,1,2,2-Tetrachloroethane	-	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1,2-Trichloroethane	(5)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1-Dichloroethane	-	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1-Dichloroethylene	(7)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1-Dichloropropylene	-	ND	ug/L	0.80	2.70	1		12/28/10	MRD
1,2,3-Trichloropropane	-	ND	ug/L	1.00	3.30	1		12/28/10	MRD
1,2,4-Trichlorobenzene	(70)	ND	ug/L	0.50	1.70	1		12/28/10	MRD
1,2-Dichlorobenzene	(600)	ND	ug/L	0.80	2.70	1		12/28/10	MRD
1,2-Dichloroethane	(5)	ND	ug/L	0.30	1.00	1		12/28/10	MRD
1,2-Dichloropropane	(5)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,3-Dichlorobenzene	-	ND	ug/L	0.20	0.67	1		12/28/10	MRD
1,3-Dichloropropane	-	ND	ug/L	0.20	0.67	1		12/28/10	MRD
1,3-Dichloropropylene (Total)	-	ND	ug/L	0.40	1.33	1		12/28/10	MRD
1,4-Dichlorobenzene	(75)	ND	ug/L	0.80	2.70	1		12/28/10	MRD
2,2-Dichloropropane	-	ND	ug/L	1.00	3.30	1		12/28/10	MRD
2-Chlorotoluene	-	ND	ug/L	0.30	1.00	1		12/28/10	MRD
4-Chlorotoluene	-	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Benzene	(5)	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Bromobenzene	-	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Bromodichloromethane	(80)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Bromoform	(80)	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Bromomethane	-	ND	ug/L	1.00	3.30	1		12/28/10	MRD
Carbon Tetrachloride	(5)	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Chlorobenzene	(100)	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Chloroethane	-	ND	ug/L	0.70	2.30	1		12/28/10	MRD
Chloroform	(80)	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Chloromethane	-	ND	ug/L	0.40	1.30	1		12/28/10	MRD
cis-1,2-Dichloroethylene	(70)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Dibromochloromethane	(80)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Dibromomethane	-	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Ethylbenzene	(700)	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Methylene Chloride	(5)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Styrene	(100)	ND	ug/L	0.10	0.50	1		12/28/10	MRD
Tetrachloroethene	(5)	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Toluene	(1000)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
trans-1,2-Dichloroethylene	(100)	ND	ug/L	0.50	1.70	1		12/28/10	MRD

SIEMENS

SAMPLE SUMMARY

<u>Lab Id</u>	<u>Client</u>	<u>Sample Id</u>	<u>Date/Time</u>	<u>Matrix</u>
1012381-01	CW-11		12/21/10 09:00	Drinking Water
1012381-02	CW-15		12/21/10 09:05	Drinking Water
1012381-03	CW-16		12/21/10 09:10	Drinking Water
1012381-04	CW-17		12/21/10 09:15	Drinking Water
1012381-05	CW-19		12/21/10 09:20	Drinking Water
1012381-06	Tower A		12/21/10 09:25	Drinking Water
1012381-07	Tower B		12/21/10 09:30	Drinking Water
1012381-08	Product (Finished)		12/21/10 09:35	Drinking Water

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1012381
DATE REC'D : 12/22/10 12:27
REPORT DATE : 01/04/11 10:55
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-11

Matrix: Drinking Water

Sample Date/Time: 12/21/10 9:00

Lab No. : 1012381-01

USEPA

MCL

()

Results

Units

LOD

LOQ

Dilution

Factor

Qualifiers

Date

Analyzed

Analyst

EPA 524.2 Continued

Trichloroethene	(5)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Vinyl chloride	(0.2)	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Xylenes, (Total)	(1000)	ND	ug/L	1.00	1.00	1		12/28/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1012381
DATE REC'D : 12/22/10 12:27
REPORT DATE : 01/04/11 10:55
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-15	Matrix: Drinking Water	Sample Date/Time: 12/21/10 9:05	Lab No. : 1012381-02						
USEPA MCL									
()	Results	Units	LOD	LOG	Dilution Factor	Qualifiers	Date Analyzed	Analyst	
EPA 524.2									
1,1,1,2-Tetrachloroethane	-	ND	ug/L	0.30	1.00	1	12/28/10	MRD	
1,1,1-Trichloroethane	(200)	ND	ug/L	0.50	1.70	1	12/28/10	MRD	
1,1,2,2-Tetrachloroethane	-	ND	ug/L	0.40	1.30	1	12/28/10	MRD	
1,1,2-Trichloroethane	(5)	ND	ug/L	0.40	1.30	1	12/28/10	MRD	
1,1-Dichloroethane	-	ND	ug/L	0.40	1.30	1	12/28/10	MRD	
1,1-Dichloroethylene	(7)	ND	ug/L	0.40	1.30	1	12/28/10	MRD	
1,1-Dichloropropylene	-	ND	ug/L	0.80	2.70	1	12/28/10	MRD	
1,2,3-Trichloropropane	-	ND	ug/L	1.00	3.30	1	12/28/10	MRD	
1,2,4-Trichlorobenzene	(70)	ND	ug/L	0.50	1.70	1	12/28/10	MRD	
1,2-Dichlorobenzene	(600)	ND	ug/L	0.80	2.70	1	12/28/10	MRD	
1,2-Dichloroethane	(5)	ND	ug/L	0.30	1.00	1	12/28/10	MRD	
1,2-Dichloropropane	(5)	ND	ug/L	0.40	1.30	1	12/28/10	MRD	
1,3-Dichlorobenzene	-	ND	ug/L	0.20	0.67	1	12/28/10	MRD	
1,3-Dichloropropane	-	ND	ug/L	0.20	0.67	1	12/28/10	MRD	
1,3-Dichloropropylene (Total)	-	ND	ug/L	0.40	1.33	1	12/28/10	MRD	
1,4-Dichlorobenzene	(75)	ND	ug/L	0.80	2.70	1	12/28/10	MRD	
2,2-Dichloropropane	-	ND	ug/L	1.00	3.30	1	12/28/10	MRD	
2-Chlorotoluene	-	ND	ug/L	0.30	1.00	1	12/28/10	MRD	
4-Chlorotoluene	-	ND	ug/L	0.30	1.00	1	12/28/10	MRD	
Benzene	(5)	ND	ug/L	0.20	0.67	1	12/28/10	MRD	
Bromobenzene	-	ND	ug/L	0.30	1.00	1	12/28/10	MRD	
Bromodichloromethane	(80)	ND	ug/L	0.40	1.30	1	12/28/10	MRD	
Bromoform	(80)	ND	ug/L	0.20	0.67	1	12/28/10	MRD	
Bromomethane	-	ND	ug/L	1.00	3.30	1	12/28/10	MRD	
Carbon Tetrachloride	(5)	ND	ug/L	0.30	1.00	1	12/28/10	MRD	
Chlorobenzene	(100)	ND	ug/L	0.20	0.67	1	12/28/10	MRD	
Chloroethane	-	ND	ug/L	0.70	2.30	1	12/28/10	MRD	
Chloroform	(80)	0.70	ug/L	0.20	0.67	1	12/28/10	MRD	
Chloromethane	-	ND	ug/L	0.40	1.30	1	12/28/10	MRD	
cis-1,2-Dichloroethylene	(70)	ND	ug/L	0.40	1.30	1	12/28/10	MRD	
Dibromochloromethane	(80)	ND	ug/L	0.40	1.30	1	12/28/10	MRD	
Dibromomethane	-	ND	ug/L	0.40	1.30	1	12/28/10	MRD	
Ethylbenzene	(700)	ND	ug/L	0.20	0.67	1	12/28/10	MRD	
Methylene Chloride	(5)	ND	ug/L	0.40	1.30	1	12/28/10	MRD	
Styrene	(100)	ND	ug/L	0.10	0.50	1	12/28/10	MRD	
Tetrachloroethene	(5)	ND	ug/L	0.30	1.00	1	12/28/10	MRD	
Toluene	(1000)	ND	ug/L	0.40	1.30	1	12/28/10	MRD	
trans-1,2-Dichloroethylene	(100)	ND	ug/L	0.50	1.70	1	12/28/10	MRD	

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1012381
DATE REC'D : 12/22/10 12:27
REPORT DATE : 01/04/11 10:55
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-15

Matrix: Drinking Water

Sample Date/Time: 12/21/10 9:05

Lab No. : 1012381-02

USEPA MCL ()	Results	Units	LOD	LOQ	Dilution Factor	Qualifiers	Date Analyzed	Analyst

EPA 524.2 Continued

Trichloroethene	(5)	ND	ug/L	0.40	1.30	1	12/28/10	MRD
Vinyl chloride	(0.2)	ND	ug/L	0.20	0.67	1	12/28/10	MRD
Xylenes, (Total)	(1000)	ND	ug/L	1.00	1.00	1	12/28/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1012381
DATE REC'D : 12/22/10 12:27
REPORT DATE : 01/04/11 10:55
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-18	Matrix: Drinking Water	Sample Date/Time: 12/21/10 9:10	Lab No.: 1012381-03						
USEPA				Dilution		Date			
MCL	Results	Units	LOD	LOQ	Factor	Qualifiers	Analyzed	Analyst	
()									
EPA 524.2									
1,1,1,2-Tetrachloroethane	-	ND	ug/L	0.30	1.00	1	12/29/10	MRD	
1,1,1-Trichloroethane	(200)	ND	ug/L	0.50	1.70	1	12/29/10	MRD	
1,1,2,2-Tetrachloroethane	-	ND	ug/L	0.40	1.30	1	12/29/10	MRD	
1,1,2-Trichloroethane	(5)	ND	ug/L	0.40	1.30	1	12/29/10	MRD	
1,1-Dichloroethane	-	ND	ug/L	0.40	1.30	1	12/29/10	MRD	
1,1-Dichloroethylene	(7)	ND	ug/L	0.40	1.30	1	12/29/10	MRD	
1,1-Dichloropropylene	-	ND	ug/L	0.80	2.70	1	12/29/10	MRD	
1,2,3-Trichloropropane	-	ND	ug/L	1.00	3.30	1	12/29/10	MRD	
1,2,4-Trichlorobenzene	(70)	ND	ug/L	0.50	1.70	1	12/29/10	MRD	
1,2-Dichlorobenzene	(600)	ND	ug/L	0.80	2.70	1	12/29/10	MRD	
1,2-Dichloroethane	(5)	ND	ug/L	0.30	1.00	1	12/29/10	MRD	
1,2-Dichloropropane	(5)	ND	ug/L	0.40	1.30	1	12/29/10	MRD	
1,3-Dichlorobenzene	-	ND	ug/L	0.20	0.67	1	12/29/10	MRD	
1,3-Dichloropropane	-	ND	ug/L	0.20	0.67	1	12/29/10	MRD	
1,3-Dichloropropylene (Total)	-	ND	ug/L	0.40	1.33	1	12/29/10	MRD	
1,4-Dichlorobenzene	(75)	ND	ug/L	0.80	2.70	1	12/29/10	MRD	
2,2-Dichloropropane	-	ND	ug/L	1.00	3.30	1	12/29/10	MRD	
2-Chlorotoluene	-	ND	ug/L	0.30	1.00	1	12/29/10	MRD	
4-Chlorotoluene	-	ND	ug/L	0.30	1.00	1	12/29/10	MRD	
Benzene	(5)	ND	ug/L	0.20	0.67	1	12/29/10	MRD	
Bromobenzene	-	ND	ug/L	0.30	1.00	1	12/29/10	MRD	
Bromodichloromethane	(80)	ND	ug/L	0.40	1.30	1	12/29/10	MRD	
Bromoform	(80)	ND	ug/L	0.20	0.67	1	12/29/10	MRD	
Bromomethane	-	ND	ug/L	1.00	3.30	1	12/29/10	MRD	
Carbon Tetrachloride	(5)	ND	ug/L	0.30	1.00	1	12/29/10	MRD	
Chlorobenzene	(100)	ND	ug/L	0.20	0.67	1	12/29/10	MRD	
Chloroethane	-	ND	ug/L	0.70	2.30	1	12/29/10	MRD	
Chloroform	(80)	ND	ug/L	0.20	0.67	1	12/29/10	MRD	
Chloromethane	-	ND	ug/L	0.40	1.30	1	12/29/10	MRD	
cis-1,2-Dichloroethylene	(70)	ND	ug/L	0.40	1.30	1	12/29/10	MRD	
Dibromochloromethane	(80)	ND	ug/L	0.40	1.30	1	12/29/10	MRD	
Dibromomethane	-	ND	ug/L	0.40	1.30	1	12/29/10	MRD	
Ethylbenzene	(700)	ND	ug/L	0.20	0.67	1	12/29/10	MRD	
Methylene Chloride	(5)	ND	ug/L	0.40	1.30	1	12/29/10	MRD	
Styrene	(100)	ND	ug/L	0.10	0.50	1	12/29/10	MRD	
Tetrachloroethene	(5)	ND	ug/L	0.30	1.00	1	12/29/10	MRD	
Toluene	(1000)	ND	ug/L	0.40	1.30	1	12/29/10	MRD	
trans-1,2-Dichloroethylene	(100)	ND	ug/L	0.50	1.70	1	12/29/10	MRD	

SIEMENS

Gannett Fleming, Inc.
 8025 Excelsior Drive
 Madison, WI 53717

PROJECT NO. : 34283.000
 REPORT NO. : 1012381
 DATE REC'D : 12/22/10 12:27
 REPORT DATE : 01/04/11 10:55
 PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-16

Matrix: Drinking Water

Sample Date/Time: 12/21/10 9:10

Lab No. : 1012381-03

USEPA
 MCL

()	Results	Units	LOD	LOQ	Dilution Factor	Qualifiers	Date Analyzed	Analyst
(5)	ND	ug/L	0.40	1.30	1		12/29/10	MRD
(0.2)	ND	ug/L	0.20	0.67	1		12/29/10	MRD
(1000)	ND	ug/L	1.00	1.00	1		12/29/10	MRD

EPA 524.2 Continued

Trichloroethene
 Vinyl chloride
 Xylenes, (Total)

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1012381
DATE REC'D : 12/22/10 12:27
REPORT DATE : 01/04/11 10:55
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-17

Matrix: Drinking Water

Sample Date/Time: 12/21/10 9:15

Lab No. : 1012381-04

USEPA MCL ()	Results	Units	LDD	LOQ	Dilution Factor	Qualifiers	Date		
							Analyzed	Analyst	
EPA 524.2									
1,1,1,2-Tetrachloroethane	-	ND	ug/L	0.30	1.00	1		12/28/10	MRD
1,1,1-Trichloroethane	(200)	ND	ug/L	0.50	1.70	1		12/28/10	MRD
1,1,2,2-Tetrachloroethane	-	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1,2-Trichloroethane	(5)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1-Dichloroethane	-	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1-Dichloroethylene	(7)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1-Dichloropropylene	-	ND	ug/L	0.80	2.70	1		12/28/10	MRD
1,2,3-Trichloropropane	-	ND	ug/L	1.00	3.30	1		12/28/10	MRD
1,2,4-Trichlorobenzene	(70)	ND	ug/L	0.50	1.70	1		12/28/10	MRD
1,2-Dichlorobenzene	(600)	ND	ug/L	0.80	2.70	1		12/28/10	MRD
1,2-Dichloroethane	(5)	ND	ug/L	0.30	1.00	1		12/28/10	MRD
1,2-Dichloropropane	(5)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,3-Dichlorobenzene	-	ND	ug/L	0.20	0.67	1		12/28/10	MRD
1,3-Dichloropropane	-	ND	ug/L	0.20	0.67	1		12/28/10	MRD
1,3-Dichloropropylene (Total)	-	ND	ug/L	0.40	1.33	1		12/28/10	MRD
1,4-Dichlorobenzene	(75)	ND	ug/L	0.80	2.70	1		12/28/10	MRD
2,2-Dichloropropane	-	ND	ug/L	1.00	3.30	1		12/28/10	MRD
2-Chlorotoluene	-	ND	ug/L	0.30	1.00	1		12/28/10	MRD
4-Chlorotoluene	-	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Benzene	(5)	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Bromobenzene	-	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Bromodichloromethane	(80)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Bromoform	(80)	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Bromomethane	-	ND	ug/L	1.00	3.30	1		12/28/10	MRD
Carbon Tetrachloride	(5)	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Chlorobenzene	(100)	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Chloroethane	-	ND	ug/L	0.70	2.30	1		12/28/10	MRD
Chloroform	(80)	0.74	ug/L	0.20	0.67	1		12/28/10	MRD
Chloromethane	-	ND	ug/L	0.40	1.30	1		12/28/10	MRD
cis-1,2-Dichloroethylene	(70)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Dibromochloromethane	(80)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Dibromomethane	-	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Ethylbenzene	(700)	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Methylene Chloride	(5)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Styrene	(100)	ND	ug/L	0.10	0.50	1		12/28/10	MRD
Tetrachloroethene	(5)	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Toluene	(1000)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
trans-1,2-Dichloroethylene	(100)	ND	ug/L	0.50	1.70	1		12/28/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1012381
DATE REC'D : 12/22/10 12:27
REPORT DATE : 01/04/11 10:55
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-17

Matrix: Drinking Water

Sample Date/Time: 12/21/10 9:15

Lab No. : 1012381-04

USEPA MCL ()	Results	Units	LOD	LOQ	Dilution Factor	Qualifiers	Date Analyzed	Analyst

EPA 524.2 Continued

Trichloroethene	(5)	ND	ug/L	0.40	1.30	1	12/28/10	MRD
Vinyl chloride	(0.2)	ND	ug/L	0.20	0.67	1	12/28/10	MRD
Xylenes, (Total)	(1000)	ND	ug/L	1.00	1.00	1	12/28/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1012381
DATE REC'D : 12/22/10 12:27
REPORT DATE : 01/04/11 10:55
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-19

Matrix: Drinking Water

Sample Date/Time: 12/21/10 9:20

Lab No. : 1012381-05

	USEPA	Results	Units	LOD	LOQ	Dilution Factor	Qualifiers	Date Analyzed	Analyst
	MCL ()								
EPA 524.2									
1,1,1,2-Tetrachloroethane	-	ND	ug/L	0.30	1.00	1		12/28/10	MRD
1,1,1-Trichloroethane	(200)	0.57	ug/L	0.50	1.70	1	J	12/28/10	MRD
1,1,2,2-Tetrachloroethane	-	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1,2-Trichloroethane	(5)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1-Dichloroethane	-	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1-Dichloroethylene	(7)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1-Dichloropropylene	-	ND	ug/L	0.80	2.70	1		12/28/10	MRD
1,2,3-Trichloropropane	-	ND	ug/L	1.00	3.30	1		12/28/10	MRD
1,2,4-Trichlorobenzene	(70)	ND	ug/L	0.50	1.70	1		12/28/10	MRD
1,2-Dichlorobenzene	(600)	ND	ug/L	0.80	2.70	1		12/28/10	MRD
1,2-Dichloroethane	(5)	ND	ug/L	0.30	1.00	1		12/28/10	MRD
1,2-Dichloropropane	(5)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,3-Dichlorobenzene	-	ND	ug/L	0.20	0.67	1		12/28/10	MRD
1,3-Dichloropropane	-	ND	ug/L	0.20	0.67	1		12/28/10	MRD
1,3-Dichloropropylene (Total)	-	ND	ug/L	0.40	1.33	1		12/28/10	MRD
1,4-Dichlorobenzene	(75)	ND	ug/L	0.80	2.70	1		12/28/10	MRD
2,2-Dichloropropane	-	ND	ug/L	1.00	3.30	1		12/28/10	MRD
2-Chlorotoluene	-	ND	ug/L	0.30	1.00	1		12/28/10	MRD
4-Chlorotoluene	-	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Benzene	(5)	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Bromobenzene	-	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Bromodichloromethane	(80)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Bromoform	(80)	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Bromomethane	-	ND	ug/L	1.00	3.30	1		12/28/10	MRD
Carbon Tetrachloride	(5)	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Chlorobenzene	(100)	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Chloroethane	-	ND	ug/L	0.70	2.30	1		12/28/10	MRD
Chloroform	(80)	0.87	ug/L	0.20	0.67	1		12/28/10	MRD
Chloromethane	-	ND	ug/L	0.40	1.30	1		12/28/10	MRD
cis-1,2-Dichloroethylene	(70)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Dibromochloromethane	(80)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Dibromomethane	-	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Ethylbenzene	(700)	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Methylene Chloride	(5)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Styrene	(100)	ND	ug/L	0.10	0.50	1		12/28/10	MRD
Tetrachloroethene	(5)	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Toluene	(1000)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
trans-1,2-Dichloroethylene	(100)	ND	ug/L	0.50	1.70	1		12/28/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1012381
DATE REC'D : 12/22/10 12:27
REPORT DATE : 01/04/11 10:55
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CW-19	Matrix: Drinking Water	Sample Date/Time: 12/21/10 9:20	Lab No. : 1012381-05					
USEPA MCL ()	Results	Units	LOD	LOQ	Dilution Factor	Qualifiers	Date Analyzed	Analyst
<u>EPA 524.2 Continued</u>								
Trichloroethene	(5)	2.49	ug/L	0.40	1.30	1	12/28/10	MRD
Vinyl chloride	(0.2)	ND	ug/L	0.20	0.67	1	12/28/10	MRD
Xylenes, (Total)	(1000)	ND	ug/L	1.00	1.00	1	12/28/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1012381
DATE REC'D : 12/22/10 12:27
REPORT DATE : 01/04/11 10:55
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Tower A

Matrix: Drinking Water

Sample Date/Time: 12/21/10 9:25

Lab No.: 1012381-06

USEPA MCL ()	Results	Units	LOD	LOQ	Dilution Factor	Qualifiers	Date	
							Analyzed	Analys1
<u>EPA 524.2</u>								
1,1,1,2-Tetrachloroethane	-	ND	ug/L	0.30	1.00	1	12/28/10	MRD
1,1,1-Trichloroethane	(200)	ND	ug/L	0.50	1.70	1	12/28/10	MRD
1,1,2,2-Tetrachloroethane	-	ND	ug/L	0.40	1.30	1	12/28/10	MRD
1,1,2-Trichloroethane	(5)	ND	ug/L	0.40	1.30	1	12/28/10	MRD
1,1-Dichloroethane	-	ND	ug/L	0.40	1.30	1	12/28/10	MRD
1,1-Dichloroethylene	(7)	ND	ug/L	0.40	1.30	1	12/28/10	MRD
1,1-Dichloropropylene	-	ND	ug/L	0.80	2.70	1	12/28/10	MRD
1,2,3-Trichloropropane	-	ND	ug/L	1.00	3.30	1	12/28/10	MRD
1,2,4-Trichlorobenzene	(70)	ND	ug/L	0.50	1.70	1	12/28/10	MRD
1,2-Dichlorobenzene	(600)	ND	ug/L	0.80	2.70	1	12/28/10	MRD
1,2-Dichloroethane	(5)	ND	ug/L	0.30	1.00	1	12/28/10	MRD
1,2-Dichloropropane	(5)	ND	ug/L	0.40	1.30	1	12/28/10	MRD
1,3-Dichlorobenzene	-	ND	ug/L	0.20	0.67	1	12/28/10	MRD
1,3-Dichloropropane	-	ND	ug/L	0.20	0.67	1	12/28/10	MRD
1,3-Dichloropropylene (Total)	-	ND	ug/L	0.40	1.33	1	12/28/10	MRD
1,4-Dichlorobenzene	(75)	ND	ug/L	0.80	2.70	1	12/28/10	MRD
2,2-Dichloropropane	-	ND	ug/L	1.00	3.30	1	12/28/10	MRD
2-Chlorotoluene	-	ND	ug/L	0.30	1.00	1	12/28/10	MRD
4-Chlorotoluene	-	ND	ug/L	0.30	1.00	1	12/28/10	MRD
Benzene	(5)	ND	ug/L	0.20	0.67	1	12/28/10	MRD
Bromobenzene	-	ND	ug/L	0.30	1.00	1	12/28/10	MRD
Bromodichloromethane	(80)	ND	ug/L	0.40	1.30	1	12/28/10	MRD
Bromoform	(80)	ND	ug/L	0.20	0.67	1	12/28/10	MRD
Bromomethane	-	ND	ug/L	1.00	3.30	1	12/28/10	MRD
Carbon Tetrachloride	(5)	ND	ug/L	0.30	1.00	1	12/28/10	MRD
Chlorobenzene	(100)	ND	ug/L	0.20	0.67	1	12/28/10	MRD
Chloroethane	-	ND	ug/L	0.70	2.30	1	12/28/10	MRD
Chloroform	(80)	0.22	ug/L	0.20	0.67	1	J 12/28/10	MRD
Chloromethane	-	ND	ug/L	0.40	1.30	1	12/28/10	MRD
cis-1,2-Dichloroethylene	(70)	ND	ug/L	0.40	1.30	1	12/28/10	MRD
Dibromochloromethane	(80)	ND	ug/L	0.40	1.30	1	12/28/10	MRD
Dibromomethane	-	ND	ug/L	0.40	1.30	1	12/28/10	MRD
Ethylbenzene	(700)	ND	ug/L	0.20	0.67	1	12/28/10	MRD
Methylene Chloride	(5)	ND	ug/L	0.40	1.30	1	12/28/10	MRD
Styrene	(100)	ND	ug/L	0.10	0.50	1	12/28/10	MRD
Tetrachloroethene	(5)	ND	ug/L	0.30	1.00	1	12/28/10	MRD
Toluene	(1000)	ND	ug/L	0.40	1.30	1	12/28/10	MRD
trans-1,2-Dichloroethylene	(100)	ND	ug/L	0.50	1.70	1	12/28/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1012381
DATE REC'D : 12/22/10 12:27
REPORT DATE : 01/04/11 10:55
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Tower A

Matrix: Drinking Water

Sample Date/Time: 12/21/10 9:25

Lab No. : 1012381-06

USEPA MCL ()	Results	Units	LOD	LOQ	Dilution Factor	Qualifiers	Date Analyzed	Analyst

EPA 524.2 Continued

Trichloroethene	(5)	ND	ug/L	0.40	1.30	1	12/28/10	MRD
Vinyl chloride	(0.2)	ND	ug/L	0.20	0.67	1	12/28/10	MRD
Xylenes, (Total)	(1000)	ND	ug/L	1.00	1.00	1	12/28/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1012381
DATE REC'D : 12/22/10 12:27
REPORT DATE : 01/04/11 10:55
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Tower B

Matrix: Drinking Water

Sample Date/Time: 12/21/10 9:30

Lab No. : 1012381-07

USEPA MCL ()	Results	Units	LOD	LOQ	Dilution Factor	Qualifiers	Date		Analyst
							Analized		
EPA 524.2									
1,1,1,2-Tetrachloroethane	-	ND	ug/L	0.30	1.00	1		12/28/10	MRD
1,1,1-Trichloroethane	(200)	ND	ug/L	0.50	1.70	1		12/28/10	MRD
1,1,2,2-Tetrachloroethane	-	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1,2-Trichloroethane	(5)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1-Dichloroethane	-	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1-Dichloroethylene	(7)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1-Dichloropropylene	-	ND	ug/L	0.80	2.70	1		12/28/10	MRD
1,2,3-Trichloropropane	-	ND	ug/L	1.00	3.30	1		12/28/10	MRD
1,2,4-Trichlorobenzene	(70)	ND	ug/L	0.50	1.70	1		12/28/10	MRD
1,2-Dichlorobenzene	(600)	ND	ug/L	0.80	2.70	1		12/28/10	MRD
1,2-Dichloroethane	(5)	ND	ug/L	0.30	1.00	1		12/28/10	MRD
1,2-Dichloropropane	(5)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,3-Dichlorobenzene	-	ND	ug/L	0.20	0.67	1		12/28/10	MRD
1,3-Dichloropropane	-	ND	ug/L	0.20	0.67	1		12/28/10	MRD
1,3-Dichloropropylene (Total)	-	ND	ug/L	0.40	1.33	1		12/28/10	MRD
1,4-Dichlorobenzene	(75)	ND	ug/L	0.80	2.70	1		12/28/10	MRD
2,2-Dichloropropane	-	ND	ug/L	1.00	3.30	1		12/28/10	MRD
2-Chlorotoluene	-	ND	ug/L	0.30	1.00	1		12/28/10	MRD
4-Chlorotoluene	-	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Benzene	(5)	ND	ug/L	0.20	0.87	1		12/28/10	MRD
Bromobenzene	-	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Bromodichloromethane	(80)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Bromoform	(80)	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Bromomethane	-	ND	ug/L	1.00	3.30	1		12/28/10	MRD
Carbon Tetrachloride	(5)	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Chlorobenzene	(100)	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Chloroethane	-	ND	ug/L	0.70	2.30	1		12/28/10	MRD
Chloroform	(80)	0.28	ug/L	0.20	0.67	1	J	12/28/10	MRD
Chloromethane	-	ND	ug/L	0.40	1.30	1		12/28/10	MRD
cis-1,2-Dichloroethylene	(70)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Dibromochloromethane	(80)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Dibromomethane	-	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Ethylbenzene	(700)	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Methylene Chloride	(5)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Styrene	(100)	ND	ug/L	0.10	0.50	1		12/28/10	MRD
Tetrachloroethene	(5)	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Toluene	(1000)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
trans-1,2-Dichloroethylene	(100)	ND	ug/L	0.50	1.70	1		12/28/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1012381
DATE REC'D : 12/22/10 12:27
REPORT DATE : 01/04/11 10:55
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Tower B

Matrix: Drinking Water

Sample Date/Time: 12/21/10 9:30

Lab No. : 1012381-07

USEPA
MCL

()

Results

Units

LOD

LOQ

Dilution
Factor

Qualifiers

Date
Analyzed

Analyst

EPA 524.2 Continued

Trichloroethene	(5)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Vinyl chloride	(0.2)	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Xylenes, (Total)	(1000)	ND	ug/L	1.00	1.00	1		12/28/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1012381
DATE REC'D : 12/22/10 12:27
REPORT DATE : 01/04/11 10:55
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Product (Finished)	Matrix: Drinking Water	Sample Date/Time: 12/21/10 9:35	Lab No. : 1012381-08						
USEPA MCL						Dilution		Date	
()	Results	Units	LOD	LOQ	Factor	Qualifiers	Analysed	Analyst	
EPA 524.2									
1,1,1,2-Tetrachloroethane	-	ND	ug/L	0.30	1.00	1		12/28/10	MRD
1,1,1-Trichloroethane	(200)	ND	ug/L	0.50	1.70	1		12/28/10	MRD
1,1,2,2-Tetrachloroethane	-	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1,2-Trichloroethane	(5)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1-Dichloroethane	-	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1-Dichloroethylene	(7)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1-Dichloropropylene	-	ND	ug/L	0.80	2.70	1		12/28/10	MRD
1,2,3-Trichloropropane	-	ND	ug/L	1.00	3.30	1		12/28/10	MRD
1,2,4-Trichlorobenzene	(70)	ND	ug/L	0.50	1.70	1		12/28/10	MRD
1,2-Dichlorobenzene	(600)	ND	ug/L	0.80	2.70	1		12/28/10	MRD
1,2-Dichloroethane	(5)	ND	ug/L	0.30	1.00	1		12/28/10	MRD
1,2-Dichloropropane	(5)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,3-Dichlorobenzene	-	ND	ug/L	0.20	0.67	1		12/28/10	MRD
1,3-Dichloropropane	-	ND	ug/L	0.20	0.67	1		12/28/10	MRD
1,3-Dichloropropylene (Total)	-	ND	ug/L	0.40	1.33	1		12/28/10	MRD
1,4-Dichlorobenzene	(75)	ND	ug/L	0.80	2.70	1		12/28/10	MRD
2,2-Dichloropropane	-	ND	ug/L	1.00	3.30	1		12/28/10	MRD
2-Chlorotoluene	-	ND	ug/L	0.30	1.00	1		12/28/10	MRD
4-Chlorotoluene	-	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Benzene	(5)	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Bromobenzene	-	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Bromodichloromethane	(80)	3.23	ug/L	0.40	1.30	1		12/28/10	MRD
Bromoform	(80)	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Bromomethane	-	ND	ug/L	1.00	3.30	1		12/28/10	MRD
Carbon Tetrachloride	(5)	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Chlorobenzene	(100)	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Chloroethane	-	ND	ug/L	0.70	2.30	1		12/28/10	MRD
Chloroform	(80)	33.1	ug/L	0.20	0.67	1		12/28/10	MRD
Chloromethane	-	ND	ug/L	0.40	1.30	1		12/28/10	MRD
cis-1,2-Dichloroethylene	(70)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Dibromochloromethane	(80)	0.45	ug/L	0.40	1.30	1	J	12/28/10	MRD
Dibromomethane	-	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Ethylbenzene	(700)	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Methylene Chloride	(5)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Styrene	(100)	ND	ug/L	0.10	0.50	1		12/28/10	MRD
Tetrachloroethene	(5)	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Toluene	(1000)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
trans-1,2-Dichloroethylene	(100)	ND	ug/L	0.50	1.70	1		12/28/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1012381
DATE REC'D : 12/22/10 12:27
REPORT DATE : 01/04/11 10:55
PREPARED BY : BMS

Attn: Dave Ollg

Sample ID: Product (Finished)	Matrix: Drinking Water	Sample Date/Time: 12/21/10 9:35	Lab No. : 1012381-08						
	USEPA MCL ()	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> Factor	<u>Qualifiers</u>	<u>Date</u> Analyzed	<u>Analyst</u>
<u>EPA 524.2 Continued</u>									
Trichloroethene	(5)	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Vinyl chloride	(0.2)	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Xylenes, (Total)	(1000)	ND	ug/L	1.00	1.00	1		12/28/10	MRD

SIEMENS

Qualifier Descriptions

J Estimated concentration below laboratory quantitation level.

Definitions

LOD = Limit of Detection (Dilution Corrected)
LOQ = Limit of Quantitation (Dilution Corrected)
Reporting Limit = LOQ (Dilution Corrected)
ND = Not Detected
COMP = Complete
SUBCON = Subcontracted analysts
mv = millivolts
pci/L = picocuries per Liter
mL/L = milliliters per Liter
mg = milligram

When the word "dry" follows the units on the result page the sample results are dry weight corrected.

LODs and LOQs are dry weight corrected for all soils except WI GRO, EPA 8021 and WI DNR/EPA 8260B methanol and WI DNR methylene chloride preserved soils being reported to the State of Wisconsin.

ug/l = Micrograms per Liter = parts per billion (ppb)
ug/kg = Micrograms per kilogram = parts per billion (ppb)
mg/l = Milligrams per liter = parts per million (ppm)
mg/kg = Milligrams per kilogram = parts per million (ppm)
NOT PRES = Not Present
ppth = Parts per thousand
* = Result outside established limits.
mg/m3 = Milligrams per meter cubed
ng/L = Nanograms per Liter = Parts per trillion (ppt)
> = Greater Than

State of Wisconsin Methanol Soils for WI GRO, WI DNR/EPA 8260B and EPA 8021 are reported to the LOQ.

SIEMENS

Company Name <i>Cornett Planning</i>	Project <i>21253.000</i>	
Report Mailing Address <i>6025 Excelsior Dr. Madison, WI 53717</i>	Contact Name, Phone, Fax, Email <i>Dave Olig 608-836-1500 / 608-836-3377 D.Olig@siemens.com</i>	
Invoice Address <i>SAME</i>	Purchase Order # <i>Ref: Siemens General Price Quote 2010</i>	Invoice Contact and Phone No. <i>Dave Olig @ 608-836-1500</i>

Matrix: Drinking Water groundwater Wastewater/ Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: WI
(If Yes, please specify Agency or Regulation) Agency/Reg.: DNR

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1012381

Analyses Requested										Lab Use Only		
524 Drinking H ₂ O										Delivered by	Walk-in	<u>Courier</u>
										Ship. Cont. OK?	<input checked="" type="checkbox"/> Y	N NA
										Samples Leaking?	Y	<input checked="" type="checkbox"/> N NA
										Seals OK?	<input checked="" type="checkbox"/> Y	N NA
										Rec'd on Ice?	<input checked="" type="checkbox"/> Y	N NA
	Sample Receiving Comments:											
											2.8	
	Comments										3.16 HCL	

Lab Use Only	Sample		No. of Containers		Sample ID
	Date	Time	Comp	Grab	
-1	12-24-10	9:00		3	CW-11
-2	}	9:05		3	CW-15
-3		9:10		3	CW-16
-4		9:15		3	CW-17
-5		9:20		3	CW-19
-6		9:25		3	Tower A
-7		9:30		3	Tower B
				3	Power
-8	9:35		3	Product (Finished)	
			3		

Relinquished By:	Date	Time	Received By:
<i>Dave Dull</i>	12-24-10	1:15	
	12-22-10	12:27	<i>Jim Arden</i>

Chain of Custody Record

SIEMENS

January 10, 2011

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

Attn: Dave Olig

REPORT NO.: 1012382

PROJECT NO.: 34283.000


Please find enclosed the analytical report, including the Sample Summary, Sample Narrative and Chain of Custody for your sample set received December 22, 2010.

All analyses were performed in accordance with NELAC Standards using approved methods as indicated on this report.

If you have any questions about the results, please call. Thank you for using Siemens Water Technologies for your analytical needs.

Sincerely,

Siemens Water Technologies

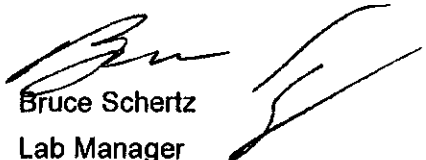
Bruce Schertz
Lab Manager
Enviroscan Analytical™ Services

I certify that the data contained in this report has been generated and reviewed in accordance with the Siemens Water Technologies Quality Assurance Program. Exceptions, if any, are discussed in the sample narrative. Samples will be retained for 30 days from the date of this report, then disposed in an appropriate manner. Siemens Water Technologies Corp. reserves the right to return samples identified as hazardous. Release of this Final Report is authorized as verified by the following signature. The contents of this report apply to the sample(s) analyzed. No duplication of this report is allowed except in its entirety.

Reviewed by: 

Certifications:

Wisconsin 737053130
Minnesota 055-999-302
Illinois 100317



Siemens Water Technologies Corp.

301 West Military Road
Rohlschild, WI 54474

Tel: 800-338-7226
Fax: 715-355-3221

www.siemens.com/enviroscan

The total number of pages in this report, including this page is 13.

Received 1/12/11
#34283.000
NPI
jcc 1/13/11

LABORATORY'S QUALITY VERIFICATION STATEMENT

Laboratory must provide a signed copy of this form with each deliverable specified in the Work Order or the deliverable will not be accepted. Laboratory must provide Gannett Fleming with a true copy of its internal QA/QC review and approval forms related to the deliverable.


This form must be signed by the Laboratory's Quality Control/Quality Assurance Officer

Project Name:

Gannett Fleming Project Number: 34283.000

Deliverable Description: Analytical Report

I, Cindy Varga, warrant and represent that the project deliverable described above and attached to this form was developed in accordance with the project scope of work and that all elements relating to the quality of the deliverable were verified in accordance with the requirements of my firm's internal quality management/quality assurance system. This deliverable satisfies all requirements of our Contract with Gannett Fleming.

Signature: 
(by Laboratory's QC/QA Officer)

Date: 1/12/11

Laboratory: Siemens Water Technologies

'Deliverable' shall mean all aspects of design including, without limitation, drawings, calculations, maps, materials and specifications, reports, data bases, logs and other information developed from wells, borings and cores, laboratory data, materials schedules, instrument calibration data and all other items developed, prepared and delivered to Gannett Fleming by Contractor as specified in the Scope of Work in any media.

bw 10.2.09

SIEMENS

SAMPLE SUMMARY

<u>Lab Id</u>	<u>Client</u>	<u>Sample Id</u>	<u>Date/Time</u>	<u>Matrix</u>
1012382-01	✓ RW-16		12/20/10 10:00	Ground Water
1012382-02	✓ RW-16B		12/20/10 10:10	Ground Water
1012382-03	✓ RW-16C		12/20/10 10:20	Ground Water
1012382-04	✓ RW-16C Dup		12/20/10 10:20	Ground Water
1012382-05	✓ MW-45A		12/20/10 10:45	Ground Water
1012382-06	✓ MW-45B		12/20/10 10:50	Ground Water
1012382-07	✓ MW-45C		12/20/10 10:55	Ground Water
1012382-08	✓ RW-3A		12/20/10 11:20	Ground Water
1012382-09	✓ RW-3B		12/20/10 11:25	Ground Water
1012382-10	✓ RW-3C		12/20/10 11:30	Ground Water
1012382-11	✓ EC-1		12/20/10 12:00	Ground Water
1012382-12	✓ EC-2		12/20/10 12:10	Ground Water
1012382-13	✓ MW-10A		12/21/10 10:00	Ground Water
1012382-14	✓ MW-10B		12/21/10 10:30	Ground Water
1012382-15	✓ MW-70A		12/21/10 12:15	Ground Water
1012382-16	✓ MW-34A		12/21/10 12:00	Ground Water
1012382-17	✓ MW-34B		12/21/10 12:30	Ground Water

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1012382
DATE REC'D: 12/22/10 12:37
REPORT DATE : 01/10/11 13:05
PREPARED BY : BMS

Attn: Dave Olig
Sample ID: RW-16

Matrix: Ground Water Sample Date/Time: 12/20/10 10:00 Lab No. : 1012382-01

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/27/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/27/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/27/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		12/27/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/29/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/27/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		12/29/10	MRD
Tetrachloroethene	0.36	ug/L	0.30	1.00	1	J	12/29/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/29/10	MRD
Trichloroethene	1.77	ug/L	0.40	1.30	1		12/29/10	MRD

Sample ID: RW-16B

Matrix: Ground Water Sample Date/Time: 12/20/10 10:10 Lab No. : 1012382-02

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	0.81	ug/L	0.50	1.70	1	J	12/27/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/27/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/27/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		12/27/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/27/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		12/27/10	MPM
Tetrachloroethene	0.30	ug/L	0.30	1.00	1	J	12/27/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Trichloroethene	5.07	ug/L	0.40	1.30	1		12/27/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1012382
DATE REC'D: 12/22/10 12:37
REPORT DATE : 01/10/11 13:05
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: RW-16C

Matrix: Ground Water

Sample Date/Time: 12/20/10 10:20

Lab No. : 1012382-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	0.57	ug/L	0.50	1.70	1	J	12/27/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/27/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/27/10	MPM
Chloroform	0.23	ug/L	0.20	0.67	1	J	12/27/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/27/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		12/27/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/27/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Trichloroethene	4.02	ug/L	0.40	1.30	1		12/27/10	MPM

Sample ID: RW-16C Dup

Matrix: Ground Water

Sample Date/Time: 12/20/10 10:20

Lab No. : 1012382-04

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	0.57	ug/L	0.50	1.70	1	J	12/27/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/27/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/27/10	MPM
Chloroform	0.20	ug/L	0.20	0.67	1	J	12/27/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/27/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		12/27/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/27/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Trichloroethene	4.21	ug/L	0.40	1.30	1		12/27/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1012382
DATE REC'D: 12/22/10 12:37
REPORT DATE : 01/10/11 13:05
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: MW-45A

Matrix: Ground Water

Sample Date/Time: 12/20/10 10:45

Lab No. : 1012382-05

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/27/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/27/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/27/10	MPM
Chloroform	ND	ug/L	0.20	0.67	1		12/27/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/27/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		12/27/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/27/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Trichloroethene	0.82	ug/L	0.40	1.30	1	J	12/27/10	MPM

Sample ID: MW-45B

Matrix: Ground Water

Sample Date/Time: 12/20/10 10:50

Lab No. : 1012382-06

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	0.67	ug/L	0.50	1.70	1	J	12/27/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/27/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/27/10	MPM
Chloroform	0.60	ug/L	0.20	0.67	1	J	12/27/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/27/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		12/27/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/27/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Trichloroethene	4.36	ug/L	0.40	1.30	1		12/27/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1012382
DATE REC'D: 12/22/10 12:37
REPORT DATE : 01/10/11 13:05
PREPARED BY : BMS

Attn: Dave Olig
Sample ID: MW-45C

Matrix: Ground Water

Sample Date/Time: 12/20/10 10:55

Lab No. : 1012382-07

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	0.56	ug/L	0.50	1.70	1	J	12/27/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/27/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/27/10	MPM
Chloroform	0.42	ug/L	0.20	0.67	1	J	12/27/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/27/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		12/27/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/27/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Trichloroethene	3.55	ug/L	0.40	1.30	1		12/27/10	MPM

Sample ID: RW-3A

Matrix: Ground Water

Sample Date/Time: 12/20/10 11:20

Lab No. : 1012382-08

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/27/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/27/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/27/10	MPM
Chloroform	0.90	ug/L	0.20	0.67	1		12/27/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/27/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		12/27/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/27/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Trichloroethene	2.74	ug/L	0.40	1.30	1		12/27/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1012382
DATE REC'D: 12/22/10 12:37
REPORT DATE : 01/10/11 13:05
PREPARED BY : BMS

Attn: Dave Olig
Sample ID: RW-3B

Matrix: Ground Water Sample Date/Time: 12/20/10 11:25 Lab No. : 1012382-09

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	0.68	ug/L	0.50	1.70	1	J	12/27/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/27/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/27/10	MPM
Chloroform	0.46	ug/L	0.20	0.67	1	J	12/27/10	MPM
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/27/10	MPM
o-Xylene	ND	ug/L	0.20	0.67	1		12/27/10	MPM
Tetrachloroethene	0.32	ug/L	0.30	1.00	1	J	12/27/10	MPM
Toluene	ND	ug/L	0.40	1.30	1		12/27/10	MPM
Trichloroethene	4.73	ug/L	0.40	1.30	1		12/27/10	MPM

Sample ID: RW-3C

Matrix: Ground Water Sample Date/Time: 12/20/10 11:30 Lab No. : 1012382-10

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1-Trichloroethane	0.73	ug/L	0.50	1.70	1	J	12/28/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Chloroform	0.40	ug/L	0.20	0.67	1	J	12/28/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/28/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Trichloroethene	5.30	ug/L	0.40	1.30	1		12/28/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1012382
DATE REC'D: 12/22/10 12:37
REPORT DATE : 01/10/11 13:05
PREPARED BY : BMS

Attn: Dave Olig
Sample ID: EC-1

Matrix: Ground Water

Sample Date/Time: 12/20/10 12:00

Lab No. : 1012382-11

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/29/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/29/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/29/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/29/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/29/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/29/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/29/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/29/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/29/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/29/10	MRD
Trichloroethene	0.83	ug/L	0.40	1.30	1	J	12/29/10	MRD

Sample ID: EC-2

Matrix: Ground Water

Sample Date/Time: 12/20/10 12:10

Lab No. : 1012382-12

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/28/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/28/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/28/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Toluene	0.44	ug/L	0.40	1.30	1	J	12/28/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		12/28/10	MRD

Sample ID: MW-10A

Matrix: Ground Water

Sample Date/Time: 12/21/10 10:00

Lab No. : 1012382-13

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 6020 - Diss.</u>								
Dissolved Cadmium	24.1	ug/L	0.20	2.00	1		01/05/11	JCH

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1012382
DATE REC'D: 12/22/10 12:37
REPORT DATE : 01/10/11 13:05
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: MW-10B

Matrix: Ground Water

Sample Date/Time: 12/21/10 10:30

Lab No. : 1012382-14

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 6020 - Diss.</u> Dissolved Cadmium	3.34	ug/L	0.20	2.00	1		01/05/11	JCH

Sample ID: MW-70A

Matrix: Ground Water

Sample Date/Time: 12/21/10 12:15

Lab No. : 1012382-15

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/28/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/28/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/28/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Trichloroethene	0.43	ug/L	0.40	1.30	1	J	12/28/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000
REPORT NO. : 1012382
DATE REC'D: 12/22/10 12:37
REPORT DATE : 01/10/11 13:05
PREPARED BY : BMS

Attn: Dave Olig
Sample ID: MW-34A

Matrix: Ground Water

Sample Date/Time: 12/21/10 12:00

Lab No. : 1012382-16

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 6020 - Diss.</u> Dissolved Cadmium	1.71	ug/L	0.20	2.00	1	J	01/05/11	JCH
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/28/10	MRD
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/28/10	MRD
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Carbon Tetrachloride	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Chloroform	ND	ug/L	0.20	0.67	1		12/28/10	MRD
m,p-Xylenes	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Methylene Chloride	ND	ug/L	0.40	1.30	1		12/28/10	MRD
o-Xylene	ND	ug/L	0.20	0.67	1		12/28/10	MRD
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/28/10	MRD
Toluene	ND	ug/L	0.40	1.30	1		12/28/10	MRD
Trichloroethene	ND	ug/L	0.40	1.30	1		12/28/10	MRD

Sample ID: MW-34B

Matrix: Ground Water

Sample Date/Time: 12/21/10 12:30

Lab No. : 1012382-17

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 6020 - Diss.</u> Dissolved Cadmium	1.39	ug/L	0.20	2.00	1	J	01/05/11	JCH

SIEMENS

Qualifier Descriptions

J Estimated concentration below laboratory quantitation level.

Definitions

LOD = Limit of Detection (Dilution Corrected)
LOQ = Limit of Quantitation (Dilution Corrected)
Reporting Limit = LOQ (Dilution Corrected)
ND = Not Detected
COMP = Complete
SUBCON = Subcontracted analysis
mv = millivolts
pci/L = picocuries per Liter
mL/L = milliliters per Liter
mg = milligram

When the word "dry" follows the units on the result page the sample results are dry weight corrected.

LODs and LOQs are dry weight corrected for all soils except WI GRO and EPA 8021 methanol and WI DNR methylene chloride preserved soils.

ug/l = Micrograms per Liter = parts per billion (ppb)
ug/kg = Micrograms per kilogram = parts per billion (ppb)
mg/l = Milligrams per liter = parts per million (ppm)
mg/kg = Milligrams per kilogram = parts per million (ppm)
NOT PRES = Not Present
ppth = Parts per thousand
* = Result outside established limits.
mg/m³ = Milligrams per meter cubed
ng/L = Nanograms per Liter = Parts per trillion (ppt)
> = Greater Than

Methanol Soils for WI GRO and EPA 8021 are reported to the LOQ.

SIEMENS

Company Name <i>Cranett Fleming</i>	Marcia A Kuehl Data Validation	Project 31283.000
Report Mailing Address 8025 Excelsior Madison WI 53717	MA Kuehl Co 3470 Charles Dix Ct. Green Bay, WI	Contact Name, Phone, Fax, Email Dave Ohg 608-836-1500/608-831-3337 Dohg@cfnet.com
Invoice Address SAME	Purchase Order # Tier 1 Per Siemens General Price Quote 2410	Invoice Contact and Phone No. Dave Ohg 608-836-1500

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: WI
(If Yes, please specify Agency or Regulation) Agency/Reg.: DNR

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1012382

Analyses Requested										Lab Use Only			
Voc's MPE Oh's Grab											Delivered by	Walk-in	Gourier
											Ship. Cont. OK?	<input checked="" type="checkbox"/> Y	N
											Samples Leaking?	<input checked="" type="checkbox"/> Y	NA
											Seals OK?	<input checked="" type="checkbox"/> Y	NA
											Rec'd on Ice?	<input checked="" type="checkbox"/> Y	NA
	Sample Receiving Comments:												
											28		
	Comments												

Lab Use Only	Sample		No. of Containers		Sample ID							
	Date	Time	Comp	Grab								
-1	12-20-10	10:00		3	Rw-16	X						3 vials HCP
-2		10:10			Rw-16B	X						
-3		10:20			Rw-16C	X						
-4		10:30			Rw-16C DUP	X						
-5		10:45			MW-45A	X						
-6		10:50			MW-45B	X						
-7		10:55			MW-45C	X						
-8		11:20			Rw-3A	X						
-9		11:25			Rw-3B	X						
-10		11:30			Rw-3C	X						

Relinquished By:	Date	Time	Received By:
<i>Dull Dull</i>	12-21-10	1:15	
	12-22-10	1237	<i>Jim Andrew</i>

Chain of Custody Record

SIEMENS

December 27, 2010

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

Attn: Dave Olig

RECEIVED	
GANNETT FLEMING-MADISON, WI	
FILE NO:	<u>34283.000</u>
	(NPI)
	DEC 30 2010
REVIEWED BY:	<u>df</u>
DATE:	<u>12/30/10</u>
ROUTE TO:	<u>jcc 1/12/2011</u>

REPORT NO.: 1012301

PROJECT NO.: 34283.000 National Presto

Please find enclosed the analytical report, including the Sample Summary, Sample Narrative and Chain of Custody for your sample set received December 17, 2010.

All analyses were performed in accordance with NELAC Standards using approved methods as indicated on this report.

If you have any questions about the results, please call. Thank you for using Siemens Water Technologies for your analytical needs.

Sincerely,

Siemens Water Technologies


Bruce Schertz
Lab Manager
Enviroscan Analytical™ Services

I certify that the data contained in this report has been generated and reviewed in accordance with the Siemens Water Technologies Quality Assurance Program. Exceptions, if any, are discussed in the sample narrative. Samples will be retained for 30 days from the date of this report, then disposed in an appropriate manner. Siemens Water Technologies Corp. reserves the right to return samples identified as hazardous. Release of this Final Report is authorized as verified by the following signature. The contents of this report apply to the sample(s) analyzed. No duplication of this report is allowed except in its entirety.

Reviewed by: 

Certifications:

Wisconsin 737053130
Minnesota 055-999-302
Illinois 100317



Siemens Water Technologies Corp.

301 West Military Road
Rothschild, WI 54474

Tel: 800-338-7226
Fax: 715-355-3221
www.siemens.com/enviroscan

LABORATORY'S QUALITY VERIFICATION STATEMENT

Laboratory must provide a signed copy of this form with each deliverable specified in the Work Order or the deliverable will not be accepted. Laboratory must provide Gannett Fleming with a true copy of its internal QA/QC review and approval forms related to the deliverable.

This form must be signed by the Laboratory's Quality Control/Quality Assurance Officer

Project Name:

Gannett Fleming Project Number: 34283.000

Deliverable Description: Analytical Report

I, Cindy Varga, warrant and represent that the project deliverable described above and attached to this form was developed in accordance with the project scope of work and that all elements relating to the quality of the deliverable were verified in accordance with the requirements of my firm's internal quality management/quality assurance system. This deliverable satisfies all requirements of our Contract with Gannett Fleming.

Signature: Cindy Varga
(by Laboratory's QC/QA Officer)

Date: 12/25/10

Laboratory: Siemens Water Technologies

'Deliverable' shall mean all aspects of design including, without limitation, drawings, calculations, maps, materials and specifications, reports, data bases, logs and other information developed from wells, borings and cores, laboratory data, materials schedules, instrument calibration data and all other items developed, prepared and delivered to Gannett Fleming by Contractor as specified in the Scope of Work in any media.

bw 10.2.09

SIEMENS

SAMPLE SUMMARY

<u>Lab Id</u>	<u>Client</u> <u>Sample Id</u>	<u>Date/Time</u>	<u>Matrix</u>
1012301-01	EW-5	12/16/10 14:00	Ground Water
1012301-02	M.H. #18	12/16/10 13:50	Ground Water
1012301-03	Trip Blank	12/16/10 00:00	Water

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 National Presto
REPORT NO. : 1012301
DATE REC'D : 12/17/10 10:51
REPORT DATE : 12/27/10 13:27
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: **EW-5**

Matrix: **Ground Water**

Sample Date/Time: **12/16/10 14:00**

Lab No. : **1012301-01**

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/22/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/22/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/22/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/22/10	MPM
Trichloroethene	1.03	ug/L	0.40	1.30	1	J	12/22/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 National Presto
REPORT NO. : 1012301
DATE REC'D : 12/17/10 10:51
REPORT DATE : 12/27/10 13:27
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: M.H. #18

Matrix: Ground Water

Sample Date/Time: 12/16/10 13:50

Lab No. : 1012301-02

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>Calculated</u>								
Trivalent Chromium	2.13	ug/L	1.60	1.60	1		12/22/10	BMS
<u>EPA 150.1</u>								
pH	6.79	pH Units			1		12/20/10 9:35	JJP
<u>EPA 200.8/6020</u>								
ICPMS Liquid Metal Prep	Completed	N/A			1		12/21/10	JCH
<u>EPA 6020 - Total</u>								
Total Arsenic	ND	ug/L	0.60	2.00	1		12/21/10	JCH
Total Cadmium	0.23	ug/L	0.20	2.00	1	J	12/21/10	JCH
Total Chromium	2.13	ug/L	1.60	5.00	1	J	12/21/10	JCH
Total Copper	2.33	ug/L	0.60	2.00	1		12/21/10	JCH
Total Lead	ND	ug/L	0.30	2.00	1		12/21/10	JCH
Total Nickel	34.7	ug/L	0.30	2.00	1		12/21/10	JCH
Total Zinc	39.7	ug/L	2.00	5.00	1		12/21/10	JCH
<u>EPA 7196A</u>								
Hexavalent Chromium	ND	mg/L	0.004	0.020	1	HT	12/21/10 11:45	BMS
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/22/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/22/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/22/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/22/10	MPM
Trichloroethene	0.72	ug/L	0.40	1.30	1	J	12/22/10	MPM
<u>EPA 8310</u>								
<i>Prep Method: Method 3510C Liquid Extraction</i>	<i>By: KAM</i>						<i>Date Prepared: 12/21/10</i>	
1-Methylnaphthalene	ND	ug/L	0.080	0.260	1		12/21/10	LMP
2-Methylnaphthalene	ND	ug/L	0.110	0.370	1		12/21/10	LMP
Acenaphthene	ND	ug/L	0.120	0.400	1		12/21/10	LMP
Acenaphthylene	ND	ug/L	0.120	0.400	1		12/21/10	LMP
Acene	ND	ug/L	0.090	0.300	1		12/21/10	LMP
Benzo(a)anthracene	ND	ug/L	0.100	0.330	1		12/21/10	LMP
Benzo(a)pyrene	ND	ug/L	0.020	0.100	1		12/21/10	LMP

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 National Presto
REPORT NO. : 1012301
DATE REC'D : 12/17/10 10:51
REPORT DATE : 12/27/10 13:27
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: M.H. #18

Matrix: Ground Water

Sample Date/Time: 12/16/10 13:50

Lab No. : 1012301-02

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8310 Continued</u>								
<i>Prep Method: Method 3510C Liquid Extraction</i>		<i>By: KAM</i>					<i>Date Prepared:</i>	12/21/10
Benzo(b)fluoranthene	ND	ug/L	0.040	0.130	1		12/21/10	LMP
Benzo(g,h,i)perylene	ND	ug/L	0.060	0.200	1		12/21/10	LMP
Benzo(k)fluoranthene	ND	ug/L	0.070	0.233	1		12/21/10	LMP
Chrysene	ND	ug/L	0.030	0.110	1		12/21/10	LMP
Dibenzo(a,h)anthracene	ND	ug/L	0.110	0.370	1		12/21/10	LMP
Fluoranthene	ND	ug/L	0.120	0.400	1		12/21/10	LMP
Fluorene	ND	ug/L	0.120	0.400	1		12/21/10	LMP
Indeno(1,2,3-cd)pyrene	ND	ug/L	0.120	0.400	1		12/21/10	LMP
Naphthalene	ND	ug/L	0.110	0.370	1		12/21/10	LMP
Phenanthrene	ND	ug/L	0.110	0.370	1		12/21/10	LMP
Pyrene	ND	ug/L	0.100	0.330	1		12/21/10	LMP
<u>SM 2340B - Total</u>								
Total Hardness as CaCO3	52.6	mg/L	0.660	0.660	1		12/21/10	DJB

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 National Presto
REPORT NO. : 1012301
DATE REC'D : 12/17/10 10:51
REPORT DATE : 12/27/10 13:27
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: Trip Blank

Matrix: Water

Sample Date/Time: 12/16/10 0:00

Lab No. : 1012301-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1-Trichloroethane	ND	ug/L	0.50	1.70	1		12/22/10	MPM
1,1-Dichloroethane	ND	ug/L	0.40	1.30	1		12/22/10	MPM
1,1-Dichloroethylene	ND	ug/L	0.40	1.30	1		12/22/10	MPM
Tetrachloroethene	ND	ug/L	0.30	1.00	1		12/22/10	MPM
Trichloroethene	ND	ug/L	0.40	1.30	1		12/22/10	MPM

SIEMENS

Qualifier Descriptions

J	Estimated concentration below laboratory quantitation level.
HT	This result was analyzed outside of the EPA recommended holding time.
COMP	Completed

Definitions

LOD = Limit of Detection (Dilution Corrected)
LOQ = Limit of Quantitation (Dilution Corrected)
Reporting Limit = LOQ (Dilution Corrected)
ND = Not Detected
COMP = Complete
SUBCON = Subcontracted analysis
mv = millivolts
pci/L = picocuries per Liter
mL/L = milliliters per Liter
mg = milligram

When the word "dry" follows the units on the result page the sample results are dry weight corrected.

LODs and LOQs are dry weight corrected for all soils except WI GRO, EPA 8021 and WI DNR/EPA 8260B methanol and WI DNR methylene chloride preserved being reported to the State of Wisconsin.

ug/l = Micrograms per Liter = parts per billion (ppb)
ug/kg = Micrograms per kilogram = parts per billion (ppb)
mg/l = Milligrams per liter = parts per million (ppm)
mg/kg = Milligrams per kilogram = parts per million (ppm)
NOT PRES = Not Present
ppth = Parts per thousand
* = Result outside established limits.
mg/m3 = Milligrams per meter cubed
ng/L = Nanograms per Liter = Parts per trillion(ppt)
> = Greater Than

State of Wisconsin Methanol Soils for WI GRO, WI DNR/EPA 8260B and EPA 8021 are reported to the LOQ.

SIEMENS

Company Name GANNETT-FLEMING	MARCEA A. RUEHL DATA VALIDATION	Project 34283000
Report Mailing Address 8025 EXCELSIOR DR. MADISON, WI. 53717	3470 CARLETON CT. GREEN BAY, WI.	Contact Name, Phone, Fax, Email DAVE OLIG 608-836-1500 / 608-831-3337
Invoice Address SAME		Purchase Order # TIER 1 PER SIEMENS GENERAL PRICE QUOTE 2010
		Invoice Contact and Phone No. DAVE OLIG 608-836-1500

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: WI.
(If Yes, please specify Agency or Regulation) Agency/Reg.: WDNR.

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1012301

Analyses Requested							Lab Use Only		
							Delivered by:	Walk-in	Courier
<u>VOCS</u>	<u>PH TEST.</u>	<u>METALS</u>	<u>PAH</u>	<u>As, Cd, Cr, Cr13, Cr+6</u>	<u>Cu, Pb, Ni, Zn, lead?</u>	<u>quantity list</u>	Ship. Cont. OK?	<u>Y</u>	<u>N</u>
							Samples Leaking?	<u>Y</u>	<u>N</u>
							Seals OK?	<u>Y</u>	<u>N</u>
							Rec'd on Ice?	<u>Y</u>	<u>N</u>
							Sample Receiving Comments:		
							Comments		

Lab Use Only	Sample		No. of Containers		Sample ID
	Date	Time	Comp	Grab	
-01	12-16-10	1400	3		EW-5
		1350	3		M.H. #18
-02		?	1		M.H. #18
			1		M.H. #18
			3		M.H. #18
			2		TRIP BLANK

Chain of Custody
Record

Relinquished By:	Date	Time	Received By:
<u>M. J. Kobliska</u>	<u>12/16/10</u>	<u>1500</u>	
	<u>12/17/10</u>	<u>1040</u>	<u>J. P. Saltzman</u>

SIEMENS

November 17, 2010

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

Attn: Dave Olig

RECEIVED	
GANNETT FLEMING-MADISON, WI	
FILE NO:	<u>34283.000</u>
	(NPI)
	NOV 19 2010
REVIEWED BY:	<u>[Signature]</u>
DATE:	<u>11/22/10</u>
ROUTE TO:	_____

REPORT NO.: 1011010

PROJECT NO.: 34283.000 TOC & SPLP

Please find enclosed the analytical report, including the Sample Summary, Sample Narrative and Chain of Custody for your sample set received November 1, 2010.

All analyses were performed in accordance with NELAC Standards using approved methods as indicated on this report.

If you have any questions about the results, please call. Thank you for using Siemens Water Technologies for your analytical needs.

Sincerely,

Siemens Water Technologies



Bruce Schertz
Lab Manager
Enviroscan Analytical™ Services

I certify that the data contained in this report has been generated and reviewed in accordance with the Siemens Water Technologies Quality Assurance Program. Exceptions, if any, are discussed in the sample narrative. Samples will be retained for 30 days from the date of this report, then disposed in an appropriate manner. Siemens Water Technologies Corp. reserves the right to return samples identified as hazardous. Release of this Final Report is authorized as verified by the following signature. The contents of this report apply to the sample(s) analyzed. No duplication of this report is allowed except in its entirety.

Reviewed by: [Signature]

Certifications:

Wisconsin 737053130
Minnesota 055-999-302
Illinois 100317



Siemens Water Technologies Corp.

301 West Military Road
Rothschild, WI 54474

Tel: 800-338-7226
Fax: 715-355-3221

www.siemens.com/enviroscan

SAMPLE SUMMARY

<u>Lab Id</u>	<u>Client Sample Id</u>	<u>Date/Time</u>	<u>Matrix</u>
1011010-01	NS1 - TOC	10/28/10 11:00	Soil
1011010-02	NS2 - TOC	10/28/10 11:18	Soil
1011010-03	CB1 -L	10/29/10 10:24	Soil
1011010-04	CB2 -L	10/29/10 10:36	Soil
1011010-05	CB4 -L	10/29/10 11:03	Soil

LABORATORY'S QUALITY VERIFICATION STATEMENT

Laboratory must provide a signed copy of this form with each deliverable specified in the Work Order or the deliverable will not be accepted. Laboratory must provide Gannett Fleming with a true copy of its internal QA/QC review and approval forms related to the deliverable.

This form must be signed by the Laboratory's Quality Control/Quality Assurance Officer

Project Name: NPI

Gannett Fleming Project Number: 34283.000

Deliverable Description: Analytical Report

I, Cindy Varga, warrant and represent that the project deliverable described above and attached to this form was developed in accordance with the project scope of work and that all elements relating to the quality of the deliverable were verified in accordance with the requirements of my firm's internal quality management/quality assurance system. This deliverable satisfies all requirements of our Contract with Gannett Fleming.

Signature: Cindy Varga
(by Laboratory's QC/QA Officer)

Date: 11/17/10

Laboratory: Siemens Water Technologies

'Deliverable' shall mean all aspects of design including, without limitation, drawings, calculations, maps, materials and specifications, reports, data bases, logs and other information developed from wells, borings and cores, laboratory data, materials schedules, instrument calibration data and all other items developed, prepared and delivered to Gannett Fleming by Contractor as specified in the Scope of Work in any media.

bw 10.2.09

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 TOC & SPLP
REPORT NO. : 1011010
DATE REC'D : 11/01/10 12:35
REPORT DATE : 11/17/10 07:28
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CB1 -L Matrix: Soil Sample Date/Time: 10/29/10 10:24 Lab No. : 1011010-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 1312								
Prep Method: EPA 1312 - SPLP Extraction	By: SMM					Date Prepared: 11/01/10		
Fluid Used	Completed				1		11/02/10	SMM
EPA 8260B								
1,1,1,2-Tetrachloroethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,1,1-Trichloroethane - SPLP	123	ug/L	4.00	13.4	20		11/11/10	MRD
1,1,2,2-Tetrachloroethane - SPLP	ND	ug/L	6.00	20.0	20		11/11/10	MRD
1,1,2-Trichloroethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,1-Dichloroethane - SPLP	12.6	ug/L	4.00	13.4	20	J	11/11/10	MRD
1,1-Dichloroethylene - SPLP	ND	ug/L	8.00	26.0	20		11/11/10	MRD
1,1-Dichloropropylene - SPLP	ND	ug/L	6.00	20.0	20		11/11/10	MRD
1,2,3-Trichlorobenzene - SPLP	ND	ug/L	10.0	34.0	20		11/11/10	MRD
1,2,3-Trichloropropane - SPLP	ND	ug/L	12.0	40.0	20		11/11/10	MRD
1,2,4-Trichlorobenzene - SPLP	ND	ug/L	10.0	34.0	20		11/11/10	MRD
1,2,4-Trimethylbenzene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,2-Dibromo-3-chloropropane - SPLP	ND	ug/L	20.0	66.0	20		11/11/10	MRD
1,2-Dibromoethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,2-Dichlorobenzene - SPLP	ND	ug/L	16.0	54.0	20		11/11/10	MRD
1,2-Dichloroethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,2-Dichloropropane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,3,5-Trimethylbenzene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,3-Dichlorobenzene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,3-Dichloropropane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,4-Dichlorobenzene - SPLP	ND	ug/L	16.0	54.0	20		11/11/10	MRD
2,2-Dichloropropane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
2-Chlorotoluene - SPLP	ND	ug/L	2.00	10.0	20		11/11/10	MRD
4-Chlorotoluene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
4-Isopropyltoluene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Benzene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Bromobenzene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Bromochloromethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Bromodichloromethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Bromoform - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Bromomethane - SPLP	ND	ug/L	20.0	66.6	20		11/11/10	MRD
Butylbenzene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Carbon Tetrachloride - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 TOC & SPLP
REPORT NO. : 1011010
DATE REC'D : 11/01/10 12:35
REPORT DATE : 11/17/10 07:28
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CB1 -L

Matrix: Soil

Sample Date/Time: 10/29/10 10:24

Lab No. : 1011010-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
Chlorobenzene - SPLP	ND	ug/L	2.00	10.0	20		11/11/10	MRD
Chloroethane - SPLP	ND	ug/L	12.0	40.0	20		11/11/10	MRD
Chloroform - SPLP	24.2	ug/L	4.00	13.4	20		11/11/10	MRD
Chloromethane - SPLP	ND	ug/L	6.00	20.0	20		11/11/10	MRD
cis-1,2-Dichloroethylene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
cis-1,3-Dichloropropylene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Dibromochloromethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Dibromomethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Dichlorodifluoromethane - SPLP	ND	ug/L	6.00	20.0	20	CSH	11/11/10	MRD
Ethylbenzene - SPLP	ND	ug/L	2.00	10.0	20		11/11/10	MRD
Hexachlorobutadiene - SPLP	ND	ug/L	20.0	66.0	20		11/11/10	MRD
Isopropylbenzene (Cumene) - SPLP	ND	ug/L	2.00	10.0	20		11/11/10	MRD
m,p-Xylenes - SPLP	ND	ug/L	8.00	26.0	20		11/11/10	MRD
Methylene Chloride - SPLP	19.2	ug/L	8.00	26.0	20	LBC, J	11/11/10	MRD
Methyl-tert-Butyl Ether - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Naphthalene - SPLP	ND	ug/L	20.0	66.0	20		11/11/10	MRD
o-Xylene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Propylbenzene - SPLP	ND	ug/L	2.00	10.0	20		11/11/10	MRD
sec-Butylbenzene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Styrene - SPLP	ND	ug/L	2.00	10.0	20		11/11/10	MRD
tert-Butylbenzene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Tetrachloroethene - SPLP	ND	ug/L	6.00	20.0	20		11/11/10	MRD
Toluene - SPLP	ND	ug/L	8.00	26.0	20		11/11/10	MRD
trans-1,2-Dichloroethylene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
trans-1,3-Dichloropropylene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Trichloroethene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Trichlorofluoromethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Vinyl Chloride - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 TOC & SPLP
REPORT NO. : 1011010
DATE REC'D 11/01/10 12:35
REPORT DATE : 11/17/10 07:28
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CB2 -L

Matrix: Soil

Sample Date/Time: 10/29/10 10:36

Lab No. : 1011010-04

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u>	<u>Analyst</u>
							<u>Analyzed</u>	
EPA 1312								
Prep Method: EPA 1312 - SPLP Extraction	By: SMM						Date Prepared: 11/01/10	
Fluid Used	Completed				1		11/02/10	SMM
EPA 8260B								
1,1,1,2-Tetrachloroethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,1,1-Trichloroethane - SPLP	41.5	ug/L	4.00	13.4	20		11/11/10	MRD
1,1,2,2-Tetrachloroethane - SPLP	ND	ug/L	6.00	20.0	20		11/11/10	MRD
1,1,2-Trichloroethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,1-Dichloroethane - SPLP	21.2	ug/L	4.00	13.4	20		11/11/10	MRD
1,1-Dichloroethylene - SPLP	ND	ug/L	8.00	26.0	20		11/11/10	MRD
1,1-Dichloropropylene - SPLP	ND	ug/L	6.00	20.0	20		11/11/10	MRD
1,2,3-Trichlorobenzene - SPLP	ND	ug/L	10.0	34.0	20		11/11/10	MRD
1,2,3-Trichloropropane - SPLP	ND	ug/L	12.0	40.0	20		11/11/10	MRD
1,2,4-Trichlorobenzene - SPLP	ND	ug/L	10.0	34.0	20		11/11/10	MRD
1,2,4-Trimethylbenzene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,2-Dibromo-3-chloropropane - SPLP	ND	ug/L	20.0	66.0	20		11/11/10	MRD
1,2-Dibromoethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,2-Dichlorobenzene - SPLP	ND	ug/L	16.0	54.0	20		11/11/10	MRD
1,2-Dichloroethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,2-Dichloropropane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,3,5-Trimethylbenzene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,3-Dichlorobenzene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,3-Dichloropropane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,4-Dichlorobenzene - SPLP	ND	ug/L	16.0	54.0	20		11/11/10	MRD
2,2-Dichloropropane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
2-Chlorotoluene - SPLP	ND	ug/L	2.00	10.0	20		11/11/10	MRD
4-Chlorotoluene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
4-Isopropyltoluene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Benzene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Bromobenzene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Bromochloromethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Bromodichloromethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Bromoform - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Bromomethane - SPLP	ND	ug/L	20.0	66.6	20		11/11/10	MRD
Butylbenzene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Carbon Tetrachloride - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 TOC & SPLP
REPORT NO. : 1011010
DATE REC'D : 11/01/10 12:35
REPORT DATE : 11/17/10 07:28
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CB2 -L

Matrix: Soil

Sample Date/Time: 10/29/10 10:36

Lab No. : 1011010-04

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
Chlorobenzene - SPLP	ND	ug/L	2.00	10.0	20		11/11/10	MRD
Chloroethane - SPLP	ND	ug/L	12.0	40.0	20		11/11/10	MRD
Chloroform - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Chloromethane - SPLP	ND	ug/L	6.00	20.0	20		11/11/10	MRD
cis-1,2-Dichloroethylene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
cis-1,3-Dichloropropylene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Dibromochloromethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Dibromomethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Dichlorodifluoromethane - SPLP	ND	ug/L	6.00	20.0	20	CSH	11/11/10	MRD
Ethylbenzene - SPLP	ND	ug/L	2.00	10.0	20		11/11/10	MRD
Hexachlorobutadiene - SPLP	ND	ug/L	20.0	66.0	20		11/11/10	MRD
Isopropylbenzene (Cumene) - SPLP	ND	ug/L	2.00	10.0	20		11/11/10	MRD
m,p-Xylenes - SPLP	ND	ug/L	8.00	26.0	20		11/11/10	MRD
Methylene Chloride - SPLP	22.2	ug/L	8.00	26.0	20	LBC, J	11/11/10	MRD
Methyl-tert-Butyl Ether - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Naphthalene - SPLP	ND	ug/L	20.0	66.0	20		11/11/10	MRD
o-Xylene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Propylbenzene - SPLP	ND	ug/L	2.00	10.0	20		11/11/10	MRD
sec-Butylbenzene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Styrene - SPLP	ND	ug/L	2.00	10.0	20		11/11/10	MRD
tert-Butylbenzene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Tetrachloroethene - SPLP	ND	ug/L	6.00	20.0	20		11/11/10	MRD
Toluene - SPLP	ND	ug/L	8.00	26.0	20		11/11/10	MRD
trans-1,2-Dichloroethylene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
trans-1,3-Dichloropropylene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Trichloroethene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Trichlorofluoromethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Vinyl Chloride - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 TOC & SPLP
REPORT NO. : 1011010
DATE REC'D 11/01/10 12:35
REPORT DATE : 11/17/10 07:28
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CB4 -L

Matrix: Soil

Sample Date/Time: 10/29/10 11:03

Lab No. : 1011010-05

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u>	<u>Analyst</u>
							<u>Analyzed</u>	
EPA 1312								
Prep Method: EPA 1312 - SPLP Extraction	By: SMM						Date Prepared: 11/01/10	
Fluid Used	Completed				1		11/02/10	SMM
EPA 8260B								
1,1,1,2-Tetrachloroethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,1,1-Trichloroethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,1,1,2,2-Tetrachloroethane - SPLP	ND	ug/L	6.00	20.0	20		11/11/10	MRD
1,1,2-Trichloroethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,1-Dichloroethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,1-Dichloroethylene - SPLP	ND	ug/L	8.00	26.0	20		11/11/10	MRD
1,1-Dichloropropylene - SPLP	ND	ug/L	6.00	20.0	20		11/11/10	MRD
1,2,3-Trichlorobenzene - SPLP	ND	ug/L	10.0	34.0	20		11/11/10	MRD
1,2,3-Trichloropropane - SPLP	ND	ug/L	12.0	40.0	20		11/11/10	MRD
1,2,4-Trichlorobenzene - SPLP	ND	ug/L	10.0	34.0	20		11/11/10	MRD
1,2,4-Trimethylbenzene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,2-Dibromo-3-chloropropane - SPLP	ND	ug/L	20.0	66.0	20		11/11/10	MRD
1,2-Dibromoethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,2-Dichlorobenzene - SPLP	ND	ug/L	16.0	54.0	20		11/11/10	MRD
1,2-Dichloroethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,2-Dichloropropane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,3,5-Trimethylbenzene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,3-Dichlorobenzene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,3-Dichloropropane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
1,4-Dichlorobenzene - SPLP	ND	ug/L	16.0	54.0	20		11/11/10	MRD
2,2-Dichloropropane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
2-Chlorotoluene - SPLP	ND	ug/L	2.00	10.0	20		11/11/10	MRD
4-Chlorotoluene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
4-Isopropyltoluene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Benzene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Bromobenzene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Bromochloromethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Bromodichloromethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Bromoform - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Bromomethane - SPLP	ND	ug/L	20.0	66.6	20		11/11/10	MRD
Butylbenzene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Carbon Tetrachloride - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 TOC & SPLP
REPORT NO. : 1011010
DATE REC'D : 11/01/10 12:35
REPORT DATE : 11/17/10 07:28
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CB4 -L

Matrix: Soil

Sample Date/Time: 10/29/10 11:03

Lab No. : 1011010-05

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
Chlorobenzene - SPLP	ND	ug/L	2.00	10.0	20		11/11/10	MRD
Chloroethane - SPLP	ND	ug/L	12.0	40.0	20		11/11/10	MRD
Chloroform - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Chloromethane - SPLP	ND	ug/L	6.00	20.0	20		11/11/10	MRD
cis-1,2-Dichloroethylene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
cis-1,3-Dichloropropylene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Dibromochloromethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Dibromomethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Dichlorodifluoromethane - SPLP	ND	ug/L	6.00	20.0	20	CSH	11/11/10	MRD
Ethylbenzene - SPLP	ND	ug/L	2.00	10.0	20		11/11/10	MRD
Hexachlorobutadiene - SPLP	ND	ug/L	20.0	66.0	20		11/11/10	MRD
Isopropylbenzene (Cumene) - SPLP	ND	ug/L	2.00	10.0	20		11/11/10	MRD
m,p-Xylenes - SPLP	ND	ug/L	8.00	26.0	20		11/11/10	MRD
Methylene Chloride - SPLP	17.4	ug/L	8.00	26.0	20	LBC, J	11/11/10	MRD
Methyl-tert-Butyl Ether - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Naphthalene - SPLP	ND	ug/L	20.0	66.0	20		11/11/10	MRD
o-Xylene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Propylbenzene - SPLP	ND	ug/L	2.00	10.0	20		11/11/10	MRD
sec-Butylbenzene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Styrene - SPLP	ND	ug/L	2.00	10.0	20		11/11/10	MRD
tert-Butylbenzene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Tetrachloroethene - SPLP	ND	ug/L	6.00	20.0	20		11/11/10	MRD
Toluene - SPLP	ND	ug/L	8.00	26.0	20		11/11/10	MRD
trans-1,2-Dichloroethylene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
trans-1,3-Dichloropropylene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Trichloroethene - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Trichlorofluoromethane - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD
Vinyl Chloride - SPLP	ND	ug/L	4.00	13.4	20		11/11/10	MRD

SIEMENS

Qualifier Descriptions

LBC	This compound is a common laboratory contaminant.
J	Estimated concentration below laboratory quantitation level.
CSH	Check standard for this analyte exhibited a high bias. Sample results may also be biased high.
COMP	Completed

Definitions

LOD = Limit of Detection (Dilution Corrected)
LOQ = Limit of Quantitation (Dilution Corrected)
Reporting Limit = LOQ (Dilution Corrected)
ND = Not Detected
COMP = Complete
SUBCON = Subcontracted analysis
mv = millivolts
pci/L = picocuries per Liter
mL/L = milliliters per Liter
mg = milligram

When the word "dry" follows the units on the result page the sample results are dry weight corrected.

LODs and LOQs are dry weight corrected for all soils except WI GRO, EPA 8021 and WI DNR/EPA 8260B methanol and WI DNR methylene chloride preserved soils being reported to the State of Wisconsin.

ug/l = Micrograms per Liter = parts per billion (ppb)
ug/kg = Micrograms per kilogram = parts per billion (ppb)
mg/l = Milligrams per liter = parts per million (ppm)
mg/kg = Milligrams per kilogram = parts per million (ppm)
NOT PRES = Not Present
ppth = Parts per thousand
* = Result outside established limits.
mg/m³ = Milligrams per meter cubed
ng/L = Nanograms per Liter = Parts per trillion (ppt)
> = Greater Than

State of Wisconsin Methanol Soils for WI GRO, WI DNR/EPA 8260B and EPA 8021 are reported to the LOQ.

ANALYTICAL REPORT

Job Number: 500-28980-1

Job Description: Subcontract Lab Services

For:

Siemens Water Technologies Corp
301 West Military Road
Rothschild, WI 54474

Attention: Ms. Mariah Peronto



Approved for release.
Jim Knapp
Customer Service Manager
11/12/2010 4:58 PM

Jim Knapp
Customer Service Manager
jim.knapp@testamericainc.com
11/12/2010

These test results meet all the requirements of NELAC for accredited parameters.

The Lab Certification ID#:
TestAmerica Chicago 100201
TestAmerica Buffalo NY00044
TestAmerica Burlington VT00008
TestAmerica Watertown WI00038

All questions regarding this test report should be directed to the TestAmerica Project Manager whose signature appears on this report. All pages of this report are integral parts of the analytical data. Therefore, this report should be reproduced only in its entirety.

Job Narrative
500-28980-1

Comments

No additional comments.

Receipt

All samples were received in good condition within temperature requirements.

General Chemistry

No analytical or quality issues were noted.

EXECUTIVE SUMMARY - Detections

Client: Siemens Water Technologies Corp

Job Number: 500-28980-t

Lab Sample ID Analyte	Client Sample ID	Result / Qualifier	Reporting Limit	Units	Method
500-28980-1 TOC Dup	1011010-01	1300	120	mg/Kg	Lloyd Kahn
500-28980-2 TOC Dup	1011010-02	1200	120	mg/Kg	Lloyd Kahn
500-28980-3 TOC Dup	1011010-03	30000	120	mg/Kg	Lloyd Kahn
500-28980-4 TOC Dup	1011010-04	70000	120	mg/Kg	Lloyd Kahn
500-28980-5 TOC Dup	1011010-05	32000	120	mg/Kg	Lloyd Kahn

METHOD SUMMARY

Client: Siemens Water Technologies Corp

Job Number: 500-28980-1

Description	Lab Location	Method	Preparation Method
Matrix: Solid			
Organic Carbon, Total (TOC)	TAL CHI	NJDEP	Lloyd Kahn

Lab References:

TAL CHI = TestAmerica Chicago

Method References:

NJDEP = New Jersey Department of Environmental Protection

METHOD / ANALYST SUMMARY

Client: Siemens Water Technologies Corp

Job Number: 500-28980-1

Method	Analyst	Analyst ID
NJDEP Lloyd Kahn	Deb, Khona	KD

SAMPLE SUMMARY

Client: Siemens Water Technologies Corp

Job Number: 500-28980-1

Lab Sample ID	Client Sample ID	Client Matrix	Date/Time Sampled	Date/Time Received
500-28980-1	1011010-01	Solid	10/28/2010 1100	11/02/2010 1000
500-28980-2	1011010-02	Solid	10/28/2010 1118	11/02/2010 1000
500-28980-3	1011010-03	Solid	10/29/2010 1024	11/02/2010 1000
500-28980-4	1011010-04	Solid	10/29/2010 1036	11/02/2010 1000
500-28980-5	1011010-05	Solid	10/29/2010 1103	11/02/2010 1000

SAMPLE RESULTS

Ms. Mariah Peronto
Siemens Water Technologies Corp
301 West Military Road
Rothschild, WI 54474

Job Number: 500-28980-1

Client Sample ID: 1011010-01
Lab Sample ID: 500-28980-1

Date Sampled: 10/28/2010 1100
Date Received: 11/02/2010 1000
Client Matrix: Solid

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: Lloyd Kahn TOC Dup	1300	mg/Kg	Date Analyzed: 11/10/2010 1435 23	120	1.0

Ms. Mariah Peronto
Siemens Water Technologies Corp
301 West Military Road
Rothschild, WI 54474

Job Number: 500-28980-1

Client Sample ID: 1011010-02
Lab Sample ID: 500-28980-2

Date Sampled: 10/28/2010 1118
Date Received: 11/02/2010 1000
Client Matrix: Solid

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: Lloyd Kahn TOC Dup	1200	mg/Kg	Date Analyzed: 11/10/2010 1443 23	120	1.0

Ms. Mariah Peronto
Siemens Water Technologies Corp
301 West Military Road
Rothschild, WI 54474

Job Number: 500-28980-1

Client Sample ID: 1011010-03
Lab Sample ID: 500-28980-3

Date Sampled: 10/29/2010 1024
Date Received: 11/02/2010 1000
Client Matrix: Solid

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: Lloyd Kahn TOC Dup	30000	mg/Kg	Date Analyzed: 11/10/2010 1502 23	120	1.0

Ms. Mariah Peronto
Siemens Water Technologies Corp
301 West Military Road
Rothschild, WI 54474

Job Number: 500-28980-1

Client Sample ID: 1011010-04
Lab Sample ID: 500-28980-4

Date Sampled: 10/29/2010 1036
Date Received: 11/02/2010 1000
Client Matrix: Solid

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: Lloyd Kahn TOC Dup	70000	mg/Kg	Date Analyzed: 23	11/10/2010 1513 120	1.0

Ms. Mariah Peronto
Siemens Water Technologies Corp
301 West Military Road
Rothschild, WI 54474

Job Number: 500-28980-1

Client Sample ID: 1011010-05
Lab Sample ID: 500-28980-5

Date Sampled: 10/29/2010 1103
Date Received: 11/02/2010 1000
Client Matrix: Solid

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: Lloyd Kahn TOC Dup	32000	mg/Kg	Date Analyzed: 11/10/2010 1519 23	120	1.0

QUALITY CONTROL RESULTS

Quality Control Results

Client: Siemens Water Technologies Corp

Job Number: 500-28980-1

QC Association Summary

<u>Lab Sample ID</u>	<u>Client Sample ID</u>	<u>Report Basis</u>	<u>Client Matrix</u>	<u>Method</u>	<u>Prep Batch</u>
General Chemistry					
Analysis Batch:500-99712					
LCS 500-99712/3	Lab Control Sample	T	Solid	Lloyd Kahn	
MB 500-99712/2	Method Blank	T	Solid	Lloyd Kahn	
500-28980-1	1011010-01	T	Solid	Lloyd Kahn	
500-28980-2	1011010-02	T	Solid	Lloyd Kahn	
500-28980-3	1011010-03	T	Solid	Lloyd Kahn	
500-28980-4	1011010-04	T	Solid	Lloyd Kahn	
500-28980-5	1011010-05	T	Solid	Lloyd Kahn	

Report Basis

T = Total

Quality Control Results

Client: Siemens Water Technologies Corp

Job Number: 500-28980-1

Method Blank - Batch: 500-99712

Method: Lloyd Kahn
Preparation: N/A

Lab Sample ID: MB 500-99712/2
Client Matrix: Solid
Dilution: 1.0
Date Analyzed: 11/10/2010 1424
Date Prepared: N/A

Analysis Batch: 500-99712
Prep Batch: N/A
Units: mg/Kg

Instrument ID: TOC4
Lab File ID: N/A
Initial Weight/Volume: 0.16 g
Final Weight/Volume: 0.16 g

Analyte	Result	Qual	MDL	RL
TOC Result 1	ND		23	120
TOC Result 2	ND		23	120
TOC Dup	ND		23	120

Lab Control Sample - Batch: 500-99712

Method: Lloyd Kahn
Preparation: N/A

Lab Sample ID: LCS 500-99712/3
Client Matrix: Solid
Dilution: 1.0
Date Analyzed: 11/10/2010 1427
Date Prepared: N/A

Analysis Batch: 500-99712
Prep Batch: N/A
Units: mg/Kg

Instrument ID: TOC4
Lab File ID: N/A
Initial Weight/Volume: 0.0062 g
Final Weight/Volume: 0.05 g

Analyte	Spike Amount	Result	% Rec.	Limit	Qual
TOC Dup	4110	6490	158	33 - 167	

SUBCONTRACT ORDER
Siemens Water Technologies Corp.
1011010

500-28980

SENDING LABORATORY:

Siemens Water Technologies Corp.
 301 West Military Road
 Rothschild, WI 54474
 Phone: 715-359-7226
 Fax: 715-355-3221
 Project Manager: Mariah Peronto Email: mariah.peronto@siemens.com
 PO #: Mariah Peronto

RECEIVING LABORATORY:

TestAmerica - Chicago (formerly STL-Chicago)
 2417 Bond Street
 University Park, IL 60466
 Phone : (708) 534-5200
 Fax: (708) 534-5211

State: WI Special Analyte List Attached:

Analysis	Due	Expires	Sample ID	Comments
----------	-----	---------	-----------	----------

Sample ID: 1011010-01	Solid	Sampled:10/28/10 11:00	NS1 - TOC	
-----------------------	-------	------------------------	-----------	--

TOC Sub (S)	11/15/10 15:00	10/28/10 11:00		
-------------	----------------	----------------	--	--

Containers Supplied:
 15_4oz Jar (A)

2 Sample ID: 1011010-02	Solid	Sampled:10/28/10 11:18	NS2 - TOC	
-------------------------	-------	------------------------	-----------	--

TOC Sub (S)	11/15/10 15:00	10/28/10 11:18		
-------------	----------------	----------------	--	--

Containers Supplied:
 15_4oz Jar (A)

3 Sample ID: 1011010-03	Solid	Sampled:10/29/10 10:24	CB1 -L	
-------------------------	-------	------------------------	--------	--

TOC Sub (S)	11/15/10 15:00	10/29/10 10:24		
-------------	----------------	----------------	--	--

Containers Supplied:
 15_4oz Jar (A)

Released By: <i>[Signature]</i>	Date: 11/1/10	Time: 14:30	<i>sample NS1</i>	
Received By: <i>[Signature]</i>	Date: 11/2/10	Time: 1000	Temperature: 2.1 C	Received On Ice: <input checked="" type="radio"/> YES / NO / NA
Received Comments:				

**Please confirm receipt of samples and analysis being tested by email to Mariah Peronto
 mariah.peronto@siemens.com**

SUBCONTRACT ORDER
Siemens Water Technologies Corp.
1011010

500-28980

Analysis	Due	Expires	Sample ID	Comments
----------	-----	---------	-----------	----------

4 Sample ID: 1011010-04	Solid	Sampled: 10/29/10 10:36	CB2-L	
TOC Sub (S)	11/15/10 15:00	10/29/10 10:36		

Containers Supplied:
 15 4oz Jar (A)

5 Sample ID: 1011010-05	Solid	Sampled: 10/29/10 11:03	CB4-L	
TOC Sub (S)	11/15/10 15:00	10/29/10 11:03		

Containers Supplied:
 15 4oz Jar (A)

Released By: <i>Steve Anderson</i>	Date: <i>11-1-10</i>	Time: <i>12:30</i>	<i>peronto</i>
Received By: <i>peronto</i>	Date: <i>11/2/10</i>	Time: <i>1000</i>	Temperature: <i>21</i> C Received On Ice: <input checked="" type="checkbox"/> YES / NO / NA
Received Comments:			

**Please confirm receipt of samples and analysis being tested by email to Mariah Peronto
 mariah.peronto@siemens.com**

Login Sample Receipt Check List

Client: Siemens Water Technologies Corp

Job Number: 500-28980-1

Login Number: 28980

Creator: Lunt, Jeff T

List Number: 1

List Source: TestAmerica Chicago

Question	T / F / NA	Comment
Radioactivity either was not measured or, if measured, is at or below background	True	
The cooler's custody seal, if present, is intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	2.1
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the sample IDs on the containers and the COC.	True	
Samples are received within Holding Time.	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
VOA sample vials do not have headspace or bubble is <6mm (1/4") in diameter.	True	
If necessary, staff have been informed of any short hold time or quick TAT needs	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	

SIEMENS

November 19, 2010

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

Attn: Dave Olig

RECEIVED	
GANNETT FLEMING-MADISON, WI	
FILE NO:	34283.000 (NPI)
NOV 24 2010	
REVIEWED BY:	dlj
DATE:	11/24/10
ROUTE TO:	

REPORT NO.: 1011095

PROJECT NO.: 34283.000 TOC & SPLP


Please find enclosed the analytical report, including the Sample Summary, Sample Narrative and Chain of Custody for your sample set received November 4, 2010.

All analyses were performed in accordance with NELAC Standards using approved methods as indicated on this report.

If you have any questions about the results, please call. Thank you for using Siemens Water Technologies for your analytical needs.


Sincerely,

Siemens Water Technologies


Bruce Schertz
Lab Manager
Enviroscan Analytical™ Services

I certify that the data contained in this report has been generated and reviewed in accordance with the Siemens Water Technologies Quality Assurance Program. Exceptions, if any, are discussed in the sample narrative. Samples will be retained for 30 days from the date of this report, then disposed in an appropriate manner. Siemens Water Technologies Corp. reserves the right to return samples identified as hazardous. Release of this Final Report is authorized as verified by the following signature. The contents of this report apply to the sample(s) analyzed. No duplication of this report is allowed except in its entirety.

Reviewed by:



Certifications:

Wisconsin 737053130
Minnesota 055-999-302
Illinois 100317



Siemens Water Technologies Corp.

301 West Military Road
Rothschild, WI 54474

Tel: 800-338-7226
Fax: 715-355-3221
www.siemens.com/enviroscan

LABORATORY'S QUALITY VERIFICATION STATEMENT

Laboratory must provide a signed copy of this form with each deliverable specified in the Work Order or the deliverable will not be accepted. Laboratory must provide Gannett Fleming with a true copy of its internal QA/QC review and approval forms related to the deliverable.

This form must be signed by the Laboratory's Quality Control/Quality Assurance Officer

Project Name: NPI

Gannett Fleming Project Number: 34283.000

Deliverable Description: Analytical Report

I, Cindy Varga, warrant and represent that the project deliverable described above and attached to this form was developed in accordance with the project scope of work and that all elements relating to the quality of the deliverable were verified in accordance with the requirements of my firm's internal quality management/quality assurance system. This deliverable satisfies all requirements of our Contract with Gannett Fleming.

Signature: Cindy Varga
(by Laboratory's QC/QA Officer)

Date: 11/22/12

Laboratory: Siemens Water Technologies

'Deliverable' shall mean all aspects of design including, without limitation, drawings, calculations, maps, materials and specifications, reports, data bases, logs and other information developed from wells, borings and cores, laboratory data, materials schedules, instrument calibration data and all other items developed, prepared and delivered to Gannett Fleming by Contractor as specified in the Scope of Work in any media.

bw 10.2.09

SIEMENS

SAMPLE SUMMARY

<u>Lab Id</u>	<u>Client</u>	<u>Sample Id</u>	<u>Date/Time</u>	<u>Matrix</u>
1011095-01	CB7-L		11/03/10 10:10	Soil

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 TOC & SPLP
REPORT NO. : 1011095
DATE REC'D 11/04/10 12:05
REPORT DATE : 11/19/10 13:41
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CB7-L

Matrix: Soil

Sample Date/Time: 11/03/10 10:10

Lab No. : 1011095-01

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 1312								
Prep Method: EPA 1312 - SPLP Extraction	By: SMM					Date Prepared:	11/11/10	
Fluid Used	Completed				1		11/12/10	SMM
EPA 8260B								
1,1,1,2-Tetrachloroethane - SPLP	ND	ug/L	4.00	13.4	20		11/17/10	MPM
1,1,1-Trichloroethane - SPLP	ND	ug/L	4.00	13.4	20	DUP	11/17/10	MPM
1,1,2,2-Tetrachloroethane - SPLP	ND	ug/L	6.00	20.0	20		11/17/10	MPM
1,1,2-Trichloroethane - SPLP	ND	ug/L	4.00	13.4	20	DUP	11/17/10	MPM
1,1-Dichloroethane - SPLP	ND	ug/L	4.00	13.4	20	S2H, DUP	11/17/10	MPM
1,1-Dichloroethylene - SPLP	ND	ug/L	8.00	26.0	20	DUP	11/17/10	MPM
1,1-Dichloropropylene - SPLP	ND	ug/L	6.00	20.0	20	DUP	11/17/10	MPM
1,2,3-Trichlorobenzene - SPLP	ND	ug/L	10.0	34.0	20		11/17/10	MPM
1,2,3-Trichloropropane - SPLP	ND	ug/L	12.0	40.0	20		11/17/10	MPM
1,2,4-Trichlorobenzene - SPLP	ND	ug/L	10.0	34.0	20		11/17/10	MPM
1,2,4-Trimethylbenzene - SPLP	ND	ug/L	4.00	13.4	20		11/17/10	MPM
1,2-Dibromo-3-chloropropane - SPLP	ND	ug/L	20.0	66.0	20	S1L, S2L	11/17/10	MPM
1,2-Dibromoethane - SPLP	ND	ug/L	4.00	13.4	20	DUP	11/17/10	MPM
1,2-Dichlorobenzene - SPLP	ND	ug/L	16.0	54.0	20		11/17/10	MPM
1,2-Dichloroethane - SPLP	ND	ug/L	4.00	13.4	20	DUP, S2H	11/17/10	MPM
1,2-Dichloropropane - SPLP	ND	ug/L	4.00	13.4	20	DUP	11/17/10	MPM
1,3,5-Trimethylbenzene - SPLP	ND	ug/L	4.00	13.4	20		11/17/10	MPM
1,3-Dichlorobenzene - SPLP	ND	ug/L	4.00	13.4	20		11/17/10	MPM
1,3-Dichloropropane - SPLP	ND	ug/L	4.00	13.4	20	DUP	11/17/10	MPM
1,4-Dichlorobenzene - SPLP	ND	ug/L	16.0	54.0	20		11/17/10	MPM
2,2-Dichloropropane - SPLP	ND	ug/L	4.00	13.4	20	S2H	11/17/10	MPM
2-Chlorotoluene - SPLP	ND	ug/L	2.00	10.0	20		11/17/10	MPM
4-Chlorotoluene - SPLP	ND	ug/L	4.00	13.4	20		11/17/10	MPM
4-Isopropyltoluene - SPLP	ND	ug/L	4.00	13.4	20		11/17/10	MPM
Benzene - SPLP	ND	ug/L	4.00	13.4	20	DUP	11/17/10	MPM
Bromobenzene - SPLP	ND	ug/L	4.00	13.4	20		11/17/10	MPM
Bromochloromethane - SPLP	ND	ug/L	4.00	13.4	20	DUP	11/17/10	MPM
Bromodichloromethane - SPLP	ND	ug/L	4.00	13.4	20	DUP	11/17/10	MPM
Bromoform - SPLP	ND	ug/L	4.00	13.4	20		11/17/10	MPM
Bromomethane - SPLP	ND	ug/L	20.0	66.6	20		11/17/10	MPM
Butylbenzene - SPLP	4.77	ug/L	4.00	13.4	20	J	11/17/10	MPM
Carbon Tetrachloride - SPLP	ND	ug/L	4.00	13.4	20	DUP	11/17/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 TOC & SPLP
REPORT NO. : 1011095
DATE REC'D 11/04/10 12:05
REPORT DATE : 11/19/10 13:41
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: CB7-L

Matrix: Soil

Sample Date/Time: 11/03/10 10:10

Lab No. : 1011095-01

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
Chlorobenzene - SPLP	ND	ug/L	2.00	10.0	20	DUP	11/17/10	MPM
Chloroethane - SPLP	ND	ug/L	12.0	40.0	20	DUP	11/17/10	MPM
Chloroform - SPLP	ND	ug/L	4.00	13.4	20	DUP	11/17/10	MPM
Chloromethane - SPLP	ND	ug/L	6.00	20.0	20	CSL, DUP	11/17/10	MPM
cis-1,2-Dichloroethylene - SPLP	7.52	ug/L	4.00	13.4	20	DUP, J	11/17/10	MPM
cis-1,3-Dichloropropylene - SPLP	ND	ug/L	4.00	13.4	20	DUP	11/17/10	MPM
Dibromochloromethane - SPLP	ND	ug/L	4.00	13.4	20	DUP	11/17/10	MPM
Dibromomethane - SPLP	ND	ug/L	4.00	13.4	20	DUP	11/17/10	MPM
Dichlorodifluoromethane - SPLP	ND	ug/L	6.00	20.0	20	CSL, DUP	11/17/10	MPM
Ethylbenzene - SPLP	ND	ug/L	2.00	10.0	20		11/17/10	MPM
Hexachlorobutadiene - SPLP	ND	ug/L	20.0	66.0	20		11/17/10	MPM
Isopropylbenzene (Cumene) - SPLP	ND	ug/L	2.00	10.0	20		11/17/10	MPM
m,p-Xylenes - SPLP	ND	ug/L	8.00	26.0	20		11/17/10	MPM
Methylene Chloride - SPLP	ND	ug/L	8.00	26.0	20	DUP	11/17/10	MPM
Methyl-tert-Butyl Ether - SPLP	ND	ug/L	4.00	13.4	20	S2H, DUP	11/17/10	MPM
Naphthalene - SPLP	ND	ug/L	20.0	66.0	20		11/17/10	MPM
o-Xylene - SPLP	ND	ug/L	4.00	13.4	20	DUP	11/17/10	MPM
Propylbenzene - SPLP	ND	ug/L	2.00	10.0	20		11/17/10	MPM
sec-Butylbenzene - SPLP	ND	ug/L	4.00	13.4	20		11/17/10	MPM
Styrene - SPLP	ND	ug/L	2.00	10.0	20		11/17/10	MPM
tert-Butylbenzene - SPLP	ND	ug/L	4.00	13.4	20		11/17/10	MPM
Tetrachloroethene - SPLP	ND	ug/L	6.00	20.0	20	DUP	11/17/10	MPM
Toluene - SPLP	ND	ug/L	8.00	26.0	20	S2H, DUP	11/17/10	MPM
trans-1,2-Dichloroethylene - SPLP	ND	ug/L	4.00	13.4	20	DUP	11/17/10	MPM
trans-1,3-Dichloropropylene - SPLP	ND	ug/L	4.00	13.4	20	DUP	11/17/10	MPM
Trichloroethene - SPLP	115	ug/L	4.00	13.4	20	DUP	11/17/10	MPM
Trichlorofluoromethane - SPLP	ND	ug/L	4.00	13.4	20	DUP	11/17/10	MPM
Vinyl Chloride - SPLP	ND	ug/L	4.00	13.4	20	DUP	11/17/10	MPM

SIEMENS

Qualifier Descriptions

S2L	Second sample matrix spike recovery was low.
S2H	Second sample matrix spike recovery was high.
S1L	First sample matrix spike recovery was low.
J	Estimated concentration below laboratory quantitation level.
DUP	Result of duplicate analysis in this quality assurance batch exceeds the limits for precision.
CSL	Check standard for this analyte exhibited a low bias. Sample results may also be biased low.
COMP	Completed

Definitions

LOD = Limit of Detection (Dilution Corrected)
LOQ = Limit of Quantitation (Dilution Corrected)
Reporting Limit = LOQ (Dilution Corrected)
ND = Not Detected
COMP = Complete
SUBCON = Subcontracted analysis
mv = millivolts
pci/L = picocuries per Liter
mL/L = milliliters per Liter
mg = milligram

When the word "dry" follows the units on the result page the sample results are dry weight corrected.

LODs and LOQs are dry weight corrected for all soils except WI GRO, EPA 8021 and WI DNR/EPA 8260B methanol and WI DNR methylene chloride preserved soils being reported to the State of Wisconsin.

ug/l = Micrograms per Liter = parts per billion (ppb)
ug/kg = Micrograms per kilogram = parts per billion (ppb)
mg/l = Milligrams per liter = parts per million (ppm)
mg/kg = Milligrams per kilogram = parts per million (ppm)
NOT PRES = Not Present
ppth = Parts per thousand
* = Result outside established limits.
mg/m³ = Milligrams per meter cubed
ng/L = Nanograms per Liter = Parts per trillion (ppt)
> = Greater Than

State of Wisconsin Methanol Soils for WI GRO, WI DNR/EPA 8260B and EPA 8021 are reported to the LOQ.

Company Name GANNETT FLEMING, INC.		Project 34283.000 (NPI)	
Report Mailing Address 8025 EXCELSIOR DR. MADISON, WI 53717		Contact Name, Phone, Fax, Email DAVE OLG 608-836-1500 ddig@gfnet.com	
Invoice Address SAME AS ABOVE		Purchase Order # 2010 QUOTE PRICE	Invoice Contact and Phone No. SAME AS ABOVE

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: _____
(If Yes, please specify Agency or Regulation) Agency/Reg.: _____

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1011095

Analyses Requested										Lab Use Only		
TOTAL ORG. CARBON SPLP (VOLs)										Delivered by:	Walk-in	<u>Courier</u>
										Ship. Cont. OK?	<input checked="" type="checkbox"/>	N NA
										Samples Leaking?	Y <input checked="" type="checkbox"/>	NA NA
										Seals OK?	<input checked="" type="checkbox"/>	N NA
										Rec'd on Ice?	<input checked="" type="checkbox"/>	N NA
Sample Receiving Comments:										2.8		
Comments										2.4oz jars		

Lab Use Only	Sample		No. of Containers		Sample ID
	Date	Time	Comp	Grab	
<input checked="" type="checkbox"/>	11/3/10	10:10		2	CB7-L
	11/3/10				

706 → Total Am Chicago

Chain of Custody Record

Relinquished By:	Date	Time	Received By:
	11/4/10	12:05	Jessie H. C.

ANALYTICAL REPORT


Job Number: 500-29088-1

Job Description: Subcontract Lab Services

For:

Siemens Water Technologies Corp
301 West Military Road
Rothschild, WI 54474

Attention: Ms. Mariah Peronto

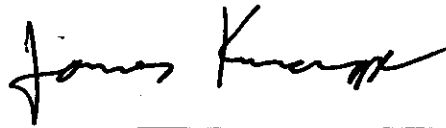

Approved for release.
Jim Knapp
Customer Service Manager
11/12/2010 4:49 PM

Jim Knapp
Customer Service Manager
jim.knapp@testamericainc.com
11/12/2010

These test results meet all the requirements of NELAC for accredited parameters.

The Lab Certification ID#:
TestAmerica Chicago 100201
TestAmerica Buffalo NY00044
TestAmerica Burlington VT00008
TestAmerica Watertown WI00038

All questions regarding this test report should be directed to the TestAmerica Project Manager whose signature appears on this report. All pages of this report are integral parts of the analytical data. Therefore, this report should be reproduced only in its entirety.

Job Narrative
500-29088-1

Comments

No additional comments.

Receipt

All samples were received in good condition within temperature requirements.

General Chemistry

No analytical or quality issues were noted.

EXECUTIVE SUMMARY - Detections

Client: Siemens Water Technologies Corp

Job Number: 500-29088-1

Lab Sample ID Analyte	Client Sample ID	Result / Qualifier	Reporting Limit	Units	Method
500-29088-1 TOC Dup	1011095-01	690000	120	mg/Kg	Lloyd Kahn

METHOD SUMMARY

Client: Siemens Water Technologies Corp

Job Number: 500-29088-1

Description	Lab Location	Method	Preparation Method
Matrix: Solid			
Organic Carbon, Total (TOC)	TAL CHI	NJDEP Lloyd Kahn	

Lab References:

TAL CHI = TestAmerica Chicago

Method References:

NJDEP = New Jersey Department of Environmental Protection

METHOD / ANALYST SUMMARY

Client: Siemens Water Technologies Corp

Job Number: 500-29088-1

Method	Analyst	Analyst ID
NJDEP Lloyd Kahn	Deb, Khona	KD

SAMPLE SUMMARY

Client: Siemens Water Technologies Corp

Job Number: 500-29088-1

Lab Sample ID	Client Sample ID	Client Matrix	Date/Time Sampled	Date/Time Received
500-29088-1	1011095-01	Solid	11/03/2010 1010	11/05/2010 0950

SAMPLE RESULTS

Ms. Mariah Peronto
Siemens Water Technologies Corp
301 West Military Road
Rothschild, WI 54474

Job Number: 500-29088-1

Client Sample ID: 1011095-01
Lab Sample ID: 500-29088-1

Date Sampled: 11/03/2010 1010
Date Received: 11/05/2010 0950
Client Matrix: Solid

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: Lloyd Kahn			Date Analyzed: 11/10/2010 1623		
TOC Dup	690000	mg/Kg	23	120	1.0

QUALITY CONTROL RESULTS

Quality Control Results

Client: Siemens Water Technologies Corp

Job Number: 500-29088-1

QC Association Summary

<u>Lab Sample ID</u>	<u>Client Sample ID</u>	<u>Report Basis</u>	<u>Client Matrix</u>	<u>Method</u>	<u>Prep Batch</u>
General Chemistry					
Analysis Batch:500-99712					
LCS 500-99712/3	Lab Control Sample	T	Solid	Lloyd Kahn	
MB 500-99712/2	Method Blank	T	Solid	Lloyd Kahn	
500-29088-1	1011095-01	T	Solid	Lloyd Kahn	

Report Basis

T = Total

Quality Control Results

Client: Siemens Water Technologies Corp

Job Number: 500-29088-1

Method Blank - Batch: 500-99712

Method: Lloyd Kahn
Preparation: N/A

Lab Sample ID: MB 500-99712/2
Client Matrix: Solid
Dilution: 1.0
Date Analyzed: 11/10/2010 1424
Date Prepared: N/A

Analysis Batch: 500-99712
Prep Batch: N/A
Units: mg/Kg

Instrument ID: TOC4
Lab File ID: N/A
Initial Weight/Volume: 0.16 g
Final Weight/Volume: 0.16 g

Analyte	Result	Qual	MDL	RL
TOC Result 1	ND		23	120
TOC Result 2	ND		23	120
TOC Dup	ND		23	120

Lab Control Sample - Batch: 500-99712

Method: Lloyd Kahn
Preparation: N/A

Lab Sample ID: LCS 500-99712/3
Client Matrix: Solid
Dilution: 1.0
Date Analyzed: 11/10/2010 1427
Date Prepared: N/A

Analysis Batch: 500-99712
Prep Batch: N/A
Units: mg/Kg

Instrument ID: TOC4
Lab File ID: N/A
Initial Weight/Volume: 0.0062 g
Final Weight/Volume: 0.05 g

Analyte	Spike Amount	Result	% Rec.	Limit	Qual
TOC Dup	4110	6490	158	33 - 167	

SUBCONTRACT ORDER

Siemens Water Technologies Corp.

1011095

500-29088

SENDING LABORATORY:

Siemens Water Technologies Corp.
301 West Military Road
Rothschild, WI 54474
Phone: 715-359-7226
Fax: 715-355-3221
Project Manager: Mariah Peronto Email: mariah.peronto@siemens.com
PO #: Mariah Peronto

RECEIVING LABORATORY:

TestAmerica - Chicago (formerly STL-Chicago)
2417 Bond Street
University Park, IL 60466
Phone : (708) 534-5200
Fax: (708) 534-5211

State: IL Special Analyte List Attached: ---

Analysis	Due	Expires	Sample ID	Comments
----------	-----	---------	-----------	----------

Sample ID: 1011095-01	Solid	Sampled: 11/03/10 10:10	CB7-L	
-----------------------	-------	-------------------------	-------	--

TOC Sub (S)	11/18/10 15:00	11/03/10 10:10		
-------------	----------------	----------------	--	--

Containers Supplied:

15 4oz Jar (A)

Released By: <i>Sean Arden</i>	Date: <i>11-4-10</i>	Time: <i>1430</i>		
Received By: <i>JP</i>	Date: <i>11/5/10</i>	Time: <i>0950</i>	Temperature: <i>2,1</i> C	Received On Ice: <input checked="" type="checkbox"/> YES / NO / NA
Received Comments:				

**Please confirm receipt of samples and analysis being tested by email to Mariah Peronto
mariah.peronto@siemens.com**

Login Sample Receipt Check List

Client: Siemens Water Technologies Corp

Job Number: 500-29088-1

LogIn Number: 29088

List Source: TestAmerica Chicago

Creator: Lunt, Jeff T

List Number: 1

Question	T / F / NA	Comment
Radioactivity either was not measured or, if measured, is at or below background	True	
The cooler's custody seal, if present, is intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	2.1
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the sample IDs on the containers and the COC.	True	
Samples are received within Holding Time.	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
VOA sample vials do not have headspace or bubble is <6mm (1/4") in diameter.	True	
If necessary, staff have been informed of any short hold time or quick TAT needs	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	

SIEMENS

October 04, 2010

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

Attn: Dave Olig

REPORT NO.: 1009467

PROJECT NO.: 34283.000 Soil - VOCs


Please find enclosed the analytical report, including the Sample Summary, Sample Narrative and Chain of Custody for your sample set received September 23, 2010.

All analyses were performed in accordance with NELAC Standards using approved methods as indicated on this report.


If you have any questions about the results, please call. Thank you for using Siemens Water Technologies for your analytical needs.

Sincerely,

Siemens Water Technologies


Bruce Schertz
Lab Manager
Enviroscan Analytical™ Services

I certify that the data contained in this report has been generated and reviewed in accordance with the Siemens Water Technologies Quality Assurance Program. Exceptions, if any, are discussed in the sample narrative. Samples will be retained for 30 days from the date of this report, then disposed in an appropriate manner. Siemens Water Technologies Corp. reserves the right to return samples identified as hazardous. Release of this Final Report is authorized as verified by the following signature. The contents of this report apply to the sample(s) analyzed. No duplication of this report is allowed except in its entirety.

Reviewed by:  _____

Certifications:

Wisconsin 737053130
Minnesota 055-999-302
Illinois 100317



Siemens Water Technologies Corp.

301 West Military Road
Rothschild, WI 54474

Tel: 800-338-7226
Fax: 715-353-3221

www.siemens.com/enviroscan

The total number of pages in this report, including this page is 10.

LABORATORY'S QUALITY VERIFICATION STATEMENT

Laboratory must provide a signed copy of this form with each deliverable specified in the Work Order or the deliverable will not be accepted. Laboratory must provide Gannett Fleming with a true copy of its internal QA/QC review and approval forms related to the deliverable.


This form must be signed by the Laboratory's Quality Control/Quality Assurance Officer

Project Name: Presto

Gannett Fleming Project Number: 34283.000

Deliverable Description: Analytical Report

I, Cindy Varga, warrant and represent that the project deliverable described above and attached to this form was developed in accordance with the project scope of work and that all elements relating to the quality of the deliverable were verified in accordance with the requirements of my firm's internal quality management/quality assurance system. This deliverable satisfies all requirements of our Contract with Gannett Fleming.

Signature: 
(by Laboratory's QC/QA Officer)

Date: 10/4/10

Laboratory: Siemens Water Technologies

'Deliverable' shall mean all aspects of design including, without limitation, drawings, calculations, maps, materials and specifications, reports, data bases, logs and other information developed from wells, borings and cores, laboratory data, materials schedules, instrument calibration data and all other items developed, prepared and delivered to Gannett Fleming by Contractor as specified in the Scope of Work in any media.

bw 10.2.09

SIEMENS

SAMPLE SUMMARY

<u>Lab Id</u>	<u>Client Sample Id</u>	<u>Date/Time</u>	<u>Matrix</u>
1009467-01	MW-76B Below 75', spoil	09/21/10 00:00	Soil
1009467-02	MW-77C Below 75', spoil	09/20/10 00:00	Soil
1009467-03	MeOH Blank	09/21/10 00:00	Soil

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 Soil - VOCs
REPORT NO. : 1009467
DATE REC'D : 09/23/10 15:15
REPORT DATE : 10/04/10 10:37
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: MW-76B Below 75', spoil Matrix: Soil

Sample Date/Time: 09/21/10 0:00

Lab No. : 1009467-01

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	37.4	41.6	104		09/30/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	40.6	41.6	104		09/30/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	37.4	41.6	104		09/30/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	42.6	46.6	104		09/30/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	38.5	41.6	104		09/30/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	59.3	62.4	104		09/30/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	92.6	93.6	104		09/30/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	48.9	52.0	104		09/30/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	51.0	52.0	104		09/30/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	43.7	46.8	104		09/30/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	37.4	41.6	104		09/30/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	103	104	104		09/30/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	35.4	38.4	104		09/30/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	40.6	41.6	104		09/30/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	41.6	41.6	104		09/30/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	35.4	41.6	104		09/30/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	37.4	41.6	104		09/30/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	39.5	41.6	104		09/30/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	39.5	41.6	104		09/30/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	38.4	38.4	104		09/30/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	104	104	104		09/30/10	MPM
2-Chlorotoluene	ND	ug/kg dry	39.5	41.6	104		09/30/10	MPM
4-Chlorotoluene	ND	ug/kg dry	34.3	38.7	104		09/30/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	38.4	38.4	104		09/30/10	MPM
Benzene	ND	ug/kg dry	37.4	41.6	104		09/30/10	MPM
Bromobenzene	ND	ug/kg dry	38.4	38.4	104		09/30/10	MPM
Bromochloromethane	ND	ug/kg dry	38.5	41.6	104		09/30/10	MPM
Bromodichloromethane	ND	ug/kg dry	39.5	41.6	104		09/30/10	MPM
Bromoform	ND	ug/kg dry	49.9	52.0	104		09/30/10	MPM
Bromomethane	ND	ug/kg dry	104	104	104		09/30/10	MPM
Butylbenzene	ND	ug/kg dry	42.6	46.8	104		09/30/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	42.6	46.8	104		09/30/10	MPM
Chlorobenzene	ND	ug/kg dry	38.5	41.6	104		09/30/10	MPM
Chloroethane	ND	ug/kg dry	70.7	72.6	104		09/30/10	MPM
Chloroform	ND	ug/kg dry	38.4	41.6	104		09/30/10	MPM
Chloromethane	ND	ug/kg dry	36.4	38.4	104		09/30/10	MPM

SIEMENS

Garnett Fleming, inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 Soil - VOCs
REPORT NO. : 1009467
DATE REC'D 09/23/10 15:15
REPORT DATE : 10/04/10 10:37
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: MW-76B Below 75', spoll Matrix: Soil

Sample Date/Time: 09/21/10 0:00

Lab No. : 1009467-01

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	42.8	48.8	104		09/30/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	34.3	36.4	104		09/30/10	MPM
Dibromochloromethane	ND	ug/kg dry	34.3	38.4	104		09/30/10	MPM
Dibromomethane	ND	ug/kg dry	40.6	41.8	104		09/30/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	51.0	52.0	104		09/30/10	MPM
Ethylbenzene	ND	ug/kg dry	38.5	41.6	104		09/30/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	52.0	52.0	104		09/30/10	MPM
Isopropyl Ether	ND	ug/kg dry	74.9	78.0	104		09/30/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	37.4	41.8	104		09/30/10	MPM
m,p-Xylenes	ND	ug/kg dry	71.8	72.8	104		09/30/10	MPM
Methylene Chloride	ND	ug/kg dry	32.2	38.4	104		09/30/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	87.4	93.8	104		09/30/10	MPM
Naphthalene	48.3	ug/kg dry	44.7	48.8	104		09/30/10	MPM
o-Xylene	ND	ug/kg dry	52.0	52.0	104		09/30/10	MPM
Propylbenzene	ND	ug/kg dry	37.4	41.8	104		09/30/10	MPM
sec-Butylbenzene	ND	ug/kg dry	41.8	41.8	104		09/30/10	MPM
Styrene	ND	ug/kg dry	38.4	41.6	104		09/30/10	MPM
tert-Butylbenzene	ND	ug/kg dry	38.5	41.8	104		09/30/10	MPM
Tetrachloroethene	ND	ug/kg dry	48.8	48.8	104		09/30/10	MPM
Toluene	ND	ug/kg dry	42.8	48.8	104		09/30/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	48.8	48.8	104		09/30/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	35.4	38.4	104		09/30/10	MPM
Trichloroethene	ND	ug/kg dry	38.5	41.8	104		09/30/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	49.9	52.0	104		09/30/10	MPM
Vinyl chloride	ND	ug/kg dry	47.8	52.0	104		09/30/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 Soil - VOCs
REPORT NO. : 1009467
DATE REC'D 09/23/10 15:15
REPORT DATE : 10/04/10 10:37
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: MW-77C Below 75', spoil Matrix: Soil

Sample Date/Time: 09/20/10 0:00

Lab No. : 1009467-02

	Results	Units	LOD	LOQ	Dilution Factor	Qualifiers	Date Analyzed	Analyst
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	40.7	45.2	113		09/30/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	44.1	45.2	113	S1H, S2H	09/30/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	40.7	45.2	113		09/30/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	46.3	50.8	113	S1H, S2H	09/30/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	41.8	45.2	113		09/30/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	64.4	67.8	113		09/30/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	101	102	113		09/30/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	53.1	56.5	113	S2H	09/30/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	55.4	56.5	113		09/30/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	47.5	50.8	113	S2H	09/30/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	40.7	45.2	113		09/30/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	112	113	113		09/30/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	38.4	39.6	113	S2H	09/30/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	44.1	45.2	113		09/30/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	45.2	45.2	113		09/30/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	38.4	45.2	113		09/30/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	40.7	45.2	113		09/30/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	42.9	45.2	113		09/30/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	42.9	45.2	113		09/30/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	39.6	39.6	113		09/30/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	113	113	113		09/30/10	MPM
2-Chlorotoluene	ND	ug/kg dry	42.9	45.2	113		09/30/10	MPM
4-Chlorotoluene	ND	ug/kg dry	37.3	39.9	113		09/30/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	39.6	39.6	113		09/30/10	MPM
Benzene	ND	ug/kg dry	40.7	45.2	113	S1H, S2H	09/30/10	MPM
Bromobenzene	ND	ug/kg dry	39.8	39.6	113		09/30/10	MPM
Bromochloromethane	ND	ug/kg dry	41.8	45.2	113	S1H, S2H	09/30/10	MPM
Bromodichloromethane	ND	ug/kg dry	42.9	45.2	113	S1H, S2H	09/30/10	MPM
Bromoform	ND	ug/kg dry	54.2	56.5	113		09/30/10	MPM
Bromomethane	ND	ug/kg dry	113	113	113		09/30/10	MPM
Butylbenzene	ND	ug/kg dry	46.3	50.6	113		09/30/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	46.3	50.8	113		09/30/10	MPM
Chlorobenzene	ND	ug/kg dry	41.8	45.2	113		09/30/10	MPM
Chloroethane	ND	ug/kg dry	76.8	79.1	113		09/30/10	MPM
Chloroform	ND	ug/kg dry	39.6	45.2	113	S1H, S2H	09/30/10	MPM
Chloromethane	ND	ug/kg dry	39.6	39.6	113		09/30/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 Soil - VOCs
REPORT NO. : 1009467
DATE REC'D : 09/23/10 15:15
REPORT DATE : 10/04/10 10:37
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: MW-77C Below 75', spoil Matrix: Soil

Sample Date/Time: 09/20/10 0:00

Lab No. : 1009467-02

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B Continued								
cis-1,2-Dichloroethylene	ND	ug/kg dry	48.3	50.8	113		09/30/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	37.3	39.6	113		09/30/10	MPM
Dibromochloromethane	ND	ug/kg dry	37.3	39.8	113		09/30/10	MPM
Dibromomethane	ND	ug/kg dry	44.1	45.2	113	S1H, S2H	09/30/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	55.4	56.5	113		09/30/10	MPM
Ethylbenzene	ND	ug/kg dry	41.8	45.2	113		09/30/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	56.5	56.5	113		09/30/10	MPM
Isopropyl Ether	ND	ug/kg dry	81.4	84.8	113	S1H, S2H	09/30/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	40.7	45.2	113		09/30/10	MPM
m,p-Xylenes	ND	ug/kg dry	78.0	79.1	113		09/30/10	MPM
Methylene Chloride	ND	ug/kg dry	35.0	39.6	113		09/30/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	94.9	102	113	S2H, S1H	09/30/10	MPM
Naphthalene	ND	ug/kg dry	48.8	50.8	113	S2H	09/30/10	MPM
o-Xylene	ND	ug/kg dry	56.5	58.5	113		09/30/10	MPM
Propylbenzene	ND	ug/kg dry	40.7	45.2	113		09/30/10	MPM
sec-Butylbenzene	ND	ug/kg dry	45.2	45.2	113		09/30/10	MPM
Styrene	ND	ug/kg dry	39.8	45.2	113		09/30/10	MPM
tert-Butylbenzene	ND	ug/kg dry	41.8	45.2	113		09/30/10	MPM
Tetrachloroethene	ND	ug/kg dry	50.8	50.8	113		09/30/10	MPM
Toluene	ND	ug/kg dry	46.3	50.8	113		09/30/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	50.8	50.8	113		09/30/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	38.4	39.8	113		09/30/10	MPM
Trichloroethene	ND	ug/kg dry	41.8	45.2	113		09/30/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	54.2	56.5	113		09/30/10	MPM
Vinyl chloride	ND	ug/kg dry	52.0	56.5	113		09/30/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 Soil - VOCs
REPORT NO. : 1009467
DATE REC'D : 09/23/10 15:15
REPORT DATE : 10/04/10 10:37
PREPARED BY : BMS

Attn: Dave Ollg

Sample ID: MeOH Blank

Matrix: Soil

Sample Date/Time: 09/21/10 0:00

Lab No. : 1009467-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg	36.0	40.0	100		09/30/10	MPM
1,1,1-Trichloroethane	ND	ug/kg	39.0	40.0	100		09/30/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg	36.0	40.0	100		09/30/10	MPM
1,1,2-Trichloroethane	ND	ug/kg	41.0	45.0	100		09/30/10	MPM
1,1-Dichloroethane	ND	ug/kg	37.0	40.0	100		09/30/10	MPM
1,1-Dichloroethylene	ND	ug/kg	57.0	60.0	100		09/30/10	MPM
1,1-Dichloropropylene	ND	ug/kg	89.0	90.0	100		09/30/10	MPM
1,2,3-Trichlorobenzene	71.9	ug/kg	47.0	50.0	100		09/30/10	MPM
1,2,3-Trichloropropane	ND	ug/kg	49.0	50.0	100		09/30/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg	42.0	45.0	100		09/30/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg	36.0	40.0	100		09/30/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg	99.0	100	100		09/30/10	MPM
1,2-Dibromoethane	ND	ug/kg	34.0	35.0	100		09/30/10	MPM
1,2-Dichlorobenzene	ND	ug/kg	39.0	40.0	100		09/30/10	MPM
1,2-Dichloroethane	ND	ug/kg	40.0	40.0	100		09/30/10	MPM
1,2-Dichloropropane	ND	ug/kg	34.0	40.0	100		09/30/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg	36.0	40.0	100		09/30/10	MPM
1,3-Dichlorobenzene	ND	ug/kg	38.0	40.0	100		09/30/10	MPM
1,3-Dichloropropane	ND	ug/kg	38.0	40.0	100		09/30/10	MPM
1,4-Dichlorobenzene	ND	ug/kg	35.0	35.0	100		09/30/10	MPM
2,2-Dichloropropane	ND	ug/kg	100	100	100		09/30/10	MPM
2-Chlorotoluene	ND	ug/kg	38.0	40.0	100		09/30/10	MPM
4-Chlorotoluene	ND	ug/kg	33.0	35.3	100		09/30/10	MPM
4-Isopropyltoluene	ND	ug/kg	35.0	35.0	100		09/30/10	MPM
Benzene	ND	ug/kg	36.0	40.0	100		09/30/10	MPM
Bromobenzene	ND	ug/kg	35.0	35.0	100		09/30/10	MPM
Bromochloromethane	ND	ug/kg	37.0	40.0	100		09/30/10	MPM
Bromodichloromethane	ND	ug/kg	38.0	40.0	100		09/30/10	MPM
Bromoform	ND	ug/kg	48.0	50.0	100		09/30/10	MPM
Bromomethane	ND	ug/kg	100	100	100		09/30/10	MPM
Butylbenzene	ND	ug/kg	41.0	45.0	100		09/30/10	MPM
Carbon Tetrachloride	ND	ug/kg	41.0	45.0	100		09/30/10	MPM
Chlorobenzene	ND	ug/kg	37.0	40.0	100		09/30/10	MPM
Chloroethane	ND	ug/kg	68.0	70.0	100		09/30/10	MPM
Chloroform	ND	ug/kg	35.0	40.0	100		09/30/10	MPM
Chloromethane	ND	ug/kg	35.0	35.0	100		09/30/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34283.000 Soil - VOCs
REPORT NO. : 1009467
DATE REC'D 09/23/10 15:15
REPORT DATE : 10/04/10 10:37
PREPARED BY : BMS

Attn: Dave Olig

Sample ID: MeOH Blank

Matrix: Soil

Sample Date/Time: 09/21/10 0:00

Lab No. : 1009467-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg	41.0	45.0	100		09/30/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg	33.0	35.0	100		09/30/10	MPM
Dibromochloromethane	ND	ug/kg	33.0	35.0	100		09/30/10	MPM
Dibromomethane	ND	ug/kg	39.0	40.0	100		09/30/10	MPM
Dichlorodifluoromethane	ND	ug/kg	49.0	50.0	100		09/30/10	MPM
Ethylbenzene	ND	ug/kg	37.0	40.0	100		09/30/10	MPM
Hexachlorobutadiene	58.9	ug/kg	50.0	50.0	100		09/30/10	MPM
Isopropyl Ether	ND	ug/kg	72.0	75.0	100		09/30/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg	38.0	40.0	100		09/30/10	MPM
m,p-Xylenes	ND	ug/kg	69.0	70.0	100		09/30/10	MPM
Methylene Chloride	ND	ug/kg	31.0	35.0	100		09/30/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg	84.0	90.0	100		09/30/10	MPM
Naphthalene	80.0	ug/kg	43.0	45.0	100		09/30/10	MPM
o-Xylene	ND	ug/kg	50.0	50.0	100		09/30/10	MPM
Propylbenzene	ND	ug/kg	38.0	40.0	100		09/30/10	MPM
sec-Butylbenzene	ND	ug/kg	40.0	40.0	100		09/30/10	MPM
Styrene	ND	ug/kg	35.0	40.0	100		09/30/10	MPM
tert-Butylbenzene	ND	ug/kg	37.0	40.0	100		09/30/10	MPM
Tetrachloroethene	ND	ug/kg	45.0	45.0	100		09/30/10	MPM
Toluene	ND	ug/kg	41.0	45.0	100		09/30/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg	45.0	45.0	100		09/30/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg	34.0	35.0	100		09/30/10	MPM
Trichloroethene	ND	ug/kg	37.0	40.0	100		09/30/10	MPM
Trichlorofluoromethane	ND	ug/kg	48.0	50.0	100		09/30/10	MPM
Vinyl chloride	ND	ug/kg	46.0	50.0	100		09/30/10	MPM

SIEMENS

Qualifier Descriptions

S2H	Second sample matrix spike recovery was high.
S1H	First sample matrix spike recovery was high.

Definltions

LOD = Limit of Detection (Dilution Corrected)
LOQ = Limit of Quantitation (Dilution Corrected)
Reporting Limit = LOQ (Dilution Corrected)
ND = Not Detected
COMP = Complete
SUBCON = Subcontracted analysis
mv = millivolts
pci/L = picocuries per Liter
mL/L = milliliters per Liter
mg = milligram

When the word "dry" follows the units on the result page the sample results are dry weight corrected.

LODs and LOQs are dry weight corrected for all soils except WI GRO, EPA 8021 and WI DNR/EPA 8260B methanol and WI DNR methylene chloride preserved soils being reported to the State of Wisconsin.

ug/l = Micrograms per Liter = parts per billion (ppb)
ug/kg = Micrograms per kilogram = parts per billion (ppb)
mg/l = Milligrams per liter = parts per million (ppm)
mg/kg = Milligrams per kilogram = parts per million (ppm)
NOT PRES = Not Present
ppth = Parts per thousand
* = Result outside established limits.
mg/m³ = Milligrams per meter cubed
ng/L = Nanograms per Liter = Parts per trillion (ppt)
> = Greater Than

State of Wisconsin Methanol Soils for WI GRO, WI DNR/EPA 8260B and EPA 8021 are reported to the LOQ.

SIEMENS

Out under 34283.000 permit
 in Element to get completed list of VOCs

Company Name Gannett Fleming		Project PRESTO 34283.000
Report Mailing Address 8025 Excelsior Dr Madison, WI 53717		Contact Name, Phone, Fax, Email Dave Olig 608-836-1500
Invoice Address same	Purchase Order # 2010 Siemens - GF contract prices	Invoice Contact and Phone No. same

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: _____
 (If Yes, please specify Agency or Regulation) Agency/Reg.: _____

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
 Date Needed: _____

WO No. 1009467

Analyses Requested										Lab Use Only		
										Delivered by	Walk-in	<u>Courier</u>
										Ship. Cont. OK?	<u>Y</u>	N NA
										Samples Leaking?	Y <u>N</u>	NA NA
										Seals OK?	<u>Y</u>	N NA
										Rec'd on Ice?	<u>Y</u>	N NA
										Sample Receiving Comments:		
										3.6		
										Comments		
										Below 75' feet, spore		
										Below 75' feet, spore		
										1-2oz meth		
										6-2106 TBolk		

Lab Use Only	Sample		No. of Containers		Sample ID
	Date	Time	Comp	Grab	
-1	9/21/10	PM	2		MW-76B
-2	9/20/10	PM	2		MW-77C
-3			1		Meth Trip

VOCs

X
X
X

1-2oz with meth
1-15 pl cup

Chain of Custody Record

Relinquished By:	Date	Time	Received By:
<i>Math Haller</i>	9/21/10	10A.	
	9/23/10	1515	<i>Sue Anderson</i>

SIEMENS

September 15, 2010

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

Attn: Tony Miller

RECEIVED	
GANNETT FLEMING-MADISON, WI	
FILE NO:	<u>34283.000</u>
SEP 18 ⁶ 2010	
REVIEWED BY:	<u>Djo</u>
DATE:	<u>9/17/10</u>
ROUTE TO:	_____

REPORT NO.: 1009178

PROJECT NO.: 34286.008


Please find enclosed the analytical report, including the Sample Summary, Sample Narrative and Chain of Custody for your sample set received September 9, 2010.

All analyses were performed in accordance with NELAC Standards using approved methods as indicated on this report.


If you have any questions about the results, please call. Thank you for using Siemens Water Technologies for your analytical needs.

Sincerely,

Siemens Water Technologies


Bruce Schertz
Lab Manager
Enviroscan Analytical™ Services
Cc: Copy of report to Dave Olig

I certify that the data contained in this report has been generated and reviewed in accordance with the Siemens Water Technologies Quality Assurance Program. Exceptions, if any, are discussed in the sample narrative. Samples will be retained for 30 days from the date of this report, then disposed in an appropriate manner. Siemens Water Technologies Corp. reserves the right to return samples identified as hazardous. Release of this Final Report is authorized as verified by the following signature. The contents of this report apply to the sample(s) analyzed. No duplication of this report is allowed except in its entirety.

Reviewed by:  _____

Certifications:

Wisconsin 737053130
Minnesota 055-999-302
Illinois 100317



Siemens Water Technologies Corp.

301 West Military Road
Rothschild, WI 54474

Tel. 800-338-7226

Fax: 715-355-3221

www.siemens.com/enviroscan

LABORATORY'S QUALITY VERIFICATION STATEMENT

Laboratory must provide a signed copy of this form with each deliverable specified in the Work Order or the deliverable will not be accepted. Laboratory must provide Gannett Fleming with a true copy of its internal QA/QC review and approval forms related to the deliverable.


This form must be signed by the Laboratory's Quality Control/Quality Assurance Officer

Project Name:

Gannett Fleming Project Number: 34286.008

Deliverable Description: Analytical Report

I, Cindy Varga, warrant and represent that the project deliverable described above and attached to this form was developed in accordance with the project scope of work and that all elements relating to the quality of the deliverable were verified in accordance with the requirements of my firm's internal quality management/quality assurance system. This deliverable satisfies all requirements of our Contract with Gannett Fleming.

Signature: 
(by Laboratory's QC/QA Officer)

Date: 9/15/10

Laboratory: Siemens Water Technologies

'Deliverable' shall mean all aspects of design including, without limitation, drawings, calculations, maps, materials and specifications, reports, data bases, logs and other information developed from wells, borings and cores, laboratory data, materials schedules, instrument calibration data and all other items developed, prepared and delivered to Gannett Fleming by Contractor as specified in the Scope of Work in any media.

bw 10.2.09

SIEMENS

SAMPLE SUMMARY

<u>Lab Id</u>	<u>Client Sample Id</u>	<u>Date/Time</u>	<u>Matrix</u>
1009178-01	CB-1 0-4'	09/07/10 11:20	Soil
1009178-02	CB-1 4-8'	09/07/10 11:25	Soil
1009178-03	CB-1 8-12'	09/07/10 11:30	Soil
1009178-04	CB-2 0-4'	09/07/10 12:25	Soil
1009178-05	CB-3 0-4'	09/07/10 12:40	Soil
1009178-06	CB-3 4-8'	09/07/10 12:45	Soil
1009178-07	CB-3 8-12'	09/07/10 12:55	Soil
1009178-08	CB-4 0-4'	09/07/10 13:00	Soil
1009178-09	CB-5 0-4'	09/07/10 13:15	Soil
1009178-10	CB-5 4-8'	09/07/10 13:20	Soil
1009178-11	CB-5 8-12'	09/07/10 13:25	Soil
1009178-12	CB-6 0-4'	09/07/10 13:50	Soil
1009178-13	CB-6 4-8'	09/07/10 13:55	Soil
1009178-14	CB-6 8-12'	09/07/10 14:00	Soil
1009178-15	CB-7 0-4'	09/07/10 14:10	Soil
1009178-16	CB-7 4-8'	09/07/10 14:15	Soil
1009178-17	CB-7 8-12'	09/07/10 14:20	Soil
1009178-18	CB-8 0-4'	09/07/10 14:30	Soil
1009178-19	CB-8 4-8'	09/07/10 14:35	Soil
1009178-20	CB-8 8-12'	09/07/10 14:45	Soil
1009178-21	CB-9 0-4'	09/07/10 14:55	Soil
1009178-22	CB-10 0-4'	09/07/10 15:20	Soil
1009178-23	CB-10 4-8'	09/07/10 15:25	Soil
1009178-24	CB-10 8-12'	09/07/10 15:40	Soil
1009178-25	CB-11 0-4'	09/07/10 16:00	Soil
1009178-26	CB-11 4-8'	09/07/10 16:10	Soil
1009178-27	CB-11 8-12'	09/07/10 16:20	Soil
1009178-28	MeOH Blank	09/07/10 00:00	Soil

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-1 0-4'

Matrix: Soil

Sample Date/Time: 09/07/10 11:20

Lab No. : 1009178-01

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	36.0	40.0	100		09/10/10	MPM
✓ 1,1,1-Trichloroethane	581	ug/kg dry	39.0	40.0	100		09/10/10	MPM
✓ 1,1,2,2-Tetrachloroethane	309	ug/kg dry	36.0	40.0	100		09/10/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	41.0	45.0	100		09/10/10	MPM
✓ 1,1-Dichloroethane	125	ug/kg dry	37.0	40.0	100		09/10/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	57.0	60.0	100		09/10/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	89.0	90.0	100		09/10/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	47.0	50.0	100		09/10/10	MPM
✓ 1,2,3-Trichloropropane	ND	ug/kg dry	49.0	50.0	100		09/10/10	MPM
✓ 1,2,4-Trichlorobenzene	ND	ug/kg dry	42.0	45.0	100		09/10/10	MPM
✓ 1,2,4-Trimethylbenzene	158	ug/kg dry	38.0	40.0	100		09/10/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	99.0	100	100		09/10/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	34.0	35.0	100		09/10/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	39.0	40.0	100		09/10/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	40.0	40.0	100		09/10/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	34.0	40.0	100		09/10/10	MPM
✓ 1,3,5-Trimethylbenzene	ND	ug/kg dry	36.0	40.0	100		09/10/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	38.0	40.0	100		09/10/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	38.0	40.0	100		09/10/10	MPM
✓ 1,4-Dichlorobenzene	ND	ug/kg dry	35.0	35.0	100		09/10/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	100	100	100		09/10/10	MPM
2-Chlorotoluene	ND	ug/kg dry	38.0	40.0	100		09/10/10	MPM
4-Chlorotoluene	ND	ug/kg dry	33.0	35.3	100		09/10/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	35.0	35.0	100		09/10/10	MPM
Benzene	ND	ug/kg dry	36.0	40.0	100		09/10/10	MPM
✓ Bromobenzene	35.2	ug/kg dry	35.0	35.0	100		09/10/10	MPM
Bromochloromethane	ND	ug/kg dry	37.0	40.0	100		09/10/10	MPM
Bromodichloromethane	ND	ug/kg dry	38.0	40.0	100		09/10/10	MPM
Bromoform	ND	ug/kg dry	48.0	50.0	100		09/10/10	MPM
Bromomethane	ND	ug/kg dry	100	100	100		09/10/10	MPM
Butylbenzene	ND	ug/kg dry	41.0	45.0	100		09/10/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	41.0	45.0	100		09/10/10	MPM
Chlorobenzene	ND	ug/kg dry	37.0	40.0	100		09/10/10	MPM
Chloroethane	ND	ug/kg dry	68.0	70.0	100		09/10/10	MPM
Chloroform	ND	ug/kg dry	35.0	40.0	100		09/10/10	MPM
Chloromethane	ND	ug/kg dry	35.0	35.0	100		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-1 0-4'

Matrix: Soil

Sample Date/Time: 09/07/10 11:20

Lab No. : 1009178-01

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
✓ cis-1,2-Dichloroethylene	ND	ug/kg dry	41.0	45.0	100		09/10/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	33.0	35.0	100		09/10/10	MPM
Dibromochloromethane	ND	ug/kg dry	33.0	35.0	100		09/10/10	MPM
Dibromomethane	ND	ug/kg dry	39.0	40.0	100		09/10/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	49.0	50.0	100		09/10/10	MPM
✓ Ethylbenzene	ND	ug/kg dry	37.0	40.0	100		09/10/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	50.0	50.0	100		09/10/10	MPM
Isopropyl Ether	ND	ug/kg dry	72.0	75.0	100		09/10/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	36.0	40.0	100		09/10/10	MPM
✓ m,p-Xylenes	ND	ug/kg dry	69.0	70.0	100		09/10/10	MPM
Methylene Chloride	ND	ug/kg dry	31.0	35.0	100		09/10/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	84.0	90.0	100		09/10/10	MPM
✓ Naphthalene	274	ug/kg dry	43.0	45.0	100		09/10/10	MPM
✓ o-Xylene	ND	ug/kg dry	50.0	50.0	100		09/10/10	MPM
Propylbenzene	ND	ug/kg dry	36.0	40.0	100		09/10/10	MPM
sec-Butylbenzene	ND	ug/kg dry	40.0	40.0	100		09/10/10	MPM
Styrene	ND	ug/kg dry	35.0	40.0	100		09/10/10	MPM
tert-Butylbenzene	ND	ug/kg dry	37.0	40.0	100		09/10/10	MPM
✓ Tetrachloroethene	57.9	ug/kg dry	45.0	45.0	100		09/10/10	MPM
✓ Toluene	129	ug/kg dry	41.0	45.0	100		09/10/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	45.0	45.0	100		09/10/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	34.0	35.0	100		09/10/10	MPM
✓ Trichloroethene	ND	ug/kg dry	37.0	40.0	100		09/10/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	48.0	50.0	100		09/10/10	MPM
Vinyl chloride	ND	ug/kg dry	46.0	50.0	100		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-1 4-8'

Matrix: Soil

Sample Date/Time: 09/07/10 11:25

Lab No. : 1009178-02

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	40.2	41.2	103		09/10/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	42.2	46.4	103		09/10/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	38.1	41.2	103		09/10/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	58.7	61.8	103		09/10/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	91.7	92.7	103		09/10/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	48.4	51.5	103		09/10/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	50.5	51.5	103		09/10/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	43.3	46.4	103		09/10/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	102	103	103		09/10/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	35.0	38.0	103		09/10/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	40.2	41.2	103		09/10/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	41.2	41.2	103		09/10/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	35.0	41.2	103		09/10/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	39.1	41.2	103		09/10/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	39.1	41.2	103		09/10/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	36.0	36.0	103		09/10/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	103	103	103		09/10/10	MPM
2-Chlorotoluene	ND	ug/kg dry	39.1	41.2	103		09/10/10	MPM
4-Chlorotoluene	ND	ug/kg dry	34.0	36.4	103		09/10/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	36.0	36.0	103		09/10/10	MPM
Benzene	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
Bromobenzene	ND	ug/kg dry	36.0	36.0	103		09/10/10	MPM
Bromochloromethane	ND	ug/kg dry	38.1	41.2	103		09/10/10	MPM
Bromodichloromethane	ND	ug/kg dry	39.1	41.2	103		09/10/10	MPM
Bromoform	ND	ug/kg dry	49.4	51.5	103		09/10/10	MPM
Bromomethane	ND	ug/kg dry	103	103	103		09/10/10	MPM
Butylbenzene	ND	ug/kg dry	42.2	46.4	103		09/10/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	42.2	46.4	103		09/10/10	MPM
Chlorobenzene	ND	ug/kg dry	38.1	41.2	103		09/10/10	MPM
Chloroethane	ND	ug/kg dry	70.0	72.1	103		09/10/10	MPM
Chloroform	ND	ug/kg dry	36.0	41.2	103		09/10/10	MPM
Chloromethane	ND	ug/kg dry	36.0	36.0	103		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-1 4-8'

Matrix: Soil

Sample Date/Time: 09/07/10 11:25

Lab No. : 1009178-02

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	42.2	46.4	103		09/10/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	34.0	36.0	103		09/10/10	MPM
Dibromochloromethane	ND	ug/kg dry	34.0	36.0	103		09/10/10	MPM
Dibromomethane	ND	ug/kg dry	40.2	41.2	103		09/10/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	50.5	51.5	103		09/10/10	MPM
Ethylbenzene	ND	ug/kg dry	38.1	41.2	103		09/10/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	51.5	51.5	103		09/10/10	MPM
Isopropyl Ether	ND	ug/kg dry	74.2	77.2	103		09/10/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
m,p-Xylenes	ND	ug/kg dry	71.1	72.1	103		09/10/10	MPM
Methylene Chloride	ND	ug/kg dry	31.9	36.0	103		09/10/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	86.5	92.7	103		09/10/10	MPM
Naphthalene	82.4	ug/kg dry	44.3	46.4	103		09/10/10	MPM
o-Xylene	ND	ug/kg dry	51.5	51.5	103		09/10/10	MPM
Propylbenzene	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
sec-Butylbenzene	ND	ug/kg dry	41.2	41.2	103		09/10/10	MPM
Styrene	ND	ug/kg dry	36.0	41.2	103		09/10/10	MPM
tert-Butylbenzene	ND	ug/kg dry	38.1	41.2	103		09/10/10	MPM
Tetrachloroethene	ND	ug/kg dry	46.4	46.4	103		09/10/10	MPM
Toluene	ND	ug/kg dry	42.2	46.4	103		09/10/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	46.4	46.4	103		09/10/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	35.0	36.0	103		09/10/10	MPM
Trichloroethene	ND	ug/kg dry	38.1	41.2	103		09/10/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	49.4	51.5	103		09/10/10	MPM
Vinyl chloride	ND	ug/kg dry	47.4	51.5	103		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-1 8-12'

Matrix: Soil

Sample Date/Time: 09/07/10 11:30

Lab No. : 1009178-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	40.2	41.2	103		09/10/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	42.2	46.4	103		09/10/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	38.1	41.2	103		09/10/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	58.7	61.8	103		09/10/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	91.7	92.7	103		09/10/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	48.4	51.5	103		09/10/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	50.5	51.5	103		09/10/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	43.3	46.4	103		09/10/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	102	103	103		09/10/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	35.0	36.0	103		09/10/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	40.2	41.2	103		09/10/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	41.2	41.2	103		09/10/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	35.0	41.2	103		09/10/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	39.1	41.2	103		09/10/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	39.1	41.2	103		09/10/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	36.0	36.0	103		09/10/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	103	103	103		09/10/10	MPM
2-Chlorotoluene	ND	ug/kg dry	39.1	41.2	103		09/10/10	MPM
4-Chlorotoluene	ND	ug/kg dry	34.0	36.4	103		09/10/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	36.0	36.0	103		09/10/10	MPM
Benzene	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
Bromobenzene	ND	ug/kg dry	36.0	36.0	103		09/10/10	MPM
Bromochloromethane	ND	ug/kg dry	38.1	41.2	103		09/10/10	MPM
Bromodichloromethane	ND	ug/kg dry	39.1	41.2	103		09/10/10	MPM
Bromoform	ND	ug/kg dry	49.4	51.5	103		09/10/10	MPM
Bromomethane	ND	ug/kg dry	103	103	103		09/10/10	MPM
Butylbenzene	ND	ug/kg dry	42.2	46.4	103		09/10/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	42.2	46.4	103		09/10/10	MPM
Chlorobenzene	ND	ug/kg dry	38.1	41.2	103		09/10/10	MPM
Chloroethane	ND	ug/kg dry	70.0	72.1	103		09/10/10	MPM
Chloroform	ND	ug/kg dry	36.0	41.2	103		09/10/10	MPM
Chloromethane	ND	ug/kg dry	36.0	36.0	103		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-1 8-12'

Matrix: Soil

Sample Date/Time: 09/07/10 11:30

Lab No. : 1009178-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	42.2	46.4	103		09/10/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	34.0	36.0	103		09/10/10	MPM
Dibromochloromethane	ND	ug/kg dry	34.0	36.0	103		09/10/10	MPM
Dibromomethane	ND	ug/kg dry	40.2	41.2	103		09/10/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	50.5	51.5	103		09/10/10	MPM
Ethylbenzene	ND	ug/kg dry	38.1	41.2	103		09/10/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	51.5	51.5	103		09/10/10	MPM
Isopropyl Ether	ND	ug/kg dry	74.2	77.2	103		09/10/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
m,p-Xylenes	ND	ug/kg dry	71.1	72.1	103		09/10/10	MPM
Methylene Chloride	ND	ug/kg dry	31.9	36.0	103		09/10/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	86.5	92.7	103		09/10/10	MPM
Naphthalene	ND	ug/kg dry	44.3	46.4	103		09/10/10	MPM
o-Xylene	ND	ug/kg dry	51.5	51.5	103		09/10/10	MPM
Propylbenzene	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
sec-Butylbenzene	ND	ug/kg dry	41.2	41.2	103		09/10/10	MPM
Styrene	ND	ug/kg dry	36.0	41.2	103		09/10/10	MPM
tert-Butylbenzene	ND	ug/kg dry	38.1	41.2	103		09/10/10	MPM
Tetrachloroethene	ND	ug/kg dry	46.4	46.4	103		09/10/10	MPM
Toluene	ND	ug/kg dry	42.2	46.4	103		09/10/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	46.4	46.4	103		09/10/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	35.0	36.0	103		09/10/10	MPM
Trichloroethene	ND	ug/kg dry	38.1	41.2	103		09/10/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	49.4	51.5	103		09/10/10	MPM
Vinyl chloride	ND	ug/kg dry	47.4	51.5	103		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-2 0-4'

Matrix: Soil

Sample Date/Time: 09/07/10 12:25

Lab No. : 1009178-04

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	41.0	45.6	114		09/10/10	MPM
1,1,1-Trichloroethane	136	ug/kg dry	44.5	45.8	114		09/10/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	41.0	45.6	114		09/10/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	46.7	51.3	114		09/10/10	MPM
1,1-Dichloroethane	61.0	ug/kg dry	42.2	45.6	114		09/10/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	65.0	68.4	114		09/10/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	101	103	114		09/10/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	53.6	57.0	114		09/10/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	55.9	57.0	114		09/10/10	MPM
1,2,4-Trichlorobenzene	54.4	ug/kg dry	47.9	51.3	114		09/10/10	MPM
1,2,4-Trimethylbenzene	80.0	ug/kg dry	41.0	45.8	114		09/10/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	113	114	114		09/10/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	36.8	39.9	114		09/10/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	44.5	45.6	114		09/10/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	45.8	45.8	114		09/10/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	38.8	45.8	114		09/10/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	41.0	45.8	114		09/10/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	43.3	45.8	114		09/10/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	43.3	45.8	114		09/10/10	MPM
1,4-Dichlorobenzene	98.9	ug/kg dry	39.9	39.9	114		09/10/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	114	114	114		09/10/10	MPM
2-Chlorotoluene	ND	ug/kg dry	43.3	45.8	114		09/10/10	MPM
4-Chlorotoluene	ND	ug/kg dry	37.8	40.2	114		09/10/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	39.9	39.9	114		09/10/10	MPM
Benzene	ND	ug/kg dry	41.0	45.6	114		09/10/10	MPM
Bromobenzene	ND	ug/kg dry	39.9	39.9	114		09/10/10	MPM
Bromochloromethane	ND	ug/kg dry	42.2	45.6	114		09/10/10	MPM
Bromodichloromethane	ND	ug/kg dry	43.3	45.8	114		09/10/10	MPM
Bromoform	ND	ug/kg dry	54.7	57.0	114		09/10/10	MPM
Bromomethane	ND	ug/kg dry	114	114	114		09/10/10	MPM
Butylbenzene	ND	ug/kg dry	46.7	51.3	114		09/10/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	46.7	51.3	114		09/10/10	MPM
Chlorobenzene	ND	ug/kg dry	42.2	45.6	114		09/10/10	MPM
Chloroethane	ND	ug/kg dry	77.5	79.8	114		09/10/10	MPM
Chloroform	ND	ug/kg dry	39.9	45.6	114		09/10/10	MPM
Chloromethane	ND	ug/kg dry	39.9	39.9	114		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-2 0-4'

Matrix: Soil

Sample Date/Time: 09/07/10 12:25

Lab No. : 1009178-04

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	46.7	51.3	114		09/10/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	37.6	39.9	114		09/10/10	MPM
Dibromochloromethane	ND	ug/kg dry	37.6	39.9	114		09/10/10	MPM
Dibromomethane	ND	ug/kg dry	44.5	45.6	114		09/10/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	55.9	57.0	114		09/10/10	MPM
Ethylbenzene	ND	ug/kg dry	42.2	45.6	114		09/10/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	57.0	57.0	114		09/10/10	MPM
Isopropyl Ether	ND	ug/kg dry	82.1	85.5	114		09/10/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	41.0	45.6	114		09/10/10	MPM
m,p-Xylenes	ND	ug/kg dry	78.7	79.8	114		09/10/10	MPM
Methylene Chloride	ND	ug/kg dry	35.3	39.9	114		09/10/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	95.6	103	114		09/10/10	MPM
Naphthalene	76.2	ug/kg dry	49.0	51.3	114		09/10/10	MPM
o-Xylene	ND	ug/kg dry	57.0	57.0	114		09/10/10	MPM
Propylbenzene	ND	ug/kg dry	41.0	45.6	114		09/10/10	MPM
sec-Butylbenzene	ND	ug/kg dry	45.6	45.6	114		09/10/10	MPM
Styrene	ND	ug/kg dry	38.9	45.6	114		09/10/10	MPM
tert-Butylbenzene	ND	ug/kg dry	42.2	45.6	114		09/10/10	MPM
Tetrachloroethene	ND	ug/kg dry	51.3	51.3	114		09/10/10	MPM
Toluene	55.2	ug/kg dry	46.7	51.3	114		09/10/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	51.3	51.3	114		09/10/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	38.8	39.9	114		09/10/10	MPM
Trichloroethene	1440	ug/kg dry	42.2	45.6	114		09/10/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	54.7	57.0	114		09/10/10	MPM
Vinyl chloride	ND	ug/kg dry	52.4	57.0	114		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-3 0-4'

Matrix: Soil

Sample Date/Time: 09/07/10 12:40

Lab No. : 1009178-05

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	40.0	44.4	111		09/10/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	43.3	44.4	111		09/10/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	40.0	44.4	111		09/10/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	45.5	50.0	111		09/10/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	41.1	44.4	111		09/10/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	83.3	88.8	111		09/10/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	98.8	99.9	111		09/10/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	52.2	55.5	111		09/10/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	54.4	55.5	111		09/10/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	46.6	50.0	111		09/10/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	40.0	44.4	111		09/10/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	110	111	111		09/10/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	37.7	38.8	111		09/10/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	43.3	44.4	111		09/10/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	44.4	44.4	111		09/10/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	37.7	44.4	111		08/10/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	40.0	44.4	111		09/10/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	42.2	44.4	111		09/10/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	42.2	44.4	111		09/10/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	38.8	38.8	111		09/10/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	111	111	111		09/10/10	MPM
2-Chlorotoluene	ND	ug/kg dry	42.2	44.4	111		08/10/10	MPM
4-Chlorotoluene	ND	ug/kg dry	36.6	39.2	111		09/10/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	38.8	38.8	111		09/10/10	MPM
Benzene	ND	ug/kg dry	40.0	44.4	111		09/10/10	MPM
Bromobenzene	ND	ug/kg dry	38.8	38.8	111		09/10/10	MPM
Bromochloromethane	ND	ug/kg dry	41.1	44.4	111		09/10/10	MPM
Bromodichloromethane	ND	ug/kg dry	42.2	44.4	111		09/10/10	MPM
Bromoform	ND	ug/kg dry	53.3	55.5	111		09/10/10	MPM
Bromomethane	ND	ug/kg dry	111	111	111		09/10/10	MPM
Butylbenzene	ND	ug/kg dry	45.5	50.0	111		09/10/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	45.5	50.0	111		09/10/10	MPM
Chlorobenzene	ND	ug/kg dry	41.1	44.4	111		09/10/10	MPM
Chloroethane	ND	ug/kg dry	75.5	77.7	111		09/10/10	MPM
Chloroform	ND	ug/kg dry	38.8	44.4	111		08/10/10	MPM
Chloromethane	ND	ug/kg dry	38.8	38.8	111		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-3 0-4'

Matrix: Soil

Sample Date/Time: 09/07/10 12:40

Lab No. : 1009178-05

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	45.5	50.0	111		09/10/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	36.6	36.8	111		09/10/10	MPM
Dibromochloromethane	ND	ug/kg dry	36.6	38.8	111		09/10/10	MPM
Dibromomethane	ND	ug/kg dry	43.3	44.4	111		09/10/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	54.4	55.5	111		09/10/10	MPM
Ethylbenzene	ND	ug/kg dry	41.1	44.4	111		09/10/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	55.5	55.5	111		09/10/10	MPM
Isopropyl Ether	ND	ug/kg dry	79.9	83.2	111		09/10/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	40.0	44.4	111		09/10/10	MPM
m,p-Xylenes	ND	ug/kg dry	76.6	77.7	111		09/10/10	MPM
Methylene Chloride	ND	ug/kg dry	34.4	38.8	111		09/10/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	93.2	99.9	111		09/10/10	MPM
Naphthalene	ND	ug/kg dry	47.7	50.0	111		09/10/10	MPM
o-Xylene	ND	ug/kg dry	55.5	55.5	111		09/10/10	MPM
Propylbenzene	ND	ug/kg dry	40.0	44.4	111		09/10/10	MPM
sec-Butylbenzene	ND	ug/kg dry	44.4	44.4	111		09/10/10	MPM
Styrene	ND	ug/kg dry	38.8	44.4	111		09/10/10	MPM
tert-Butylbenzene	ND	ug/kg dry	41.1	44.4	111		09/10/10	MPM
Tetrachloroethene	ND	ug/kg dry	50.0	50.0	111		09/10/10	MPM
Toluene	ND	ug/kg dry	45.5	50.0	111		09/10/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	50.0	50.0	111		09/10/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	37.7	38.8	111		09/10/10	MPM
Trichloroethene	48.4	ug/kg dry	41.1	44.4	111		09/10/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	53.3	55.5	111		09/10/10	MPM
Vinyl chloride	ND	ug/kg dry	51.1	55.5	111		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-3 4-8'

Matrix: Soil

Sample Date/Time: 09/07/10 12:45

Lab No. : 1009178-06

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	36.7	40.8	102		09/10/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	39.8	40.8	102		09/10/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	36.7	40.8	102		09/10/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	41.8	45.9	102		09/10/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	37.7	40.8	102		09/10/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	58.1	81.2	102		09/10/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	90.8	91.8	102		09/10/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	47.9	51.0	102		09/10/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	50.0	51.0	102		09/10/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	42.8	45.9	102		09/10/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	36.7	40.8	102		09/10/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	101	102	102		09/10/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	34.7	35.7	102		09/10/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	39.8	40.8	102		09/10/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	40.6	40.8	102		09/10/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	34.7	40.8	102		09/10/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	36.7	40.8	102		09/10/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	36.8	40.8	102		09/10/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	36.8	40.8	102		09/10/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	35.7	35.7	102		09/10/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	102	102	102		09/10/10	MPM
2-Chlorotoluene	ND	ug/kg dry	38.8	40.8	102		09/10/10	MPM
4-Chlorotoluene	ND	ug/kg dry	33.7	36.0	102		09/10/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	35.7	35.7	102		09/10/10	MPM
Benzene	ND	ug/kg dry	36.7	40.8	102		09/10/10	MPM
Bromobenzene	ND	ug/kg dry	35.7	35.7	102		09/10/10	MPM
Bromochloromethane	ND	ug/kg dry	37.7	40.8	102		09/10/10	MPM
Bromodichloromethane	ND	ug/kg dry	36.8	40.8	102		09/10/10	MPM
Bromoform	ND	ug/kg dry	49.0	51.0	102		09/10/10	MPM
Bromomethane	ND	ug/kg dry	102	102	102		09/10/10	MPM
Butylbenzene	ND	ug/kg dry	41.8	45.9	102		09/10/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	41.8	45.9	102		09/10/10	MPM
Chlorobenzene	ND	ug/kg dry	37.7	40.8	102		09/10/10	MPM
Chloroethane	ND	ug/kg dry	69.4	71.4	102		09/10/10	MPM
Chloroform	ND	ug/kg dry	35.7	40.8	102		09/10/10	MPM
Chloromethane	ND	ug/kg dry	35.7	35.7	102		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-3 4-8'

Matrix: Soil

Sample Date/Time: 09/07/10 12:45

Lab No. : 1009178-06

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	41.8	45.9	102		09/10/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	33.7	35.7	102		09/10/10	MPM
Dibromochloromethane	ND	ug/kg dry	33.7	35.7	102		09/10/10	MPM
Dibromomethane	ND	ug/kg dry	39.8	40.8	102		09/10/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	50.0	51.0	102		09/10/10	MPM
Ethylbenzene	ND	ug/kg dry	37.7	40.8	102		09/10/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	51.0	51.0	102		09/10/10	MPM
Isopropyl Ether	ND	ug/kg dry	73.4	76.5	102		09/10/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	36.7	40.8	102		09/10/10	MPM
m,p-Xylenes	ND	ug/kg dry	70.4	71.4	102		09/10/10	MPM
Methylene Chloride	ND	ug/kg dry	31.6	35.7	102		09/10/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	85.7	91.8	102		09/10/10	MPM
Naphthalene	ND	ug/kg dry	43.9	45.9	102		09/10/10	MPM
o-Xylene	ND	ug/kg dry	51.0	51.0	102		09/10/10	MPM
Propylbenzene	ND	ug/kg dry	36.7	40.8	102		09/10/10	MPM
sec-Butylbenzene	ND	ug/kg dry	40.8	40.8	102		09/10/10	MPM
Styrene	ND	ug/kg dry	35.7	40.8	102		09/10/10	MPM
tert-Butylbenzene	ND	ug/kg dry	37.7	40.8	102		09/10/10	MPM
Tetrachloroethane	ND	ug/kg dry	45.9	45.9	102		09/10/10	MPM
Toluene	ND	ug/kg dry	41.8	45.9	102		09/10/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	45.9	45.9	102		09/10/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	34.7	35.7	102		09/10/10	MPM
Trichloroethane	3160	ug/kg dry	37.7	40.8	102		09/10/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	49.0	51.0	102		09/10/10	MPM
Vinyl chloride	ND	ug/kg dry	48.9	51.0	102		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-3 8-12'

Matrix: Soil

Sample Date/Time: 09/07/10 12:55

Lab No. : 1009178-07

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	41.4	46.0	115		09/10/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	44.8	46.0	115		09/10/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	41.4	46.0	115		09/10/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	47.2	51.8	115		09/10/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	42.6	46.0	115		09/10/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	65.6	69.0	115		09/10/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	102	104	115		09/10/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	54.0	57.5	115		09/10/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	56.4	57.5	115		09/10/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	48.3	51.8	115		09/10/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	41.4	46.0	115		09/10/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	114	115	115		09/10/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	39.1	40.2	115		09/10/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	44.8	46.0	115		09/10/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	46.0	46.0	115		09/10/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	39.1	46.0	115		09/10/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	41.4	46.0	115		09/10/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	43.7	46.0	115		09/10/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	43.7	46.0	115		09/10/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	40.2	40.2	115		09/10/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	115	115	115		09/10/10	MPM
2-Chlorotoluene	ND	ug/kg dry	43.7	46.0	115		09/10/10	MPM
4-Chlorotoluene	ND	ug/kg dry	36.0	40.6	115		09/10/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	40.2	40.2	115		09/10/10	MPM
Benzene	ND	ug/kg dry	41.4	46.0	115		09/10/10	MPM
Bromobenzene	ND	ug/kg dry	40.2	40.2	115		09/10/10	MPM
Bromochloromethane	ND	ug/kg dry	42.6	48.0	115		09/10/10	MPM
Bromodichloromethane	ND	ug/kg dry	43.7	46.0	115		09/10/10	MPM
Bromoform	ND	ug/kg dry	55.2	57.5	115		09/10/10	MPM
Bromomethane	ND	ug/kg dry	115	115	115		09/10/10	MPM
Butylbenzene	ND	ug/kg dry	47.2	51.8	115		09/10/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	47.2	51.8	115		09/10/10	MPM
Chlorobenzene	ND	ug/kg dry	42.6	46.0	115		09/10/10	MPM
Chloroethane	ND	ug/kg dry	78.2	80.5	115		09/10/10	MPM
Chloroform	ND	ug/kg dry	40.2	46.0	115		09/10/10	MPM
Chloromethane	ND	ug/kg dry	40.2	40.2	115		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-3 8-12'

Matrix: Soil

Sample Date/Time: 09/07/10 12:55

Lab No. : 1009178-07

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis- t,2-Dichloroethylene	ND	ug/kg dry	47.2	51.8	t15		09/ t0/ t0	MPM
cis- t,3-Dichloropropylene	ND	ug/kg dry	38.0	40.2	t15		09/ t0/ t0	MPM
Dibromochloromethane	ND	ug/kg dry	38.0	40.2	t15		09/ t0/ t0	MPM
Dibromomethane	ND	ug/kg dry	44.8	46.0	t15		09/ t0/ t0	MPM
Dichlorodifluoromethane	ND	ug/kg dry	56.4	57.5	t15		09/ t0/ t0	MPM
Ethylbenzene	ND	ug/kg dry	42.8	46.0	t15		09/ t0/ t0	MPM
Hexachlorobutadiene	ND	ug/kg dry	57.5	57.5	t15		09/ t0/ t0	MPM
Isopropyl Ether	ND	ug/kg dry	82.8	86.2	t15		09/ t0/ t0	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	41.4	48.0	t15		09/ t0/ t0	MPM
m,p-Xylenes	ND	ug/kg dry	79.4	80.5	t15		09/ t0/ t0	MPM
Methylene Chloride	ND	ug/kg dry	35.6	40.2	t15		09/ t0/ t0	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	96.6	t04	t15		09/ t0/ t0	MPM
Naphthalene	ND	ug/kg dry	49.4	51.8	t15		09/ t0/ t0	MPM
o-Xylene	ND	ug/kg dry	57.5	57.5	t15		09/ t0/ t0	MPM
Propylbenzene	ND	ug/kg dry	41.4	48.0	t15		09/ t0/ t0	MPM
sec-Butylbenzene	ND	ug/kg dry	48.0	46.0	t15		09/ t0/ t0	MPM
Styrene	ND	ug/kg dry	40.2	48.0	t15		09/ t0/ t0	MPM
tert-Butylbenzene	ND	ug/kg dry	42.6	48.0	t15		09/ t0/ t0	MPM
Tetrachloroethene	ND	ug/kg dry	51.8	51.8	t15		09/ t0/ t0	MPM
Toluene	ND	ug/kg dry	47.2	51.8	t15		09/ t0/ t0	MPM
trans- t,2-Dichloroethylene	ND	ug/kg dry	51.8	51.8	t15		09/ t0/ t0	MPM
trans- t,3-Dichloropropylene	ND	ug/kg dry	39.1	40.2	t15		09/ t0/ t0	MPM
Trichloroethene	85.1	ug/kg dry	42.8	46.0	t15		09/ t0/ t0	MPM
Trichlorofluoromethane	ND	ug/kg dry	55.2	57.5	t15		09/ t0/ t0	MPM
Vinyl chloride	ND	ug/kg dry	52.9	57.5	t15		09/ t0/ t0	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-4 0-4'

Matrix: Soil

Sample Date/Time: 09/07/10 13:00

Lab No. : 1009178-08

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	38.2	42.4	106		09/10/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	41.3	42.4	106		09/10/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	38.2	42.4	106		09/10/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	43.5	47.7	106		09/10/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	39.2	42.4	106		09/10/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	60.4	63.8	106		09/10/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	94.3	95.4	106		09/10/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	49.8	53.0	106		09/10/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	51.9	53.0	106		09/10/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	44.5	47.7	106		09/10/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	38.2	42.4	106		09/10/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	105	106	106		09/10/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	36.0	37.1	106		09/10/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	41.3	42.4	106		09/10/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	42.4	42.4	106		09/10/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	36.0	42.4	106		09/10/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	38.2	42.4	106		09/10/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	40.3	42.4	106		09/10/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	40.3	42.4	106		09/10/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	37.1	37.1	106		09/10/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	106	106	106		09/10/10	MPM
2-Chlorotoluene	ND	ug/kg dry	40.3	42.4	106		09/10/10	MPM
4-Chlorotoluene	ND	ug/kg dry	35.0	37.4	106		09/10/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	37.1	37.1	106		09/10/10	MPM
Benzene	ND	ug/kg dry	38.2	42.4	106		09/10/10	MPM
Bromobenzene	ND	ug/kg dry	37.1	37.1	106		09/10/10	MPM
Bromochloromethane	ND	ug/kg dry	39.2	42.4	106		09/10/10	MPM
Bromodichloromethane	ND	ug/kg dry	40.3	42.4	106		09/10/10	MPM
Bromoform	ND	ug/kg dry	50.9	53.0	106		09/10/10	MPM
Bromomethane	ND	ug/kg dry	106	106	106		09/10/10	MPM
Butylbenzene	ND	ug/kg dry	43.5	47.7	106		09/10/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	43.5	47.7	106		09/10/10	MPM
Chlorobenzene	ND	ug/kg dry	39.2	42.4	106		09/10/10	MPM
Chloroethane	ND	ug/kg dry	72.1	74.2	106		09/10/10	MPM
Chloroform	ND	ug/kg dry	37.1	42.4	106		09/10/10	MPM
Chloromethane	ND	ug/kg dry	37.1	37.1	106		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-4 0-4'

Matrix: Soil

Sample Date/Time: 09/07/10 13:00

Lab No. : 1009178-08

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B Continued								
cis-1,2-Dichloroethylene	ND	ug/kg dry	43.5	47.7	106		09/10/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	35.0	37.1	106		09/10/10	MPM
Dibromochloromethane	ND	ug/kg dry	35.0	37.1	106		09/10/10	MPM
Dibromomethane	ND	ug/kg dry	41.3	42.4	106		09/10/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	51.9	53.0	106		09/10/10	MPM
Ethylbenzene	ND	ug/kg dry	39.2	42.4	106		09/10/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	53.0	53.0	106		09/10/10	MPM
Isopropyl Ether	ND	ug/kg dry	76.3	79.5	106		09/10/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	38.2	42.4	106		09/10/10	MPM
m,p-Xylenes	ND	ug/kg dry	73.1	74.2	106		09/10/10	MPM
Methylene Chloride	ND	ug/kg dry	32.9	37.1	106		09/10/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	89.0	95.4	106		09/10/10	MPM
Naphthalene	ND	ug/kg dry	45.6	47.7	106		09/10/10	MPM
o-Xylene	ND	ug/kg dry	53.0	53.0	106		09/10/10	MPM
Propylbenzene	ND	ug/kg dry	38.2	42.4	106		09/10/10	MPM
sec-Butylbenzene	ND	ug/kg dry	42.4	42.4	106		09/10/10	MPM
Styrene	ND	ug/kg dry	37.1	42.4	106		09/10/10	MPM
tert-Butylbenzene	ND	ug/kg dry	39.2	42.4	106		09/10/10	MPM
Tetrachloroethene	ND	ug/kg dry	47.7	47.7	106		09/10/10	MPM
Toluene	ND	ug/kg dry	43.5	47.7	106		09/10/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	47.7	47.7	106		09/10/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	36.0	37.1	106		09/10/10	MPM
Trichloroethene	6790	ug/kg dry	39.2	42.4	106		09/10/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	50.9	53.0	106		09/10/10	MPM
Vinyl chloride	ND	ug/kg dry	48.6	53.0	106		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-5 0-4'

Matrix: Soil

Sample Date/Time: 09/07/10 13:15

Lab No. : 1009178-09

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	36.0	40.0	100		09/10/10	MPM
1,1,1-Trichloroethane	284	ug/kg dry	39.0	40.0	100		09/10/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	36.0	40.0	100		09/10/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	41.0	45.0	100		09/10/10	MPM
1,1-Dichloroethane	275	ug/kg dry	37.0	40.0	100		09/10/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	57.0	60.0	100		09/10/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	89.0	90.0	100		09/10/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	47.0	50.0	100		09/10/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	49.0	50.0	100		09/10/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	42.0	45.0	100		09/10/10	MPM
1,2,4-Trimethylbenzene	688	ug/kg dry	36.0	40.0	100		09/10/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	99.0	100	100		09/10/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	34.0	35.0	100		09/10/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	39.0	40.0	100		09/10/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	40.0	40.0	100		09/10/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	34.0	40.0	100		09/10/10	MPM
1,3,5-Trimethylbenzene	220	ug/kg dry	36.0	40.0	100		09/10/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	38.0	40.0	100		09/10/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	38.0	40.0	100		09/10/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	35.0	35.0	100		09/10/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	100	100	100		09/10/10	MPM
2-Chlorotoluene	ND	ug/kg dry	38.0	40.0	100		09/10/10	MPM
4-Chlorotoluene	ND	ug/kg dry	33.0	35.3	100		09/10/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	35.0	35.0	100		09/10/10	MPM
Benzene	ND	ug/kg dry	36.0	40.0	100		09/10/10	MPM
Bromobenzene	ND	ug/kg dry	35.0	35.0	100		09/10/10	MPM
Bromochloromethane	ND	ug/kg dry	37.0	40.0	100		09/10/10	MPM
Bromodichloromethane	ND	ug/kg dry	38.0	40.0	100		09/10/10	MPM
Bromoform	ND	ug/kg dry	48.0	50.0	100		09/10/10	MPM
Bromomethane	ND	ug/kg dry	100	100	100		09/10/10	MPM
Butylbenzene	ND	ug/kg dry	41.0	45.0	100		09/10/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	41.0	45.0	100		09/10/10	MPM
Chlorobenzene	ND	ug/kg dry	37.0	40.0	100		09/10/10	MPM
Chloroethane	ND	ug/kg dry	68.0	70.0	100		09/10/10	MPM
Chloroform	ND	ug/kg dry	35.0	40.0	100		09/10/10	MPM
Chloromethane	ND	ug/kg dry	35.0	35.0	100		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-5 0-4'

Matrix: Soil

Sample Date/Time: 09/07/10 13:15

Lab No. : 1009178-09

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	82.9	ug/kg dry	41.0	45.0	100		09/10/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	33.0	35.0	100		09/10/10	MPM
Dibromochloromethane	ND	ug/kg dry	33.0	35.0	100		09/10/10	MPM
Dibromomethane	ND	ug/kg dry	39.0	40.0	100		09/10/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	49.0	50.0	100		09/10/10	MPM
Ethylbenzene	109	ug/kg dry	37.0	40.0	100		09/10/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	50.0	50.0	100		09/10/10	MPM
Isopropyl Ether	ND	ug/kg dry	72.0	75.0	100		09/10/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	36.0	40.0	100		09/10/10	MPM
m,p-Xylenes	408	ug/kg dry	69.0	70.0	100		09/10/10	MPM
Methylene Chloride	ND	ug/kg dry	31.0	35.0	100		09/10/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	84.0	90.0	100		09/10/10	MPM
Naphthalene	816	ug/kg dry	43.0	45.0	100		09/10/10	MPM
o-Xylene	166	ug/kg dry	50.0	50.0	100		09/10/10	MPM
Propylbenzene	ND	ug/kg dry	36.0	40.0	100		09/10/10	MPM
sec-Butylbenzene	ND	ug/kg dry	40.0	40.0	100		09/10/10	MPM
Styrene	ND	ug/kg dry	35.0	40.0	100		09/10/10	MPM
tert-Butylbenzene	ND	ug/kg dry	37.0	40.0	100		09/10/10	MPM
Tetrachloroethene	99.6	ug/kg dry	45.0	45.0	100		09/10/10	MPM
Toluene	300	ug/kg dry	41.0	45.0	100		09/10/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	45.0	45.0	100		09/10/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	34.0	35.0	100		09/10/10	MPM
Trichloroethene	153	ug/kg dry	37.0	40.0	100		09/10/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	48.0	50.0	100		09/10/10	MPM
Vinyl chloride	ND	ug/kg dry	46.0	50.0	100		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-5 4-8'

Matrix: Soil

Sample Date/Time: 09/07/10 13:20

Lab No. : 1009178-10

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	38.2	42.4	106		09/10/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	41.3	42.4	106		09/10/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	38.2	42.4	106		09/10/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	43.5	47.7	106		09/10/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	39.2	42.4	106		09/10/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	60.4	63.6	106		09/10/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	94.3	95.4	106		09/10/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	49.8	53.0	106		09/10/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	51.9	53.0	106		09/10/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	44.5	47.7	106		09/10/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	38.2	42.4	106		09/10/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	105	106	106		09/10/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	36.0	37.1	106		09/10/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	41.3	42.4	106		09/10/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	42.4	42.4	106		09/10/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	38.0	42.4	106		09/10/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	38.2	42.4	106		09/10/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	40.3	42.4	106		09/10/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	40.3	42.4	106		09/10/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	37.1	37.1	106		09/10/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	106	106	106		09/10/10	MPM
2-Chlorotoluene	ND	ug/kg dry	40.3	42.4	106		09/10/10	MPM
4-Chlorotoluene	ND	ug/kg dry	35.0	37.4	106		09/10/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	37.1	37.1	106		09/10/10	MPM
Benzene	ND	ug/kg dry	38.2	42.4	106		09/10/10	MPM
Bromobenzene	ND	ug/kg dry	37.1	37.1	106		09/10/10	MPM
Bromochloromethane	ND	ug/kg dry	39.2	42.4	106		09/10/10	MPM
Bromodichloromethane	ND	ug/kg dry	40.3	42.4	106		09/10/10	MPM
Bromoform	ND	ug/kg dry	50.9	53.0	106		09/10/10	MPM
Bromomethane	ND	ug/kg dry	106	106	106		09/10/10	MPM
Butylbenzene	ND	ug/kg dry	43.5	47.7	106		09/10/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	43.5	47.7	106		09/10/10	MPM
Chlorobenzene	ND	ug/kg dry	39.2	42.4	106		09/10/10	MPM
Chloroethane	ND	ug/kg dry	72.1	74.2	106		09/10/10	MPM
Chloroform	ND	ug/kg dry	37.1	42.4	106		09/10/10	MPM
Chloromethane	ND	ug/kg dry	37.1	37.1	106		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-5 4-8'

Matrix: Soil

Sample Date/Time: 09/07/10 13:20

Lab No. : 1009178-10

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	43.5	47.7	106		09/10/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	35.0	37.1	106		09/10/10	MPM
Dibromochloromethane	ND	ug/kg dry	35.0	37.1	106		09/10/10	MPM
Dibromomethane	ND	ug/kg dry	41.3	42.4	106		09/10/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	51.9	53.0	106		09/10/10	MPM
Ethylbenzene	ND	ug/kg dry	39.2	42.4	106		09/10/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	53.0	53.0	106		09/10/10	MPM
Isopropyl Ether	ND	ug/kg dry	78.3	79.5	106		09/10/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	38.2	42.4	106		09/10/10	MPM
m,p-Xylenes	ND	ug/kg dry	73.1	74.2	106		09/10/10	MPM
Methylene Chloride	ND	ug/kg dry	32.9	37.1	106		09/10/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	89.0	95.4	106		09/10/10	MPM
Naphthalene	198	ug/kg dry	45.6	47.7	106		09/10/10	MPM
o-Xylene	ND	ug/kg dry	53.0	53.0	106		09/10/10	MPM
Propylbenzene	ND	ug/kg dry	38.2	42.4	106		09/10/10	MPM
sec-Butylbenzene	ND	ug/kg dry	42.4	42.4	106		09/10/10	MPM
Styrene	ND	ug/kg dry	37.1	42.4	106		09/10/10	MPM
tert-Butylbenzene	ND	ug/kg dry	39.2	42.4	106		09/10/10	MPM
Tetrachloroethene	ND	ug/kg dry	47.7	47.7	106		09/10/10	MPM
Toluene	ND	ug/kg dry	43.5	47.7	106		09/10/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	47.7	47.7	106		09/10/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	36.0	37.1	106		09/10/10	MPM
Trichloroethene	ND	ug/kg dry	39.2	42.4	106		09/10/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	50.9	53.0	106		09/10/10	MPM
Vinyl chloride	ND	ug/kg dry	48.8	53.0	106		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-5 8-12'

Matrix: Soil

Sample Date/Time: 09/07/10 13:25

Lab No. : 1009178-11

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	36.7	40.8	102		09/10/10	MRD
1,1,1-Trichloroethane	ND	ug/kg dry	39.8	40.8	102		09/10/10	MRD
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	36.7	40.8	102		09/10/10	MRD
1,1,2-Trichloroethane	ND	ug/kg dry	41.8	45.9	102		09/10/10	MRD
1,1-Dichloroethane	ND	ug/kg dry	37.7	40.8	102		09/10/10	MRD
1,1-Dichloroethylene	ND	ug/kg dry	58.1	61.2	102		09/10/10	MRD
1,1-Dichloropropylene	ND	ug/kg dry	90.8	91.8	102		09/10/10	MRD
1,2,3-Trichlorobenzene	ND	ug/kg dry	47.9	51.0	102		09/10/10	MRD
1,2,3-Trichloropropane	ND	ug/kg dry	50.0	51.0	102		09/10/10	MRD
1,2,4-Trichlorobenzene	ND	ug/kg dry	42.8	45.9	102		09/10/10	MRD
1,2,4-Trimethylbenzene	ND	ug/kg dry	36.7	40.8	102		09/10/10	MRD
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	101	102	102		09/10/10	MRD
1,2-Dibromoethane	ND	ug/kg dry	34.7	35.7	102		09/10/10	MRD
1,2-Dichlorobenzene	ND	ug/kg dry	39.8	40.8	102		09/10/10	MRD
1,2-Dichloroethane	ND	ug/kg dry	40.8	40.8	102		09/10/10	MRD
1,2-Dichloropropane	ND	ug/kg dry	34.7	40.8	102		09/10/10	MRD
1,3,5-Trimethylbenzene	ND	ug/kg dry	36.7	40.8	102		09/10/10	MRD
1,3-Dichlorobenzene	ND	ug/kg dry	36.8	40.8	102		09/10/10	MRD
1,3-Dichloropropane	ND	ug/kg dry	36.8	40.8	102		09/10/10	MRD
1,4-Dichlorobenzene	ND	ug/kg dry	35.7	35.7	102		09/10/10	MRD
2,2-Dichloropropane	ND	ug/kg dry	102	102	102		09/10/10	MRD
2-Chlorotoluene	ND	ug/kg dry	36.8	40.8	102		09/10/10	MRD
4-Chlorotoluene	ND	ug/kg dry	33.7	38.0	102		09/10/10	MRD
4-Isopropyltoluene	ND	ug/kg dry	35.7	35.7	102		09/10/10	MRD
Benzene	ND	ug/kg dry	36.7	40.8	102		09/10/10	MRD
Bromobenzene	ND	ug/kg dry	35.7	35.7	102		09/10/10	MRD
Bromochloromethane	ND	ug/kg dry	37.7	40.8	102		09/10/10	MRD
Bromodichloromethane	ND	ug/kg dry	36.8	40.8	102		09/10/10	MRD
Bromoform	ND	ug/kg dry	49.0	51.0	102		09/10/10	MRD
Bromomethane	ND	ug/kg dry	102	102	102		09/10/10	MRD
Butylbenzene	ND	ug/kg dry	41.8	45.9	102		09/10/10	MRD
Carbon Tetrachloride	ND	ug/kg dry	41.8	45.9	102		09/10/10	MRD
Chlorobenzene	ND	ug/kg dry	37.7	40.8	102		09/10/10	MRD
Chloroethane	ND	ug/kg dry	69.4	71.4	102		09/10/10	MRD
Chloroform	ND	ug/kg dry	35.7	40.8	102		09/10/10	MRD
Chloromethane	ND	ug/kg dry	35.7	35.7	102		09/10/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-5 8-12'

Matrix: Soil

Sample Date/Time: 09/07/10 13:25

Lab No. : 1009178-11

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOG</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	41.8	45.9	102		09/10/10	MRD
cis-1,3-Dichloropropylene	ND	ug/kg dry	33.7	35.7	102		09/10/10	MRD
Dibromochloromethane	ND	ug/kg dry	33.7	35.7	102		09/10/10	MRD
Dibromomethane	ND	ug/kg dry	39.8	40.8	102		09/10/10	MRD
Dichlorodifluoromethane	ND	ug/kg dry	50.0	51.0	102		09/10/10	MRD
Ethylbenzene	ND	ug/kg dry	37.7	40.8	102		09/10/10	MRD
Hexachlorobutadiene	ND	ug/kg dry	51.0	51.0	102		09/10/10	MRD
Isopropyl Ether	ND	ug/kg dry	73.4	76.5	102		09/10/10	MRD
Isopropylbenzene (Cumene)	ND	ug/kg dry	38.7	40.8	102		09/10/10	MRD
m,p-Xylenes	ND	ug/kg dry	70.4	71.4	102		09/10/10	MRD
Methylene Chloride	ND	ug/kg dry	31.6	35.7	102		09/10/10	MRD
Methyl-tert-Butyl Ether	ND	ug/kg dry	85.7	91.8	102		09/10/10	MRD
Naphthalene	ND	ug/kg dry	43.9	45.9	102		09/10/10	MRD
o-Xylene	ND	ug/kg dry	51.0	51.0	102		09/10/10	MRD
Propylbenzene	ND	ug/kg dry	38.7	40.8	102		09/10/10	MRD
sec-Butylbenzene	ND	ug/kg dry	40.8	40.8	102		09/10/10	MRD
Styrene	ND	ug/kg dry	35.7	40.8	102		09/10/10	MRD
tert-Butylbenzene	ND	ug/kg dry	37.7	40.8	102		09/10/10	MRD
Tetrachloroethene	ND	ug/kg dry	45.9	45.9	102		09/10/10	MRD
Toluene	ND	ug/kg dry	41.8	45.9	102		09/10/10	MRD
trans-1,2-Dichloroethylene	ND	ug/kg dry	45.9	45.9	102		09/10/10	MRD
trans-1,3-Dichloropropylene	ND	ug/kg dry	34.7	35.7	102		09/10/10	MRD
Trichloroethene	ND	ug/kg dry	37.7	40.8	102		09/10/10	MRD
Trichlorofluoromethane	ND	ug/kg dry	49.0	51.0	102		09/10/10	MRD
Vinyl chloride	ND	ug/kg dry	46.9	51.0	102		09/10/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-6 0-4'

Matrix: Soil

Sample Date/Time: 09/07/10 13:50

Lab No. : 1009178-12

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	36.7	40.8	102		09/10/10	MRD
1,1,1-Trichloroethane	ND	ug/kg dry	39.8	40.8	102		09/10/10	MRD
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	36.7	40.8	102		09/10/10	MRD
1,1,2-Trichloroethane	ND	ug/kg dry	41.8	45.9	102		09/10/10	MRD
1,1-Dichloroethane	ND	ug/kg dry	37.7	40.8	102		09/10/10	MRD
1,1-Dichloroethylene	ND	ug/kg dry	58.1	61.2	102		09/10/10	MRD
1,1-Dichloropropylene	ND	ug/kg dry	90.8	91.8	102		09/10/10	MRD
1,2,3-Trichlorobenzene	ND	ug/kg dry	47.9	51.0	102		09/10/10	MRD
1,2,3-Trichloropropane	ND	ug/kg dry	50.0	51.0	102		09/10/10	MRD
1,2,4-Trichlorobenzene	ND	ug/kg dry	42.8	45.9	102		09/10/10	MRD
1,2,4-Trimethylbenzene	ND	ug/kg dry	36.7	40.8	102		09/10/10	MRD
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	101	102	102		09/10/10	MRD
1,2-Dibromoethane	ND	ug/kg dry	34.7	35.7	102		09/10/10	MRD
1,2-Dichlorobenzene	ND	ug/kg dry	39.8	40.8	102		09/10/10	MRD
1,2-Dichloroethane	ND	ug/kg dry	40.8	40.8	102		09/10/10	MRD
1,2-Dichloropropane	ND	ug/kg dry	34.7	40.8	102		09/10/10	MRD
1,3,5-Trimethylbenzene	ND	ug/kg dry	36.7	40.8	102		09/10/10	MRD
1,3-Dichlorobenzene	ND	ug/kg dry	38.8	40.8	102		09/10/10	MRD
1,3-Dichloropropane	ND	ug/kg dry	38.8	40.8	102		09/10/10	MRD
1,4-Dichlorobenzene	ND	ug/kg dry	35.7	35.7	102		09/10/10	MRD
2,2-Dichloropropane	ND	ug/kg dry	102	102	102		09/10/10	MRD
2-Chlorotoluene	ND	ug/kg dry	38.8	40.8	102		09/10/10	MRD
4-Chlorotoluene	ND	ug/kg dry	33.7	36.0	102		09/10/10	MRD
4-Isopropyltoluene	ND	ug/kg dry	35.7	35.7	102		09/10/10	MRD
Benzene	ND	ug/kg dry	36.7	40.8	102		09/10/10	MRD
Bromobenzene	ND	ug/kg dry	35.7	35.7	102		09/10/10	MRD
Bromochloromethane	ND	ug/kg dry	37.7	40.8	102		09/10/10	MRD
Bromodichloromethane	ND	ug/kg dry	38.8	40.8	102		09/10/10	MRD
Bromoform	ND	ug/kg dry	49.0	51.0	102		09/10/10	MRD
Bromomethane	ND	ug/kg dry	102	102	102		09/10/10	MRD
Butylbenzene	ND	ug/kg dry	41.8	45.9	102		09/10/10	MRD
Carbon Tetrachloride	ND	ug/kg dry	41.8	45.9	102		09/10/10	MRD
Chlorobenzene	ND	ug/kg dry	37.7	40.8	102		09/10/10	MRD
Chloroethane	ND	ug/kg dry	69.4	71.4	102		09/10/10	MRD
Chloroform	ND	ug/kg dry	35.7	40.8	102		09/10/10	MRD
Chloromethane	ND	ug/kg dry	35.7	35.7	102		09/10/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-6 0-4'

Matrix: Soil

Sample Date/Time: 09/07/10 13:50

Lab No. : 1009178-12

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	41.8	45.9	102		09/10/10	MRD
cis-1,3-Dichloropropylene	ND	ug/kg dry	33.7	35.7	102		09/10/10	MRD
Dibromochloromethane	ND	ug/kg dry	33.7	35.7	102		09/10/10	MRD
Dibromomethane	ND	ug/kg dry	39.8	40.8	102		09/10/10	MRD
Dichlorodifluoromethane	ND	ug/kg dry	50.0	51.0	102		09/10/10	MRD
Ethylbenzene	ND	ug/kg dry	37.7	40.8	102		09/10/10	MRD
Hexachlorobutadiene	ND	ug/kg dry	51.0	51.0	102		09/10/10	MRD
Isopropyl Ether	ND	ug/kg dry	73.4	76.5	102		09/10/10	MRD
Isopropylbenzene (Cumene)	ND	ug/kg dry	38.7	40.8	102		09/10/10	MRD
m,p-Xylenes	ND	ug/kg dry	70.4	71.4	102		09/10/10	MRD
Methylene Chloride	ND	ug/kg dry	31.6	35.7	102		09/10/10	MRD
Methyl-tert-Butyl Ether	ND	ug/kg dry	85.7	91.8	102		09/10/10	MRD
Naphthalene	ND	ug/kg dry	43.9	45.9	102		09/10/10	MRD
o-Xylene	ND	ug/kg dry	51.0	51.0	102		09/10/10	MRD
Propylbenzene	ND	ug/kg dry	36.7	40.8	102		09/10/10	MRD
sec-Butylbenzene	ND	ug/kg dry	40.8	40.8	102		09/10/10	MRD
Styrene	ND	ug/kg dry	35.7	40.8	102		09/10/10	MRD
tert-Butylbenzene	ND	ug/kg dry	37.7	40.8	102		09/10/10	MRD
Tetrachloroethene	ND	ug/kg dry	45.9	45.9	102		09/10/10	MRD
Toluene	ND	ug/kg dry	41.8	45.9	102		09/10/10	MRD
trans-1,2-Dichloroethylene	ND	ug/kg dry	45.9	45.9	102		09/10/10	MRD
trans-1,3-Dichloropropylene	ND	ug/kg dry	34.7	35.7	102		09/10/10	MRD
Trichloroethene	ND	ug/kg dry	37.7	40.8	102		09/10/10	MRD
Trichlorofluoromethane	ND	ug/kg dry	49.0	51.0	102		09/10/10	MRD
Vinyl chloride	ND	ug/kg dry	46.9	51.0	102		09/10/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-6 4-8'

Matrix: Soil

Sample Date/Time: 09/07/10 13:55

Lab No. : 1009178-13

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	36.7	40.8	102		09/10/10	MRD
1,1,1-Trichloroethane	ND	ug/kg dry	39.8	40.8	102		09/10/10	MRD
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	36.7	40.8	102		09/10/10	MRD
1,1,2-Trichloroethane	ND	ug/kg dry	41.8	45.9	102		09/10/10	MRD
1,1-Dichloroethane	ND	ug/kg dry	37.7	40.8	102		09/10/10	MRD
1,1-Dichloroethylene	ND	ug/kg dry	58.1	61.2	102		09/10/10	MRD
1,1-Dichloropropylene	ND	ug/kg dry	90.8	91.8	102		09/10/10	MRD
1,2,3-Trichlorobenzene	ND	ug/kg dry	47.9	51.0	102		09/10/10	MRD
1,2,3-Trichloropropane	ND	ug/kg dry	50.0	51.0	102		09/10/10	MRD
1,2,4-Trichlorobenzene	ND	ug/kg dry	42.8	45.9	102		09/10/10	MRD
1,2,4-Trimethylbenzene	ND	ug/kg dry	36.7	40.8	102		09/10/10	MRD
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	101	102	102		09/10/10	MRD
1,2-Dibromoethane	ND	ug/kg dry	34.7	35.7	102		09/10/10	MRD
1,2-Dichlorobenzene	ND	ug/kg dry	39.8	40.8	102		09/10/10	MRD
1,2-Dichloroethane	ND	ug/kg dry	40.8	40.8	102		09/10/10	MRD
1,2-Dichloropropane	ND	ug/kg dry	34.7	40.8	102		09/10/10	MRD
1,3,5-Trimethylbenzene	ND	ug/kg dry	36.7	40.8	102		09/10/10	MRD
1,3-Dichlorobenzene	ND	ug/kg dry	38.8	40.8	102		09/10/10	MRD
1,3-Dichloropropane	ND	ug/kg dry	38.8	40.8	102		09/10/10	MRD
1,4-Dichlorobenzene	ND	ug/kg dry	35.7	35.7	102		09/10/10	MRD
2,2-Dichloropropane	ND	ug/kg dry	102	102	102		09/10/10	MRD
2-Chlorotoluene	ND	ug/kg dry	38.8	40.8	102		09/10/10	MRD
4-Chlorotoluene	ND	ug/kg dry	33.7	36.0	102		09/10/10	MRD
4-Isopropyltoluene	ND	ug/kg dry	35.7	35.7	102		09/10/10	MRD
Benzene	ND	ug/kg dry	38.7	40.8	102		09/10/10	MRD
Bromobenzene	ND	ug/kg dry	35.7	35.7	102		09/10/10	MRD
Bromochloromethane	ND	ug/kg dry	37.7	40.8	102		09/10/10	MRD
Bromodichloromethane	ND	ug/kg dry	38.8	40.8	102		09/10/10	MRD
Bromoform	ND	ug/kg dry	49.0	51.0	102		09/10/10	MRD
Bromomethane	ND	ug/kg dry	102	102	102		09/10/10	MRD
Butylbenzene	ND	ug/kg dry	41.8	45.9	102		09/10/10	MRD
Carbon Tetrachloride	ND	ug/kg dry	41.8	45.9	102		09/10/10	MRD
Chlorobenzene	ND	ug/kg dry	37.7	40.8	102		09/10/10	MRD
Chloroethane	ND	ug/kg dry	69.4	71.4	102		09/10/10	MRD
Chloroform	ND	ug/kg dry	35.7	40.8	102		09/10/10	MRD
Chloromethane	ND	ug/kg dry	35.7	35.7	102		09/10/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-6 4-8'

Matrix: Soil

Sample Date/Time: 09/07/10 13:55

Lab No. : 1009178-13

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	41.8	45.9	102		09/10/10	MRD
cis-1,3-Dichloropropylene	ND	ug/kg dry	33.7	35.7	102		09/10/10	MRD
Dibromochloromethane	ND	ug/kg dry	33.7	35.7	102		09/10/10	MRD
Dibromomethane	ND	ug/kg dry	39.8	40.8	102		09/10/10	MRD
Dichlorodifluoromethane	ND	ug/kg dry	50.0	51.0	102		09/10/10	MRD
Ethylbenzene	ND	ug/kg dry	37.7	40.8	102		09/10/10	MRD
Hexachlorobutadiene	ND	ug/kg dry	51.0	51.0	102		09/10/10	MRD
Isopropyl Ether	ND	ug/kg dry	73.4	76.5	102		09/10/10	MRD
Isopropylbenzene (Cumene)	ND	ug/kg dry	36.7	40.8	102		09/10/10	MRD
m,p-Xylenes	ND	ug/kg dry	70.4	71.4	102		09/10/10	MRD
Methylene Chloride	ND	ug/kg dry	31.6	35.7	102		09/10/10	MRD
Methyl-tert-Butyl Ether	ND	ug/kg dry	85.7	91.8	102		09/10/10	MRD
Naphthalene	ND	ug/kg dry	43.9	45.9	102		09/10/10	MRD
o-Xylene	ND	ug/kg dry	51.0	51.0	102		09/10/10	MRD
Propylbenzene	ND	ug/kg dry	36.7	40.8	102		09/10/10	MRD
sec-Butylbenzene	ND	ug/kg dry	40.8	40.8	102		09/10/10	MRD
Styrene	ND	ug/kg dry	35.7	40.8	102		09/10/10	MRD
tert-Butylbenzene	ND	ug/kg dry	37.7	40.8	102		09/10/10	MRD
Tetrachloroethene	ND	ug/kg dry	45.9	45.9	102		09/10/10	MRD
Toluene	ND	ug/kg dry	41.8	45.9	102		09/10/10	MRD
trans-1,2-Dichloroethylene	ND	ug/kg dry	45.9	45.9	102		09/10/10	MRD
trans-1,3-Dichloropropylene	ND	ug/kg dry	34.7	35.7	102		09/10/10	MRD
Trichloroethene	ND	ug/kg dry	37.7	40.8	102		09/10/10	MRD
Trichlorofluoromethane	ND	ug/kg dry	49.0	51.0	102		09/10/10	MRD
Vinyl chloride	ND	ug/kg dry	46.9	51.0	102		09/10/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-6 8-12'

Matrix: Soil

Sample Date/Time: 09/07/10 14:00

Lab No. : 1009178-14

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	36.7	40.8	102		09/10/10	MRD
1,1,1-Trichloroethane	ND	ug/kg dry	39.8	40.8	102		09/10/10	MRD
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	38.7	40.8	102		09/10/10	MRD
1,1,2-Trichloroethane	ND	ug/kg dry	41.8	45.9	102		09/10/10	MRD
1,1-Dichloroethane	ND	ug/kg dry	37.7	40.8	102		09/10/10	MRD
1,1-Dichloroethylene	ND	ug/kg dry	58.1	61.2	102		09/10/10	MRD
1,1-Dichloropropylene	ND	ug/kg dry	90.8	91.8	102		09/10/10	MRD
1,2,3-Trichlorobenzene	ND	ug/kg dry	47.9	51.0	102		09/10/10	MRD
1,2,3-Trichloropropane	ND	ug/kg dry	50.0	51.0	102		09/10/10	MRD
1,2,4-Trichlorobenzene	ND	ug/kg dry	42.8	45.9	102		09/10/10	MRD
1,2,4-Trimethylbenzene	ND	ug/kg dry	36.7	40.8	102		09/10/10	MRD
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	101	102	102		09/10/10	MRD
1,2-Dibromoethane	ND	ug/kg dry	34.7	35.7	102		09/10/10	MRD
1,2-Dichlorobenzene	ND	ug/kg dry	39.8	40.8	102		09/10/10	MRD
1,2-Dichloroethane	ND	ug/kg dry	40.8	40.8	102		09/10/10	MRD
1,2-Dichloropropane	ND	ug/kg dry	34.7	40.8	102		09/10/10	MRD
1,3,5-Trimethylbenzene	ND	ug/kg dry	36.7	40.8	102		09/10/10	MRD
1,3-Dichlorobenzene	ND	ug/kg dry	38.8	40.8	102		09/10/10	MRD
1,3-Dichloropropane	ND	ug/kg dry	38.8	40.8	102		09/10/10	MRD
1,4-Dichlorobenzene	ND	ug/kg dry	35.7	35.7	102		09/10/10	MRD
2,2-Dichloropropane	ND	ug/kg dry	102	102	102		09/10/10	MRD
2-Chlorotoluene	ND	ug/kg dry	38.8	40.8	102		09/10/10	MRD
4-Chlorotoluene	ND	ug/kg dry	33.7	36.0	102		09/10/10	MRD
4-Isopropyltoluene	ND	ug/kg dry	35.7	35.7	102		09/10/10	MRD
Benzene	ND	ug/kg dry	38.7	40.8	102		09/10/10	MRD
Bromobenzene	ND	ug/kg dry	35.7	35.7	102		09/10/10	MRD
Bromochloromethane	ND	ug/kg dry	37.7	40.8	102		09/10/10	MRD
Bromodichloromethane	ND	ug/kg dry	38.8	40.8	102		09/10/10	MRD
Bromoform	ND	ug/kg dry	49.0	51.0	102		09/10/10	MRD
Bromomethane	ND	ug/kg dry	102	102	102		09/10/10	MRD
Butylbenzene	ND	ug/kg dry	41.8	45.9	102		09/10/10	MRD
Carbon Tetrachloride	ND	ug/kg dry	41.8	45.9	102		09/10/10	MRD
Chlorobenzene	ND	ug/kg dry	37.7	40.8	102		09/10/10	MRD
Chloroethane	ND	ug/kg dry	69.4	71.4	102		09/10/10	MRD
Chloroform	ND	ug/kg dry	35.7	40.8	102		09/10/10	MRD
Chloromethane	ND	ug/kg dry	35.7	35.7	102		09/10/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-6 8-12'

Matrix: Soil

Sample Date/Time: 09/07/10 14:00

Lab No. : 1009178-14

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	41.8	45.9	102		09/10/10	MRD
cis-1,3-Dichloropropylene	ND	ug/kg dry	33.7	35.7	102		09/10/10	MRD
Dibromochloromethane	ND	ug/kg dry	33.7	35.7	102		09/10/10	MRD
Dibromomethane	ND	ug/kg dry	39.8	40.8	102		09/10/10	MRD
Dichlorodifluoromethane	ND	ug/kg dry	50.0	51.0	102		09/10/10	MRD
Ethylbenzene	ND	ug/kg dry	37.7	40.8	102		09/10/10	MRD
Hexachlorobutadiene	ND	ug/kg dry	51.0	51.0	102		09/10/10	MRD
Isopropyl Ether	ND	ug/kg dry	73.4	78.5	102		09/10/10	MRD
Isopropylbenzene (Cumene)	ND	ug/kg dry	36.7	40.8	102		09/10/10	MRD
m,p-Xylenes	ND	ug/kg dry	70.4	71.4	102		09/10/10	MRD
Methylene Chloride	ND	ug/kg dry	31.6	35.7	102		09/10/10	MRD
Methyl-tert-Butyl Ether	ND	ug/kg dry	85.7	91.8	102		09/10/10	MRD
Naphthalene	ND	ug/kg dry	43.9	45.9	102		09/10/10	MRD
o-Xylene	ND	ug/kg dry	51.0	51.0	102		09/10/10	MRD
Propylbenzene	ND	ug/kg dry	36.7	40.8	102		09/10/10	MRD
sec-Butylbenzene	ND	ug/kg dry	40.8	40.8	102		09/10/10	MRD
Styrene	ND	ug/kg dry	35.7	40.8	102		09/10/10	MRD
tert-Butylbenzene	ND	ug/kg dry	37.7	40.8	102		09/10/10	MRD
Tetrachloroethene	ND	ug/kg dry	45.9	45.9	102		09/10/10	MRD
Toluene	ND	ug/kg dry	41.8	45.9	102		09/10/10	MRD
trans-1,2-Dichloroethylene	ND	ug/kg dry	45.9	45.9	102		09/10/10	MRD
trans-1,3-Dichloropropylene	ND	ug/kg dry	34.7	35.7	102		09/10/10	MRD
Trichloroethene	ND	ug/kg dry	37.7	40.8	102		09/10/10	MRD
Trichlorofluoromethane	ND	ug/kg dry	49.0	51.0	102		09/10/10	MRD
Vinyl chloride	ND	ug/kg dry	46.9	51.0	102		09/10/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-7 0-4'

Matrix: Soil

Sample Date/Time: 09/07/10 14:10

Lab No. : 1009178-15

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	37.1	41.2	103		09/10/10	MRD
1,1,1-Trichloroethane	ND	ug/kg dry	40.2	41.2	103		09/10/10	MRD
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	37.1	41.2	103		09/10/10	MRD
1,1,2-Trichloroethane	ND	ug/kg dry	42.2	46.4	103		09/10/10	MRD
1,1-Dichloroethane	ND	ug/kg dry	38.1	41.2	103		09/10/10	MRD
1,1-Dichloroethylene	ND	ug/kg dry	58.7	61.8	103		09/10/10	MRD
1,1-Dichloropropylene	ND	ug/kg dry	91.7	92.7	103		09/10/10	MRD
1,2,3-Trichlorobenzene	ND	ug/kg dry	48.4	51.5	103		09/10/10	MRD
1,2,3-Trichloropropane	ND	ug/kg dry	50.5	51.5	103		09/10/10	MRD
1,2,4-Trichlorobenzene	ND	ug/kg dry	43.3	46.4	103		09/10/10	MRD
1,2,4-Trimethylbenzene	ND	ug/kg dry	37.1	41.2	103		09/10/10	MRD
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	102	103	103		09/10/10	MRD
1,2-Dibromoethane	ND	ug/kg dry	35.0	36.0	103		09/10/10	MRD
1,2-Dichlorobenzene	ND	ug/kg dry	40.2	41.2	103		09/10/10	MRD
1,2-Dichloroethane	ND	ug/kg dry	41.2	41.2	103		09/10/10	MRD
1,2-Dichloropropane	ND	ug/kg dry	35.0	41.2	103		09/10/10	MRD
1,3,5-Trimethylbenzene	ND	ug/kg dry	37.1	41.2	103		09/10/10	MRD
1,3-Dichlorobenzene	ND	ug/kg dry	39.1	41.2	103		09/10/10	MRD
1,3-Dichloropropane	ND	ug/kg dry	39.1	41.2	103		09/10/10	MRD
1,4-Dichlorobenzene	ND	ug/kg dry	36.0	36.0	103		09/10/10	MRD
2,2-Dichloropropane	ND	ug/kg dry	103	103	103		09/10/10	MRD
2-Chlorotoluene	ND	ug/kg dry	39.1	41.2	103		09/10/10	MRD
4-Chlorotoluene	ND	ug/kg dry	34.0	36.4	103		09/10/10	MRD
4-Isopropyltoluene	ND	ug/kg dry	36.0	36.0	103		09/10/10	MRD
Benzene	ND	ug/kg dry	37.1	41.2	103		09/10/10	MRD
Bromobenzene	ND	ug/kg dry	36.0	36.0	103		09/10/10	MRD
Bromochloromethane	ND	ug/kg dry	36.1	41.2	103		09/10/10	MRD
Bromodichloromethane	ND	ug/kg dry	39.1	41.2	103		09/10/10	MRD
Bromoform	ND	ug/kg dry	49.4	51.5	103		09/10/10	MRD
Bromomethane	ND	ug/kg dry	103	103	103		09/10/10	MRD
Butylbenzene	ND	ug/kg dry	42.2	46.4	103		09/10/10	MRD
Carbon Tetrachloride	ND	ug/kg dry	42.2	46.4	103		09/10/10	MRD
Chlorobenzene	ND	ug/kg dry	38.1	41.2	103		09/10/10	MRD
Chloroethane	ND	ug/kg dry	70.0	72.1	103		09/10/10	MRD
Chloroform	ND	ug/kg dry	36.0	41.2	103		09/10/10	MRD
Chloromethane	ND	ug/kg dry	36.0	36.0	103		09/10/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-7 0-4'

Matrix: Soil

Sample Date/Time: 09/07/10 14:10

Lab No. : 1009178-15

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	42.2	46.4	103		09/10/10	MRD
cis-1,3-Dichloropropylene	ND	ug/kg dry	34.0	36.0	103		09/10/10	MRD
Dibromochloromethane	ND	ug/kg dry	34.0	36.0	103		09/10/10	MRD
Dibromomethane	ND	ug/kg dry	40.2	41.2	103		09/10/10	MRD
Dichlorodifluoromethane	ND	ug/kg dry	50.5	51.5	103		09/10/10	MRD
Ethylbenzene	ND	ug/kg dry	38.1	41.2	103		09/10/10	MRD
Hexachlorobutadiene	ND	ug/kg dry	51.5	51.5	103		09/10/10	MRD
Isopropyl Ether	ND	ug/kg dry	74.2	77.2	103		09/10/10	MRD
Isopropylbenzene (Cumene)	ND	ug/kg dry	37.1	41.2	103		09/10/10	MRD
m,p-Xylenes	ND	ug/kg dry	71.1	72.1	103		09/10/10	MRD
Methylene Chloride	ND	ug/kg dry	31.9	36.0	103		09/10/10	MRD
Methyl-tert-Butyl Ether	ND	ug/kg dry	86.5	92.7	103		09/10/10	MRD
Naphthalene	ND	ug/kg dry	44.3	46.4	103		09/10/10	MRD
o-Xylene	ND	ug/kg dry	51.5	51.5	103		09/10/10	MRD
Propylbenzene	ND	ug/kg dry	37.1	41.2	103		09/10/10	MRD
sec-Butylbenzene	ND	ug/kg dry	41.2	41.2	103		09/10/10	MRD
Styrene	ND	ug/kg dry	36.0	41.2	103		09/10/10	MRD
tert-Butylbenzene	ND	ug/kg dry	38.1	41.2	103		09/10/10	MRD
Tetrachloroethene	ND	ug/kg dry	46.4	46.4	103		09/10/10	MRD
Toluene	ND	ug/kg dry	42.2	46.4	103		09/10/10	MRD
trans-1,2-Dichloroethylene	ND	ug/kg dry	46.4	46.4	103		09/10/10	MRD
trans-1,3-Dichloropropylene	ND	ug/kg dry	35.0	36.0	103		09/10/10	MRD
Trichloroethene	287	ug/kg dry	38.1	41.2	103		09/10/10	MRD
Trichlorofluoromethane	ND	ug/kg dry	49.4	51.5	103		09/10/10	MRD
Vinyl chloride	ND	ug/kg dry	47.4	51.5	103		09/10/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-7 4-8'

Matrix: Soil

Sample Date/Time: 09/07/10 14:15

Lab No.: 1009178-16

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B</u>								
1,1,1,2-Tetrachloroethane	214	ug/kg dry	38.2	42.4	106		09/10/10	MRD
1,1,1-Trichloroethane	74.0	ug/kg dry	41.3	42.4	106		09/10/10	MRD
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	38.2	42.4	106		09/10/10	MRD
1,1,2-Trichloroethane	ND	ug/kg dry	43.5	47.7	106		09/10/10	MRD
1,1-Dichloroethane	ND	ug/kg dry	39.2	42.4	106		09/10/10	MRD
1,1-Dichloroethylene	ND	ug/kg dry	60.4	63.6	106		09/10/10	MRD
1,1-Dichloropropylene	ND	ug/kg dry	94.3	95.4	106		09/10/10	MRD
1,2,3-Trichlorobenzene	ND	ug/kg dry	49.8	53.0	106		09/10/10	MRD
1,2,3-Trichloropropane	ND	ug/kg dry	51.9	53.0	106		09/10/10	MRD
1,2,4-Trichlorobenzene	ND	ug/kg dry	44.5	47.7	106		09/10/10	MRD
1,2,4-Trimethylbenzene	53.3	ug/kg dry	38.2	42.4	106		09/10/10	MRD
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	106	106	106		09/10/10	MRD
1,2-Dibromoethane	ND	ug/kg dry	38.0	37.1	106		09/10/10	MRD
1,2-Dichlorobenzene	ND	ug/kg dry	41.3	42.4	106		09/10/10	MRD
1,2-Dichloroethene	ND	ug/kg dry	42.4	42.4	106		09/10/10	MRD
1,2-Dichloropropane	ND	ug/kg dry	38.0	42.4	106		09/10/10	MRD
1,3,5-Trimethylbenzene	ND	ug/kg dry	38.2	42.4	106		09/10/10	MRD
1,3-Dichlorobenzene	ND	ug/kg dry	40.3	42.4	106		09/10/10	MRD
1,3-Dichloropropane	ND	ug/kg dry	40.3	42.4	106		09/10/10	MRD
1,4-Dichlorobenzene	ND	ug/kg dry	37.1	37.1	106		09/10/10	MRD
2,2-Dichloropropane	ND	ug/kg dry	106	106	106		09/10/10	MRD
2-Chlorotoluene	ND	ug/kg dry	40.3	42.4	106		09/10/10	MRD
4-Chlorotoluene	ND	ug/kg dry	35.0	37.4	106		09/10/10	MRD
4-Isopropyltoluene	ND	ug/kg dry	37.1	37.1	106		09/10/10	MRD
Benzene	ND	ug/kg dry	38.2	42.4	106		09/10/10	MRD
Bromobenzene	ND	ug/kg dry	37.1	37.1	106		09/10/10	MRD
Bromochloromethane	ND	ug/kg dry	39.2	42.4	106		09/10/10	MRD
Bromodichloromethane	ND	ug/kg dry	40.3	42.4	106		09/10/10	MRD
Bromoform	ND	ug/kg dry	50.9	53.0	106		09/10/10	MRD
Bromomethane	ND	ug/kg dry	106	106	106		09/10/10	MRD
Butylbenzene	ND	ug/kg dry	43.5	47.7	106		09/10/10	MRD
Carbon Tetrachloride	ND	ug/kg dry	43.5	47.7	106		09/10/10	MRD
Chlorobenzene	ND	ug/kg dry	39.2	42.4	106		09/10/10	MRD
Chloroethane	ND	ug/kg dry	72.1	74.2	106		09/10/10	MRD
Chloroform	ND	ug/kg dry	37.1	42.4	106		09/10/10	MRD
Chloromethane	ND	ug/kg dry	37.1	37.1	106		09/10/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-7 4-8'

Matrix: Soil

Sample Date/Time: 09/07/10 14:15

Lab No. : 1009178-16

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	539	ug/kg dry	43.5	47.7	106		09/10/10	MRD
cis-1,3-Dichloropropylene	ND	ug/kg dry	35.0	37.1	106		09/10/10	MRD
Dibromochloromethane	ND	ug/kg dry	35.0	37.1	106		09/10/10	MRD
Dibromomethane	ND	ug/kg dry	41.3	42.4	106		09/10/10	MRD
Dichlorodifluoromethane	ND	ug/kg dry	51.9	53.0	106		09/10/10	MRD
Ethylbenzene	ND	ug/kg dry	39.2	42.4	106		09/10/10	MRD
Hexachlorobutadiene	ND	ug/kg dry	53.0	53.0	106		09/10/10	MRD
isopropyl Ether	ND	ug/kg dry	76.3	79.5	106		09/10/10	MRD
Isopropylbenzene (Cumene)	ND	ug/kg dry	38.2	42.4	106		09/10/10	MRD
m,p-Xylenes	169	ug/kg dry	73.1	74.2	106		09/10/10	MRD
Methylene Chloride	ND	ug/kg dry	32.9	37.1	106		09/10/10	MRD
Methyl-tert-Butyl Ether	ND	ug/kg dry	89.0	95.4	106		09/10/10	MRD
Naphthalene	94.4	ug/kg dry	45.6	47.7	106		09/10/10	MRD
o-Xylene	ND	ug/kg dry	53.0	53.0	106		09/10/10	MRD
Propylbenzene	ND	ug/kg dry	38.2	42.4	106		09/10/10	MRD
sec-Butylbenzene	ND	ug/kg dry	42.4	42.4	106		09/10/10	MRD
Styrene	ND	ug/kg dry	37.1	42.4	106		09/10/10	MRD
tert-Butylbenzene	ND	ug/kg dry	39.2	42.4	106		09/10/10	MRD
Tetrachloroethene	326	ug/kg dry	47.7	47.7	106		09/10/10	MRD
Toluene	80.2	ug/kg dry	43.5	47.7	106		09/10/10	MRD
trans-1,2-Dichloroethylene	ND	ug/kg dry	47.7	47.7	106		09/10/10	MRD
trans-1,3-Dichloropropylene	ND	ug/kg dry	36.0	37.1	106		09/10/10	MRD
Trichloroethene	51400	ug/kg dry	784	848	2120		09/10/10	MRD
Trichlorofluoromethane	ND	ug/kg dry	50.9	53.0	106		09/10/10	MRD
Vinyl chloride	ND	ug/kg dry	48.6	53.0	106		09/10/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-7 8-12'

Matrix: Soil

Sample Date/Time: 09/07/10 14:20

Lab No. : 1009178-17

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	37.8	42.0	105		09/10/10	MRD
1,1,1-Trichloroethane	ND	ug/kg dry	41.0	42.0	105		09/10/10	MRD
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	37.8	42.0	105		09/10/10	MRD
1,1,2-Trichloroethane	ND	ug/kg dry	43.0	47.2	105		09/10/10	MRD
1,1-Dichloroethane	ND	ug/kg dry	38.8	42.0	105		09/10/10	MRD
1,1-Dichloroethylene	ND	ug/kg dry	59.8	63.0	105		09/10/10	MRD
1,1-Dichloropropylene	ND	ug/kg dry	93.4	94.5	105		09/10/10	MRD
1,2,3-Trichlorobenzene	ND	ug/kg dry	49.4	52.5	105		09/10/10	MRD
1,2,3-Trichloropropane	ND	ug/kg dry	51.4	52.5	105		09/10/10	MRD
1,2,4-Trichlorobenzene	ND	ug/kg dry	44.1	47.2	105		09/10/10	MRD
1,2,4-Trimethylbenzene	ND	ug/kg dry	37.8	42.0	105		09/10/10	MRD
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	104	105	105		09/10/10	MRD
1,2-Dibromoethane	ND	ug/kg dry	35.7	36.8	105		09/10/10	MRD
1,2-Dichlorobenzene	ND	ug/kg dry	41.0	42.0	105		09/10/10	MRD
1,2-Dichloroethane	ND	ug/kg dry	42.0	42.0	105		09/10/10	MRD
1,2-Dichloropropane	ND	ug/kg dry	35.7	42.0	105		09/10/10	MRD
1,3,5-Trimethylbenzene	ND	ug/kg dry	37.8	42.0	105		09/10/10	MRD
1,3-Dichlorobenzene	ND	ug/kg dry	39.9	42.0	105		09/10/10	MRD
1,3-Dichloropropane	ND	ug/kg dry	39.9	42.0	105		09/10/10	MRD
1,4-Dichlorobenzene	ND	ug/kg dry	36.8	38.8	105		09/10/10	MRD
2,2-Dichloropropane	ND	ug/kg dry	105	105	105		09/10/10	MRD
2-Chlorotoluene	ND	ug/kg dry	39.9	42.0	105		09/10/10	MRD
4-Chlorotoluene	ND	ug/kg dry	34.6	37.1	105		09/10/10	MRD
4-Isopropyltoluene	ND	ug/kg dry	38.8	38.8	105		09/10/10	MRD
Benzene	ND	ug/kg dry	37.8	42.0	105		09/10/10	MRD
Bromobenzene	ND	ug/kg dry	36.8	36.8	105		09/10/10	MRD
Bromochloromethane	ND	ug/kg dry	38.8	42.0	105		09/10/10	MRD
Bromodichloromethane	ND	ug/kg dry	39.9	42.0	105		09/10/10	MRD
Bromoform	ND	ug/kg dry	50.4	52.5	105		09/10/10	MRD
Bromomethane	ND	ug/kg dry	105	105	105		09/10/10	MRD
Butylbenzene	ND	ug/kg dry	43.0	47.2	105		09/10/10	MRD
Carbon Tetrachloride	ND	ug/kg dry	43.0	47.2	105		09/10/10	MRD
Chlorobenzene	ND	ug/kg dry	38.8	42.0	105		09/10/10	MRD
Chloroethane	ND	ug/kg dry	71.4	73.5	105		09/10/10	MRD
Chloroform	ND	ug/kg dry	36.8	42.0	105		09/10/10	MRD
Chloromethane	ND	ug/kg dry	36.8	36.8	105		09/10/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-7 8-12'

Matrix: Soil

Sample Date/Time: 09/07/10 14:20

Lab No. : 1009178-17

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	43.0	47.2	105		09/10/10	MRD
cis-1,3-Dichloropropylene	ND	ug/kg dry	34.6	36.8	105		09/10/10	MRD
Dibromochloromethane	ND	ug/kg dry	34.6	36.8	105		09/10/10	MRD
Dibromomethane	ND	ug/kg dry	41.0	42.0	105		09/10/10	MRD
Dichlorodifluoromethane	ND	ug/kg dry	51.4	52.5	105		09/10/10	MRD
Ethylbenzene	ND	ug/kg dry	38.8	42.0	105		09/10/10	MRD
Hexachlorobutadiene	ND	ug/kg dry	52.5	52.5	105		09/10/10	MRD
Isopropyl Ether	ND	ug/kg dry	75.6	78.8	105		09/10/10	MRD
Isopropylbenzene (Cumene)	ND	ug/kg dry	37.8	42.0	105		09/10/10	MRD
m,p-Xylenes	ND	ug/kg dry	72.4	73.5	105		09/10/10	MRD
Methylene Chloride	ND	ug/kg dry	32.6	36.8	105		09/10/10	MRD
Methyl-tert-Butyl Ether	ND	ug/kg dry	88.2	94.5	105		09/10/10	MRD
Naphthalene	ND	ug/kg dry	45.2	47.2	105		09/10/10	MRD
o-Xylene	ND	ug/kg dry	52.5	52.5	105		09/10/10	MRD
Propylbenzene	ND	ug/kg dry	37.8	42.0	105		09/10/10	MRD
sec-Butylbenzene	ND	ug/kg dry	42.0	42.0	105		09/10/10	MRD
Styrene	ND	ug/kg dry	36.8	42.0	105		09/10/10	MRD
tert-Butylbenzene	ND	ug/kg dry	36.8	42.0	105		09/10/10	MRD
Tetrachloroethene	ND	ug/kg dry	47.2	47.2	105		09/10/10	MRD
Toluene	ND	ug/kg dry	43.0	47.2	105		09/10/10	MRD
trans-1,2-Dichloroethylene	ND	ug/kg dry	47.2	47.2	105		09/10/10	MRD
trans-1,3-Dichloropropylene	ND	ug/kg dry	35.7	36.8	105		09/10/10	MRD
Trichloroethene	348	ug/kg dry	38.8	42.0	105		09/10/10	MRD
Trichlorofluoromethane	ND	ug/kg dry	50.4	52.5	105		09/10/10	MRD
Vinyl chloride	ND	ug/kg dry	48.3	52.5	105		09/10/10	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-8 0-4'

Matrix: Soil

Sample Date/Time: 09/07/10 14:30

Lab No. : 1009178-18

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	41.0	42.0	105		09/13/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	43.0	47.2	105		09/13/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	38.8	42.0	105		09/13/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	59.8	63.0	105		09/13/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	93.4	94.5	105		09/13/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	49.4	52.5	105		09/13/10	MPM
1,2,3-Trichloropropane	291	ug/kg dry	51.4	52.5	105		09/13/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	44.1	47.2	105		09/13/10	MPM
1,2,4-Trimethylbenzene	112	ug/kg dry	37.8	42.0	105		09/13/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	104	105	105		09/13/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	35.7	36.8	105		09/13/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	41.0	42.0	105		09/13/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	42.0	42.0	105		09/13/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	35.7	42.0	105		09/13/10	MPM
1,3,5-Trimethylbenzene	65.6	ug/kg dry	37.8	42.0	105		09/13/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	39.9	42.0	105		09/13/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	39.9	42.0	105		09/13/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	36.8	36.8	105		09/13/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	105	105	105		09/13/10	MPM
2-Chlorotoluene	ND	ug/kg dry	39.9	42.0	105		09/13/10	MPM
4-Chlorotoluene	ND	ug/kg dry	34.6	37.1	105		09/13/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	36.8	36.8	105		09/13/10	MPM
Benzene	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
Bromobenzene	ND	ug/kg dry	36.8	36.8	105		09/13/10	MPM
Bromochloromethane	ND	ug/kg dry	38.8	42.0	105		09/13/10	MPM
Bromodichloromethane	ND	ug/kg dry	39.9	42.0	105		09/13/10	MPM
Bromoform	ND	ug/kg dry	50.4	52.5	105		09/13/10	MPM
Bromomethane	ND	ug/kg dry	105	105	105		09/13/10	MPM
Butylbenzene	ND	ug/kg dry	43.0	47.2	105		09/13/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	43.0	47.2	105		09/13/10	MPM
Chlorobenzene	ND	ug/kg dry	38.8	42.0	105		09/13/10	MPM
Chloroethane	ND	ug/kg dry	71.4	73.5	105		09/13/10	MPM
Chloroform	ND	ug/kg dry	36.8	42.0	105		09/13/10	MPM
Chloromethane	ND	ug/kg dry	36.8	36.8	105		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-8 0-4'

Matrix: Soil

Sample Date/Time: 09/07/10 14:30

Lab No. : 1009178-18

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B Continued								
cis-1,2-Dichloroethylene	176	ug/kg dry	43.0	47.2	105		09/13/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	34.6	36.8	105		09/13/10	MPM
Dibromochloromethane	ND	ug/kg dry	34.6	36.8	105		09/13/10	MPM
Dibromomethane	ND	ug/kg dry	41.0	42.0	105		09/13/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	51.4	52.5	105		09/13/10	MPM
Ethylbenzene	ND	ug/kg dry	38.8	42.0	105		09/13/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	52.5	52.5	105		09/13/10	MPM
Isopropyl Ether	ND	ug/kg dry	75.6	78.8	105		09/13/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
m,p-Xylenes	ND	ug/kg dry	72.4	73.5	105		09/13/10	MPM
Methylene Chloride	ND	ug/kg dry	32.6	36.8	105		09/13/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	88.2	94.5	105		09/13/10	MPM
Naphthalene	149	ug/kg dry	45.2	47.2	105		09/13/10	MPM
o-Xylene	ND	ug/kg dry	52.5	52.5	105		09/13/10	MPM
Propylbenzene	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
sec-Butylbenzene	ND	ug/kg dry	42.0	42.0	105		09/13/10	MPM
Styrene	ND	ug/kg dry	36.8	42.0	105		09/13/10	MPM
tert-Butylbenzene	ND	ug/kg dry	38.8	42.0	105		09/13/10	MPM
Tetrachloroethene	ND	ug/kg dry	47.2	47.2	105		09/13/10	MPM
Toluene	ND	ug/kg dry	43.0	47.2	105		09/13/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	47.2	47.2	105		09/13/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	35.7	38.8	105		09/13/10	MPM
Trichloroethene	94.8	ug/kg dry	38.8	42.0	105		09/13/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	50.4	52.5	105		09/13/10	MPM
Vinyl chloride	ND	ug/kg dry	48.3	52.5	105		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-8 4-8'

Matrix: Soil

Sample Date/Time: 09/07/10 14:35

Lab No. : 1009178-19

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	40.2	41.2	103		09/13/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	42.2	46.4	103		09/13/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	38.1	41.2	103		09/13/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	58.7	61.8	103		09/13/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	91.7	92.7	103		09/13/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	48.4	51.5	103		09/13/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	50.5	51.5	103		09/13/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	43.3	46.4	103		09/13/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	102	103	103		09/13/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	35.0	38.0	103		09/13/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	40.2	41.2	103		09/13/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	41.2	41.2	103		09/13/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	35.0	41.2	103		09/13/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	39.1	41.2	103		09/13/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	39.1	41.2	103		09/13/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	38.0	38.0	103		09/13/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	103	103	103		09/13/10	MPM
2-Chlorotoluene	ND	ug/kg dry	38.1	41.2	103		09/13/10	MPM
4-Chlorotoluene	ND	ug/kg dry	34.0	38.4	103		09/13/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	38.0	38.0	103		09/13/10	MPM
Benzene	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
Bromobenzene	ND	ug/kg dry	38.0	36.0	103		09/13/10	MPM
Bromochloromethane	ND	ug/kg dry	38.1	41.2	103		09/13/10	MPM
Bromodichloromethane	ND	ug/kg dry	38.1	41.2	103		09/13/10	MPM
Bromoform	ND	ug/kg dry	49.4	51.5	103		09/13/10	MPM
Bromomethane	ND	ug/kg dry	103	103	103		09/13/10	MPM
Butylbenzene	ND	ug/kg dry	42.2	46.4	103		09/13/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	42.2	46.4	103		09/13/10	MPM
Chlorobenzene	ND	ug/kg dry	38.1	41.2	103		09/13/10	MPM
Chloroethane	ND	ug/kg dry	70.0	72.1	103		09/13/10	MPM
Chloroform	ND	ug/kg dry	36.0	41.2	103		09/13/10	MPM
Chloromethane	ND	ug/kg dry	36.0	36.0	103		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-8 4-8'

Matrix: Soil

Sample Date/Time: 09/07/10 14:35

Lab No. : 1009178-19

	<u>Results</u>	<u>Units</u>	<u>LQD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	42.2	46.4	103		09/13/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	34.0	36.0	103		09/13/10	MPM
Dibromochloromethane	ND	ug/kg dry	34.0	36.0	103		09/13/10	MPM
Dibromomethane	ND	ug/kg dry	40.2	41.2	103		09/13/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	50.5	51.5	103		09/13/10	MPM
Ethylbenzene	ND	ug/kg dry	38.1	41.2	103		09/13/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	51.5	51.5	103		09/13/10	MPM
Isopropyl Ether	ND	ug/kg dry	74.2	77.2	103		09/13/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
m,p-Xylenes	ND	ug/kg dry	71.1	72.1	103		09/13/10	MPM
Methylene Chloride	ND	ug/kg dry	31.9	36.0	103		09/13/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	86.5	92.7	103		09/13/10	MPM
Naphthalene	65.1	ug/kg dry	44.3	46.4	103		09/13/10	MPM
o-Xylene	ND	ug/kg dry	51.5	51.5	103		09/13/10	MPM
Propylbenzene	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
sec-Butylbenzene	ND	ug/kg dry	41.2	41.2	103		09/13/10	MPM
Styrene	ND	ug/kg dry	36.0	41.2	103		09/13/10	MPM
tert-Butylbenzene	ND	ug/kg dry	38.1	41.2	103		09/13/10	MPM
Tetrachloroethene	ND	ug/kg dry	46.4	46.4	103		09/13/10	MPM
Toluene	ND	ug/kg dry	42.2	46.4	103		09/13/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	46.4	46.4	103		09/13/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	35.0	38.0	103		09/13/10	MPM
Trichloroethene	228	ug/kg dry	38.1	41.2	103		09/13/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	49.4	51.6	103		09/13/10	MPM
Vinyl chloride	ND	ug/kg dry	47.4	51.5	103		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-8 8-12'

Matrix: Soil

Sample Date/Time: 09/07/10 14:45

Lab No. : 1009178-20

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	40.2	41.2	103		09/13/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	42.2	46.4	103		09/13/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	36.1	41.2	103		09/13/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	58.7	61.8	103		09/13/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	91.7	92.7	103		09/13/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	48.4	51.5	103		09/13/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	50.5	51.5	103		09/13/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	43.3	46.4	103		09/13/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	102	103	103		09/13/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	35.0	36.0	103		09/13/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	40.2	41.2	103		09/13/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	41.2	41.2	103		09/13/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	35.0	41.2	103		09/13/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	39.1	41.2	103		09/13/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	39.1	41.2	103		09/13/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	36.0	36.0	103		09/13/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	103	103	103		09/13/10	MPM
2-Chlorotoluene	ND	ug/kg dry	39.1	41.2	103		09/13/10	MPM
4-Chlorotoluene	ND	ug/kg dry	34.0	36.4	103		09/13/10	MPM
4-isopropyltoluene	ND	ug/kg dry	36.0	36.0	103		09/13/10	MPM
Benzene	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
Bromobenzene	ND	ug/kg dry	36.0	36.0	103		09/13/10	MPM
Bromochloromethane	ND	ug/kg dry	38.1	41.2	103		09/13/10	MPM
Bromodichloromethane	ND	ug/kg dry	39.1	41.2	103		09/13/10	MPM
Bromoform	ND	ug/kg dry	49.4	51.5	103		09/13/10	MPM
Bromomethane	ND	ug/kg dry	103	103	103		09/13/10	MPM
Butylbenzene	ND	ug/kg dry	42.2	46.4	103		09/13/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	42.2	46.4	103		09/13/10	MPM
Chlorobenzene	ND	ug/kg dry	36.1	41.2	103		09/13/10	MPM
Chloroethane	ND	ug/kg dry	70.0	72.1	103		09/13/10	MPM
Chloroform	ND	ug/kg dry	36.0	41.2	103		09/13/10	MPM
Chloromethane	ND	ug/kg dry	36.0	36.0	103		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-8 8-12'

Matrix: Soil

Sample Date/Time: 09/07/10 14:45

Lab No. : 1009178-20

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	42.2	46.4	103		09/13/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	34.0	36.0	103		09/13/10	MPM
Dibromochloromethane	ND	ug/kg dry	34.0	36.0	103		09/13/10	MPM
Dibromomethane	ND	ug/kg dry	40.2	41.2	103		09/13/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	50.5	51.5	103		09/13/10	MPM
Ethylbenzene	ND	ug/kg dry	38.1	41.2	103		09/13/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	51.5	51.5	103		09/13/10	MPM
Isopropyl Ether	ND	ug/kg dry	74.2	77.2	103		09/13/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
m,p-Xylenes	ND	ug/kg dry	71.1	72.1	103		09/13/10	MPM
Methylene Chloride	ND	ug/kg dry	31.9	36.0	103		09/13/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	86.5	92.7	103		09/13/10	MPM
Naphthalene	ND	ug/kg dry	44.3	46.4	103		09/13/10	MPM
o-Xylene	ND	ug/kg dry	51.5	51.5	103		09/13/10	MPM
Propylbenzene	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
sec-Butylbenzene	ND	ug/kg dry	41.2	41.2	103		09/13/10	MPM
Styrene	ND	ug/kg dry	36.0	41.2	103		09/13/10	MPM
tert-Butylbenzene	ND	ug/kg dry	38.1	41.2	103		09/13/10	MPM
Tetrachloroethene	ND	ug/kg dry	46.4	46.4	103		09/13/10	MPM
Toluene	ND	ug/kg dry	42.2	46.4	103		09/13/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	46.4	46.4	103		09/13/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	35.0	36.0	103		09/13/10	MPM
Trichloroethene	ND	ug/kg dry	38.1	41.2	103		09/13/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	49.4	51.5	103		09/13/10	MPM
Vinyl chloride	ND	ug/kg dry	47.4	51.5	103		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-9 0-4'

Matrix: Soil

Sample Date/Time: 09/07/10 14:55

Lab No. : 1009178-21

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	40.2	41.2	103		09/13/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	42.2	46.4	103		09/13/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	36.1	41.2	103		09/13/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	58.7	61.8	103		09/13/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	91.7	92.7	103		09/13/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	48.4	51.5	103		09/13/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	50.5	51.5	103		09/13/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	43.3	46.4	103		09/13/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	102	103	103		09/13/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	35.0	36.0	103		09/13/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	40.2	41.2	103		09/13/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	41.2	41.2	103		09/13/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	35.0	41.2	103		09/13/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	39.1	41.2	103		09/13/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	39.1	41.2	103		09/13/10	MPM
1,4-Dichlorobenzene	100	ug/kg dry	36.0	38.0	103		09/13/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	103	103	103		09/13/10	MPM
2-Chlorotoluene	ND	ug/kg dry	39.1	41.2	103		09/13/10	MPM
4-Chlorotoluene	ND	ug/kg dry	34.0	36.4	103		09/13/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	36.0	38.0	103		09/13/10	MPM
Benzene	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
Bromobenzene	ND	ug/kg dry	36.0	36.0	103		09/13/10	MPM
Bromochloromethane	ND	ug/kg dry	36.1	41.2	103		09/13/10	MPM
Bromodichloromethane	ND	ug/kg dry	39.1	41.2	103		09/13/10	MPM
Bromoform	ND	ug/kg dry	49.4	51.5	103		09/13/10	MPM
Bromomethane	ND	ug/kg dry	103	103	103		09/13/10	MPM
Butylbenzene	ND	ug/kg dry	42.2	46.4	103		09/13/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	42.2	46.4	103		09/13/10	MPM
Chlorobenzene	ND	ug/kg dry	36.1	41.2	103		09/13/10	MPM
Chloroethane	ND	ug/kg dry	70.0	72.1	103		09/13/10	MPM
Chloroform	ND	ug/kg dry	36.0	41.2	103		09/13/10	MPM
Chloromethane	ND	ug/kg dry	36.0	36.0	103		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-9 0-4'

Matrix: Soil

Sample Date/Time: 09/07/10 14:55

Lab No. : 1009178-21

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B Continued								
cis-1,2-Dichloroethylene	ND	ug/kg dry	42.2	46.4	103		09/13/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	34.0	36.0	103		09/13/10	MPM
Dibromochloromethane	ND	ug/kg dry	34.0	36.0	103		09/13/10	MPM
Dibromomethane	ND	ug/kg dry	40.2	41.2	103		09/13/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	50.5	51.5	103		08/13/10	MPM
Ethylbenzene	ND	ug/kg dry	38.1	41.2	103		09/13/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	51.5	51.5	103		09/13/10	MPM
Isopropyl Ether	ND	ug/kg dry	74.2	77.2	103		09/13/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
m,p-Xylenes	ND	ug/kg dry	71.1	72.1	103		09/13/10	MPM
Methylene Chloride	ND	ug/kg dry	31.9	36.0	103		09/13/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	88.5	92.7	103		09/13/10	MPM
Naphthalene	ND	ug/kg dry	44.3	46.4	103		09/13/10	MPM
o-Xylene	ND	ug/kg dry	51.5	51.5	103		09/13/10	MPM
Propylbenzene	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
sec-Butylbenzene	ND	ug/kg dry	41.2	41.2	103		09/13/10	MPM
Styrene	ND	ug/kg dry	38.0	41.2	103		09/13/10	MPM
tert-Butylbenzene	ND	ug/kg dry	38.1	41.2	103		09/13/10	MPM
Tetrachloroethene	ND	ug/kg dry	46.4	46.4	103		09/13/10	MPM
Toluene	ND	ug/kg dry	42.2	46.4	103		09/13/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	46.4	46.4	103		09/13/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	35.0	36.0	103		09/13/10	MPM
Trichloroethene	4400	ug/kg dry	38.1	41.2	103		09/13/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	49.4	51.5	103		09/13/10	MPM
Vinyl chloride	ND	ug/kg dry	47.4	51.5	103		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-10 0-4'

Matrix: Soil

Sample Date/Time: 09/07/10 15:20

Lab No. : 1009178-22

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	36.7	40.8	102		09/13/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	39.8	40.8	102		09/13/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	36.7	40.8	102		09/13/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	41.8	45.9	102		09/13/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	37.7	40.8	102		09/13/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	58.1	61.2	102		09/13/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	90.8	91.8	102		09/13/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	47.9	51.0	102		09/13/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	50.0	51.0	102		09/13/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	42.8	45.9	102		09/13/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	36.7	40.8	102		09/13/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	101	102	102		09/13/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	34.7	35.7	102		09/13/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	39.8	40.8	102		09/13/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	40.8	40.8	102		09/13/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	34.7	40.8	102		09/13/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	36.7	40.8	102		09/13/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	36.8	40.8	102		09/13/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	38.8	40.8	102		09/13/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	35.7	35.7	102		09/13/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	102	102	102		09/13/10	MPM
2-Chlorotoluene	ND	ug/kg dry	38.8	40.8	102		09/13/10	MPM
4-Chlorotoluene	ND	ug/kg dry	33.7	36.0	102		09/13/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	35.7	35.7	102		09/13/10	MPM
Benzene	ND	ug/kg dry	36.7	40.8	102		09/13/10	MPM
Bromobenzene	ND	ug/kg dry	35.7	35.7	102		09/13/10	MPM
Bromochloromethane	ND	ug/kg dry	37.7	40.8	102		09/13/10	MPM
Bromodichloromethane	ND	ug/kg dry	38.8	40.8	102		09/13/10	MPM
Bromoform	ND	ug/kg dry	49.0	51.0	102		09/13/10	MPM
Bromomethane	ND	ug/kg dry	102	102	102		09/13/10	MPM
Butylbenzene	ND	ug/kg dry	41.8	45.9	102		09/13/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	41.8	45.9	102		09/13/10	MPM
Chlorobenzene	ND	ug/kg dry	37.7	40.8	102		09/13/10	MPM
Chloroethane	ND	ug/kg dry	69.4	71.4	102		09/13/10	MPM
Chloroform	ND	ug/kg dry	35.7	40.8	102		09/13/10	MPM
Chloromethane	ND	ug/kg dry	35.7	35.7	102		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-10 0-4'

Matrix: Soil

Sample Date/Time: 09/07/10 15:20

Lab No. : 1009178-22

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B Continued								
cis-1,2-Dichloroethylene	ND	ug/kg dry	41.8	45.9	102		09/13/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	33.7	35.7	102		09/13/10	MPM
Dibromochloromethane	ND	ug/kg dry	33.7	35.7	102		09/13/10	MPM
Dibromomethane	ND	ug/kg dry	39.8	40.8	102		09/13/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	50.0	51.0	102		09/13/10	MPM
Ethylbenzene	ND	ug/kg dry	37.7	40.8	102		09/13/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	51.0	51.0	102		09/13/10	MPM
Isopropyl Ether	ND	ug/kg dry	73.4	76.5	102		09/13/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	36.7	40.8	102		09/13/10	MPM
m,p-Xylenes	ND	ug/kg dry	70.4	71.4	102		09/13/10	MPM
Methylene Chloride	ND	ug/kg dry	31.6	35.7	102		09/13/10	MPM
Methyl-Tert-Butyl Ether	ND	ug/kg dry	85.7	91.8	102		09/13/10	MPM
Naphthalene	ND	ug/kg dry	43.9	45.9	102		09/13/10	MPM
o-Xylene	ND	ug/kg dry	51.0	51.0	102		09/13/10	MPM
Propylbenzene	ND	ug/kg dry	36.7	40.8	102		09/13/10	MPM
sec-Butylbenzene	ND	ug/kg dry	40.8	40.8	102		09/13/10	MPM
Styrene	ND	ug/kg dry	35.7	40.8	102		09/13/10	MPM
tert-Butylbenzene	ND	ug/kg dry	37.7	40.8	102		09/13/10	MPM
Tetrachloroethene	ND	ug/kg dry	45.9	45.9	102		09/13/10	MPM
Toluene	ND	ug/kg dry	41.8	45.9	102		09/13/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	45.9	45.9	102		09/13/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	34.7	35.7	102		09/13/10	MPM
Trichloroethene	ND	ug/kg dry	37.7	40.8	102		09/13/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	49.0	51.0	102		09/13/10	MPM
Vinyl chloride	ND	ug/kg dry	46.9	51.0	102		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-10 4-8'

Matrix: Soil

Sample Date/Time: 09/07/10 15:25

Lab No. : 1009178-23

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	36.0	40.0	100		09/13/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	39.0	40.0	100		09/13/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	36.0	40.0	100		09/13/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	41.0	45.0	100		09/13/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	37.0	40.0	100		09/13/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	57.0	60.0	100		09/13/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	89.0	90.0	100		09/13/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	47.0	50.0	100		09/13/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	49.0	50.0	100		09/13/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	42.0	45.0	100		09/13/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	36.0	40.0	100		09/13/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	99.0	100	100		09/13/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	34.0	35.0	100		09/13/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	39.0	40.0	100		09/13/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	40.0	40.0	100		09/13/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	34.0	40.0	100		09/13/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	36.0	40.0	100		09/13/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	36.0	40.0	100		09/13/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	38.0	40.0	100		09/13/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	35.0	35.0	100		09/13/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	100	100	100		09/13/10	MPM
2-Chlorotoluene	ND	ug/kg dry	38.0	40.0	100		09/13/10	MPM
4-Chlorotoluene	ND	ug/kg dry	33.0	35.3	100		09/13/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	35.0	35.0	100		09/13/10	MPM
Benzene	ND	ug/kg dry	36.0	40.0	100		09/13/10	MPM
Bromobenzene	ND	ug/kg dry	35.0	35.0	100		09/13/10	MPM
Bromochloromethane	ND	ug/kg dry	37.0	40.0	100		09/13/10	MPM
Bromodichloromethane	ND	ug/kg dry	38.0	40.0	100		09/13/10	MPM
Bromoform	ND	ug/kg dry	48.0	50.0	100		09/13/10	MPM
Bromomethane	ND	ug/kg dry	100	100	100		09/13/10	MPM
Butylbenzene	ND	ug/kg dry	41.0	45.0	100		09/13/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	41.0	45.0	100		09/13/10	MPM
Chlorobenzene	ND	ug/kg dry	37.0	40.0	100		09/13/10	MPM
Chloroethane	ND	ug/kg dry	68.0	70.0	100		09/13/10	MPM
Chloroform	ND	ug/kg dry	35.0	40.0	100		09/13/10	MPM
Chloromethane	ND	ug/kg dry	35.0	35.0	100		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-10 4-8'

Matrix: Soil

Sample Date/Time: 09/07/10 15:25

Lab No. : 1009178-23

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	41.0	45.0	100		09/13/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	33.0	35.0	100		09/13/10	MPM
Dibromochloromethane	ND	ug/kg dry	33.0	35.0	100		09/13/10	MPM
Dibromomethane	ND	ug/kg dry	39.0	40.0	100		09/13/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	49.0	50.0	100		09/13/10	MPM
Ethylbenzene	ND	ug/kg dry	37.0	40.0	100		09/13/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	50.0	50.0	100		09/13/10	MPM
Isopropyl Ether	ND	ug/kg dry	72.0	75.0	100		09/13/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	36.0	40.0	100		09/13/10	MPM
m,p-Xylenes	ND	ug/kg dry	69.0	70.0	100		09/13/10	MPM
Methylene Chloride	ND	ug/kg dry	31.0	35.0	100		09/13/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	84.0	90.0	100		09/13/10	MPM
Naphthalene	ND	ug/kg dry	43.0	45.0	100		09/13/10	MPM
o-Xylene	ND	ug/kg dry	50.0	50.0	100		09/13/10	MPM
Propylbenzene	ND	ug/kg dry	36.0	40.0	100		09/13/10	MPM
sec-Butylbenzene	ND	ug/kg dry	40.0	40.0	100		09/13/10	MPM
Styrene	ND	ug/kg dry	35.0	40.0	100		09/13/10	MPM
tert-Butylbenzene	ND	ug/kg dry	37.0	40.0	100		09/13/10	MPM
Tetrachloroethene	ND	ug/kg dry	45.0	45.0	100		09/13/10	MPM
Toluene	ND	ug/kg dry	41.0	45.0	100		09/13/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	45.0	45.0	100		09/13/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	34.0	35.0	100		09/13/10	MPM
Trichloroethene	ND	ug/kg dry	37.0	40.0	100		09/13/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	48.0	50.0	100		09/13/10	MPM
Vinyl chloride	ND	ug/kg dry	46.0	50.0	100		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-10 8-12'

Matrix: Soil

Sample Date/Time: 09/07/10 15:40

Lab No. : 1009178-24

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	36.7	40.8	102		09/13/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	39.8	40.8	102		09/13/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	36.7	40.8	102		09/13/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	41.8	45.9	102		09/13/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	37.7	40.8	102		09/13/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	58.1	81.2	102		09/13/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	90.8	91.8	102		09/13/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	47.9	51.0	102		09/13/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	50.0	51.0	102		09/13/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	42.8	45.9	102		09/13/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	36.7	40.8	102		09/13/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	101	102	102		09/13/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	34.7	35.7	102		09/13/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	39.8	40.8	102		09/13/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	40.8	40.8	102		09/13/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	34.7	40.8	102		09/13/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	36.7	40.8	102		09/13/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	38.8	40.8	102		09/13/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	38.8	40.8	102		09/13/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	35.7	35.7	102		09/13/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	102	102	102		09/13/10	MPM
2-Chlorotoluene	ND	ug/kg dry	38.8	40.8	102		09/13/10	MPM
4-Chlorotoluene	ND	ug/kg dry	33.7	36.0	102		09/13/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	35.7	35.7	102		09/13/10	MPM
Benzene	ND	ug/kg dry	36.7	40.8	102		09/13/10	MPM
Bromobenzene	ND	ug/kg dry	35.7	35.7	102		09/13/10	MPM
Bromochloromethane	ND	ug/kg dry	37.7	40.8	102		09/13/10	MPM
Bromodichloromethane	ND	ug/kg dry	38.8	40.8	102		09/13/10	MPM
Bromoform	ND	ug/kg dry	49.0	51.0	102		09/13/10	MPM
Bromomethane	ND	ug/kg dry	102	102	102		09/13/10	MPM
Butylbenzene	ND	ug/kg dry	41.8	45.9	102		09/13/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	41.8	45.9	102		09/13/10	MPM
Chlorobenzene	ND	ug/kg dry	37.7	40.8	102		09/13/10	MPM
Chloroethane	ND	ug/kg dry	89.4	71.4	102		09/13/10	MPM
Chloroform	ND	ug/kg dry	35.7	40.8	102		09/13/10	MPM
Chloromethane	ND	ug/kg dry	35.7	35.7	102		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-10 8-12'

Matrix: Soil

Sample Date/Time: 09/07/10 15:40

Lab No. : 1009178-24

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	41.8	45.9	102		09/13/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	33.7	35.7	102		09/13/10	MPM
Dibromochloromethane	ND	ug/kg dry	33.7	35.7	102		09/13/10	MPM
Dibromomethane	ND	ug/kg dry	39.8	40.8	102		09/13/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	50.0	51.0	102		09/13/10	MPM
Ethylbenzene	ND	ug/kg dry	37.7	40.8	102		09/13/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	51.0	51.0	102		09/13/10	MPM
Isopropyl Ether	ND	ug/kg dry	73.4	78.5	102		09/13/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	36.7	40.8	102		09/13/10	MPM
m,p-Xylenes	ND	ug/kg dry	70.4	71.4	102		09/13/10	MPM
Methylene Chloride	ND	ug/kg dry	31.8	35.7	102		09/13/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	85.7	91.8	102		09/13/10	MPM
Naphthalene	ND	ug/kg dry	43.9	45.9	102		09/13/10	MPM
o-Xylene	ND	ug/kg dry	51.0	51.0	102		09/13/10	MPM
Propylbenzene	ND	ug/kg dry	36.7	40.8	102		09/13/10	MPM
sec-Butylbenzene	ND	ug/kg dry	40.8	40.8	102		09/13/10	MPM
Styrene	ND	ug/kg dry	35.7	40.8	102		09/13/10	MPM
tert-Butylbenzene	ND	ug/kg dry	37.7	40.8	102		09/13/10	MPM
Tetrachloroethene	ND	ug/kg dry	45.9	45.9	102		09/13/10	MPM
Toluene	ND	ug/kg dry	41.8	45.9	102		09/13/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	45.9	45.9	102		09/13/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	34.7	35.7	102		09/13/10	MPM
Trichloroethene	ND	ug/kg dry	37.7	40.8	102		09/13/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	49.0	51.0	102		09/13/10	MPM
Vinyl chloride	ND	ug/kg dry	46.9	51.0	102		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-11 0-4'

Matrix: Soil

Sample Date/Time: 09/07/10 16:00

Lab No. : 1009178-25

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	40.6	41.6	104		09/13/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	42.6	46.8	104		09/13/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	38.5	41.6	104		09/13/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	59.3	62.4	104		09/13/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	92.6	93.6	104		09/13/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	48.9	52.0	104		09/13/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	51.0	52.0	104		09/13/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	43.7	46.8	104		09/13/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	103	104	104		09/13/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	35.4	36.4	104		09/13/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	40.6	41.6	104		09/13/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	41.6	41.6	104		09/13/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	35.4	41.6	104		09/13/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	39.5	41.6	104		09/13/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	39.5	41.6	104		09/13/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	36.4	36.4	104		09/13/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	104	104	104		09/13/10	MPM
2-Chlorotoluene	ND	ug/kg dry	39.5	41.6	104		09/13/10	MPM
4-Chlorotoluene	ND	ug/kg dry	34.3	36.7	104		09/13/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	36.4	36.4	104		09/13/10	MPM
Benzene	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
Bromobenzene	ND	ug/kg dry	36.4	36.4	104		09/13/10	MPM
Bromochloromethane	ND	ug/kg dry	38.5	41.6	104		09/13/10	MPM
Bromodichloromethane	ND	ug/kg dry	39.5	41.6	104		09/13/10	MPM
Bromoform	ND	ug/kg dry	49.9	52.0	104		09/13/10	MPM
Bromomethane	ND	ug/kg dry	104	104	104		09/13/10	MPM
Butylbenzene	ND	ug/kg dry	42.6	46.8	104		09/13/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	42.6	46.8	104		09/13/10	MPM
Chlorobenzene	ND	ug/kg dry	38.5	41.6	104		09/13/10	MPM
Chloroethane	ND	ug/kg dry	70.7	72.8	104		09/13/10	MPM
Chloroform	ND	ug/kg dry	36.4	41.6	104		09/13/10	MPM
Chloromethane	ND	ug/kg dry	36.4	36.4	104		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-11 0-4'

Matrix: Soil

Sample Date/Time: 09/07/10 16:00

Lab No. : 1009178-25

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	42.6	46.8	104		09/13/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	34.3	36.4	104		09/13/10	MPM
Dibromochloromethane	ND	ug/kg dry	34.3	36.4	104		09/13/10	MPM
Dibromomethane	ND	ug/kg dry	40.6	41.6	104		09/13/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	51.0	52.0	104		09/13/10	MPM
Ethylbenzene	ND	ug/kg dry	36.5	41.6	104		09/13/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	52.0	52.0	104		09/13/10	MPM
Isopropyl Ether	ND	ug/kg dry	74.9	78.0	104		09/13/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
m,p-Xylenes	ND	ug/kg dry	71.8	72.8	104		09/13/10	MPM
Methylene Chloride	ND	ug/kg dry	32.2	36.4	104		09/13/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	87.4	93.6	104		09/13/10	MPM
Naphthalene	ND	ug/kg dry	44.7	46.8	104		09/13/10	MPM
o-Xylene	ND	ug/kg dry	52.0	52.0	104		09/13/10	MPM
Propylbenzene	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
sec-Butylbenzene	ND	ug/kg dry	41.6	41.6	104		09/13/10	MPM
Styrene	ND	ug/kg dry	36.4	41.8	104		09/13/10	MPM
tert-Butylbenzene	ND	ug/kg dry	38.5	41.6	104		09/13/10	MPM
Tetrachloroethene	ND	ug/kg dry	46.8	46.8	104		09/13/10	MPM
Toluene	ND	ug/kg dry	42.6	46.8	104		09/13/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	46.8	46.8	104		09/13/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	35.4	36.4	104		09/13/10	MPM
Trichloroethene	83.8	ug/kg dry	38.5	41.6	104		09/13/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	49.9	52.0	104		09/13/10	MPM
Vinyl chloride	ND	ug/kg dry	47.8	52.0	104		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-11 4-8'

Matrix: Soil

Sample Date/Time: 09/07/10 16:10

Lab No. : 1009178-26

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	40.6	41.6	104		09/13/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	42.6	46.6	104		09/13/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	36.5	41.6	104		09/13/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	59.3	62.4	104		09/13/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	92.6	93.6	104		09/13/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	48.9	52.0	104		09/13/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	51.0	52.0	104		09/13/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	43.7	46.6	104		09/13/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	103	104	104		09/13/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	35.4	38.4	104		09/13/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	40.6	41.6	104		09/13/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	41.6	41.6	104		09/13/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	36.4	41.6	104		09/13/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	39.5	41.6	104		09/13/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	39.5	41.6	104		09/13/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	36.4	38.4	104		09/13/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	104	104	104		09/13/10	MPM
2-Chlorotoluene	ND	ug/kg dry	39.5	41.6	104		09/13/10	MPM
4-Chlorotoluene	ND	ug/kg dry	34.3	38.7	104		09/13/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	36.4	38.4	104		09/13/10	MPM
Benzene	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
Bromobenzene	ND	ug/kg dry	36.4	36.4	104		09/13/10	MPM
Bromochloromethane	ND	ug/kg dry	36.5	41.6	104		09/13/10	MPM
Bromodichloromethane	ND	ug/kg dry	39.5	41.6	104		09/13/10	MPM
Bromoform	ND	ug/kg dry	49.9	52.0	104		09/13/10	MPM
Bromomethane	ND	ug/kg dry	104	104	104		09/13/10	MPM
Butylbenzene	ND	ug/kg dry	42.6	46.8	104		09/13/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	42.6	46.8	104		09/13/10	MPM
Chlorobenzene	ND	ug/kg dry	38.5	41.6	104		09/13/10	MPM
Chloroethane	ND	ug/kg dry	70.7	72.8	104		09/13/10	MPM
Chloroform	ND	ug/kg dry	36.4	41.6	104		09/13/10	MPM
Chloromethane	ND	ug/kg dry	36.4	36.4	104		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-11 4-8'

Matrix: Soil

Sample Date/Time: 09/07/10 16:10

Lab No. : 1009178-26

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B Continued								
cis-1,2-Dichloroethylene	ND	ug/kg dry	42.8	46.8	104		09/13/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	34.3	38.4	104		09/13/10	MPM
Dibromochloromethane	ND	ug/kg dry	34.3	38.4	104		09/13/10	MPM
Dibromomethane	ND	ug/kg dry	40.6	41.6	104		09/13/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	51.0	52.0	104		09/13/10	MPM
Ethylbenzene	ND	ug/kg dry	38.5	41.8	104		09/13/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	52.0	52.0	104		09/13/10	MPM
Isopropyl Ether	ND	ug/kg dry	74.9	78.0	104		09/13/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
m,p-Xylenes	ND	ug/kg dry	71.8	72.8	104		09/13/10	MPM
Methylene Chloride	ND	ug/kg dry	32.2	36.4	104		09/13/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	87.4	93.6	104		09/13/10	MPM
Naphthalene	ND	ug/kg dry	44.7	48.8	104		09/13/10	MPM
o-Xylene	ND	ug/kg dry	52.0	52.0	104		09/13/10	MPM
Propylbenzene	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
sec-Butylbenzene	ND	ug/kg dry	41.8	41.8	104		09/13/10	MPM
Styrene	ND	ug/kg dry	36.4	41.8	104		09/13/10	MPM
tert-Butylbenzene	ND	ug/kg dry	38.5	41.6	104		09/13/10	MPM
Tetrachloroethene	ND	ug/kg dry	46.8	46.8	104		09/13/10	MPM
Toluene	ND	ug/kg dry	42.6	46.8	104		09/13/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	46.8	46.8	104		09/13/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	35.4	38.4	104		09/13/10	MPM
Trichloroethene	ND	ug/kg dry	38.5	41.8	104		09/13/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	49.9	52.0	104		09/13/10	MPM
Vinyl chloride	ND	ug/kg dry	47.8	52.0	104		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-11 8-12'

Matrix: Soil

Sample Date/Time: 09/07/10 16:20

Lab No. : 1009178-27

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	40.2	41.2	103		09/13/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	42.2	46.4	103		09/13/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	38.1	41.2	103		09/13/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	58.7	61.8	103		09/13/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	91.7	92.7	103		09/13/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	46.4	51.5	103		09/13/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	50.5	51.5	103		09/13/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	43.3	46.4	103		09/13/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	102	103	103		09/13/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	35.0	36.0	103		09/13/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	40.2	41.2	103		09/13/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	41.2	41.2	103		09/13/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	35.0	41.2	103		09/13/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	39.1	41.2	103		09/13/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	39.1	41.2	103		09/13/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	36.0	36.0	103		09/13/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	103	103	103		09/13/10	MPM
2-Chlorotoluene	ND	ug/kg dry	39.1	41.2	103		09/13/10	MPM
4-Chlorotoluene	ND	ug/kg dry	34.0	36.4	103		09/13/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	36.0	36.0	103		09/13/10	MPM
Benzene	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
Bromobenzene	ND	ug/kg dry	38.0	36.0	103		09/13/10	MPM
Bromochloromethane	ND	ug/kg dry	36.1	41.2	103		09/13/10	MPM
Bromodichloromethane	ND	ug/kg dry	39.1	41.2	103		09/13/10	MPM
Bromoform	ND	ug/kg dry	49.4	51.5	103		09/13/10	MPM
Bromomethane	ND	ug/kg dry	103	103	103		09/13/10	MPM
Butylbenzene	ND	ug/kg dry	42.2	46.4	103		09/13/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	42.2	46.4	103		09/13/10	MPM
Chlorobenzene	ND	ug/kg dry	36.1	41.2	103		09/13/10	MPM
Chloroethane	ND	ug/kg dry	70.0	72.1	103		09/13/10	MPM
Chloroform	ND	ug/kg dry	36.0	41.2	103		09/13/10	MPM
Chloromethane	ND	ug/kg dry	36.0	36.0	103		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: CB-11 8-12'

Matrix: Soil

Sample Date/Time: 09/07/10 16:20

Lab No. : 1009178-27

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	42.2	46.4	103		09/13/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	34.0	36.0	103		09/13/10	MPM
Dibromochloromethane	ND	ug/kg dry	34.0	36.0	103		09/13/10	MPM
Dibromomethane	ND	ug/kg dry	40.2	41.2	103		09/13/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	50.5	51.5	103		09/13/10	MPM
Ethylbenzene	ND	ug/kg dry	38.1	41.2	103		09/13/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	51.5	51.5	103		09/13/10	MPM
Isopropyl Ether	ND	ug/kg dry	74.2	77.2	103		09/13/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
m,p-Xylenes	ND	ug/kg dry	71.1	72.1	103		09/13/10	MPM
Methylene Chloride	ND	ug/kg dry	31.8	36.0	103		09/13/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	86.5	92.7	103		09/13/10	MPM
Naphthalene	ND	ug/kg dry	44.3	46.4	103		09/13/10	MPM
o-Xylene	ND	ug/kg dry	51.5	51.5	103		09/13/10	MPM
Propylbenzene	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
sec-Butylbenzene	ND	ug/kg dry	41.2	41.2	103		09/13/10	MPM
Styrene	ND	ug/kg dry	36.0	41.2	103		09/13/10	MPM
tert-Butylbenzene	ND	ug/kg dry	38.1	41.2	103		09/13/10	MPM
Tetrachloroethene	ND	ug/kg dry	46.4	46.4	103		09/13/10	MPM
Toluene	ND	ug/kg dry	42.2	46.4	103		09/13/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	46.4	46.4	103		09/13/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	35.0	36.0	103		09/13/10	MPM
Trichloroethene	ND	ug/kg dry	38.1	41.2	103		09/13/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	49.4	51.5	103		09/13/10	MPM
Vinyl chloride	ND	ug/kg dry	47.4	51.5	103		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: MeOH Blank

Matrix: Soil

Sample Date/Time: 09/07/10 0:00

Lab No. : 1009178-28

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg	36.0	40.0	100		09/13/10	MPM
1,1,1-Trichloroethane	ND	ug/kg	39.0	40.0	100		09/13/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg	36.0	40.0	100		09/13/10	MPM
1,1,2-Trichloroethane	ND	ug/kg	41.0	45.0	100		09/13/10	MPM
1,1-Dichloroethane	ND	ug/kg	37.0	40.0	100		09/13/10	MPM
1,1-Dichloroethylene	ND	ug/kg	57.0	60.0	100		09/13/10	MPM
1,1-Dichloropropylene	ND	ug/kg	89.0	90.0	100		09/13/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg	47.0	50.0	100		09/13/10	MPM
1,2,3-Trichloropropane	ND	ug/kg	49.0	50.0	100		09/13/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg	42.0	45.0	100		09/13/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg	36.0	40.0	100		09/13/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg	99.0	100	100		09/13/10	MPM
1,2-Dibromoethane	ND	ug/kg	34.0	35.0	100		09/13/10	MPM
1,2-Dichlorobenzene	ND	ug/kg	39.0	40.0	100		09/13/10	MPM
1,2-Dichloroethane	ND	ug/kg	40.0	40.0	100		09/13/10	MPM
1,2-Dichloropropane	ND	ug/kg	34.0	40.0	100		09/13/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg	36.0	40.0	100		09/13/10	MPM
1,3-Dichlorobenzene	ND	ug/kg	38.0	40.0	100		09/13/10	MPM
1,3-Dichloropropane	ND	ug/kg	38.0	40.0	100		09/13/10	MPM
1,4-Dichlorobenzene	ND	ug/kg	35.0	35.0	100		09/13/10	MPM
2,2-Dichloropropane	ND	ug/kg	100	100	100		09/13/10	MPM
2-Chlorotoluene	ND	ug/kg	38.0	40.0	100		09/13/10	MPM
4-Chlorotoluene	ND	ug/kg	33.0	35.3	100		09/13/10	MPM
4-Isopropyltoluene	ND	ug/kg	35.0	35.0	100		09/13/10	MPM
Benzene	ND	ug/kg	36.0	40.0	100		09/13/10	MPM
Bromobenzene	ND	ug/kg	35.0	35.0	100		09/13/10	MPM
Bromochloromethane	ND	ug/kg	37.0	40.0	100		09/13/10	MPM
Bromodichloromethane	ND	ug/kg	38.0	40.0	100		09/13/10	MPM
Bromoform	ND	ug/kg	48.0	50.0	100		09/13/10	MPM
Bromomethane	ND	ug/kg	100	100	100		09/13/10	MPM
Butylbenzene	ND	ug/kg	41.0	45.0	100		09/13/10	MPM
Carbon Tetrachloride	ND	ug/kg	41.0	45.0	100		09/13/10	MPM
Chlorobenzene	ND	ug/kg	37.0	40.0	100		09/13/10	MPM
Chloroethane	ND	ug/kg	68.0	70.0	100		09/13/10	MPM
Chloroform	ND	ug/kg	35.0	40.0	100		09/13/10	MPM
Chloromethane	ND	ug/kg	35.0	35.0	100		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009178
DATE REC'D : 09/09/10 17:14
REPORT DATE : 09/15/10 12:27
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: MeOH Blank

Matrix: Soil

Sample Date/Time: 09/07/10 0:00

Lab No. : 1009178-28

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg	41.0	45.0	100		09/13/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg	33.0	35.0	100		09/13/10	MPM
Dibromochloromethane	ND	ug/kg	33.0	35.0	100		09/13/10	MPM
Dibromomethane	ND	ug/kg	38.0	40.0	100		09/13/10	MPM
Dichlorodifluoromethane	ND	ug/kg	49.0	50.0	100		09/13/10	MPM
Ethylbenzene	ND	ug/kg	37.0	40.0	100		09/13/10	MPM
Hexachlorobutadiene	ND	ug/kg	50.0	50.0	100		09/13/10	MPM
Isopropyl Ether	ND	ug/kg	72.0	75.0	100		09/13/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg	36.0	40.0	100		09/13/10	MPM
m,p-Xylenes	ND	ug/kg	69.0	70.0	100		09/13/10	MPM
Methylene Chloride	ND	ug/kg	31.0	35.0	100		09/13/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg	84.0	90.0	100		09/13/10	MPM
Naphthalene	ND	ug/kg	43.0	45.0	100		09/13/10	MPM
o-Xylene	ND	ug/kg	50.0	50.0	100		09/13/10	MPM
Propylbenzene	ND	ug/kg	36.0	40.0	100		09/13/10	MPM
sec-Butylbenzene	ND	ug/kg	40.0	40.0	100		09/13/10	MPM
Styrene	ND	ug/kg	35.0	40.0	100		09/13/10	MPM
tert-Butylbenzene	ND	ug/kg	37.0	40.0	100		09/13/10	MPM
Tetrachloroethene	ND	ug/kg	45.0	45.0	100		09/13/10	MPM
Toluene	ND	ug/kg	41.0	45.0	100		09/13/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg	45.0	45.0	100		09/13/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg	34.0	35.0	100		09/13/10	MPM
Trichloroethene	ND	ug/kg	37.0	40.0	100		09/13/10	MPM
Trichlorofluoromethane	ND	ug/kg	48.0	50.0	100		09/13/10	MPM
Vinyl chloride	ND	ug/kg	46.0	50.0	100		09/13/10	MPM

SIEMENS

Qualifier Descriptions

LOD = Limit of Detection (Dilution Corrected)
LOQ = Limit of Quantitation (Dilution Corrected)
Reporting Limit = LOQ (Dilution Corrected)
ND = Not Detected
COMP = Complete
SUBCON = Subcontracted analysis
mv = millivolts
pci/L = picocuries per Liter
mL/L = milliliters per Liter
mg = milligram

When the word "dry" follows the units on the result page the sample results are dry weight corrected.

LODs and LOQs are dry weight corrected for all soils except WI GRO, EPA 8021 and WI DNR/EPA 8260B methanol and WI DNR methylene chloride preserved soils being reported to the State of Wisconsin.

Definitions

ug/l = Micrograms per Liter = parts per billion (ppb)
ug/kg = Micrograms per kilogram = parts per billion (ppb)
mg/l = Milligrams per liter = parts per million (ppm)
mg/kg = Milligrams per kilogram = parts per million (ppm)
NOT PRES = Not Present
ppth = Parts per thousand
* = Result outside established limits.
mg/m3 = Milligrams per meter cubed
ng/L = Nanograms per Liter = Parts per trillion (ppt)
> = Greater Than

State of Wisconsin Methanol Soils for WI GRO, WI DNR/EPA 8260B and EPA 8021 are reported to the LOQ.

Company Name GANNETT FLEMING		Project 34286.008 34/70	
Report Mailing Address 8025 EXCELSIOR DR MADISON, WI 53717		Contact Name, Phone, Fax, Email TONY MILLER - ph 608-836-1500 - Copy 608-831-3337 amiller@gnf.com	
Invoice Address NATIONAL PESTO INDUSTRIES 3925 N. HASTINGS WAY BAU CLAIRE, WI 54703 (sample)		Purchase Order # 2010 TIER 1 UNIT PRICES	Invoice Contact and Phone No. DAVE OLIG - GANNETT FLEMING 608-836-1510

Copy
Directly
in
Report
per Tony

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wts. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: WI
(If Yes, please specify Agency or Regulation) Agency/Reg.: MDNR/EPA

Turnaround Request: Normal (10 Bus. Days) ok per Tony Miller Sat
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1009178

Analyses Requested						Lab Use Only			
VOCs - 8260						Delivered by:	Walk-In	Courier	
						Ship. Cont. OK?	<input checked="" type="checkbox"/> N	NA	
						Samples Leaking?	<input checked="" type="checkbox"/> N	NA	
						Seals OK?	<input checked="" type="checkbox"/> N	NA	
						Rec'd on ice?	<input checked="" type="checkbox"/> N	NA	
	Sample Receiving Comments:						3.7		
	Comments						PID READINGS		

Lab Use Only	Sample		No. of Containers		Sample ID		VOCs	TSS	Meth	Comments
	Date	Time	Comp	Grab	Comp	Grab				
-1	9/8/10	11:20	2		CB-1	0-4'	X			0.4 PPM
-2		11:25	2		CB-1	4-8'	X			<0.1 PPM
-3		11:30	2		CB-1	8-12'	X			0.1 PPM
-4		12:25	2		CB-2	0-4'	X			5.0 PPM
-5		12:40	2		CB-3	0-4'	X			<0.1 PPM
-6		12:45	2		CB-3	4-8'	X			0.5 PPM
-7		12:55	2		CB-3	8-12'	X			<0.1 PPM
-8		13:00	2		CB-4	0-4'	X			0.1 PPM
-9		13:15	2		CB-5	0-4'	X			6.9 PPM
-10	✓	13:20	2		CB-5	4-8'	X		✓	0.1 PPM

Chain of Custody
Record

Relinquished By:	Date	Time	Received By:
<i>Tony Miller</i>	9/8/10	1000	
	9-9-10	1714	<i>See Above</i>

Company Name GANNETT FLEMING	Project 34286.008	34/70
Report Mailing Address	Contact Name, Phone, Fax, Email	
Invoice Address SEE PG 1	Purchase Order #	Invoice Contact and Phone No. SEE PG 1

Matrix: Drinking Water Groundwater Wastewater Solid/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: WI
(if Yes, please specify Agency or Regulation) Agency/Reg.: WDNR/EPA

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1009178

Analyses Requested		Lab Use Only	
NOV-8260		Delivered by:	Walk-in
		Ship. Cont. OK?	<u>Y</u> N NA
		Samples Leaking?	<u>Y</u> <u>N</u> NA
		Seals OK?	<u>Y</u> N NA
	Rec'd on Ice?	<u>Y</u> N NA	
		Sample Receiving Comments:	
		3.2	

Lab Use Only	Sample		No. of Containers		Sample ID				Comments
	Date	Time	Comp	Grab					
-11	9/7/10	13:25	2		CB-5 8-12'	X	TS	MACT	<0.1 PPM
-12		13:50	2		CB-6 0-4'	X			0.2 PPM
-13		13:55	2		CB-6 4-8'	X			0.1 PPM
-14		14:00	2		CB-6 8-12'	X			<0.1 PPM
-15		14:10	2		CB-7 0-4'	X			<0.1 PPM
-16		14:15	2		CB-7 4-8'	X			1.0 PPM
-17		14:20	2		CB-7 8-12'	X			0.3 PPM
-18		14:30	2		CB-8 0-4'	X			3.1 PPM
-19		14:35	2		CB-8 4-8'	X			<0.1 PPM
-20	✓	14:45	2		CB-8 8-12'	X		Gravim CB-8 10-12'	0.5 PPM

Chain of Custody Record

Relinquished By:	Date	Time	Received By:
<i>Roy Miller</i>	9/8/10	10:00	
	9/9/10	17:14	<i>Jer Ader</i>

Company Name GANNETT FLEMING	Project 34286.008 34/70
Report Mailing Address SEE PG 1	Contact Name, Phone, Fax, Email SEE PG 1
Invoice Address SEE PG 1	Purchase Order # SEE PG 1

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: _____

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: **WI**
(If Yes, please specify Agency or Regulation) Agency/Reg.: **WDNR/EPA**

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
Date Needed: _____

WO No. 1009178

Analyses Requested		Lab Use Only	
VOCs - 8260		Delivered by:	Walk-in <input type="checkbox"/> <u>Courier</u>
		Ship. Cont. OK?	<input checked="" type="checkbox"/> Y <input type="checkbox"/> N NA
		Samples Leaking?	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N NA
		Seals OK?	<input checked="" type="checkbox"/> Y <input type="checkbox"/> N NA
		Rec'd on Ice?	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N NA
		Sample Receiving Comments: 3.2	

Lab Use Only	Sample		No. of Containers		Sample ID	X	TS & Meth	Comments
	Date	Time	Comp	Grab				
-21	9/7	14:55	2		CB-9 0-4'	X	TS & Meth	<0.1 PPM
-22		15:20	2		CB-10 0-4'	X		<0.1 PPM
-23		15:25	2		CB-10 4-8'	X		<0.1 PPM
-24		15:40	2		CB-10 8-12'	X		<0.1 PPM
-25		16:00	2		CB-11 0-4'	X		<0.1 PPM
-26		16:10	2		CB-11 4-8'	X		<0.1 PPM
-27	✓	16:20	2		CB-11 8-12'	X		<0.1 PPM
-28	7/27		1		TRIP BLANK	X	Meth	1 vial meth 7-27-10 +8034

Chain of Custody Record

Relinquished By:	Date	Time	Received By:
<i>[Signature]</i>	9/5/10	10:00	
	9/9/10	17:14	<i>[Signature]</i>

SIEMENS

September 15, 2010

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

Attn: Tony Miller

RECEIVED	
GANNETT FLEMING-MADISON, WI	
FILE NO:	34283.000
SEP 15 2010	
REVIEWED BY:	<i>djo</i>
DATE:	9/17/10
ROUTE TO:	

REPORT NO.: 1009185

PROJECT NO.: 34286.008


Please find enclosed the analytical report, including the Sample Summary, Sample Narrative and Chain of Custody for your sample set received September 10, 2010.

All analyses were performed in accordance with NELAC Standards using approved methods as indicated on this report.

If you have any questions about the results, please call. Thank you for using Siemens Water Technologies for your analytical needs.

Sincerely,

Siemens Water Technologies

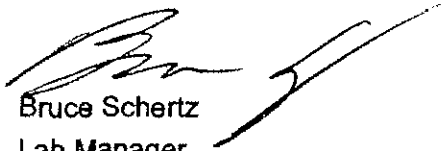
Bruce Schertz
Lab Manager

Enviroscan Analytical™ Services
Cc: Copy of report to Dave Olig

I certify that the data contained in this report has been generated and reviewed in accordance with the Siemens Water Technologies Quality Assurance Program. Exceptions, if any, are discussed in the sample narrative. Samples will be retained for 30 days from the date of this report, then disposed in an appropriate manner. Siemens Water Technologies Corp. reserves the right to return samples identified as hazardous. Release of this Final Report is authorized as verified by the following signature. The contents of this report apply to the sample(s) analyzed. No duplication of this report is allowed except in its entirety.

Reviewed by: 

Certifications:

Wisconsin 737053130
Minnesota 055-999-302
Illinois 100317



Siemens Water Technologies Corp.

301 West Military Road
Rothschild, WI 54474

Tel: 800-338-7226
Fax: 715-355-3221
www.siemens.com/enviroscan

LABORATORY'S QUALITY VERIFICATION STATEMENT

Laboratory must provide a signed copy of this form with each deliverable specified in the Work Order or the deliverable will not be accepted. Laboratory must provide Gannett Fleming with a true copy of its internal QA/QC review and approval forms related to the deliverable.

This form must be signed by the Laboratory's Quality Control/Quality Assurance Officer

Project Name:

Gannett Fleming Project Number: 34286.008

Deliverable Description: Analytical Report

I, Cindy Varga, warrant and represent that the project deliverable described above and attached to this form was developed in accordance with the project scope of work and that all elements relating to the quality of the deliverable were verified in accordance with the requirements of my firm's internal quality management/quality assurance system. This deliverable satisfies all requirements of our Contract with Gannett Fleming.

Signature: Cindy Varga
(by Laboratory's QC/QA Officer)

Date: 9/15/10

Laboratory: Siemens Water Technologies

'Deliverable' shall mean all aspects of design including, without limitation, drawings, calculations, maps, materials and specifications, reports, data bases, logs and other information developed from wells, borings and cores, laboratory data, materials schedules, instrument calibration data and all other items developed, prepared and delivered to Gannett Fleming by Contractor as specified in the Scope of Work in any media.

bw 10.2.09

SIEMENS

SAMPLE SUMMARY

<u>Lab Id</u>	<u>Client Sample Id</u>	<u>Date/Time</u>	<u>Matrix</u>
1009185-01	IB-4 0-4'	09/09/10 07:55	Soil
1009185-02	IB-4 4-8'	09/09/10 08:00	Soil
1009185-03	IB-4 8-10'	09/09/10 08:25	Soil
1009185-04	IB-4 10-11'	09/09/10 08:30	Soil
1009185-05	IB-5 0-4'	09/09/10 09:00	Soil
1009185-06	IB-5 4-8'	09/09/10 09:05	Soil
1009185-07	IB-5 8-12'	09/09/10 09:10	Soil
1009185-08	IB-5 12-16'	09/09/10 09:20	Soil
1009185-09	IB-5 26.5-28	09/09/10 09:35	Air
1009185-10	IB-6 0-4'	09/09/10 10:05	Soil
1009185-11	IB-6 4-8'	09/09/10 10:10	Soil
1009185-12	IB-6 8-12'	09/09/10 10:15	Soil
1009185-13	IB-6 12-16'	09/09/10 10:20	Soil
1009185-14	IB-6 26.5-28	09/09/10 10:35	Air
1009185-15	MeOH Blank	09/09/10 00:00	Soil

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D : 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-4 0-4'

Matrix: Soil

Sample Date/Time: 09/09/10 7:55

Lab No. : 1009185-01

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260E								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	40.6	41.6	104		09/13/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	42.6	46.8	104		09/13/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	38.5	41.6	104		09/13/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	59.3	62.4	104		09/13/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	92.6	93.6	104		09/13/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	48.9	52.0	104	S2H	09/13/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	51.0	52.0	104		09/13/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	43.7	46.8	104	S1H	09/13/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	103	104	104		09/13/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	35.4	38.4	104		09/13/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	40.6	41.6	104		09/13/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	41.6	41.6	104		09/13/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	35.4	41.6	104		09/13/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	39.5	41.6	104		09/13/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	39.5	41.6	104		09/13/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	36.4	36.4	104		09/13/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	104	104	104		09/13/10	MPM
2-Chlorotoluene	ND	ug/kg dry	39.5	41.6	104		09/13/10	MPM
4-Chlorotoluene	ND	ug/kg dry	34.3	36.7	104		09/13/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	36.4	36.4	104		09/13/10	MPM
Benzene	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
Bromobenzene	ND	ug/kg dry	36.4	36.4	104		09/13/10	MPM
Bromochloromethane	ND	ug/kg dry	38.5	41.6	104		09/13/10	MPM
Bromodichloromethane	ND	ug/kg dry	39.5	41.6	104		09/13/10	MPM
Bromoform	ND	ug/kg dry	49.9	52.0	104		09/13/10	MPM
Bromomethane	ND	ug/kg dry	104	104	104		09/13/10	MPM
Butylbenzene	ND	ug/kg dry	42.6	48.8	104		09/13/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	42.6	46.8	104		09/13/10	MPM
Chlorobenzene	ND	ug/kg dry	38.5	41.6	104		09/13/10	MPM
Chloroethane	ND	ug/kg dry	70.7	72.8	104		09/13/10	MPM
Chloroform	ND	ug/kg dry	36.4	41.6	104		09/13/10	MPM
Chloromethane	ND	ug/kg dry	36.4	36.4	104		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-4 0-4'

Matrix: Soil

Sample Date/Time: 09/09/10 7:55

Lab No. : 1009185-01

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B Continued								
cis-1,2-Dichloroethylene	ND	ug/kg dry	42.8	46.8	104		09/13/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	34.3	36.4	104		09/13/10	MPM
Dibromochloromethane	ND	ug/kg dry	34.3	36.4	104		09/13/10	MPM
Dibromomethane	ND	ug/kg dry	40.8	41.6	104		09/13/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	51.0	52.0	104		09/13/10	MPM
Ethylbenzene	ND	ug/kg dry	38.5	41.8	104		09/13/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	52.0	52.0	104		09/13/10	MPM
Isopropyl Ether	ND	ug/kg dry	74.9	78.0	104		09/13/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
m,p-Xylenes	ND	ug/kg dry	71.8	72.8	104		09/13/10	MPM
Methylene Chloride	ND	ug/kg dry	32.2	36.4	104		09/13/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	87.4	93.6	104		09/13/10	MPM
Naphthalene	ND	ug/kg dry	44.7	46.8	104	S1L, S2L, DUP	09/13/10	MPM
o-Xylene	ND	ug/kg dry	52.0	52.0	104		09/13/10	MPM
Propylbenzene	ND	ug/kg dry	37.4	41.8	104		09/13/10	MPM
sec-Butylbenzene	ND	ug/kg dry	41.6	41.8	104		09/13/10	MPM
Styrene	ND	ug/kg dry	36.4	41.6	104		09/13/10	MPM
tert-Butylbenzene	ND	ug/kg dry	38.5	41.8	104		09/13/10	MPM
Tetrachloroethene	ND	ug/kg dry	46.8	46.8	104		09/13/10	MPM
Toluene	ND	ug/kg dry	42.8	46.8	104		09/13/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	46.8	46.8	104		09/13/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	35.4	36.4	104		09/13/10	MPM
Trichloroethene	ND	ug/kg dry	38.5	41.6	104		09/13/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	49.9	52.0	104		09/13/10	MPM
Vinyl chloride	ND	ug/kg dry	47.8	52.0	104		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-4 4-8'

Matrix: Soil

Sample Date/Time: 09/09/10 8:00

Lab No. : 1009185-02

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8280B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	40.6	41.6	104		09/13/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	42.6	46.8	104		09/13/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	38.5	41.6	104		09/13/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	59.3	62.4	104		09/13/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	92.6	93.6	104		09/13/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	48.9	52.0	104		09/13/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	51.0	52.0	104		09/13/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	43.7	46.8	104		09/13/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	103	104	104		09/13/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	35.4	36.4	104		09/13/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	40.6	41.6	104		09/13/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	41.6	41.6	104		09/13/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	35.4	41.6	104		09/13/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	39.5	41.6	104		09/13/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	39.5	41.6	104		09/13/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	38.4	38.4	104		09/13/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	104	104	104		09/13/10	MPM
2-Chlorotoluene	ND	ug/kg dry	39.5	41.6	104		09/13/10	MPM
4-Chlorotoluene	ND	ug/kg dry	34.3	36.7	104		09/13/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	36.4	36.4	104		09/13/10	MPM
Benzene	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
Bromobenzene	ND	ug/kg dry	38.4	38.4	104		09/13/10	MPM
Bromochloromethane	ND	ug/kg dry	38.5	41.6	104		09/13/10	MPM
Bromodichloromethane	ND	ug/kg dry	39.5	41.6	104		09/13/10	MPM
Bromoform	ND	ug/kg dry	49.9	52.0	104		09/13/10	MPM
Bromomethane	ND	ug/kg dry	104	104	104		09/13/10	MPM
Butylbenzene	ND	ug/kg dry	42.6	46.8	104		09/13/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	42.6	46.8	104		09/13/10	MPM
Chlorobenzene	ND	ug/kg dry	38.5	41.6	104		09/13/10	MPM
Chloroethane	ND	ug/kg dry	70.7	72.8	104		09/13/10	MPM
Chloroform	ND	ug/kg dry	36.4	41.6	104		09/13/10	MPM
Chloromethane	ND	ug/kg dry	36.4	36.4	104		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Millier

Sample ID: IB-4 4-8'

Matrix: Soil

Sample Date/Time: 09/09/10 8:00

Lab No. : 1009185-02

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	42.6	46.8	104		09/13/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	34.3	36.4	104		09/13/10	MPM
Dibromochloromethane	ND	ug/kg dry	34.3	36.4	104		09/13/10	MPM
Dibromomethane	ND	ug/kg dry	40.8	41.6	104		09/13/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	51.0	52.0	104		09/13/10	MPM
Ethylbenzene	ND	ug/kg dry	38.5	41.6	104		09/13/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	52.0	52.0	104		09/13/10	MPM
Isopropyl Ether	ND	ug/kg dry	74.9	78.0	104		09/13/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
m,p-Xylenes	ND	ug/kg dry	71.8	72.8	104		09/13/10	MPM
Methylene Chloride	43.2	ug/kg dry	32.2	36.4	104		09/13/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	87.4	93.6	104		09/13/10	MPM
Naphthalene	ND	ug/kg dry	44.7	46.8	104		09/13/10	MPM
o-Xylene	ND	ug/kg dry	52.0	52.0	104		09/13/10	MPM
Propylbenzene	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
sec-Butylbenzene	ND	ug/kg dry	41.6	41.6	104		09/13/10	MPM
Styrene	ND	ug/kg dry	36.4	41.6	104		09/13/10	MPM
tert-Butylbenzene	ND	ug/kg dry	38.5	41.6	104		09/13/10	MPM
Tetrachloroethene	ND	ug/kg dry	46.8	46.8	104		09/13/10	MPM
Toluene	ND	ug/kg dry	42.6	46.8	104		09/13/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	46.8	46.8	104		09/13/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	35.4	36.4	104		09/13/10	MPM
Trichloroethene	ND	ug/kg dry	38.5	41.6	104		09/13/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	49.9	52.0	104		09/13/10	MPM
Vinyl chloride	ND	ug/kg dry	47.8	52.0	104		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-4 8-10' Matrix: Soil Sample Date/Time: 09/09/10 8:25 Lab No. : 1009185-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	41.0	42.0	105		09/13/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	43.0	47.2	105		09/13/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	38.8	42.0	105		09/13/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	59.8	63.0	105		09/13/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	93.4	94.5	105		09/13/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	49.4	52.5	105		09/13/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	51.4	52.5	105		09/13/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	44.1	47.2	105		09/13/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	104	105	105		09/13/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	35.7	36.8	105		09/13/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	41.0	42.0	105		09/13/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	42.0	42.0	105		09/13/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	35.7	42.0	105		09/13/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	39.9	42.0	105		09/13/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	39.9	42.0	105		09/13/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	36.8	36.8	105		09/13/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	105	105	105		09/13/10	MPM
2-Chlorotoluene	ND	ug/kg dry	39.9	42.0	105		09/13/10	MPM
4-Chlorotoluene	ND	ug/kg dry	34.6	37.1	105		09/13/10	MPM
4-isopropyltoluene	ND	ug/kg dry	36.8	36.8	105		09/13/10	MPM
Benzene	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
Bromobenzene	ND	ug/kg dry	36.8	36.8	105		09/13/10	MPM
Bromochloromethane	ND	ug/kg dry	36.8	42.0	105		09/13/10	MPM
Bromodichloromethane	ND	ug/kg dry	39.9	42.0	105		09/13/10	MPM
Bromoform	ND	ug/kg dry	50.4	52.5	105		09/13/10	MPM
Bromomethane	ND	ug/kg dry	105	105	105		09/13/10	MPM
Butylbenzene	ND	ug/kg dry	43.0	47.2	105		09/13/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	43.0	47.2	105		09/13/10	MPM
Chlorobenzene	ND	ug/kg dry	38.8	42.0	105		09/13/10	MPM
Chloroethane	ND	ug/kg dry	71.4	73.5	105		09/13/10	MPM
Chloroform	ND	ug/kg dry	36.8	42.0	105		09/13/10	MPM
Chloromethane	ND	ug/kg dry	36.8	36.8	105		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-4 8-10'

Matrix: Soil

Sample Date/Time: 09/09/10 8:25

Lab No. : 1009185-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u>	<u>Analyst</u>
							<u>Analyzed</u>	
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	43.0	47.2	105		09/13/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	34.8	36.8	105		09/13/10	MPM
Dibromochloromethane	ND	ug/kg dry	34.6	36.8	105		09/13/10	MPM
Dibromomethane	ND	ug/kg dry	41.0	42.0	105		09/13/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	51.4	52.5	105		09/13/10	MPM
Ethylbenzene	ND	ug/kg dry	36.8	42.0	105		09/13/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	52.5	52.5	105		09/13/10	MPM
isopropyl Ether	ND	ug/kg dry	75.6	78.8	105		09/13/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
m,p-Xylenes	ND	ug/kg dry	72.4	73.5	105		09/13/10	MPM
Methylene Chloride	ND	ug/kg dry	32.6	36.8	105		09/13/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	88.2	94.5	105		09/13/10	MPM
Naphthalene	ND	ug/kg dry	45.2	47.2	105		09/13/10	MPM
o-Xylene	ND	ug/kg dry	52.5	52.5	105		09/13/10	MPM
Propylbenzene	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
sec-Butylbenzene	ND	ug/kg dry	42.0	42.0	105		09/13/10	MPM
Styrene	ND	ug/kg dry	36.8	42.0	105		09/13/10	MPM
tert-Butylbenzene	ND	ug/kg dry	36.8	42.0	105		09/13/10	MPM
Tetrachloroethene	ND	ug/kg dry	47.2	47.2	105		09/13/10	MPM
Toluene	ND	ug/kg dry	43.0	47.2	105		09/13/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	47.2	47.2	105		09/13/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	35.7	38.8	105		09/13/10	MPM
Trichloroethene	ND	ug/kg dry	36.8	42.0	105		09/13/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	50.4	52.5	105		09/13/10	MPM
Vinyl chloride	ND	ug/kg dry	48.3	52.5	105		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-4 10-11'

Matrix: Soil

Sample Date/Time: 09/09/10 8:30

Lab No. : 1009185-04

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u>	<u>Analyst</u>
							<u>Analyzed</u>	
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	38.2	42.4	106		09/13/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	41.3	42.4	106		09/13/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	38.2	42.4	106		09/13/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	43.5	47.7	106		09/13/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	39.2	42.4	106		09/13/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	60.4	63.6	106		09/13/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	94.3	95.4	106		09/13/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	49.8	53.0	106		09/13/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	51.9	53.0	108		09/13/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	44.5	47.7	106		09/13/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	38.2	42.4	108		09/13/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	105	106	106		09/13/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	36.0	37.1	106		09/13/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	41.3	42.4	106		09/13/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	42.4	42.4	106		09/13/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	36.0	42.4	106		09/13/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	38.2	42.4	106		09/13/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	40.3	42.4	106		09/13/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	40.3	42.4	106		09/13/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	37.1	37.1	106		09/13/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	106	106	106		09/13/10	MPM
2-Chlorotoluene	ND	ug/kg dry	40.3	42.4	106		09/13/10	MPM
4-Chlorotoluene	ND	ug/kg dry	35.0	37.4	106		09/13/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	37.1	37.1	106		09/13/10	MPM
Benzene	ND	ug/kg dry	38.2	42.4	106		09/13/10	MPM
Bromobenzene	ND	ug/kg dry	37.1	37.1	106		09/13/10	MPM
Bromochloromethane	ND	ug/kg dry	39.2	42.4	106		09/13/10	MPM
Bromodichloromethane	ND	ug/kg dry	40.3	42.4	106		09/13/10	MPM
Bromoform	ND	ug/kg dry	50.9	53.0	106		09/13/10	MPM
Bromomethane	ND	ug/kg dry	106	106	106		09/13/10	MPM
Butylbenzene	ND	ug/kg dry	43.5	47.7	106		09/13/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	43.5	47.7	106		09/13/10	MPM
Chlorobenzene	ND	ug/kg dry	39.2	42.4	106		09/13/10	MPM
Chloroethane	ND	ug/kg dry	72.1	74.2	106		09/13/10	MPM
Chloroform	ND	ug/kg dry	37.1	42.4	106		09/13/10	MPM
Chloromethane	ND	ug/kg dry	37.1	37.1	106		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-4 10-11'

Matrix: Soil

Sample Date/Time: 09/09/10 8:30

Lab No. : 1009185-04

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B Continued								
cis-1,2-Dichloroethylene	ND	ug/kg dry	43.5	47.7	106		09/13/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	35.0	37.1	106		09/13/10	MPM
Dibromochloromethane	ND	ug/kg dry	35.0	37.1	106		09/13/10	MPM
Dibromomethane	ND	ug/kg dry	41.3	42.4	106		09/13/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	51.9	53.0	106		09/13/10	MPM
Ethylbenzene	ND	ug/kg dry	39.2	42.4	106		09/13/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	53.0	53.0	106		09/13/10	MPM
Isopropyl Ether	ND	ug/kg dry	76.3	79.5	106		09/13/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	38.2	42.4	106		09/13/10	MPM
m,p-Xylenes	ND	ug/kg dry	73.1	74.2	106		09/13/10	MPM
Methylene Chloride	46.9	ug/kg dry	32.9	37.1	106		09/13/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	89.0	95.4	106		09/13/10	MPM
Naphthalene	ND	ug/kg dry	45.6	47.7	106		09/13/10	MPM
o-Xylene	ND	ug/kg dry	53.0	53.0	106		09/13/10	MPM
Propylbenzene	ND	ug/kg dry	38.2	42.4	106		09/13/10	MPM
sec-Butylbenzene	ND	ug/kg dry	42.4	42.4	106		09/13/10	MPM
Styrene	ND	ug/kg dry	37.1	42.4	106		09/13/10	MPM
tert-Butylbenzene	ND	ug/kg dry	39.2	42.4	106		09/13/10	MPM
Tetrachloroethene	ND	ug/kg dry	47.7	47.7	106		09/13/10	MPM
Toluene	ND	ug/kg dry	43.5	47.7	106		09/13/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	47.7	47.7	106		09/13/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	36.0	37.1	106		09/13/10	MPM
Trichloroethene	ND	ug/kg dry	39.2	42.4	106		09/13/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	50.9	53.0	106		09/13/10	MPM
Vinyl chloride	ND	ug/kg dry	48.6	53.0	106		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-5 0-4'

Matrix: Soil

Sample Date/Time: 09/09/10 9:00

Lab No. : 1009185-05

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	38.2	42.4	106		09/13/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	41.3	42.4	106		09/13/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	38.2	42.4	106		09/13/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	43.5	47.7	106		09/13/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	39.2	42.4	106		09/13/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	60.4	63.6	106		09/13/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	94.3	95.4	106		09/13/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	49.8	53.0	106		09/13/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	51.9	53.0	106		09/13/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	44.5	47.7	106		09/13/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	38.2	42.4	106		09/13/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	105	106	106		09/13/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	38.0	37.1	106		09/13/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	41.3	42.4	106		09/13/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	42.4	42.4	106		09/13/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	38.0	42.4	106		09/13/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	38.2	42.4	106		09/13/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	40.3	42.4	106		09/13/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	40.3	42.4	106		09/13/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	37.1	37.1	106		09/13/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	106	106	106		09/13/10	MPM
2-Chlorotoluene	ND	ug/kg dry	40.3	42.4	106		09/13/10	MPM
4-Chlorotoluene	ND	ug/kg dry	35.0	37.4	106		09/13/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	37.1	37.1	106		09/13/10	MPM
Benzene	ND	ug/kg dry	38.2	42.4	106		09/13/10	MPM
Bromobenzene	ND	ug/kg dry	37.1	37.1	106		09/13/10	MPM
Bromochloromethane	ND	ug/kg dry	39.2	42.4	106		09/13/10	MPM
Bromodichloromethane	ND	ug/kg dry	40.3	42.4	106		09/13/10	MPM
Bromoform	ND	ug/kg dry	50.9	53.0	106		09/13/10	MPM
Bromomethane	ND	ug/kg dry	106	106	106		09/13/10	MPM
Butylbenzene	ND	ug/kg dry	43.5	47.7	106		09/13/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	43.5	47.7	106		09/13/10	MPM
Chlorobenzene	ND	ug/kg dry	39.2	42.4	106		09/13/10	MPM
Chloroethane	ND	ug/kg dry	72.1	74.2	106		09/13/10	MPM
Chloroform	ND	ug/kg dry	37.1	42.4	106		09/13/10	MPM
Chloromethane	ND	ug/kg dry	37.1	37.1	106		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D : 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-5 0-4'

Matrix: Soil

Sample Date/Time: 09/09/10 9:00

Lab No. : 1009186-05

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u>	<u>Analyst</u>
							<u>Analyzed</u>	
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	43.5	47.7	106		09/13/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	35.0	37.1	106		09/13/10	MPM
Dibromochloromethane	ND	ug/kg dry	35.0	37.1	106		09/13/10	MPM
Dibromomethane	ND	ug/kg dry	41.3	42.4	106		09/13/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	51.9	53.0	106		09/13/10	MPM
Ethylbenzene	ND	ug/kg dry	39.2	42.4	106		09/13/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	53.0	53.0	106		09/13/10	MPM
Isopropyl Ether	ND	ug/kg dry	76.3	79.5	106		09/13/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	38.2	42.4	106		09/13/10	MPM
m,p-Xylenes	ND	ug/kg dry	73.1	74.2	106		09/13/10	MPM
Methylene Chloride	38.5	ug/kg dry	32.9	37.1	106		09/13/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	89.0	95.4	106		09/13/10	MPM
Naphthalene	ND	ug/kg dry	45.6	47.7	106		09/13/10	MPM
o-Xylene	ND	ug/kg dry	53.0	53.0	106		09/13/10	MPM
Propylbenzene	ND	ug/kg dry	38.2	42.4	106		09/13/10	MPM
sec-Butylbenzene	ND	ug/kg dry	42.4	42.4	106		09/13/10	MPM
Styrene	ND	ug/kg dry	37.1	42.4	106		09/13/10	MPM
tert-Butylbenzene	ND	ug/kg dry	39.2	42.4	106		09/13/10	MPM
Tetrachloroethene	ND	ug/kg dry	47.7	47.7	106		09/13/10	MPM
Toluene	ND	ug/kg dry	43.5	47.7	106		09/13/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	47.7	47.7	106		09/13/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	36.0	37.1	106		09/13/10	MPM
Trichloroethene	ND	ug/kg dry	39.2	42.4	106		09/13/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	50.9	53.0	106		09/13/10	MPM
Vinyl chloride	ND	ug/kg dry	48.6	53.0	106		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D : 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-5 4-8'

Matrix: Soil

Sample Date/Time: 09/09/10 9:05

Lab No. : 1009185-06

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	36.7	40.8	102		09/13/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	39.8	40.8	102		09/13/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	36.7	40.8	102		09/13/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	41.8	45.9	102		09/13/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	37.7	40.8	102		09/13/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	58.1	61.2	102		09/13/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	90.8	91.8	102		09/13/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	47.9	51.0	102		09/13/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	50.0	51.0	102		09/13/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	42.8	45.9	102		09/13/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	36.7	40.8	102		09/13/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	101	102	102		09/13/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	34.7	35.7	102		09/13/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	38.8	40.8	102		09/13/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	40.8	40.8	102		09/13/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	34.7	40.8	102		09/13/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	36.7	40.8	102		09/13/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	38.8	40.8	102		09/13/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	38.8	40.8	102		09/13/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	35.7	35.7	102		09/13/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	102	102	102		09/13/10	MPM
2-Chlorotoluene	ND	ug/kg dry	38.8	40.8	102		09/13/10	MPM
4-Chlorotoluene	ND	ug/kg dry	33.7	38.0	102		09/13/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	35.7	35.7	102		09/13/10	MPM
Benzene	ND	ug/kg dry	36.7	40.8	102		09/13/10	MPM
Bromobenzene	ND	ug/kg dry	35.7	35.7	102		09/13/10	MPM
Bromochloromethane	ND	ug/kg dry	37.7	40.8	102		09/13/10	MPM
Bromodichloromethane	ND	ug/kg dry	38.8	40.8	102		09/13/10	MPM
Bromoform	ND	ug/kg dry	49.0	51.0	102		09/13/10	MPM
Bromomethane	ND	ug/kg dry	102	102	102		09/13/10	MPM
Butylbenzene	ND	ug/kg dry	41.8	45.9	102		09/13/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	41.8	45.9	102		09/13/10	MPM
Chlorobenzene	ND	ug/kg dry	37.7	40.8	102		09/13/10	MPM
Chloroethane	ND	ug/kg dry	69.4	71.4	102		09/13/10	MPM
Chloroform	ND	ug/kg dry	35.7	40.8	102		09/13/10	MPM
Chloromethane	ND	ug/kg dry	35.7	35.7	102		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-5 4-8'

Matrix: Soil

Sample Date/Time: 09/09/10 9:05

Lab No. : 1009185-06

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	41.8	45.9	102		09/13/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	33.7	35.7	102		09/13/10	MPM
Dibromochloromethane	ND	ug/kg dry	33.7	35.7	102		09/13/10	MPM
Dibromomethane	ND	ug/kg dry	39.8	40.8	102		09/13/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	50.0	51.0	102		09/13/10	MPM
Ethylbenzene	ND	ug/kg dry	37.7	40.8	102		09/13/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	51.0	51.0	102		09/13/10	MPM
Isopropyl Ether	ND	ug/kg dry	73.4	76.5	102		09/13/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	36.7	40.8	102		09/13/10	MPM
m,p-Xylenes	ND	ug/kg dry	70.4	71.4	102		09/13/10	MPM
Methylene Chloride	ND	ug/kg dry	31.6	35.7	102		09/13/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	85.7	91.8	102		09/13/10	MPM
Naphthalene	ND	ug/kg dry	43.9	45.9	102		09/13/10	MPM
o-Xylene	ND	ug/kg dry	51.0	51.0	102		09/13/10	MPM
Propylbenzene	ND	ug/kg dry	36.7	40.8	102		09/13/10	MPM
sec-Butylbenzene	ND	ug/kg dry	40.8	40.8	102		09/13/10	MPM
Styrene	ND	ug/kg dry	35.7	40.8	102		09/13/10	MPM
tert-Butylbenzene	ND	ug/kg dry	37.7	40.8	102		09/13/10	MPM
Tetrachloroethene	ND	ug/kg dry	45.9	45.9	102		09/13/10	MPM
Toluene	ND	ug/kg dry	41.8	45.9	102		09/13/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	45.9	45.9	102		09/13/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	34.7	35.7	102		09/13/10	MPM
Trichloroethene	ND	ug/kg dry	37.7	40.8	102		09/13/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	49.0	51.0	102		09/13/10	MPM
Vinyl chloride	ND	ug/kg dry	46.9	51.0	102		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-5 8-12'

Matrix: Soil

Sample Date/Time: 09/09/10 9:10

Lab No. : 1009185-07

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	40.6	41.6	104		09/13/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	42.6	46.8	104		09/13/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	38.5	41.6	104		09/13/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	59.3	62.4	104		09/13/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	92.6	93.6	104		09/13/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	48.9	52.0	104		09/13/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	51.0	52.0	104		09/13/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	43.7	46.8	104		09/13/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	103	104	104		09/13/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	35.4	36.4	104		09/13/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	40.6	41.6	104		09/13/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	41.6	41.6	104		09/13/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	35.4	41.6	104		09/13/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	39.5	41.6	104		09/13/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	39.5	41.8	104		09/13/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	36.4	36.4	104		09/13/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	104	104	104		09/13/10	MPM
2-Chlorotoluene	ND	ug/kg dry	39.5	41.6	104		09/13/10	MPM
4-Chlorotoluene	ND	ug/kg dry	34.3	36.7	104		09/13/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	38.4	36.4	104		09/13/10	MPM
Benzene	ND	ug/kg dry	37.4	41.6	104		09/13/10	MPM
Bromobenzene	ND	ug/kg dry	36.4	36.4	104		09/13/10	MPM
Bromochloromethane	ND	ug/kg dry	38.5	41.6	104		09/13/10	MPM
Bromodichloromethane	ND	ug/kg dry	39.5	41.6	104		09/13/10	MPM
Bromoform	ND	ug/kg dry	49.9	52.0	104		09/13/10	MPM
Bromomethane	ND	ug/kg dry	104	104	104		09/13/10	MPM
Butylbenzene	ND	ug/kg dry	42.6	46.8	104		09/13/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	42.6	46.8	104		09/13/10	MPM
Chlorobenzene	ND	ug/kg dry	38.5	41.6	104		09/13/10	MPM
Chloroethane	ND	ug/kg dry	70.7	72.8	104		09/13/10	MPM
Chloroform	ND	ug/kg dry	36.4	41.6	104		09/13/10	MPM
Chloromethane	ND	ug/kg dry	36.4	36.4	104		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-5 8-12'

Matrix: Soil

Sample Date/Time: 09/09/10 9:10

Lab No. : 1009185-07

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B Continued								
cis-1,2-Dichloroethylene	ND	ug/kg dry	42.8	46.8	104		09/13/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	34.3	36.4	104		09/13/10	MPM
Dibromochloromethane	ND	ug/kg dry	34.3	36.4	104		09/13/10	MPM
Dibromomethane	ND	ug/kg dry	40.6	41.8	104		09/13/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	51.0	52.0	104		09/13/10	MPM
Ethylbenzene	ND	ug/kg dry	38.5	41.8	104		09/13/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	52.0	52.0	104		09/13/10	MPM
Isopropyl Ether	ND	ug/kg dry	74.9	78.0	104		09/13/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	37.4	41.8	104		09/13/10	MPM
m,p-Xylenes	ND	ug/kg dry	71.8	72.8	104		09/13/10	MPM
Methylene Chloride	ND	ug/kg dry	32.2	36.4	104		09/13/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	67.4	93.8	104		09/13/10	MPM
Naphthalene	ND	ug/kg dry	44.7	46.8	104		09/13/10	MPM
o-Xylene	ND	ug/kg dry	52.0	52.0	104		09/13/10	MPM
Propylbenzene	ND	ug/kg dry	37.4	41.8	104		09/13/10	MPM
sec-Butylbenzene	ND	ug/kg dry	41.6	41.6	104		09/13/10	MPM
Styrene	ND	ug/kg dry	36.4	41.8	104		09/13/10	MPM
tert-Butylbenzene	ND	ug/kg dry	36.5	41.8	104		09/13/10	MPM
Tetrachloroethene	ND	ug/kg dry	46.8	46.8	104		09/13/10	MPM
Toluene	ND	ug/kg dry	42.8	46.8	104		09/13/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	46.8	46.8	104		09/13/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	35.4	36.4	104		09/13/10	MPM
Trichloroethene	ND	ug/kg dry	36.5	41.8	104		09/13/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	49.9	52.0	104		09/13/10	MPM
Vinyl chloride	ND	ug/kg dry	47.8	52.0	104		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-5 12-16'

Matrix: Soil

Sample Date/Time: 09/09/10 9:20

Lab No. : 1009185-08

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date</u>	<u>Analyst</u>
							<u>Analyzed</u>	
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	38.9	43.2	108		09/13/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	42.1	43.2	108		09/13/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	38.9	43.2	108		09/13/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	44.3	48.8	108		09/13/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	40.0	43.2	108		09/13/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	61.6	64.8	108		09/13/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	96.1	97.2	108		09/13/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	50.8	54.0	108		09/13/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	52.9	54.0	108		09/13/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	45.4	48.8	108		09/13/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	38.9	43.2	108		09/13/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	107	108	108		09/13/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	36.7	37.8	108		09/13/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	42.1	43.2	108		09/13/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	43.2	43.2	108		09/13/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	38.7	43.2	108		09/13/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	38.9	43.2	108		09/13/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	41.0	43.2	108		09/13/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	41.0	43.2	108		09/13/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	37.8	37.8	108		09/13/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	108	108	108		09/13/10	MPM
2-Chlorotoluene	ND	ug/kg dry	41.0	43.2	108		09/13/10	MPM
4-Chlorotoluene	ND	ug/kg dry	35.6	38.1	108		09/13/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	37.8	37.8	108		09/13/10	MPM
Benzene	ND	ug/kg dry	38.9	43.2	108		09/13/10	MPM
Bromobenzene	ND	ug/kg dry	37.8	37.8	108		09/13/10	MPM
Bromochloromethane	ND	ug/kg dry	40.0	43.2	108		09/13/10	MPM
Bromodichloromethane	ND	ug/kg dry	41.0	43.2	108		09/13/10	MPM
Bromoform	ND	ug/kg dry	51.8	54.0	108		09/13/10	MPM
Bromomethane	ND	ug/kg dry	108	108	108		09/13/10	MPM
Butylbenzene	ND	ug/kg dry	44.3	48.6	108		09/13/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	44.3	48.6	108		09/13/10	MPM
Chlorobenzene	ND	ug/kg dry	40.0	43.2	108		09/13/10	MPM
Chloroethane	ND	ug/kg dry	73.4	75.6	108		09/13/10	MPM
Chloroform	ND	ug/kg dry	37.8	43.2	108		09/13/10	MPM
Chloromethane	ND	ug/kg dry	37.8	37.8	108		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-5 12-16'

Matrix: Soil

Sample Date/Time: 09/09/10 9:20

Lab No. : 1009185-08

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	44.3	48.6	108		09/13/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	35.6	37.8	108		09/13/10	MPM
Dibromochloromethane	ND	ug/kg dry	35.8	37.8	108		09/13/10	MPM
Dibromomethane	ND	ug/kg dry	42.1	43.2	108		09/13/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	52.9	54.0	108		09/13/10	MPM
Ethylbenzene	ND	ug/kg dry	40.0	43.2	108		09/13/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	54.0	54.0	108		09/13/10	MPM
Isopropyl Ether	ND	ug/kg dry	77.8	81.0	108		09/13/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	38.9	43.2	108		09/13/10	MPM
m,p-Xylenes	ND	ug/kg dry	74.5	75.6	108		09/13/10	MPM
Methylene Chloride	ND	ug/kg dry	33.5	37.8	108		09/13/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	90.7	97.2	108		09/13/10	MPM
Naphthalene	ND	ug/kg dry	46.4	48.6	108		09/13/10	MPM
o-Xylene	ND	ug/kg dry	54.0	54.0	108		09/13/10	MPM
Propylbenzene	ND	ug/kg dry	38.9	43.2	108		09/13/10	MPM
sec-Butylbenzene	ND	ug/kg dry	43.2	43.2	108		09/13/10	MPM
Styrene	ND	ug/kg dry	37.8	43.2	108		09/13/10	MPM
tert-Butylbenzene	ND	ug/kg dry	40.0	43.2	108		09/13/10	MPM
Tetrachloroethene	ND	ug/kg dry	48.8	48.8	108		09/13/10	MPM
Toluene	ND	ug/kg dry	44.3	48.8	108		09/13/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	48.8	48.8	108		09/13/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	36.7	37.8	108		09/13/10	MPM
Trichloroethene	ND	ug/kg dry	40.0	43.2	108		09/13/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	51.8	54.0	108		09/13/10	MPM
Vinyl chloride	ND	ug/kg dry	49.7	54.0	108		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D : 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-5 26.5-28

Matrix: Air

Sample Date/Time: 09/09/10 9:35

Lab No. : 1009185-09

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u>		<u>Analyst</u>
							<u>Analyzed</u>		
EPA 8260B									
1,1,1,2-Tetrachloroethane	ND	ug/L	1.50	5.00	5		09/10/10	9:57	MRD
1,1,1-Trichloroethane	ND	ug/L	2.50	8.50	5		09/10/10	9:57	MRD
1,1,2,2-Tetrachloroethane	ND	ug/L	2.00	6.50	5		09/10/10	9:57	MRD
1,1,2-Trichloroethane	ND	ug/L	2.00	6.50	5		09/10/10	9:57	MRD
1,1-Dichloroethane	ND	ug/L	2.00	6.50	5		09/10/10	9:57	MRD
1,1-Dichloroethylene	ND	ug/L	2.00	6.50	5		09/10/10	9:57	MRD
1,1-Dichloropropylene	ND	ug/L	4.00	13.5	5		09/10/10	9:57	MRD
1,2,3-Trichlorobenzene	ND	ug/L	2.50	8.50	5		09/10/10	9:57	MRD
1,2,3-Trichloropropane	ND	ug/L	5.00	16.5	5		09/10/10	9:57	MRD
1,2,4-Trichlorobenzene	ND	ug/L	2.50	8.50	5		09/10/10	9:57	MRD
1,2,4-Trimethylbenzene	ND	ug/L	1.00	3.35	5		09/10/10	9:57	MRD
1,2-Dibromo-3-chloropropane	ND	ug/L	6.50	21.5	5		09/10/10	9:57	MRD
1,2-Dibromoethane	ND	ug/L	1.50	5.00	5		09/10/10	9:57	MRD
1,2-Dichlorobenzene	ND	ug/L	4.00	13.5	5		09/10/10	9:57	MRD
1,2-Dichloroethane	ND	ug/L	1.50	5.00	5		09/10/10	9:57	MRD
1,2-Dichloropropane	ND	ug/L	2.00	6.50	5		09/10/10	9:57	MRD
1,3,5-Trimethylbenzene	ND	ug/L	1.00	3.35	5		09/10/10	9:57	MRD
1,3-Dichlorobenzene	ND	ug/L	1.00	3.35	5		09/10/10	9:57	MRD
1,3-Dichloropropane	ND	ug/L	1.00	3.35	5		09/10/10	9:57	MRD
1,4-Dichlorobenzene	ND	ug/L	4.00	13.5	5		09/10/10	9:57	MRD
2,2-Dichloropropane	ND	ug/L	5.00	16.5	5		09/10/10	9:57	MRD
2-Chlorotoluene	ND	ug/L	1.50	5.00	5		09/10/10	9:57	MRD
4-Chlorotoluene	ND	ug/L	1.50	5.00	5		09/10/10	9:57	MRD
4-Isopropyltoluene	ND	ug/L	2.00	6.65	5		09/10/10	9:57	MRD
Benzene	ND	ug/L	1.00	3.35	5		09/10/10	9:57	MRD
Bromobenzene	ND	ug/L	1.50	5.00	5		09/10/10	9:57	MRD
Bromochloromethane	ND	ug/L	2.00	6.50	5		09/10/10	9:57	MRD
Bromodichloromethane	ND	ug/L	2.00	6.50	5		09/10/10	9:57	MRD
Bromoform	ND	ug/L	1.00	3.35	5		09/10/10	9:57	MRD
Bromomethane	ND	ug/L	5.00	16.5	5		09/10/10	9:57	MRD
Butylbenzene	ND	ug/L	2.00	6.50	5		09/10/10	9:57	MRD
Carbon Tetrachloride	ND	ug/L	1.50	5.00	5		09/10/10	9:57	MRD
Chlorobenzene	ND	ug/L	1.00	3.35	5		09/10/10	9:57	MRD
Chloroethane	ND	ug/L	3.50	11.5	5		09/10/10	9:57	MRD
Chloroform	ND	ug/L	1.00	3.35	5		09/10/10	9:57	MRD
Chloromethane	ND	ug/L	2.00	6.50	5		09/10/10	9:57	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D : 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-5 26.5-28

Matrix: Air

Sample Date/Time: 09/09/10 9:35

Lab No. : 1009185-09

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u>		<u>Analyst</u>
							<u>Analyzed</u>		
EPA 8260B Continued									
cis-1,2-Dichloroethylene	ND	ug/L	2.00	6.50	5		09/10/10	9:57	MRD
cis-1,3-Dichloropropylene	ND	ug/L	1.00	3.35	5		09/10/10	9:57	MRD
Dibromochloromethane	ND	ug/L	2.00	6.50	5		09/10/10	9:57	MRD
Dibromomethane	ND	ug/L	2.00	6.50	5		09/10/10	9:57	MRD
Dichlorodifluoromethane	ND	ug/L	1.50	5.00	5		09/10/10	9:57	MRD
Ethylbenzene	ND	ug/L	1.00	3.35	5		09/10/10	9:57	MRD
Hexachlorobutadiene	ND	ug/L	5.00	16.5	5		09/10/10	9:57	MRD
Isopropylbenzene (Cumene)	ND	ug/L	1.00	3.35	5		09/10/10	9:57	MRD
m,p-Xylenes	ND	ug/L	2.00	6.50	5		09/10/10	9:57	MRD
Methylene Chloride	ND	ug/L	2.00	6.50	5		09/10/10	9:57	MRD
Methyl-tert-Butyl Ether	ND	ug/L	2.50	8.50	5		09/10/10	9:57	MRD
Naphthalene	ND	ug/L	5.00	16.5	5		09/10/10	9:57	MRD
o-Xylene	ND	ug/L	1.00	3.35	5		09/10/10	9:57	MRD
Propylbenzene	ND	ug/L	1.00	3.35	5		09/10/10	9:57	MRD
sec-Butylbenzene	ND	ug/L	1.50	5.00	5		09/10/10	9:57	MRD
Styrene	ND	ug/L	0.50	2.50	5		09/10/10	9:57	MRD
tert-Butylbenzene	ND	ug/L	1.50	5.00	5		09/10/10	9:57	MRD
Tetrachloroethene	ND	ug/L	1.50	5.00	5		09/10/10	9:57	MRD
Toluene	ND	ug/L	2.00	6.50	5		09/10/10	9:57	MRD
trans-1,2-Dichloroethylene	ND	ug/L	2.50	6.50	5		09/10/10	9:57	MRD
trans-1,3-Dichloropropylene	ND	ug/L	2.00	6.50	5		09/10/10	9:57	MRD
Trichloroethene	ND	ug/L	2.00	6.50	5		09/10/10	9:57	MRD
Trichlorofluoromethane	ND	ug/L	1.50	5.00	5		09/10/10	9:57	MRD
Vinyl chloride	ND	ug/L	1.00	3.35	5		09/10/10	9:57	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-6 0-4'

Matrix: Soil

Sample Date/Time: 09/09/10 10:05

Lab No. : 1009185-10

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	41.0	42.0	105		09/13/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	43.0	47.2	105		09/13/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	38.8	42.0	105		09/13/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	59.8	63.0	105		09/13/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	93.4	94.5	105		09/13/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	49.4	52.5	105		09/13/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	51.4	52.5	105		09/13/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	44.1	47.2	105		09/13/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	104	105	105		09/13/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	35.7	36.8	105		09/13/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	41.0	42.0	105		09/13/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	42.0	42.0	105		09/13/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	35.7	42.0	105		09/13/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	39.9	42.0	105		09/13/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	39.9	42.0	105		09/13/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	38.8	38.8	105		09/13/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	105	105	105		09/13/10	MPM
2-Chlorotoluene	ND	ug/kg dry	39.9	42.0	105		09/13/10	MPM
4-Chlorotoluene	ND	ug/kg dry	34.6	37.1	105		09/13/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	36.8	36.8	105		09/13/10	MPM
Benzene	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
Bromobenzene	ND	ug/kg dry	36.8	36.8	105		09/13/10	MPM
Bromochloromethane	ND	ug/kg dry	38.8	42.0	105		09/13/10	MPM
Bromodichloromethane	ND	ug/kg dry	39.9	42.0	105		09/13/10	MPM
Bromoform	ND	ug/kg dry	50.4	52.5	105		09/13/10	MPM
Bromomethane	ND	ug/kg dry	105	105	105		09/13/10	MPM
Butylbenzene	ND	ug/kg dry	43.0	47.2	105		09/13/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	43.0	47.2	105		09/13/10	MPM
Chlorobenzene	ND	ug/kg dry	38.8	42.0	105		09/13/10	MPM
Chloroethane	ND	ug/kg dry	71.4	73.5	105		09/13/10	MPM
Chloroform	ND	ug/kg dry	36.8	42.0	105		09/13/10	MPM
Chloromethane	ND	ug/kg dry	36.8	36.8	105		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-6 0-4'

Matrix: Soil

Sample Date/Time: 09/09/10 10:05

Lab No. : 1009185-10

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u>	<u>Analyst</u>
							<u>Analyzed</u>	
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	43.0	47.2	105		09/13/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	34.6	36.8	105		09/13/10	MPM
Dibromochloromethane	ND	ug/kg dry	34.6	36.8	105		09/13/10	MPM
Dibromomethane	ND	ug/kg dry	41.0	42.0	105		09/13/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	51.4	52.5	105		09/13/10	MPM
Ethylbenzene	ND	ug/kg dry	38.8	42.0	105		09/13/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	52.5	52.5	105		09/13/10	MPM
Isopropyl Ether	ND	ug/kg dry	75.6	78.8	105		09/13/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
m,p-Xylenes	ND	ug/kg dry	72.4	73.5	105		09/13/10	MPM
Methylene Chloride	ND	ug/kg dry	32.6	36.8	105		09/13/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	88.2	94.5	105		09/13/10	MPM
Naphthalene	ND	ug/kg dry	45.2	47.2	105		09/13/10	MPM
o-Xylene	ND	ug/kg dry	52.5	52.5	105		09/13/10	MPM
Propylbenzene	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
sec-Butylbenzene	ND	ug/kg dry	42.0	42.0	105		09/13/10	MPM
Styrene	ND	ug/kg dry	36.8	42.0	105		09/13/10	MPM
tert-Butylbenzene	ND	ug/kg dry	38.8	42.0	105		09/13/10	MPM
Tetrachloroethene	ND	ug/kg dry	47.2	47.2	105		09/13/10	MPM
Toluene	ND	ug/kg dry	43.0	47.2	105		09/13/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	47.2	47.2	105		09/13/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	35.7	36.8	105		09/13/10	MPM
Trichloroethene	ND	ug/kg dry	36.6	42.0	105		09/13/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	50.4	52.5	105		09/13/10	MPM
Vinyl chloride	ND	ug/kg dry	48.3	52.5	105		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-6 4-8'

Matrix: Soil

Sample Date/Time: 09/09/10 10:10

Lab No. : 1009185-11

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u>	<u>Analyst</u>
							<u>Analyzed</u>	
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	40.2	41.2	103		09/13/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	42.2	46.4	103		09/13/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	38.1	41.2	103		09/13/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	58.7	61.6	103		09/13/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	91.7	92.7	103		09/13/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	48.4	51.5	103		09/13/10	MPM
1,2,3-Trichloropropene	ND	ug/kg dry	50.5	51.5	103		09/13/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	43.3	46.4	103		09/13/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	102	103	103		09/13/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	35.0	36.0	103		09/13/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	40.2	41.2	103		09/13/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	41.2	41.2	103		09/13/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	35.0	41.2	103		09/13/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	39.1	41.2	103		09/13/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	38.1	41.2	103		09/13/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	36.0	36.0	103		09/13/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	103	103	103		09/13/10	MPM
2-Chlorotoluene	ND	ug/kg dry	39.1	41.2	103		09/13/10	MPM
4-Chlorotoluene	ND	ug/kg dry	34.0	36.4	103		09/13/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	36.0	36.0	103		09/13/10	MPM
Benzene	ND	ug/kg dry	37.1	41.2	103		09/13/10	MPM
Bromobenzene	ND	ug/kg dry	36.0	36.0	103		09/13/10	MPM
Bromochloromethane	ND	ug/kg dry	38.1	41.2	103		09/13/10	MPM
Bromodichloromethane	ND	ug/kg dry	38.1	41.2	103		09/13/10	MPM
Bromoform	ND	ug/kg dry	49.4	51.5	103		09/13/10	MPM
Bromomethane	ND	ug/kg dry	103	103	103		09/13/10	MPM
Butylbenzene	ND	ug/kg dry	42.2	46.4	103		09/13/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	42.2	46.4	103		09/13/10	MPM
Chlorobenzene	ND	ug/kg dry	38.1	41.2	103		09/13/10	MPM
Chloroethane	ND	ug/kg dry	70.0	72.1	103		09/13/10	MPM
Chloroform	ND	ug/kg dry	36.0	41.2	103		09/13/10	MPM
Chloromethane	ND	ug/kg dry	36.0	36.0	103		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-6 4-8'

Matrix: Soil

Sample Date/Time: 09/09/10 10:10

Lab No. : 1009185-11

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B Continued								
cis-1,2-Dichloroethylene	ND	ug/kg dry	42.2	46.4	t03		09/13/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	34.0	36.0	t03		09/13/10	MPM
Dibromochloromethane	ND	ug/kg dry	34.0	36.0	t03		09/13/10	MPM
Dibromomethane	ND	ug/kg dry	40.2	41.2	t03		09/13/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	50.5	51.5	t03		09/13/10	MPM
Ethylbenzene	ND	ug/kg dry	38.1	41.2	t03		09/13/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	51.5	51.5	t03		09/13/10	MPM
Isopropyl Ether	ND	ug/kg dry	74.2	77.2	t03		09/13/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	37.1	41.2	t03		09/13/10	MPM
m,p-Xylenes	ND	ug/kg dry	71.1	72.1	t03		09/13/10	MPM
Methylene Chloride	37.7	ug/kg dry	31.9	36.0	t03		09/13/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	86.5	92.7	t03		09/13/10	MPM
Naphthalene	ND	ug/kg dry	44.3	46.4	t03		09/13/10	MPM
o-Xylene	ND	ug/kg dry	51.5	51.5	t03		09/13/10	MPM
Propylbenzene	ND	ug/kg dry	37.1	41.2	t03		09/13/10	MPM
sec-Butylbenzene	ND	ug/kg dry	41.2	41.2	t03		09/13/10	MPM
Styrene	ND	ug/kg dry	36.0	41.2	t03		09/13/10	MPM
tert-Butylbenzene	ND	ug/kg dry	38.1	41.2	t03		09/13/10	MPM
Tetrachloroethene	ND	ug/kg dry	46.4	46.4	t03		09/13/10	MPM
Toluene	ND	ug/kg dry	42.2	46.4	t03		09/13/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	46.4	46.4	t03		09/13/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	35.0	36.0	t03		09/13/10	MPM
Trichloroethene	ND	ug/kg dry	38.1	41.2	t03		09/13/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	49.4	51.5	t03		09/13/10	MPM
Vinyl chloride	ND	ug/kg dry	47.4	51.5	t03		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-6 8-12'

Matrix: Soil

Sample Date/Time: 09/09/10 10:15

Lab No. : 1009185-12

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	36.0	40.0	100		09/13/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	39.0	40.0	100		09/13/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	36.0	40.0	100		09/13/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	41.0	45.0	100		09/13/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	37.0	40.0	100		09/13/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	57.0	60.0	100		09/13/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	89.0	90.0	100		09/13/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	47.0	50.0	100		09/13/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	49.0	50.0	100		09/13/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	42.0	45.0	100		09/13/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	36.0	40.0	100		09/13/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	99.0	100	100		09/13/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	34.0	35.0	100		09/13/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	39.0	40.0	100		09/13/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	40.0	40.0	100		09/13/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	34.0	40.0	100		09/13/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	36.0	40.0	100		09/13/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	36.0	40.0	100		09/13/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	38.0	40.0	100		09/13/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	35.0	35.0	100		09/13/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	100	100	100		09/13/10	MPM
2-Chlorotoluene	ND	ug/kg dry	36.0	40.0	100		09/13/10	MPM
4-Chlorotoluene	ND	ug/kg dry	33.0	35.3	100		09/13/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	35.0	35.0	100		09/13/10	MPM
Benzene	ND	ug/kg dry	36.0	40.0	100		09/13/10	MPM
Bromobenzene	ND	ug/kg dry	35.0	35.0	100		09/13/10	MPM
Bromochloromethane	ND	ug/kg dry	37.0	40.0	100		09/13/10	MPM
Bromodichloromethane	ND	ug/kg dry	38.0	40.0	100		09/13/10	MPM
Bromoform	ND	ug/kg dry	48.0	50.0	100		09/13/10	MPM
Bromomethane	ND	ug/kg dry	100	100	100		09/13/10	MPM
Butylbenzene	ND	ug/kg dry	41.0	45.0	100		09/13/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	41.0	45.0	100		09/13/10	MPM
Chlorobenzene	ND	ug/kg dry	37.0	40.0	100		09/13/10	MPM
Chloroethane	ND	ug/kg dry	68.0	70.0	100		09/13/10	MPM
Chloroform	ND	ug/kg dry	35.0	40.0	100		09/13/10	MPM
Chloromethane	ND	ug/kg dry	35.0	35.0	100		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-6 8-12'

Matrix: Soil

Sample Date/Time: 09/09/10 10:15

Lab No. : 1009185-12

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B Continued								
cis-1,2-Dichloroethylene	ND	ug/kg dry	41.0	45.0	100		09/13/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	33.0	35.0	100		09/13/10	MPM
Dibromochloromethane	ND	ug/kg dry	33.0	35.0	100		09/13/10	MPM
Dibromomethane	ND	ug/kg dry	39.0	40.0	100		09/13/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	49.0	50.0	100		09/13/10	MPM
Ethylbenzene	ND	ug/kg dry	37.0	40.0	100		09/13/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	50.0	50.0	100		09/13/10	MPM
Isopropyl Ether	ND	ug/kg dry	72.0	75.0	100		09/13/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	38.0	40.0	100		09/13/10	MPM
m,p-Xylenes	ND	ug/kg dry	69.0	70.0	100		09/13/10	MPM
Methylene Chloride	45.9	ug/kg dry	31.0	35.0	100		09/13/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	84.0	90.0	100		09/13/10	MPM
Naphthalene	ND	ug/kg dry	43.0	45.0	100		09/13/10	MPM
o-Xylene	ND	ug/kg dry	50.0	50.0	100		09/13/10	MPM
Propylbenzene	ND	ug/kg dry	36.0	40.0	100		09/13/10	MPM
sec-Butylbenzene	ND	ug/kg dry	40.0	40.0	100		09/13/10	MPM
Styrene	ND	ug/kg dry	35.0	40.0	100		09/13/10	MPM
tert-Butylbenzene	ND	ug/kg dry	37.0	40.0	100		09/13/10	MPM
Tetrachloroethene	ND	ug/kg dry	45.0	45.0	100		09/13/10	MPM
Toluene	ND	ug/kg dry	41.0	45.0	100		09/13/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	45.0	45.0	100		09/13/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	34.0	35.0	100		09/13/10	MPM
Trichloroethene	ND	ug/kg dry	37.0	40.0	100		09/13/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	48.0	50.0	100		09/13/10	MPM
Vinyl chloride	ND	ug/kg dry	46.0	50.0	100		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-6 12-16'

Matrix: Soil

Sample Date/Time: 09/09/10 10:20

Lab No. : 1009185-13

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u>	<u>Analyst</u>
							<u>Analyzed</u>	
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	41.0	42.0	105		09/13/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	43.0	47.2	105		09/13/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	38.8	42.0	105		09/13/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	59.8	63.0	105		09/13/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	93.4	94.5	105		09/13/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	49.4	52.5	105		09/13/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	51.4	52.5	105		09/13/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	44.1	47.2	105		09/13/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	104	105	105		09/13/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	35.7	38.8	105		09/13/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	41.0	42.0	105		09/13/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	42.0	42.0	105		09/13/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	35.7	42.0	105		09/13/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	39.9	42.0	105		09/13/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	39.9	42.0	105		09/13/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	36.8	38.8	105		09/13/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	105	105	105		09/13/10	MPM
2-Chlorotoluene	ND	ug/kg dry	39.9	42.0	105		09/13/10	MPM
4-Chlorotoluene	ND	ug/kg dry	34.8	37.1	105		09/13/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	38.8	38.8	105		09/13/10	MPM
Benzene	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
Bromobenzene	ND	ug/kg dry	38.8	36.8	105		09/13/10	MPM
Bromochloromethane	ND	ug/kg dry	38.8	42.0	105		09/13/10	MPM
Bromodichloromethane	ND	ug/kg dry	39.9	42.0	105		09/13/10	MPM
Bromoform	ND	ug/kg dry	50.4	52.5	105		09/13/10	MPM
Bromomethane	ND	ug/kg dry	105	105	105		09/13/10	MPM
Butylbenzene	ND	ug/kg dry	43.0	47.2	105		09/13/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	43.0	47.2	105		09/13/10	MPM
Chlorobenzene	ND	ug/kg dry	38.8	42.0	105		09/13/10	MPM
Chloroethane	ND	ug/kg dry	71.4	73.5	105		09/13/10	MPM
Chloroform	ND	ug/kg dry	36.8	42.0	105		09/13/10	MPM
Chloromethane	ND	ug/kg dry	36.8	36.8	105		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-6 12-16'

Matrix: Soil

Sample Date/Time: 09/09/10 10:20

Lab No. : 1009185-13

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B Continued								
cis-1,2-Dichloroethylene	ND	ug/kg dry	43.0	47.2	105		09/13/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	34.6	38.8	105		09/13/10	MPM
Dibromochloromethane	ND	ug/kg dry	34.6	38.8	105		09/13/10	MPM
Dibromomethane	ND	ug/kg dry	41.0	42.0	105		09/13/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	51.4	52.5	105		09/13/10	MPM
Ethylbenzene	ND	ug/kg dry	38.8	42.0	105		09/13/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	52.5	52.5	105		09/13/10	MPM
Isopropyl Ether	ND	ug/kg dry	75.6	78.8	105		09/13/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
m,p-Xylenes	ND	ug/kg dry	72.4	73.5	105		09/13/10	MPM
Methylene Chloride	41.1	ug/kg dry	32.6	38.8	105		09/13/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	88.2	94.5	105		09/13/10	MPM
Naphthalene	ND	ug/kg dry	45.2	47.2	105		09/13/10	MPM
o-Xylene	ND	ug/kg dry	52.5	52.5	105		09/13/10	MPM
Propylbenzene	ND	ug/kg dry	37.8	42.0	105		09/13/10	MPM
sec-Butylbenzene	ND	ug/kg dry	42.0	42.0	105		09/13/10	MPM
Styrene	ND	ug/kg dry	38.8	42.0	105		09/13/10	MPM
tert-Butylbenzene	ND	ug/kg dry	38.8	42.0	105		09/13/10	MPM
Tetrachloroethene	ND	ug/kg dry	47.2	47.2	105		09/13/10	MPM
Toluene	ND	ug/kg dry	43.0	47.2	105		09/13/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	47.2	47.2	105		09/13/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	35.7	38.8	105		09/13/10	MPM
Trichloroethene	ND	ug/kg dry	38.8	42.0	105		09/13/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	50.4	52.5	105		09/13/10	MPM
Vinyl chloride	ND	ug/kg dry	48.3	52.5	105		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-6 26.5-28

Matrix: Air

Sample Date/Time: 09/09/10 10:35

Lab No. : 1009185-14

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/L	1.50	5.00	5		09/10/10 10:20	MRD
1,1,1-Trichloroethane	ND	ug/L	2.50	8.50	5		09/10/10 10:20	MRD
1,1,2,2-Tetrachloroethane	ND	ug/L	2.00	6.50	5		09/10/10 10:20	MRD
1,1,2-Trichloroethane	ND	ug/L	2.00	6.50	5		09/10/10 10:20	MRD
1,1-Dichloroethane	ND	ug/L	2.00	6.50	5		09/10/10 10:20	MRD
1,1-Dichloroethylene	ND	ug/L	2.00	6.50	5		09/10/10 10:20	MRD
1,1-Dichloropropylene	ND	ug/L	4.00	13.5	5		09/10/10 10:20	MRD
1,2,3-Trichlorobenzene	ND	ug/L	2.50	8.50	5		09/10/10 10:20	MRD
1,2,3-Trichloropropene	ND	ug/L	5.00	16.5	5		09/10/10 10:20	MRD
1,2,4-Trichlorobenzene	ND	ug/L	2.50	8.50	5		09/10/10 10:20	MRD
1,2,4-Trimethylbenzene	ND	ug/L	1.00	3.35	5		09/10/10 10:20	MRD
1,2-Dibromo-3-chloropropane	ND	ug/L	6.50	21.5	5		09/10/10 10:20	MRD
1,2-Dibromoethane	ND	ug/L	1.50	5.00	5		09/10/10 10:20	MRD
1,2-Dichlorobenzene	ND	ug/L	4.00	13.5	5		09/10/10 10:20	MRD
1,2-Dichloroethane	ND	ug/L	1.50	5.00	5		09/10/10 10:20	MRD
1,2-Dichloropropane	ND	ug/L	2.00	6.50	5		09/10/10 10:20	MRD
1,3,5-Trimethylbenzene	ND	ug/L	1.00	3.35	5		09/10/10 10:20	MRD
1,3-Dichlorobenzene	ND	ug/L	1.00	3.35	5		09/10/10 10:20	MRD
1,3-Dichloropropane	ND	ug/L	1.00	3.35	5		09/10/10 10:20	MRD
1,4-Dichlorobenzene	ND	ug/L	4.00	13.5	5		09/10/10 10:20	MRD
2,2-Dichloropropane	ND	ug/L	5.00	16.5	5		09/10/10 10:20	MRD
2-Chlorotoluene	ND	ug/L	1.50	5.00	5		09/10/10 10:20	MRD
4-Chlorotoluene	ND	ug/L	1.50	5.00	5		09/10/10 10:20	MRD
4-Isopropyltoluene	ND	ug/L	2.00	6.65	5		09/10/10 10:20	MRD
Benzene	ND	ug/L	1.00	3.35	5		09/10/10 10:20	MRD
Bromobenzene	ND	ug/L	1.50	5.00	5		09/10/10 10:20	MRD
Bromochloromethane	ND	ug/L	2.00	6.50	5		09/10/10 10:20	MRD
Bromodichloromethane	ND	ug/L	2.00	6.50	5		09/10/10 10:20	MRD
Bromoform	ND	ug/L	1.00	3.35	5		09/10/10 10:20	MRD
Bromomethane	ND	ug/L	5.00	16.5	5		09/10/10 10:20	MRD
Butylbenzene	ND	ug/L	2.00	6.50	5		09/10/10 10:20	MRD
Carbon Tetrachloride	ND	ug/L	1.50	5.00	5		09/10/10 10:20	MRD
Chlorobenzene	ND	ug/L	1.00	3.35	5		09/10/10 10:20	MRD
Chloroethane	ND	ug/L	3.50	11.5	5		09/10/10 10:20	MRD
Chloroform	ND	ug/L	1.00	3.35	5		09/10/10 10:20	MRD
Chloromethane	ND	ug/L	2.00	6.50	5		09/10/10 10:20	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D : 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-6 26.5-28

Matrix: Air

Sample Date/Time: 09/09/10 10:35

Lab No. : 1009185-14

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u>	
							<u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/L	2.00	6.50	5		09/10/10 10:20	MRD
cis-1,3-Dichloropropylene	ND	ug/L	1.00	3.35	5		09/10/10 10:20	MRD
Dibromochloromethane	ND	ug/L	2.00	6.50	5		09/10/10 10:20	MRD
Dibromomethane	ND	ug/L	2.00	6.50	5		09/10/10 10:20	MRD
Dichlorodifluoromethane	ND	ug/L	1.50	5.00	5		09/10/10 10:20	MRD
Ethylbenzene	ND	ug/L	1.00	3.35	5		09/10/10 10:20	MRD
Hexachlorobutadiene	ND	ug/L	5.00	16.5	5		09/10/10 10:20	MRD
isopropylbenzene (Cumene)	ND	ug/L	1.00	3.35	5		09/10/10 10:20	MRD
m,p-Xylenes	ND	ug/L	2.00	6.50	5		09/10/10 10:20	MRD
Methylene Chloride	ND	ug/L	2.00	6.50	5		09/10/10 10:20	MRD
Methyl-tert-Butyl Ether	ND	ug/L	2.50	8.50	5		09/10/10 10:20	MRD
Naphthalene	ND	ug/L	5.00	16.5	5		09/10/10 10:20	MRD
o-Xylene	ND	ug/L	1.00	3.35	5		09/10/10 10:20	MRD
Propylbenzene	ND	ug/L	1.00	3.35	5		09/10/10 10:20	MRD
sec-Butylbenzene	ND	ug/L	1.50	5.00	5		09/10/10 10:20	MRD
Styrene	ND	ug/L	0.50	2.50	5		09/10/10 10:20	MRD
tert-Butylbenzene	ND	ug/L	1.50	5.00	5		09/10/10 10:20	MRD
Tetrachloroethene	ND	ug/L	1.50	5.00	5		09/10/10 10:20	MRD
Toluene	ND	ug/L	2.00	6.50	5		09/10/10 10:20	MRD
trans-1,2-Dichloroethylene	ND	ug/L	2.50	8.50	5		09/10/10 10:20	MRD
trans-1,3-Dichloropropylene	ND	ug/L	2.00	6.50	5		09/10/10 10:20	MRD
Trichloroethene	ND	ug/L	2.00	6.50	5		09/10/10 10:20	MRD
Trichlorofluoromethane	ND	ug/L	1.50	5.00	5		09/10/10 10:20	MRD
Vinyl chloride	ND	ug/L	1.00	3.35	5		09/10/10 10:20	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: MeOH Blank

Matrix: Soil

Sample Date/Time: 09/09/10 0:00

Lab No. : 1009185-15

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg	36.0	40.0	100		09/13/10	MPM
1,1,1-Trichloroethane	ND	ug/kg	39.0	40.0	100		09/13/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg	36.0	40.0	100		09/13/10	MPM
1,1,2-Trichloroethane	ND	ug/kg	41.0	45.0	100		09/13/10	MPM
1,1-Dichloroethane	ND	ug/kg	37.0	40.0	100		09/13/10	MPM
1,1-Dichloroethylene	ND	ug/kg	57.0	60.0	100		09/13/10	MPM
1,1-Dichloropropylene	ND	ug/kg	89.0	90.0	100		09/13/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg	47.0	50.0	100		09/13/10	MPM
1,2,3-Trichloropropane	ND	ug/kg	49.0	50.0	100		09/13/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg	42.0	45.0	100		09/13/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg	36.0	40.0	100		09/13/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg	99.0	100	100		09/13/10	MPM
1,2-Dibromoethane	ND	ug/kg	34.0	35.0	100		09/13/10	MPM
1,2-Dichlorobenzene	ND	ug/kg	38.0	40.0	100		09/13/10	MPM
1,2-Dichloroethane	ND	ug/kg	40.0	40.0	100		09/13/10	MPM
1,2-Dichloropropane	ND	ug/kg	34.0	40.0	100		09/13/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg	36.0	40.0	100		09/13/10	MPM
1,3-Dichlorobenzene	ND	ug/kg	36.0	40.0	100		09/13/10	MPM
1,3-Dichloropropane	ND	ug/kg	38.0	40.0	100		09/13/10	MPM
1,4-Dichlorobenzene	ND	ug/kg	35.0	35.0	100		09/13/10	MPM
2,2-Dichloropropane	ND	ug/kg	100	100	100		09/13/10	MPM
2-Chlorotoluene	ND	ug/kg	38.0	40.0	100		09/13/10	MPM
4-Chlorotoluene	ND	ug/kg	33.0	35.3	100		09/13/10	MPM
4-Isopropyltoluene	ND	ug/kg	35.0	35.0	100		09/13/10	MPM
Benzene	ND	ug/kg	36.0	40.0	100		09/13/10	MPM
Bromobenzene	ND	ug/kg	35.0	35.0	100		09/13/10	MPM
Bromochloromethane	ND	ug/kg	37.0	40.0	100		09/13/10	MPM
Bromodichloromethane	ND	ug/kg	38.0	40.0	100		09/13/10	MPM
Bromoform	ND	ug/kg	48.0	50.0	100		09/13/10	MPM
Bromomethane	ND	ug/kg	100	100	100		09/13/10	MPM
Butylbenzene	ND	ug/kg	41.0	45.0	100		09/13/10	MPM
Carbon Tetrachloride	ND	ug/kg	41.0	45.0	100		09/13/10	MPM
Chlorobenzene	ND	ug/kg	37.0	40.0	100		09/13/10	MPM
Chloroethane	ND	ug/kg	68.0	70.0	100		09/13/10	MPM
Chloroform	ND	ug/kg	35.0	40.0	100		09/13/10	MPM
Chloromethane	ND	ug/kg	35.0	35.0	100		09/13/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009185
DATE REC'D : 09/10/10 09:39
REPORT DATE : 09/15/10 12:30
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: MeOH Blank

Matrix: Soil

Sample Date/Time: 09/09/10 0:00

Lab No. : 1009185-15

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg	41.0	45.0	100		09/13/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg	33.0	35.0	100		09/13/10	MPM
Dibromochloromethane	ND	ug/kg	33.0	35.0	100		09/13/10	MPM
Dibromomethane	ND	ug/kg	39.0	40.0	100		09/13/10	MPM
Dichlorodifluoromethane	ND	ug/kg	49.0	50.0	100		09/13/10	MPM
Ethylbenzene	ND	ug/kg	37.0	40.0	100		09/13/10	MPM
Hexachlorobutadiene	ND	ug/kg	50.0	50.0	100		09/13/10	MPM
Isopropyl Ether	ND	ug/kg	72.0	75.0	100		09/13/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg	38.0	40.0	100		09/13/10	MPM
m,p-Xylenes	ND	ug/kg	69.0	70.0	100		09/13/10	MPM
Methylene Chloride	ND	ug/kg	31.0	35.0	100		09/13/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg	84.0	90.0	100		09/13/10	MPM
Naphthalene	ND	ug/kg	43.0	45.0	100		09/13/10	MPM
o-Xylene	ND	ug/kg	50.0	50.0	100		09/13/10	MPM
Propylbenzene	ND	ug/kg	38.0	40.0	100		09/13/10	MPM
sec-Butylbenzene	ND	ug/kg	40.0	40.0	100		09/13/10	MPM
Styrene	ND	ug/kg	35.0	40.0	100		09/13/10	MPM
tert-Butylbenzene	ND	ug/kg	37.0	40.0	100		09/13/10	MPM
Tetrachloroethene	ND	ug/kg	45.0	45.0	100		09/13/10	MPM
Toluene	ND	ug/kg	41.0	45.0	100		09/13/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg	45.0	45.0	100		09/13/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg	34.0	35.0	100		09/13/10	MPM
Trichloroethene	ND	ug/kg	37.0	40.0	100		09/13/10	MPM
Trichlorofluoromethane	ND	ug/kg	48.0	50.0	100		09/13/10	MPM
Vinyl chloride	ND	ug/kg	46.0	50.0	100		09/13/10	MPM

SIEMENS

Qualifier Descriptions

S2L	Second sample matrix spike recovery was low.
S2H	Second sample matrix spike recovery was high.
S1L	First sample matrix spike recovery was low.
S1H	First sample matrix spike recovery was high.
DUP	Result of duplicate analysis in this quality assurance batch exceeds the limits for precision.

Definitions

LOD = Limit of Detection (Dilution Corrected)
LOQ = Limit of Quantitation (Dilution Corrected)
Reporting Limit = LOQ (Dilution Corrected)
ND = Not Detected
COMP = Complete
SUBCON = Subcontracted analysis
mv = millivolts
pci/L = picocuries per Liter
mL/L = milliliters per Liter
mg = milligram

When the word "dry" follows the units on the result page the sample results are dry weight corrected.

LODs and LOQs are dry weight corrected for all soils except WI GRO, EPA 8021 and WI DNR/EPA 8260B methanol and WI DNR methylene chloride preserved soils being reported to the State of Wisconsin.

ug/l = Micrograms per Liter = parts per billion (ppb)
ug/kg = Micrograms per kilogram = parts per billion (ppb)
mg/l = Milligrams per liter = parts per million (ppm)
mg/kg = Milligrams per kilogram = parts per million (ppm)
NOT PRES = Not Present
ppth = Parts per thousand
* = Result outside established limits.
mg/m³ = Milligrams per meter cubed
ng/L = Nanograms per Liter = Parts per trillion (ppt)
> = Greater Than

State of Wisconsin Methanol Soils for WI GRO, WI DNR/EPA 8260B and EPA 8021 are reported to the LOQ.

Company Name GANNETT FLEMING	Project 34286.008
Report Mailing Address	Contact Name, Phone, Fax, Email
Invoice Address SEE PG 1	Purchase Order # SEE PG 1 Invoice Contact and Phone No.

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: AIR

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: WI
 (If Yes, please specify Agency or Regulation) Agency/Reg.: WDNR/EPA

Turnaround Request: [] Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharges)
 Date Needed: _____

WO No. 1009185

Analyses Requested										Lab Use Only		
VOCs - 8260										Delivered by:	Walk-in	<input checked="" type="radio"/> Courier
										Ship. Cont. OK?	<input checked="" type="radio"/> Y	<input type="radio"/> N NA
										Samples Leaking?	<input type="radio"/> Y	<input checked="" type="radio"/> N NA
										Seals OK?	<input checked="" type="radio"/> Y	<input type="radio"/> N NA
										Rec'd on Ice?	<input checked="" type="radio"/> Y	<input type="radio"/> N NA
Sample Receiving Comments:												
1.4												
Comments <u>RD READINGS (PPM)</u>												

Lab Use Only	Sample		No. of Containers		Sample ID
	Date	Time	Comp	Grab	
-11	9/9	10:10	2		IB-6 4-8' X
-12	↓	10:15	2		IB-6 8-12' X
-13	↓	10:20	2		IB-6 12-16' X
-14	↓	10:35		1	IB-6 26.5-38' X
-15	7/29			1	TRIP BLANK X

SOIL <0.1
 ↓ <0.1
 ↓ <0.1
 AIR 1-Tool too long
 (Vial Mouth 7.27) 10 TB034

Chain of Custody Record

Relinquished By:	Date	Time	Received By:
<u>Fay Mula</u>	11 ³⁰	9/9/00	
	9-10-00	0939	<u>Les Arden</u>

SIEMENS

September 13, 2010

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

Attn: Tony Miller

REPORT NO.: 1009149

PROJECT NO.: 34286.008

Please find enclosed the analytical report, including the Sample Summary, Sample Narrative and Chain of Custody for your sample set received September 9, 2010.

All analyses were performed in accordance with NELAC Standards using approved methods as indicated on this report.

If you have any questions about the results, please call. Thank you for using Siemens Water Technologies for your analytical needs.

Sincerely,

Siemens Water Technologies



Bruce Schertz


Lab Manager

Enviroscan Analytical™ Services

Cc: copy report to Dave Olig

I certify that the data contained in this report has been generated and reviewed in accordance with the Siemens Water Technologies Quality Assurance Program. Exceptions, if any, are discussed in the sample narrative. Samples will be retained for 30 days from the date of this report, then disposed in an appropriate manner. Siemens Water Technologies Corp. reserves the right to return samples identified as hazardous. Release of this Final Report is authorized as verified by the following signature. The contents of this report apply to the sample(s) analyzed. No duplication of this report is allowed except in its entirety.

Reviewed by:



Certifications:

Wisconsin 737053130
Minnesota 055-999-302
Illinois 100317



Siemens Water Technologies Corp.

301 West Military Road
Rothschild, WI 54474

Tel: 800-338-7226
Fax: 715-355-3221
www.siemens.com/eviroscan

The total number of pages in this report, including this page is 38.

SIEMENS

SAMPLE SUMMARY

<u>Lab Id</u>	<u>Client Sample Id</u>	<u>Date/Time</u>	<u>Matrix</u>
1009149-01	IB-1 0-4'	09/08/10 11:00	Soil
1009149-02	IB-1 4-8'	09/08/10 11:10	Soil
1009149-03	IB-1 8-12'	09/08/10 12:45	Soil
1009149-04	IB-1 12-16'	09/08/10 13:05	Soil
1009149-05	IB-1 26.5-28'	09/08/10 13:35	Air
1009149-06	IB-2 0-4'	09/08/10 14:05	Soil
1009149-07	IB-2 4-8'	09/08/10 14:15	Soil
1009149-08	IB-2 8-12'	09/08/10 14:20	Soil
1009149-09	IB-2 12-16'	09/08/10 14:25	Soil
1009149-10	IB-2 26.5-28'	09/08/10 14:45	Air
1009149-11	IB-3 0-4'	09/08/10 15:05	Soil
1009149-12	IB-3 4-8'	09/08/10 15:10	Soil
1009149-13	IB-3 8-12'	09/08/10 15:20	Soil
1009149-14	IB-3 12-16'	09/08/10 15:30	Soil
1009149-15	IB-3 26.5-28'	09/08/10 15:45	Air
1009149-16	MeOH Blank	09/08/10 00:00	Soil

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-1 0-4'

Matrix: Soil

Sample Date/Time: 09/08/10 11:00

Lab No.: 1009149-01

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	38.9	43.2	108		09/10/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	42.1	43.2	108		09/10/10	MPM
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	38.9	43.2	108		09/10/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	44.3	48.8	108		09/10/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	40.0	43.2	108		09/10/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	81.8	84.8	108		09/10/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	96.1	97.2	108		09/10/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	50.8	54.0	108		09/10/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	52.9	54.0	108		09/10/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	45.4	48.6	108	S2H	09/10/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	38.9	43.2	108		09/10/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	107	108	108		09/10/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	36.7	37.8	108		09/10/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	42.1	43.2	108		09/10/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	43.2	43.2	108		09/10/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	36.7	43.2	108		09/10/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	38.9	43.2	108		09/10/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	41.0	43.2	108		09/10/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	41.0	43.2	108		09/10/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	37.8	37.8	108		09/10/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	108	108	108		09/10/10	MPM
2-Chlorotoluene	ND	ug/kg dry	41.0	43.2	108		09/10/10	MPM
4-Chlorotoluene	ND	ug/kg dry	35.6	38.1	108		09/10/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	37.8	37.8	108		09/10/10	MPM
Benzene	ND	ug/kg dry	38.9	43.2	108		09/10/10	MPM
Bromobenzene	ND	ug/kg dry	37.8	37.8	108		09/10/10	MPM
Bromochloromethane	ND	ug/kg dry	40.0	43.2	108		09/10/10	MPM
Bromodichloromethane	ND	ug/kg dry	41.0	43.2	108		09/10/10	MPM
Bromoform	ND	ug/kg dry	51.8	54.0	108		09/10/10	MPM
Bromomethane	ND	ug/kg dry	108	108	108		09/10/10	MPM
Butylbenzene	ND	ug/kg dry	44.3	48.6	108		09/10/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	44.3	48.8	108		09/10/10	MPM
Chlorobenzene	ND	ug/kg dry	40.0	43.2	108		09/10/10	MPM
Chloroethane	ND	ug/kg dry	73.4	75.6	108		09/10/10	MPM
Chloroform	ND	ug/kg dry	37.8	43.2	108		09/10/10	MPM
Chloromethane	ND	ug/kg dry	37.8	37.8	108		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D : 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-1 0-4' Matrix: Soil Sample Date/Time: 09/08/10 11:00 Lab No. : 1009149-01

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	44.3	48.8	108		09/10/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	35.8	37.8	108		09/10/10	MPM
Dibromochloromethane	ND	ug/kg dry	35.8	37.8	108		09/10/10	MPM
Dibromomethane	ND	ug/kg dry	42.1	43.2	108		09/10/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	52.9	54.0	108		09/10/10	MPM
Ethylbenzene	ND	ug/kg dry	40.0	43.2	108		09/10/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	54.0	54.0	108		09/10/10	MPM
Isopropyl Ether	ND	ug/kg dry	77.8	81.0	108		09/10/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	38.9	43.2	108		09/10/10	MPM
m,p-Xylenes	ND	ug/kg dry	74.5	75.6	108		09/10/10	MPM
Methylene Chloride	ND	ug/kg dry	33.5	37.8	108		09/10/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	90.7	97.2	108		09/10/10	MPM
Naphthalene	73.2	ug/kg dry	46.4	48.8	108	S2H	09/10/10	MPM
o-Xylene	ND	ug/kg dry	54.0	54.0	108		09/10/10	MPM
Propylbenzene	ND	ug/kg dry	38.9	43.2	108		09/10/10	MPM
sec-Butylbenzene	ND	ug/kg dry	43.2	43.2	108		09/10/10	MPM
Styrene	ND	ug/kg dry	37.8	43.2	108		09/10/10	MPM
tert-Butylbenzene	ND	ug/kg dry	40.0	43.2	108		09/10/10	MPM
Tetrachloroethene	ND	ug/kg dry	48.6	48.6	108		09/10/10	MPM
Toluene	ND	ug/kg dry	44.3	48.8	108		09/10/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	48.8	48.6	108		09/10/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	36.7	37.8	108		09/10/10	MPM
Trichloroethene	ND	ug/kg dry	40.0	43.2	108		09/10/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	51.8	54.0	108		09/10/10	MPM
Vinyl chloride	ND	ug/kg dry	49.7	54.0	108		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-1 4-8'

Matrix: Soil

Sample Date/Time: 09/08/10 11:10

Lab No. : 1009149-02

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	37.4	41.6	104		09/10/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	40.6	41.6	104		09/10/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	37.4	41.6	104		09/10/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	42.6	46.6	104		09/10/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	36.5	41.6	104		09/10/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	59.3	62.4	104		09/10/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	92.6	93.6	104		09/10/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	48.9	52.0	104		09/10/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	51.0	52.0	104		09/10/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	43.7	46.8	104		09/10/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	37.4	41.6	104		09/10/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	103	104	104		09/10/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	35.4	36.4	104		09/10/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	40.6	41.6	104		09/10/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	41.6	41.6	104		09/10/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	35.4	41.6	104		09/10/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	37.4	41.6	104		09/10/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	39.5	41.6	104		09/10/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	39.5	41.6	104		09/10/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	36.4	36.4	104		09/10/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	104	104	104		09/10/10	MPM
2-Chlorotoluene	ND	ug/kg dry	39.5	41.6	104		09/10/10	MPM
4-Chlorotoluene	ND	ug/kg dry	34.3	36.7	104		09/10/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	36.4	36.4	104		09/10/10	MPM
Benzene	ND	ug/kg dry	37.4	41.6	104		09/10/10	MPM
Bromobenzene	ND	ug/kg dry	36.4	36.4	104		09/10/10	MPM
Bromochloromethane	ND	ug/kg dry	38.5	41.6	104		09/10/10	MPM
Bromodichloromethane	ND	ug/kg dry	39.5	41.6	104		09/10/10	MPM
Bromoform	ND	ug/kg dry	49.9	52.0	104		09/10/10	MPM
Bromomethane	ND	ug/kg dry	104	104	104		09/10/10	MPM
Butylbenzene	ND	ug/kg dry	42.6	46.8	104		09/10/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	42.6	46.8	104		09/10/10	MPM
Chlorobenzene	ND	ug/kg dry	36.5	41.6	104		09/10/10	MPM
Chloroethane	ND	ug/kg dry	70.7	72.8	104		09/10/10	MPM
Chloroform	ND	ug/kg dry	36.4	41.6	104		09/10/10	MPM
Chloromethane	ND	ug/kg dry	36.4	36.4	104		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-1 4-8'

Matrix: Soil

Sample Date/Time: 09/08/10 11:10

Lab No. : 1009149-02

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	42.8	46.8	104		09/10/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	34.3	36.4	104		09/10/10	MPM
Dibromochloromethane	ND	ug/kg dry	34.3	36.4	104		09/10/10	MPM
Dibromomethane	ND	ug/kg dry	40.8	41.8	104		09/10/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	51.0	52.0	104		09/10/10	MPM
Ethylbenzene	ND	ug/kg dry	38.5	41.6	104		09/10/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	52.0	52.0	104		09/10/10	MPM
Isopropyl Ether	ND	ug/kg dry	74.9	78.0	104		09/10/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	37.4	41.6	104		09/10/10	MPM
m,p-Xylenes	ND	ug/kg dry	71.8	72.8	104		09/10/10	MPM
Methylene Chloride	ND	ug/kg dry	32.2	36.4	104		09/10/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	87.4	93.8	104		09/10/10	MPM
Naphthalene	ND	ug/kg dry	44.7	46.8	104		09/10/10	MPM
o-Xylene	ND	ug/kg dry	52.0	52.0	104		09/10/10	MPM
Propylbenzene	ND	ug/kg dry	37.4	41.8	104		09/10/10	MPM
sec-Butylbenzene	ND	ug/kg dry	41.6	41.8	104		09/10/10	MPM
Styrene	ND	ug/kg dry	38.4	41.8	104		09/10/10	MPM
tert-Butylbenzene	ND	ug/kg dry	38.5	41.8	104		09/10/10	MPM
Tetrachloroethene	ND	ug/kg dry	46.8	48.8	104		09/10/10	MPM
Toluene	ND	ug/kg dry	42.8	46.8	104		09/10/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	46.8	46.8	104		09/10/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	35.4	36.4	104		09/10/10	MPM
Trichloroethane	ND	ug/kg dry	38.5	41.8	104		09/10/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	49.9	52.0	104		09/10/10	MPM
Vinyl chloride	ND	ug/kg dry	47.8	52.0	104		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-1 8-12'

Matrix: Soil

Sample Date/Time: 09/08/10 12:45

Lab No. : 1009149-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	40.2	41.2	103		09/10/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	42.2	46.4	103		09/10/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	38.1	41.2	103		09/10/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	58.7	61.8	103		09/10/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	91.7	92.7	103		09/10/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	48.4	51.5	103		09/10/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	50.5	51.5	103		09/10/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	43.3	46.4	103		09/10/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	102	103	103		09/10/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	35.0	36.0	103		09/10/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	40.2	41.2	103		09/10/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	41.2	41.2	103		09/10/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	35.0	41.2	103		09/10/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	39.1	41.2	103		09/10/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	39.1	41.2	103		09/10/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	36.0	36.0	103		09/10/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	103	103	103		09/10/10	MPM
2-Chlorotoluene	ND	ug/kg dry	39.1	41.2	103		09/10/10	MPM
4-Chlorotoluene	ND	ug/kg dry	34.0	36.4	103		09/10/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	36.0	36.0	103		09/10/10	MPM
Benzene	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
Bromobenzene	ND	ug/kg dry	36.0	36.0	103		09/10/10	MPM
Bromochloromethane	ND	ug/kg dry	38.1	41.2	103		09/10/10	MPM
Bromodichloromethane	ND	ug/kg dry	39.1	41.2	103		09/10/10	MPM
Bromoform	ND	ug/kg dry	49.4	51.5	103		09/10/10	MPM
Bromomethane	ND	ug/kg dry	103	103	103		09/10/10	MPM
Butylbenzene	ND	ug/kg dry	42.2	46.4	103		09/10/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	42.2	46.4	103		09/10/10	MPM
Chlorobenzene	ND	ug/kg dry	38.1	41.2	103		09/10/10	MPM
Chloroethane	ND	ug/kg dry	70.0	72.1	103		09/10/10	MPM
Chloroform	ND	ug/kg dry	36.0	41.2	103		09/10/10	MPM
Chloromethane	ND	ug/kg dry	36.0	36.0	103		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D : 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-1 8-12'

Matrix: Soil

Sample Date/Time: 09/08/10 12:45

Lab No. : 1009149-03

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B Continued								
cis-1,2-Dichloroethylene	ND	ug/kg dry	42.2	46.4	103		09/10/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	34.0	36.0	103		09/10/10	MPM
Dibromochloromethane	ND	ug/kg dry	34.0	36.0	103		09/10/10	MPM
Dibromomethane	ND	ug/kg dry	40.2	41.2	103		09/10/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	50.5	51.5	103		09/10/10	MPM
Ethylbenzene	ND	ug/kg dry	38.1	41.2	103		09/10/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	51.5	51.5	103		09/10/10	MPM
Isopropyl Ether	ND	ug/kg dry	74.2	77.2	103		09/10/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
m,p-Xylenes	ND	ug/kg dry	71.1	72.1	103		09/10/10	MPM
Methylene Chloride	ND	ug/kg dry	31.9	36.0	103		09/10/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	86.5	92.7	103		09/10/10	MPM
Naphthalene	ND	ug/kg dry	44.3	46.4	103		09/10/10	MPM
o-Xylene	ND	ug/kg dry	51.5	51.5	103		09/10/10	MPM
Propylbenzene	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
sec-Butylbenzene	ND	ug/kg dry	41.2	41.2	103		09/10/10	MPM
Styrene	ND	ug/kg dry	36.0	41.2	103		09/10/10	MPM
tert-Butylbenzene	ND	ug/kg dry	36.1	41.2	103		09/10/10	MPM
Tetrachloroethane	58.3	ug/kg dry	46.4	46.4	103		09/10/10	MPM
Toluene	ND	ug/kg dry	42.2	46.4	103		09/10/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	46.4	46.4	103		09/10/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	35.0	36.0	103		09/10/10	MPM
Trichloroethene	ND	ug/kg dry	38.1	41.2	103		09/10/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	49.4	51.5	103		09/10/10	MPM
Vinyl chloride	ND	ug/kg dry	47.4	51.5	103		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-1 12-16'

Matrix: Soil

Sample Date/Time: 09/08/10 13:05

Lab No. : 1009149-04

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	43.9	48.8	122		09/10/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	47.6	48.8	122		09/10/10	MPM
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	43.9	48.8	122		09/10/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	50.0	54.9	122		09/10/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	45.1	48.8	122		09/10/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	69.5	73.2	122		09/10/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	109	110	122		09/10/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	57.3	61.0	122		09/10/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	59.8	61.0	122		09/10/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	51.2	54.9	122		09/10/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	43.9	48.8	122		09/10/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	121	122	122		09/10/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	41.5	42.7	122		09/10/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	47.8	48.8	122		09/10/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	48.8	48.8	122		09/10/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	41.5	48.8	122		09/10/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	43.9	48.8	122		09/10/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	46.4	48.8	122		09/10/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	46.4	48.8	122		09/10/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	42.7	42.7	122		09/10/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	122	122	122		09/10/10	MPM
2-Chlorotoluene	ND	ug/kg dry	46.4	48.8	122		09/10/10	MPM
4-Chlorotoluene	ND	ug/kg dry	40.3	43.1	122		09/10/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	42.7	42.7	122		09/10/10	MPM
Benzene	ND	ug/kg dry	43.9	48.8	122		09/10/10	MPM
Bromobenzene	ND	ug/kg dry	42.7	42.7	122		09/10/10	MPM
Bromochloromethane	ND	ug/kg dry	45.1	48.8	122		09/10/10	MPM
Bromodichloromethane	ND	ug/kg dry	46.4	48.8	122		09/10/10	MPM
Bromoform	ND	ug/kg dry	58.6	61.0	122		09/10/10	MPM
Bromomethane	ND	ug/kg dry	122	122	122		09/10/10	MPM
Butylbenzene	ND	ug/kg dry	50.0	54.9	122		09/10/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	50.0	54.9	122		09/10/10	MPM
Chlorobenzene	ND	ug/kg dry	45.1	48.8	122		09/10/10	MPM
Chloroethane	ND	ug/kg dry	83.0	85.4	122		09/10/10	MPM
Chloroform	ND	ug/kg dry	42.7	48.8	122		09/10/10	MPM
Chloromethane	ND	ug/kg dry	42.7	42.7	122		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-1 12-16'

Matrix: Soil

Sample Date/Time: 09/08/10 13:05

Lab No. : 1009149-04

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	50.0	54.9	122		09/10/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	40.3	42.7	122		09/10/10	MPM
Dibromochloromethane	ND	ug/kg dry	40.3	42.7	122		09/10/10	MPM
Dibromomethane	ND	ug/kg dry	47.6	48.8	122		09/10/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	59.8	61.0	122		09/10/10	MPM
Ethylbenzene	ND	ug/kg dry	45.1	48.8	122		09/10/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	61.0	61.0	122		09/10/10	MPM
Isopropyl Ether	ND	ug/kg dry	87.8	91.5	122		09/10/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	43.9	48.8	122		09/10/10	MPM
m,p-Xylenes	ND	ug/kg dry	84.2	85.4	122		09/10/10	MPM
Methylene Chloride	ND	ug/kg dry	37.8	42.7	122		09/10/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	102	110	122		09/10/10	MPM
Naphthalene	ND	ug/kg dry	52.5	54.9	122		09/10/10	MPM
o-Xylena	ND	ug/kg dry	61.0	61.0	122		09/10/10	MPM
Propylbenzene	ND	ug/kg dry	43.9	48.8	122		09/10/10	MPM
sec-Butylbenzene	ND	ug/kg dry	48.8	48.8	122		09/10/10	MPM
Styrene	ND	ug/kg dry	42.7	48.8	122		09/10/10	MPM
tert-Butylbenzene	ND	ug/kg dry	45.1	48.6	122		09/10/10	MPM
Tetrachloroethene	ND	ug/kg dry	54.9	54.9	122		09/10/10	MPM
Toluene	ND	ug/kg dry	50.0	54.9	122		09/10/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	54.9	54.9	122		09/10/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	41.5	42.7	122		09/10/10	MPM
Trichloroethene	ND	ug/kg dry	45.1	48.8	122		09/10/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	58.6	61.0	122		09/10/10	MPM
Vinyl chloride	ND	ug/kg dry	56.1	61.0	122		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-1 26.5-28'

Matrix: Air

Sample Date/Time: 09/08/10 13:35

Lab No. : 1009149-05

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date</u>		<u>Analyst</u>
							<u>Analyzed</u>		
EPA 8260B									
1,1,1,2-Tetrachloroethane	ND	ug/L	1.50	5.00	5		09/10/10	8:45	MRD
1,1,1-Trichloroethane	9.95	ug/L	2.50	8.50	5		09/10/10	8:45	MRD
1,1,2,2-Tetrachloroethane	ND	ug/L	2.00	6.50	5		09/10/10	8:45	MRD
1,1,2-Trichloroethane	ND	ug/L	2.00	6.50	5		09/10/10	8:45	MRD
1,1-Dichloroethane	ND	ug/L	2.00	6.50	5		09/10/10	8:45	MRD
1,1-Dichloroethylene	ND	ug/L	2.00	6.50	5		09/10/10	8:45	MRD
1,1-Dichloropropylene	ND	ug/L	4.00	13.5	5		09/10/10	8:45	MRD
1,2,3-Trichlorobenzene	ND	ug/L	2.50	8.50	5		09/10/10	8:45	MRD
1,2,3-Trichloropropane	ND	ug/L	5.00	16.5	5		09/10/10	8:45	MRD
1,2,4-Trichlorobenzene	ND	ug/L	2.50	8.50	5		09/10/10	8:45	MRD
1,2,4-Trimethylbenzene	ND	ug/L	1.00	3.35	5		09/10/10	8:45	MRD
1,2-Dibromo-3-chloropropane	ND	ug/L	6.50	21.5	5		09/10/10	8:45	MRD
1,2-Dibromoethane	ND	ug/L	1.50	5.00	5		09/10/10	8:45	MRD
1,2-Dichlorobenzene	ND	ug/L	4.00	13.5	5		09/10/10	8:45	MRD
1,2-Dichloroethane	ND	ug/L	1.50	5.00	5		09/10/10	8:45	MRD
1,2-Dichloropropane	ND	ug/L	2.00	6.50	5		09/10/10	8:45	MRD
1,3,5-Trimethylbenzene	ND	ug/L	1.00	3.35	5		09/10/10	8:45	MRD
1,3-Dichlorobenzene	ND	ug/L	1.00	3.35	5		09/10/10	8:45	MRD
1,3-Dichloropropane	ND	ug/L	1.00	3.35	5		09/10/10	8:45	MRD
1,4-Dichlorobenzene	ND	ug/L	4.00	13.5	5		09/10/10	8:45	MRD
2,2-Dichloropropane	ND	ug/L	5.00	16.5	5		09/10/10	8:45	MRD
2-Chlorotoluene	ND	ug/L	1.50	5.00	5		09/10/10	8:45	MRD
4-Chlorotoluene	ND	ug/L	1.50	5.00	5		09/10/10	8:45	MRD
4-Isopropyltoluene	ND	ug/L	2.00	6.65	5		09/10/10	8:45	MRD
Benzene	ND	ug/L	1.00	3.35	5		09/10/10	8:45	MRD
Bromobenzene	ND	ug/L	1.50	5.00	5		09/10/10	8:45	MRD
Bromochloromethane	ND	ug/L	2.00	6.50	5		09/10/10	8:45	MRD
Bromodichloromethane	ND	ug/L	2.00	6.50	5		09/10/10	8:45	MRD
Bromoform	ND	ug/L	1.00	3.35	5		09/10/10	8:45	MRD
Bromomethane	ND	ug/L	5.00	16.5	5		09/10/10	8:45	MRD
Butylbenzene	ND	ug/L	2.00	6.50	5		09/10/10	8:45	MRD
Carbon Tetrachloride	ND	ug/L	1.50	5.00	5		09/10/10	8:45	MRD
Chlorobenzene	ND	ug/L	1.00	3.35	5		09/10/10	8:45	MRD
Chloroethane	ND	ug/L	3.50	11.5	5		09/10/10	8:45	MRD
Chloroform	ND	ug/L	1.00	3.35	5		09/10/10	8:45	MRD
Chloromethane	ND	ug/L	2.00	6.50	5		09/10/10	8:45	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-1 26.5-28'

Matrix: Air

Sample Date/Time: 09/08/10 13:35

Lab No. : 1009149-05

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B Continued								
cis-1,2-Dichloroethylene	ND	ug/L	2.00	6.50	5		09/10/10 8:45	MRD
cis-1,3-Dichloropropylene	ND	ug/L	1.00	3.35	5		09/10/10 8:45	MRD
Dibromochloromethane	ND	ug/L	2.00	6.50	5		09/10/10 8:45	MRD
Dibromomethane	ND	ug/L	2.00	6.50	5		09/10/10 8:45	MRD
Dichlorodifluoromethane	ND	ug/L	1.50	5.00	5		09/10/10 8:45	MRD
Ethylbenzene	ND	ug/L	1.00	3.35	5		09/10/10 8:45	MRD
Hexachlorobutadiene	ND	ug/L	5.00	16.5	5		09/10/10 8:45	MRD
Isopropylbenzene (Cumene)	ND	ug/L	1.00	3.35	5		09/10/10 8:45	MRD
m,p-Xylenes	ND	ug/L	2.00	6.50	5		09/10/10 8:45	MRD
Methylene Chloride	ND	ug/L	2.00	6.50	5		09/10/10 8:45	MRD
Methyl-tert-Butyl Ether	ND	ug/L	2.50	8.50	5		09/10/10 8:45	MRD
Naphthalene	ND	ug/L	5.00	16.5	5		09/10/10 8:45	MRD
o-Xylene	ND	ug/L	1.00	3.35	5		09/10/10 8:45	MRD
Propylbenzene	ND	ug/L	1.00	3.35	5		09/10/10 8:45	MRD
sec-Butylbenzene	ND	ug/L	1.50	5.00	5		09/10/10 8:45	MRD
Styrene	ND	ug/L	0.50	2.50	5		09/10/10 8:45	MRD
tert-Butylbenzene	ND	ug/L	1.50	5.00	5		09/10/10 8:45	MRD
Tetrachloroethene	ND	ug/L	1.50	5.00	5		09/10/10 8:45	MRD
Toluene	ND	ug/L	2.00	6.50	5		09/10/10 8:45	MRD
trans-1,2-Dichloroethylene	ND	ug/L	2.50	6.50	5		09/10/10 8:45	MRD
trans-1,3-Dichloropropylene	ND	ug/L	2.00	6.50	5		09/10/10 8:45	MRD
Trichloroethene	ND	ug/L	2.00	6.50	5		09/10/10 8:45	MRD
Trichlorofluoromethane	ND	ug/L	1.50	5.00	5		09/10/10 8:45	MRD
Vinyl chloride	ND	ug/L	1.00	3.35	5		09/10/10 8:45	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attr: Tony Miller

Sample ID: IB-2 0-4'

Matrix: Soil

Sample Date/Time: 09/08/10 14:05

Lab No. : 1009149-06

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	42.5	47.2	118		09/10/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	46.0	47.2	118		09/10/10	MPM
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	42.5	47.2	118		09/10/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	48.4	53.1	118		09/10/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	43.7	47.2	118		09/10/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	67.3	70.8	118		09/10/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	105	106	118		09/10/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	55.5	59.0	118		09/10/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	57.8	59.0	118		09/10/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	49.6	53.1	118		09/10/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	42.5	47.2	118		09/10/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	117	118	118		09/10/10	MPM
1,2-Dibromomethane	ND	ug/kg dry	40.1	41.3	118		09/10/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	46.0	47.2	118		09/10/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	47.2	47.2	118		09/10/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	40.1	47.2	118		09/10/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	42.5	47.2	118		09/10/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	44.8	47.2	118		09/10/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	44.8	47.2	118		09/10/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	41.3	41.3	118		09/10/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	118	118	118		09/10/10	MPM
2-Chlorotoluene	ND	ug/kg dry	44.8	47.2	118		09/10/10	MPM
4-Chlorotoluene	ND	ug/kg dry	38.9	41.7	118		09/10/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	41.3	41.3	118		09/10/10	MPM
Benzene	ND	ug/kg dry	42.5	47.2	118		09/10/10	MPM
Bromobenzene	ND	ug/kg dry	41.3	41.3	118		09/10/10	MPM
Bromochloromethane	ND	ug/kg dry	43.7	47.2	118		09/10/10	MPM
Bromodichloromethane	ND	ug/kg dry	44.8	47.2	118		09/10/10	MPM
Bromoform	ND	ug/kg dry	56.6	59.0	118		09/10/10	MPM
Bromomethane	ND	ug/kg dry	118	118	118		09/10/10	MPM
Butylbenzene	ND	ug/kg dry	46.4	53.1	118		09/10/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	46.4	53.1	118		09/10/10	MPM
Chlorobenzene	ND	ug/kg dry	43.7	47.2	118		09/10/10	MPM
Chloroethane	ND	ug/kg dry	80.2	82.8	118		09/10/10	MPM
Chloroform	ND	ug/kg dry	41.3	47.2	118		09/10/10	MPM
Chloromethane	ND	ug/kg dry	41.3	41.3	118		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-2 0-4'

Matrix: Soil

Sample Date/Time: 09/08/10 14:05

Lab No. : 1009149-06

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	48.4	53.1	118		09/10/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	38.9	41.3	118		09/10/10	MPM
Dibromochloromethane	ND	ug/kg dry	38.9	41.3	118		09/10/10	MPM
Dibromomethane	ND	ug/kg dry	48.0	47.2	118		09/10/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	57.8	59.0	118		09/10/10	MPM
Ethylbenzene	ND	ug/kg dry	43.7	47.2	118		09/10/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	59.0	59.0	118		09/10/10	MPM
Isopropyl Ether	ND	ug/kg dry	85.0	88.5	118		09/10/10	MPM
isopropylbenzene (Cumene)	ND	ug/kg dry	42.5	47.2	118		09/10/10	MPM
m,p-Xylenes	ND	ug/kg dry	81.4	82.6	118		09/10/10	MPM
Methylene Chloride	ND	ug/kg dry	38.6	41.3	118		09/10/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	99.1	106	118		09/10/10	MPM
Naphthalene	ND	ug/kg dry	50.7	53.1	118		09/10/10	MPM
o-Xylene	ND	ug/kg dry	59.0	59.0	118		09/10/10	MPM
Propylbenzene	ND	ug/kg dry	42.5	47.2	118		09/10/10	MPM
sec-Butylbenzene	ND	ug/kg dry	47.2	47.2	118		09/10/10	MPM
Styrene	ND	ug/kg dry	41.3	47.2	118		09/10/10	MPM
tert-Butylbenzene	ND	ug/kg dry	43.7	47.2	118		09/10/10	MPM
Tetrachloroethene	ND	ug/kg dry	53.1	53.1	118		09/10/10	MPM
Toluene	ND	ug/kg dry	48.4	53.1	118		09/10/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	53.1	53.1	118		09/10/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	40.1	41.3	118		09/10/10	MPM
Trichloroethene	ND	ug/kg dry	43.7	47.2	118		09/10/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	56.6	59.0	118		09/10/10	MPM
Vinyl chloride	ND	ug/kg dry	54.3	59.0	118		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-2 4-8'

Matrix: Soil

Sample Date/Time: 09/08/10 14:15

Lab No. : 1009149-07

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	37.8	42.0	105		09/10/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	41.0	42.0	105		09/10/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	37.8	42.0	105		09/10/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	43.0	47.2	105		09/10/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	38.8	42.0	105		09/10/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	59.8	63.0	105		09/10/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	93.4	94.5	105		09/10/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	49.4	52.5	105		09/10/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	51.4	52.5	105		09/10/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	44.1	47.2	105		09/10/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	37.8	42.0	105		09/10/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	104	105	105		09/10/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	35.7	36.8	105		09/10/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	41.0	42.0	105		09/10/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	42.0	42.0	105		09/10/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	35.7	42.0	105		09/10/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	37.8	42.0	105		09/10/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	39.9	42.0	105		09/10/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	39.9	42.0	105		09/10/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	38.8	38.8	105		09/10/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	105	105	105		09/10/10	MPM
2-Chlorotoluene	ND	ug/kg dry	39.9	42.0	105		09/10/10	MPM
4-Chlorotoluene	ND	ug/kg dry	34.8	37.1	105		09/10/10	MPM
4-isopropyltoluene	ND	ug/kg dry	36.8	36.8	105		09/10/10	MPM
Benzene	ND	ug/kg dry	37.8	42.0	105		09/10/10	MPM
Bromobenzene	ND	ug/kg dry	36.9	36.8	105		09/10/10	MPM
Bromochloromethane	ND	ug/kg dry	38.8	42.0	105		09/10/10	MPM
Bromodichloromethane	ND	ug/kg dry	39.9	42.0	105		09/10/10	MPM
Bromoform	ND	ug/kg dry	50.4	52.5	105		09/10/10	MPM
Bromomethane	ND	ug/kg dry	105	105	105		09/10/10	MPM
Butylbenzene	ND	ug/kg dry	43.0	47.2	105		09/10/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	43.0	47.2	105		09/10/10	MPM
Chlorobenzene	ND	ug/kg dry	38.8	42.0	105		09/10/10	MPM
Chloroethane	ND	ug/kg dry	71.4	73.5	105		09/10/10	MPM
Chloroform	ND	ug/kg dry	36.8	42.0	105		09/10/10	MPM
Chloromethane	ND	ug/kg dry	36.8	36.8	105		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D : 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-2 4-8'

Matrix: Soil

Sample Date/Time: 09/08/10 14:15

Lab No. : 1009149-07

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	43.0	47.2	105		09/10/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	34.6	36.8	105		09/10/10	MPM
Dibromochloromethane	ND	ug/kg dry	34.6	36.8	105		09/10/10	MPM
Dibromomethane	ND	ug/kg dry	41.0	42.0	105		09/10/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	51.4	52.5	105		09/10/10	MPM
Ethylbenzene	ND	ug/kg dry	38.8	42.0	105		09/10/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	52.5	52.5	105		09/10/10	MPM
Isopropyl Ether	ND	ug/kg dry	75.6	78.8	105		09/10/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	37.8	42.0	105		09/10/10	MPM
m,p-Xylenes	ND	ug/kg dry	72.4	73.5	105		09/10/10	MPM
Methylene Chloride	ND	ug/kg dry	32.6	36.8	105		09/10/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	88.2	94.5	105		09/10/10	MPM
Naphthalene	ND	ug/kg dry	45.2	47.2	105		09/10/10	MPM
o-Xylene	ND	ug/kg dry	52.5	52.5	105		09/10/10	MPM
Propylbenzene	ND	ug/kg dry	37.8	42.0	105		09/10/10	MPM
sec-Butylbenzene	ND	ug/kg dry	42.0	42.0	105		09/10/10	MPM
Styrene	ND	ug/kg dry	36.8	42.0	105		09/10/10	MPM
tert-Butylbenzene	ND	ug/kg dry	38.8	42.0	105		09/10/10	MPM
Tetrachloroethene	ND	ug/kg dry	47.2	47.2	105		09/10/10	MPM
Toluene	ND	ug/kg dry	43.0	47.2	105		09/10/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	47.2	47.2	105		09/10/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	35.7	36.8	105		09/10/10	MPM
Trichloroethene	ND	ug/kg dry	38.8	42.0	105		09/10/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	50.4	52.5	105		09/10/10	MPM
Vinyl chloride	ND	ug/kg dry	48.3	52.5	105		09/10/10	MPM

SIEMENS

Gannett Fleming, inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-2 8-12' Matrix: Soil Sample Date/Time: 09/08/10 14:20 Lab No. : 1009149-08

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	39.6	44.0	110		09/10/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	42.9	44.0	110		09/10/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	39.8	44.0	110		09/10/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	45.1	49.5	110		09/10/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	40.7	44.0	110		09/10/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	62.7	66.0	110		09/10/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	97.9	99.0	110		09/10/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	51.7	55.0	110		09/10/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	53.9	55.0	110		09/10/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	46.2	49.5	110		09/10/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	39.8	44.0	110		09/10/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	109	110	110		09/10/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	37.4	38.5	110		09/10/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	42.9	44.0	110		09/10/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	44.0	44.0	110		09/10/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	37.4	44.0	110		09/10/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	39.8	44.0	110		09/10/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	41.8	44.0	110		09/10/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	41.8	44.0	110		09/10/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	38.5	38.5	110		09/10/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	110	110	110		09/10/10	MPM
2-Chlorotoluene	ND	ug/kg dry	41.8	44.0	110		09/10/10	MPM
4-Chlorotoluene	ND	ug/kg dry	36.3	38.8	110		09/10/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	38.5	38.5	110		09/10/10	MPM
Benzene	ND	ug/kg dry	39.8	44.0	110		09/10/10	MPM
Bromobenzene	ND	ug/kg dry	38.5	38.5	110		09/10/10	MPM
Bromochloromethane	ND	ug/kg dry	40.7	44.0	110		09/10/10	MPM
Bromodichloromethane	ND	ug/kg dry	41.8	44.0	110		09/10/10	MPM
Bromoform	ND	ug/kg dry	52.8	55.0	110		09/10/10	MPM
Bromomethane	ND	ug/kg dry	110	110	110		09/10/10	MPM
Butylbenzene	ND	ug/kg dry	45.1	49.5	110		09/10/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	45.1	49.5	110		09/10/10	MPM
Chlorobenzene	ND	ug/kg dry	40.7	44.0	110		09/10/10	MPM
Chloroethane	ND	ug/kg dry	74.8	77.0	110		09/10/10	MPM
Chloroform	ND	ug/kg dry	38.5	44.0	110		09/10/10	MPM
Chloromethane	ND	ug/kg dry	38.5	38.5	110		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-2 8-12' Matrix: Soil Sample Date/Time: 09/08/10 14:20 Lab No. : 1009149-08

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B Continued								
cis-1,2-Dichloroethylene	ND	ug/kg dry	45.1	49.5	110		09/10/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	36.3	38.5	110		09/10/10	MPM
Dibromochloromethane	ND	ug/kg dry	36.3	38.5	110		09/10/10	MPM
Dibromomethane	ND	ug/kg dry	42.9	44.0	110		09/10/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	53.9	55.0	110		09/10/10	MPM
Ethylbenzene	ND	ug/kg dry	40.7	44.0	110		09/10/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	55.0	55.0	110		09/10/10	MPM
Isopropyl Ether	ND	ug/kg dry	79.2	82.5	110		09/10/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	39.6	44.0	110		09/10/10	MPM
m,p-Xylenes	ND	ug/kg dry	75.9	77.0	110		09/10/10	MPM
Methylene Chloride	ND	ug/kg dry	34.1	38.5	110		09/10/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	92.4	99.0	110		09/10/10	MPM
Naphthalene	ND	ug/kg dry	47.3	49.5	110		09/10/10	MPM
o-Xylene	ND	ug/kg dry	55.0	55.0	110		09/10/10	MPM
Propylbenzene	ND	ug/kg dry	39.6	44.0	110		09/10/10	MPM
sec-Butylbenzene	ND	ug/kg dry	44.0	44.0	110		09/10/10	MPM
Styrene	ND	ug/kg dry	38.5	44.0	110		09/10/10	MPM
tert-Butylbenzene	ND	ug/kg dry	40.7	44.0	110		09/10/10	MPM
Tetrachloroethene	ND	ug/kg dry	49.5	49.5	110		09/10/10	MPM
Toluene	ND	ug/kg dry	45.1	49.5	110		09/10/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	49.5	49.5	110		09/10/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	37.4	38.5	110		09/10/10	MPM
Trichloroethene	ND	ug/kg dry	40.7	44.0	110		09/10/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	52.8	55.0	110		09/10/10	MPM
Vinyl chloride	ND	ug/kg dry	50.6	55.0	110		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-2 12-16'

Matrix: Soil

Sample Date/Time: 09/08/10 14:25

Lab No. : 1009149-09

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	38.0	40.0	100		09/10/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	39.0	40.0	100		09/10/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	36.0	40.0	100		09/10/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	41.0	45.0	100		09/10/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	37.0	40.0	100		09/10/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	57.0	60.0	100		09/10/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	89.0	90.0	100		09/10/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	47.0	50.0	100		09/10/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	49.0	50.0	100		09/10/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	42.0	45.0	100		09/10/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	38.0	40.0	100		09/10/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	99.0	100	100		09/10/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	34.0	35.0	100		09/10/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	39.0	40.0	100		09/10/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	40.0	40.0	100		09/10/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	34.0	40.0	100		09/10/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	38.0	40.0	100		09/10/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	38.0	40.0	100		09/10/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	38.0	40.0	100		09/10/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	35.0	35.0	100		09/10/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	100	100	100		09/10/10	MPM
2-Chlorotoluene	ND	ug/kg dry	38.0	40.0	100		09/10/10	MPM
4-Chlorotoluene	ND	ug/kg dry	33.0	35.3	100		09/10/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	35.0	35.0	100		09/10/10	MPM
Benzene	ND	ug/kg dry	38.0	40.0	100		09/10/10	MPM
Bromobenzene	ND	ug/kg dry	35.0	35.0	100		09/10/10	MPM
Bromochloromethane	ND	ug/kg dry	37.0	40.0	100		09/10/10	MPM
Bromodichloromethane	ND	ug/kg dry	38.0	40.0	100		09/10/10	MPM
Bromoform	ND	ug/kg dry	48.0	50.0	100		09/10/10	MPM
Bromomethane	ND	ug/kg dry	100	100	100		09/10/10	MPM
Butylbenzene	ND	ug/kg dry	41.0	45.0	100		09/10/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	41.0	45.0	100		09/10/10	MPM
Chlorobenzene	ND	ug/kg dry	37.0	40.0	100		09/10/10	MPM
Chloroethane	ND	ug/kg dry	68.0	70.0	100		09/10/10	MPM
Chloroform	ND	ug/kg dry	35.0	40.0	100		09/10/10	MPM
Chloromethane	ND	ug/kg dry	35.0	35.0	100		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D : 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-2 12-16'

Matrix: Soil

Sample Date/Time: 09/08/10 14:25

Lab No. : 1009149-09

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B Continued								
cis-1,2-Dichloroethylene	ND	ug/kg dry	41.0	45.0	100		09/10/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	33.0	35.0	100		09/10/10	MPM
Dibromochloromethane	ND	ug/kg dry	33.0	35.0	100		09/10/10	MPM
Dibromomethane	ND	ug/kg dry	39.0	40.0	100		09/10/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	49.0	50.0	100		09/10/10	MPM
Ethylbenzene	ND	ug/kg dry	37.0	40.0	100		09/10/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	50.0	50.0	100		09/10/10	MPM
Isopropyl Ether	ND	ug/kg dry	72.0	75.0	100		09/10/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	36.0	40.0	100		09/10/10	MPM
m,p-Xylenes	ND	ug/kg dry	69.0	70.0	100		09/10/10	MPM
Methylene Chloride	ND	ug/kg dry	31.0	35.0	100		09/10/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	84.0	90.0	100		09/10/10	MPM
Naphthalene	ND	ug/kg dry	43.0	45.0	100		09/10/10	MPM
o-Xylene	ND	ug/kg dry	50.0	50.0	100		09/10/10	MPM
Propylbenzene	ND	ug/kg dry	36.0	40.0	100		09/10/10	MPM
sec-Butylbenzene	ND	ug/kg dry	40.0	40.0	100		09/10/10	MPM
Styrene	ND	ug/kg dry	35.0	40.0	100		09/10/10	MPM
tert-Butylbenzene	ND	ug/kg dry	37.0	40.0	100		09/10/10	MPM
Tetrachloroethene	ND	ug/kg dry	45.0	45.0	100		09/10/10	MPM
Toluene	ND	ug/kg dry	41.0	45.0	100		09/10/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	45.0	45.0	100		09/10/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	34.0	35.0	100		09/10/10	MPM
Trichloroethene	ND	ug/kg dry	37.0	40.0	100		09/10/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	48.0	50.0	100		09/10/10	MPM
Vinyl chloride	ND	ug/kg dry	46.0	50.0	100		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-2 26.5-28'

Matrix: Air

Sample Date/Time: 09/08/10 14:45

Lab No. : 1009149-10

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/L	1.50	5.00	5		09/10/10 9:09	MRD
1,1,1-Trichloroethane	4.03	ug/L	2.50	8.50	5	J	09/10/10 9:09	MRD
1,1,2,2-Tetrachloroethane	ND	ug/L	2.00	6.50	5		09/10/10 9:09	MRD
1,1,2-Trichloroethane	ND	ug/L	2.00	6.50	5		09/10/10 9:09	MRD
1,1-Dichloroethane	ND	ug/L	2.00	6.50	5		09/10/10 9:09	MRD
1,1-Dichloroethylene	ND	ug/L	2.00	6.50	5		09/10/10 9:09	MRD
1,1-Dichloropropylene	ND	ug/L	4.00	13.5	5		09/10/10 9:09	MRD
1,2,3-Trichlorobenzene	ND	ug/L	2.50	8.50	5		09/10/10 9:09	MRD
1,2,3-Trichloropropane	ND	ug/L	5.00	16.5	5		09/10/10 9:09	MRD
1,2,4-Trichlorobenzene	ND	ug/L	2.50	8.50	5		09/10/10 9:09	MRD
1,2,4-Trimethylbenzene	ND	ug/L	1.00	3.35	5		09/10/10 9:09	MRD
1,2-Dibromo-3-chloropropane	ND	ug/L	6.50	21.5	5		09/10/10 9:09	MRD
1,2-Dibromoethane	ND	ug/L	1.50	5.00	5		09/10/10 9:09	MRD
1,2-Dichlorobenzene	ND	ug/L	4.00	13.5	5		09/10/10 9:09	MRD
1,2-Dichloroethane	ND	ug/L	1.50	5.00	5		09/10/10 9:09	MRD
1,2-Dichloropropane	ND	ug/L	2.00	6.50	5		09/10/10 9:09	MRD
1,3,5-Trimethylbenzene	ND	ug/L	1.00	3.35	5		09/10/10 9:09	MRD
1,3-Dichlorobenzene	ND	ug/L	1.00	3.35	5		09/10/10 9:09	MRD
1,3-Dichloropropane	ND	ug/L	1.00	3.35	5		09/10/10 9:09	MRD
1,4-Dichlorobenzene	ND	ug/L	4.00	13.5	5		09/10/10 9:09	MRD
2,2-Dichloropropane	ND	ug/L	5.00	16.5	5		09/10/10 9:09	MRD
2-Chlorotoluene	ND	ug/L	1.50	5.00	5		09/10/10 9:09	MRD
4-Chlorotoluene	ND	ug/L	1.50	5.00	5		09/10/10 9:09	MRD
4-Isopropyltoluene	ND	ug/L	2.00	6.65	5		09/10/10 9:09	MRD
Benzene	ND	ug/L	1.00	3.35	5		09/10/10 9:09	MRD
Bromobenzene	ND	ug/L	1.50	5.00	5		09/10/10 9:09	MRD
Bromochloromethane	ND	ug/L	2.00	6.50	5		09/10/10 9:09	MRD
Bromodichloromethane	ND	ug/L	2.00	6.50	5		09/10/10 9:09	MRD
Bromoform	ND	ug/L	1.00	3.35	5		09/10/10 9:09	MRD
Bromomethane	ND	ug/L	5.00	16.5	5		09/10/10 9:09	MRD
Butylbenzene	ND	ug/L	2.00	6.50	5		09/10/10 9:09	MRD
Carbon Tetrachloride	ND	ug/L	1.50	5.00	5		09/10/10 9:09	MRD
Chlorobenzene	ND	ug/L	1.00	3.35	5		09/10/10 9:09	MRD
Chloroethane	ND	ug/L	3.50	11.5	5		09/10/10 9:09	MRD
Chloroform	ND	ug/L	1.00	3.35	5		09/10/10 9:09	MRD
Chloromethane	ND	ug/L	2.00	6.50	5		09/10/10 9:09	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-2 26.5-28'

Matrix: Air

Sample Date/Time: 09/08/10 14:45

Lab No. : 1009149-10

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u>		<u>Analyst</u>
							<u>Analyzed</u>		
<u>EPA 8260B Continued</u>									
cis-1,2-Dichloroethylene	ND	ug/L	2.00	6.50	5		09/10/10	9:09	MRD
cis-1,3-Dichloropropylene	ND	ug/L	1.00	3.35	5		09/10/10	9:09	MRD
Dibromochloromethane	ND	ug/L	2.00	6.50	5		09/10/10	9:09	MRD
Dibromomethane	ND	ug/L	2.00	6.50	5		09/10/10	9:09	MRD
Dichlorodifluoromethane	ND	ug/L	1.50	5.00	5		09/10/10	9:09	MRD
Ethylbenzene	ND	ug/L	1.00	3.35	5		09/10/10	9:09	MRD
Hexachlorobutadiene	ND	ug/L	5.00	16.5	5		09/10/10	9:09	MRD
Isopropylbenzene (Cumene)	ND	ug/L	1.00	3.35	5		09/10/10	9:09	MRD
m,p-Xylenes	ND	ug/L	2.00	6.50	5		09/10/10	9:09	MRD
Methylene Chloride	ND	ug/L	2.00	6.50	5		09/10/10	9:09	MRD
Methyl-tert-Butyl Ether	ND	ug/L	2.50	8.50	5		09/10/10	9:09	MRD
Naphthalene	ND	ug/L	5.00	16.5	5		09/10/10	9:09	MRD
o-Xylene	ND	ug/L	1.00	3.35	5		09/10/10	9:09	MRD
Propylbenzene	ND	ug/L	1.00	3.35	5		09/10/10	9:09	MRD
sec-Butylbenzene	ND	ug/L	1.50	5.00	5		09/10/10	9:09	MRD
Styrene	ND	ug/L	0.50	2.50	5		09/10/10	9:09	MRD
tert-Butylbenzene	ND	ug/L	1.50	5.00	5		09/10/10	9:09	MRD
Tetrachloroethene	ND	ug/L	1.50	5.00	5		09/10/10	9:09	MRD
Toluene	ND	ug/L	2.00	6.50	5		09/10/10	9:09	MRD
trans-1,2-Dichloroethylene	ND	ug/L	2.50	8.50	5		09/10/10	9:09	MRD
trans-1,3-Dichloropropylene	ND	ug/L	2.00	6.50	5		09/10/10	9:09	MRD
Trichloroethene	ND	ug/L	2.00	6.50	5		09/10/10	9:09	MRD
Trichlorofluoromethane	ND	ug/L	1.50	5.00	5		09/10/10	9:09	MRD
Vinyl chloride	ND	ug/L	1.00	3.35	5		09/10/10	9:09	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-3 0-4'

Matrix: Soil

Sample Date/Time: 09/08/10 15:05

Lab No. : 1009149-11

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	42.8	47.6	119		09/10/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	46.4	47.6	119		09/10/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	42.8	47.6	119		09/10/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	48.8	53.6	119		09/10/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	44.0	47.6	119		09/10/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	67.8	71.4	119		09/10/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	106	107	119		09/10/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	55.9	59.5	119		09/10/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	58.3	59.5	119		09/10/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	50.0	53.6	119		09/10/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	42.8	47.6	119		09/10/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	118	119	119		09/10/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	40.5	41.6	119		09/10/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	48.4	47.6	119		09/10/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	47.6	47.6	119		09/10/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	40.5	47.6	119		09/10/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	42.8	47.6	119		09/10/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	45.2	47.6	119		09/10/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	45.2	47.6	119		09/10/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	41.8	41.8	119		09/10/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	119	119	119		09/10/10	MPM
2-Chlorotoluene	ND	ug/kg dry	45.2	47.6	119		09/10/10	MPM
4-Chlorotoluene	ND	ug/kg dry	39.3	42.0	119		09/10/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	41.8	41.8	119		09/10/10	MPM
Benzene	ND	ug/kg dry	42.8	47.6	119		09/10/10	MPM
Bromobenzene	ND	ug/kg dry	41.8	41.6	119		09/10/10	MPM
Bromochloromethane	ND	ug/kg dry	44.0	47.6	119		09/10/10	MPM
Bromodichloromethane	ND	ug/kg dry	45.2	47.6	119		09/10/10	MPM
Bromoform	ND	ug/kg dry	57.1	59.5	119		09/10/10	MPM
Bromomethane	ND	ug/kg dry	119	119	119		09/10/10	MPM
Butylbenzene	ND	ug/kg dry	48.8	53.6	119		09/10/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	48.8	53.6	119		09/10/10	MPM
Chlorobenzene	ND	ug/kg dry	44.0	47.6	119		09/10/10	MPM
Chloroethane	ND	ug/kg dry	80.9	83.3	119		09/10/10	MPM
Chloroform	ND	ug/kg dry	41.8	47.6	119		09/10/10	MPM
Chloromethane	ND	ug/kg dry	41.8	41.8	119		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-3 0-4'

Matrix: Soil

Sample Date/Time: 09/08/10 15:05

Lab No. : 1009149-11

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	48.6	53.6	119		09/10/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	39.3	41.6	119		09/10/10	MPM
Dibromochloromethane	ND	ug/kg dry	39.3	41.6	119		09/10/10	MPM
Dibromomethane	ND	ug/kg dry	46.4	47.8	119		09/10/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	56.3	59.5	119		09/10/10	MPM
Ethylbenzene	ND	ug/kg dry	44.0	47.8	119		09/10/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	59.5	59.5	119		09/10/10	MPM
Isopropyl Ether	ND	ug/kg dry	65.7	69.2	119		09/10/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	42.6	47.8	119		09/10/10	MPM
m,p-Xylenes	ND	ug/kg dry	82.1	83.3	119		09/10/10	MPM
Methylene Chloride	ND	ug/kg dry	36.9	41.6	119		09/10/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	100	107	119		09/10/10	MPM
Naphthalene	ND	ug/kg dry	51.2	53.6	119		09/10/10	MPM
o-Xylene	ND	ug/kg dry	59.5	59.5	119		09/10/10	MPM
Propylbenzene	ND	ug/kg dry	42.6	47.8	119		09/10/10	MPM
sec-Butylbenzene	ND	ug/kg dry	47.6	47.8	119		09/10/10	MPM
Styrene	ND	ug/kg dry	41.6	47.6	119		09/10/10	MPM
tert-Butylbenzene	ND	ug/kg dry	44.0	47.8	119		09/10/10	MPM
Tetrachloroethene	ND	ug/kg dry	53.6	53.6	119		09/10/10	MPM
Toluene	ND	ug/kg dry	48.6	53.6	119		09/10/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	53.6	53.6	119		09/10/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	40.5	41.6	119		09/10/10	MPM
Trichloroethene	ND	ug/kg dry	44.0	47.6	119		09/10/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	57.1	59.5	119		09/10/10	MPM
Vinyl chloride	ND	ug/kg dry	54.7	59.5	119		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-3 4-8'

Matrix: Soil

Sample Date/Time: 09/08/10 15:10

Lab No. : 1009149-12

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	36.7	40.8	102		09/10/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	39.8	40.8	102		09/10/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	36.7	40.8	102		09/10/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	41.8	45.9	102		09/10/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	37.7	40.8	102		09/10/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	58.1	61.2	102		09/10/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	90.8	91.8	102		09/10/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	47.9	51.0	102		09/10/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	50.0	51.0	102		09/10/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	42.8	45.9	102		09/10/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	36.7	40.8	102		09/10/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	101	102	102		09/10/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	34.7	35.7	102		09/10/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	39.8	40.8	102		09/10/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	40.8	40.8	102		09/10/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	34.7	40.8	102		09/10/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	36.7	40.8	102		09/10/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	38.8	40.8	102		09/10/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	38.8	40.8	102		09/10/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	35.7	35.7	102		09/10/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	102	102	102		09/10/10	MPM
2-Chlorotoluene	ND	ug/kg dry	38.8	40.8	102		09/10/10	MPM
4-Chlorotoluene	ND	ug/kg dry	33.7	36.0	102		09/10/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	35.7	35.7	102		09/10/10	MPM
Benzene	ND	ug/kg dry	36.7	40.8	102		09/10/10	MPM
Bromobenzene	ND	ug/kg dry	35.7	35.7	102		09/10/10	MPM
Bromochloromethane	ND	ug/kg dry	37.7	40.8	102		09/10/10	MPM
Bromodichloromethane	ND	ug/kg dry	38.8	40.8	102		09/10/10	MPM
Bromoform	ND	ug/kg dry	49.0	51.0	102		09/10/10	MPM
Bromomethane	ND	ug/kg dry	102	102	102		09/10/10	MPM
Butylbenzene	ND	ug/kg dry	41.8	45.9	102		09/10/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	41.8	45.9	102		09/10/10	MPM
Chlorobenzene	ND	ug/kg dry	37.7	40.8	102		09/10/10	MPM
Chloroethane	ND	ug/kg dry	69.4	71.4	102		09/10/10	MPM
Chloroform	ND	ug/kg dry	35.7	40.8	102		09/10/10	MPM
Chloromethane	ND	ug/kg dry	35.7	35.7	102		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D : 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-3 4-8*

Matrix: Soil

Sample Date/Time: 09/08/10 15:10

Lab No. : 1009149-12

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B Continued								
cis-1,2-Dichloroethylene	ND	ug/kg dry	41.8	45.9	102		09/10/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	33.7	35.7	102		09/10/10	MPM
Dibromochloromethane	ND	ug/kg dry	33.7	35.7	102		09/10/10	MPM
Dibromomethane	ND	ug/kg dry	39.8	40.8	102		09/10/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	50.0	51.0	102		09/10/10	MPM
Ethylbenzene	ND	ug/kg dry	37.7	40.8	102		09/10/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	51.0	51.0	102		09/10/10	MPM
Isopropyl Ether	ND	ug/kg dry	73.4	76.5	102		09/10/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	36.7	40.8	102		09/10/10	MPM
m,p-Xylenes	ND	ug/kg dry	70.4	71.4	102		09/10/10	MPM
Methylene Chloride	ND	ug/kg dry	31.6	35.7	102		09/10/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	85.7	91.8	102		09/10/10	MPM
Naphthalene	ND	ug/kg dry	43.9	45.9	102		09/10/10	MPM
o-Xylene	ND	ug/kg dry	51.0	51.0	102		09/10/10	MPM
Propylbenzene	ND	ug/kg dry	36.7	40.8	102		09/10/10	MPM
sec-Butylbenzene	ND	ug/kg dry	40.8	40.8	102		09/10/10	MPM
Styrene	ND	ug/kg dry	35.7	40.8	102		09/10/10	MPM
tert-Butylbenzene	ND	ug/kg dry	37.7	40.8	102		09/10/10	MPM
Tetrachloroethene	ND	ug/kg dry	45.9	45.9	102		09/10/10	MPM
Toluene	ND	ug/kg dry	41.8	45.9	102		09/10/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	45.9	45.9	102		09/10/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	34.7	35.7	102		09/10/10	MPM
Trichloroethene	ND	ug/kg dry	37.7	40.8	102		09/10/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	49.0	51.0	102		09/10/10	MPM
Vinyl chloride	ND	ug/kg dry	46.9	51.0	102		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D : 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-3 8-12'

Matrix: Soil

Sample Date/Time: 09/08/10 15:20

Lab No. : 1009149-13

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	38.0	40.0	100		09/10/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	39.0	40.0	100		09/10/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	38.0	40.0	100		09/10/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	41.0	45.0	100		09/10/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	37.0	40.0	100		09/10/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	57.0	60.0	100		09/10/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	89.0	90.0	100		09/10/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	47.0	50.0	100		09/10/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	49.0	50.0	100		09/10/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	42.0	45.0	100		09/10/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	36.0	40.0	100		09/10/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	99.0	100	100		09/10/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	34.0	35.0	100		09/10/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	39.0	40.0	100		09/10/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	40.0	40.0	100		09/10/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	34.0	40.0	100		09/10/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	38.0	40.0	100		09/10/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	38.0	40.0	100		09/10/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	38.0	40.0	100		09/10/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	35.0	35.0	100		09/10/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	100	100	100		09/10/10	MPM
2-Chlorotoluene	ND	ug/kg dry	38.0	40.0	100		09/10/10	MPM
4-Chlorotoluene	ND	ug/kg dry	33.0	35.3	100		09/10/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	35.0	35.0	100		09/10/10	MPM
Benzene	ND	ug/kg dry	36.0	40.0	100		09/10/10	MPM
Bromobenzene	ND	ug/kg dry	35.0	35.0	100		09/10/10	MPM
Bromochloromethane	ND	ug/kg dry	37.0	40.0	100		09/10/10	MPM
Bromodichloromethane	ND	ug/kg dry	38.0	40.0	100		09/10/10	MPM
Bromoform	ND	ug/kg dry	48.0	50.0	100		09/10/10	MPM
Bromomethane	ND	ug/kg dry	100	100	100		09/10/10	MPM
Butylbenzene	ND	ug/kg dry	41.0	45.0	100		09/10/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	41.0	45.0	100		09/10/10	MPM
Chlorobenzene	ND	ug/kg dry	37.0	40.0	100		09/10/10	MPM
Chloroethane	ND	ug/kg dry	68.0	70.0	100		09/10/10	MPM
Chloroform	ND	ug/kg dry	35.0	40.0	100		09/10/10	MPM
Chloromethane	ND	ug/kg dry	35.0	35.0	100		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: **IB-3 8-12'**

Matrix: **Soil**

Sample Date/Time: **09/08/10 15:20**

Lab No. : **1009149-13**

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	41.0	45.0	100		09/10/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	33.0	35.0	100		09/10/10	MPM
Dibromochloromethane	ND	ug/kg dry	33.0	35.0	100		09/10/10	MPM
Dibromomethane	ND	ug/kg dry	39.0	40.0	100		09/10/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	49.0	50.0	100		09/10/10	MPM
Ethylbenzene	ND	ug/kg dry	37.0	40.0	100		09/10/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	50.0	50.0	100		09/10/10	MPM
Isopropyl Ether	ND	ug/kg dry	72.0	75.0	100		09/10/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	36.0	40.0	100		09/10/10	MPM
m,p-Xylenes	ND	ug/kg dry	69.0	70.0	100		09/10/10	MPM
Methylene Chloride	ND	ug/kg dry	31.0	35.0	100		09/10/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	84.0	90.0	100		09/10/10	MPM
Naphthalene	ND	ug/kg dry	43.0	45.0	100		09/10/10	MPM
o-Xylene	ND	ug/kg dry	50.0	50.0	100		09/10/10	MPM
Propylbenzene	ND	ug/kg dry	36.0	40.0	100		09/10/10	MPM
sec-Butylbenzene	ND	ug/kg dry	40.0	40.0	100		09/10/10	MPM
Styrene	ND	ug/kg dry	35.0	40.0	100		09/10/10	MPM
tert-Butylbenzene	ND	ug/kg dry	37.0	40.0	100		09/10/10	MPM
Tetrachloroethene	ND	ug/kg dry	45.0	45.0	100		09/10/10	MPM
Toluene	ND	ug/kg dry	41.0	45.0	100		09/10/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	45.0	45.0	100		09/10/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	34.0	35.0	100		09/10/10	MPM
Trichloroethene	ND	ug/kg dry	37.0	40.0	100		09/10/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	48.0	50.0	100		09/10/10	MPM
Vinyl chloride	ND	ug/kg dry	46.0	50.0	100		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attr: Tony Miller

Sample ID: IB-3 12-16'

Matrix: Soil

Sample Date/Time: 09/08/10 15:30

Lab No. : 1009149-14

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
1,1,1-Trichloroethane	ND	ug/kg dry	40.2	41.2	103		09/10/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
1,1,2-Trichloroethane	ND	ug/kg dry	42.2	46.4	103		09/10/10	MPM
1,1-Dichloroethane	ND	ug/kg dry	38.1	41.2	103		09/10/10	MPM
1,1-Dichloroethylene	ND	ug/kg dry	58.7	61.8	103		09/10/10	MPM
1,1-Dichloropropylene	ND	ug/kg dry	91.7	92.7	103		09/10/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg dry	48.4	51.5	103		09/10/10	MPM
1,2,3-Trichloropropane	ND	ug/kg dry	50.5	51.5	103		09/10/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg dry	43.3	46.4	103		09/10/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg dry	102	103	103		09/10/10	MPM
1,2-Dibromoethane	ND	ug/kg dry	35.0	36.0	103		09/10/10	MPM
1,2-Dichlorobenzene	ND	ug/kg dry	40.2	41.2	103		09/10/10	MPM
1,2-Dichloroethane	ND	ug/kg dry	41.2	41.2	103		09/10/10	MPM
1,2-Dichloropropane	ND	ug/kg dry	35.0	41.2	103		09/10/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
1,3-Dichlorobenzene	ND	ug/kg dry	39.1	41.2	103		09/10/10	MPM
1,3-Dichloropropane	ND	ug/kg dry	39.1	41.2	103		09/10/10	MPM
1,4-Dichlorobenzene	ND	ug/kg dry	36.0	36.0	103		09/10/10	MPM
2,2-Dichloropropane	ND	ug/kg dry	103	103	103		09/10/10	MPM
2-Chlorotoluene	ND	ug/kg dry	39.1	41.2	103		09/10/10	MPM
4-Chlorotoluene	ND	ug/kg dry	34.0	36.4	103		09/10/10	MPM
4-Isopropyltoluene	ND	ug/kg dry	36.0	36.0	103		09/10/10	MPM
Benzene	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
Bromobenzene	ND	ug/kg dry	36.0	36.0	103		09/10/10	MPM
Bromochloromethane	ND	ug/kg dry	38.1	41.2	103		09/10/10	MPM
Bromodichloromethane	ND	ug/kg dry	39.1	41.2	103		09/10/10	MPM
Bromoform	ND	ug/kg dry	49.4	51.5	103		09/10/10	MPM
Bromomethane	ND	ug/kg dry	103	103	103		09/10/10	MPM
Butylbenzene	ND	ug/kg dry	42.2	46.4	103		09/10/10	MPM
Carbon Tetrachloride	ND	ug/kg dry	42.2	46.4	103		09/10/10	MPM
Chlorobenzene	ND	ug/kg dry	36.1	41.2	103		09/10/10	MPM
Chloroethane	ND	ug/kg dry	70.0	72.1	103		09/10/10	MPM
Chloroform	ND	ug/kg dry	36.0	41.2	103		09/10/10	MPM
Chloromethane	ND	ug/kg dry	36.0	36.0	103		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-3 12-16'

Matrix: Soil

Sample Date/Time: 09/08/10 15:30

Lab No. : 1009149-14

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution Factor</u>	<u>Qualifiers</u>	<u>Date Analyzed</u>	<u>Analyst</u>
<u>EPA 8260B Continued</u>								
cis-1,2-Dichloroethylene	ND	ug/kg dry	42.2	46.4	103		09/10/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg dry	34.0	36.0	103		09/10/10	MPM
Dibromochloromethane	ND	ug/kg dry	34.0	36.0	103		09/10/10	MPM
Dibromomethane	ND	ug/kg dry	40.2	41.2	103		09/10/10	MPM
Dichlorodifluoromethane	ND	ug/kg dry	50.5	51.5	103		09/10/10	MPM
Ethylbenzene	ND	ug/kg dry	38.1	41.2	103		09/10/10	MPM
Hexachlorobutadiene	ND	ug/kg dry	51.5	51.5	103		09/10/10	MPM
Isopropyl Ether	ND	ug/kg dry	74.2	77.2	103		09/10/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
m,p-Xylenes	ND	ug/kg dry	71.1	72.1	103		09/10/10	MPM
Methylene Chloride	ND	ug/kg dry	31.9	36.0	103		09/10/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg dry	86.5	92.7	103		09/10/10	MPM
Naphthalene	ND	ug/kg dry	44.3	46.4	103		09/10/10	MPM
o-Xylene	ND	ug/kg dry	51.5	51.5	103		09/10/10	MPM
Propylbenzene	ND	ug/kg dry	37.1	41.2	103		09/10/10	MPM
sec-Butylbenzene	ND	ug/kg dry	41.2	41.2	103		09/10/10	MPM
Styrene	ND	ug/kg dry	36.0	41.2	103		09/10/10	MPM
tert-Butylbenzene	ND	ug/kg dry	38.1	41.2	103		09/10/10	MPM
Tetrachloroethene	ND	ug/kg dry	46.4	46.4	103		09/10/10	MPM
Toluene	ND	ug/kg dry	42.2	46.4	103		09/10/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg dry	46.4	46.4	103		09/10/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg dry	35.0	36.0	103		09/10/10	MPM
Trichloroethene	ND	ug/kg dry	38.1	41.2	103		09/10/10	MPM
Trichlorofluoromethane	ND	ug/kg dry	49.4	51.5	103		09/10/10	MPM
Vinyl chloride	ND	ug/kg dry	47.4	51.5	103		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-3 26.5-28'

Matrix: Air

Sample Date/Time: 09/08/10 15:45

Lab No. : 1009149-15

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u>		<u>Analyst</u>
							<u>Analyzed</u>		
EPA 8260B									
1,1,1,2-Tetrachloroethane	ND	ug/L	1.50	5.00	5		09/10/10	9:33	MRD
1,1,1-Trichloroethane	ND	ug/L	2.50	8.50	5		09/10/10	9:33	MRD
1,1,1,2-Tetrachloroethane	ND	ug/L	2.00	6.50	5		09/10/10	9:33	MRD
1,1,2-Trichloroethane	ND	ug/L	2.00	6.50	5		09/10/10	9:33	MRD
1,1-Dichloroethane	ND	ug/L	2.00	6.50	5		09/10/10	9:33	MRD
1,1-Dichloroethylene	ND	ug/L	2.00	6.50	5		09/10/10	9:33	MRD
1,1-Dichloropropylene	ND	ug/L	4.00	13.5	5		09/10/10	9:33	MRD
1,2,3-Trichlorobenzene	ND	ug/L	2.50	8.50	5		09/10/10	9:33	MRD
1,2,3-Trichloropropane	ND	ug/L	5.00	16.5	5		09/10/10	9:33	MRD
1,2,4-Trichlorobenzene	ND	ug/L	2.50	8.50	5		09/10/10	9:33	MRD
1,2,4-Trimethylbenzene	ND	ug/L	1.00	3.35	5		09/10/10	9:33	MRD
1,2-Dibromo-3-chloropropane	ND	ug/L	8.50	21.5	5		09/10/10	9:33	MRD
1,2-Dibromoethane	ND	ug/L	1.50	5.00	5		09/10/10	9:33	MRD
1,2-Dichlorobenzene	ND	ug/L	4.00	13.5	5		09/10/10	9:33	MRD
1,2-Dichloroethane	ND	ug/L	1.50	5.00	5		09/10/10	9:33	MRD
1,2-Dichloropropane	ND	ug/L	2.00	6.50	5		09/10/10	9:33	MRD
1,3,5-Trimethylbenzene	ND	ug/L	1.00	3.35	5		09/10/10	9:33	MRD
1,3-Dichlorobenzene	ND	ug/L	1.00	3.35	5		09/10/10	9:33	MRD
1,3-Dichloropropane	ND	ug/L	1.00	3.35	5		09/10/10	9:33	MRD
1,4-Dichlorobenzene	ND	ug/L	4.00	13.5	5		09/10/10	9:33	MRD
2,2-Dichloropropane	ND	ug/L	5.00	16.5	5		09/10/10	9:33	MRD
2-Chlorotoluene	ND	ug/L	1.50	5.00	5		09/10/10	9:33	MRD
4-Chlorotoluene	ND	ug/L	1.50	5.00	5		09/10/10	9:33	MRD
4-Isopropyltoluene	ND	ug/L	2.00	6.65	5		09/10/10	9:33	MRD
Benzene	ND	ug/L	1.00	3.35	5		09/10/10	9:33	MRD
Bromobenzene	ND	ug/L	1.50	5.00	5		09/10/10	9:33	MRD
Bromochloromethane	ND	ug/L	2.00	6.50	5		09/10/10	9:33	MRD
Bromodichloromethane	ND	ug/L	2.00	6.50	5		09/10/10	9:33	MRD
Bromoform	ND	ug/L	1.00	3.35	5		09/10/10	9:33	MRD
Bromomethane	ND	ug/L	5.00	16.5	5		09/10/10	9:33	MRD
Butylbenzene	ND	ug/L	2.00	6.50	5		09/10/10	9:33	MRD
Carbon Tetrachloride	ND	ug/L	1.50	5.00	5		09/10/10	9:33	MRD
Chlorobenzene	ND	ug/L	1.00	3.35	5		09/10/10	9:33	MRD
Chloroethane	ND	ug/L	3.50	11.5	5		09/10/10	9:33	MRD
Chloroform	ND	ug/L	1.00	3.35	5		09/10/10	9:33	MRD
Chloromethane	ND	ug/L	2.00	6.50	5		09/10/10	9:33	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D : 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: IB-3 26.5-28'

Matrix: Air

Sample Date/Time: 09/08/10 15:45

Lab No. : 1009149-15

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u>		<u>Analyst</u>
							<u>Analyzed</u>		
<u>EPA 8260B Continued</u>									
cis-1,2-Dichloroethylene	ND	ug/L	2.00	6.50	5		09/10/10	9:33	MRD
cis-1,3-Dichloropropylene	ND	ug/L	1.00	3.35	5		09/10/10	9:33	MRD
Dibromochloromethane	ND	ug/L	2.00	6.50	5		09/10/10	9:33	MRD
Dibromomethane	ND	ug/L	2.00	6.50	5		09/10/10	9:33	MRD
Dichlorodifluoromethane	ND	ug/L	1.50	5.00	5		09/10/10	9:33	MRD
Ethylbenzene	ND	ug/L	1.00	3.35	5		09/10/10	9:33	MRD
Hexachlorobutadiene	ND	ug/L	5.00	16.5	5		09/10/10	9:33	MRD
Isopropylbenzene (Cumene)	ND	ug/L	1.00	3.35	5		09/10/10	9:33	MRD
m,p-Xylenes	ND	ug/L	2.00	6.50	5		09/10/10	9:33	MRD
Methylene Chloride	ND	ug/L	2.00	6.50	5		09/10/10	9:33	MRD
Methyl-tert-Butyl Ether	ND	ug/L	2.50	8.50	5		09/10/10	9:33	MRD
Naphthalene	ND	ug/L	5.00	16.5	5		09/10/10	9:33	MRD
o-Xylene	ND	ug/L	1.00	3.35	5		09/10/10	9:33	MRD
Propylbenzene	ND	ug/L	1.00	3.35	5		09/10/10	9:33	MRD
sec-Butylbenzene	ND	ug/L	1.50	5.00	5		09/10/10	9:33	MRD
Styrene	ND	ug/L	0.50	2.50	5		09/10/10	9:33	MRD
tert-Butylbenzene	ND	ug/L	1.50	5.00	5		09/10/10	9:33	MRD
Tetrachloroethene	ND	ug/L	1.50	5.00	5		09/10/10	9:33	MRD
Toluene	ND	ug/L	2.00	6.50	5		09/10/10	9:33	MRD
trans-1,2-Dichloroethylene	ND	ug/L	2.50	8.50	5		09/10/10	9:33	MRD
trans-1,3-Dichloropropylene	ND	ug/L	2.00	6.50	5		09/10/10	9:33	MRD
Trichloroethene	ND	ug/L	2.00	6.50	5		09/10/10	9:33	MRD
Trichlorofluoromethane	ND	ug/L	1.50	5.00	5		09/10/10	9:33	MRD
Vinyl chloride	ND	ug/L	1.00	3.35	5		09/10/10	9:33	MRD

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D : 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: MeOH Blank

Matrix: Soil

Sample Date/Time: 09/08/10 0:00

Lab No. : 1009149-16

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B								
1,1,1,2-Tetrachloroethane	ND	ug/kg	36.0	40.0	100		09/10/10	MPM
1,1,1-Trichloroethane	ND	ug/kg	39.0	40.0	100		09/10/10	MPM
1,1,2,2-Tetrachloroethane	ND	ug/kg	36.0	40.0	100		09/10/10	MPM
1,1,2-Trichloroethane	ND	ug/kg	41.0	45.0	100		09/10/10	MPM
1,1-Dichloroethane	ND	ug/kg	37.0	40.0	100		09/10/10	MPM
1,1-Dichloroethylene	ND	ug/kg	57.0	60.0	100		09/10/10	MPM
1,1-Dichloropropylene	ND	ug/kg	89.0	90.0	100		09/10/10	MPM
1,2,3-Trichlorobenzene	ND	ug/kg	47.0	50.0	100		09/10/10	MPM
1,2,3-Trichloropropane	ND	ug/kg	49.0	50.0	100		09/10/10	MPM
1,2,4-Trichlorobenzene	ND	ug/kg	42.0	45.0	100		09/10/10	MPM
1,2,4-Trimethylbenzene	ND	ug/kg	38.0	40.0	100		09/10/10	MPM
1,2-Dibromo-3-chloropropane	ND	ug/kg	99.0	100	100		09/10/10	MPM
1,2-Dibromoethane	ND	ug/kg	34.0	35.0	100		09/10/10	MPM
1,2-Dichlorobenzene	ND	ug/kg	39.0	40.0	100		09/10/10	MPM
1,2-Dichloroethane	ND	ug/kg	40.0	40.0	100		09/10/10	MPM
1,2-Dichloropropane	ND	ug/kg	34.0	40.0	100		09/10/10	MPM
1,3,5-Trimethylbenzene	ND	ug/kg	36.0	40.0	100		09/10/10	MPM
1,3-Dichlorobenzene	ND	ug/kg	36.0	40.0	100		09/10/10	MPM
1,3-Dichloropropane	ND	ug/kg	36.0	40.0	100		09/10/10	MPM
1,4-Dichlorobenzene	ND	ug/kg	35.0	35.0	100		09/10/10	MPM
2,2-Dichloropropane	ND	ug/kg	100	100	100		09/10/10	MPM
2-Chlorotoluene	ND	ug/kg	38.0	40.0	100		09/10/10	MPM
4-Chlorotoluene	ND	ug/kg	33.0	35.3	100		09/10/10	MPM
4-Isopropyltoluene	ND	ug/kg	35.0	35.0	100		09/10/10	MPM
Benzene	ND	ug/kg	36.0	40.0	100		09/10/10	MPM
Bromobenzene	ND	ug/kg	35.0	35.0	100		09/10/10	MPM
Bromochloromethane	ND	ug/kg	37.0	40.0	100		09/10/10	MPM
Bromodichloromethane	ND	ug/kg	38.0	40.0	100		09/10/10	MPM
Bromoform	ND	ug/kg	48.0	50.0	100		09/10/10	MPM
Bromomethane	ND	ug/kg	100	100	100		09/10/10	MPM
Butylbenzene	ND	ug/kg	41.0	45.0	100		09/10/10	MPM
Carbon Tetrachloride	ND	ug/kg	41.0	45.0	100		09/10/10	MPM
Chlorobenzene	ND	ug/kg	37.0	40.0	100		09/10/10	MPM
Chloroethane	ND	ug/kg	68.0	70.0	100		09/10/10	MPM
Chloroform	ND	ug/kg	35.0	40.0	100		09/10/10	MPM
Chloromethane	ND	ug/kg	35.0	35.0	100		09/10/10	MPM

SIEMENS

Gannett Fleming, Inc.
8025 Excelsior Drive
Madison, WI 53717

PROJECT NO. : 34286.008
REPORT NO. : 1009149
DATE REC'D 09/09/10 08:45
REPORT DATE : 09/13/10 12:50
PREPARED BY : BMS

Attn: Tony Miller

Sample ID: MeOH Blank

Matrix: Soil

Sample Date/Time: 09/08/10 0:00

Lab No. : 1009149-16

	<u>Results</u>	<u>Units</u>	<u>LOD</u>	<u>LOQ</u>	<u>Dilution</u> <u>Factor</u>	<u>Qualifiers</u>	<u>Date</u> <u>Analyzed</u>	<u>Analyst</u>
EPA 8260B Continued								
cis-1,2-Dichloroethylene	ND	ug/kg	41.0	45.0	100		09/10/10	MPM
cis-1,3-Dichloropropylene	ND	ug/kg	33.0	35.0	100		09/10/10	MPM
Dibromochloromethane	ND	ug/kg	33.0	35.0	100		09/10/10	MPM
Dibromomethane	ND	ug/kg	39.0	40.0	100		09/10/10	MPM
Dichlorodifluoromethane	ND	ug/kg	49.0	50.0	100		09/10/10	MPM
Ethylbenzene	ND	ug/kg	37.0	40.0	100		09/10/10	MPM
Hexachlorobutadiene	ND	ug/kg	50.0	50.0	100		09/10/10	MPM
Isopropyl Ether	ND	ug/kg	72.0	75.0	100		09/10/10	MPM
Isopropylbenzene (Cumene)	ND	ug/kg	36.0	40.0	100		09/10/10	MPM
m,p-Xylenes	ND	ug/kg	69.0	70.0	100		09/10/10	MPM
Methylene Chloride	ND	ug/kg	31.0	35.0	100		09/10/10	MPM
Methyl-tert-Butyl Ether	ND	ug/kg	84.0	90.0	100		09/10/10	MPM
Naphthalene	ND	ug/kg	43.0	45.0	100		09/10/10	MPM
o-Xylene	ND	ug/kg	50.0	50.0	100		09/10/10	MPM
Propylbenzene	ND	ug/kg	36.0	40.0	100		09/10/10	MPM
sec-Butylbenzene	ND	ug/kg	40.0	40.0	100		09/10/10	MPM
Styrene	ND	ug/kg	35.0	40.0	100		09/10/10	MPM
tert-Butylbenzene	ND	ug/kg	37.0	40.0	100		09/10/10	MPM
Tetrachloroethene	ND	ug/kg	45.0	45.0	100		09/10/10	MPM
Toluene	ND	ug/kg	41.0	45.0	100		09/10/10	MPM
trans-1,2-Dichloroethylene	ND	ug/kg	45.0	45.0	100		09/10/10	MPM
trans-1,3-Dichloropropylene	ND	ug/kg	34.0	35.0	100		09/10/10	MPM
Trichloroethene	ND	ug/kg	37.0	40.0	100		09/10/10	MPM
Trichlorofluoromethane	ND	ug/kg	48.0	50.0	100		09/10/10	MPM
Vinyl chloride	ND	ug/kg	46.0	50.0	100		09/10/10	MPM

SIEMENS

Qualifier Descriptions

S2H	Second sample matrix spike recovery was high.
J	Estimated concentration below laboratory quantitation level.

Definitions

LOD = Limit of Detection (Dilution Corrected)
LOQ = Limit of Quantitation (Dilution Corrected)
Reporting Limit = LOQ (Dilution Corrected)
ND = Not Detected
COMP = Complete
SUBCON = Subcontracted analysis
mv = millivolts
pci/L = picocuries per Liter
mL/L = milliliters per Liter
mg = milligram

When the word "dry" follows the units on the result page the sample results are dry weight corrected.

LODs and LOQs are dry weight corrected for all soils except WI GRO, EPA 8021 and WI DNR/EPA 8260B methanol and WI DNR methylene chloride preserved soils being reported to the State of Wisconsin.

ug/l = Micrograms per Liter = parts per billion (ppb)
ug/kg = Micrograms per kilogram = parts per billion (ppb)
mg/l = Milligrams per liter = parts per million (ppm)
mg/kg = Milligrams per kilogram = parts per million (ppm)
NOT PRES = Not Present
ppth = Parts per thousand
* = Result outside established limits.
mg/m³ = Milligrams per meter cubed
ng/L = Nanograms per Liter = Parts per trillion (ppt)
> = Greater Than

State of Wisconsin Methanol Soils for WI GRO, WI DNR/EPA 8260B and EPA 8021 are reported to the LOQ.

Company Name GANNETT FLEMING		Project 34286.008	
Report Mailing Address 8025 EXCELSIOR DR MADISON, WI 53717		Contact Name, Phone, Fax, Email TONY MILLER p 608-836-1500 awmiller@gfnet.com	
Invoice Address SAME AS ABOVE		Purchase Order # 2010 TIER 1 UNIT PRICES	Invoice Contact and Phone No. DAVE OLG - copy on report per Tony 608-836-1500

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: AIR

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: WI
(If Yes, please specify Agency or Regulation) Agency/Reg.: MDNR/EPA

Turnaround Request: [] Normal (10 Bus. Days) *called to verify Mr. Miller's office*
 Rush (Must be pre-approved by Lab and is subject to surcharge) *cut out*
Date Needed: 9-16-10 *5 days per Tony Miller AmA*

WO No: 1009149

Analyses Requested				Lab Use Only		
VER 13-8260	Delivered by	Walk-In	<input checked="" type="radio"/> Counts			
	Shp. Cont. OK?	<input checked="" type="radio"/> Y <input type="radio"/> N	NA			
	Samples Leaking?	<input checked="" type="radio"/> Y <input type="radio"/> N	NA			
	Seals OK?	<input checked="" type="radio"/> Y <input type="radio"/> N	NA			
Rec'd on ice?	<input checked="" type="radio"/> Y <input type="radio"/> N	NA				
Sample Receiving Comments: 2-8						
Comments: PID READING						

Lab Use Only	Sample		No. of Containers		Sample ID						Comments
	Date	Time	Comp	Grab							
-1	9/8	11:00	2		IB-1 0-4'	X					Soil <0.1 PPM
-2		11:10	2		IB-2 4-8'	X					<0.1 PPM
-3		12:45	2		IB-2 8-12'	X					<0.1 PPM
-4		13:05	2		IB-1 12-16'	X					0.1 PPM
-5		13:35		1	IB-1 26.5-28'	X					AIR checks → 1-Tedlar bag
-6		14:05	2		IB-2 0-4'	X					soil <0.1 PPM
-7		14:15	2		IB-2 4-8'	X					<0.1 PPM
-8		14:20	2		IB-2 8-12'	X					<0.1 PPM
-9		14:25	2		IB-2 12-16'	X					<0.1 PPM
-10	✓	14:45		1	IB-2 26.5-28'	X					AIR checks 1-Tedlar bag

1-2oz w/meat
1-TS pl cup

bag

bag

Chain of Custody Record

Relinquished By:	Date	Time	Received By:
<i>Tony Miller</i>	9/8/10	4:30	
	9-9-10	0845	<i>Jura - Jack</i>

Company Name GANNETT FLEMING	Project 34286-008
Report Mailing Address	Contact Name, Phone, Fax, Email
Invoice Address SEE PG 1	Purchase Order # SEE PG 1 Invoice Contact and Phone No.

Matrix: Drinking Water Groundwater Wastewater Soil/Solid Other: ALK

Wis. PECFA Project subject to U&C? Yes No

For Compliance Monitoring? Yes No State: WI
 (If Yes, please specify Agency or Regulation) Agency/Reg.: WDNR/EPA

Turnaround Request: Normal (10 Bus. Days)
 Rush (Must be pre-approved by Lab and is subject to surcharge)
 Date Needed: 9-16-10

WO No.: 1609149

Analyses Requested						Lab Use Only		
VOL-8260						Delivered by	Walk-in	<input checked="" type="checkbox"/> Couried
						Shp. Cont. OK?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N NA
						Samples Leaking?	<input type="checkbox"/> Y	<input checked="" type="checkbox"/> N NA
						Seals OK?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N NA
					Rec'd on ice?	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N NA	
						Sample Receiving Comments:		
						2-8		
						Comments		
						201L \leq 0.1 PPM ↓ \leq 0.1 PPM ↓ \leq 0.1 PPM ↓ \leq 0.1 PPM clients container → 1 - Tcd on bag 1 vial meth 7-27-10 T B034		

Lab Use Only	Sample		No. of Containers		Sample ID
	Date	Time	Comp	Grab	
-11	9/8	15:05	2		IB-3 0-4' X
-12		15:10	2		IB-3 4-8' X
-13		15:20	2		IB-3 8-12' X
-14		15:30	2		IB-3 12-16' X
-15		15:45		1	IB-3 26.5-28' X
-16	7/29			1	TRIP BLANK X

Chain of Custody Record

Relinquished By:	Date	Time	Received By:
<i>[Signature]</i>	9/8/10	4:30	
	09-09-10	0845	<i>[Signature]</i>

SIEMENS

Client: Gannett Fleming Date Received: 9/19/10
1009149
Analytical Number: -1 through -16

Check all deviations from the EPA or WDNR sample protocol.

- Sample(s) received at _____ °C which is above the EPA and WDNR limit of 4°C.
- VOC vial(s) received with headspace.
- Sample(s) received in bottles not furnished by Siemens Water Technologies. The preservation method, if used, is unknown.
- Sample(s) were not properly preserved per EPA or WDNR protocol for the following analyses:
 - _____
- Sample(s) were received beyond the EPA/WDNR holding time for the following analyses:
 - _____
- Sample date/time not supplied by client. Actual holding time is unknown.
- GRO / PVOC / VOC / DRO (circle) sample(s) are <19.5 grams. This report is the qualifier flag for that QC failure. The client has been contacted for further instructions. Analytical number(s) of the sample(s) under weight are:
 - _____
- GRO / PVOC / VOC (circle) sample(s) were between 28.4 and 35.4 grams. Methanol was added in a 1:1 ratio in the lab. Analytical number(s) of the sample(s) affected are:
 - 1009149-9A + 6 ml.
- GRO / PVOC / VOC / DRO (circle) sample(s) are >35.4 grams and are required to be rejected. This report is the qualifier flag for that QC failure. The client has been contacted for further instructions. Analytical number(s) of the sample(s) affected are:
 - _____
- Other problems:
 - _____

Client contacted concerning the above deviations:

_____ notified of the above deviation(s) on ____/____/____ @
_____ contact name
_____ am/pm by _____ and the client ordered the following:
_____ initial

- Proceed with analyses as ordered.
- Proceed with analyses after taking the following corrective action:
 - _____
- Do NOT proceed with analyses.

Siemens Water Technologies Corp.

301 West Military Road
Rothschild, WI 54474

Tel: (800)338-7226
Fax: (715)355-3221

APPENDIX B

TCE TIME VERSUS CONCENTRATION GRAPHS
PLUME 1/2 (SOUTHWEST CORNER)

APPENDIX C

TCE TIME VERSUS CONCENTRATION GRAPHS
PLUME 3/4 (MELBY ROAD DISPOSAL SITE)

APPENDIX D

TCE TIME VERSUS CONCENTRATION GRAPHS
PLUME 5 (EAST DISPOSAL SITE)

APPENDIX E

2010 DATA VALIDATION DOCUMENTATION



RECEIVED	
GANNETT FLEMING-MADISON, WI	
FILE NO:	<u>34283.000 - NPI</u>
JAN 13 2011	
REVIEWED BY:	<u>[Signature]</u>
DATE:	<u>1/19/11</u>
ROUTE TO:	<u>[Signature]</u>

TECHNICAL MEMORANDUM

DATE: January 14, 2010

TO: Derrick Paul
National Presto Industries, Inc.

FROM: Marcia A. Kuehl
President/Owner, MAKuehl Company

SUBJECT: Data Validation for National Presto Industries, Inc.
Interim Remedial Action Project
March 2010 Quarterly Groundwater Sampling Event
Project #: 34283.000

1.0 OVERVIEW

Analytical results (8260 volatiles and dissolved cadmium) for the samples listed in Table 1, collected by Gannett Fleming, Inc. from the interim remedial action at National Presto Industries, Inc. from March 15-16, 2010 have been evaluated using the EPA guidance documents "National Functional Guidelines for Organic Data Review", dated October 1999, EPA-540/R-99/008, and the EPA Region V "Standard Operating Procedure for Validation of CLP Organic Data, April, 1991, Revised August 25, 1993". The project data quality objective was assumed to be that data were to be usable for the purposes of assessing the interim remedial action for the site groundwater. The review was based on the Level II data packages supplied by the analytical laboratory, Siemens, located in Rothschild, Wisconsin.

DQO Attainment

All 8260 data and dissolved cadmium data were usable as reported without additional qualification for the purposes of assessing interim remedial action.

2.0 CADMIUM DATA

Siemens utilized EPA method 6020. No significant deviations from this method that affected data quality were evident from the documentation supplied. No action was needed to qualify sample data.

2.1 Completeness Assessment

The data package received for cadmium analyses included a summary of the lab blank, calibration check standards, initial calibration curve coefficient and MS/MSD results. The required method 6020 frequency for internal laboratory QC samples and calibration checks were met. All samples collected and indicated on the chain-of-custody form were analyzed.

2.2 Compliance Assessment

2.2.1 Holding Time/Preservation

All samples were analyzed within the 6 month holding time for cadmium. No action was needed to qualify sample data. Verification of sample pH upon receipt/analysis indicated that all samples were adequately preserved to pH < 2. Sample temperature upon receipt by the lab was acceptable. No action was needed to qualify sample data.

2.2.2 Calibration

The initial calibration curve (2, 20, 50 ppb) coefficient was acceptable (> 0.995). Initial and final check standard recoveries were within the 90-110 % limits. Continuing calibration standard (CCV) recoveries of 0.2, 2 and 30 ppb were all within method limits. All lithium and scandium internal standard recoveries were within method limits. No action was needed to qualify sample data.

2.2.3 Laboratory Blanks

No cadmium was reported in the reagent lab blanks or continuing calibration blanks associated with the project samples. No action was needed to qualify sample data.

2.2.4 MS/MSD Sample Recovery and RPD

Recoveries and the RPD value for cadmium in the project sample analyzed as the MS/MSD (MW-10B) were all within data validation and Siemens limits. No action was taken to qualify sample data.

2.3 Field QC Results

No field blanks or duplicates were collected and analyzed for dissolved cadmium with the project samples. No action was taken to qualify sample data.

2.4 Data Usability

All dissolved cadmium data as reported by Siemens was acceptable for use in the investigation. No action was needed to qualify any cadmium sample data.

3.0 VOLATILE ORGANICS DATA BY METHOD 8260B

Siemens utilized EPA method 8260B for all project sample analysis. No significant deviations affecting data quality were evident from the documentation received and reviewed. No action was needed to qualify sample data.

3.1 Completeness Assessment

The required method 8260 frequency for internal laboratory QC samples and calibration checks were met. All samples collected and indicated on the chain-of-custody form were analyzed. No action was needed to qualify sample data.

3.2 Compliance Assessment

3.2.1 Holding Times/Preservation

All samples were analyzed within the 14 day holding time. Verification of sample pH upon analysis indicated that all samples were adequately preserved at a pH of < 2. Sample temperature upon receipt by the lab was acceptable. No action was needed to qualify sample data.

3.2.2 Initial Calibration and Tuning

BFB tuning results met method 8260 criteria. No action was needed to qualify sample data.

Nine point initial calibration curves ranging from 0.5-100.0 ug/L were analyzed on 2/23/10 and 3/19/10. All rsd values for the reported volatile organics were less than the 15 % limit required by the method. Method System Performance Check Compounds (chloromethane, 1,1-dichloroethane, bromoform, 1,1,2,2-tetrachloroethane, chlorobenzene) met the EPA method data validation criteria of > 0.30 for 1,1,2,2-tetrachloroethane and chlorobenzene and > 0.10 for chloromethane, 1,1-dichloroethane, and bromoform. No action was needed to qualify sample data.

3.2.3 Continuing Calibration

A 20 ug/L continuing calibration standard (CCAL) was analyzed according to method 8260B every 12 hours. Method System Performance Check Compounds (chloromethane, 1,1-dichloroethane, bromoform, 1,1,2,2-tetrachloroethane, chlorobenzene) met the EPA method data validation criteria of > 0.30 for 1,1,2,2-tetrachloroethane and chlorobenzene and > 0.10 for chloromethane, 1,1-dichloroethane, and bromoform. All response factors of reported compounds met data validation criteria. No action was needed to qualify sample data.

All Calibration Check Compounds (vinyl chloride, 1,1-dichloroethene, chloroform, 1,2-

dichloropropane, toluene) and System Performance Check Compounds (chloromethane, 1,1-dichloroethane, bromoform, 1,1,2,2-tetrachloroethane, chlorobenzene) met the method 8260B limits of < 20 % difference. No action was needed to qualify sample data.

3.2.4 Laboratory Blanks

No detectable volatile organics above the LOD were present in the lab blanks analyzed with the project samples. No action was needed to qualify sample data.

3.2.5 Surrogate Recoveries

All surrogate recoveries were within Siemens limits and ranged from 91 -118 %. No limits are specified in method 8260. No action was needed to qualify sample data.

3.2.6 Matrix Spike/Matrix Spike Duplicates

MS/MSD recoveries and RPD values in the project samples used for the MS/MSD (MW-68B, MW-72) were not all within historical limits established by Siemens. Toluene relative percent difference (RPD) in MW-72 was 5.97 %, in exceedance of Siemens 5.20 % limit. Siemens qualified the associated sample data with a "DUP" qualifier. No further action was taken to qualify sample data, as no toluene was detected in the associated unspiked sample, and 5.20 % RPD limit is very stringent, as usually a 20 % limit is allowable and achievable.

Recoveries of 1,1-dichloroethane (135 %, 139 %; limit 128 %), 1,1-dichloroethene (155 %, 155 %; limit 134 %), methylene chloride (139 %, 141 %; limit 126 %) and toluene (131 %, 134 %; limit 116 %) exceeded Siemens upper control limit in sample MW-68B. Siemens qualified the associated sample data with "S1H" and S2H" qualifiers. No further action was needed to qualify sample data, as none of these compounds were detected in the associated sample and therefore no high bias was possible.

3.2.7 Internal Standards

Internal standard areas for quantitation ions in project samples were within the method 8260 limit of - 50 % to + 100 %.

3.3 Field QC Results

An equipment blank was collected with the project samples on 3/16/10. Detectable m,p-xylenes (0.77 ug/L), o-xylene (0.34 ug/L) and toluene (1.02 ug/L) was present above the LOD in the equipment blank. No action was needed to qualify sample data, as none of these compounds were detected in the project samples, only in the equipment blank.

Field duplicates were collected for MW-38B. The calculated Relative Percent Differences

(RPD) were 1 % for 1,1,1-trichloroethane, 21 % for tetrachloroethene and 2 % for trichloroethene. All RPD values were within the U.S. EPA Region V limit of a factor of five (133 % RPD) for organics. No action was needed to qualify sample data.

3.4 Data Usability

All 8260 data reported were usable as reported by Siemens for the purposes of assessing interim remedial action. No additional qualification was necessary.

Values qualified with a J code by the laboratory are those that are above the LOD, but less than the LOQ. These values should therefore be considered estimates.

If you have any questions regarding the qualification of data or the data validation process/criteria used, please contact me at (920) 469-9113.

Attachments:

Table 1
Validated Analytical Reports (hard copy)
Analytical Results March2010.xls (Gannett Fleming only)

cc: Gannett Fleming, Inc.

Table 1 Sample Results Validated - Presto March 2010

	Volatiles	dissolved
	SW846	cadmium
SAMPLE ID	8260B	200.9
MW-5B	✓	
MW-10A		✓
MW-10B		✓
MW-23A	✓	
MW-23B	✓	
MW-38B	✓	
MW-38B DUP	✓	
MW-68B	✓	
MW-69B	✓	
MW-70A	✓	
MW-72	✓	
EC-1	✓	
EC-2	✓	
RW-16B	✓	
RW-3B	✓	
RW-3C	✓	
Equipment Blank	✓	



TECHNICAL MEMORANDUM

DATE: July 27, 2010

TO: Derrick Paul
National Presto Industries, Inc.

FROM: Marcia A. Kuehl *MAK*
President/Owner, MAKuehl Company

SUBJECT: Data Validation for National Presto Industries, Inc.
Interim Remedial Action Project
June Quarterly Groundwater Sampling Event
Project #: 34283

RECEIVED	
GANNETT FLEMING-MADISON, WI	
FILE NO:	<u>34283 000</u> NPI
JUL 30 2010	
REVIEWED BY:	<u>dko</u>
DATE:	<u>8/2/10</u>
ROUTE TO:	_____

1.0 OVERVIEW

Analytical results (8260 volatiles and dissolved cadmium) for the samples listed in Table 1, collected by Gannett Fleming, Inc. from the interim remedial action at National Presto Industries, Inc. from June 29-30, 2010 have been evaluated using the EPA guidance documents "National Functional Guidelines for Organic Data Review", dated October 1999, EPA-540/R-99/008, and the EPA Region V "Standard Operating Procedure for Validation of CLP Organic Data, April, 1991, Revised August 25, 1993". The project data quality objective was assumed to be that data were to be usable for the purposes of assessing the interim remedial action for the site groundwater. The review was based on the Level II data packages supplied by the analytical laboratory, Siemens, located in Rothschild, Wisconsin.

DQO Attainment

All cadmium data were usable for the purposes of assessing interim remedial action. No additional qualification of cadmium data was needed.

All 8260 data reported were usable for the purposes of assessing interim remedial action. 1,1-dichloroethane in MW-43B was qualified with S1H and S2H, as the result reported may be biased high and should be considered estimated. As this result was already qualified as estimated with a J code due to the concentration being between the LOD and LOQ, no further action was needed.

Values qualified with a J code by the laboratory are those that are above the LOD, but less than the LOQ. The validated data sheets are attached.

2.0 CADMIUM DATA

Siemens utilized EPA method 200.8. No significant deviations from this method that affected data quality were evident from the documentation supplied. No action was needed to qualify sample data.

2.1 Completeness Assessment

The cadmium analyses included a summary of the lab blank, calibration check standards, initial calibration curve coefficient and MS/MSD results. The raw data for the samples was requested and received. The required method 200.8 frequency for internal laboratory QC samples and calibration checks were met. All samples collected and indicated on the chain-of-custody form were analyzed. No action was needed to qualify sample data.

2.2 Compliance Assessment

2.2.1 Holding Time/Preservation

All samples were analyzed within the 6 month holding time for cadmium. No action was needed to qualify sample data. Verification of sample pH upon receipt/analysis indicated that all samples were adequately preserved to pH < 2. Sample temperature upon receipt by the lab was acceptable. No action was needed to qualify sample data.

2.2.2 Calibration

The initial calibration curve coefficient was acceptable (> 0.995). Initial and final check standard recoveries were within the 90-110 % limits. No action was needed to qualify sample data.

2.2.3 Laboratory Blanks

No cadmium was reported in the reagent lab blank associated with the project samples. No action was needed to qualify sample data.

2.2.4 MS/MSD Sample Recovery and RPD

Recoveries and the RPD value for cadmium in the non-project sample analyzed as the MS/MSD were all within data validation and Siemens limits. No action was taken to qualify sample data.

2.3 Field QC Results

No field blanks or duplicates were collected and analyzed for dissolved cadmium with the project samples.

2.4 Data Usability

All dissolved cadmium data as reported by Siemens was acceptable for use in the investigation. No action was needed to qualify any cadmium sample data.

3.0 VOLATILE ORGANICS DATA BY METHOD 8260B

Siemens/Enviroscan utilized EPA method 8260B for all project sample analysis. No significant deviations from this reference method affecting data quality were evident from the documentation received and reviewed. No action was needed to qualify sample data.

3.1 Completeness Assessment

The required method 8260 frequency for internal laboratory QC samples and calibration checks were met. All samples collected and indicated on the chain-of-custody form were analyzed. The initial calibration data applicable to the analyses was missing and was requested and received. No action was needed to qualify sample data.

3.2 Compliance Assessment

3.2.1 Holding Times/Preservation

All samples were analyzed within the 14 day holding time. Verification of sample pH upon analysis indicated that all samples were adequately preserved at a pH of < 2. Sample temperature upon receipt by the lab was acceptable. No action was needed to qualify sample data.

3.2.2 Initial Calibration and Tuning

BFB tuning results met method 8260 criteria. No action was needed to qualify sample data.

A nine point initial calibration curve ranging from 0.5-100.0 ug/L was analyzed on 4/6/10. All rsd values for the reported volatile organics were less than the 15 % limit required by the method. Method System Performance Check Compounds (chloromethane, 1,1-dichloroethane, bromoform, 1,1,2,2-tetrachloroethane, chlorobenzene) met the EPA method data validation criteria of > 0.30 for 1,1,2,2-tetrachloroethane and chlorobenzene and > 0.10 for chloromethane, 1,1-dichloroethane, and bromoform. No action was needed to qualify sample data.

3.2.3 Continuing Calibration

A 20 ug/L continuing calibration standard (CCAL) was analyzed according to method 8260B every 12 hours. Method System Performance Check Compounds (chloromethane, 1,1-dichloroethane, bromoform, 1,1,2,2-tetrachloroethane, chlorobenzene) met the EPA

method data validation criteria of > 0.30 for 1,1,2,2-tetrachloroethane and chlorobenzene and > 0.10 for chloromethane, 1,1-dichloroethane, and bromoform. All Calibration Check Compounds (vinyl chloride, 1,1-dichloroethene, chloroform, 1,2-dichloropropane, toluene) and System Performance Check Compounds (chloromethane, 1,1-dichloroethane, bromoform, 1,1,2,2-tetrachloroethane, chlorobenzene) met the method 8260B limits of < 20 % difference. All response factors of reported compounds met data validation criteria. No action was needed to qualify sample data.

3.2.4 Laboratory Blanks

No detectable volatile organics above the Limit of Detection (LOD) were present in the lab blanks analyzed with the project samples. No action was needed to qualify sample data.

3.2.5 Surrogate Recoveries

All surrogate recoveries were within Siemens limits and ranged from 91.6-111.4 %. No limits are specified in method 8260. No action was needed to qualify sample data.

3.2.6 Matrix Spike/Matrix Spike Duplicates

MS/MSD recoveries and RPD values in the project samples used for the MS/MSD (MW-23B, RW-16B, non-project) were within historical limits established by Siemens except for 1,1-dichloroethane in RW-16B (130.97 %, 131.06 %; limit 127.99 %) 10070802. Siemens qualified the results in the MS/MSD samples and the parent sample RW-16B with S1H and S2H qualifiers. Further action was taken to qualify the detected 1,1-dichloroethane in the associated sample, MW-43B, with S1H and S2H, as the result reported may be biased high and should be considered estimated. As this result was already qualified as estimated with a J code due to the concentration being between the LOD and LOQ, no further action was needed.

3.2.7 Internal Standards

Internal standard areas for quantitation ions in project samples were within the method 8260 limit of - 50 % to + 100 %.

3.3 Field QC Results

The trip blank collected with the project samples did not contain any detectable volatile organics above the LOD. No action was needed to qualify sample data.

The equipment blank (EB) contained detectable m,p-xylene at 2.92 ug/L, o-xylene at 1.58 ug/L and toluene at 4.41 ug/L. No action was needed to qualify sample data, as none of these volatile organics were detected in the project samples.

Field duplicates were collected for MW-23B, MW-53B, RW-16B, RW-3C and RW-16C. The

calculated Relative Percent Differences (RPD) for the detected volatile organics between the samples and their field duplicate are presented in Table 2. All RPD values were within the U.S. EPA Region V limit of a factor of five (133 % RPD) for organics and ranged from 0-12 %. No action was needed to qualify sample data.

3.4 Data Usability

All 8260 data reported were usable for the purposes of assessing interim remedial action.

1,1-dichloroethane in MW-43B was qualified with S1H and S2H, as the result reported may be biased high and should be considered estimated. As this result was already qualified as estimated with a J code due to the concentration being between the LOD and LOQ, no further action was needed.

If you have any questions regarding the qualification of data or the data validation process/criteria used, please contact me at (920) 469-9113.

Attachments:

Tables 1, 2
Validated Analytical Reports (hard copy)
Analytical Results June2010.xls (Gannett Fleming only)

cc: Gannett Fleming, Inc.

Table 1 Sample Results Validated - Presto June 2010

	Volatiles	dissolved		Volatiles
	SW846	cadmium		SW846
SAMPLE ID	8260B	200.9	SAMPLE ID	8260B
MW-4B	✓		MW-64C	✓
MW-10A		✓	MW-65B	✓
MW-10B		✓	MW-65C	✓
MW-23A	✓		MW-66B	✓
MW-23B	✓		MW-68A	✓
MW-23B DUP			MW-68B	✓
MW-29B	✓		MW-70A	✓
MW-34B		✓	EC-1	✓
MW-38A	✓		EC-2	✓
MW-38B	✓		RW-3A	✓
MW-38C	✓		RW-3B	✓
MW-41A	✓		RW-3C	✓
MW-41B	✓		RW-3C DUP	✓
MW-43A	✓		RW-15	✓
MW-43B	✓		RW-16	✓
MW-45A	✓		RW-16B	✓
MW-45B	✓		RW-16B DUP	✓
MW-45C	✓		RW-16C	✓
MW-53A	✓		RW-16C DUP	✓
MW-53B	✓		EB	✓
MW-53B DUP	✓		TRIP BLANK	✓
MW-64B	✓			

Table 2 Field Duplicate Precision-June 2010

Compound	DUP			DUP			DUP		
	MW-23B	MW-23B	RPD	MW-53B	MW-53B	RPD	RW-3C	RW-3C	RPD
Units:	ug/l	ug/l	%	ug/l	ug/l	0	ug/l	ug/l	%
1,1,1-trichloroethane	0.62	0.65	5	0.52	0.57	9	0.88	0.91	3
chloroform	ND	ND	0	0.51	0.53	4	0.37	0.39	5
1,1-dichloroethane	ND	ND	0	ND	ND	0	ND	ND	0
1,1-dichloroethylene	ND	ND	0	ND	ND	0	ND	ND	0
methylene chloride	ND	ND	0	ND	ND	0	ND	ND	0
tetrachloroethylene	ND	ND	0	ND	ND	0	ND	ND	0
toluene	ND	ND	0	ND	ND	0	ND	ND	0
carbon tetrachloride	ND	ND	0	ND	ND	0	ND	ND	0
trichloroethylene	3.28	3.46	5	3.93	3.83	3	6.05	5.95	2
m/p-xylene	ND	ND	0	ND	ND	0	ND	ND	0
o-xylene	ND	ND	0	ND	ND	0	ND	ND	0
Compound	DUP			DUP			DUP		
	RW-16B	RW-16B	RPD	RW-16C	RW-16C	RPD			
Units:	ug/l	ug/l	%	ug/l	ug/l	0			
1,1,1-trichloroethane	0.78	0.69	12	0.51	0.50	2			
chloroform	ND	ND	0	ND	ND	0			
1,1-dichloroethane	ND	ND	0	ND	ND	0			
1,1-dichloroethylene	ND	ND	0	ND	ND	0			
methylene chloride	ND	ND	0	ND	ND	0			
tetrachloroethylene	ND	ND	0	ND	ND	0			
toluene	ND	ND	0	ND	ND	0			
carbon tetrachloride	ND	ND	0	ND	ND	0			
trichloroethylene	4.94	4.88	1	3.86	3.91	1			
m/p-xylene	ND	ND	0	ND	ND	0			
o-xylene	ND	ND	0	ND	ND	0			



RECEIVED	
GANNETT FLEMING-MADISON, WI	
FILE NO:	34283.000 (NPL)
OCT 27 2010	
REVIEWED BY:	<i>ajg</i>
DATE:	10/27/10
ROUTE TO:	

TECHNICAL MEMORANDUM

DATE: October 25, 2010

TO: Derrick Paul
National Presto Industries, Inc.

FROM: Marcia A. Kuehl
President/Owner, MAKuehl Company

SUBJECT: Data Validation for National Presto Industries, Inc.
Interim Remedial Action Project
October Quarterly Groundwater Sampling Event
Project #: 34283

MAK

1.0 OVERVIEW

Analytical results (8260 volatiles and dissolved cadmium) for the samples listed in Table 1, collected by Gannett Fleming, Inc. from the interim remedial action at National Presto Industries, Inc. from October 4-6, 2010 have been evaluated using the EPA guidance documents "National Functional Guidelines for Organic Data Review", dated October 1999, EPA-540/R-99/008, and the EPA Region V "Standard Operating Procedure for Validation of CLP Organic Data, April, 1991, Revised August 25, 1993". The project data quality objective was assumed to be that data were to be usable for the purposes of assessing the interim remedial action for the site groundwater. The review was based on the Level II data packages supplied by the analytical laboratory, Siemens, located in Rothschild, Wisconsin.

DQO Attainment

All cadmium data were usable for the purposes of assessing interim remedial action. No additional qualification of cadmium data was needed.

All 8260 data reported were usable for the purposes of assessing interim remedial action. Detected tetrachloroethene in MW-73 was estimated from a possible high calibration bias. Detected trichloroethene in MW-52B and the associated samples in run 0101202 (MW-23A, MW-23B, MW-38B, RW-16B, RW-16B DUP, MW-51B, RW-3B, RW-3C, EC-1) was estimated from a possible high bias as exhibited in the MS/MSD.

Values qualified with a J code by the laboratory are those that are above the LOD, but less than the LOQ. The validated data sheets are attached.

2.0 CADMIUM DATA

Siemens utilized EPA method 200.8. No significant deviations from this method that affected data quality were evident from the documentation supplied. No action was needed to qualify sample data.

2.1 Completeness Assessment

The cadmium analyses included a summary of the lab blank, calibration check standards, initial calibration curve coefficient and MS/MSD results. The raw data for the samples was requested and received. The required method 200.8 frequency for internal laboratory QC samples and calibration checks were met. All samples collected and indicated on the chain-of-custody form were analyzed. No action was needed to qualify sample data.

2.2 Compliance Assessment

2.2.1 Holding Time/Preservation

All samples were analyzed within the 6 month holding time for cadmium. No action was needed to qualify sample data. Verification of sample pH upon receipt/analysis indicated that all samples were adequately preserved to pH < 2. Sample temperature upon receipt by the lab was acceptable. No action was needed to qualify sample data.

2.2.2 Calibration

The initial calibration curve coefficient was acceptable (> 0.995). Initial and final check standard recoveries were within the 90-110 % limits. No action was needed to qualify sample data.

2.2.3 Laboratory Blanks

No cadmium was reported in the reagent lab blank associated with the project samples. No action was needed to qualify sample data.

2.2.4 MS/MSD Sample Recovery and RPD

Recoveries and the RPD value for cadmium in the project sample analyzed as the MS/MSD (MW-54) were within data validation and Siemens limits. No action was taken to qualify sample data.

2.3 Field QC Results

No field blanks or duplicates were collected and analyzed for dissolved cadmium with the project samples.

2.4 Data Usability

All dissolved cadmium data as reported by Siemens was acceptable for use in the investigation. No action was needed to qualify any cadmium sample data.

3.0 VOLATILE ORGANICS DATA BY METHOD 8260B

Siemens/Enviroscan utilized EPA method 8260B for all project sample analysis. No significant deviations from this reference method affecting data quality were evident from the documentation received and reviewed. No action was needed to qualify sample data.

3.1 Completeness Assessment

The required method 8260 frequency for internal laboratory QC samples and calibration checks were met. All samples collected and indicated on the chain-of-custody form were analyzed. The field duplicate for sample MW-76A (MW-76A DUP) was misreported by the laboratory as MW-77A DUP. The report sheet was corrected by the validator.

3.2 Compliance Assessment

3.2.1 Holding Times/Preservation

All samples were analyzed within the 14 day holding time. Verification of sample pH upon analysis indicated that all samples were adequately preserved at a pH of < 2. Sample temperature upon receipt by the lab was acceptable. No action was needed to qualify sample data.

3.2.2 Initial Calibration and Tuning

BFB tuning results met method 8260 criteria. No action was needed to qualify sample data.

A nine point initial calibration curve ranging from 0.5-100.0 ug/L was analyzed on 9/16/10. All rsd values for the reported volatile organics were less than the 15 % limit required by the method. Method System Performance Check Compounds (chloromethane, 1,1-dichloroethane, bromoform, 1,1,2,2-tetrachloroethane, chlorobenzene) met the EPA method data validation criteria of > 0.30 for 1,1,2,2-tetrachloroethane and chlorobenzene and > 0.10 for chloromethane, 1,1-dichloroethane, and bromoform. No action was needed to qualify sample data.

3.2.3 Continuing Calibration

A 20 ug/L continuing calibration standard (CCAL) was analyzed according to method 8260B every 12 hours. Method System Performance Check Compounds (chloromethane, 1,1-dichloroethane, bromoform, 1,1,2,2-tetrachloroethane, chlorobenzene) met the EPA

method data validation criteria of > 0.30 for 1,1,2,2-tetrachloroethane and chlorobenzene and > 0.10 for chloromethane, 1,1-dichloroethane, and bromoform. All Calibration Check Compounds (vinyl chloride, 1,1-dichloroethene, chloroform, 1,2-dichloropropane, toluene) and System Performance Check Compounds (chloromethane, 1,1-dichloroethane, bromoform, 1,1,2,2-tetrachloroethane, chlorobenzene) met the method 8260B limits of < 20 % difference. All response factors of reported compounds met data validation criteria.

In run 0101101, percent differences of methylene chloride (21.95 %) and tetrachloroethene (21.916 %) exceeded the 20 % limit. Siemens appropriately qualified associated sample results in run 0101101 with a "CSH" qualifier. Further action taken was to qualify detected tetrachloroethene in MW-73 as estimated with a J code from a possible high calibration bias. No action was needed to qualify MW-73 data, as detected tetrachloroethene was already qualified with a J code as the concentration reported was between the LOD and LOQ.

3.2.4 Laboratory Blanks

No detectable volatile organics above the Limit of Detection (LOD) were present in the lab blanks analyzed with the project samples. No action was needed to qualify sample data.

3.2.5 Surrogate Recoveries

All surrogate recoveries were within Siemens limits and ranged from 84.9-118.8 %. No limits are specified in method 8260. No action was needed to qualify sample data.

3.2.6 Matrix Spike/Matrix Spike Duplicates

MS/MSD recoveries and RPD values in the project samples used for the MS/MSD (MW-52B, MW-63A, MW-77C) were within historical limits established by Siemens except for the outliers listed in Table 3. Action taken was to qualify detected trichloroethene in MW-52B and the associated samples in run 0101202 (MW-23A, MW-23B, MW-38B, RW-16B, RW-16B DUP, MW-51B, RW-3B, RW-3C, EC-1) as estimated with a J code from a possible high bias. No action was needed to qualify detected sample data associated with high recoveries in MW-63A in run 0101101, as none of the volatile organics that were recovered with a high bias (1,1-dichloroethene, methylene chloride) were detected in the associated project samples and no high bias was possible.

Detected trichloroethene, methylene chloride and 1,1,1-trichloroethane in associated project samples in run 0101202 was qualified as estimated from high method/matrix imprecision with a J code if not already qualified with a J code from being between the LOD and LOQ.

3.2.7 Internal Standards

Internal standard areas for quantitation ions in project samples were within the method 8260 limit of - 50 % to + 100 %.

3.3 Field QC Results

The trip blanks collected with the project samples on 10/4/10 and 10/5/10 did not contain any detectable volatile organics above the LOD. No action was needed to qualify sample data. The trip blank collected on 10/6/10 contained detectable methylene chloride at 0.52 ug/L. No action was needed to qualify sample data, as none of the samples collected and shipped with this trip blank contained detectable methylene chloride and therefore no high bias was possible.

Field duplicates were collected for MW-62A, MW-76A and RW-16B. The calculated Relative Percent Differences (RPD) for the detected volatile organics between the samples and their field duplicate are presented in Table 2. All RPD values were within the U.S. EPA Region V limit of a factor of five (133 % RPD) for organics and ranged from 0-26 %. No action was needed to qualify sample data.

3.4 Data Usability

All 8260 data reported were usable for the purposes of assessing interim remedial action. Detected tetrachloroethene in MW-73 was estimated from a possible high calibration bias. Detected trichloroethene in MW-52B and the associated samples in run 0101202 (MW-23A, MW-23B, MW-38B, RW-16B, RW-16B DUP, MW-51B, RW-3B, RW-3C, EC-1) was estimated from a possible high bias as exhibited in the MS/MSD.

If you have any questions regarding the qualification of data or the data validation process/criteria used, please contact me at (920) 469-9113.

Attachments:

Tables 1, 2, 3
Validated Analytical Reports (hard copy)
Analytical Results Oct2010.xls (Gannett Fleming only)

cc: Gannett Fleming, Inc.



RECEIVED GANNETT FLEMING-MADISON, WI FILE NO: _____ OCT 27 2010 REVIEWED BY: _____ DATE: _____ ROUTE TO: _____

TECHNICAL MEMORANDUM

DATE: October 25, 2010

TO: Derrick Paul
National Presto Industries, Inc. *MAU*

FROM: Marcia A. Kuehl
President/Owner, MAKuehl Company

SUBJECT: Data Validation for National Presto Industries, Inc.
Interim Remedial Action Project
October 4, 2010 Groundwater Sampling Event
Project #: 34283

1.0 OVERVIEW

Analytical results (8260 volatiles) for M.H. #18, CAS-1, CAS-2, EW-1, EW-2, EW-4, EW-5, an equipment blank and a trip blank collected by Gannett Fleming, Inc. from the interim remedial action at National Presto Industries, Inc. from October 4-6, 2010 have been evaluated using the EPA guidance documents "National Functional Guidelines for Organic Data Review", dated October 1999, EPA-540/R-99/008, and the EPA Region V "Standard Operating Procedure for Validation of CLP Organic Data, April, 1991, Revised August 25, 1993". The project data quality objective was assumed to be that data were to be usable for the purposes of assessing the interim remedial action for the site groundwater. The review was based on the Level II data packages supplied by the analytical laboratory, Siemens, located in Rothschild, Wisconsin.

DQO Attainment

All 8260 data reported were usable for the purposes of assessing interim remedial action without additional qualification.

Values qualified with a J code by the laboratory are those that are above the LOD, but less than the LOQ. The validated data sheets are attached.

2.0 VOLATILE ORGANICS DATA BY METHOD 8260B

Siemens/Enviroscan utilized EPA method 8260B for all project sample analysis. No

significant deviations from this reference method affecting data quality were evident from the documentation received and reviewed. No action was needed to qualify sample data.

2.1 Completeness Assessment

The required method 8260 frequency for internal laboratory QC samples and calibration checks were met. All samples collected and indicated on the chain-of-custody form were analyzed. No action was needed to qualify sample data.

2.2 Compliance Assessment

2.2.1 Holding Times/Preservation

All samples were analyzed within the 14 day holding time. Verification of sample pH upon analysis indicated that all samples were adequately preserved at a pH of < 2. Sample temperature upon receipt by the lab was acceptable. No action was needed to qualify sample data.

2.2.2 Initial Calibration and Tuning

BFB tuning results met method 8260 criteria. No action was needed to qualify sample data.

A nine point initial calibration curve ranging from 0.5-100.0 ug/L was analyzed on 9/16/10. All rsd values for the reported volatile organics were less than the 15 % limit required by the method. Method System Performance Check Compounds (chloromethane, 1,1-dichloroethane, bromoform, 1,1,2,2-tetrachloroethane, chlorobenzene) met the EPA method data validation criteria of > 0.30 for 1,1,2,2-tetrachloroethane and chlorobenzene and > 0.10 for chloromethane, 1,1-dichloroethane, and bromoform. No action was needed to qualify sample data.

2.2.3 Continuing Calibration

A 20 ug/L continuing calibration standard (CCAL) was analyzed according to method 8260B every 12 hours. Method System Performance Check Compounds (chloromethane, 1,1-dichloroethane, bromoform, 1,1,2,2-tetrachloroethane, chlorobenzene) met the EPA method data validation criteria of > 0.30 for 1,1,2,2-tetrachloroethane and chlorobenzene and > 0.10 for chloromethane, 1,1-dichloroethane, and bromoform. All Calibration Check Compounds (vinyl chloride, 1,1-dichloroethene, chloroform, 1,2-dichloropropane, toluene) and System Performance Check Compounds (chloromethane, 1,1-dichloroethane, bromoform, 1,1,2,2-tetrachloroethane, chlorobenzene) met the method 8260B limits of < 20 % difference. All response factors of reported compounds met data validation criteria.

In run 0101101, percent difference of tetrachloroethen (21.916 %) exceeded the 20 % limit. Siemens appropriately qualified associated sample results in run 0101101 with a "CSH" qualifier. No further action to qualify detected tetrachloroethene as estimated with a J code

from a possible high calibration bias was needed, as none of the project samples contained detectable tetrachloroethene.

2.2.4 Laboratory Blanks

No detectable volatile organics above the Limit of Detection (LOD) were present in the lab blanks analyzed with the project samples. No action was needed to qualify sample data.

2.2.5 Surrogate Recoveries

All surrogate recoveries were within Siemens limits and ranged from 106.3-118.3 %. No limits are specified in method 8260. No action was needed to qualify sample data.

2.2.6 Matrix Spike/Matrix Spike Duplicates

MS/MSD recoveries and RPD values in the project samples used for the MS/MSD (MW-63A) were within historical limits established by Siemens except for the outliers listed in Table 1. No action was needed to qualify detected sample data associated with high recoveries in MW-63A in run 0101101, as the volatile organic that was recovered with a high bias (1,1-dichloroethene) was not detected in the associated project samples and no high bias was possible.

2.2.7 Internal Standards

Internal standard areas for quantitation ions in project samples were within the method 8260 limit of - 50 % to + 100 %.

2.3 Field QC Results

The trip blank and equipment blank collected after the project samples on 10/6/10 did not contain any detectable volatile organics above the LOD. No action was needed to qualify sample data.

No field duplicates were collected for the project samples. No action was taken to qualify sample data.

2.4 Data Usability

All 8260 data reported were usable for the purposes of assessing interim remedial action without additional qualification.

If you have any questions regarding the qualification of data or the data validation process/criteria used, please contact me at (920) 469-9113.

Attachments:

Table 1

Validated Analytical Reports (hard copy)

Analytical Results Oct2010a.xls (Gannett Fleming only)

cc: Gannett Fleming, Inc.



RECEIVED	
GANNETT FLEMING-MADISON, WI	
FILE NO:	_____
OCT 27 2010	
REVIEWED BY:	_____
DATE:	_____
ROUTE TO:	_____

TECHNICAL MEMORANDUM

DATE: October 25, 2010

TO: Derrick Paul
National Presto Industries, Inc.

FROM: Marcia A. Kuehl
President/Owner, MAKuehl Company *MAK*

SUBJECT: Data Validation for National Presto Industries, Inc.
Interim Remedial Action Project
October Quarterly Groundwater Sampling Event
Project #: 34283

1.0 OVERVIEW

Analytical results (8260 volatiles and dissolved cadmium) for the samples listed in Table 1, collected by Gannett Fleming, Inc. from the interim remedial action at National Presto Industries, Inc. from October 4-6, 2010 have been evaluated using the EPA guidance documents "National Functional Guidelines for Organic Data Review", dated October 1999, EPA-540/R-99/008, and the EPA Region V "Standard Operating Procedure for Validation of CLP Organic Data, April, 1991, Revised August 25, 1993". The project data quality objective was assumed to be that data were to be usable for the purposes of assessing the interim remedial action for the site groundwater. The review was based on the Level II data packages supplied by the analytical laboratory, Siemens, located in Rothschild, Wisconsin.

DQO Attainment

All cadmium data were usable for the purposes of assessing interim remedial action. No additional qualification of cadmium data was needed.

All 8260 data reported were usable for the purposes of assessing interim remedial action. Detected tetrachloroethene in MW-73 was estimated from a possible high calibration bias. Detected trichloroethene in MW-52B and the associated samples in run 0101202 (MW-23A, MW-23B, MW-38B, RW-16B, RW-16B DUP, MW-51B, RW-3B, RW-3C, EC-1) was estimated from a possible high bias as exhibited in the MS/MSD.

Values qualified with a J code by the laboratory are those that are above the LOD, but less than the LOQ. The validated data sheets are attached.

2.0 CADMIUM DATA

Siemens utilized EPA method 200.8. No significant deviations from this method that affected data quality were evident from the documentation supplied. No action was needed to qualify sample data.

2.1 Completeness Assessment

The cadmium analyses included a summary of the lab blank, calibration check standards, initial calibration curve coefficient and MS/MSD results. The raw data for the samples was requested and received. The required method 200.8 frequency for internal laboratory QC samples and calibration checks were met. All samples collected and indicated on the chain-of-custody form were analyzed. No action was needed to qualify sample data.

2.2 Compliance Assessment

2.2.1 Holding Time/Preservation

All samples were analyzed within the 6 month holding time for cadmium. No action was needed to qualify sample data. Verification of sample pH upon receipt/analysis indicated that all samples were adequately preserved to pH < 2. Sample temperature upon receipt by the lab was acceptable. No action was needed to qualify sample data.

2.2.2 Calibration

The initial calibration curve coefficient was acceptable (> 0.995). Initial and final check standard recoveries were within the 90-110 % limits. No action was needed to qualify sample data.

2.2.3 Laboratory Blanks

No cadmium was reported in the reagent lab blank associated with the project samples. No action was needed to qualify sample data.

2.2.4 MS/MSD Sample Recovery and RPD

Recoveries and the RPD value for cadmium in the project sample analyzed as the MS/MSD (MW-54) were within data validation and Siemens limits. No action was taken to qualify sample data.

2.3 Field QC Results

No field blanks or duplicates were collected and analyzed for dissolved cadmium with the project samples.

2.4 Data Usability

All dissolved cadmium data as reported by Siemens was acceptable for use in the investigation. No action was needed to qualify any cadmium sample data.

3.0 VOLATILE ORGANICS DATA BY METHOD 8260B

Siemens/Enviroscan utilized EPA method 8260B for all project sample analysis. No significant deviations from this reference method affecting data quality were evident from the documentation received and reviewed. No action was needed to qualify sample data.

3.1 Completeness Assessment

The required method 8260 frequency for internal laboratory QC samples and calibration checks were met. All samples collected and indicated on the chain-of-custody form were analyzed. The field duplicate for sample MW-76A (MW-76A DUP) was misreported by the laboratory as MW-77A DUP. The report sheet was corrected by the validator.

3.2 Compliance Assessment

3.2.1 Holding Times/Preservation

All samples were analyzed within the 14 day holding time. Verification of sample pH upon analysis indicated that all samples were adequately preserved at a pH of < 2. Sample temperature upon receipt by the lab was acceptable. No action was needed to qualify sample data.

3.2.2 Initial Calibration and Tuning

BFB tuning results met method 8260 criteria. No action was needed to qualify sample data.

A nine point initial calibration curve ranging from 0.5-100.0 ug/L was analyzed on 9/16/10. All rsd values for the reported volatile organics were less than the 15 % limit required by the method. Method System Performance Check Compounds (chloromethane, 1,1-dichloroethane, bromoform, 1,1,2,2-tetrachloroethane, chlorobenzene) met the EPA method data validation criteria of > 0.30 for 1,1,2,2-tetrachloroethane and chlorobenzene and > 0.10 for chloromethane, 1,1-dichloroethane, and bromoform. No action was needed to qualify sample data.

3.2.3 Continuing Calibration

A 20 ug/L continuing calibration standard (CCAL) was analyzed according to method 8260B every 12 hours. Method System Performance Check Compounds (chloromethane, 1,1-dichloroethane, bromoform, 1,1,2,2-tetrachloroethane, chlorobenzene) met the EPA

method data validation criteria of > 0.30 for 1,1,2,2-tetrachloroethane and chlorobenzene and > 0.10 for chloromethane, 1,1-dichloroethane, and bromoform. All Calibration Check Compounds (vinyl chloride, 1,1-dichloroethene, chloroform, 1,2-dichloropropane, toluene) and System Performance Check Compounds (chloromethane, 1,1-dichloroethane, bromoform, 1,1,2,2-tetrachloroethane, chlorobenzene) met the method 8260B limits of $< 20\%$ difference. All response factors of reported compounds met data validation criteria.

In run 0101101, percent differences of methylene chloride (21.95 %) and tetrachloroethene (21.916 %) exceeded the 20 % limit. Siemens appropriately qualified associated sample results in run 0101101 with a "CSH" qualifier. Further action taken was to qualify detected tetrachloroethene in MW-73 as estimated with a J code from a possible high calibration bias. No action was needed to qualify MW-73 data, as detected tetrachloroethene was already qualified with a J code as the concentration reported was between the LOD and LOQ.

3.2.4 Laboratory Blanks

No detectable volatile organics above the Limit of Detection (LOD) were present in the lab blanks analyzed with the project samples. No action was needed to qualify sample data.

3.2.5 Surrogate Recoveries

All surrogate recoveries were within Siemens limits and ranged from 84.9-118.8 %. No limits are specified in method 8260. No action was needed to qualify sample data.

3.2.6 Matrix Spike/Matrix Spike Duplicates

MS/MSD recoveries and RPD values in the project samples used for the MS/MSD (MW-52B, MW-63A, MW-77C) were within historical limits established by Siemens except for the outliers listed in Table 3. Action taken was to qualify detected trichloroethene in MW-52B and the associated samples in run 0101202 (MW-23A, MW-23B, MW-38B, RW-16B, RW-16B DUP, MW-51B, RW-3B, RW-3C, EC-1) as estimated with a J code from a possible high bias. No action was needed to qualify detected sample data associated with high recoveries in MW-63A in run 0101101, as none of the volatile organics that were recovered with a high bias (1,1-dichloroethene, methylene chloride) were detected in the associated project samples and no high bias was possible.

Detected trichloroethene, methylene chloride and 1,1,1-trichloroethane in associated project samples in run 0101202 was qualified as estimated from high method/matrix imprecision with a J code if not already qualified with a J code from being between the LOD and LOQ.

3.2.7 Internal Standards

Internal standard areas for quantitation ions in project samples were within the method 8260 limit of - 50 % to + 100 %.

3.3 Field QC Results

The trip blanks collected with the project samples on 10/4/10 and 10/5/10 did not contain any detectable volatile organics above the LOD. No action was needed to qualify sample data. The trip blank collected on 10/6/10 contained detectable methylene chloride at 0.52 ug/L. No action was needed to qualify sample data, as none of the samples collected and shipped with this trip blank contained detectable methylene chloride and therefore no high bias was possible.

Field duplicates were collected for MW-62A, MW-76A and RW-16B. The calculated Relative Percent Differences (RPD) for the detected volatile organics between the samples and their field duplicate are presented in Table 2. All RPD values were within the U.S. EPA Region V limit of a factor of five (133 % RPD) for organics and ranged from 0-26 %. No action was needed to qualify sample data.

3.4 Data Usability

All 8260 data reported were usable for the purposes of assessing interim remedial action. Detected tetrachloroethene in MW-73 was estimated from a possible high calibration bias. Detected trichloroethene in MW-52B and the associated samples in run 0101202 (MW-23A, MW-23B, MW-38B, RW-16B, RW-16B DUP, MW-51B, RW-3B, RW-3C, EC-1) was estimated from a possible high bias as exhibited in the MS/MSD.

If you have any questions regarding the qualification of data or the data validation process/criteria used, please contact me at (920) 469-9113.

Attachments:

Tables 1, 2, 3
Validated Analytical Reports (hard copy)
Analytical Results Oct2010.xls (Gannett Fleming only)

cc: Gannett Fleming, Inc.



132

RECEIVED	
GANNETT FLEMING-MADISON, WI	
FILE NO:	<u>34283.000</u> NPI
JAN 12 2011	
REVIEWED BY:	<u>[Signature]</u>
DATE:	<u>1/12/11</u>
ROUTE TO:	_____

TECHNICAL MEMORANDUM

DATE: January 11, 2011

TO: Derrick Paul
National Presto Industries, Inc.

FROM: Marcia A. Kuehl
President/Owner, MAKuehl Company *MAK*

SUBJECT: Data Validation for National Presto Industries, Inc.
Interim Remedial Action Project
December Quarterly Groundwater Sampling Event
Project #: 34283

1.0 OVERVIEW

Analytical results (8260 volatiles) for the samples listed in Table 1, collected by Gannett Fleming, Inc. from the interim remedial action at National Presto Industries, Inc. from December 15-16, 2010 have been evaluated using the EPA guidance documents "National Functional Guidelines for Organic Data Review", dated October 1999, EPA-540/R-99/008, and the EPA Region V "Standard Operating Procedure for Validation of CLP Organic Data, April, 1991, Revised August 25, 1993". The project data quality objective was assumed to be that data were to be usable for the purposes of assessing the interim remedial action for the site groundwater. The review was based on the Level II data packages supplied by the analytical laboratory, Siemens, located in Rothschild, Wisconsin.

DQO Attainment

All 8260 data reported were usable for the purposes of assessing interim remedial action. Detected trichloroethene in MW-23A was estimated from a possible high bias as evidenced by the MSD recovery.

Values qualified with a J code by the laboratory are those that are above the LOD, but less than the LOQ. The validated data sheets are attached.

2.0 VOLATILE ORGANICS DATA BY METHOD 8260B

Siemens utilized EPA method 8260B for all project sample analysis. No significant

deviations from this reference method affecting data quality were evident from the documentation received and reviewed. No action was needed to qualify sample data.

2.1 Completeness Assessment

The required method 8260 frequency for internal laboratory QC samples and calibration checks were met. All samples collected and indicated on the chain-of-custody form were analyzed.

Sample location MW-74B was noted on the chain-of-custody form as being sampled twice, at 11:15 AM and again on 11:50 AM on 12/16/10, but neither sample was indicated as a field duplicate. It was clarified from Dave Olig, Gannett Fleming that MW-74B was the sample collected on 11:15, and the samples collected on 11:45 and 11:50 should be labeled MW-23A and MW-23B, respectively, with the MS/MSD samples being from MW-23A. The reports were corrected by this validator. A full and accurate chain-of-custody record is not available for this sampling event.

2.2 Compliance Assessment

2.2.1 Holding Times/Preservation

All samples were analyzed within the 14 day holding time. Verification of sample pH upon analysis indicated that all samples were adequately preserved at a pH of < 2. Sample temperature upon receipt by the lab was acceptable. No action was needed to qualify sample data.

2.2.2 Initial Calibration and Tuning

BFB tuning results met method 8260 criteria. No action was needed to qualify sample data.

An eight point initial calibration curve ranging from 0.5-75 ug/L was analyzed on 12/14/10. All rsd values for the reported volatile organics were less than the 15 % limit required by the method. Method System Performance Check Compounds (chloromethane, 1,1-dichloroethane, bromoform, 1,1,2,2-tetrachloroethane, chlorobenzene) met the EPA method data validation criteria of > 0.30 for 1,1,2,2-tetrachloroethane and chlorobenzene and > 0.10 for chloromethane, 1,1-dichloroethane, and bromoform. No action was needed to qualify sample data.

2.2.3 Continuing Calibration

A 20 ug/L continuing calibration standard (CCAL) was analyzed according to method 8260B every 12 hours. Method System Performance Check Compounds (chloromethane, 1,1-dichloroethane, bromoform, 1,1,2,2-tetrachloroethane, chlorobenzene) met the EPA method data validation criteria of > 0.30 for 1,1,2,2-tetrachloroethane and chlorobenzene and > 0.10 for chloromethane, 1,1-dichloroethane, and bromoform. All Calibration Check

Compounds (vinyl chloride, 1,1-dichloroethene, chloroform, 1,2-dichloropropane, toluene) and System Performance Check Compounds (chloromethane, 1,1-dichloroethane, bromoform, 1,1,2,2-tetrachloroethane, chlorobenzene) met the method 8260B limits of < 20 % difference. All response factors of reported compounds met data validation criteria.

2.2.4 Laboratory Blanks

No detectable volatile organics above the Limit of Detection (LOD) were present in the lab blanks analyzed with the project samples. No action was needed to qualify sample data.

2.2.5 Surrogate Recoveries

All surrogate recoveries in project samples were within Siemens limits and ranged from 96.8-111.0 %. No limits are specified in method 8260. No action was needed to qualify sample data.

2.2.6 Matrix Spike/Matrix Spike Duplicates

MS/MSD recoveries and RPD values in the project samples used for the MS/MSD (MW-38A, 65B, 23A) were within historical limits established by Siemens except for the outliers listed in Table 2. Action taken was to qualify detected trichloroethene in MW-23A as estimated with a J code from a possible high bias as evidenced by the MSD recovery.

2.2.7 Internal Standards

Internal standard areas for quantitation ions in project samples were within the method 8260 limit of - 50 % to + 100 %.

2.3 Field QC Results

The trip blanks collected with the project samples on 12/15/10 and 12/16/10 did not contain any detectable volatile organics above the LOD. No action was needed to qualify sample data.

An equipment blank, EQB, was collected on 12/16/10. Detectable m,p-xylene (0.44 ug/L), o-xylene (0.23 ug/L) and toluene (0.42 ug/L) was present in this blank. No action was needed to qualify sample data for samples collected on 12/16/10 with this blank, as no m,p-xylene, o-xylene or toluene was present in these samples.

Field duplicates were collected for MW-77C and MW-38C. The calculated Relative Percent Differences (RPD) for the detected volatile organics between the samples and their field duplicate are presented in Table 3. All RPD values were within the U.S. EPA Region V limit of a factor of five (133 % RPD) for organics and ranged from 0-23 %. No action was needed to qualify sample data.

2.4 Data Usability

All 8260 data reported were usable for the purposes of assessing interim remedial action.

Detected trichloroethene in MW-23A was estimated from a possible high bias as evidenced by the MSD recovery.

If you have any questions regarding the qualification of data or the data validation process/criteria used, please contact me at (920) 469-9113.

Attachments:

Tables 1, 2, 3

Validated Analytical Reports (hard copy)

Analytical Results Dec2010.xls (Gannett Fleming only)

cc: Gannett Fleming, Inc.