

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Jake Lucht
150 N. Washington St.
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. Lucht:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 150 N. Washington St., Unity, Clark County, and inform you of the contaminants found and provide additional information. The well was sampled for Volatile Organic Compounds (VOCs) by DNR on October 4, 2016 after the carbon treatment system was serviced, as part of the monitoring required for the chlorinated solvent contamination issue in the Village of Unity.

In the pretreatment water sample tetrachloroethene was detected at a concentration of 55.2 micrograms per liter ($\mu\text{g/l}$) which exceeds the groundwater quality standard for tetrachloroethene of 5.0 $\mu\text{g/l}$. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water. When a state water standard is exceeded, the state may require the party responsible for the contaminant release to restore groundwater quality. The VOC compounds cis-1,2-dichloroethene and trichloroethene were also detected in your pre-treatment water sample, however these compounds were detected below state groundwater standards.

No VOCs were detected in either of the post-treatment water samples collected from your well. Based on the water sample results the carbon treatment system installed in your home is effective in removing the VOC-related contaminants from your water.


If you have health-related questions about chlorinated solvents in drinking water, contact Robert Leischow at the Clark County Health Department at (715) 743-5105.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Robert Leischow – Clark County Health Department
Roy Irving - DHS

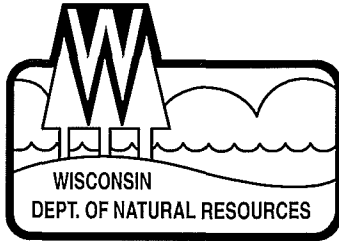

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 1, 2016

Mr. and Mrs. Tom and Angela Smith
240 South Washington Street
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. and Mrs. Smith:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results for the post-treatment water sample collected from the well at 240 South Washington Street, Unity, Wisconsin, and inform you of the contaminants found and provide additional information.

The well was sampled for Volatile Organic Compounds (VOCs) by DNR on October 6, 2016. Dichlorodifluoromethane was detected at 0.46 micrograms per liter ($\mu\text{g/l}$) which is below state drinking water standards. No other VOCs were detected in the sample collected at your residence.


If you have health-related questions about chlorinated solvents in drinking water, contact Robert Leischow at the Clark County Health Department at (715) 743-5105.

If you have any questions about the well water sample results, the cause of the contamination or the status of clean-up efforts, please contact me at (715) 839-3750 or MatthewA.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire,
Robert Leischow – Clark County Health Department,
Roy Irving – DHS

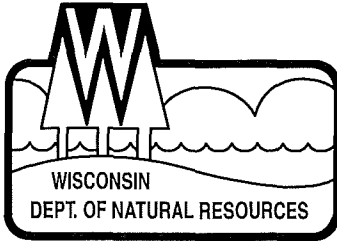

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Mr. Thomas Much
290 South Washington Street
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. Much:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results for the post-treatment water sample collected from the well at 290 South Washington Street, Unity, Wisconsin, and inform you of the contaminants found and provide additional information.

The well was sampled for Volatile Organic Compounds (VOCs) by DNR on October 6, 2016. Tetrachloroethene was detected between the limit of detection (LOD) and the limit of quantification (LOQ) at 0.85 micrograms per liter ($\mu\text{g/L}$). This means that the laboratory instrument was able to detect the presence of tetrachloroethene but there was not enough in the water sample to accurately report the concentration.


If you have health-related questions about chlorinated solvents in drinking water, contact Robert Leischow at the Clark County Health Department at (715) 743-5105.

If you have any questions about the well water sample results, the cause of the contamination or the status of clean-up efforts, please contact me at (715) 839-3750 or MatthewA.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire,
Robert Leischow – Clark County Health Department,
Roy Irving – DHS

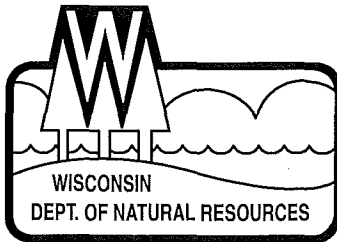

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Mr. Cody Meyer
270 South Washington Street
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. Meyer:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results for the post-treatment water sample collected from the well at 270 South Washington Street, Unity, Wisconsin, and inform you of the contaminants found and provide additional information.

The well was sampled for Volatile Organic Compounds (VOCs) by DNR on October 5, 2016. Toluene was detected at 0.42 micrograms per liter ($\mu\text{g/l}$) which is below the state groundwater standards of 800 $\mu\text{g/l}$. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water.


If you have health-related questions about chlorinated solvents in drinking water, contact Robert Leischow at the Clark County Health Department at (715) 743-5105.

If you have any questions about the well water sample results please contact me at (715) 839-3750 or MatthewA.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire,
Robert Leischow – Clark County Health Department,
Roy Irving – DHS

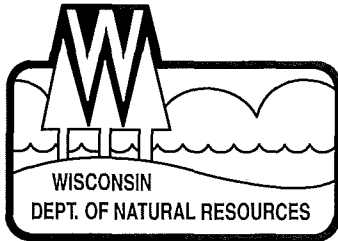

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Mr. Matt Porath
151 South Madison Street
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. Porath:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 151 South Madison Street, Unity, Clark County, and inform you that Volatile Organic Compounds (VOCs) contaminants were not found in the water sample collected from your well.


The well was sampled for VOCs by DNR on October 5, 2016 as part of the routine groundwater monitoring program being conducted in the Village of Unity. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Robert Leischow – Clark County Health Department
Roy Irving - DHS

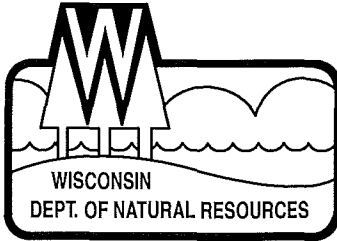

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Mr. & Ms. Gary & Linda Meyer
191 S. Madison St.
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. & Ms. Meyer:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 191 S. Madison St., Unity, Clark County, and inform you of the contaminants found and provide additional information.

The well was sampled for Volatile Organic Compounds (VOCs) by DNR on October 4, 2016, after the carbon treatment system was serviced, as part of the monitoring required for the chlorinated solvent contamination issue in the Village of Unity.

In the pretreatment water sample tetrachloroethene was detected at a concentration of 37.3 micrograms per liter ($\mu\text{g/l}$) which exceeds the groundwater quality standard for tetrachloroethene of 5.0 $\mu\text{g/l}$. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water. When a state water standard is exceeded, the state may require the party responsible for the contaminant release to restore groundwater quality. The VOC compounds dichlorodifluoromethane, cis-1,2-dichloroethene and trichloroethene were also detected in your pre-treatment water sample, however these compounds were detected below state groundwater standards.

No VOCs were detected in the post-treatment water samples collected from your well.

Based on the water sample results the carbon treatment system installed in your home is effective in removing the VOC-related contaminants from your water.

If you have health-related questions about chlorinated solvents in drinking water, contact Robert Leischow at the Clark County Health Department at (715) 743-5105.


If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

A handwritten signature in dark ink, appearing to read 'Matt Thompson', with a horizontal line extending to the right.

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Robert Leischow – Clark County Health Department
Roy Irving - DHS

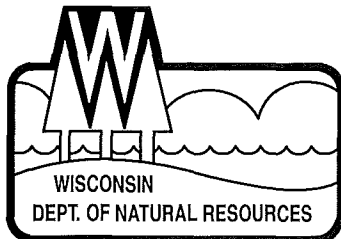

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Ms. Bonnie Weideman
101 South Washington Street
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Ms. Weideman:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 101 South Washington Street, Unity, Clark County, and inform you that Volatile Organic Compounds (VOCs) contaminants were not found in the water sample collected from your well.

The well was sampled for VOCs by DNR on October 4, 2016 as part of the routine groundwater monitoring program being conducted in the Village of Unity. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.thompson@wisconsin.gov, you can also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Robert Leischow – Clark County Health Department
Roy Irving - DHS



State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Mr. Al Revling
1801 South Schmidt St.
Marshfield, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. Revling:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 101 South Madison St., Unity, Clark County, and inform you of the post-treatment results and provide additional information.

The well was sampled for Volatile Organic Compounds (VOCs) by DNR on October 4, 2016, after the carbon treatment system was serviced, as part of the monitoring required for the chlorinated solvent contamination issue in the Village of Unity.

In the pre-treatment water sample tetrachloroethene was detected at a concentration of 62.4 micrograms per liter ($\mu\text{g/l}$), which exceeds the groundwater quality standard of 5.0 $\mu\text{g/l}$ for this compound. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water. When a state water standard is exceeded, the state may require the party responsible for the contaminant release to restore groundwater quality. The VOC compounds trichloroethene and cis-1,2-dichloroethene were also detected in your water sample, however these compounds were detected below state groundwater standards.

No VOCs were detected in either of the post-treatment samples collected from this well. Based on the water sample results the carbon treatment system installed at this location is effective in removing the VOC-related contaminants from your water.


If you have health-related questions about chlorinated solvents in drinking water, contact Robert Leischow at the Clark County Health Department at (715) 743-5105.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Robert Leischow – Clark County Health Department
Roy Irving - DHS

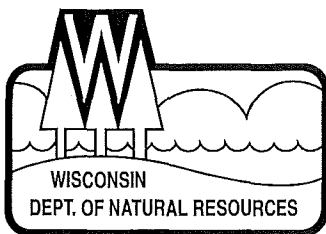

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 1, 2016

Mr. & Mrs. Clyde & Irene Schreiber
310 West Clark St.
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. and Mrs. Schreiber:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 310 West Clark Street, Unity, Clark County, and inform you that Volatile Organic Compounds (VOCs) contaminants were not found in the water sample collected from your well.


The well was sampled for VOCs by DNR on October 5, 2016 as part of the routine groundwater monitoring program being conducted in the Village of Unity. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Robert Leischow – Clark County Health Department
Roy Irving – DHS

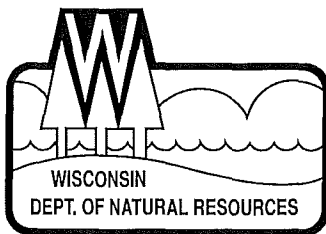

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Bradley Brinegar
291 S. Washington St.
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. Brinegar:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 285 S. Washington Street, Unity, Clark County, and inform you that Volatile Organic Compounds (VOCs) contaminants were not found in the water sample collected from your well. You are receiving this letter because it is our understanding that your property shares a well with 285 S. Washington Street.


The well was sampled for VOCs by DNR on October 5, 2016 as part of the routine groundwater monitoring program being conducted in the Village of Unity. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Robert Leischow – Clark County Health Department
Roy Irving – DHS

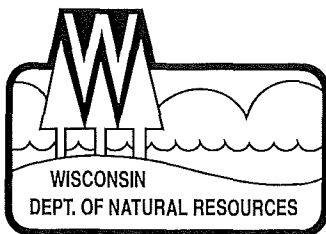

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 1, 2016

Mr. Robert Kauffman
291 South Madison Street
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. Kauffman:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 291 South Madison Street, Unity, Clark County, and inform you that Volatile Organic Compounds (VOCs) contaminants were not found in the water sample collected from your well.


The well was sampled for VOCs by DNR on October 5, 2016 as part of the routine groundwater monitoring program being conducted in the Village of Unity. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Robert Leischow – Clark County Health Department
Roy Irving - DHS

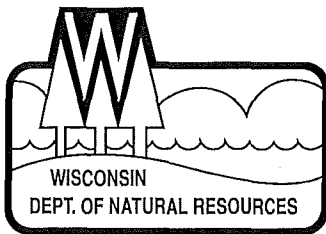

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Ron Loertscher
285 S. Washington St.
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. Loertscher:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 285 S. Washington Street, Unity, Clark County, and inform you that Volatile Organic Compounds (VOCs) contaminants were not found in the water sample collected from your well.


The well was sampled for VOCs by DNR on October 5, 2016 as part of the routine groundwater monitoring program being conducted in the Village of Unity. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Robert Leischow – Clark County Health Department
Roy Irving – DHS

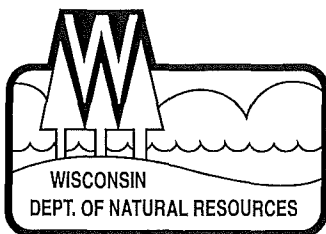

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Mr. and Mrs. Jeremy and Jill Bertsinger
285 South Madison Street
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. and Mrs. Bertsinger:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 285 South Madison Street, Unity, Clark County, and inform you that Volatile Organic Compounds (VOCs) contaminants were not found in the water sample collected from your well.


The well was sampled for VOCs by DNR on October 6, 2016 as part of the routine groundwater monitoring program being conducted in the Village of Unity. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Robert Leischow – Clark County Health Department
Roy Irving - DHS

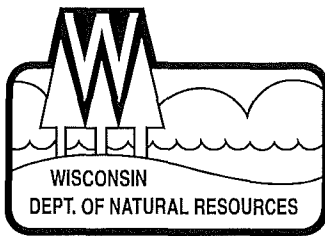

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Mr. Adam Shelley
271 South Madison Street
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. Shelley:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 271 South Madison Street, Unity, Clark County, and inform you that Volatile Organic Compounds (VOCs) contaminants were not found in the water sample collected from your well.


The well was sampled for VOCs by DNR on October 6, 2016 as part of the routine groundwater monitoring program being conducted in the Village of Unity. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or MatthewA.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire,
Robert Leischow – Clark County Health Department,
Roy Irving - DHS

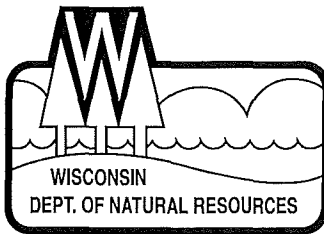

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Mr. Travis Schraufnagel
261 South Washington Street
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. Schraufnagel:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 261 South Washington Street, Unity, Clark County, and inform you that Volatile Organic Compounds (VOCs) contaminants were not found in the water sample collected from your well.


The well was sampled for VOCs by DNR on October 6, 2016 as part of the routine groundwater monitoring program being conducted in the Village of Unity. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Robert Leischow – Clark County Health Department
Roy Irving – DHS

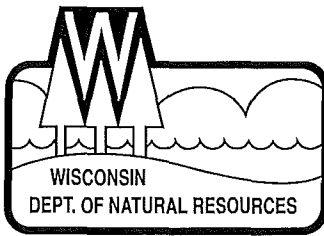

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Ray Neustedt
251 S. Washington St.
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. Loertscher:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 251 S. Washington Street, Unity, Clark County, and inform you that Volatile Organic Compounds (VOCs) contaminants were not found in the water sample collected from your well.


The well was sampled for VOCs by DNR on October 5, 2016 as part of the routine groundwater monitoring program being conducted in the Village of Unity. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Robert Leischow – Clark County Health Department
Roy Irving – DHS

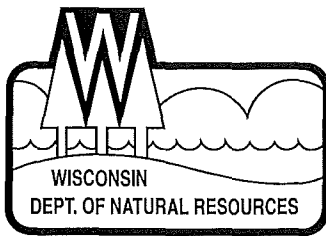

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Steve Knight
250 South Washington Street
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. Knight:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 250 South Washington Street, Unity, Clark County, and inform you that Volatile Organic Compounds (VOCs) contaminants were not found in the water sample collected from your well.


The well was sampled for VOCs by DNR on October 5, 2016 as part of the routine groundwater monitoring program being conducted in the Village of Unity. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Robert Leischow – Clark County Health Department
Roy Irving – DHS

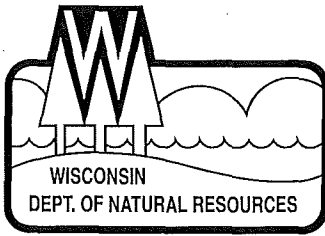

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Ms. Dawn High
231 West Cook Street
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Ms. High:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 231 West Cook Street, Unity, Clark County, and inform you that Volatile Organic Compounds (VOCs) contaminants were not found in the water sample collected from your well.


The well was sampled for VOCs by DNR on October 5, 2016 as part of the routine groundwater monitoring program being conducted in the Village of Unity. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Robert Leischow – Clark County Health Department
Roy Irving - DHS

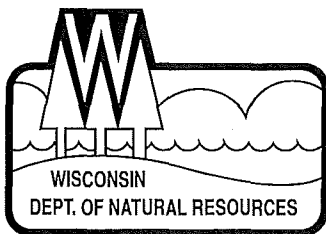

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Mr. Ernst Kibbel Jr.
S3570 County Highway F
Spencer, WI 54479

Subject: Notification of Private Well Test Results
221 West Clark St., Unity, Wisconsin

Dear Mr. Kibbel:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 221 West Clark Street, Unity, Clark County, and inform you of the contaminants found and provide additional information.

The well was sampled for Volatile Organic Compounds (VOCs) by DNR on October 6, 2016 as part of the monitoring required for the chlorinated solvent contamination issue in the Village of Unity. Tetrachloroethene was detected at a concentration of 0.28 micrograms per liter ($\mu\text{g/l}$) which is below the groundwater quality standard for tetrachloroethene of 5.0 $\mu\text{g/l}$. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water. When a state water standard is exceeded, the state may require the party responsible for the contaminant release to restore groundwater quality.


When contaminant levels in water exceed state standards, the Wisconsin Department of Health Services recommends that people not consume the water either by drinking or by eating food prepared with the water.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.thompson@wisconsin.gov, you can also contact Tom Hvizdak at 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Melisa Brust, 221 W. Clark St., Unity, WI
Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire,
Robert Leischow – Clark County Health Department
Roy Irving – DHS

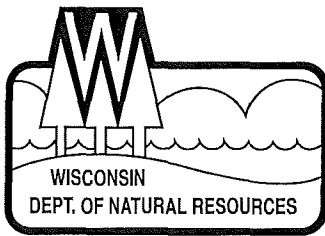

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Mr. Kurt Scheer
221 S. Madison St.
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. Scheer:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 221 S. Madison St., Unity, Clark County, and inform you of the contaminants found and provide additional information.

The well was sampled for Volatile Organic Compounds (VOCs) by DNR on October 5, 2016 as part of the monitoring required for the chlorinated solvent contamination issue in the Village of Unity. Tetrachloroethene was detected at a concentration of 15.1 micrograms per liter ($\mu\text{g/l}$) which exceeds the groundwater quality standard for tetrachloroethene of 5.0 $\mu\text{g/l}$. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water. When a state water standard is exceeded, the state may require the party responsible for the contaminant release to restore groundwater quality. The VOC compounds cis-1,2-dichloroethene, dichlorodifluoromethane and trichloroethene were also detected in your water sample, however these compounds were detected below state groundwater standards.

When contaminant levels in water exceed state standards, the Wisconsin Department of Health Services recommends that people not consume the water either by drinking or by eating food prepared with the water.

If you have health-related questions about chlorinated solvents in drinking water, contact Robert Leischow at the Clark County Health Department at (715) 743-5105.


Based on the results from this water sample the DNR began providing you with a temporary emergency water supply. For questions about a temporary water supply, the cause of the contamination or the status of clean-up efforts, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire

Robert Leischow – Clark County Health Department
Roy Irving - DHS

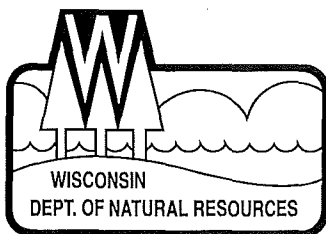

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Frank and Angela Makovec
220 West Taylor Street
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. and Mrs. Makovec:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results for the post-treatment water sample collected from the well at 220 West Taylor Street, Unity, Wisconsin, and inform you of the contaminants found and provide additional information.

The well was sampled for Volatile Organic Compounds (VOCs) by DNR on October 5, 2016. Dichlorodifluoromethane and Tetrachloroethane were detected at 0.46 micrograms per liter ($\mu\text{g/l}$) and 0.78 micrograms per liter ($\mu\text{g/l}$), respectively. Both of these compounds are below state groundwater standards. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water.


If you have health-related questions about chlorinated solvents in drinking water, contact Robert Leischow at the Clark County Health Department at (715) 743-5105.

If you have any questions about the well water sample results, the cause of the contamination or the status of clean-up efforts, please contact me at (715) 839-3750 or MatthewA.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire,
Robert Leischow – Clark County Health Department,
Roy Irving – DHS

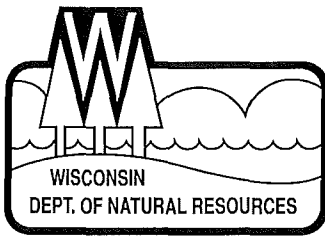

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Mr. Kevin Roe
211 West Cook St.
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. Roe:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 211 West Cook St., Unity, Clark County, and inform you of the contaminants found and provide additional information.

The well was sampled for Volatile Organic Compounds (VOCs) by DNR on October 6, 2016 as part of the monitoring required for the chlorinated solvent contamination issue in the Village of Unity. Tetrachloroethene was detected at a concentration of 6.22 micrograms per liter ($\mu\text{g/l}$) which exceeds the groundwater quality standard for tetrachloroethene of 5.0 $\mu\text{g/l}$. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water. When a state water standard is exceeded, the state may require the party responsible for the contaminant release to restore groundwater quality. The VOC compounds cis-1,2-dichloroethene and dichlorodifluoromethane were also detected in your water sample, however these compounds were detected below state groundwater standards.

When contaminant levels in water exceed state standards, the Wisconsin Department of Health Services recommends that people not consume the water either by drinking or by eating food prepared with the water. If you have health-related questions about chlorinated solvents in drinking water, contact Robert Leischow at the Clark County Health Department at (715) 743-5105.

Based on the results from this and past water samples the DNR began providing you with a temporary emergency water supply. For questions about a temporary water supply, the cause of the contamination or the status of clean-up efforts, please contact me at (715) 839-3750 or MatthewA.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,


Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Robert Leischow – Clark County Health Department
Roy Irving - DHS



State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Mr. John Czuppa
210 S. Washington St.
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. Czuppa:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 210 S. Washington St., Unity, Clark County, and inform you of the contaminants found and provide additional information.

The well was sampled for Volatile Organic Compounds (VOCs) by DNR on October 5, 2016 as part of the monitoring required for the chlorinated solvent contamination issue in the Village of Unity. Tetrachloroethene was detected at a concentration of 1.12 micrograms per liter ($\mu\text{g/l}$) which exceeds the groundwater quality standard for tetrachloroethene of 5.0 $\mu\text{g/l}$. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water. When a state water standard is exceeded, the state may require the party responsible for the contaminant release to restore groundwater quality. The VOC compounds cis-1,2-dichloroethene and chloroform were also detected in your water sample, however these compounds were detected below state groundwater standards.

When contaminant levels in water exceed state standards, the Wisconsin Department of Health Services recommends that people not consume the water either by drinking or by eating food prepared with the water.

If you have health-related questions about chlorinated solvents in drinking water, contact Robert Leischow at the Clark County Health Department at (715) 743-5105.

The DNR has been providing you with a temporary emergency water supply. For questions about a temporary water supply, the cause of the contamination or the status of clean-up efforts, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,


Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Robert Leischow – Clark County Health Department
Roy Irving - DHS



State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Pastor Al Houts
201 South Washington Street
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Pastor Houts:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 201 South Washington Street, Unity, Clark County, and inform you that Volatile Organic Compounds (VOCs) contaminants were not found in the water sample collected from your well.


The well was sampled for VOCs by DNR on October 6, 2016 as part of the routine groundwater monitoring program being conducted in the Village of Unity. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Robert Leischow – Clark County Health Department
Roy Irving – DHS

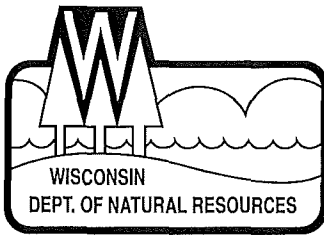

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Mr. Jeff Sweeney
191 South Washington Street
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. Sweeney:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 191 South Washington Street, Unity, Clark County, and inform you that Volatile Organic Compounds (VOCs) contaminants were not found in the water sample collected from your well.


The well was sampled for VOCs by DNR on October 5, 2016 as part of the routine groundwater monitoring program being conducted in the Village of Unity. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Robert Leischow – Clark County Health Department
Roy Irving - DHS

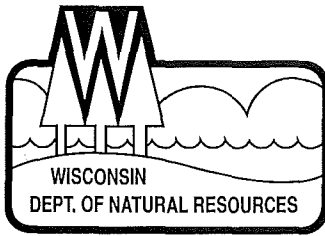

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 1, 2016

Mr. Frank Carey
181 South Madison Street
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. Carey:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 181 South Madison Street, Unity, Clark County, and inform you that Volatile Organic Compounds (VOCs) contaminants were not found in the water sample collected from your well.

The well was sampled for VOCs by DNR on October 6, 2016 as part of the routine groundwater monitoring program being conducted in the Village of Unity. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or MatthewA.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire,
Robert Leischow – Clark County Health Department,
Roy Irving - DHS



State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Mr. and Mrs. Don and Paula Kieser
171 South Washington Street
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. and Mrs. Kieser:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 171 South Washington Street, Unity, Clark County, and inform you that Volatile Organic Compounds (VOCs) contaminants were not found in the water sample collected from your well.


The well was sampled for VOCs by DNR on October 5, 2016 as part of the routine groundwater monitoring program being conducted in the Village of Unity. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Robert Leischow – Clark County Health Department
Roy Irving – DHS

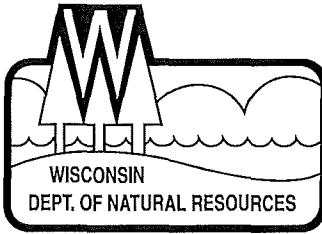

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Mr. Jason Ludtke
141 South Washington Street
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. Ludtke:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 141 South Washington Street, Unity, Clark County, and inform you that Volatile Organic Compounds (VOCs) contaminants were not found in the water sample collected from your well.

The well was sampled for VOCs by DNR on October 5, 2016 as part of the routine groundwater monitoring program being conducted in the Village of Unity. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Robert Leischow – Clark County Health Department
Roy Irving - DHS



State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Jake Lucht
150 N. Washington St.
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. Lucht:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 150 N. Washington St., Unity, Clark County, and inform you of the contaminants found and provide additional information. The well was sampled for Volatile Organic Compounds (VOCs) by DNR on October 4, 2016 after the carbon treatment system was serviced, as part of the monitoring required for the chlorinated solvent contamination issue in the Village of Unity.


In the pretreatment water sample tetrachloroethene was detected at a concentration of 55.2 micrograms per liter ($\mu\text{g/l}$) which exceeds the groundwater quality standard for tetrachloroethene of 5.0 $\mu\text{g/l}$. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water. When a state water standard is exceeded, the state may require the party responsible for the contaminant release to restore groundwater quality. The VOC compounds cis-1,2-dichloroethene and trichloroethene were also detected in your pre-treatment water sample, however these compounds were detected below state groundwater standards.

No VOCs were detected in either of the post-treatment water samples collected from your well. Based on the water sample results the carbon treatment system installed in your home is effective in removing the VOC-related contaminants from your water.

If you have health-related questions about chlorinated solvents in drinking water, contact Robert Leischow at the Clark County Health Department at (715) 743-5105.


If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,



Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Steve Moss – Clark County Health Department
Roy Irving - DHS

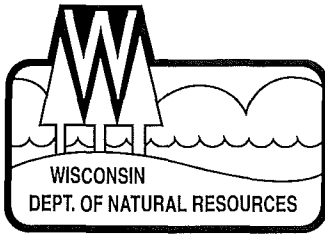

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Roger Hamus
161 North Washington Street
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. Hamus:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 161 North Washington Street, Unity, Clark County, and inform you that Volatile Organic Compounds (VOCs) contaminants were not found in the water sample collected from your well.


The well was sampled for VOCs by DNR on October 5, 2016 as part of the routine groundwater monitoring program being conducted in the Village of Unity. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Robert Leischow – Clark County Health Department
Roy Irving – DHS

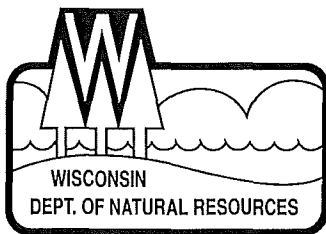

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 1, 2016

Mr. and Mrs. Jeff and Carrie Bloome
161 South Washington Street
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. and Mrs. Bloome:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 161 South Washington Street, Unity, Clark County, and inform you that Volatile Organic Compounds (VOCs) contaminants were not found in the water sample collected from your well.


The well was sampled for VOCs by DNR on October 5, 2016 as part of the routine groundwater monitoring program being conducted in the Village of Unity. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Robert Leischow – Clark County Health Department
Roy Irving - DHS

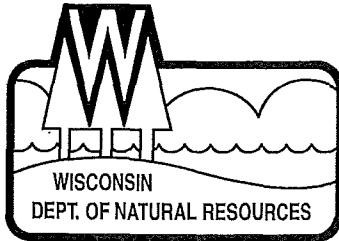

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Mr. Lorin Cliven
210 West Clark Street
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. Cliven:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 210 West Clark Street, Unity, Clark County, and inform you of the contaminants found and provide additional information.

The well was sampled for Volatile Organic Compounds (VOCs) by DNR on October 5, 2016, after the carbon treatment system was serviced, as part of the monitoring required for the chlorinated solvent contamination issue in the Village of Unity.

In the pre-treatment water sample tetrachloroethene and trichloroethene were detected at concentrations of 264 micrograms per liter ($\mu\text{g/l}$) and 17.3 $\mu\text{g/l}$, respectively, which exceed their groundwater quality standard of 5.0 $\mu\text{g/l}$ for each compound. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water. When a state water standard is exceeded, the state may require the party responsible for the contaminant release to restore groundwater quality. The VOC compounds cis-1,2-dichloroethene, trans-1,2-dichloroethene, and dichlorodifluoromethane were also detected in your water sample, however these compounds were detected below state groundwater standards.


No VOCs were detected in either of the post-treatment samples collected from this well.

Based on the water sample results the carbon treatment system installed at this location is effective in removing the VOC-related contaminants from your water.

If you have health-related questions about chlorinated solvents in drinking water, contact Robert Leischow at the Clark County Health Department at (715) 743-5105.


If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

A handwritten signature in black ink, appearing to read 'MT', with a long horizontal stroke extending to the right.

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Robert Leischow – Clark County Health Department
Roy Irving - DHS

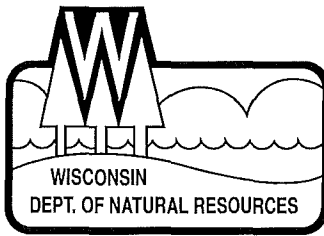

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Mr. Joshua Wanaher
131 North Madison St.
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. Wanaher:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 131 North Madison Street, Unity, Clark County, and inform you of the contaminants found and provide additional information.

The well was sampled for Volatile Organic Compounds (VOCs) by DNR on October 5, 2016, after the carbon treatment system was serviced, as part of the monitoring required for the chlorinated solvent contamination issue in the Village of Unity.

In the pre-treatment water sample tetrachloroethene and trichloroethene were detected at concentrations of 289 micrograms per liter ($\mu\text{g/l}$) and 18.5 $\mu\text{g/l}$, respectively, which exceed their groundwater quality standard of 5.0 $\mu\text{g/l}$ for each compound. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water. When a state water standard is exceeded, the state may require the party responsible for the contaminant release to restore groundwater quality. The VOC compounds cis-1,2-dichloroethene, trans-1,2-dichloroethene, and dichlorodifluoromethane were also detected in your water sample, however these compounds were detected below state groundwater standards.

No VOCs were detected in either of the post-treatment samples collected from this well. Based on the water sample results the carbon treatment system installed at this location is effective in removing the VOC-related contaminants from your water.


If you have health-related questions about chlorinated solvents in drinking water, contact Robert Leischow at the Clark County Health Department at (715) 743-5105.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Robert Leischow – Clark County Health Department
Roy Irving - DHS

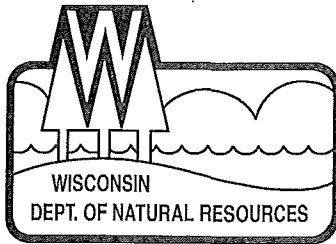

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 1, 2016

Mr. and Mrs. Tom and Angela Smith
240 South Washington Street
Unity, WI 54488

Subject: Notification of Private Well Test Results,
Bad Habits Bar
140 North Front Street, Unity, Wisconsin

Dear Mr. and Mrs. Smith:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 140 North Front St., Unity, Marathon County, and inform you of the contaminants found and provide additional information.


The well was sampled for Volatile Organic Compounds (VOCs) by DNR on October 4, 2016, after the carbon treatment system was serviced, as part of the monitoring required for the chlorinated solvent contamination issue in the Village of Unity.

In the pre-treatment water sample tetrachloroethene was detected at a concentration of 19.6 micrograms per liter ($\mu\text{g/l}$), which exceeds the groundwater quality standard of 5.0 $\mu\text{g/l}$ for this compound. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water. When a state water standard is exceeded, the state may require the party responsible for the contaminant release to restore groundwater quality. The VOC compounds trichloroethene and cis-1,2-dichloroethene were also detected in your water sample, however these compounds were detected below state groundwater standards.

No VOCs were detected in either of the post-treatment samples collected from this well. Based on the water sample results the carbon treatment system installed at this location is effective in removing the VOC-related contaminants from your water.

If you have health-related questions about chlorinated solvents in drinking water, contact Dale Grosskurth at the Marathon County Health Department at (715) 261-1907. For questions about the cause of the contamination or the status of clean-up efforts, please contact me at (715) 839-3750 or MatthewA.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

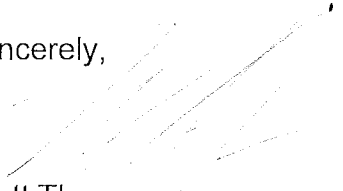

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Dale Grosskurth – Marathon County Health Department
Roy Irving - DHS



State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Rodney Kohl
102 South Russell Street
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. Kohl:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 102 South Russell Street, Unity, Marathon County, and inform you that Volatile Organic Compounds (VOCs) contaminants were not found in the water sample collected from your well.


The well was sampled for VOCs by DNR on October 6, 2016 as part of the routine groundwater monitoring program being conducted in the Village of Unity. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Dale Grosskurth – Marathon County Health Department
Roy Irving – DHS

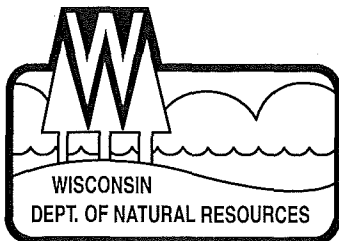

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Mr. Lorin Cliven
117 South Russell Street
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. Cliven:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 117 South Russell Street, Unity, Marathon County, and inform you that Volatile Organic Compounds (VOCs) contaminants were not found in the water sample collected from your well.

The well was sampled for VOCs by DNR on October 6, 2016 as part of the routine groundwater monitoring program being conducted in the Village of Unity. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or MatthewA.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Dale Grosskurth – Marathon County Health Department
Roy Irving - DHS



State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Ms. Barbara Noeldner
120 South Russell Street
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Ms. Noeldner:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 120 South Russell Street, Unity, Marathon County, and inform you that Volatile Organic Compounds (VOCs) contaminants were not found in the water sample collected from your well.


The well was sampled for VOCs by DNR on October 6, 2016 as part of the routine groundwater monitoring program being conducted in the Village of Unity. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Dale Grosskurth – Marathon County Health Department
Roy Irving – DHS

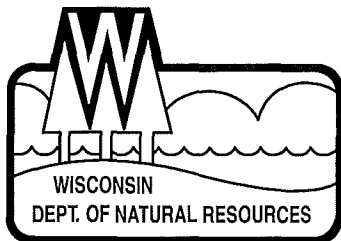

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Mr. Brian Michlig
151 South Main Street
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. Michlig:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 151 South Main Street, Unity, Marathon County, and inform you that Volatile Organic Compounds (VOCs) contaminants were not found in the water sample collected from your well.


The well was sampled for VOCs by DNR on October 6, 2016 as part of the routine groundwater monitoring program being conducted in the Village of Unity. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Dale Grosskurth – Marathon County Health Department
Roy Irving – DHS

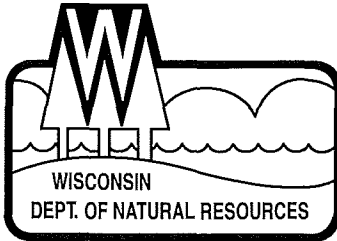

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Postal Building & Leasing Company
720 Olive Street
Suite 1630
St. Louis, MO 63101

Subject: Notification of Private Well Test Results,
Unity Post Office Building
102 South Front Street, Unity, Wisconsin

Dear Property Manager:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 102 South Front Madison St., Unity, Marathon County, Wisconsin, and inform you of the contaminants found and provide additional information.

The well was sampled for Volatile Organic Compounds (VOCs) by DNR on October 4, 2016 after the carbon treatment system was serviced, as part of the monitoring required for the chlorinated solvent contamination issue in the Village of Unity.

In the pre-treatment water sample tetrachloroethene and trichloroethene were detected at concentrations of 118 micrograms per liter ($\mu\text{g/l}$) and 10.7 $\mu\text{g/l}$, respectively, which exceed their groundwater quality standard of 5.0 $\mu\text{g/l}$ for each compound. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water. When a state water standard is exceeded, the state may require the party responsible for the contaminant release to restore groundwater quality. The VOC compounds benzene, cis-1,2-dichloroethene, trans-1,2-dichloroethene, and dichlorodifluoromethane were also detected in your water sample, however these compounds were detected below state groundwater standards.

No VOCs were detected in either of the post-treatment samples collected from this well. Based on the water sample results the carbon treatment system installed at this location is effective in removing the VOC-related contaminants from your water.

If you have health-related questions about chlorinated solvents in drinking water, contact Dale Grosskurth at the Marathon County Health Department at (715) 261-1907.


If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

A handwritten signature in dark ink, appearing to read 'Matt Thompson', with a stylized flourish extending to the right.

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Dale Grosskurth – Marathon County Health Department
Roy Irving - DHS

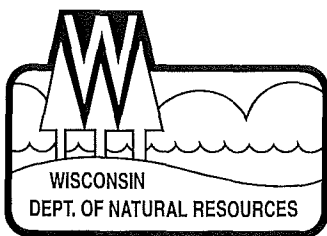

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Mr. Scott Jones
919 Martin Dr.
Marshfield, WI 54449

Subject: Notification of Private Well Test Results

Dear Mr. Jones:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 211 E. Clark St., Unity, Marathon County, and inform you of the contaminants found and provide additional information.


The well was sampled for Volatile Organic Compounds (VOCs) by DNR on October 6, 2016 as part of the monitoring required for the chlorinated solvent contamination issue in the Village of Unity. Tetrachloroethene was detected at a concentration of 7.96 micrograms per liter ($\mu\text{g/l}$) which exceeds the groundwater quality standard for tetrachloroethene of 5.0 $\mu\text{g/l}$. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water. When a state water standard is exceeded, the state may require the party responsible for the contaminant release to restore groundwater quality. The VOC compounds cis-1,2-dichloroethene, dichlorodifluoromethane and trichloroethene were also detected in your water sample, however these compounds were detected below state groundwater standards.

When contaminant levels in water exceed state standards, the Wisconsin Department of Health Services recommends that people not consume the water either by drinking or by eating food prepared with the water.


If you have health-related questions about chlorinated solvents in drinking water, contact Dale Grosskurth at the Marathon County Health Department at (715) 261-1907.

For questions about the cause of the contamination or the status of clean-up efforts, please contact me at (715) 839-3750 or Matthewa.thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,


Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Dale Grosskurth – Marathon County Health Department
Roy Irving - DHS

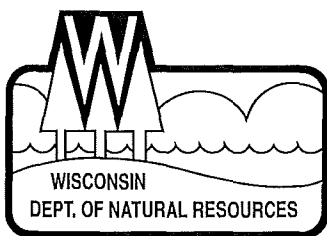

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Mr. & Mrs. Robin & Heidi Maldonis
101 South Main St.
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Mr. & Mrs. Maldonis:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 101 South Main St., Unity, Marathon County, and inform you of the contaminants found and provide additional information.

The well was sampled for Volatile Organic Compounds (VOCs) by DNR on October 6, 2016 as part of the monitoring required for the chlorinated solvent contamination issue in the Village of Unity. Dichlorodifluoromethane was detected at a concentration of 1.62 micrograms per liter ($\mu\text{g/l}$), this is below the groundwater quality standard of 1000 $\mu\text{g/l}$. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water. When a state water standard is exceeded, the state may require the party responsible for the contaminant release to restore groundwater quality. No other VOCs were detected in your water sample.


When contaminant levels in water exceed state standards, the Wisconsin Department of Health Services recommends that people not consume the water either by drinking or by eating food prepared with the water.

For questions about the status of clean-up efforts, please contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov, you may also contact me at (715)839-3750 or matthewa.thompson@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Dale Grosskurth – Marathon County Health Department
Roy Irving - DHS

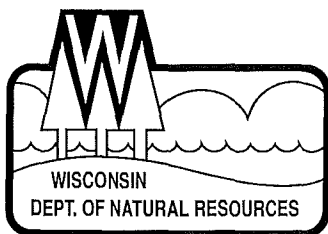

State of Wisconsin \ DEPARTMENT OF NATURAL RESOURCES

Scott Walker, Governor
Cathy Stepp, Secretary
Dan Baumann, Regional Director

Eau Claire Service Center
1300 W. Clairemont Avenue
Eau Claire, Wisconsin 54701
Telephone 715-839-3700
FAX 715-839-6076

November 4, 2016

Ms. Cindy Bennett
124 East Clark St.
Unity, WI 54488

Subject: Notification of Private Well Test Results

Dear Ms. Bennett:

This letter is to notify you that the Department of Natural Resources (DNR) received analytical test results collected from the well at 124 East Clark Street, Unity, Marathon County, and inform you of the contaminants found and provide additional information.

The well was sampled for Volatile Organic Compounds (VOCs) by DNR on October 4, 2016, after the carbon treatment system was serviced, as part of the monitoring required for the chlorinated solvent contamination issue in the Village of Unity.

In the pre-treatment water sample tetrachloroethene was detected at a concentration of 124 micrograms per liter ($\mu\text{g/l}$), which exceeds its groundwater quality standard of 5.0 $\mu\text{g/l}$ for this compound. Trichloroethene was detected at a concentration of 5.09 $\mu\text{g/l}$, which exceeds the groundwater quality standard of 5.0 $\mu\text{g/l}$ for this compound. State groundwater standards are established to protect public health and welfare by limiting the levels of contaminants in groundwater and drinking water. When a state water standard is exceeded, the state may require the party responsible for the contaminant release to restore groundwater quality. The VOC compounds benzene, cis-1,2-dichloroethene, trans-1,2-dichloroethene, and dichlorodifluoromethane were also detected in your water sample, however these compounds were detected below state groundwater standards.

Based on the water sample results the carbon treatment system installed in your home is effective in removing the VOC-related contaminants from your water, there were no contaminant detections in the post-system water samples.

If you have health-related questions about chlorinated solvents in drinking water, contact Dale Grosskurth at the Marathon County Health Department at (715) 261-1907.

If you have any questions about the well water sample results, please contact me at (715) 839-3750 or Matthewa.Thompson@wisconsin.gov, you may also contact Tom Hvizdak at (715) 421-7850 or Tom.Hvizdak@wisconsin.gov.

Sincerely,

Matt Thompson
Hydrogeologist

cc: Marty Nessman – DNR DG-5
David Rozeboom – DNR Eau Claire
Dale Grosskurth – Marathon County Health Department
Roy Irving - DHS