

**From:** James Lindemann <jclindemann@hyde-env.com>  
**Sent:** Tuesday, May 9, 2023 2:07 PM  
**To:** Saliars, Gwen N - DNR  
**Cc:** Pamela Shudy  
**Subject:** FW: OECI PFAS Sampling  
**Attachments:** Residential results mailing - All.pdf

**Follow Up Flag:** Follow up  
**Flag Status:** Completed

**CAUTION: This email originated from outside the organization.  
Do not click links or open attachments unless you recognize the sender and know the content is safe.**

Gwen,

Attached are the letters sent to the well owners near the OECI Superfund site. Please contact me if you have questions. Thanks.

Jim Lindemann  
*Hyde Environmental, Inc.*  
[www.hyde-env.com](http://www.hyde-env.com)

**W175 N11163 Stonewood Drive, Suite 110  
Germantown WI 53022-6501**

**(262) 250-1226 office  
(262) 317-9171 fax  
(262) 227-5878 cell**

---

**From:** Pamela Shudy <pshudy@hyde-env.com>  
**Sent:** Tuesday, May 9, 2023 1:48 PM  
**To:** James Lindemann <jclindemann@hyde-env.com>  
**Subject:** OECI PFAS Sampling

Jim –

Attached is the combined pdf of all the letters sent today to residential well owners that were sampled.

**Pam Shudy**  
*Hyde Environmental, Inc.*  
[www.hyde-env.com](http://www.hyde-env.com)

**W175 N11163 Stonewood Drive, Suite 110  
Germantown, WI 53022-6501**

**(262) 250-1226  
Fax (262) 317-9171**

**Notice:** This form may be used to comply with the requirements of s. NR 716.14 (2), Wis. Adm. Code; however, use of this form is not required. An alternate format may be used. The rule requires that notification be provided to 1) property owners when someone else is conducting the sampling, 2) to occupants of property belonging to the responsible person, and 3) to owners and occupants of property that does not belong to the responsible person but has been affected by contamination arising on his or her property. Notification is required within 10 business days of receiving the sample results. Personal information collected will be used for program administration and may be provided to requesters to the extent required by Wisconsin's Open Records law [ss. 19.31-19.39, Wis. Stats.].

**NOTE:** Under s. NR 716.14, Wis. Adm. Code, the responsible party must also submit sample results and other required information to the DNR. We recommend that copies of the sample results notifications be included with that submittal, along with all attachments. Using the same format used for data presentation for a closure request may be helpful to all parties. See s. NR 716.14, Wis. Adm. Code for the full list of information to be submitted to the DNR.

**Notification of Property Owners and Occupants:**

This notification form has been provided to you in order to provide the results of environmental sampling that has been conducted on property that you own or occupy. Samples were collected in accordance with the methods identified in the site investigation work plan, in accordance with s. NR. 716.09 and 716.13, Wis. Adm. Code. This sampling was conducted as a result of contamination originating at the following location.

Site Information			
Site Name		DNR ID # (BRRTS #)	
Oconomowoc Electroplating Company, Inc. (OECI) Superfund Site		02-14-000905	
Address	City	State	ZIP Code
W2573 Oak Street	Ashippun	WI	53003

**Responsible Party**

The person(s) responsible for completing this environmental investigation is:

Property Owner

Oconomowoc Electroplating Company, Inc.

Address	City	State	ZIP Code
W2573 Oak Street	Ashippun	WI	53003

Contact Person	Phone Number (include area code)
Gwen Saliars (WDNR PM), William Murray (US EPA Remedial PM)	(920) 510-4343

Person or company that collected samples

Hyde Environmental, Inc.

**Sample Results (Results Attached)**

Reason for Sampling:  Routine  Other (define) \_\_\_\_\_

The contaminants that have been identified at this time on property that you own or occupy include:

Contaminant	In Soil?		In Groundwater?	
	Yes	No	Yes	No
Gasoline	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Diesel or Fuel Oil	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Solvents	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Heavy Metals	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Pesticides	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Other: PFAS	<input type="radio"/>	<input checked="" type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>

This sampling event included sampling of a drinking water well. <input checked="" type="radio"/> Yes <input type="radio"/> No
If yes, the sampled drinking water well had detectable contaminants. <input checked="" type="radio"/> Yes <input type="radio"/> No

**Contaminants in Vapor**

	Yes	No
Indoor Air	<input type="radio"/>	<input checked="" type="radio"/>
Sub-slab	<input type="radio"/>	<input checked="" type="radio"/>
Exterior Soil Gas	<input type="radio"/>	<input checked="" type="radio"/>

## Site Investigation Sample Results Notification

Form 4400-249 (R 03/14)

Page 2 of 2

**Attached are:**

- A map that shows the locations from which samples were collected. (The map needs to meet the requirements of s. NR 716.15 (4), Wis. Adm. Code.)
- A data table with specific contaminant levels at each sample location and whether or not the sample results exceed state standards.
- A copy of the laboratory results.

**You are not identified as the person that is responsible for this contamination.** However, your cooperation is important. Property owners may become legally responsible for contamination if they do not allow access to the person that is responsible so that person may complete the environmental investigation and clean up activities.

**Option for written exemption:** You have the option of requesting a written liability exemption from the DNR for contamination that originated on another property, or on property that you lease. To do this, you must present an adequate environmental assessment of your property and pay a \$700 fee for review of this information. If you are interested in this option, please see DNR publication # RR 589, "When Contamination Crosses a Property Line - Rights and Responsibilities of Property Owners", available at: [dnr.wi.gov/files/PDF/pubs/rr/rr589.pdf](http://dnr.wi.gov/files/PDF/pubs/rr/rr589.pdf).

**Contact Information**

Please address questions regarding this notification, or requests for additional information to the contact person listed above, or to one of the following contacts:



**Environmental Consultant**

Company Name		Contact Person Last Name	First Name	
Hyde Environmental, Inc.		Lindemann	James	
Address		City	State	ZIP Code
W175 N11163 Stonewood Drive, Suite 110		Germantown	WI	53022
Phone # (inc. area code)	Email			
(262) 250-1226	jclindemann@hyde-env.com			

Select which agency:  Natural Resources       Agriculture, Trade and Consumer Protection

**State of Wisconsin Department of Natural Resources**

Contact Person Last Name		First Name	Phone # (inc. area code)	
Saliars		Gwen	(920) 510-4343	
Address		City	State	ZIP Code
625 E County Road Y, Suite 700		Oshkosh	WI	54901
Email				
gwen.saliars@wisconsin.gov				

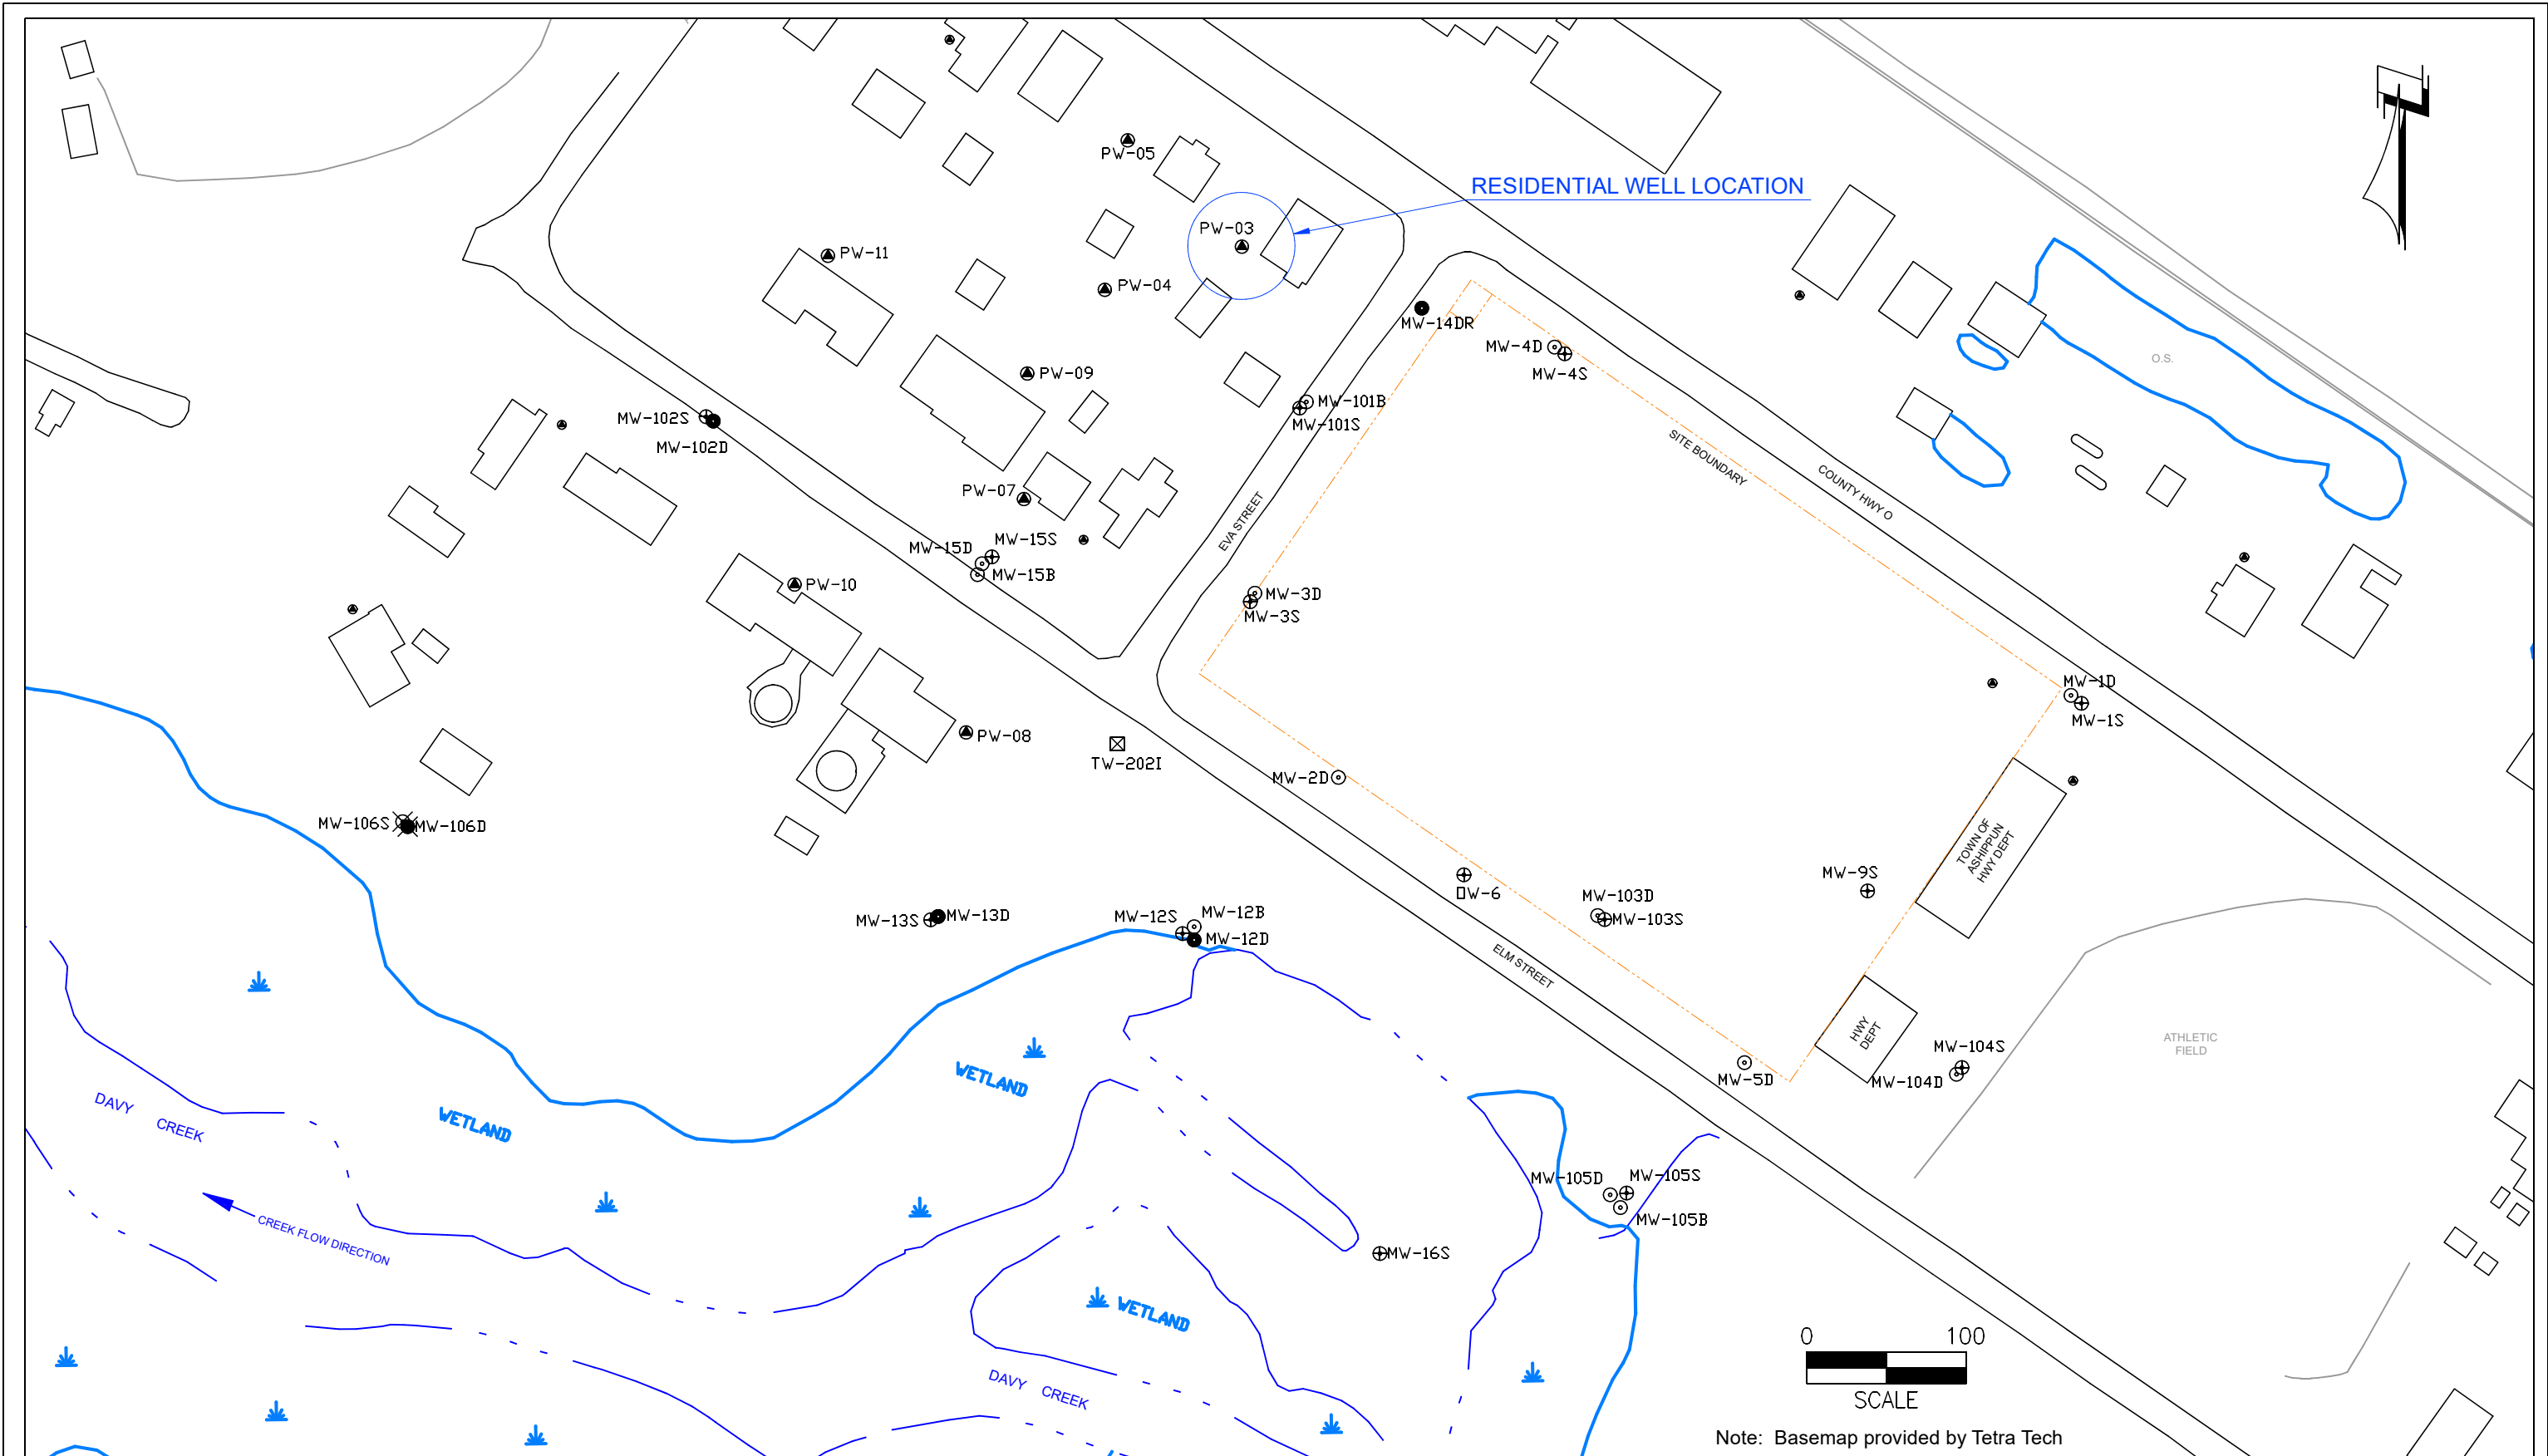

Note: Basemap provided by Tetra Tech

⊕ MW-105B	BEDROCK MONITORING WELL	● PW-11	RESIDENTIAL WELL
● MW-105D	DEEP UNCONSOLIDATED MONITORING WELL	● MW-106D	DEEP UNCONSOLIDATED SENTINEL WELL
⊕ MW-105S	SHALLOW UNCONSOLIDATED MONITORING WELL	⊗ MW-106S	SHALLOW UNCONSOLIDATED SENTINEL WELL
-----	FORMER OECl SITE BOUNDARY		



Figure 1  
**SITE MAP**  
Oconomowoc Electroplating Company, Inc.  
Ashippun, WI

# GROUNDWATER ANALYTICAL RESULTS SUMMARY

W2601 Oak Street, Ashippun, WI

Sampled March 24, 2023

Analyte	<i>PAL</i>	PW-03
	<i>ng/L</i>	
PFBA	2,000	2.5

Notes:

PAL = Department of Health Services recommended Preventive Action Limit  
Italicized values attain or exceed the NR 140 PAL  
ng/L = nanograms per liter  
Only detected analytes shown

## ANALYTICAL RESULTS

Project: OECl  
Pace Project No.: 10647233

Sample: PW-03 Lab ID: 10647233001 Collected: 03/24/23 16:30 Received: 03/28/23 08:50 Matrix: Water

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
<b>WI ID NPW</b>									
Analytical Method: ENV-SOP-MIN4-0178 Preparation Method: ENV-SOP-MIN4-0178									
Pace Analytical Services - Minneapolis									
11Cl-PF3OUdS	ND	ng/L	1.9	0.55	1	03/30/23 21:44	04/04/23 06:19	763051-92-9	N2
4:2 FTS	ND	ng/L	1.8	0.46	1	03/30/23 21:44	04/04/23 06:19	757124-72-4	N2
6:2 FTS	ND	ng/L	1.9	0.66	1	03/30/23 21:44	04/04/23 06:19	27619-97-2	N2
8:2 FTS	ND	ng/L	1.9	0.50	1	03/30/23 21:44	04/04/23 06:19	39108-34-4	N2
9Cl-PF3ONS	ND	ng/L	1.8	0.46	1	03/30/23 21:44	04/04/23 06:19	756426-58-1	N2
ADONA	ND	ng/L	1.9	0.90	1	03/30/23 21:44	04/04/23 06:19	919005-14-4	N2
HFPO-DA	ND	ng/L	2.0	0.49	1	03/30/23 21:44	04/04/23 06:19	13252-13-6	N2
NEtFOSAA	ND	ng/L	2.0	0.80	1	03/30/23 21:44	04/04/23 06:19	2991-50-6	N2
NEtFOSA	ND	ng/L	2.0	0.57	1	03/30/23 21:44	04/04/23 06:19	4151-50-2	N2
NEtFOSE	ND	ng/L	2.0	0.88	1	03/30/23 21:44	04/04/23 06:19	1691-99-2	N2
NMeFOSAA	ND	ng/L	2.0	0.68	1	03/30/23 21:44	04/04/23 06:19	2355-31-9	N2
NMeFOSA	ND	ng/L	2.0	0.54	1	03/30/23 21:44	04/04/23 06:19	31506-32-8	N2
NMeFOSE	ND	ng/L	2.0	0.51	1	03/30/23 21:44	04/04/23 06:19	24448-09-7	N2
Perfluorobutanesulfonic acid	ND	ng/L	1.7	0.48	1	03/30/23 21:44	04/04/23 06:19	375-73-5	N2
Perfluorodecanoic acid	ND	ng/L	2.0	0.60	1	03/30/23 21:44	04/04/23 06:19	335-76-2	N2
Perfluorohexanoic acid	ND	ng/L	2.0	0.90	1	03/30/23 21:44	04/04/23 06:19	307-24-4	N2
PFBA	2.5	ng/L	2.0	0.49	1	03/30/23 21:44	04/04/23 06:19	375-22-4	N2
PFDS	ND	ng/L	1.9	0.63	1	03/30/23 21:44	04/04/23 06:19	335-77-3	N2
PFDoS	ND	ng/L	1.9	0.58	1	03/30/23 21:44	04/04/23 06:19	79780-39-5	N2
PFHpS	ND	ng/L	1.9	0.66	1	03/30/23 21:44	04/04/23 06:19	375-92-8	N2
PFNS	ND	ng/L	1.9	0.58	1	03/30/23 21:44	04/04/23 06:19	68259-12-1	N2
PFOSA	ND	ng/L	2.0	0.71	1	03/30/23 21:44	04/04/23 06:19	754-91-6	N2
PFPeA	ND	ng/L	2.0	0.81	1	03/30/23 21:44	04/04/23 06:19	2706-90-3	N2
PFPeS	ND	ng/L	1.9	0.59	1	03/30/23 21:44	04/04/23 06:19	2706-91-4	N2
Perfluorododecanoic acid	ND	ng/L	2.0	0.47	1	03/30/23 21:44	04/04/23 06:19	307-55-1	N2
Perfluoroheptanoic acid	ND	ng/L	2.0	0.68	1	03/30/23 21:44	04/04/23 06:19	375-85-9	N2
Perfluorohexanesulfonic acid	ND	ng/L	1.8	0.52	1	03/30/23 21:44	04/04/23 06:19	355-46-4	N2
Perfluorononanoic acid	ND	ng/L	2.0	0.78	1	03/30/23 21:44	04/04/23 06:19	375-95-1	N2
Perfluorooctanesulfonic acid	ND	ng/L	1.8	0.66	1	03/30/23 21:44	04/04/23 06:19	1763-23-1	N2
Perfluorooctanoic acid	ND	ng/L	2.0	0.85	1	03/30/23 21:44	04/04/23 06:19	335-67-1	N2
Perfluorotetradecanoic acid	ND	ng/L	2.0	0.59	1	03/30/23 21:44	04/04/23 06:19	376-06-7	N2
Perfluorotridecanoic acid	ND	ng/L	2.0	0.61	1	03/30/23 21:44	04/04/23 06:19	72629-94-8	N2
Perfluoroundecanoic acid	ND	ng/L	2.0	0.48	1	03/30/23 21:44	04/04/23 06:19	2058-94-8	N2
<b>Surrogates</b>									
13C4-PFBA (S)	129	%	25-150		1	03/30/23 21:44	04/04/23 06:19		
13C5-PFPeA (S)	135	%	25-150		1	03/30/23 21:44	04/04/23 06:19		
13C3-PFBS (S)	137	%	25-150		1	03/30/23 21:44	04/04/23 06:19		
13C24:2FTS (S)	169	%	25-150		1	03/30/23 21:44	04/04/23 06:19		S0
13C3HFPO-DA (S)	154	%	25-150		1	03/30/23 21:44	04/04/23 06:19		S0
13C4-PFHpA (S)	127	%	25-150		1	03/30/23 21:44	04/04/23 06:19		
13C3-PFHxS (S)	131	%	25-150		1	03/30/23 21:44	04/04/23 06:19		
13C26:2FTS (S)	152	%	25-150		1	03/30/23 21:44	04/04/23 06:19		S0
13C8-PFOA (S)	141	%	25-150		1	03/30/23 21:44	04/04/23 06:19		
13C8-PFOS (S)	130	%	25-150		1	03/30/23 21:44	04/04/23 06:19		
13C9-PFNA (S)	136	%	25-150		1	03/30/23 21:44	04/04/23 06:19		

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## ANALYTICAL RESULTS

Project: OECl  
Pace Project No.: 10647233

**Sample: PW-03**      **Lab ID: 10647233001**      Collected: 03/24/23 16:30      Received: 03/28/23 08:50      Matrix: Water

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
------------	---------	-------	-----	-----	----	----------	----------	---------	------

**WI ID NPW**      Analytical Method: ENV-SOP-MIN4-0178      Preparation Method: ENV-SOP-MIN4-0178  
Pace Analytical Services - Minneapolis

**Surrogates**

13C6-PFDA (S)	156	%	25-150		1	03/30/23 21:44	04/04/23 06:19		S0
13C28:2FTS (S)	124	%	25-150		1	03/30/23 21:44	04/04/23 06:19		
d3-MeFOSAA (S)	93	%	25-150		1	03/30/23 21:44	04/04/23 06:19		
13C7-PFUdA (S)	129	%	25-150		1	03/30/23 21:44	04/04/23 06:19		
13C8-PFOSA (S)	71	%	25-150		1	03/30/23 21:44	04/04/23 06:19		
d5-EtFOSAA (S)	95	%	25-150		1	03/30/23 21:44	04/04/23 06:19		
13C2-PFDoA (S)	160	%	25-150		1	03/30/23 21:44	04/04/23 06:19		S0
d3-NMeFOSA (S)	14	%	10-150		1	03/30/23 21:44	04/04/23 06:19		
d7-NMeFOSE (S)	66	%	10-150		1	03/30/23 21:44	04/04/23 06:19		
13C2-PFTA (S)	107	%	25-150		1	03/30/23 21:44	04/04/23 06:19		
d9-NEtFOSE (S)	58	%	10-150		1	03/30/23 21:44	04/04/23 06:19		
d5-NEtFOSA (S)	11	%	10-150		1	03/30/23 21:44	04/04/23 06:19		
13C2PFHxDA (S)	105	%	25-150		1	03/30/23 21:44	04/04/23 06:19		
13C5-PFHxA (S)	150	%	25-150		1	03/30/23 21:44	04/04/23 06:19		

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

**Notice:** This form may be used to comply with the requirements of s. NR 716.14 (2), Wis. Adm. Code; however, use of this form is not required. An alternate format may be used. The rule requires that notification be provided to 1) property owners when someone else is conducting the sampling, 2) to occupants of property belonging to the responsible person, and 3) to owners and occupants of property that does not belong to the responsible person but has been affected by contamination arising on his or her property. Notification is required within 10 business days of receiving the sample results. Personal information collected will be used for program administration and may be provided to requesters to the extent required by Wisconsin's Open Records law [ss. 19.31-19.39, Wis. Stats.].

**NOTE:** Under s. NR 716.14, Wis. Adm. Code, the responsible party must also submit sample results and other required information to the DNR. We recommend that copies of the sample results notifications be included with that submittal, along with all attachments. Using the same format used for data presentation for a closure request may be helpful to all parties. See s. NR 716.14, Wis. Adm. Code for the full list of information to be submitted to the DNR.

**Notification of Property Owners and Occupants:**

This notification form has been provided to you in order to provide the results of environmental sampling that has been conducted on property that you own or occupy. Samples were collected in accordance with the methods identified in the site investigation work plan, in accordance with s. NR. 716.09 and 716.13, Wis. Adm. Code. This sampling was conducted as a result of contamination originating at the following location.

Site Information			
Site Name		DNR ID # (BRRTS #)	
Oconomowoc Electroplating Company, Inc. (OECI) Superfund Site		02-14-000905	
Address	City	State	ZIP Code
W2573 Oak Street	Ashippun	WI	53003

**Responsible Party**

The person(s) responsible for completing this environmental investigation is:

Property Owner

Oconomowoc Electroplating Company, Inc.

Address	City	State	ZIP Code
W2573 Oak Street	Ashippun	WI	53003

Contact Person	Phone Number (include area code)
Gwen Saliars (WDNR PM), William Murray (US EPA Remedial PM)	(920) 510-4343

Person or company that collected samples

Hyde Environmental, Inc.

**Sample Results (Results Attached)**

Reason for Sampling:  Routine  Other (define) \_\_\_\_\_

The contaminants that have been identified at this time on property that you own or occupy include:

Contaminant	In Soil?		In Groundwater?	
	Yes	No	Yes	No
Gasoline	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Diesel or Fuel Oil	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Solvents	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Heavy Metals	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Pesticides	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Other: PFAS	<input type="radio"/>	<input checked="" type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>

This sampling event included sampling of a drinking water well. <input checked="" type="radio"/> Yes <input type="radio"/> No
If yes, the sampled drinking water well had detectable contaminants. <input checked="" type="radio"/> Yes <input type="radio"/> No

Contaminants in Vapor	Yes	No
	Indoor Air	<input type="radio"/>
Sub-slab	<input type="radio"/>	<input checked="" type="radio"/>
Exterior Soil Gas	<input type="radio"/>	<input checked="" type="radio"/>



## Site Investigation Sample Results Notification

Form 4400-249 (R 03/14)

Page 2 of 2

**Attached are:**

- A map that shows the locations from which samples were collected. (The map needs to meet the requirements of s. NR 716.15 (4), Wis. Adm. Code.)
- A data table with specific contaminant levels at each sample location and whether or not the sample results exceed state standards.
- A copy of the laboratory results.

**You are not identified as the person that is responsible for this contamination.** However, your cooperation is important. Property owners may become legally responsible for contamination if they do not allow access to the person that is responsible so that person may complete the environmental investigation and clean up activities.

**Option for written exemption:** You have the option of requesting a written liability exemption from the DNR for contamination that originated on another property, or on property that you lease. To do this, you must present an adequate environmental assessment of your property and pay a \$700 fee for review of this information. If you are interested in this option, please see DNR publication # RR 589, "When Contamination Crosses a Property Line - Rights and Responsibilities of Property Owners", available at: [dnr.wi.gov/files/PDF/pubs/rr/rr589.pdf](http://dnr.wi.gov/files/PDF/pubs/rr/rr589.pdf).

**Contact Information**

Please address questions regarding this notification, or requests for additional information to the contact person listed above, or to one of the following contacts:


**Environmental Consultant**

Company Name		Contact Person Last Name	First Name	
Hyde Environmental, Inc.		Lindemann	James	
Address		City	State	ZIP Code
W175 N11163 Stonewood Drive, Suite 110		Germantown	WI	53022
Phone # (inc. area code)	Email			
(262) 250-1226	jclindemann@hyde-env.com			

Select which agency:  Natural Resources       Agriculture, Trade and Consumer Protection

**State of Wisconsin Department of Natural Resources**

Contact Person Last Name		First Name	Phone # (inc. area code)	
Saliars		Gwen	(920) 510-4343	
Address		City	State	ZIP Code
625 E County Road Y, Suite 700		Oshkosh	WI	54901
Email				
gwen.saliars@wisconsin.gov				

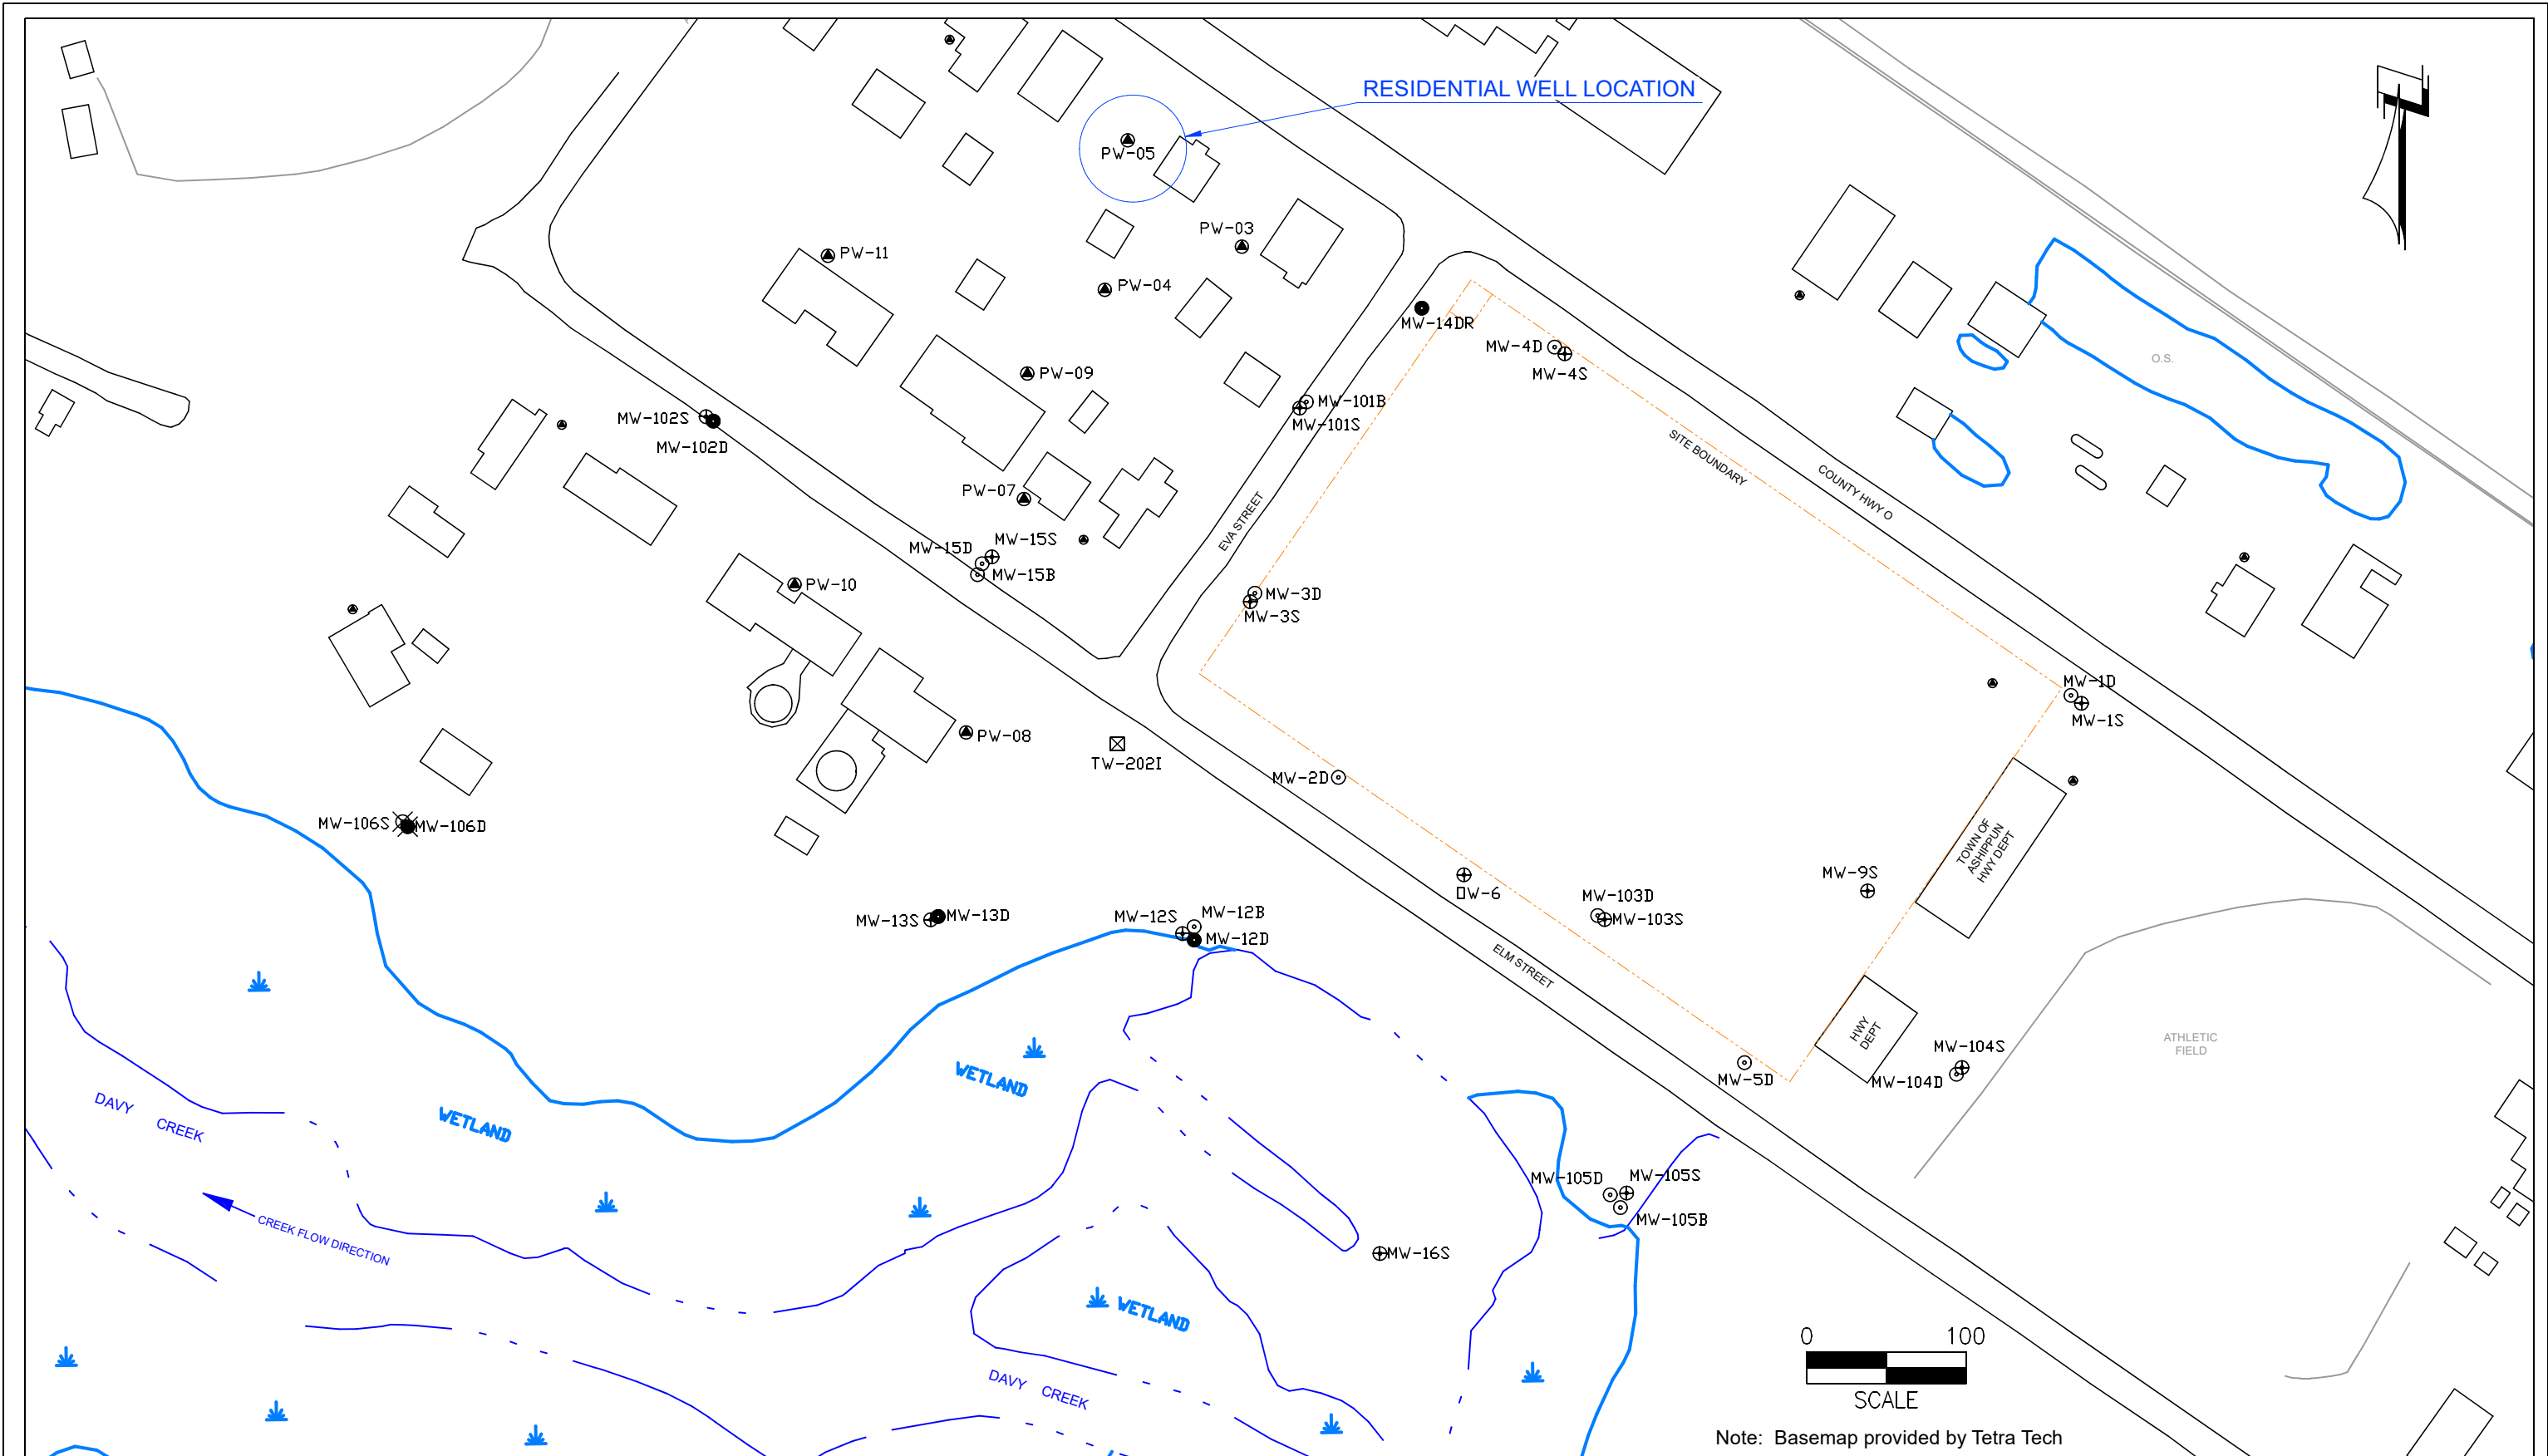

⊙ MW-105B	BEDROCK MONITORING WELL	● PW-11	RESIDENTIAL WELL
● MW-105D	DEEP UNCONSOLIDATED MONITORING WELL	● MW-106D	DEEP UNCONSOLIDATED SENTINEL WELL
⊕ MW-105S	SHALLOW UNCONSOLIDATED MONITORING WELL	⊕ MW-106S	SHALLOW UNCONSOLIDATED SENTINEL WELL
-----	FORMER OECI SITE BOUNDARY		



Figure 1  
**SITE MAP**  
Oconomowoc Electroplating Company, Inc.  
Ashippun, WI

Note: Basemap provided by Tetra Tech

# GROUNDWATER ANALYTICAL RESULTS SUMMARY

W2611 Oak Street, Ashippun, WI

Sampled March 24, 2023

Analyte	<i>PAL</i>	PW-05
	<i>ng/L</i>	
PFBA	2,000	2.6

Notes:

PAL = Department of Health Services recommended Preventive Action Limit

Italicized values attain or exceed the NR 140 PAL

ng/L = nanograms per liter

Only detected analytes shown

### ANALYTICAL RESULTS

Project: OECl  
Pace Project No.: 10647233

Sample: PW-05 Lab ID: 10647233002 Collected: 03/24/23 16:45 Received: 03/28/23 08:50 Matrix: Water

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
<b>WI ID NPW</b> Analytical Method: ENV-SOP-MIN4-0178 Preparation Method: ENV-SOP-MIN4-0178 Pace Analytical Services - Minneapolis									
11Cl-PF3OUdS	ND	ng/L	1.9	0.56	1	03/30/23 21:44	04/04/23 06:39	763051-92-9	N2
4:2 FTS	ND	ng/L	1.9	0.47	1	03/30/23 21:44	04/04/23 06:39	757124-72-4	N2
6:2 FTS	ND	ng/L	1.9	0.68	1	03/30/23 21:44	04/04/23 06:39	27619-97-2	N2
8:2 FTS	ND	ng/L	1.9	0.51	1	03/30/23 21:44	04/04/23 06:39	39108-34-4	N2
9Cl-PF3ONS	ND	ng/L	1.9	0.47	1	03/30/23 21:44	04/04/23 06:39	756426-58-1	N2
ADONA	ND	ng/L	1.9	0.93	1	03/30/23 21:44	04/04/23 06:39	919005-14-4	N2
HFPO-DA	ND	ng/L	2.0	0.50	1	03/30/23 21:44	04/04/23 06:39	13252-13-6	N2
NEtFOSAA	ND	ng/L	2.0	0.82	1	03/30/23 21:44	04/04/23 06:39	2991-50-6	N2
NEtFOSA	ND	ng/L	2.0	0.58	1	03/30/23 21:44	04/04/23 06:39	4151-50-2	N2
NEtFOSE	ND	ng/L	2.0	0.90	1	03/30/23 21:44	04/04/23 06:39	1691-99-2	N2
NMeFOSAA	ND	ng/L	2.0	0.70	1	03/30/23 21:44	04/04/23 06:39	2355-31-9	N2
NMeFOSA	ND	ng/L	2.0	0.56	1	03/30/23 21:44	04/04/23 06:39	31506-32-8	N2
NMeFOSE	ND	ng/L	2.0	0.53	1	03/30/23 21:44	04/04/23 06:39	24448-09-7	N2
Perfluorobutanesulfonic acid	ND	ng/L	1.8	0.49	1	03/30/23 21:44	04/04/23 06:39	375-73-5	N2
Perfluorodecanoic acid	ND	ng/L	2.0	0.61	1	03/30/23 21:44	04/04/23 06:39	335-76-2	N2
Perfluorohexanoic acid	ND	ng/L	2.0	0.92	1	03/30/23 21:44	04/04/23 06:39	307-24-4	N2
PFBA	2.6	ng/L	2.0	0.50	1	03/30/23 21:44	04/04/23 06:39	375-22-4	N2
PFDS	ND	ng/L	1.9	0.65	1	03/30/23 21:44	04/04/23 06:39	335-77-3	N2
PFDoS	ND	ng/L	2.0	0.60	1	03/30/23 21:44	04/04/23 06:39	79780-39-5	N2
PFHpS	ND	ng/L	1.9	0.67	1	03/30/23 21:44	04/04/23 06:39	375-92-8	N2
PFNS	ND	ng/L	1.9	0.59	1	03/30/23 21:44	04/04/23 06:39	68259-12-1	N2
PFOSA	ND	ng/L	2.0	0.72	1	03/30/23 21:44	04/04/23 06:39	754-91-6	N2
PFPeA	ND	ng/L	2.0	0.83	1	03/30/23 21:44	04/04/23 06:39	2706-90-3	N2
PFPeS	ND	ng/L	1.9	0.61	1	03/30/23 21:44	04/04/23 06:39	2706-91-4	N2
Perfluorododecanoic acid	ND	ng/L	2.0	0.48	1	03/30/23 21:44	04/04/23 06:39	307-55-1	N2
Perfluoroheptanoic acid	ND	ng/L	2.0	0.70	1	03/30/23 21:44	04/04/23 06:39	375-85-9	N2
Perfluorohexanesulfonic acid	ND	ng/L	1.8	0.54	1	03/30/23 21:44	04/04/23 06:39	355-46-4	N2
Perfluorononanoic acid	ND	ng/L	2.0	0.80	1	03/30/23 21:44	04/04/23 06:39	375-95-1	N2
Perfluorooctanesulfonic acid	ND	ng/L	1.9	0.67	1	03/30/23 21:44	04/04/23 06:39	1763-23-1	N2
Perfluorooctanoic acid	ND	ng/L	2.0	0.87	1	03/30/23 21:44	04/04/23 06:39	335-67-1	N2
Perfluorotetradecanoic acid	ND	ng/L	2.0	0.61	1	03/30/23 21:44	04/04/23 06:39	376-06-7	N2
Perfluorotridecanoic acid	ND	ng/L	2.0	0.63	1	03/30/23 21:44	04/04/23 06:39	72629-94-8	N2
Perfluoroundecanoic acid	ND	ng/L	2.0	0.49	1	03/30/23 21:44	04/04/23 06:39	2058-94-8	N2
<b>Surrogates</b>									
13C4-PFBA (S)	136	%	25-150		1	03/30/23 21:44	04/04/23 06:39		
13C5-PFPeA (S)	153	%	25-150		1	03/30/23 21:44	04/04/23 06:39		S0
13C3-PFBS (S)	141	%	25-150		1	03/30/23 21:44	04/04/23 06:39		
13C24:2FTS (S)	189	%	25-150		1	03/30/23 21:44	04/04/23 06:39		S0
13C3HFPO-DA (S)	156	%	25-150		1	03/30/23 21:44	04/04/23 06:39		S0
13C4-PFHpA (S)	142	%	25-150		1	03/30/23 21:44	04/04/23 06:39		
13C3-PFHxS (S)	135	%	25-150		1	03/30/23 21:44	04/04/23 06:39		
13C26:2FTS (S)	174	%	25-150		1	03/30/23 21:44	04/04/23 06:39		S0
13C8-PFOA (S)	144	%	25-150		1	03/30/23 21:44	04/04/23 06:39		
13C8-PFOS (S)	136	%	25-150		1	03/30/23 21:44	04/04/23 06:39		
13C9-PFNA (S)	140	%	25-150		1	03/30/23 21:44	04/04/23 06:39		

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## ANALYTICAL RESULTS

Project: OECl  
Pace Project No.: 10647233

**Sample: PW-05**      **Lab ID: 10647233002**      Collected: 03/24/23 16:45      Received: 03/28/23 08:50      Matrix: Water

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
------------	---------	-------	-----	-----	----	----------	----------	---------	------

**WI ID NPW**

Analytical Method: ENV-SOP-MIN4-0178      Preparation Method: ENV-SOP-MIN4-0178  
Pace Analytical Services - Minneapolis

**Surrogates**

13C6-PFDA (S)	165	%.	25-150		1	03/30/23 21:44	04/04/23 06:39		S0
13C28:2FTS (S)	127	%.	25-150		1	03/30/23 21:44	04/04/23 06:39		
d3-MeFOSAA (S)	114	%.	25-150		1	03/30/23 21:44	04/04/23 06:39		
13C7-PFUdA (S)	151	%.	25-150		1	03/30/23 21:44	04/04/23 06:39		S0
13C8-PFOSA (S)	87	%.	25-150		1	03/30/23 21:44	04/04/23 06:39		
d5-EtFOSAA (S)	111	%.	25-150		1	03/30/23 21:44	04/04/23 06:39		
13C2-PFDoA (S)	186	%.	25-150		1	03/30/23 21:44	04/04/23 06:39		S0
d3-NMeFOSE (S)	61	%.	10-150		1	03/30/23 21:44	04/04/23 06:39		
d7-NMeFOSE (S)	89	%.	10-150		1	03/30/23 21:44	04/04/23 06:39		
13C2-PFTA (S)	135	%.	25-150		1	03/30/23 21:44	04/04/23 06:39		
d9-NEtFOSE (S)	87	%.	10-150		1	03/30/23 21:44	04/04/23 06:39		
d5-NEtFOSE (S)	60	%.	10-150		1	03/30/23 21:44	04/04/23 06:39		
13C2PFHxDA (S)	120	%.	25-150		1	03/30/23 21:44	04/04/23 06:39		
13C5-PFHxA (S)	161	%.	25-150		1	03/30/23 21:44	04/04/23 06:39		S0

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

**Notice:** This form may be used to comply with the requirements of s. NR 716.14 (2), Wis. Adm. Code; however, use of this form is not required. An alternate format may be used. The rule requires that notification be provided to 1) property owners when someone else is conducting the sampling, 2) to occupants of property belonging to the responsible person, and 3) to owners and occupants of property that does not belong to the responsible person but has been affected by contamination arising on his or her property. Notification is required within 10 business days of receiving the sample results. Personal information collected will be used for program administration and may be provided to requesters to the extent required by Wisconsin's Open Records law [ss. 19.31-19.39, Wis. Stats.].

**NOTE:** Under s. NR 716.14, Wis. Adm. Code, the responsible party must also submit sample results and other required information to the DNR. We recommend that copies of the sample results notifications be included with that submittal, along with all attachments. Using the same format used for data presentation for a closure request may be helpful to all parties. See s. NR 716.14, Wis. Adm. Code for the full list of information to be submitted to the DNR.

**Notification of Property Owners and Occupants:**

This notification form has been provided to you in order to provide the results of environmental sampling that has been conducted on property that you own or occupy. Samples were collected in accordance with the methods identified in the site investigation work plan, in accordance with s. NR. 716.09 and 716.13, Wis. Adm. Code. This sampling was conducted as a result of contamination originating at the following location.

Site Information			
Site Name		DNR ID # (BRRTS #)	
Oconomowoc Electroplating Company, Inc. (OECI) Superfund Site		02-14-000905	
Address	City	State	ZIP Code
W2573 Oak Street	Ashippun	WI	53003

**Responsible Party**

The person(s) responsible for completing this environmental investigation is:

Property Owner

Oconomowoc Electroplating Company, Inc.

Address	City	State	ZIP Code
W2573 Oak Street	Ashippun	WI	53003

Contact Person	Phone Number (include area code)
Gwen Saliars (WDNR PM), William Murray (US EPA Remedial PM)	(920) 510-4343

Person or company that collected samples

Hyde Environmental, Inc.

**Sample Results (Results Attached)**

Reason for Sampling:  Routine  Other (define) \_\_\_\_\_

The contaminants that have been identified at this time on property that you own or occupy include:

Contaminant	In Soil?		In Groundwater?	
	Yes	No	Yes	No
Gasoline	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Diesel or Fuel Oil	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Solvents	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Heavy Metals	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Pesticides	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Other: PFAS	<input type="radio"/>	<input checked="" type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>

This sampling event included sampling of a drinking water well. <input checked="" type="radio"/> Yes <input type="radio"/> No
If yes, the sampled drinking water well had detectable contaminants. <input checked="" type="radio"/> Yes <input type="radio"/> No

**Contaminants in Vapor**

	Yes	No
Indoor Air	<input type="radio"/>	<input checked="" type="radio"/>
Sub-slab	<input type="radio"/>	<input checked="" type="radio"/>
Exterior Soil Gas	<input type="radio"/>	<input checked="" type="radio"/>

## Site Investigation Sample Results Notification

Form 4400-249 (R 03/14)

Page 2 of 2

**Attached are:**

- A map that shows the locations from which samples were collected. (The map needs to meet the requirements of s. NR 716.15 (4), Wis. Adm. Code.)
- A data table with specific contaminant levels at each sample location and whether or not the sample results exceed state standards.
- A copy of the laboratory results.

**You are not identified as the person that is responsible for this contamination.** However, your cooperation is important. Property owners may become legally responsible for contamination if they do not allow access to the person that is responsible so that person may complete the environmental investigation and clean up activities.

**Option for written exemption:** You have the option of requesting a written liability exemption from the DNR for contamination that originated on another property, or on property that you lease. To do this, you must present an adequate environmental assessment of your property and pay a \$700 fee for review of this information. If you are interested in this option, please see DNR publication # RR 589, "When Contamination Crosses a Property Line - Rights and Responsibilities of Property Owners", available at: [dnr.wi.gov/files/PDF/pubs/rr/rr589.pdf](http://dnr.wi.gov/files/PDF/pubs/rr/rr589.pdf).

**Contact Information**

Please address questions regarding this notification, or requests for additional information to the contact person listed above, or to one of the following contacts:


**Environmental Consultant**

Company Name		Contact Person Last Name	First Name	
Hyde Environmental, Inc.		Lindemann	James	
Address		City	State	ZIP Code
W175 N11163 Stonewood Drive, Suite 110		Germantown	WI	53022
Phone # (inc. area code)	Email			
(262) 250-1226	jclindemann@hyde-env.com			

Select which agency:  Natural Resources       Agriculture, Trade and Consumer Protection

**State of Wisconsin Department of Natural Resources**

Contact Person Last Name		First Name	Phone # (inc. area code)	
Saliars		Gwen	(920) 510-4343	
Address		City	State	ZIP Code
625 E County Road Y, Suite 700		Oshkosh	WI	54901
Email				
gwen.saliars@wisconsin.gov				

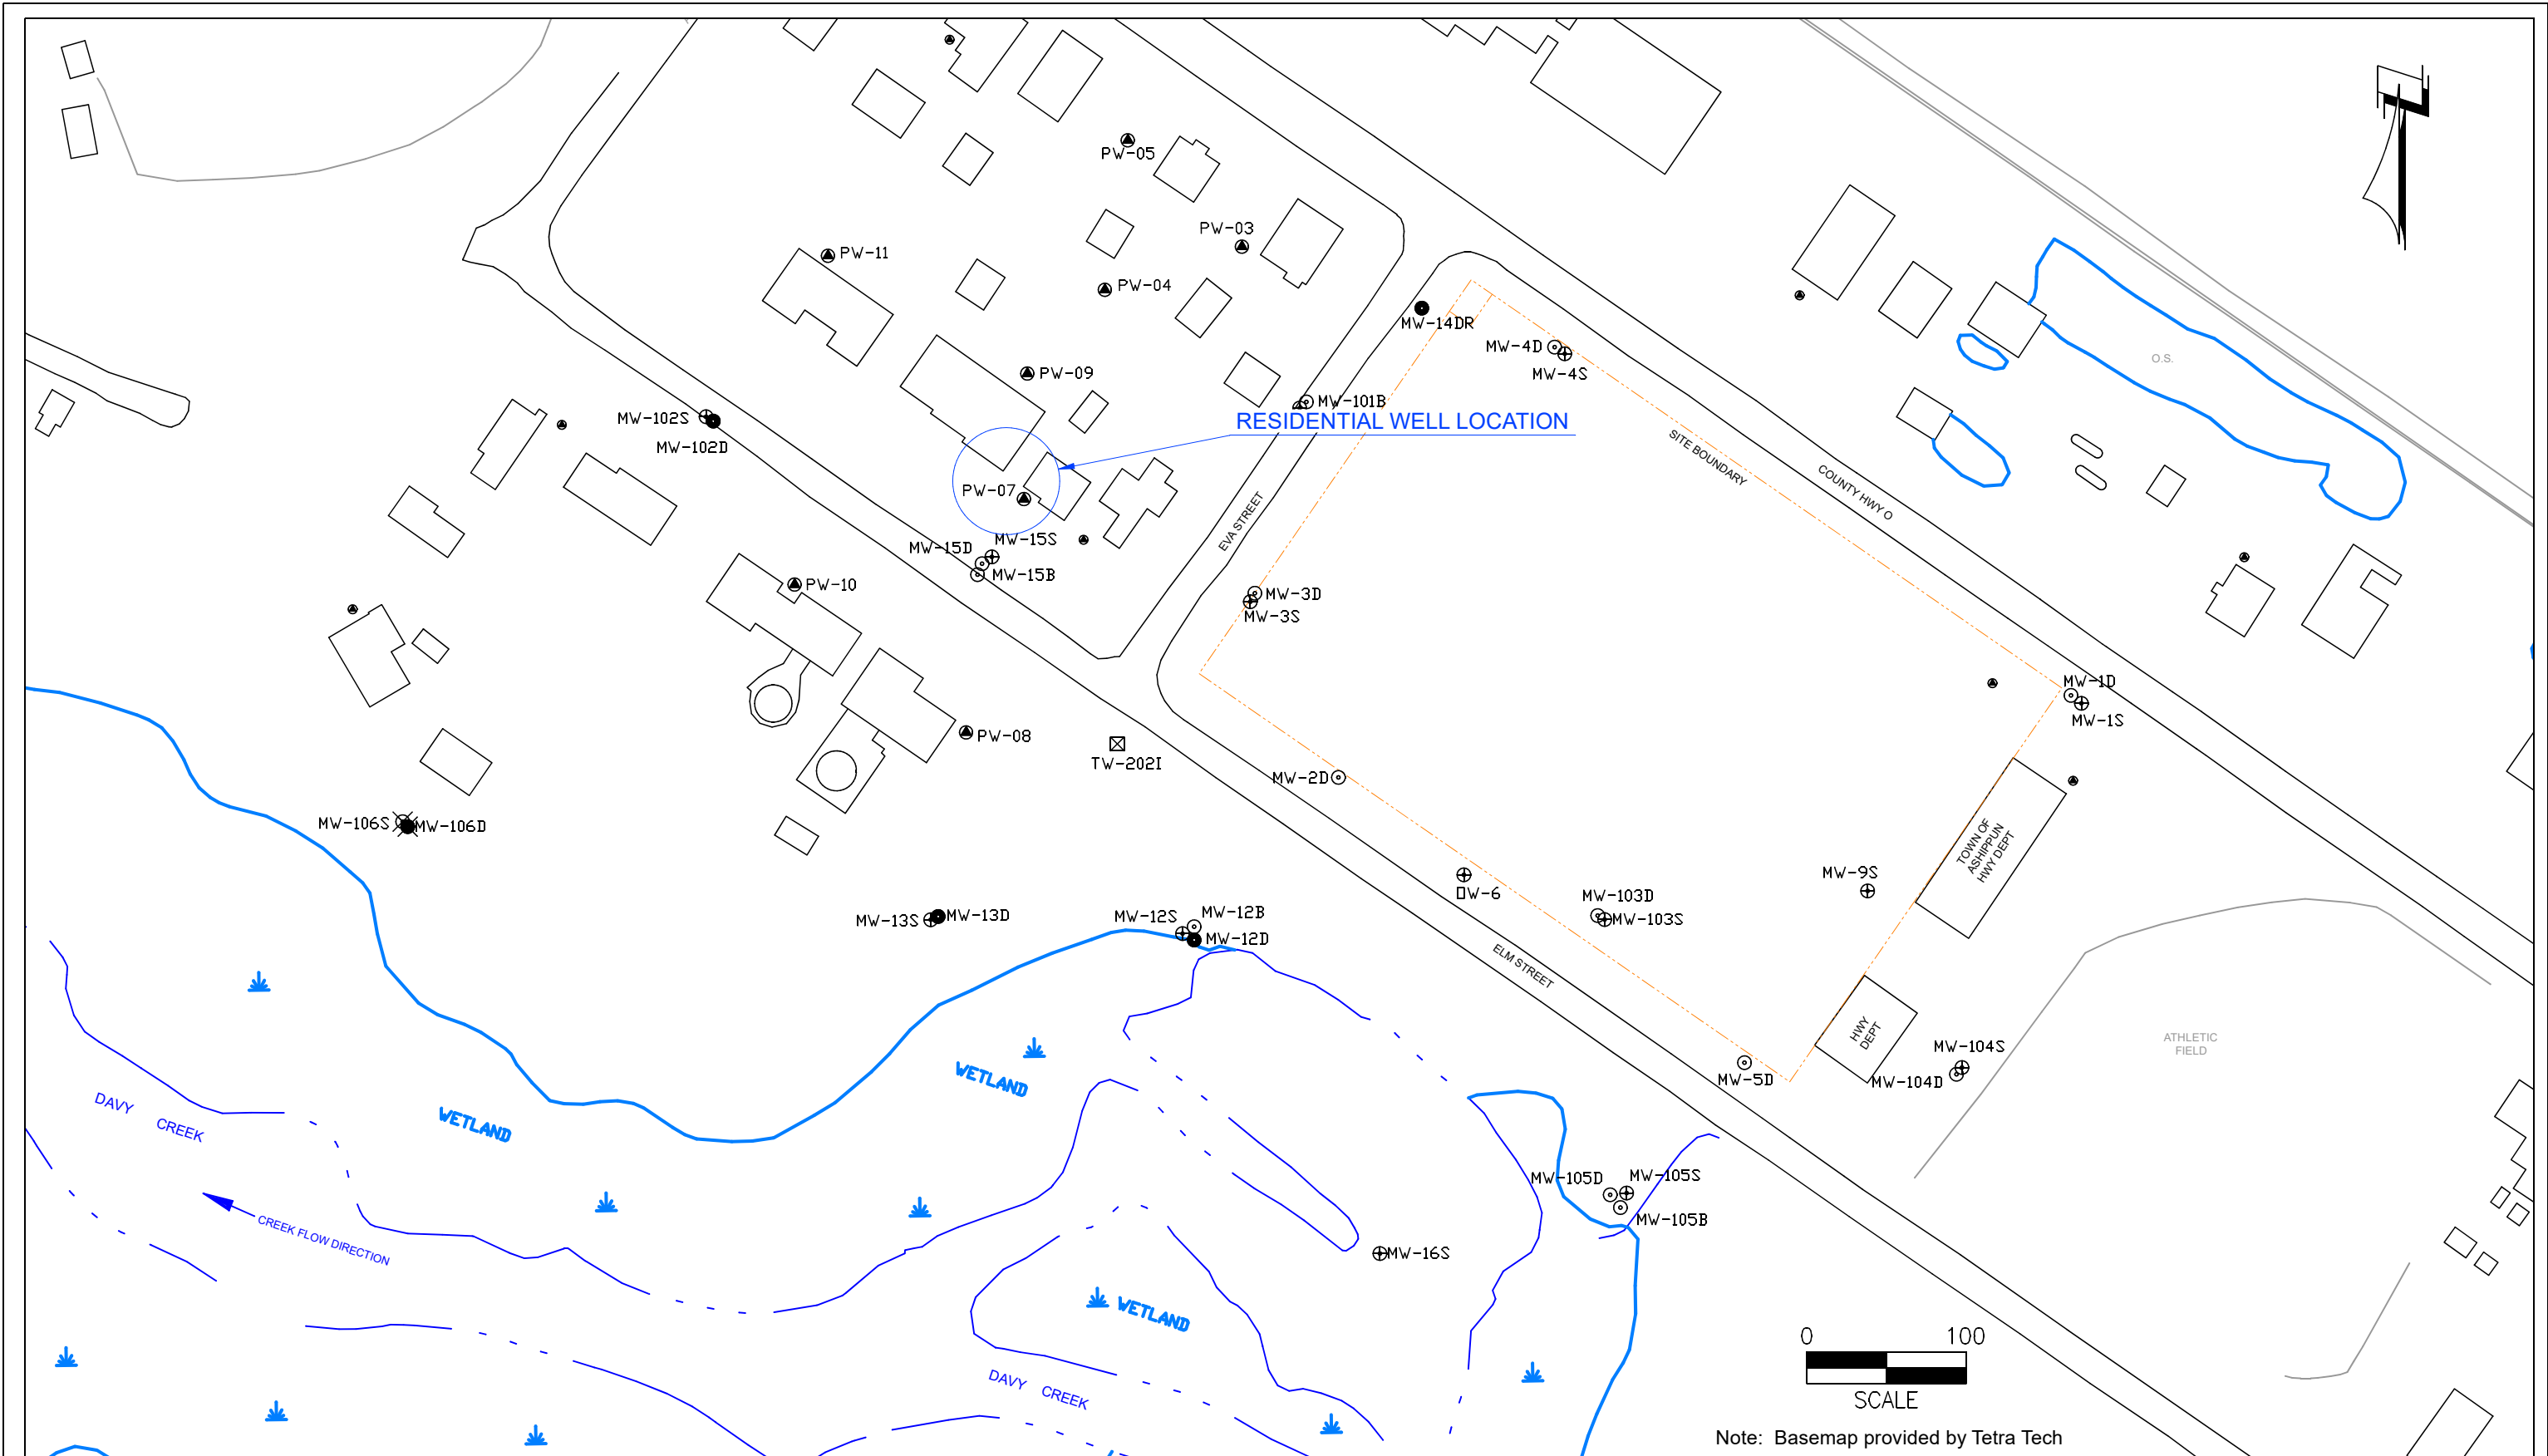

- |           |  |           |                                      |
|-----------|--|-----------|--------------------------------------|
| ⊕ MW-105B | BEDROCK MONITORING WELL                | ● PW-11   | RESIDENTIAL WELL                     |
| ● MW-105D | DEEP UNCONSOLIDATED MONITORING WELL    | ● MW-106D | DEEP UNCONSOLIDATED SENTINEL WELL    |
| ⊕ MW-105S | SHALLOW UNCONSOLIDATED MONITORING WELL | ⊗ MW-106S | SHALLOW UNCONSOLIDATED SENTINEL WELL |
| -----     | FORMER OECI SITE BOUNDARY              |           |                                      |



Figure 1  
**SITE MAP**  
Oconomowoc Electroplating Company, Inc.  
Ashippun, WI



# GROUNDWATER ANALYTICAL RESULTS SUMMARY

W2602 Elm Street, Ashippun, WI

Sampled March 24, 2023

Analyte	<i>PAL</i>	PW-07
	<i>ng/L</i>	
Perfluorobutanesulfonic acid	90,000	2.6
Perfluorohexanoic acid	30,000	3.4
PFBA	2,000	3.6
PFPeS	--	2.1
Perfluorohexanesulfonic acid	4	2.4

Notes:

PAL = Department of Health Services recommended Preventive Action Limit

Italicized values attain or exceed the NR 140 PAL

ng/L = nanograms per liter

-- = Limit not established

Only detected analytes shown

### ANALYTICAL RESULTS

Project: OECl  
Pace Project No.: 10647233

Sample: PW-07 Lab ID: 10647233003 Collected: 03/24/23 17:10 Received: 03/28/23 08:50 Matrix: Water

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
<b>WI ID NPW</b> Analytical Method: ENV-SOP-MIN4-0178 Preparation Method: ENV-SOP-MIN4-0178 Pace Analytical Services - Minneapolis									
11Cl-PF3OUdS	ND	ng/L	1.8	0.54	1	03/30/23 21:44	04/04/23 06:59	763051-92-9	N2
4:2 FTS	ND	ng/L	1.8	0.45	1	03/30/23 21:44	04/04/23 06:59	757124-72-4	N2
6:2 FTS	ND	ng/L	1.9	0.66	1	03/30/23 21:44	04/04/23 06:59	27619-97-2	N2
8:2 FTS	ND	ng/L	1.9	0.49	1	03/30/23 21:44	04/04/23 06:59	39108-34-4	N2
9Cl-PF3ONS	ND	ng/L	1.8	0.46	1	03/30/23 21:44	04/04/23 06:59	756426-58-1	N2
ADONA	ND	ng/L	1.8	0.90	1	03/30/23 21:44	04/04/23 06:59	919005-14-4	N2
HFPO-DA	ND	ng/L	2.0	0.48	1	03/30/23 21:44	04/04/23 06:59	13252-13-6	N2
NEtFOSAA	ND	ng/L	2.0	0.80	1	03/30/23 21:44	04/04/23 06:59	2991-50-6	N2
NEtFOSA	ND	ng/L	2.0	0.56	1	03/30/23 21:44	04/04/23 06:59	4151-50-2	N2
NEtFOSE	ND	ng/L	2.0	0.87	1	03/30/23 21:44	04/04/23 06:59	1691-99-2	N2
NMeFOSAA	ND	ng/L	2.0	0.68	1	03/30/23 21:44	04/04/23 06:59	2355-31-9	N2
NMeFOSA	ND	ng/L	2.0	0.54	1	03/30/23 21:44	04/04/23 06:59	31506-32-8	N2
NMeFOSE	ND	ng/L	2.0	0.51	1	03/30/23 21:44	04/04/23 06:59	24448-09-7	N2
Perfluorobutanesulfonic acid	2.6	ng/L	1.7	0.47	1	03/30/23 21:44	04/04/23 06:59	375-73-5	N2
Perfluorodecanoic acid	ND	ng/L	2.0	0.59	1	03/30/23 21:44	04/04/23 06:59	335-76-2	N2
Perfluorohexanoic acid	3.4	ng/L	2.0	0.89	1	03/30/23 21:44	04/04/23 06:59	307-24-4	N2
PFBA	3.6	ng/L	2.0	0.49	1	03/30/23 21:44	04/04/23 06:59	375-22-4	N2
PFDS	ND	ng/L	1.9	0.63	1	03/30/23 21:44	04/04/23 06:59	335-77-3	N2
PFDoS	ND	ng/L	1.9	0.58	1	03/30/23 21:44	04/04/23 06:59	79780-39-5	N2
PFHpS	ND	ng/L	1.9	0.65	1	03/30/23 21:44	04/04/23 06:59	375-92-8	N2
PFNS	ND	ng/L	1.9	0.57	1	03/30/23 21:44	04/04/23 06:59	68259-12-1	N2
PFOSA	ND	ng/L	2.0	0.70	1	03/30/23 21:44	04/04/23 06:59	754-91-6	N2
PFPeA	ND	ng/L	2.0	0.80	1	03/30/23 21:44	04/04/23 06:59	2706-90-3	N2
PFPeS	2.1	ng/L	1.8	0.59	1	03/30/23 21:44	04/04/23 06:59	2706-91-4	N2
Perfluorododecanoic acid	ND	ng/L	2.0	0.47	1	03/30/23 21:44	04/04/23 06:59	307-55-1	N2
Perfluoroheptanoic acid	ND	ng/L	2.0	0.67	1	03/30/23 21:44	04/04/23 06:59	375-85-9	N2
Perfluorohexanesulfonic acid	2.4	ng/L	1.8	0.52	1	03/30/23 21:44	04/04/23 06:59	355-46-4	N2
Perfluorononanoic acid	ND	ng/L	2.0	0.78	1	03/30/23 21:44	04/04/23 06:59	375-95-1	N2
Perfluorooctanesulfonic acid	ND	ng/L	1.8	0.65	1	03/30/23 21:44	04/04/23 06:59	1763-23-1	N2
Perfluorooctanoic acid	ND	ng/L	2.0	0.84	1	03/30/23 21:44	04/04/23 06:59	335-67-1	N2
Perfluorotetradecanoic acid	ND	ng/L	2.0	0.59	1	03/30/23 21:44	04/04/23 06:59	376-06-7	N2
Perfluorotridecanoic acid	ND	ng/L	2.0	0.61	1	03/30/23 21:44	04/04/23 06:59	72629-94-8	N2
Perfluoroundecanoic acid	ND	ng/L	2.0	0.47	1	03/30/23 21:44	04/04/23 06:59	2058-94-8	N2
<b>Surrogates</b>									
13C4-PFBA (S)	126	%	25-150		1	03/30/23 21:44	04/04/23 06:59		
13C5-PFPeA (S)	137	%	25-150		1	03/30/23 21:44	04/04/23 06:59		
13C3-PFBS (S)	133	%	25-150		1	03/30/23 21:44	04/04/23 06:59		
13C24:2FTS (S)	174	%	25-150		1	03/30/23 21:44	04/04/23 06:59		S0
13C3HFPO-DA (S)	146	%	25-150		1	03/30/23 21:44	04/04/23 06:59		
13C4-PFHpA (S)	129	%	25-150		1	03/30/23 21:44	04/04/23 06:59		
13C3-PFHxS (S)	133	%	25-150		1	03/30/23 21:44	04/04/23 06:59		
13C26:2FTS (S)	159	%	25-150		1	03/30/23 21:44	04/04/23 06:59		S0
13C8-PFOA (S)	129	%	25-150		1	03/30/23 21:44	04/04/23 06:59		
13C8-PFOS (S)	129	%	25-150		1	03/30/23 21:44	04/04/23 06:59		
13C9-PFNA (S)	127	%	25-150		1	03/30/23 21:44	04/04/23 06:59		

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## ANALYTICAL RESULTS

Project: OECl  
Pace Project No.: 10647233

**Sample: PW-07**      **Lab ID: 10647233003**      Collected: 03/24/23 17:10      Received: 03/28/23 08:50      Matrix: Water

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
------------	---------	-------	-----	-----	----	----------	----------	---------	------

**WI ID NPW**      Analytical Method: ENV-SOP-MIN4-0178      Preparation Method: ENV-SOP-MIN4-0178  
Pace Analytical Services - Minneapolis

**Surrogates**

13C6-PFDA (S)	145	%	25-150		1	03/30/23 21:44	04/04/23 06:59		
13C28:2FTS (S)	114	%	25-150		1	03/30/23 21:44	04/04/23 06:59		
d3-MeFOSAA (S)	108	%	25-150		1	03/30/23 21:44	04/04/23 06:59		
13C7-PFUdA (S)	135	%	25-150		1	03/30/23 21:44	04/04/23 06:59		
13C8-PFOSA (S)	50	%	25-150		1	03/30/23 21:44	04/04/23 06:59		
d5-EtFOSAA (S)	102	%	25-150		1	03/30/23 21:44	04/04/23 06:59		
13C2-PFDoA (S)	150	%	25-150		1	03/30/23 21:44	04/04/23 06:59		
d3-NMeFOSA (S)	1	%	10-150		1	03/30/23 21:44	04/04/23 06:59		S0
d7-NMeFOSE (S)	19	%	10-150		1	03/30/23 21:44	04/04/23 06:59		
13C2-PFTA (S)	122	%	25-150		1	03/30/23 21:44	04/04/23 06:59		
d9-NEtFOSE (S)	14	%	10-150		1	03/30/23 21:44	04/04/23 06:59		
d5-NEtFOSA (S)	1	%	10-150		1	03/30/23 21:44	04/04/23 06:59		S0
13C2PFHxDA (S)	104	%	25-150		1	03/30/23 21:44	04/04/23 06:59		
13C5-PFHxA (S)	145	%	25-150		1	03/30/23 21:44	04/04/23 06:59		

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

**Notice:** This form may be used to comply with the requirements of s. NR 716.14 (2), Wis. Adm. Code; however, use of this form is not required. An alternate format may be used. The rule requires that notification be provided to 1) property owners when someone else is conducting the sampling, 2) to occupants of property belonging to the responsible person, and 3) to owners and occupants of property that does not belong to the responsible person but has been affected by contamination arising on his or her property. Notification is required within 10 business days of receiving the sample results. Personal information collected will be used for program administration and may be provided to requesters to the extent required by Wisconsin's Open Records law [ss. 19.31-19.39, Wis. Stats.].

**NOTE:** Under s. NR 716.14, Wis. Adm. Code, the responsible party must also submit sample results and other required information to the DNR. We recommend that copies of the sample results notifications be included with that submittal, along with all attachments. Using the same format used for data presentation for a closure request may be helpful to all parties. See s. NR 716.14, Wis. Adm. Code for the full list of information to be submitted to the DNR.

**Notification of Property Owners and Occupants:**

This notification form has been provided to you in order to provide the results of environmental sampling that has been conducted on property that you own or occupy. Samples were collected in accordance with the methods identified in the site investigation work plan, in accordance with s. NR. 716.09 and 716.13, Wis. Adm. Code. This sampling was conducted as a result of contamination originating at the following location.

Site Information			
Site Name		DNR ID # (BRRTS #)	
Oconomowoc Electroplating Company, Inc. (OECI) Superfund Site		02-14-000905	
Address	City	State	ZIP Code
W2573 Oak Street	Ashippun	WI	53003

**Responsible Party**

The person(s) responsible for completing this environmental investigation is:

Property Owner

Oconomowoc Electroplating Company, Inc.

Address	City	State	ZIP Code
W2573 Oak Street	Ashippun	WI	53003

Contact Person	Phone Number (include area code)
Gwen Saliars (WDNR PM), William Murray (US EPA Remedial PM)	(920) 510-4343

Person or company that collected samples

Hyde Environmental, Inc.

**Sample Results (Results Attached)**

Reason for Sampling:  Routine  Other (define) \_\_\_\_\_

The contaminants that have been identified at this time on property that you own or occupy include:

Contaminant	In Soil?		In Groundwater?	
	Yes	No	Yes	No
Gasoline	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Diesel or Fuel Oil	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Solvents	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Heavy Metals	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Pesticides	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Other: PFAS	<input type="radio"/>	<input checked="" type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>

This sampling event included sampling of a drinking water well. <input checked="" type="radio"/> Yes <input type="radio"/> No
If yes, the sampled drinking water well had detectable contaminants. <input checked="" type="radio"/> Yes <input type="radio"/> No

Contaminants in Vapor	Yes	No
	Indoor Air	<input type="radio"/>
Sub-slab	<input type="radio"/>	<input checked="" type="radio"/>
Exterior Soil Gas	<input type="radio"/>	<input checked="" type="radio"/>

## Site Investigation Sample Results Notification

Form 4400-249 (R 03/14)

Page 2 of 2

**Attached are:**

- A map that shows the locations from which samples were collected. (The map needs to meet the requirements of s. NR 716.15 (4), Wis. Adm. Code.)
- A data table with specific contaminant levels at each sample location and whether or not the sample results exceed state standards.
- A copy of the laboratory results.

**You are not identified as the person that is responsible for this contamination.** However, your cooperation is important. Property owners may become legally responsible for contamination if they do not allow access to the person that is responsible so that person may complete the environmental investigation and clean up activities.

**Option for written exemption:** You have the option of requesting a written liability exemption from the DNR for contamination that originated on another property, or on property that you lease. To do this, you must present an adequate environmental assessment of your property and pay a \$700 fee for review of this information. If you are interested in this option, please see DNR publication # RR 589, "When Contamination Crosses a Property Line - Rights and Responsibilities of Property Owners", available at: [dnr.wi.gov/files/PDF/pubs/rr/rr589.pdf](http://dnr.wi.gov/files/PDF/pubs/rr/rr589.pdf).

**Contact Information**

Please address questions regarding this notification, or requests for additional information to the contact person listed above, or to one of the following contacts:


**Environmental Consultant**

Company Name		Contact Person Last Name	First Name	
Hyde Environmental, Inc.		Lindemann	James	
Address		City	State	ZIP Code
W175 N11163 Stonewood Drive, Suite 110		Germantown	WI	53022
Phone # (inc. area code)	Email			
(262) 250-1226	jclindemann@hyde-env.com			


Select which agency:  Natural Resources       Agriculture, Trade and Consumer Protection

**State of Wisconsin Department of Natural Resources**

Contact Person Last Name		First Name	Phone # (inc. area code)	
Saliars		Gwen	(920) 510-4343	
Address		City	State	ZIP Code
625 E County Road Y, Suite 700		Oshkosh	WI	54901
Email				
gwen.saliars@wisconsin.gov				

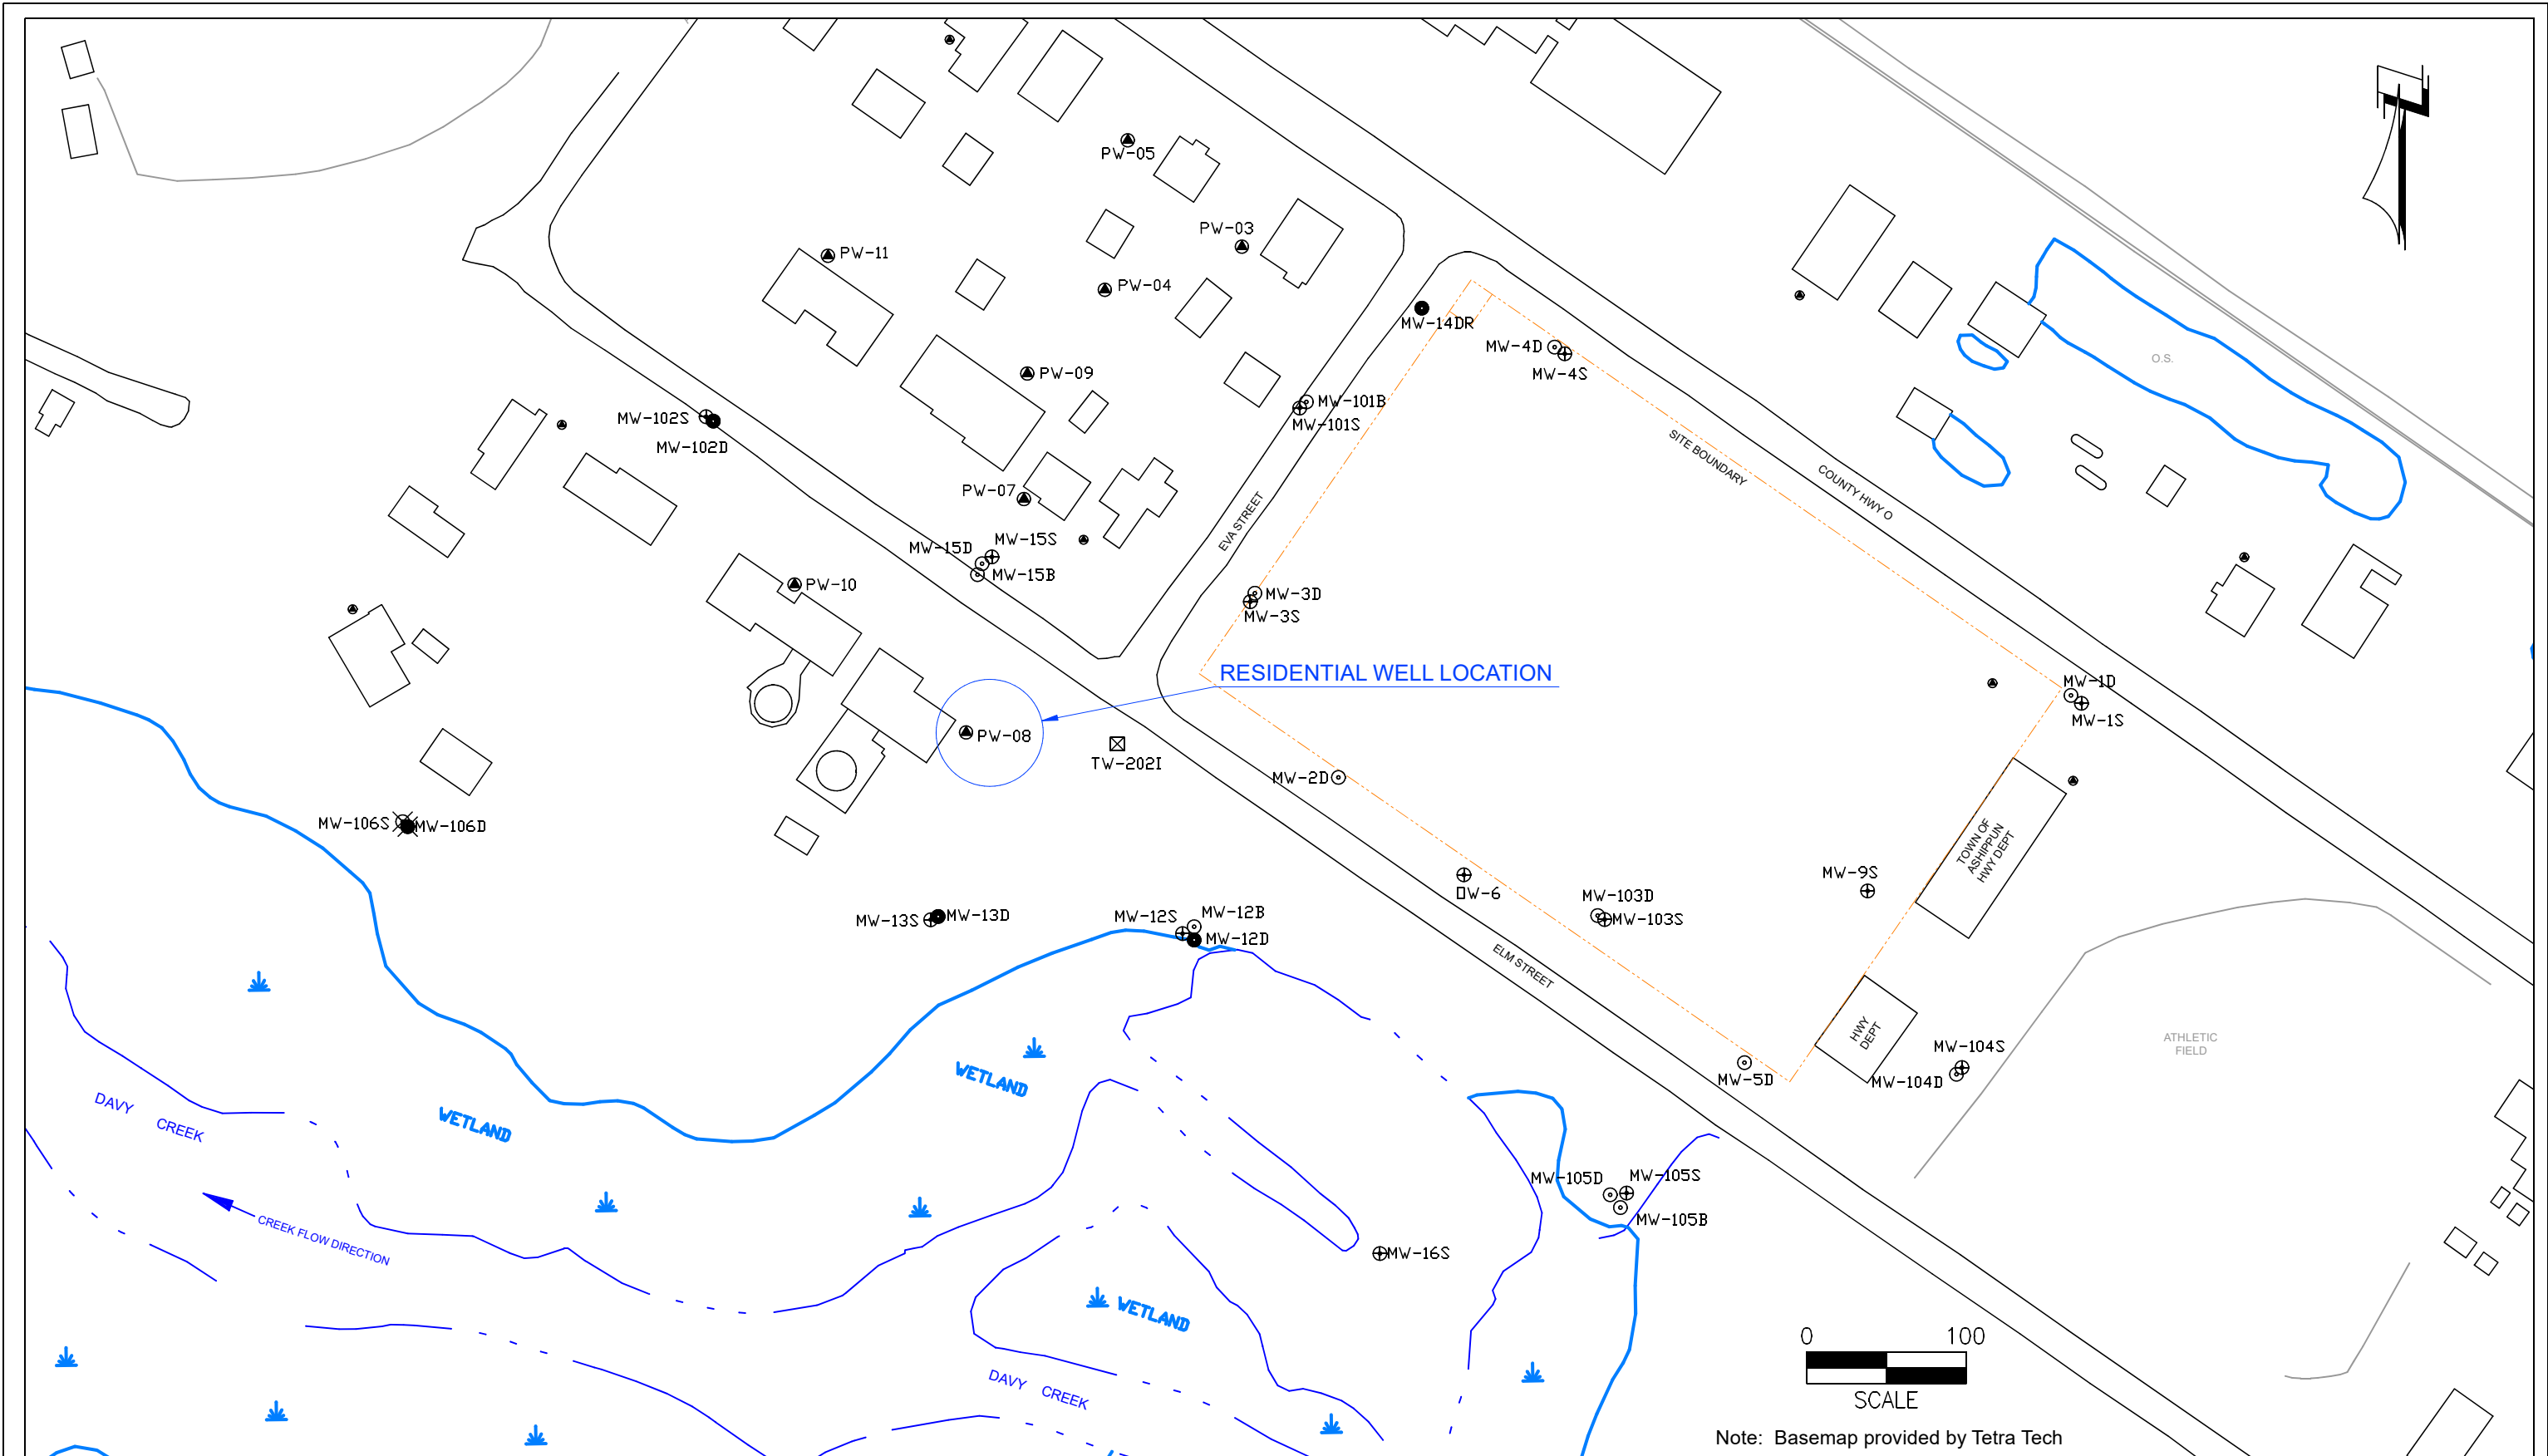

RESIDENTIAL WELL LOCATION



Note: Basemap provided by Tetra Tech

⊕ MW-105B	BEDROCK MONITORING WELL	● PW-11	RESIDENTIAL WELL
● MW-105D	DEEP UNCONSOLIDATED MONITORING WELL	⊗ MW-106D	DEEP UNCONSOLIDATED SENTINEL WELL
⊕ MW-105S	SHALLOW UNCONSOLIDATED MONITORING WELL	⊗ MW-106S	SHALLOW UNCONSOLIDATED SENTINEL WELL
---	FORMER OECI SITE BOUNDARY		



Figure 1  
**SITE MAP**  
 Oconomowoc Electroplating Company, Inc.  
 Ashippun, WI

# GROUNDWATER ANALYTICAL RESULTS SUMMARY

W2603 Elm Street, Ashippun, WI

Sampled March 24, 2023

Analyte	<i>PAL</i>	PW-08
	<i>ng/L</i>	
Perfluorobutanesulfonic acid	90,000	2.4
Perfluorohexanoic acid	30,000	3.5
PFBA	2,000	3.8

Notes:

PAL = Department of Health Services recommended Preventive Action Limit

Italicized values attain or exceed the NR 140 PAL

ng/L = nanograms per liter

Only detected analytes shown

### ANALYTICAL RESULTS

Project: OECl  
Pace Project No.: 10647233

Sample: PW-08 Lab ID: 10647233005 Collected: 03/24/23 17:30 Received: 03/28/23 08:50 Matrix: Water

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
<b>WI ID NPW</b> Analytical Method: ENV-SOP-MIN4-0178 Preparation Method: ENV-SOP-MIN4-0178 Pace Analytical Services - Minneapolis									
11Cl-PF3OUdS	ND	ng/L	1.9	0.57	1	03/30/23 21:44	04/04/23 07:59	763051-92-9	N2
4:2 FTS	ND	ng/L	1.9	0.48	1	03/30/23 21:44	04/04/23 07:59	757124-72-4	N2
6:2 FTS	ND	ng/L	1.9	0.69	1	03/30/23 21:44	04/04/23 07:59	27619-97-2	N2
8:2 FTS	ND	ng/L	2.0	0.52	1	03/30/23 21:44	04/04/23 07:59	39108-34-4	N2
9Cl-PF3ONS	ND	ng/L	1.9	0.48	1	03/30/23 21:44	04/04/23 07:59	756426-58-1	N2
ADONA	ND	ng/L	1.9	0.94	1	03/30/23 21:44	04/04/23 07:59	919005-14-4	N2
HFPO-DA	ND	ng/L	2.0	0.50	1	03/30/23 21:44	04/04/23 07:59	13252-13-6	N2
NEtFOSAA	ND	ng/L	2.0	0.83	1	03/30/23 21:44	04/04/23 07:59	2991-50-6	N2
NEtFOSA	ND	ng/L	2.0	0.59	1	03/30/23 21:44	04/04/23 07:59	4151-50-2	N2
NEtFOSE	ND	ng/L	2.0	0.91	1	03/30/23 21:44	04/04/23 07:59	1691-99-2	N2
NMeFOSAA	ND	ng/L	2.0	0.71	1	03/30/23 21:44	04/04/23 07:59	2355-31-9	N2
NMeFOSA	ND	ng/L	2.0	0.56	1	03/30/23 21:44	04/04/23 07:59	31506-32-8	N2
NMeFOSE	ND	ng/L	2.0	0.53	1	03/30/23 21:44	04/04/23 07:59	24448-09-7	N2
Perfluorobutanesulfonic acid	2.4	ng/L	1.8	0.50	1	03/30/23 21:44	04/04/23 07:59	375-73-5	N2
Perfluorodecanoic acid	ND	ng/L	2.0	0.62	1	03/30/23 21:44	04/04/23 07:59	335-76-2	N2
Perfluorohexanoic acid	3.5	ng/L	2.0	0.93	1	03/30/23 21:44	04/04/23 07:59	307-24-4	N2
PFBA	3.8	ng/L	2.0	0.51	1	03/30/23 21:44	04/04/23 07:59	375-22-4	N2
PFDS	ND	ng/L	2.0	0.66	1	03/30/23 21:44	04/04/23 07:59	335-77-3	N2
PFDoS	ND	ng/L	2.0	0.60	1	03/30/23 21:44	04/04/23 07:59	79780-39-5	N2
PFHpS	ND	ng/L	1.9	0.68	1	03/30/23 21:44	04/04/23 07:59	375-92-8	N2
PFNS	ND	ng/L	2.0	0.60	1	03/30/23 21:44	04/04/23 07:59	68259-12-1	N2
PFOSA	ND	ng/L	2.0	0.73	1	03/30/23 21:44	04/04/23 07:59	754-91-6	N2
PFPeA	ND	ng/L	2.0	0.84	1	03/30/23 21:44	04/04/23 07:59	2706-90-3	N2
PFPeS	ND	ng/L	1.9	0.61	1	03/30/23 21:44	04/04/23 07:59	2706-91-4	N2
Perfluorododecanoic acid	ND	ng/L	2.0	0.49	1	03/30/23 21:44	04/04/23 07:59	307-55-1	N2
Perfluoroheptanoic acid	ND	ng/L	2.0	0.70	1	03/30/23 21:44	04/04/23 07:59	375-85-9	N2
Perfluorohexanesulfonic acid	ND	ng/L	1.9	0.54	1	03/30/23 21:44	04/04/23 07:59	355-46-4	N2
Perfluorononanoic acid	ND	ng/L	2.0	0.81	1	03/30/23 21:44	04/04/23 07:59	375-95-1	N2
Perfluorooctanesulfonic acid	ND	ng/L	1.9	0.68	1	03/30/23 21:44	04/04/23 07:59	1763-23-1	N2
Perfluorooctanoic acid	ND	ng/L	2.0	0.88	1	03/30/23 21:44	04/04/23 07:59	335-67-1	N2
Perfluorotetradecanoic acid	ND	ng/L	2.0	0.61	1	03/30/23 21:44	04/04/23 07:59	376-06-7	N2
Perfluorotridecanoic acid	ND	ng/L	2.0	0.64	1	03/30/23 21:44	04/04/23 07:59	72629-94-8	N2
Perfluoroundecanoic acid	ND	ng/L	2.0	0.50	1	03/30/23 21:44	04/04/23 07:59	2058-94-8	N2
<b>Surrogates</b>									
13C4-PFBA (S)	131	%	25-150		1	03/30/23 21:44	04/04/23 07:59		
13C5-PFPeA (S)	151	%	25-150		1	03/30/23 21:44	04/04/23 07:59		S0
13C3-PFBS (S)	130	%	25-150		1	03/30/23 21:44	04/04/23 07:59		
13C24:2FTS (S)	174	%	25-150		1	03/30/23 21:44	04/04/23 07:59		S0
13C3HFPO-DA (S)	145	%	25-150		1	03/30/23 21:44	04/04/23 07:59		
13C4-PFHpA (S)	130	%	25-150		1	03/30/23 21:44	04/04/23 07:59		
13C3-PFHxS (S)	128	%	25-150		1	03/30/23 21:44	04/04/23 07:59		
13C26:2FTS (S)	155	%	25-150		1	03/30/23 21:44	04/04/23 07:59		S0
13C8-PFOA (S)	132	%	25-150		1	03/30/23 21:44	04/04/23 07:59		
13C8-PFOS (S)	117	%	25-150		1	03/30/23 21:44	04/04/23 07:59		
13C9-PFNA (S)	128	%	25-150		1	03/30/23 21:44	04/04/23 07:59		

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.



## ANALYTICAL RESULTS

Project: OECl  
Pace Project No.: 10647233

**Sample: PW-08**      **Lab ID: 10647233005**      Collected: 03/24/23 17:30      Received: 03/28/23 08:50      Matrix: Water

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
------------	---------	-------	-----	-----	----	----------	----------	---------	------

**WI ID NPW**

Analytical Method: ENV-SOP-MIN4-0178      Preparation Method: ENV-SOP-MIN4-0178  
Pace Analytical Services - Minneapolis

**Surrogates**

13C6-PFDA (S)	126	%	25-150		1	03/30/23 21:44	04/04/23 07:59		
13C28:2FTS (S)	106	%	25-150		1	03/30/23 21:44	04/04/23 07:59		
d3-MeFOSAA (S)	89	%	25-150		1	03/30/23 21:44	04/04/23 07:59		
13C7-PFUdA (S)	118	%	25-150		1	03/30/23 21:44	04/04/23 07:59		
13C8-PFOSA (S)	82	%	25-150		1	03/30/23 21:44	04/04/23 07:59		
d5-EtFOSAA (S)	90	%	25-150		1	03/30/23 21:44	04/04/23 07:59		
13C2-PFDoA (S)	151	%	25-150		1	03/30/23 21:44	04/04/23 07:59		S0
d3-NMeFOSA (S)	47	%	10-150		1	03/30/23 21:44	04/04/23 07:59		
d7-NMeFOSE (S)	74	%	10-150		1	03/30/23 21:44	04/04/23 07:59		
13C2-PFTA (S)	115	%	25-150		1	03/30/23 21:44	04/04/23 07:59		
d9-NEtFOSE (S)	66	%	10-150		1	03/30/23 21:44	04/04/23 07:59		
d5-NEtFOSA (S)	45	%	10-150		1	03/30/23 21:44	04/04/23 07:59		
13C2PFHxDA (S)	99	%	25-150		1	03/30/23 21:44	04/04/23 07:59		
13C5-PFHxA (S)	147	%	25-150		1	03/30/23 21:44	04/04/23 07:59		

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

**Notice:** This form may be used to comply with the requirements of s. NR 716.14 (2), Wis. Adm. Code; however, use of this form is not required. An alternate format may be used. The rule requires that notification be provided to 1) property owners when someone else is conducting the sampling, 2) to occupants of property belonging to the responsible person, and 3) to owners and occupants of property that does not belong to the responsible person but has been affected by contamination arising on his or her property. Notification is required within 10 business days of receiving the sample results. Personal information collected will be used for program administration and may be provided to requesters to the extent required by Wisconsin's Open Records law [ss. 19.31-19.39, Wis. Stats.].

**NOTE:** Under s. NR 716.14, Wis. Adm. Code, the responsible party must also submit sample results and other required information to the DNR. We recommend that copies of the sample results notifications be included with that submittal, along with all attachments. Using the same format used for data presentation for a closure request may be helpful to all parties. See s. NR 716.14, Wis. Adm. Code for the full list of information to be submitted to the DNR.

**Notification of Property Owners and Occupants:**

This notification form has been provided to you in order to provide the results of environmental sampling that has been conducted on property that you own or occupy. Samples were collected in accordance with the methods identified in the site investigation work plan, in accordance with s. NR. 716.09 and 716.13, Wis. Adm. Code. This sampling was conducted as a result of contamination originating at the following location.

Site Information			
Site Name		DNR ID # (BRRTS #)	
Oconomowoc Electroplating Company, Inc. (OECI) Superfund Site		02-14-000905	
Address	City	State	ZIP Code
W2573 Oak Street	Ashippun	WI	53003

**Responsible Party**

The person(s) responsible for completing this environmental investigation is:

Property Owner

Oconomowoc Electroplating Company, Inc.

Address	City	State	ZIP Code
W2573 Oak Street	Ashippun	WI	53003

Contact Person	Phone Number (include area code)
Gwen Saliars (WDNR PM), William Murray (US EPA Remedial PM)	(920) 510-4343

Person or company that collected samples

Hyde Environmental, Inc.

**Sample Results (Results Attached)**

Reason for Sampling:  Routine  Other (define) \_\_\_\_\_

The contaminants that have been identified at this time on property that you own or occupy include:

Contaminant	In Soil?		In Groundwater?	
	Yes	No	Yes	No
Gasoline	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Diesel or Fuel Oil	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Solvents	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Heavy Metals	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Pesticides	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Other: PFAS	<input type="radio"/>	<input checked="" type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>

This sampling event included sampling of a drinking water well. <input checked="" type="radio"/> Yes <input type="radio"/> No
If yes, the sampled drinking water well had detectable contaminants. <input checked="" type="radio"/> Yes <input type="radio"/> No

**Contaminants in Vapor**

	Yes	No
Indoor Air	<input type="radio"/>	<input checked="" type="radio"/>
Sub-slab	<input type="radio"/>	<input checked="" type="radio"/>
Exterior Soil Gas	<input type="radio"/>	<input checked="" type="radio"/>

## Site Investigation Sample Results Notification

Form 4400-249 (R 03/14)

Page 2 of 2

**Attached are:**

- A map that shows the locations from which samples were collected. (The map needs to meet the requirements of s. NR 716.15 (4), Wis. Adm. Code.)
- A data table with specific contaminant levels at each sample location and whether or not the sample results exceed state standards.
- A copy of the laboratory results.

**You are not identified as the person that is responsible for this contamination.** However, your cooperation is important. Property owners may become legally responsible for contamination if they do not allow access to the person that is responsible so that person may complete the environmental investigation and clean up activities.

**Option for written exemption:** You have the option of requesting a written liability exemption from the DNR for contamination that originated on another property, or on property that you lease. To do this, you must present an adequate environmental assessment of your property and pay a \$700 fee for review of this information. If you are interested in this option, please see DNR publication # RR 589, "When Contamination Crosses a Property Line - Rights and Responsibilities of Property Owners", available at: [dnr.wi.gov/files/PDF/pubs/rr/rr589.pdf](http://dnr.wi.gov/files/PDF/pubs/rr/rr589.pdf).

**Contact Information**

Please address questions regarding this notification, or requests for additional information to the contact person listed above, or to one of the following contacts:


**Environmental Consultant**

Company Name		Contact Person Last Name	First Name	
Hyde Environmental, Inc.		Lindemann	James	
Address		City	State	ZIP Code
W175 N11163 Stonewood Drive, Suite 110		Germantown	WI	53022
Phone # (inc. area code)	Email			
(262) 250-1226	jclindemann@hyde-env.com			

Select which agency:  Natural Resources       Agriculture, Trade and Consumer Protection

**State of Wisconsin Department of Natural Resources**

Contact Person Last Name		First Name	Phone # (inc. area code)	
Saliars		Gwen	(920) 510-4343	
Address		City	State	ZIP Code
625 E County Road Y, Suite 700		Oshkosh	WI	54901
Email				
gwen.saliars@wisconsin.gov				

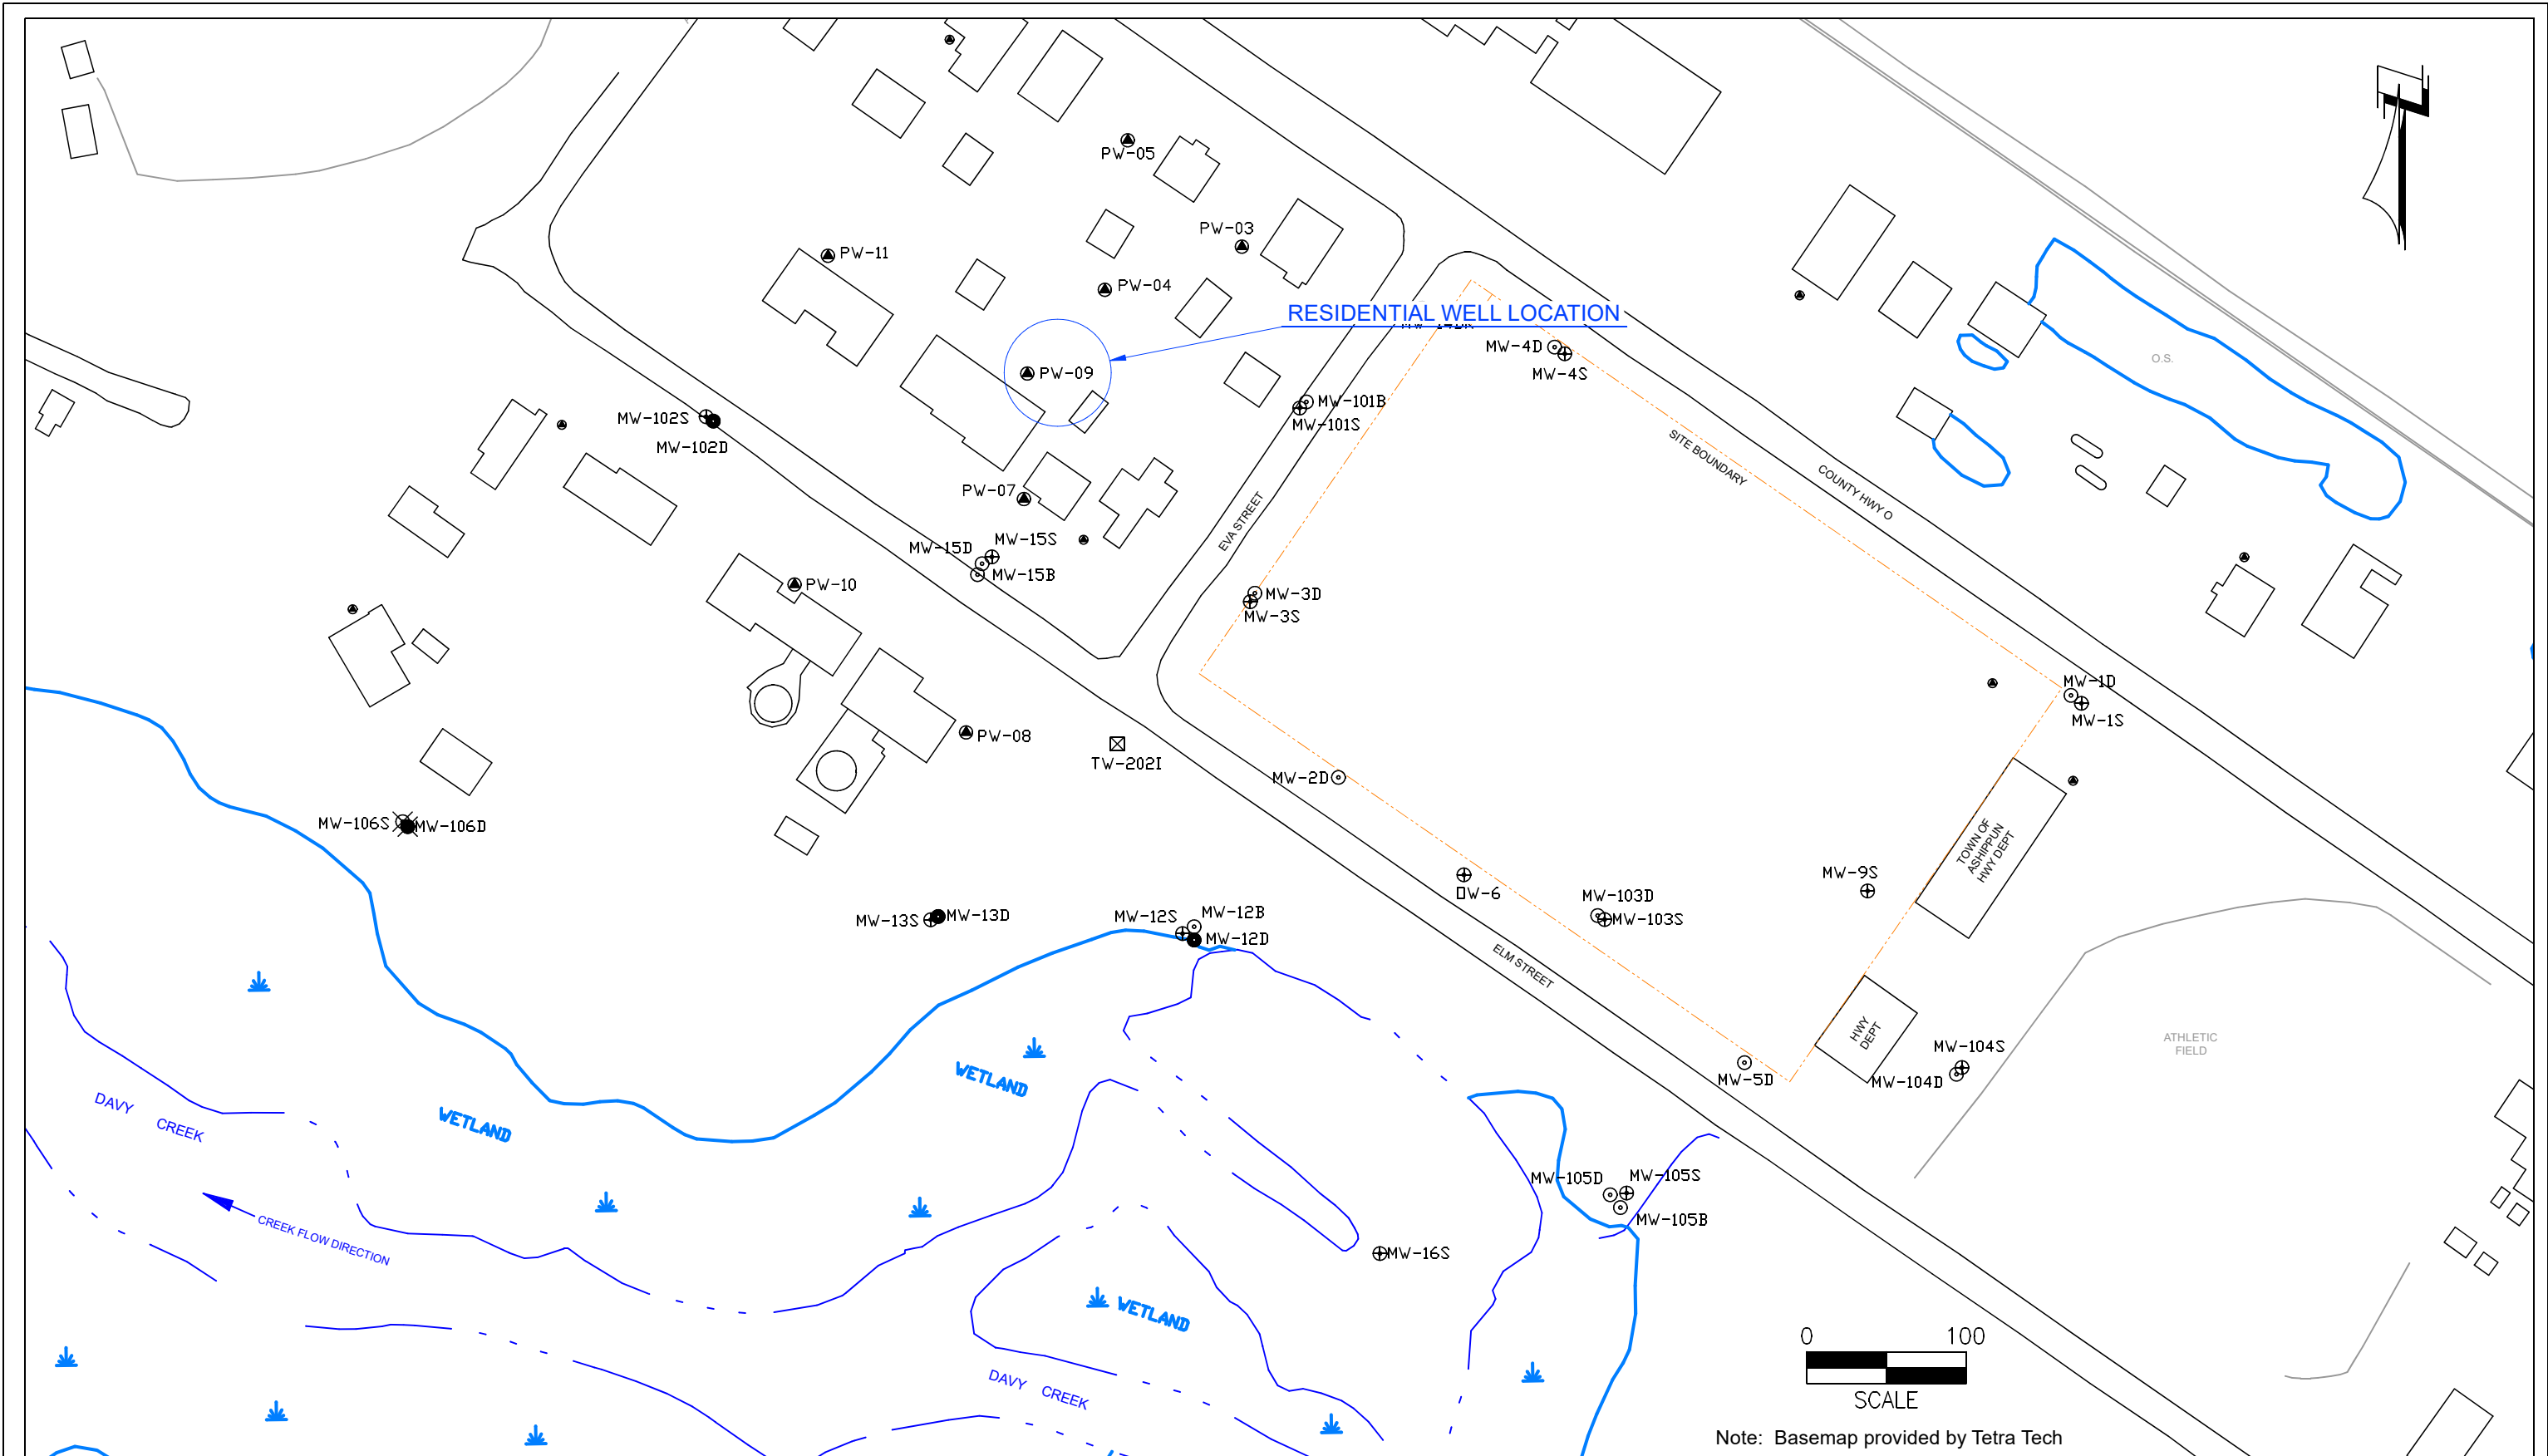

RESIDENTIAL WELL LOCATION

⊕ MW-105B	BEDROCK MONITORING WELL	● PW-11	RESIDENTIAL WELL
● MW-105D	DEEP UNCONSOLIDATED MONITORING WELL	● MW-106D	DEEP UNCONSOLIDATED SENTINEL WELL
⊕ MW-105S	SHALLOW UNCONSOLIDATED MONITORING WELL	⊗ MW-106S	SHALLOW UNCONSOLIDATED SENTINEL WELL
-----	FORMER OECl SITE BOUNDARY		



Figure 1  
**SITE MAP**  
Oconomowoc Electroplating Company, Inc.  
Ashippun, WI

# GROUNDWATER ANALYTICAL RESULTS SUMMARY

W2606 Elm Street, Ashippun, WI

Sampled March 24, 2023

Analyte	<i>PAL</i>	PW-09
	<i>ng/L</i>	
Perfluorobutanesulfonic acid	90,000	2.5
Perfluorohexanoic acid	30,000	2.4
PFBA	2,000	3.4
PFPeS	--	2.1
Perfluorohexanesulfonic acid	4	3.0

Notes:

PAL = Department of Health Services recommended Preventive Action Limit

Italicized values attain or exceed the NR 140 PAL

ng/L = nanograms per liter

-- = Limit not established

Only detected analytes shown

### ANALYTICAL RESULTS

Project: OECl  
Pace Project No.: 10647233

Sample: PW-09 Lab ID: 10647233004 Collected: 03/24/23 17:20 Received: 03/28/23 08:50 Matrix: Water

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
<b>WI ID NPW</b> Analytical Method: ENV-SOP-MIN4-0178 Preparation Method: ENV-SOP-MIN4-0178 Pace Analytical Services - Minneapolis									
11Cl-PF3OUdS	ND	ng/L	1.9	0.56	1	03/30/23 21:44	04/04/23 07:39	763051-92-9	N2
4:2 FTS	ND	ng/L	1.9	0.47	1	03/30/23 21:44	04/04/23 07:39	757124-72-4	N2
6:2 FTS	ND	ng/L	1.9	0.67	1	03/30/23 21:44	04/04/23 07:39	27619-97-2	N2
8:2 FTS	ND	ng/L	1.9	0.50	1	03/30/23 21:44	04/04/23 07:39	39108-34-4	N2
9Cl-PF3ONS	ND	ng/L	1.9	0.47	1	03/30/23 21:44	04/04/23 07:39	756426-58-1	N2
ADONA	ND	ng/L	1.9	0.92	1	03/30/23 21:44	04/04/23 07:39	919005-14-4	N2
HFPO-DA	ND	ng/L	2.0	0.49	1	03/30/23 21:44	04/04/23 07:39	13252-13-6	N2
NEtFOSAA	ND	ng/L	2.0	0.81	1	03/30/23 21:44	04/04/23 07:39	2991-50-6	N2
NEtFOSA	ND	ng/L	2.0	0.57	1	03/30/23 21:44	04/04/23 07:39	4151-50-2	N2
NEtFOSE	ND	ng/L	2.0	0.89	1	03/30/23 21:44	04/04/23 07:39	1691-99-2	N2
NMeFOSAA	ND	ng/L	2.0	0.69	1	03/30/23 21:44	04/04/23 07:39	2355-31-9	N2
NMeFOSA	ND	ng/L	2.0	0.55	1	03/30/23 21:44	04/04/23 07:39	31506-32-8	N2
NMeFOSE	ND	ng/L	2.0	0.52	1	03/30/23 21:44	04/04/23 07:39	24448-09-7	N2
Perfluorobutanesulfonic acid	2.5	ng/L	1.8	0.48	1	03/30/23 21:44	04/04/23 07:39	375-73-5	N2
Perfluorodecanoic acid	ND	ng/L	2.0	0.61	1	03/30/23 21:44	04/04/23 07:39	335-76-2	N2
Perfluorohexanoic acid	2.4	ng/L	2.0	0.91	1	03/30/23 21:44	04/04/23 07:39	307-24-4	N2
PFBA	3.4	ng/L	2.0	0.50	1	03/30/23 21:44	04/04/23 07:39	375-22-4	N2
PFDS	ND	ng/L	1.9	0.64	1	03/30/23 21:44	04/04/23 07:39	335-77-3	N2
PFDoS	ND	ng/L	1.9	0.59	1	03/30/23 21:44	04/04/23 07:39	79780-39-5	N2
PFHpS	ND	ng/L	1.9	0.67	1	03/30/23 21:44	04/04/23 07:39	375-92-8	N2
PFNS	ND	ng/L	1.9	0.59	1	03/30/23 21:44	04/04/23 07:39	68259-12-1	N2
PFOSA	ND	ng/L	2.0	0.72	1	03/30/23 21:44	04/04/23 07:39	754-91-6	N2
PFPeA	ND	ng/L	2.0	0.82	1	03/30/23 21:44	04/04/23 07:39	2706-90-3	N2
PFPeS	2.1	ng/L	1.9	0.60	1	03/30/23 21:44	04/04/23 07:39	2706-91-4	N2
Perfluorododecanoic acid	ND	ng/L	2.0	0.48	1	03/30/23 21:44	04/04/23 07:39	307-55-1	N2
Perfluoroheptanoic acid	ND	ng/L	2.0	0.69	1	03/30/23 21:44	04/04/23 07:39	375-85-9	N2
Perfluorohexanesulfonic acid	3.0	ng/L	1.8	0.53	1	03/30/23 21:44	04/04/23 07:39	355-46-4	N2
Perfluorononanoic acid	ND	ng/L	2.0	0.79	1	03/30/23 21:44	04/04/23 07:39	375-95-1	N2
Perfluorooctanesulfonic acid	ND	ng/L	1.8	0.67	1	03/30/23 21:44	04/04/23 07:39	1763-23-1	N2
Perfluorooctanoic acid	ND	ng/L	2.0	0.86	1	03/30/23 21:44	04/04/23 07:39	335-67-1	N2
Perfluorotetradecanoic acid	ND	ng/L	2.0	0.60	1	03/30/23 21:44	04/04/23 07:39	376-06-7	N2
Perfluorotridecanoic acid	ND	ng/L	2.0	0.62	1	03/30/23 21:44	04/04/23 07:39	72629-94-8	N2
Perfluoroundecanoic acid	ND	ng/L	2.0	0.49	1	03/30/23 21:44	04/04/23 07:39	2058-94-8	N2
<b>Surrogates</b>									
13C4-PFBA (S)	131	%	25-150		1	03/30/23 21:44	04/04/23 07:39		
13C5-PFPeA (S)	144	%	25-150		1	03/30/23 21:44	04/04/23 07:39		
13C3-PFBS (S)	129	%	25-150		1	03/30/23 21:44	04/04/23 07:39		
13C24:2FTS (S)	168	%	25-150		1	03/30/23 21:44	04/04/23 07:39		S0
13C3HFPO-DA (S)	154	%	25-150		1	03/30/23 21:44	04/04/23 07:39		S0
13C4-PFHpA (S)	129	%	25-150		1	03/30/23 21:44	04/04/23 07:39		
13C3-PFHxS (S)	128	%	25-150		1	03/30/23 21:44	04/04/23 07:39		
13C26:2FTS (S)	158	%	25-150		1	03/30/23 21:44	04/04/23 07:39		S0
13C8-PFOA (S)	138	%	25-150		1	03/30/23 21:44	04/04/23 07:39		
13C8-PFOS (S)	120	%	25-150		1	03/30/23 21:44	04/04/23 07:39		
13C9-PFNA (S)	138	%	25-150		1	03/30/23 21:44	04/04/23 07:39		

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## ANALYTICAL RESULTS

Project: OECl  
Pace Project No.: 10647233

**Sample: PW-09**      **Lab ID: 10647233004**      Collected: 03/24/23 17:20      Received: 03/28/23 08:50      Matrix: Water

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
------------	---------	-------	-----	-----	----	----------	----------	---------	------

**WI ID NPW**      Analytical Method: ENV-SOP-MIN4-0178      Preparation Method: ENV-SOP-MIN4-0178  
Pace Analytical Services - Minneapolis

**Surrogates**

13C6-PFDA (S)	134	%	25-150		1	03/30/23 21:44	04/04/23 07:39		
13C28:2FTS (S)	110	%	25-150		1	03/30/23 21:44	04/04/23 07:39		
d3-MeFOSAA (S)	99	%	25-150		1	03/30/23 21:44	04/04/23 07:39		
13C7-PFUdA (S)	129	%	25-150		1	03/30/23 21:44	04/04/23 07:39		
13C8-PFOSA (S)	79	%	25-150		1	03/30/23 21:44	04/04/23 07:39		
d5-EtFOSAA (S)	101	%	25-150		1	03/30/23 21:44	04/04/23 07:39		
13C2-PFDoA (S)	168	%	25-150		1	03/30/23 21:44	04/04/23 07:39		S0
d3-NMeFOSA (S)	27	%	10-150		1	03/30/23 21:44	04/04/23 07:39		
d7-NMeFOSE (S)	76	%	10-150		1	03/30/23 21:44	04/04/23 07:39		
13C2-PFTA (S)	121	%	25-150		1	03/30/23 21:44	04/04/23 07:39		
d9-NEtFOSE (S)	72	%	10-150		1	03/30/23 21:44	04/04/23 07:39		
d5-NEtFOSA (S)	23	%	10-150		1	03/30/23 21:44	04/04/23 07:39		
13C2PFHxDA (S)	106	%	25-150		1	03/30/23 21:44	04/04/23 07:39		
13C5-PFHxA (S)	151	%	25-150		1	03/30/23 21:44	04/04/23 07:39		S0

### REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

**Notice:** This form may be used to comply with the requirements of s. NR 716.14 (2), Wis. Adm. Code; however, use of this form is not required. An alternate format may be used. The rule requires that notification be provided to 1) property owners when someone else is conducting the sampling, 2) to occupants of property belonging to the responsible person, and 3) to owners and occupants of property that does not belong to the responsible person but has been affected by contamination arising on his or her property. Notification is required within 10 business days of receiving the sample results. Personal information collected will be used for program administration and may be provided to requesters to the extent required by Wisconsin's Open Records law [ss. 19.31-19.39, Wis. Stats.].

**NOTE:** Under s. NR 716.14, Wis. Adm. Code, the responsible party must also submit sample results and other required information to the DNR. We recommend that copies of the sample results notifications be included with that submittal, along with all attachments. Using the same format used for data presentation for a closure request may be helpful to all parties. See s. NR 716.14, Wis. Adm. Code for the full list of information to be submitted to the DNR.

**Notification of Property Owners and Occupants:**

This notification form has been provided to you in order to provide the results of environmental sampling that has been conducted on property that you own or occupy. Samples were collected in accordance with the methods identified in the site investigation work plan, in accordance with s. NR. 716.09 and 716.13, Wis. Adm. Code. This sampling was conducted as a result of contamination originating at the following location.

Site Information			
Site Name		DNR ID # (BRRTS #)	
Oconomowoc Electroplating Company, Inc. (OECI) Superfund Site		02-14-000905	
Address	City	State	ZIP Code
W2573 Oak Street	Ashippun	WI	53003

**Responsible Party**

The person(s) responsible for completing this environmental investigation is:

Property Owner

Oconomowoc Electroplating Company, Inc.

Address	City	State	ZIP Code
W2573 Oak Street	Ashippun	WI	53003

Contact Person	Phone Number (include area code)
Gwen Saliars (WDNR PM), William Murray (US EPA Remedial PM)	(920) 510-4343

Person or company that collected samples

Hyde Environmental, Inc.

**Sample Results (Results Attached)**

Reason for Sampling:  Routine  Other (define) \_\_\_\_\_

The contaminants that have been identified at this time on property that you own or occupy include:

Contaminant	In Soil?		In Groundwater?	
	Yes	No	Yes	No
Gasoline	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Diesel or Fuel Oil	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Solvents	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Heavy Metals	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Pesticides	<input type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>	<input checked="" type="radio"/>
Other: PFAS	<input type="radio"/>	<input checked="" type="radio"/>	<input checked="" type="radio"/>	<input type="radio"/>

This sampling event included sampling of a drinking water well. <input checked="" type="radio"/> Yes <input type="radio"/> No
If yes, the sampled drinking water well had detectable contaminants. <input checked="" type="radio"/> Yes <input type="radio"/> No

	Contaminants in Vapor	
	Yes	No
Indoor Air	<input type="radio"/>	<input checked="" type="radio"/>
Sub-slab	<input type="radio"/>	<input checked="" type="radio"/>
Exterior Soil Gas	<input type="radio"/>	<input checked="" type="radio"/>



## Site Investigation Sample Results Notification

Form 4400-249 (R 03/14)

Page 2 of 2

**Attached are:**

- A map that shows the locations from which samples were collected. (The map needs to meet the requirements of s. NR 716.15 (4), Wis. Adm. Code.)
- A data table with specific contaminant levels at each sample location and whether or not the sample results exceed state standards.
- A copy of the laboratory results.

**You are not identified as the person that is responsible for this contamination.** However, your cooperation is important. Property owners may become legally responsible for contamination if they do not allow access to the person that is responsible so that person may complete the environmental investigation and clean up activities.

**Option for written exemption:** You have the option of requesting a written liability exemption from the DNR for contamination that originated on another property, or on property that you lease. To do this, you must present an adequate environmental assessment of your property and pay a \$700 fee for review of this information. If you are interested in this option, please see DNR publication # RR 589, "When Contamination Crosses a Property Line - Rights and Responsibilities of Property Owners", available at: [dnr.wi.gov/files/PDF/pubs/rr/rr589.pdf](http://dnr.wi.gov/files/PDF/pubs/rr/rr589.pdf).

**Contact Information**

Please address questions regarding this notification, or requests for additional information to the contact person listed above, or to one of the following contacts:


**Environmental Consultant**

Company Name		Contact Person Last Name	First Name	
Hyde Environmental, Inc.		Lindemann	James	
Address		City	State	ZIP Code
W175 N11163 Stonewood Drive, Suite 110		Germantown	WI	53022
Phone # (inc. area code)	Email			
(262) 250-1226	jclindemann@hyde-env.com			

Select which agency:  Natural Resources       Agriculture, Trade and Consumer Protection

**State of Wisconsin Department of Natural Resources**

Contact Person Last Name		First Name	Phone # (inc. area code)	
Saliars		Gwen	(920) 510-4343	
Address		City	State	ZIP Code
625 E County Road Y, Suite 700		Oshkosh	WI	54901
Email				
gwen.saliars@wisconsin.gov				

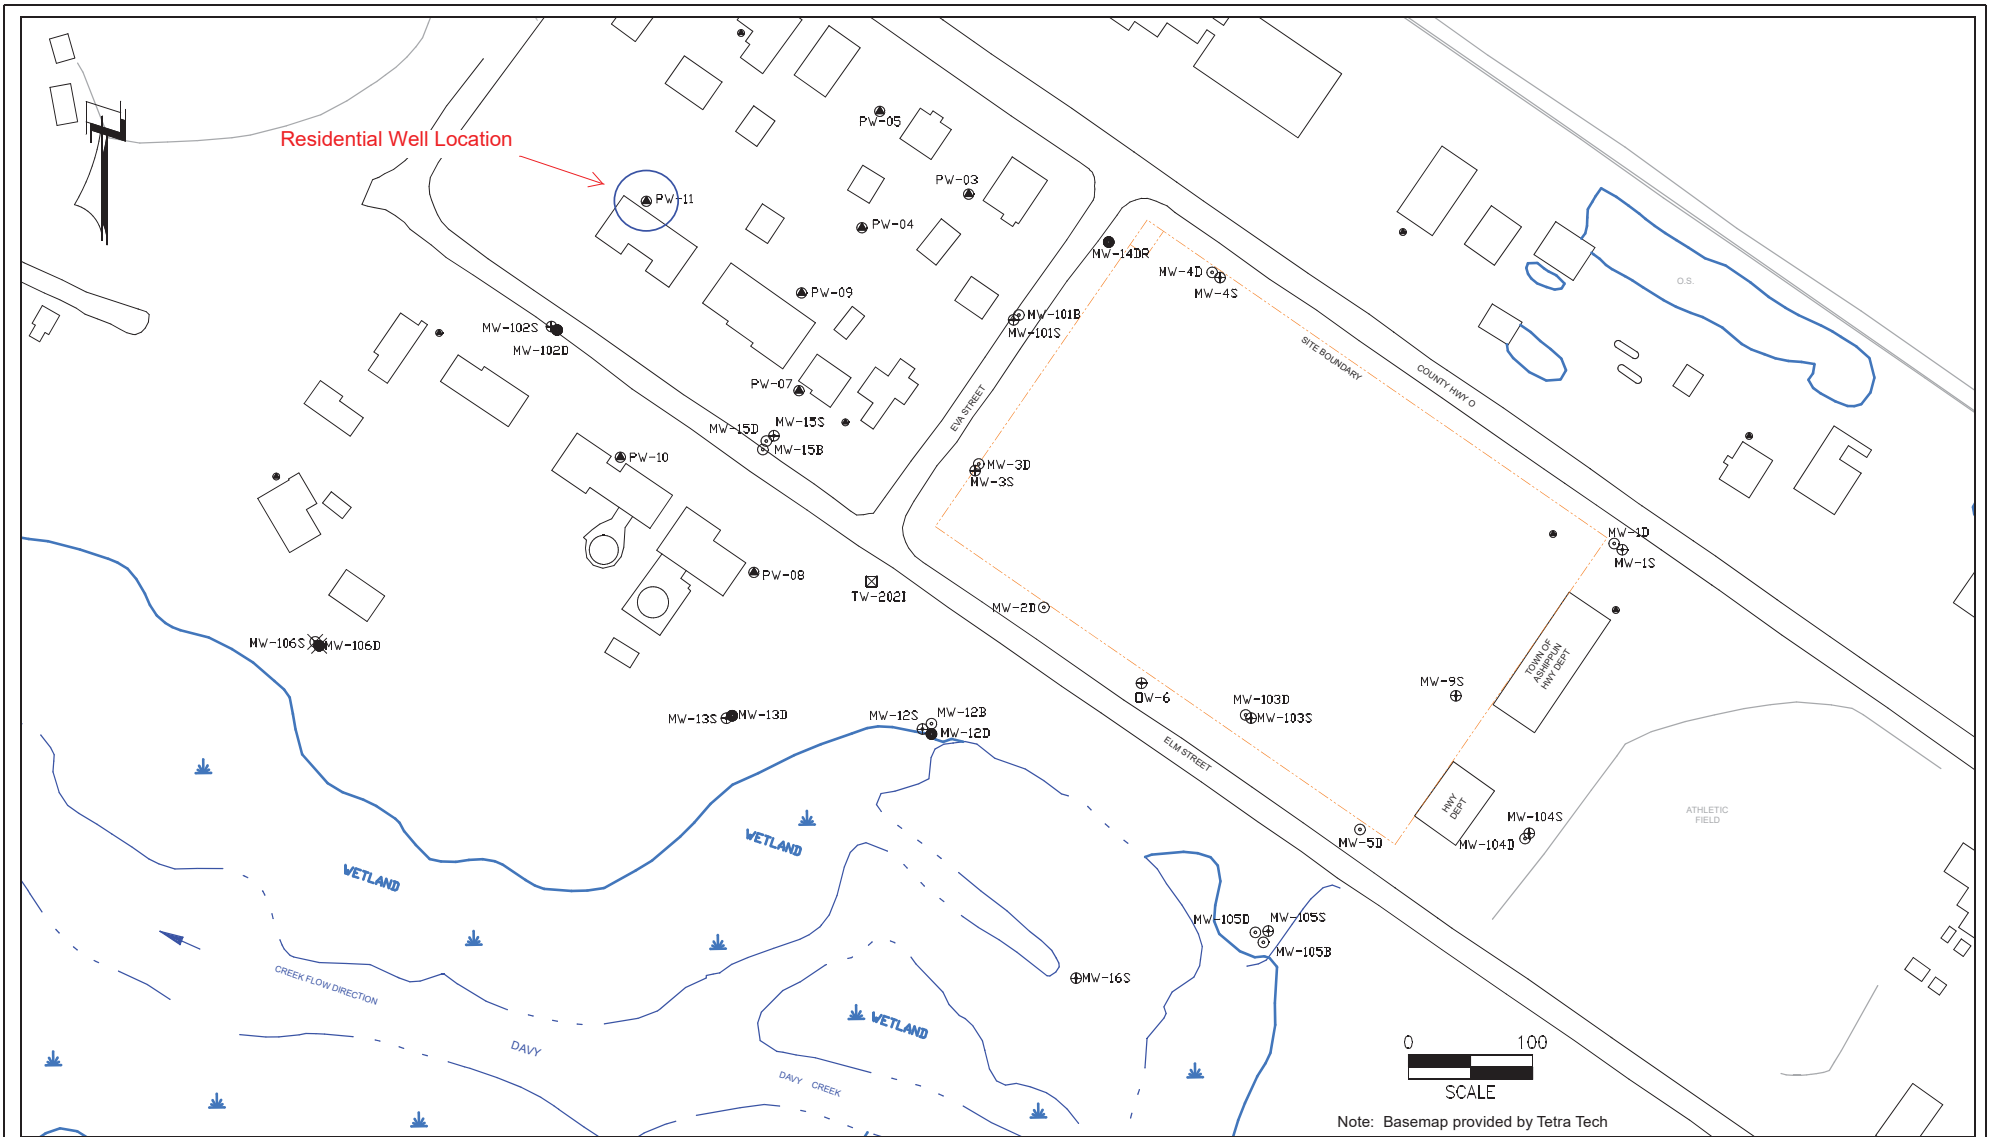

- MW-105B    BEDROCK MONITORING WELL
- MW-105D    DEEP UNCONSOLIDATED MONITORING WELL
- ⊕ MW-105S    SHALLOW UNCONSOLIDATED MONITORING WELL

- PW-11    RESIDENTIAL WELL
- ⊗ MW-106D    DEEP UNCONSOLIDATED SENTINEL WELL
- ⊗ MW-106S    SHALLOW UNCONSOLIDATED SENTINEL WELL



**SITE MAP**  
Oconomowoc Electroplating Company, Inc.  
Ashippun, WI

# GROUNDWATER ANALYTICAL RESULTS SUMMARY

W2612 Elm Street, Ashippun, WI

Sampled March 24, 2023

Analyte	<i>PAL</i>	PW-11
	<i>ng/L</i>	
Perfluorobutanesulfonic acid	90,000	1.8
Perfluorohexanoic acid	30,000	2.0
PFBA	2,000	3.3

Notes:

PAL = Department of Health Services recommended Preventive Action Limit

Italicized values attain or exceed the NR 140 PAL

ng/L = nanograms per liter

Only detected analytes shown

## ANALYTICAL RESULTS

Project: OECl  
Pace Project No.: 10647233

**Sample: PW-11**      **Lab ID: 10647233006**      Collected: 03/24/23 17:40      Received: 03/28/23 08:50      Matrix: Water

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
<b>WI ID NPW</b>									
Analytical Method: ENV-SOP-MIN4-0178    Preparation Method: ENV-SOP-MIN4-0178									
Pace Analytical Services - Minneapolis									
11Cl-PF3OUdS	ND	ng/L	1.9	0.55	1	03/30/23 21:44	04/04/23 08:19	763051-92-9	N2
4:2 FTS	ND	ng/L	1.8	0.46	1	03/30/23 21:44	04/04/23 08:19	757124-72-4	N2
6:2 FTS	ND	ng/L	1.9	0.67	1	03/30/23 21:44	04/04/23 08:19	27619-97-2	N2
8:2 FTS	ND	ng/L	1.9	0.50	1	03/30/23 21:44	04/04/23 08:19	39108-34-4	N2
9Cl-PF3ONS	ND	ng/L	1.8	0.46	1	03/30/23 21:44	04/04/23 08:19	756426-58-1	N2
ADONA	ND	ng/L	1.9	0.90	1	03/30/23 21:44	04/04/23 08:19	919005-14-4	N2
HFPO-DA	ND	ng/L	2.0	0.49	1	03/30/23 21:44	04/04/23 08:19	13252-13-6	N2
NEtFOSAA	ND	ng/L	2.0	0.80	1	03/30/23 21:44	04/04/23 08:19	2991-50-6	N2
NEtFOSA	ND	ng/L	2.0	0.57	1	03/30/23 21:44	04/04/23 08:19	4151-50-2	N2
NEtFOSE	ND	ng/L	2.0	0.88	1	03/30/23 21:44	04/04/23 08:19	1691-99-2	N2
NMeFOSAA	ND	ng/L	2.0	0.68	1	03/30/23 21:44	04/04/23 08:19	2355-31-9	N2
NMeFOSA	ND	ng/L	2.0	0.54	1	03/30/23 21:44	04/04/23 08:19	31506-32-8	N2
NMeFOSE	ND	ng/L	2.0	0.51	1	03/30/23 21:44	04/04/23 08:19	24448-09-7	N2
Perfluorobutanesulfonic acid	<b>1.8</b>	ng/L	1.7	0.48	1	03/30/23 21:44	04/04/23 08:19	375-73-5	N2
Perfluorodecanoic acid	ND	ng/L	2.0	0.60	1	03/30/23 21:44	04/04/23 08:19	335-76-2	N2
Perfluorohexanoic acid	<b>2.0</b>	ng/L	2.0	0.90	1	03/30/23 21:44	04/04/23 08:19	307-24-4	N2
PFBA	<b>3.3</b>	ng/L	2.0	0.49	1	03/30/23 21:44	04/04/23 08:19	375-22-4	N2
PFDS	ND	ng/L	1.9	0.63	1	03/30/23 21:44	04/04/23 08:19	335-77-3	N2
PFDoS	ND	ng/L	1.9	0.58	1	03/30/23 21:44	04/04/23 08:19	79780-39-5	N2
PFHpS	ND	ng/L	1.9	0.66	1	03/30/23 21:44	04/04/23 08:19	375-92-8	N2
PFNS	ND	ng/L	1.9	0.58	1	03/30/23 21:44	04/04/23 08:19	68259-12-1	N2
PFOSA	ND	ng/L	2.0	0.71	1	03/30/23 21:44	04/04/23 08:19	754-91-6	N2
PFPeA	ND	ng/L	2.0	0.81	1	03/30/23 21:44	04/04/23 08:19	2706-90-3	N2
PFPeS	ND	ng/L	1.9	0.59	1	03/30/23 21:44	04/04/23 08:19	2706-91-4	N2
Perfluorododecanoic acid	ND	ng/L	2.0	0.47	1	03/30/23 21:44	04/04/23 08:19	307-55-1	N2
Perfluoroheptanoic acid	ND	ng/L	2.0	0.68	1	03/30/23 21:44	04/04/23 08:19	375-85-9	N2
Perfluorohexanesulfonic acid	ND	ng/L	1.8	0.52	1	03/30/23 21:44	04/04/23 08:19	355-46-4	N2
Perfluorononanoic acid	ND	ng/L	2.0	0.78	1	03/30/23 21:44	04/04/23 08:19	375-95-1	N2
Perfluorooctanesulfonic acid	ND	ng/L	1.8	0.66	1	03/30/23 21:44	04/04/23 08:19	1763-23-1	N2
Perfluorooctanoic acid	ND	ng/L	2.0	0.85	1	03/30/23 21:44	04/04/23 08:19	335-67-1	N2
Perfluorotetradecanoic acid	ND	ng/L	2.0	0.59	1	03/30/23 21:44	04/04/23 08:19	376-06-7	N2
Perfluorotridecanoic acid	ND	ng/L	2.0	0.61	1	03/30/23 21:44	04/04/23 08:19	72629-94-8	N2
Perfluoroundecanoic acid	ND	ng/L	2.0	0.48	1	03/30/23 21:44	04/04/23 08:19	2058-94-8	N2
<b>Surrogates</b>									
13C4-PFBA (S)	121	%	25-150		1	03/30/23 21:44	04/04/23 08:19		
13C5-PFPeA (S)	149	%	25-150		1	03/30/23 21:44	04/04/23 08:19		
13C3-PFBS (S)	122	%	25-150		1	03/30/23 21:44	04/04/23 08:19		
13C24:2FTS (S)	149	%	25-150		1	03/30/23 21:44	04/04/23 08:19		
13C3HFPO-DA (S)	139	%	25-150		1	03/30/23 21:44	04/04/23 08:19		
13C4-PFHpA (S)	122	%	25-150		1	03/30/23 21:44	04/04/23 08:19		
13C3-PFHxS (S)	116	%	25-150		1	03/30/23 21:44	04/04/23 08:19		
13C26:2FTS (S)	140	%	25-150		1	03/30/23 21:44	04/04/23 08:19		
13C8-PFOA (S)	121	%	25-150		1	03/30/23 21:44	04/04/23 08:19		
13C8-PFOS (S)	109	%	25-150		1	03/30/23 21:44	04/04/23 08:19		
13C9-PFNA (S)	122	%	25-150		1	03/30/23 21:44	04/04/23 08:19		

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.

## ANALYTICAL RESULTS

Project: OECl  
Pace Project No.: 10647233

**Sample: PW-11**      **Lab ID: 10647233006**      Collected: 03/24/23 17:40      Received: 03/28/23 08:50      Matrix: Water

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
------------	---------	-------	-----	-----	----	----------	----------	---------	------

**WI ID NPW**

Analytical Method: ENV-SOP-MIN4-0178      Preparation Method: ENV-SOP-MIN4-0178  
Pace Analytical Services - Minneapolis

**Surrogates**

13C6-PFDA (S)	125	%.	25-150		1	03/30/23 21:44	04/04/23 08:19		
13C28:2FTS (S)	114	%.	25-150		1	03/30/23 21:44	04/04/23 08:19		
d3-MeFOSAA (S)	85	%.	25-150		1	03/30/23 21:44	04/04/23 08:19		
13C7-PFUdA (S)	110	%.	25-150		1	03/30/23 21:44	04/04/23 08:19		
13C8-PFOSA (S)	76	%.	25-150		1	03/30/23 21:44	04/04/23 08:19		
d5-EtFOSAA (S)	90	%.	25-150		1	03/30/23 21:44	04/04/23 08:19		
13C2-PFDoA (S)	139	%.	25-150		1	03/30/23 21:44	04/04/23 08:19		
d3-NMeFOSE (S)	59	%.	10-150		1	03/30/23 21:44	04/04/23 08:19		
d7-NMeFOSE (S)	80	%.	10-150		1	03/30/23 21:44	04/04/23 08:19		
13C2-PFTA (S)	105	%.	25-150		1	03/30/23 21:44	04/04/23 08:19		
d9-NEtFOSE (S)	76	%.	10-150		1	03/30/23 21:44	04/04/23 08:19		
d5-NEtFOSE (S)	58	%.	10-150		1	03/30/23 21:44	04/04/23 08:19		
13C2PFHxDA (S)	99	%.	25-150		1	03/30/23 21:44	04/04/23 08:19		
13C5-PFHxA (S)	137	%.	25-150		1	03/30/23 21:44	04/04/23 08:19		

## REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,  
without the written consent of Pace Analytical Services, LLC.