



September 2, 2014

WDNR Milwaukee Office
Attn: Victoria Stovall
2300 N. Martin Luther King Drive
Milwaukee, WI 53212

RECEIVED

SEP 9 - 2014

BY: _____



Subject:

U.S. Petroleum, Inc. – Sabra Rehman TSSA
8004 22nd Avenue
Kenosha, WI

Dear Ms. Stovall,

Enclosed is the Tank System Site Assessment for the U.S. Petroleum, Inc. – Sabra Rehman site in Kenosha, WI. The site location is shown on Figure 1.

The subject property does not have documented contamination listed on WDNR BRRTS website. Soil sampling during the removal indicates that contamination exists at the north end of the piping trench with levels exceeding Groundwater Pathway RCLs and Non-Industrial Not-to-exceed Direct Contact RCL. The soil sampling results are summarized on Table 1. The site assessment sampling locations are shown on Figure 2.

Please contact me with questions or comments at (715) 675-9784 or bbailey@reiengineering.com.

Sincerely,
REI Engineering, Inc.

Brian J. Bailey
Environmental Scientist

Attachments

CC: Jay Schlueter, SGS Environmental Contracting, LLC, N2570 Daytona Drive Merrill, WI 54452



RESPONSIVE. EFFICIENT. INNOVATIVE.

4080 N. 20th Avenue Wausau, WI 54401
715-675-9784 www.REIengineering.com

DRAWING FILE: P:\6700-6799\6754 - SGS U.S. PETROLEUM\DWG\6754-SITE.DWG LAYOUT: SITE PLOTTED: Aug 19, 2014 - 3:19pm PLOTTED BY: TODDW



LEGEND

0 30
 SCALE: 1" = 30'

+ SOIL SAMPLE
 -P- UNDERGROUND PRODUCT PIPING
 -SS- SANITARY SEWER LINE

REI Engineering, INC.

U.S. PETROLEUM, INC.
 8004 22nd AVENUE
 KENOSHA, WISCONSIN

FIGURE 2 : SITE MAP		
PROJECT NO.	DRAWN BY:	DATE:
6754	TAW	8/19/2014

TABLE 1 SOIL FIELD SCREENING & GRO/DRO LABORATORY ANALYTICAL RESULTS-FOR PETROLEUM PRODUCTS

Sample ID #	Sample Location & Soil/Geologic Description	Sample Collection Method				Depth Below Tank/Piping (feet)	Field Screening Result (ppm)	GRO (mg/kg)	DRO (mg/kg)
		Grab	Shelby Tube	Direct Push	Split Spoon				
SS-1	Tank Bed / 3/8" Stone	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	2' BLS	0.2		
SS-2	Tank Bed / 3/8" Stone	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	2' BLS	0.8		
SS-3	Tank Bed / 3/8" Stone	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	2' BLS	3.5		
SS-4	Tank Bed / Brown Silty Sand	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	3' BLS	1.5		
SS-5	Tank Bed / Brown Silty Sand	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	2' BLS	0		
SS-6	Tank Bed / Brown Silty Sand	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	2' BLS	1.4		
SS-7	Tank Bed / Brown Silty Sand	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	2' BLS	1.4		
SS-8	Tank Bed / Brown Silty Sand	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	2' BLS	1.8		
SS-9	Piping Trench / Brown Silty Sand	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	3' BLS	3.3		
SS-10	Piping Trench / Brown Silty Sand	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	3' BLS	2.7		
SS-11	Piping Trench / Brown Silty Sand	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	3' BLS	1.9		
SS-12	Piping Trench / Brown Silty Sand	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	3' BLS	2.6		
SS-13	Piping Trench / Brown Silty Sand	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	3' BLS	10.6		
SS-14	Piping Trench / Brown Silty Sand	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	3' BLS	1,504		

TABLE 2 SOIL LABORATORY ANALYTICAL RESULTS-FOR PETROLEUM PRODUCTS

Sample ID #	BENZENE	TOLUENE	ETHYLBENZENE	MTBE	TRIMETHYL - BENZENES (TOTAL)	XYLENES (TOTAL)	NAPHTHALENE
	ug/kg	ug/kg	ug/kg	ug/kg	ug/kg	ug/kg	ug/kg
SS-1	< 25	< 25	< 25	< 25	< 25	< 25	< 25
SS-2	< 25	< 25	< 25	< 25	65.6	< 25	114
SS-3	< 25	< 25	< 25	< 25	26.1J	< 25	< 25
SS-4	< 25	< 25	< 25	50.0J	40.0J	< 25	114
SS-5	< 25	< 25	< 25	< 25	< 25	< 25	< 25
SS-6	< 25	< 25	< 25	< 25	< 25	< 25	< 25
SS-7	< 25	< 25	< 25	< 25	< 25	< 25	< 25
SS-8	< 25	< 25	< 25	< 25	< 25	< 25	< 25
SS-9	< 25	< 25	< 25	< 25	< 25	< 25	< 25
SS-10	< 25	< 25	< 25	< 25	< 25	< 25	< 25
SS-11	< 25	< 25	< 25	< 25	< 25	< 25	< 25
SS-12	< 25	< 25	< 25	< 25	< 25	< 25	< 25
SS-13	< 25	< 25	< 25	< 25	< 25	< 25	< 25
SS-14	< 200	< 200	3,570	501J	55,200	11,030	5,890

K. TANK-SYSTEM SITE ASSESSMENT INFORMATION

As a tank-system site assessor certified under Wis. Admin. Code section Comm 5.83, it is my opinion that there is no indication of a release of a regulated substance to the environment.

Sampling at the site indicates there has been a release to the environment. Pursuant to Wis. Admin. Code section Comm 10.585 (2) (a) and Wis. Stats. section 292.11 (2) (a), the owner or operator or contractor performing work under chapter Comm 10 shall immediately report any release of a regulated substance to the Wisconsin Department of Natural Resources. Failure to do so may result in forfeitures of a minimum of \$10 and a maximum of \$5000 for each violation under Wis. Stats. section 101.09 (5). Each day of continued violation and each tank are treated as separate offenses.

Brian J. Bailey

Tank-System Site Assessor Name (print)

715-675-9784

Tank-System Site Assessor Telephone Number



Tank-System Site Assessor Signature

9/2/14

Date Signed

1279084

Certification Number #

REI Engineering, Inc.

Company Name

Part B – To be completed by environmental professional

Submit original Part B to the WDNR along with a copy of Part A

I. TANK-SYSTEM SITE ASSESSMENT (TSSA)

Site Name: U.S. PETROLEUM, INC. - SABRA REHMAN

Address: 8004 22ND AVE, KENOSHA, WI

Note: Site name and address must match with Part A Section 1.

To determine if a TSSA is required, see Comm 10 and section II part B of ASSESSMENT AND REPORTING OF SUSPECTED AND OBVIOUS RELEASES FROM UNDERGROUND AND ABOVEGROUND STORAGE TANK SYSTEMS.

If a TSSA is required, then follow the procedures detailed in ASSESSMENT AND REPORTING OF SUSPECTED AND OBVIOUS RELEASES FROM UNDERGROUND AND ABOVEGROUND STORAGE TANK SYSTEMS.

1. Site Information

a. Has there been a previously documented release at this site? Y N

If yes, provide the Commerce # _____, or DNR BRRT's # _____.

b. Number of active tanks¹ at facility prior to completion of current services USTs ² _____ ASTs ¹ _____.

(NOTE 1: Do not include previously closed systems or system components.)

c. Excavation/trench dimensions (in feet). (Photos must be provided.)

EXCAVATION/TRENCH #	LENGTH	WIDTH	DEPTH
Tank Bed	36	27	12
Pipe Trench	105	4	3

2. Visual Excavation/Trench Inspection (Photos must be provided for "Yes" responses, except item b.)

Do any of the following conditions exist in or about the excavation(s)?

a. Stained soils: Y N b. Petroleum odor: Y N c. Water In excavation/trench: Y N

d. Free product in the excavation/trench: Y N e. Sheen or free product on water: Y N

3. Geology/Hydrogeology

a. Depth to groundwater ³ _____ feet b. Indicate type of geology² S

(Note 2: Use these symbols individually or in combination as appropriate: C = Clay, SLT = Silt, S = Sand, Gr = Gravel)

4. Receptors

a. Water supply well(s) within 250 feet of the facility? Y N If yes, specify None known

b. Surface water(s) within 1000 feet of the facility? Y N If yes, specify _____

5. Sampling

a. Follow the procedures detailed in ASSESSMENT AND REPORTING OF SUSPECTED AND OBVIOUS RELEASES FROM UNDERGROUND AND ABOVEGROUND STORAGE TANK SYSTEMS.

b. Complete Tables 1 and 2 as appropriate. (Attach chain-of-custody and laboratory analytical reports.)

c. Attach a detailed map of site features and sample locations.

J. NOTE RELEVANT OBSERVATIONS, SPECIFIC PROBLEMS OR CONCERNS BELOW

**TABLE 1
SOIL SAMPLE ANALYTICAL RESULTS
U.S. PETROLEUM INC - SABRA REHMAN
8004 22ND STREET
KENOSHA, WI**

<i>Date --></i>		8/13/14	8/13/14	8/13/14	8/13/14	8/13/14	8/13/14	8/13/14	8/13/14	8/13/14	8/13/14	8/13/14	8/13/14	8/13/14	8/13/14	
<i>Sample ID --></i>		SS-1	SS-2	SS-3	SS-4	SS-5	SS-6	SS-7	SS-8	SS-9	SS-10	SS-11	SS-12	SS-13	SS-14	
<i>Sample Depth (Feet) --></i>		2	2	2	3	2	2	2	2	3	3	3	3	3	3	
Petroleum VOC's (mg/kg)	Non-Industrial Not-To-Exceed DC RCL															
	NR 140 Groundwater Pathway Protection (DF=2)															
Benzene	1.49	0.0051	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.200
Ethylbenzene	7.47	1.57	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	3.57
Toluene	818	1.1072	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.200
Xylenes (Total)	258	3.9400	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	11.03
Methyl tert Butyl Ether	59.4	0.027	<0.025	<0.025	<0.025	0.050 ^J	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	0.501 ^J
1,2,4-Trimethylbenzene	89.8	NS	<0.025	0.066	0.026 ^J	0.040 ^J	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	41.0
1,3,5-Trimethylbenzene	182	NS	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	14.2
Trimethylbenzenes (Total)	NS	1.3793	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	55.2
Naphthalene	5.15	0.6587	<0.025	<0.025	<0.025	0.114	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	<0.025	5.89

Notes:

NR720 Standards Obtained From WDNR Online Excel Database

RCL - NR 720 Proposed Soil Residual Contaminant Level

DC - Direct Contact

< - Concentration below listed laboratory detection limit


NS - No Standard

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

Bold Exceeds Non-Industrial Not-To-Exceed DC RCL


Outline Exceeds Industrial Not-To-Exceed DC RCL

Italic Exceeds NR 140 Groundwater Pathway Protection

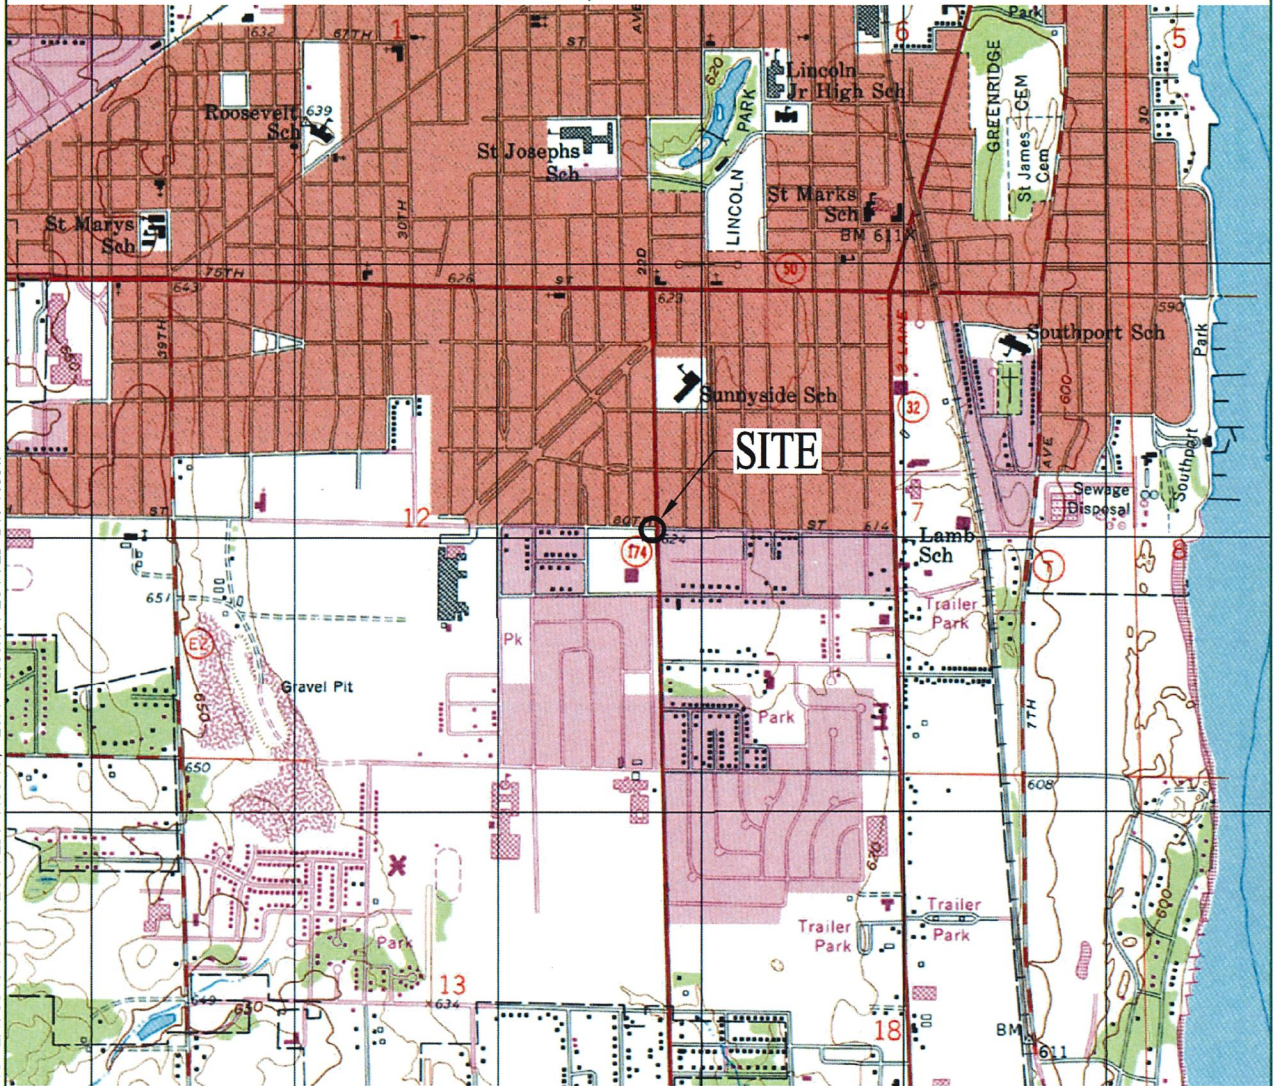


DRAWING FILE: P:\6700-6799\6754 - SGS U.S. PETROLEUM\DWG\6754-VICN.DWG LAYOUT: VICN PLOTTED: Aug 19, 2014 - 3:50PM PLOTTED BY: TODDW

SCALE 1:24 000



CONTOUR INTERVAL 10 FEET
 SEA LEVEL DATUM OF 1929
 DEPTH CURVES AND SOUNDINGS IN FEET—DATUM IS 578 FEET



UTM GRID AND 1994 MAGNETIC NORTH
 DECLINATION AT CENTER OF SHEET



KENOSHA, WIS.
 SE/4 RACINE 15' QUADRANGLE
 42087-E7-TF-024

1958
 PHOTOREVISED 1971

REI Engineering, INC.

U.S. PETROLEUM, INC.
 8004 22nd AVENUE
 KENOSHA, WISCONSIN

FIGURE 1 : SITE VICINITY MAP

PROJECT NO.	6754	DRAWN BY:	TAW	DATE:	8/19/2014
-------------	------	-----------	-----	-------	-----------



Facig Northwest at U.S. Petroleum Station Tank Bed



Tank Bed - South of Pump Island



Facing Southwest at Pump Island



Facing South - Piping Trench



12,000 gallon UST Removed From Site



Soil Backfill Pile



Tank Bed - Sampling



Dispenser Island - Piping Sampling



Pace Analytical Services, Inc.
1241 Bellevue Street - Suite 9
Green Bay, WI 54302
(920)469-2436

August 21, 2014

Brian Bailey
REI Engineering
4080 North 20th Ave
Wausau, WI 54401

RE: Project: 6754 U.S. PETRO -SGS
Pace Project No.: 40101767

Dear Brian Bailey:

Enclosed are the analytical results for sample(s) received by the laboratory on August 16, 2014. The results relate only to the samples included in this report. Results reported herein conform to the most current TNI standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,

Steven Mleczko for
Brian Basten
brian.basten@pacelabs.com
Project Manager

Enclosures



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, Inc..



Pace Analytical Services, Inc.
1241 Bellevue Street - Suite 9
Green Bay, WI 54302
(920)469-2436

CERTIFICATIONS

Project: 6754 U.S. PETRO -SGS
Pace Project No.: 40101767

Green Bay Certification IDs

1241 Bellevue Street, Green Bay, WI 54302
Florida/NELAP Certification #: E87948
Illinois Certification #: 200050
Kentucky Certification #: 82
Louisiana Certification #: 04168
Minnesota Certification #: 055-999-334

New York Certification #: 11888
North Dakota Certification #: R-150
South Carolina Certification #: 83006001
Texas Certification #: T104704529-14-1
US Dept of Agriculture #: S-76505
Wisconsin Certification #: 405132750

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, Inc.

SAMPLE SUMMARY

Project: 6754 U.S. PETRO -SGS
Pace Project No.: 40101767

Lab ID	Sample ID	Matrix	Date Collected	Date Received
40101767001	SS-1 @ 2' BLS	Solid	08/13/14 10:40	08/16/14 08:20
40101767002	SS-2 @ 2' BLS	Solid	08/13/14 10:45	08/16/14 08:20
40101767003	SS-3 @ 2' BLS	Solid	08/13/14 10:50	08/16/14 08:20
40101767004	SS-4 @ 3' BLS	Solid	08/13/14 10:55	08/16/14 08:20
40101767005	SS-5 @ 2' BLS	Solid	08/13/14 11:00	08/16/14 08:20
40101767006	SS-6 @ 2' BLS	Solid	08/13/14 11:05	08/16/14 08:20
40101767007	SS-7 @ 2' BLS	Solid	08/13/14 11:10	08/16/14 08:20
40101767008	SS-8 @ 2' BLS	Solid	08/13/14 11:15	08/16/14 08:20
40101767009	SS-9 @ 3' BLS	Solid	08/13/14 11:35	08/16/14 08:20
40101767010	SS-10 @ 3' BLS	Solid	08/13/14 11:40	08/16/14 08:20
40101767011	SS-11 @ 3' BLS	Solid	08/13/14 11:45	08/16/14 08:20
40101767012	SS-12 @ 3' BLS	Solid	08/13/14 11:50	08/16/14 08:20
40101767013	SS-13 @ 3' BLS	Solid	08/13/14 11:55	08/16/14 08:20
40101767014	SS-14 @ 3' BLS	Solid	08/13/14 12:00	08/16/14 08:20

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, Inc..



SAMPLE ANALYTE COUNT

Project: 6754 U.S. PETRO -SGS
 Pace Project No.: 40101767

Lab ID	Sample ID	Method	Analysts	Analytes Reported
40101767001	SS-1 @ 2' BLS	WI MOD GRO	LCF	10
		ASTM D2974-87	AH	1
40101767002	SS-2 @ 2' BLS	WI MOD GRO	LCF	10
		ASTM D2974-87	AH	1
40101767003	SS-3 @ 2' BLS	WI MOD GRO	LCF	10
		ASTM D2974-87	AH	1
40101767004	SS-4 @ 3' BLS	WI MOD GRO	LCF	10
		ASTM D2974-87	AH	1
40101767005	SS-5 @ 2' BLS	WI MOD GRO	LCF	10
		ASTM D2974-87	AH	1
40101767006	SS-6 @ 2' BLS	WI MOD GRO	LCF	10
		ASTM D2974-87	AH	1
40101767007	SS-7 @ 2' BLS	WI MOD GRO	LCF	10
		ASTM D2974-87	AH	1
40101767008	SS-8 @ 2' BLS	WI MOD GRO	LCF	10
		ASTM D2974-87	AH	1
40101767009	SS-9 @ 3' BLS	WI MOD GRO	LCF	10
		ASTM D2974-87	AH	1
40101767010	SS-10 @ 3' BLS	WI MOD GRO	LCF	10
		ASTM D2974-87	AH	1
40101767011	SS-11 @ 3' BLS	WI MOD GRO	LCF	10
		ASTM D2974-87	AH	1
40101767012	SS-12 @ 3' BLS	WI MOD GRO	LCF	10
		ASTM D2974-87	AH	1
40101767013	SS-13 @ 3' BLS	WI MOD GRO	LCF	10
		ASTM D2974-87	AH	1
40101767014	SS-14 @ 3' BLS	WI MOD GRO	LCF	10
		ASTM D2974-87	AH	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
 without the written consent of Pace Analytical Services, Inc.



ANALYTICAL RESULTS

Project: 6754 U.S. PETRO -SGS
 Pace Project No.: 40101767

Sample: SS-1 @ 2' BLS Lab ID: 40101767001 Collected: 08/13/14 10:40 Received: 08/16/14 08:20 Matrix: Solid

Results reported on a "dry-weight" basis

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
WIGRO GCV									
Analytical Method: WI MOD GRO Preparation Method: TPH GRO/PVOC WI ext.									
Benzene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 12:24	71-43-2	W
Ethylbenzene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 12:24	100-41-4	W
Methyl-tert-butyl ether	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 12:24	1634-04-4	W
Naphthalene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 12:24	91-20-3	W
Toluene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 12:24	108-88-3	W
1,2,4-Trimethylbenzene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 12:24	95-63-6	W
1,3,5-Trimethylbenzene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 12:24	108-67-8	W
m&p-Xylene	<50.0 ug/kg		120	50.0	1	08/20/14 07:02	08/20/14 12:24	179601-23-1	W
o-Xylene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 12:24	95-47-6	W
Surrogates									
a,a,a-Trifluorotoluene (S)	101 %		80-120		1	08/20/14 07:02	08/20/14 12:24	98-08-8	
Percent Moisture									
Analytical Method: ASTM D2974-87									
Percent Moisture	4.7 %		0.10	0.10	1		08/18/14 15:58		

Sample: SS-2 @ 2' BLS Lab ID: 40101767002 Collected: 08/13/14 10:45 Received: 08/16/14 08:20 Matrix: Solid

Results reported on a "dry-weight" basis

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
WIGRO GCV									
Analytical Method: WI MOD GRO Preparation Method: TPH GRO/PVOC WI ext.									
Benzene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 12:49	71-43-2	W
Ethylbenzene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 12:49	100-41-4	W
Methyl-tert-butyl ether	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 12:49	1634-04-4	W
Naphthalene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 12:49	91-20-3	W
Toluene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 12:49	108-88-3	W
1,2,4-Trimethylbenzene	65.6 ug/kg		62.4	26.0	1	08/20/14 07:02	08/20/14 12:49	95-63-6	
1,3,5-Trimethylbenzene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 12:49	108-67-8	W
m&p-Xylene	<50.0 ug/kg		120	50.0	1	08/20/14 07:02	08/20/14 12:49	179601-23-1	W
o-Xylene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 12:49	95-47-6	W
Surrogates									
a,a,a-Trifluorotoluene (S)	102 %		80-120		1	08/20/14 07:02	08/20/14 12:49	98-08-8	
Percent Moisture									
Analytical Method: ASTM D2974-87									
Percent Moisture	3.8 %		0.10	0.10	1		08/18/14 15:58		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
 without the written consent of Pace Analytical Services, Inc..



ANALYTICAL RESULTS

Project: 6754 U.S. PETRO -SGS
 Pace Project No.: 40101767

Sample: SS-3 @ 2' BLS Lab ID: 40101767003 Collected: 08/13/14 10:50 Received: 08/16/14 08:20 Matrix: Solid

Results reported on a "dry-weight" basis

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
WIGRO GCV Analytical Method: WI MOD GRO Preparation Method: TPH GRO/PVOC WI ext.									
Benzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 13:15	71-43-2	W
Ethylbenzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 13:15	100-41-4	W
Methyl-tert-butyl ether	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 13:15	1634-04-4	W
Naphthalene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 13:15	91-20-3	W
Toluene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 13:15	108-88-3	W
1,2,4-Trimethylbenzene	26.1J	ug/kg	62.1	25.9	1	08/20/14 07:02	08/20/14 13:15	95-63-6	W
1,3,5-Trimethylbenzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 13:15	108-67-8	W
m&p-Xylene	<50.0	ug/kg	120	50.0	1	08/20/14 07:02	08/20/14 13:15	179601-23-1	W
o-Xylene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 13:15	95-47-6	W
Surrogates									
a,a,a-Trifluorotoluene (S)	103	%	80-120		1	08/20/14 07:02	08/20/14 13:15	98-08-8	
Percent Moisture Analytical Method: ASTM D2974-87									
Percent Moisture	3.3	%	0.10	0.10	1		08/18/14 15:58		

Sample: SS-4 @ 3' BLS Lab ID: 40101767004 Collected: 08/13/14 10:55 Received: 08/16/14 08:20 Matrix: Solid

Results reported on a "dry-weight" basis

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
WIGRO GCV Analytical Method: WI MOD GRO Preparation Method: TPH GRO/PVOC WI ext.									
Benzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 13:40	71-43-2	W
Ethylbenzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 13:40	100-41-4	W
Methyl-tert-butyl ether	50.0J	ug/kg	70.4	29.3	1	08/20/14 07:02	08/20/14 13:40	1634-04-4	W
Naphthalene	114	ug/kg	70.4	29.3	1	08/20/14 07:02	08/20/14 13:40	91-20-3	W
Toluene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 13:40	108-88-3	W
1,2,4-Trimethylbenzene	40.0J	ug/kg	70.4	29.3	1	08/20/14 07:02	08/20/14 13:40	95-63-6	W
1,3,5-Trimethylbenzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 13:40	108-67-8	W
m&p-Xylene	<50.0	ug/kg	120	50.0	1	08/20/14 07:02	08/20/14 13:40	179601-23-1	W
o-Xylene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 13:40	95-47-6	W
Surrogates									
a,a,a-Trifluorotoluene (S)	103	%	80-120		1	08/20/14 07:02	08/20/14 13:40	98-08-8	
Percent Moisture Analytical Method: ASTM D2974-87									
Percent Moisture	14.7	%	0.10	0.10	1		08/18/14 15:58		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
 without the written consent of Pace Analytical Services, Inc..

ANALYTICAL RESULTS

Project: 6754 U.S. PETRO -SGS
Pace Project No.: 40101767

Sample: SS-5 @ 2' BLS Lab ID: 40101767005 Collected: 08/13/14 11:00 Received: 08/16/14 08:20 Matrix: Solid

Results reported on a "dry-weight" basis

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
WIGRO GCV									
Analytical Method: WI MOD GRO Preparation Method: TPH GRO/PVOC WI ext.									
Benzene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 14:06	71-43-2	W
Ethylbenzene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 14:06	100-41-4	W
Methyl-tert-butyl ether	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 14:06	1634-04-4	W
Naphthalene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 14:06	91-20-3	W
Toluene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 14:06	108-88-3	W
1,2,4-Trimethylbenzene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 14:06	95-63-6	W
1,3,5-Trimethylbenzene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 14:06	108-67-8	W
m&p-Xylene	<50.0 ug/kg		120	50.0	1	08/20/14 07:02	08/20/14 14:06	179601-23-1	W
o-Xylene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 14:06	95-47-6	W
Surrogates									
a,a,a-Trifluorotoluene (S)	102 %		80-120		1	08/20/14 07:02	08/20/14 14:06	98-08-8	
Percent Moisture									
Analytical Method: ASTM D2974-87									
Percent Moisture	12.4 %		0.10	0.10	1		08/18/14 16:23		

Sample: SS-6 @ 2' BLS Lab ID: 40101767006 Collected: 08/13/14 11:05 Received: 08/16/14 08:20 Matrix: Solid

Results reported on a "dry-weight" basis

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
WIGRO GCV									
Analytical Method: WI MOD GRO Preparation Method: TPH GRO/PVOC WI ext.									
Benzene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 14:31	71-43-2	W
Ethylbenzene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 14:31	100-41-4	W
Methyl-tert-butyl ether	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 14:31	1634-04-4	W
Naphthalene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 14:31	91-20-3	W
Toluene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 14:31	108-88-3	W
1,2,4-Trimethylbenzene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 14:31	95-63-6	W
1,3,5-Trimethylbenzene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 14:31	108-67-8	W
m&p-Xylene	<50.0 ug/kg		120	50.0	1	08/20/14 07:02	08/20/14 14:31	179601-23-1	W
o-Xylene	<25.0 ug/kg		60.0	25.0	1	08/20/14 07:02	08/20/14 14:31	95-47-6	W
Surrogates									
a,a,a-Trifluorotoluene (S)	103 %		80-120		1	08/20/14 07:02	08/20/14 14:31	98-08-8	
Percent Moisture									
Analytical Method: ASTM D2974-87									
Percent Moisture	8.7 %		0.10	0.10	1		08/18/14 16:23		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, Inc..

ANALYTICAL RESULTS

Project: 6754 U.S. PETRO -SGS
Pace Project No.: 40101767

Sample: SS-7 @ 2' BLS Lab ID: 40101767007 Collected: 08/13/14 11:10 Received: 08/16/14 08:20 Matrix: Solid

Results reported on a "dry-weight" basis

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
WIGRO GCV									
Analytical Method: WI MOD GRO Preparation Method: TPH GRO/PVOC WI ext.									
Benzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 14:57	71-43-2	W
Ethylbenzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 14:57	100-41-4	W
Methyl-tert-butyl ether	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 14:57	1634-04-4	W
Naphthalene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 14:57	91-20-3	W
Toluene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 14:57	108-88-3	W
1,2,4-Trimethylbenzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 14:57	95-63-6	W
1,3,5-Trimethylbenzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 14:57	108-67-8	W
m&p-Xylene	<50.0	ug/kg	120	50.0	1	08/20/14 07:02	08/20/14 14:57	179601-23-1	W
o-Xylene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 14:57	95-47-6	W
Surrogates									
a,a,a-Trifluorotoluene (S)	101	%	80-120		1	08/20/14 07:02	08/20/14 14:57	98-08-8	
Percent Moisture									
Analytical Method: ASTM D2974-87									
Percent Moisture	9.1	%	0.10	0.10	1		08/18/14 16:23		

Sample: SS-8 @ 2' BLS Lab ID: 40101767008 Collected: 08/13/14 11:15 Received: 08/16/14 08:20 Matrix: Solid

Results reported on a "dry-weight" basis

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
WIGRO GCV									
Analytical Method: WI MOD GRO Preparation Method: TPH GRO/PVOC WI ext.									
Benzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 15:22	71-43-2	W
Ethylbenzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 15:22	100-41-4	W
Methyl-tert-butyl ether	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 15:22	1634-04-4	W
Naphthalene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 15:22	91-20-3	W
Toluene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 15:22	108-88-3	W
1,2,4-Trimethylbenzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 15:22	95-63-6	W
1,3,5-Trimethylbenzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 15:22	108-67-8	W
m&p-Xylene	<50.0	ug/kg	120	50.0	1	08/20/14 07:02	08/20/14 15:22	179601-23-1	W
o-Xylene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 15:22	95-47-6	W
Surrogates									
a,a,a-Trifluorotoluene (S)	102	%	80-120		1	08/20/14 07:02	08/20/14 15:22	98-08-8	
Percent Moisture									
Analytical Method: ASTM D2974-87									
Percent Moisture	13.5	%	0.10	0.10	1		08/18/14 16:23		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, Inc..

ANALYTICAL RESULTS

Project: 6754 U.S. PETRO -SGS
Pace Project No.: 40101767

Sample: SS-9 @ 3' BLS Lab ID: 40101767009 Collected: 08/13/14 11:35 Received: 08/16/14 08:20 Matrix: Solid

Results reported on a "dry-weight" basis

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
WIGRO GCV									
Analytical Method: WI MOD GRO Preparation Method: TPH GRO/PVOC WI ext.									
Benzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 15:48	71-43-2	W
Ethylbenzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 15:48	100-41-4	W
Methyl-tert-butyl ether	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 15:48	1634-04-4	W
Naphthalene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 15:48	91-20-3	W
Toluene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 15:48	108-88-3	W
1,2,4-Trimethylbenzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 15:48	95-63-6	W
1,3,5-Trimethylbenzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 15:48	108-67-8	W
m&p-Xylene	<50.0	ug/kg	120	50.0	1	08/20/14 07:02	08/20/14 15:48	179601-23-1	W
o-Xylene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 15:48	95-47-6	W
Surrogates									
a,a,a-Trifluorotoluene (S)	101	%	80-120		1	08/20/14 07:02	08/20/14 15:48	98-08-8	
Percent Moisture									
Analytical Method: ASTM D2974-87									
Percent Moisture	10.3	%	0.10	0.10	1		08/18/14 16:23		

Sample: SS-10 @ 3' BLS Lab ID: 40101767010 Collected: 08/13/14 11:40 Received: 08/16/14 08:20 Matrix: Solid

Results reported on a "dry-weight" basis

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
WIGRO GCV									
Analytical Method: WI MOD GRO Preparation Method: TPH GRO/PVOC WI ext.									
Benzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 19:37	71-43-2	W
Ethylbenzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 19:37	100-41-4	W
Methyl-tert-butyl ether	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 19:37	1634-04-4	W
Naphthalene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 19:37	91-20-3	W
Toluene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 19:37	108-88-3	W
1,2,4-Trimethylbenzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 19:37	95-63-6	W
1,3,5-Trimethylbenzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 19:37	108-67-8	W
m&p-Xylene	<50.0	ug/kg	120	50.0	1	08/20/14 07:02	08/20/14 19:37	179601-23-1	W
o-Xylene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 19:37	95-47-6	W
Surrogates									
a,a,a-Trifluorotoluene (S)	102	%	80-120		1	08/20/14 07:02	08/20/14 19:37	98-08-8	
Percent Moisture									
Analytical Method: ASTM D2974-87									
Percent Moisture	10.7	%	0.10	0.10	1		08/18/14 16:24		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, Inc..



ANALYTICAL RESULTS

Project: 6754 U.S. PETRO -SGS
 Pace Project No.: 40101767

Sample: SS-11 @ 3' BLS Lab ID: 40101767011 Collected: 08/13/14 11:45 Received: 08/16/14 08:20 Matrix: Solid

Results reported on a "dry-weight" basis

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
WIGRO GCV									
Analytical Method: WI MOD GRO Preparation Method: TPH GRO/PVOC WI ext.									
Benzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 20:02	71-43-2	W
Ethylbenzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 20:02	100-41-4	W
Methyl-tert-butyl ether	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 20:02	1634-04-4	W
Naphthalene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 20:02	91-20-3	W
Toluene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 20:02	108-88-3	W
1,2,4-Trimethylbenzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 20:02	95-63-6	W
1,3,5-Trimethylbenzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 20:02	108-67-8	W
m&p-Xylene	<50.0	ug/kg	120	50.0	1	08/20/14 07:02	08/20/14 20:02	179601-23-1	W
o-Xylene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 20:02	95-47-6	W
Surrogates									
a,a,a-Trifluorotoluene (S)	100 %		80-120		1	08/20/14 07:02	08/20/14 20:02	98-08-8	
Percent Moisture									
Analytical Method: ASTM D2974-87									
Percent Moisture	11.9 %		0.10	0.10	1		08/18/14 16:24		

Sample: SS-12 @ 3' BLS Lab ID: 40101767012 Collected: 08/13/14 11:50 Received: 08/16/14 08:20 Matrix: Solid

Results reported on a "dry-weight" basis

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
WIGRO GCV									
Analytical Method: WI MOD GRO Preparation Method: TPH GRO/PVOC WI ext.									
Benzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 20:28	71-43-2	W
Ethylbenzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 20:28	100-41-4	W
Methyl-tert-butyl ether	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 20:28	1634-04-4	W
Naphthalene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 20:28	91-20-3	W
Toluene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 20:28	108-88-3	W
1,2,4-Trimethylbenzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 20:28	95-63-6	W
1,3,5-Trimethylbenzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 20:28	108-67-8	W
m&p-Xylene	<50.0	ug/kg	120	50.0	1	08/20/14 07:02	08/20/14 20:28	179601-23-1	W
o-Xylene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 20:28	95-47-6	W
Surrogates									
a,a,a-Trifluorotoluene (S)	100 %		80-120		1	08/20/14 07:02	08/20/14 20:28	98-08-8	
Percent Moisture									
Analytical Method: ASTM D2974-87									
Percent Moisture	8.7 %		0.10	0.10	1		08/18/14 16:24		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
 without the written consent of Pace Analytical Services, Inc..



ANALYTICAL RESULTS

Project: 6754 U.S. PETRO -SGS
 Pace Project No.: 40101767

Sample: SS-13 @ 3' BLS Lab ID: 40101767013 Collected: 08/13/14 11:55 Received: 08/16/14 08:20 Matrix: Solid

Results reported on a "dry-weight" basis

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
WIGRO GCV									
Analytical Method: WI MOD GRO Preparation Method: TPH GRO/PVOC WI ext.									
Benzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 20:53	71-43-2	W
Ethylbenzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 20:53	100-41-4	W
Methyl-tert-butyl ether	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 20:53	1634-04-4	W
Naphthalene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 20:53	91-20-3	W
Toluene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 20:53	108-88-3	W
1,2,4-Trimethylbenzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 20:53	95-63-6	W
1,3,5-Trimethylbenzene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 20:53	108-67-8	W
m&p-Xylene	<50.0	ug/kg	120	50.0	1	08/20/14 07:02	08/20/14 20:53	179601-23-1	W
o-Xylene	<25.0	ug/kg	60.0	25.0	1	08/20/14 07:02	08/20/14 20:53	95-47-6	W
Surrogates									
a,a,a-Trifluorotoluene (S)	105	%	80-120		1	08/20/14 07:02	08/20/14 20:53	98-08-8	
Percent Moisture									
Analytical Method: ASTM D2974-87									
Percent Moisture	14.4	%	0.10	0.10	1		08/18/14 16:24		

Sample: SS-14 @ 3' BLS Lab ID: 40101767014 Collected: 08/13/14 12:00 Received: 08/16/14 08:20 Matrix: Solid

Results reported on a "dry-weight" basis

Parameters	Results	Units	LOQ	LOD	DF	Prepared	Analyzed	CAS No.	Qual
WIGRO GCV									
Analytical Method: WI MOD GRO Preparation Method: TPH GRO/PVOC WI ext.									
Benzene	<200	ug/kg	480	200	8	08/20/14 07:02	08/20/14 17:04	71-43-2	W
Ethylbenzene	3570	ug/kg	577	241	8	08/20/14 07:02	08/20/14 17:04	100-41-4	
Methyl-tert-butyl ether	501J	ug/kg	577	241	8	08/20/14 07:02	08/20/14 17:04	1634-04-4	
Naphthalene	5890	ug/kg	577	241	8	08/20/14 07:02	08/20/14 17:04	91-20-3	
Toluene	<200	ug/kg	480	200	8	08/20/14 07:02	08/20/14 17:04	108-88-3	W
1,2,4-Trimethylbenzene	41000	ug/kg	577	241	8	08/20/14 07:02	08/20/14 17:04	95-63-6	
1,3,5-Trimethylbenzene	14200	ug/kg	577	241	8	08/20/14 07:02	08/20/14 17:04	108-67-8	
m&p-Xylene	9430	ug/kg	1150	481	8	08/20/14 07:02	08/20/14 17:04	179601-23-1	
o-Xylene	1600	ug/kg	577	241	8	08/20/14 07:02	08/20/14 17:04	95-47-6	
Surrogates									
a,a,a-Trifluorotoluene (S)	138	%	80-120		8	08/20/14 07:02	08/20/14 17:04	98-08-8	S7
Percent Moisture									
Analytical Method: ASTM D2974-87									
Percent Moisture	16.9	%	0.10	0.10	1		08/18/14 16:24		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
 without the written consent of Pace Analytical Services, Inc..

QUALITY CONTROL DATA

Project: 6754 U.S. PETRO -SGS

Pace Project No.: 40101767

QC Batch: GCV/13019 Analysis Method: WI MOD GRO
 QC Batch Method: TPH GRO/PVOC WI ext. Analysis Description: WIGRO Solid GCV
 Associated Lab Samples: 40101767001, 40101767002, 40101767003, 40101767004, 40101767005, 40101767006, 40101767007,
 40101767008, 40101767009, 40101767010, 40101767011, 40101767012, 40101767013, 40101767014

METHOD BLANK: 1029113 Matrix: Solid
 Associated Lab Samples: 40101767001, 40101767002, 40101767003, 40101767004, 40101767005, 40101767006, 40101767007,
 40101767008, 40101767009, 40101767010, 40101767011, 40101767012, 40101767013, 40101767014

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
1,2,4-Trimethylbenzene	ug/kg	<25.0	50.0	08/20/14 09:51	
1,3,5-Trimethylbenzene	ug/kg	<25.0	50.0	08/20/14 09:51	
Benzene	ug/kg	<25.0	50.0	08/20/14 09:51	
Ethylbenzene	ug/kg	<25.0	50.0	08/20/14 09:51	
m&p-Xylene	ug/kg	<50.0	100	08/20/14 09:51	
Methyl-tert-butyl ether	ug/kg	<25.0	50.0	08/20/14 09:51	
Naphthalene	ug/kg	<25.0	50.0	08/20/14 09:51	
o-Xylene	ug/kg	<25.0	50.0	08/20/14 09:51	
Toluene	ug/kg	<25.0	50.0	08/20/14 09:51	
a,a,a-Trifluorotoluene (S)	%	113	80-120	08/20/14 09:51	

Parameter	Units	1029114					1029115				
		Spike Conc.	LCS Result	LCSD Result	LCS % Rec	LCSD % Rec	% Rec Limits	RPD	Max RPD	Qualifiers	
1,2,4-Trimethylbenzene	ug/kg	1000	1030	1080	103	108	80-120	5	20		
1,3,5-Trimethylbenzene	ug/kg	1000	1020	1060	102	106	80-120	4	20		
Benzene	ug/kg	1000	1060	1110	106	111	80-120	5	20		
Ethylbenzene	ug/kg	1000	1060	1110	106	111	80-120	5	20		
m&p-Xylene	ug/kg	2000	2130	2240	107	112	80-120	5	20		
Methyl-tert-butyl ether	ug/kg	1000	1040	1080	104	108	80-120	4	20		
Naphthalene	ug/kg	1000	1090	1140	109	114	80-120	5	20		
o-Xylene	ug/kg	1000	1070	1130	107	113	80-120	5	20		
Toluene	ug/kg	1000	1070	1120	107	112	80-120	5	20		
a,a,a-Trifluorotoluene (S)	%				106	105	80-120				

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
 without the written consent of Pace Analytical Services, Inc..



QUALITY CONTROL DATA

Project: 6754 U.S. PETRO -SGS
Pace Project No.: 40101767

QC Batch: PMST/10117 Analysis Method: ASTM D2974-87
QC Batch Method: ASTM D2974-87 Analysis Description: Dry Weight/Percent Moisture
Associated Lab Samples: 40101767001, 40101767002, 40101767003, 40101767004

SAMPLE DUPLICATE: 1028195

Parameter	Units	40101223003 Result	Dup Result	RPD	Max RPD	Qualifiers
Percent Moisture	%	16.0	16.2	1	10	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, Inc..

QUALITY CONTROL DATA

Project: 6754 U.S. PETRO -SGS
Pace Project No.: 40101767

QC Batch: PMST/10118 Analysis Method: ASTM D2974-87
QC Batch Method: ASTM D2974-87 Analysis Description: Dry Weight/Percent Moisture
Associated Lab Samples: 40101767005, 40101767006, 40101767007, 40101767008, 40101767009, 40101767010, 40101767011,
40101767012, 40101767013, 40101767014

SAMPLE DUPLICATE: 1028215

Parameter	Units	40101767014 Result	Dup Result	RPD	Max RPD	Qualifiers
Percent Moisture	%	16.9	16.8	0	10	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, Inc..



QUALIFIERS

Project: 6754 U.S. PETRO -SGS
Pace Project No.: 40101767

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to changes in sample preparation, dilution of the sample aliquot, or moisture content.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit.

S - Surrogate

1,2-Diphenylhydrazine (8270 listed analyte) decomposes to Azobenzene.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

LOD - Limit of Detection.

LOQ - Limit of Quantitation.

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

ANALYTE QUALIFIERS

S7 Surrogate recovery outside control limits (not confirmed by re-analysis).

W Non-detect results are reported on a wet weight basis.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, Inc..

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: 6754 U.S. PETRO -SGS

Pace Project No.: 40101767

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
40101767001	SS-1 @ 2' BLS	TPH GRO/PVOC WI ext.	GCV/13019	WI MOD GRO	GCV/13024
40101767002	SS-2 @ 2' BLS	TPH GRO/PVOC WI ext.	GCV/13019	WI MOD GRO	GCV/13024
40101767003	SS-3 @ 2' BLS	TPH GRO/PVOC WI ext.	GCV/13019	WI MOD GRO	GCV/13024
40101767004	SS-4 @ 3' BLS	TPH GRO/PVOC WI ext.	GCV/13019	WI MOD GRO	GCV/13024
40101767005	SS-5 @ 2' BLS	TPH GRO/PVOC WI ext.	GCV/13019	WI MOD GRO	GCV/13024
40101767006	SS-6 @ 2' BLS	TPH GRO/PVOC WI ext.	GCV/13019	WI MOD GRO	GCV/13024
40101767007	SS-7 @ 2' BLS	TPH GRO/PVOC WI ext.	GCV/13019	WI MOD GRO	GCV/13024
40101767008	SS-8 @ 2' BLS	TPH GRO/PVOC WI ext.	GCV/13019	WI MOD GRO	GCV/13024
40101767009	SS-9 @ 3' BLS	TPH GRO/PVOC WI ext.	GCV/13019	WI MOD GRO	GCV/13024
40101767010	SS-10 @ 3' BLS	TPH GRO/PVOC WI ext.	GCV/13019	WI MOD GRO	GCV/13024
40101767011	SS-11 @ 3' BLS	TPH GRO/PVOC WI ext.	GCV/13019	WI MOD GRO	GCV/13024
40101767012	SS-12 @ 3' BLS	TPH GRO/PVOC WI ext.	GCV/13019	WI MOD GRO	GCV/13024
40101767013	SS-13 @ 3' BLS	TPH GRO/PVOC WI ext.	GCV/13019	WI MOD GRO	GCV/13024
40101767014	SS-14 @ 3' BLS	TPH GRO/PVOC WI ext.	GCV/13019	WI MOD GRO	GCV/13024
40101767001	SS-1 @ 2' BLS	ASTM D2974-87	PMST/10117		
40101767002	SS-2 @ 2' BLS	ASTM D2974-87	PMST/10117		
40101767003	SS-3 @ 2' BLS	ASTM D2974-87	PMST/10117		
40101767004	SS-4 @ 3' BLS	ASTM D2974-87	PMST/10117		
40101767005	SS-5 @ 2' BLS	ASTM D2974-87	PMST/10118		
40101767006	SS-6 @ 2' BLS	ASTM D2974-87	PMST/10118		
40101767007	SS-7 @ 2' BLS	ASTM D2974-87	PMST/10118		
40101767008	SS-8 @ 2' BLS	ASTM D2974-87	PMST/10118		
40101767009	SS-9 @ 3' BLS	ASTM D2974-87	PMST/10118		
40101767010	SS-10 @ 3' BLS	ASTM D2974-87	PMST/10118		
40101767011	SS-11 @ 3' BLS	ASTM D2974-87	PMST/10118		
40101767012	SS-12 @ 3' BLS	ASTM D2974-87	PMST/10118		
40101767013	SS-13 @ 3' BLS	ASTM D2974-87	PMST/10118		
40101767014	SS-14 @ 3' BLS	ASTM D2974-87	PMST/10118		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, Inc..

(Please Print Clearly)

Company Name: REI
 Branch/Location: Wausau
 Project Contact: Brian Bailey
 Phone: 715-675-9784
 Project Number: 6754
 Project Name: U.S. Petro - SGS
 Project State: WI
 Sampled By (Print): Brian Bailey
 Sampled By (Sign): *Brian Bailey*



UPPER MIDWEST REGION
 MN: 612-607-1700 WI: 920-469-2436

Page 1 of 2
 4010176

CHAIN OF CUSTODY

Preservation Codes
 A=None B=HCL C=H2SO4 D=HNO3 E=DI Water F=Methanol G=NaOH
 H=Sodium Bisulfate Solution I=Sodium Thiosulfate J=Other

FILTERED? (YES/NO)
 PRESERVATION (CODE)

Y/N	N	N																		
	N	N																		
	F	A																		
Analyses Requested	Pboc + Napthalen																			
	Dry lab.																			

Quote #:
 Mail To Contact: Brian Bailey
 Mail To Company: REI
 Mail To Address: 4080 N. 20th Ave
 Wausau, WI 54400
 Invoice To Contact: SAA
 Invoice To Company:
 Invoice To Address:
 Invoice To Phone:
 CLIENT COMMENTS: 1-40ml VF
 LAB COMMENTS: 1-40ml VF
 Profile #

Data Package Options (billable)
 EPA Level III
 EPA Level IV

MS/MSD (billable)
 On your sample
 NOT needed on your sample

Matrix Codes
 A = Air W = Water
 B = Blota DW = Drinking Water
 C = Charcoal GW = Ground Water
 O = Oil SW = Surface Water
 S = Soil WW = Waste Water
 SI = Sludge WP = Wipe

PACE LAB #	CLIENT FIELD ID	COLLECTION		MATRIX	DATE	TIME	S	X	X												
		DATE	TIME																		
001	SS-1 @ 2' BLS	8/13/14	10:40A	S	8/13/14	10:40A	S	X	X												
002	SS-2 @ 2' BLS	8/13/14	10:45A	S	8/13/14	10:45A	S	X	X												
003	SS-3 @ 2' BLS	8/13/14	10:50A	S	8/13/14	10:50A	S	X	X												
004	SS-4 @ 3' BLS	8/13/14	10:55A	S	8/13/14	10:55A	S	X	X												
005	SS-5 @ 2' BLS	8/13/14	11:00A	S	8/13/14	11:00A	S	X	X												
006	SS-6 @ 2' BLS	8/13/14	11:05A	S	8/13/14	11:05A	S	X	X												
007	SS-7 @ 2' BLS	8/13/14	11:10A	S	8/13/14	11:10A	S	X	X												
008	SS-8 @ 2' BLS	8/13/14	11:15A	S	8/13/14	11:15A	S	X	X												
009	SS-9 @ 3' BLS	8/13/14	11:35A	S	8/13/14	11:35A	S	X	X												
010	SS-10 @ 3' BLS	8/13/14	11:40A	S	8/13/14	11:40A	S	X	X												
011	SS-11 @ 3' BLS	8/13/14	11:45A	S	8/13/14	11:45A	S	X	X												
012	SS-12 @ 3' BLS	8/13/14	11:50A	S	8/13/14	11:50A	S	X	X												
013	SS-13 @ 3' BLS	8/13/14	11:55A	S	8/13/14	11:55A	S	X	X												

Rush Turnaround Time Requested - Prelims (Rush TAT subject to approval/surcharge)
 Date Needed:
 Relinquished By: *Scotty Bloda* Date/Time: 8/15/14 1:30a
 Received By:
 Date/Time:
 Transmit Prelim Rush Results by (complete what you want):
 Relinquished By: *Walter* Date/Time: 8/16/14 0920
 Received By: *S. Paul* Date/Time: 8/16/14 0920
 Email #1:
 Relinquished By:
 Date/Time:
 Received By:
 Date/Time:
 Email #2:
 Relinquished By:
 Date/Time:
 Received By:
 Date/Time:
 Telephone:
 Relinquished By:
 Date/Time:
 Received By:
 Date/Time:
 Fax:
 Relinquished By:
 Date/Time:
 Received By:
 Date/Time:
 Samples on HOLD are subject to special pricing and release of liability
 Relinquished By:
 Date/Time:
 Received By:
 Date/Time:
 PACE Project No. 40101767
 Receipt Temp = 6 °C
 Sample Receipt pH OK / Adjusted
 Cooler Custody Seal Present / Not Present Intact / Not Intact

(Please Print Clearly)

Company Name: REI
 Branch/Location: Wausau
 Project Contact: Brian Bailey
 Phone: 715-675-9784
 Project Number: 6754
 Project Name: U.S. Petro - SGS
 Project State: WI
 Sampled By (Print): Brian Bailey
 Sampled By (Sign): *[Signature]*



UPPER MIDWEST REGION
 MN: 612-607-1700 WI: 920-469-2436

Page 2 of 2
 4010176
 Page 6 of 16

CHAIN OF CUSTODY

***Preservation Codes**
 A=None B=HCL C=H2SO4 D=HNO3 E=DI Water F=Methanol G=NaOH
 H=Sodium Bisulfate Solution I=Sodium Thiosulfate J=Other

FILTERED?
(YES/NO)
 PRESERVATION
(CODE)*

Y/N	Pick Letter	Analysis Requested	COLLECTION		MATRIX
			DATE	TIME	
N	N	AVOC + Naphthalene Dry wt.	8/12/14	12:00 P	S
F	A				

Quote #:
 Mail To Contact: Brian Bailey
 Mail To Company: REI
 Mail To Address: 4060 N. 20th Ave
 Wausau, WI 54401
 Invoice To Contact: SAA
 Invoice To Company:
 Invoice To Address:
 Invoice To Phone:
 CLIENT COMMENTS: 1-40m 2V
 LAB COMMENTS (Lab Use Only): 1-402P
 Profile #:

Data Package Options (billable)
 EPA Level III
 EPA Level IV


MS/MSD
 On your sample (billable)
 NOT needed on your sample

Matrix Codes
 A = Air W = Water
 B = Biota DW = Drinking Water
 C = Charcoal GW = Ground Water
 O = Oil SW = Surface Water
 S = Soil WW = Waste Water
 SI = Sludge WP = Wipe

PACE LAB #	CLIENT FIELD ID	COLLECTION		MATRIX
		DATE	TIME	
014	SS-14 @ 3' BLS	8/12/14	12:00 P	S

Rush Turnaround Time Requested - Prelims (Rush TAT subject to approval/surcharge) Date Needed:

Relinquished By: *[Signature]* Date/Time: 08/15 9:30a.
 Received By: Date/Time:
 Transmit Prelim Rush Results by (complete what you want):
 Relinquished By: *[Signature]* Date/Time: 8/16/14 08:00
 Received By: *[Signature]* Date/Time: 8/16/14 08:00
 Email #1:
 Email #2:
 Telephone:
 Fax:
 Samples on HOLD are subject to special pricing and release of liability
 Relinquished By: Date/Time:
 Received By: Date/Time:
 PACE Project No.
 Receipt Temp = 6 °C
 Sample Receipt pH OK / Adjusted
 Cooler Custody Seal Present / Not Present Intact / Not Intact

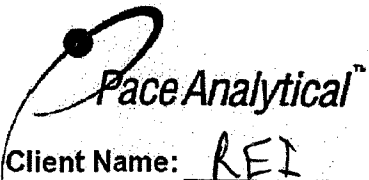

Sample Condition Upon Receipt

Pace Analytical Services, Inc.
1241 Bellevue Street, Suite 9
Green Bay, WI 54302


Client Name: REI

Project #:

WO#: 40101767

Courier: Fed Ex UPS Client Pace Other: Walgreens

Tracking #: 616301



Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Custody Seal on Samples Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other

Thermometer Used SK-44 Type of Ice: Wet Blue Dry None

Cooler Temperature Uncorr: 6 / Corr: 6 Biological Tissue is Frozen: yes

Temp Blank Present: yes no

Temp should be above freezing to 6°C for all sample except Biota.
Frozen Biota Samples should be received ≤ 0°C.

Person examining contents:
Date: 8/16/14
Initials: SR

Comments:

Table with 15 rows and 3 columns. Columns: Question, Yes/No/N/A checkboxes, and Numbered field. Rows include Chain of Custody Present, Short Hold Time Analysis, Containers Intact, etc.

Client Notification/ Resolution:

Person Contacted: Date/Time:

Comments/ Resolution:

If checked, see attached form for additional comments

Project Manager Review:

Date: 8-18-14

[Petroleum Programs Home](#)[Search Instructions](#)[Search by Tank ID](#)[Search by Site, Owner, or
Tank Characteristics](#)

Tank List

Searching for:

Owner ID equal to 928951

Number of matching records: 3

Type	ID	Facility ID	Address	Status	Contents	Size (gals)	Cust ID	Owner
County: , FDID: 3002 - Kenosha, Municipality: CITY OF KENOSHA								
1. AST	205613	72168	8004 22ND AVE		Interstitial Monitor- Visual	280	928951	U S PETROLEUM INC - SABRA REHMAN
2. UST	453079	72168	8004 22ND AVE		Vapor Monitor	10000	928951	U S PETROLEUM INC - SABRA REHMAN
3. UST	453085	72168	8004 22ND AVE		Vapor Monitor	12000	928951	U S PETROLEUM INC - SABRA REHMAN

[Download](#)**Disclaimer:** Tank Status does not reflect that the tank is code complying.[Close this response window](#)

8/29/2014

Tank Search Results List

This document was last revised: February 2010

Wisconsin Department of Safety and Professional Services

<u>Search Instructions</u>	<u>Search by Site, Owner, or Tank Characteristics</u>	<u>Search by Tank ID</u>
--	---	--

Tank Detail

Site and Owner

Site Info	County & Municipality	Owner
Facility ID: 72168 U S MOBIL 8004 22ND AVE KENOSHA Landowner Type: Private	30 - KENOSHA City of KENOSHA Fire Dept ID: 3002 - Kenosha	ID: 928951 U S PETROLEUM INC - SABRA REHMAN 6831 53RD ST #148 KENOSHA WI 53144
Site Anniversary Date:	Dispensers have Sumps: Yes	

Aboveground Storage Tank - ID: 205613, Wang ID: 300200088,

Install Date:	Capacity in Gallons:	280	Contents:	Interstitial Monitor-Visual
Tank Occupancy:	Marketer:	N	CAS Number:	
Federally Regulated:	Spill Protection:		Overfill Protection:	
Overfill Prot Type:	Site Gauge	Containment Sump Installed:	Unknown	
Corrosion Protect Type:		Date of Lining:		Lining Inspected Date:
Leak Detection:	Interstitial Monitor	Cath Test Date:		Cath Expire Date:
Leak Test Meth:		Leak Expire Date:		Leak Test Date: 12/16/2010
Construction Material:	Automatic Shut Off	Wall Size:		Underground Piping: N
Close Order Date:		Close Order By:		

Piping -

Flex Connectors:	UST mainfolded:	N	Related Tank ID:
Type:	Aboveground Piping:		Aboveground Pipe Construction: Steel
Construction Material:	Corrosion Protect Type:		Leak Detection: Not Required
Cath Test Date:	Cath Expire Date:		Leak Test Meth:
Leak Test Date:	Leak Expire Date:		Pipe Wall Size:
Catastrophic Leak Detection:	Cat Leak Test Date:		Piping System Type:

Inspections [Click here for login page](#)

Trans ID	Type	Status	Date	Fiscal Yr
913408	AN	CLOS	12/16/2003	2004
1043820	AN	CLOS	02/03/2005	2005
1178482	AN	CLOS	07/12/2006	2006
1964978	AN	CLOS	03/07/2012	2012
2117282	AN	RLEG	01/02/2013	2013
1451750	AN	CLOS	11/16/2007	2008
1301954	AN	CLNI		2007
1564424	AN	CLOS	11/17/2008	2009
1716295	AN	CLOS	03/17/2010	2010
1819682	AN	CLOS	12/16/2010	2011

[Close this response window](#)

Wisconsin Department of Safety and Professional Services

<u>Search Instructions</u>	<u>Search by Site, Owner, or Tank Characteristics</u>	<u>Search by Tank ID</u>
--	---	--

Tank Detail

Site and Owner

Site Info	County & Municipality	Owner
Facility ID: 72168 U S MOBIL 8004 22ND AVE KENOSHA Landowner Type: Private	30 - KENOSHA City of KENOSHA Fire Dept ID: 3002 - Kenosha	ID: 928951 U S PETROLEUM INC - SABRA REHMAN 6831 53RD ST #148 KENOSHA WI 53144
Site Anniversary Date:	Dispensers have Sumps: Yes	

Underground Storage Tank - ID: 453079, Wang ID: null, , PTO Expiration: 12/28/2010

Install Date:	11/14/1994	Capacity in Gallons:	10000	Contents:	Vapor Monitor
Tank Occupancy:		Marketer:	Y	CAS Number:	
Federally Regulated:	Y	Spill Protection:		Overfill Protection:	
Overfill Prot Type:	Alarm	Containment Sump Installed:	Yes		
Corrosion Protect Type:	Lined Steel	Date of Lining:		Lining Inspected Date:	
Leak Detection:	Interstitial Monitor	Cath Test Date:		Cath Expire Date:	
Leak Test Meth:		Leak Expire Date:		Leak Test Date:	12/16/2010
Construction Material:		Wall Size:		Underground Piping:	Y
Close Order Date:		Close Order By:			

Piping -

Flex Connectors:	Y	UST mainfolded:	N	Related Tank ID:	
-------------------------	---	------------------------	---	-------------------------	--

Type:		Aboveground Piping:		Aboveground Pipe Construction:	
Construction Material:		Corrosion Protect Type:	Lined Steel	Leak Detection:	Interstitial Monitor
Cath Test Date:		Cath Expire Date:		Leak Test Meth:	
Leak Test Date:	12/16/2010	Leak Expire Date:		Pipe Wall Size:	
Catastrophic Leak Detection:	Flow Restrictor	Cat Leak Test Date:	04/10/2010	Piping System Type:	

Inspections [Click here for login page](#)

Trans ID	Type	Status	Date	Fiscal Yr
913408	AN	CLOS	12/16/2003	2004
1043820	AN	CLOS	02/03/2005	2005
1178482	AN	CLOS	07/12/2006	2006
1964978	AN	CLOS	03/07/2012	2012
2117282	AN	RLEG	01/02/2013	2013
1451750	AN	CLOS	11/16/2007	2008
1301954	AN	CLNI		2007
1564424	AN	CLOS	11/17/2008	2009
1716295	AN	CLOS	03/17/2010	2010
1819682	AN	CLOS	12/16/2010	2011

[Close this response window](#)

Wisconsin Department of Safety and Professional Services

<u>Search Instructions</u>	<u>Search by Site, Owner, or Tank Characteristics</u>	<u>Search by Tank ID</u>
--	---	--

Tank Detail

Site and Owner

Site Info	County & Municipality	Owner
Facility ID: 72168 U S MOBIL 30 - KENOSHA 8004 22ND AVE KENOSHA Landowner Type: Private	City of KENOSHA Fire Dept ID: 3002 - Kenosha	ID: 928951 U S PETROLEUM INC - SABRA REHMAN 6831 53RD ST #148 KENOSHA WI 53144
Site Anniversary Date:	Dispensers have Sumps: Yes	

Underground Storage Tank - ID: 453085, Wang ID: null, , PTO Expiration: 12/28/2010

Install Date:	11/14/1994	Capacity in Gallons:	12000	Contents:	Vapor Monitor
Tank Occupancy:		Marketer:	Y	CAS Number:	
Federally Regulated:	Y	Spill Protection:		Overfill Protection:	
Overfill Prot Type:	Alarm	Containment Sump Installed:	Yes		
Corrosion Protect Type:	Lined Steel	Date of Lining:		Lining Inspected Date:	
Leak Detection:	Interstitial Monitor	Cath Test Date:		Cath Expire Date:	
Leak Test Meth:		Leak Expire Date:		Leak Test Date:	12/16/2010
Construction Material:		Wall Size:		Underground Piping:	Y
Close Order Date:		Close Order By:			

Piping -

Flex Connectors:	Y	UST mainfolded:	N	Related Tank ID:	
------------------	---	-----------------	---	------------------	--

Type:		Aboveground Piping:		Aboveground Pipe Construction:	
Construction Material:		Corrosion Protect Type:	Lined Steel	Leak Detection:	Interstitial Monitor
Cath Test Date:		Cath Expire Date:		Leak Test Meth:	
Leak Test Date:	12/16/2010	Leak Expire Date:		Pipe Wall Size:	
Catastrophic Leak Detection:	Flow Restrictor	Cat Leak Test Date:	04/10/2010	Piping System Type:	

Inspections [Click here for login page](#)

Trans ID	Type	Status	Date	Fiscal Yr
913408	AN	CLOS	12/16/2003	2004
1043820	AN	CLOS	02/03/2005	2005
1178482	AN	CLOS	07/12/2006	2006
1451750	AN	CLOS	11/16/2007	2008
1301954	AN	CLNI		2007
1564424	AN	CLOS	11/17/2008	2009
1716295	AN	CLOS	03/17/2010	2010
1819682	AN	CLOS	12/16/2010	2011
1964978	AN	CLOS	03/07/2012	2012
2117282	AN	RLEG	01/02/2013	2013

[Close this response window](#)

Wisconsin Department of Safety and Professional Services