



ORIGINAL

FILED
OFFICE OF THE
SECRETARY

2007 JAN -8 A 11: 36

Stora Enso North America
P.O. Box 8050
Wisconsin Rapids, WI 54495-8050
Telephone 715 422 3111

January 2, 2007

REGULATORY DIVISION

Ms. Magalie R. Salas, Secretary
Federal Energy Regulatory Commission
888 1st Street, N.E.
Washington, D.C. 20426

Little Quinnesec Falls Hydroelectric Project (FERC No. 2536), Article 406 - Submittal of Water Quality Monitoring - 2006

Dear Secretary Salas:

In accordance with the FERC Order dated December 24, 2002 modifying and amending Article 406, we are submitting the five-year (2006) water quality monitoring report for the above Project. A draft report was provided to the resource agencies on November 22, 2006 requesting comments or questions. Evidence of that consultation is enclosed. The Michigan Department of Environmental Quality requested the monitoring data in spreadsheet format. This was provided via email transmittal to the Michigan agencies.

Sincerely,

STORA ENSO NORTH AMERICA

Mark E. Anderson
Resources Manager

Enclosures:

cc: File, Little Quinnesec Falls, LG-90-30 Article 406
T.J. Witt - K.F. Goodreau
Ms. Peggy A. Harding - FERC, CRO
Ms. Louise Clemency - USFWS
Ms. Jessica Mistak - MDNR
Mr. John Suppnick - MDEQ
Peshtigo Office - WDNR



*Stora Enso North America
P.O. Box 8050
Wisconsin Rapids, WI 54495-8050
Telephone 715 422 3111*

November 22, 2006

Wisconsin Department of Natural Resources
101 North Ogden
Peshtigo, WI 54157

Ms. Louise Clemency
U.S. Fish & Wildlife Service
2661 Scott Tower Drive
New Franken, WI 54229-9565

Ms. Jessica Mistak
Michigan Department of Natural Resources
488 Cherry Creek Road
Marquette, MI 49855

Mr. John Suppnick
Michigan Department of Environmental Quality
300 S. Washington, 2nd Floor
Knapp Center
Lansing, MI 48933

Little Quinnesec Falls Hydroelectric Project, FERC No. 2536 – Article 406, Five-Year Water Quality Monitoring Report

In accordance with the FERC Order dated December 24, 2002 modifying and amending Article 406, we are submitting for your review the draft water quality monitoring report. Please provide any comments back to us no later than December 31, 2006 so that we compile any comments and submit them with the final report to the FERC by the end of January 2007. Comments can be provided in written form or emailed to us at mark.anderson@storaenso.com. All will be included in the filing with the FERC.

Sincerely,

STORA ENSO

A handwritten signature in black ink, appearing to read 'Mark E. Anderson', written over a horizontal line.

Mark E. Anderson
Resources Manager

Enclosure:

cc: File, Little Quinnesec Falls, LG-90-30 Article 406, Tom Witt – N (cover only)

Anderson, Mark

From: Jessica Mistak [mistakj@michigan.gov]
Sent: Monday, November 27, 2006 11:01 AM
To: Anderson, Mark
Cc: Bob Martini; <Clemency Louise; John Supnick
Subject: Little Quinnesec Water Quality Monitoring

Michigan DNR has reviewed your Five-Year Water Quality Monitoring Report dated November 22, 2006. We concur that water quality standards are being met at the Little Quinnesec project.
Jessica

<>< <>< <>< <>< <>< <>< <>< <><
Jessica Mistak, Senior Fisheries Biologist
DNR Marquette Fisheries Station
484 Cherry Creek Rd
Marquette, MI 49855
906-249-1611 ext. 308
FAX 906-249-3190
><> ><> ><> ><> ><> ><> ><> ><> ><>

Anderson, Mark

From: Louise_Clemency@fws.gov
Sent: Monday, November 27, 2006 4:52 PM
To: Anderson, Mark
Subject: Little Quinnesec - Water Quality Monitoring Report

This office will not be providing comments on the subject report.

Louise Clemency
Field Supervisor
U.S. Fish and Wildlife Service
Green Bay Ecological Services Office
2661 Scott Tower Drive
New Franken, Wisconsin 54229-9565
920-866-1725
920-866-1710 Fax

Anderson, Mark

From: John Suppnick [SUPPNICJ@michigan.gov]
Sent: Tuesday, November 28, 2006 9:36 AM
To: Anderson, Mark
Cc: Jessica Mistak
Subject: Water Quality Monitoring Report for Little Quinnesec Project

Mark,

Thank you for sending a copy of the 2006 water quality monitoring report for the Little Quinnesec Hydroelectric Project. The report demonstrates compliance with Michigan Water Quality Standards. We have no further comments on the report but would appreciate receiving an electronic copy of the spreadsheet file.

Thanks, John

John Suppnick
Michigan Department of Environmental Quality
Water Bureau
517-335-4192
suppnick@michigan.gov

12/04/2006

Anderson, Mark

From: Anderson, Mark
Sent: Wednesday, December 06, 2006 8:32 AM
To: John Supnick
Cc: Jessica Mistak (mistakjl@state.mi.us)
Subject: 2006 Little Quinnesec Falls Water Quality Data

Attachments: sena_2006_data.xls; Mark E. Anderson (Mark.Anderson@storaenso.com).vcf

John:
As requested here is the spreadsheet with the raw data from the entire monitoring period this year.



sena_2006_data.xls
(472 KB)


Mark.

Mark E. Anderson
Resources Manager
Consolidated Water Power Company
P.O. Box 8050
Wisconsin Rapids, WI 54495-8050

715 422 3927



Mark E. Anderson
(Mark.Anderso...



WHITE WATER ASSOCIATES, INC.

**Little Quinnesec Falls Hydroelectric Facility
2006 Water Quality Study (FERC Project No. 2536)**

Report Prepared for:

Stora Enso North America Corporation

Thomas Witt, Utilities Technical Coordinator

1101 Mill Street, Niagara, WI. 54151

Phone: (715) 251-8334

Mark Anderson, Resources Manager

Consolidated Water Power Company

P.O. Box 8050, Wisconsin Rapids, WI 54495

Phone: (715) 422-3927

Prepared by:

White Water Associates, Inc.

429 River Lane, P.O. Box 27

Amasa, Michigan 49903

Phone: (906) 822-7889

Prepared by:

Kent Premo, M.S.

INTRODUCTION

White Water Associates, Inc., is a full-service laboratory and ecological consulting firm located in Amasa, Michigan. In 2006, White Water Associates was contracted by Stora Enso North America Corporation, the operator of the Little Quinnesec Falls Hydroelectric Facility in Niagara, Wisconsin, to carry out a water quality monitoring study outlined in a Federal Regulatory Commission (FERC) order issued July 1, 1999. The order was modified in 2001 to require that a study be carried out to test water quality every 5 years for 20 years. The original order, water quality monitoring plan, and revised order are included in Appendix A. This report summarizes work fulfilling the water quality monitoring requirements for the 2006 monitoring season, the previous study having been conducted in 2001.

BACKGROUND

The FERC order approving the water quality monitoring plan for the Little Quinnesec Falls Project specifies that monitoring be conducted for temperature, dissolved oxygen, and pH. The monitoring period runs from May 1 through September 30.

The point designated for the monitoring station was upstream of the wastewater treatment discharge point. Continuous monitoring equipment was to be installed there to sample water conditions hourly, measuring the three water quality parameters of concern. Monitoring also involved special provisions in the case of a low DO event, defined to be less than 5.0 mg/L. These provisions included taking a vertical measurement (i.e., profile) of the deepest part of the project reservoir and contacting the agencies within two days of the event.

In addition to the DO limit, the proposed plan also indicated that temperature readings be less than 32° C (89° F) and pH readings be between 6.0 and 9.0 (standard units).

METHODS

A Hydrolab Datasonde 3 (DS3) was used to measure temperature, DO, and pH. The DS3 unit is basically a plastic cannister equipped with various environmental probes, internal data storage, and an external connector for serial communication. The temperature probe was factory calibrated; probes for the latter two parameters were calibrated according to manufacturer's specifications. The DS3 unit was deployed in an open steel tube with a perforated bottom fixed to a concrete deck structure directly below the tailrace abutting the dam operations building.

The DS3 unit was in part controlled by a programmable datalogger (Campbell Scientific Model CR-510) mounted in a weatherproof cabinet, powered by a solar panel, and attached by underwater cable to the DS3's external connector, and in part controlled by its own internal logging program set up to record measurements every hour on the half-hour. The Campbell Scientific datalogger was programmed to prompt the DS3 to take measurements every hour on the hour then store and process that data. The datalogger was programmed to have an attached voice synthesizer modem dial a prescribed phone number and deliver a warning message if the DO approached the level of concern (5.0 mg/L).

FINDINGS

The DS3 unit was deployed on April 28, 2006, for a planned monitoring period through September 30 and removal on October 4. The connected datalogger was called by computer to periodically check that the equipment was functioning properly. The DS3's internal logging program, set to record measurements hourly, is the basis for all data presented herein.

The datalogger provided an important alarm function on a remote, ongoing basis. In one instance that occurred late in June, the DS3 unit fell out of calibration after a few weeks of service and provided readings that were unrealistically low compared to DO readings from handheld meters taken at the same time. This condition was detected in a timely manner by our phone contact system with the datalogger. This instance, specifically June 20-23, was the only time when DO readings fell below the 5.0 mg/L level of concern. As an example, a DO reading

2006 Water Quality Study — Little Quinnesec Falls Hydroelectric Facility (Project No. 2536)

taken with a handheld meter was 7.5 mg/L (22.9° C) at 12:30 AM CT, June 21, compared to the DS3's reading of 4.23 mg/L at the same time. Replacement with a DS3 unit on June 23 produced readings back in the range of the field meter, 7.84 mg/L at 11:30 AM.

Aside from this instance involving a calibration problem, DO, temperature, and pH were all recorded within standards set by the water quality monitoring plan for the entire monitoring period.

Data for 2006 appear at the end of this report in Appendix B as tables summarizing monthly and weekly results, monthly graphs of DO and temperature (together), and a graph showing pH over the entire run, all uncorrected as recorded by the instrument. The complete data set for 2006 is included in Appendix C. An Excel spreadsheet with this data, the basis for the graphs and summary tables herein, will be retained by White Water Associates and Stora Enso Niagara Mill.

CONCLUSIONS

With no interruptions and only one instance where calibration drifted significantly, we collected data hourly for the entire period, May through September. Except for that instance of drift, at which time independent field measures and post-calibration readings indicated levels were more likely between 7.5 and 7.84 mg/L at midday, dissolved oxygen readings were always recorded above the level of concern (5.0 mg/L). Temperature and pH data during the period of measurement were also within the range of compliance. White Water Associates has seen no data to suggest that water quality standards below the hydroelectric facility are being compromised by the project.

APPENDIX A:

Background Documents and Correspondence

88 FERC ¶ 61,002

UNITED STATES OF AMERICA
FEDERAL ENERGY REGULATORY COMMISSION

Consolidated Papers, Inc) Project No. 2536-021

ORDER APPROVING WATER QUALITY MONITORING PLAN
Issued July 1, 1999

On December 3, 1997, Consolidated Papers, Inc., licensee for the Little Quinnesec Project (FERC No. 2536), filed its Water Quality Monitoring Plan. The plan was required by article 406 of the project license. 1/ The project is located on the Menominee River in Dickinson County, Michigan, and Marinette County, Wisconsin.

BACKGROUND

A new license for the Little Quinnesec Project was issued on May 7, 1997. Article 406 of that license required the licensee to file a plan, for Commission approval, to monitor dissolved oxygen concentration (DO), water temperature, and pH of the Menominee River at the Project. The purpose of the monitoring is to ensure that releases from the project maintain state standards for water temperature, dissolved oxygen (DO) concentration, and pH in the Menominee River immediately downstream of the project, whenever river flows are greater than the 95 percent exceedance flow, or when natural conditions prohibit attainment of the standards. The plan was to be developed after consultation with the Michigan Department of Natural Resources (MDNR), the Wisconsin Department of Natural Resources (WDNR), and the U.S. Fish and Wildlife Service (FWS).

THE PROPOSED PLAN

The licensee proposes to establish a monitoring station at the Little Quinnesec Project intake, upstream of the Consolidated Papers, Inc. - Niagara Division, wastewater treatment discharge point. Continuous monitoring equipment would record water temperature, DO concentration, and pH at hourly intervals.

1/ 79 FERC ¶ 62,093 (1997).

EC-A-1

Project No. 2536-021 -2-

Monitoring would be conducted from May through September for two years. If, after two years, data suggests that water quality problems do not exist, the licensee, in consultation with the agencies, would pursue modification or elimination of this article from the license.

If the continuous monitoring indicated a low DO event, the licensee would conduct an in-situ vertical measurement (i.e., profile) of water temperature and DO concentration in a deep part of the project reservoir, to determine whether project operation was contributing to the low DO event. The licensee proposes to notify the agencies of the occurrence of any such event within two business days. The licensee would include in this notification the results of any profile sampling or other information that might indicate the cause of the event.

The licensee proposes to store the continuous monitoring data in electronic format at its corporate office. The licensee would provide the resource agencies with data summary sheets via email by July 30 and October 30 of each year.

AGENCY COMMENTS

The licensee consulted with the agencies in the development of its proposal on October 22, 1997. All but two of the agency recommendations were adopted by the licensee in its proposed plan. The licensee did not agree to MDNR's request that it conduct continuous monitoring for DO at the upstream Big Quinnesec Falls Project (FERC No. 1980). The licensee stated that it did not feel this was appropriate since it did not own the Big Quinnesec Project and can not control their operations. Also, the licensee did not agree to conduct once-per-week in-situ vertical profiles of water temperature and DO concentration in the project reservoir. Instead, the licensee proposed to conduct such profiles only when the continuous monitoring below the Little Quinnesec Dam indicated that a low DO event was occurring.

DISCUSSION AND CONCLUSION

The licensee's plan outlines a program that is adequate for monitoring whether releases from the Little Quinnesec Project maintain state standards for water temperature, DO, and pH in the Menominee River below the project, in accordance with the requirements of article 406. Sampling is proposed for the summer months, during which high ambient temperatures and low streamflows may lead to high water temperatures and low DO concentrations.

1999-08-2000: 09:47 FROM: STOPPENSO
715E811730
TO: 715-422-4199
P. 002

WATER QUALITY MONITORING PLAN - ARTICLE 406

**CONSOLIDATED PAPERS, INC.
NIAGARA DIVISION**

**HYDRO PROJECT NO. 2536
LITTLE QUINNESEC FALLS**

I. Purpose

To ensure that releases from Project No. 2536 maintain State water quality standards below the project except when river flow in the Menominee River is <95% exceedance flow or when natural conditions prohibit attainment of those standards.

Temperature	<89°F	~ 32 °C
Dissolved oxygen	>5.0 mg/l	
pH	6.0 - 9.0	

II. Scope

A monitoring station will be established at the Little Quinnesec Project Tailrace, upstream of the CPI, Niagara Division, wastewater treatment outfall.

"Summertime" dissolved oxygen profiles will be taken at one meter intervals in the deep location of the impoundment during low D.O. events to verify water quality as it enters the project.

III. Quality Assurance Program

Continuous recording equipment will be calibrated periodically during the monitoring period using appropriate methodology noted in "Standard Methods for the Examination of Water and Wastewater", 18th Edition.

Temperature	Method	2550 B
Dissolved Oxygen	Method	4500-O C
pH	Method	4500-H+

IV. Timetable and Reporting

Continuous recording equipment for temperature, dissolved oxygen, and pH will be installed at the Little Quinnesec Tailrace site. Data will be recorded on an hourly basis for a two year period (May-September) commencing in 1998.

Data summary reports will be submitted to MDNR, MDEQ, WDNR, USFWS, and the Commission electronically (E-mail with cover sheet) within 30 days from the end of the quarter (by July 30 and October 30).

Notice of water quality standard exceedance will be provided to the Agencies noted above within one working day.

V. Consultation with Agencies

During consultation with the Agencies, it was determined that no factual data existed to indicate a water quality problem at Little Quinnesec. Based on this information, it was agreed upon between CPI and the Agencies to maintain water quality, based on the above plan, for two years. Based on the data received during these two years, and after consultation with the Agencies, CPI may file to modify or possibly eliminate water quality monitoring if it is determined no impacts are being caused by Project operation.

DWS:sd

UNITED STATES OF AMERICA
FEDERAL ENERGY REGULATORY COMMISSION

Stora Enso North America

101 FERC ¶ 62,196
Project No. 2536-057

ORDER MODIFYING AND AMENDING WATER QUALITY MONITORING PLAN

(Issued December 24, 2002)

On November 28, 2001, Stora Enso North America (SENA or licensee), licensee for the Little Quinnesec Falls Hydro Project, ¹ filed a request to amend its water quality monitoring plan concurrent with filing their 2001 annual monitoring report. The original water quality monitoring plan was approved by Order Approving Water Quality Monitoring Plan (1999 Order), ² filed pursuant to license article 406. The Little Quinnesec Falls Project is located on the Menominee River near the City of Niagara in Marinette County, Wisconsin and Dickinson County, Michigan.

BACKGROUND

The 1999 Order requires the licensee to monitor water quality parameters from May through September for two years. If, after two years, monitoring data suggests that water quality problems do not exist, the licensee, in consultation with the agencies, would pursue modifications or elimination of article 406 from the license.

LICENSEE'S PROPOSAL

After much consultation with the resource agencies, SENA now proposes to alter the frequency of water quality monitoring at the project site based upon an agency agreed-to timetable. Attached to its proposal, SENA submitted the 2001 water quality monitoring results, which will represent the start of a 20-year study.

The Study Scope: The monitoring station will remain located in the project tailrace, upstream of the SENA - Niagara Mill wastewater treatment discharge point. Continuous monitoring equipment will record on an hourly basis - water temperature, dissolved

¹ See 79 FERC ¶ 62,095 (issued May 7, 1997).

² See 88 FERC ¶ 62,002 (issued July 1, 1999).

oxygen (DO) concentration, and pH. The test parameters and monitoring schedule are consistent with the previous study.

Monitoring will occur during May through September. Monitoring commenced in 2001. The next monitoring year will occur in 2006, then at a frequency of every five years for a twenty-year period (2001, 2006, 2011, 2016, and 2021). This schedule reflects existing evidence from the two-year study and data gathered during relicensing of the project, which shows no water quality problems at the project, along with consultation with the U.S. Fish and Wildlife Service (FWS), Wisconsin Department of Natural Resources (WDNR), and Michigan Department of Natural Resources (MDNR). If no adverse water quality issues are observed during this twenty-year monitoring effort, the resource agencies agree to allow elimination of license article 406.

Low DO Events: If, during continuous monitoring, a low DO event is recorded, recordings at one-meter intervals will be taken throughout the water column in a deep part of the impoundment immediately upstream from the project. This measure is to determine if water entering the project is contributing to the event. The state and federal agencies will be notified by telephone or e-mail within five working days. The results of the profile sampling and any circumstances that may have caused the event will be reported to the resource agencies within thirty working days and summarized in the monitoring report to be filed by November 30.

If monitoring data supports the conclusions that the low DO event is related to the operation of the project, SENA will consult with the resource agencies on any revisions to the monitoring plan considered appropriate and approved by the Commission.

Quality Assurance Program: Continuous monitoring equipment will be calibrated periodically during the water quality monitoring period using appropriate methodology noted in "Standard Methods for the Examination of Water and Wastewater", 18th Edition: Temperature - Method 2550 B; Dissolved Oxygen - Method 4500-0 C; and pH - Method 4500 - H+.

Reporting: Data from the continuous monitoring will be electronically recorded and stored at SENA's Niagara Mill. The Commission, USFWS, WDNR, MDNR, and Michigan Department of Environmental Quality (MDEQ) will receive a report with supporting data no later than November 30 of the monitoring year (every five years). As noted above, the resource agencies will be notified of low DO events within five working days from the date of the occurrence, with the results of the profile sampling within thirty days.

Project No. 2536-057

3

AGENCY COMMENTS & LICENSEE'S RESPONSE

On November 3, 2000, the licensee provided the 2000 water quality monitoring report and requested agency comments on whether further sampling would be needed. By letter dated November 15, 2000, the MDNR reported there was an obvious lack of data, especially in the months of May, June, and July. MDNR recommends monitoring water temperature, DO, and pH in May, June, and July of 2001. By letter dated December 13, 2000, the WDNR supported all comments provided in the MDNR's November 15, 2000 letter.

SENA completed the recommended 2001 monitoring and provided the data, citing no water quality problems to the resource agencies, with the request to suspend future water quality monitoring based on the data. However, by letter dated September 13, 2001, the MDNR stated that article 406 should be retained in the license and that future water quality monitoring is necessary because to eliminate the monitoring too soon would be overly presumptuous. MDNR recommends that the frequency of water quality monitoring be reduced to every three to five years over the term of license to confirm that the project is being operated within state standards. MDNR says if water quality levels exceeding state standards are detected, SENA should develop a plan for remedial action, in consultation with the resource agencies.

By letter dated September 24, 2001, the FWS provided the same recommendations as the MDNR and WDNR provided in their September 13, and September 25, 2001 letters, respectively.

Subsequently, SENA recommended monitoring water quality parameters at the 2001 site in five years (2006) and thereafter monitor the tailwater every ten years up to year 2036. Again, by letters dated October 16, 2001, respectively, the WDNR and MDNR, rejected SENA's proposal to monitor every ten years and recommended monitoring every five years.

SENA has adopted the agencies recommendation to monitor water quality parameters every five years, starting in 2001, for the next twenty years. In return, the resource agencies agree that if no project-related water quality problems (DO, pH, temperature) are detected during this time period, then article 406 will be automatically eliminated for the balance of the license term.

Project No. 2536-057

4

DISCUSSION

Currently, the license expires in year 2037 with article 406 written with the intention to monitor water quality for the term of license. The resource agencies, however, concur with suspending water quality monitoring after 20 years (2021), if monitoring results indicate no problems. SENA should file water quality monitoring reports with the resource agencies by November 30 every five years for the next twenty years, with the next report due in 2006. The licensee should allow the agencies at least 30 days to review the report and provide their comments. The licensee should then file the report, including the agency comments, for Commission approval by January 30 of the following year.

The final monitoring report (due to the agencies by November 30, 2021) should include recommendations from the licensee on the need for future water quality monitoring and the filing of monitoring reports. The licensee should again allow the agencies at least 30 days to review the report and provide their comments and recommendations. If the licensee does not agree with an agency recommendation, it should include its reasons based on project-specific information. The final report should be filed with the Commission by January 30, 2022, and should include recommendations for Commission approval on the need for future water quality monitoring and the filing of monitoring reports.

The licensee's proposed plan will be adequate to monitor the project's compliance with state water quality standards and will adequately protect project water quality. Therefore, SENA's plan with the above stated modification should be approved.

The Director's Orders:

(A) The licensee's November 28, 2001 request to amend its water quality monitoring plan under article 406 of its license is approved as modified by paragraph (B) below.

(B) The licensee shall file water quality monitoring reports with the U.S. Fish and Wildlife Service (FWS), the Wisconsin Department of Natural Resources (WDNR), the Michigan Department of Natural Resources (MDNR), and the Michigan Department of Environmental Quality (MDEQ), by November 30 every five years for the next twenty years, with the next report due to the agencies in 2006. The licensee shall allow the consulted agencies at least 30 days to review the report and provide their comments. The licensee shall file the five-year reports, including the agency comments, with the Commission for approval, by January 30 of the following year, with the next report due to the Commission on January 30, 2007.

Project No. 2536-057

5

The final monitoring report (due to the agencies by November 30, 2021) shall include recommendations from the licensee on the need for future water quality monitoring and the filing of monitoring reports. The licensee shall allow the agencies at least 30 days to review the report and provide their comments and recommendations. If the licensee does not agree with an agency recommendation, it should include its reasons based on project-specific information. The final report shall be filed with the Commission by January 30, 2022, and shall include recommendations for Commission approval on the need for future water quality monitoring and the filing of monitoring reports.

(C) This order constitutes final agency action. Requests for rehearing by the Commission may be filed within 30 days of the date of issuance this order, pursuant to 18 C.F.R. § 385.713.

George H. Taylor
Chief, Biological Resources Branch
Division of Hydropower Administration
and Compliance

APPENDIX B:

Summary Tables and Graphs

**Little Quinnesec Falls Hydroelectric Dam, Niagara, WI
 Monthly Average, Minimum, Maximum, Standard Deviation, 2006 Monitoring**

Temperature (°C)	Average	Minimum	Maximum	Std Dev
April (28-30)	12.35	11.89	13.52	0.43
May	13.62	9.46	20.98	2.63
June	21.66	19.05	24.26	1.13
July	24.71	21.94	27.22	1.26
August	23.48	20.46	26.63	1.48
September	17.95	13.54	21.83	2.39
OVERALL	20.17	9.46	27.22	4.54

Dissolved Oxygen (mg/L)	Average	Minimum	Maximum	Std Dev
April (28-30)	10.42	9.29	11.39	0.63
May	8.50	6.52	10.52	0.96
June	6.68	4.08	8.57	0.98
July	7.12	5.63	7.91	0.33
August	7.14	6.08	8.63	0.50
September	7.91	6.74	9.78	0.52
OVERALL	7.52	4.08	11.39	1.02

pH (s.u.)	Average	Minimum	Maximum	Std Dev
April (28-30)	7.46	7.41	7.54	0.03
May	8.22	7.46	8.65	0.23
June	7.59	7.02	8.46	0.37
July	8.41	8.04	8.89	0.19
August	8.15	7.60	8.94	0.31
September	8.19	7.80	8.48	0.11
OVERALL	8.11	7.02	8.94	0.38

Note: By June 20, the DS3 unit had drifted out of calibration, resulting in unrealistically low DO readings compared to handheld meter readings taken during this time. Replacement of the DS3 unit on June 23 produced readings back in the range of the field meter.

**Little Quinnesec Falls Hydroelectric Dam, Niagara, WI
Weekly Minimums and Maximums, 2006 Monitoring**

Begin Date	End Date	Temp. (°C)		DO (mg/L)		pH (s.u.)	
		Max.	Min.	Max.	Min.	Max.	Min.
Apr 28*	Apr 30	13.52	11.89	11.39	9.29	7.54	7.75
May 1	May 7	14.43	11.64	10.52	8.60	8.34	7.46
May 8	May 14	14.99	9.48	10.20	8.01	8.65	7.75
May 15	May 21	13.98	9.64	10.08	8.27	8.35	7.79
May 22	May 28	18.43	12.33	8.58	6.60	8.58	8.08
May 29	Jun 4	22.77	17.65	8.57	5.94	8.57	7.02
Jun 5	Jun 11	22.95	19.36	7.52	6.73	7.54	7.18
Jun 12	Jun 18	22.89	19.05	7.09	5.69	7.47	7.13
Jun 19	Jun 25	24.16	21.42	7.84	4.08	8.15	7.12
Jun 26	Jul 2	24.26	21.30	8.09	6.81	8.32	7.91
Jul 3	Jul 9	24.50	22.43	7.91	6.77	8.39	8.06
Jul 10	Jul 16	25.98	21.94	7.77	6.51	8.54	8.15
Jul 17	Jul 23	26.78	24.08	7.81	6.36	8.76	8.30
Jul 24	Jul 30	26.80	24.10	7.39	6.24	8.79	8.37
Jul 31	Aug 6	27.22	24.13	7.86	5.63	8.94	8.30
Aug 7	Aug 13	25.57	23.10	7.64	6.16	8.88	7.63
Aug 14	Aug 20	24.90	22.24	8.08	6.50	8.27	7.60
Aug 21	Aug 27	23.73	20.60	8.09	6.64	8.35	7.76
Aug 28	Sep 3	22.40	20.39	8.63	6.69	8.48	7.83
Sep 4	Sep 10	21.83	18.64	8.09	6.74	8.44	7.80
Sep 11	Sep 17	18.83	17.37	8.13	7.02	8.30	7.96
Sep 18	Sep 24	18.66	15.08	8.80	7.24	8.35	8.03
Sep 25	Sep 30**	15.92	13.54	9.78	8.00	8.36	8.12
OVERALL		27.22	9.46	11.39	4.08	8.94	7.02

Note: By June 20, the DS3 unit had drifted out of calibration, resulting in unrealistically low DO readings compared to handheld meter readings taken during this time. Replacement of the DS3 unit on June 23 produced readings back in the range of the field meter.

Standards:

Temp. < 32°C (89°F)


DO > 5.0 mg/L


pH = 6.0 -9.0

* The first period (April 28 to April 30) are not a full 7 days.


** The last period includes a total of 6 days.

Dissolved Oxygen, Temperature Below Little Quinnebec Falls Hydroelectric Dam, Niagara, WI April 2006

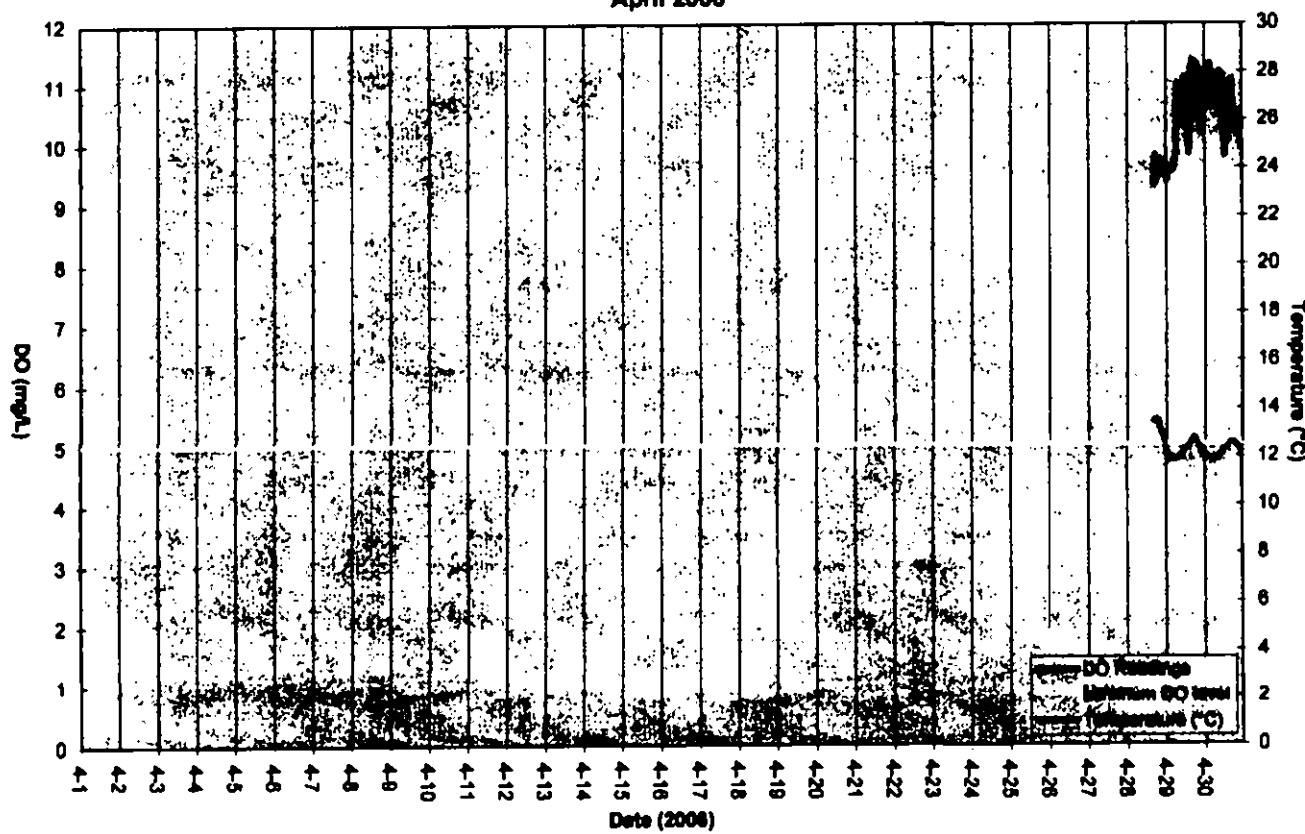


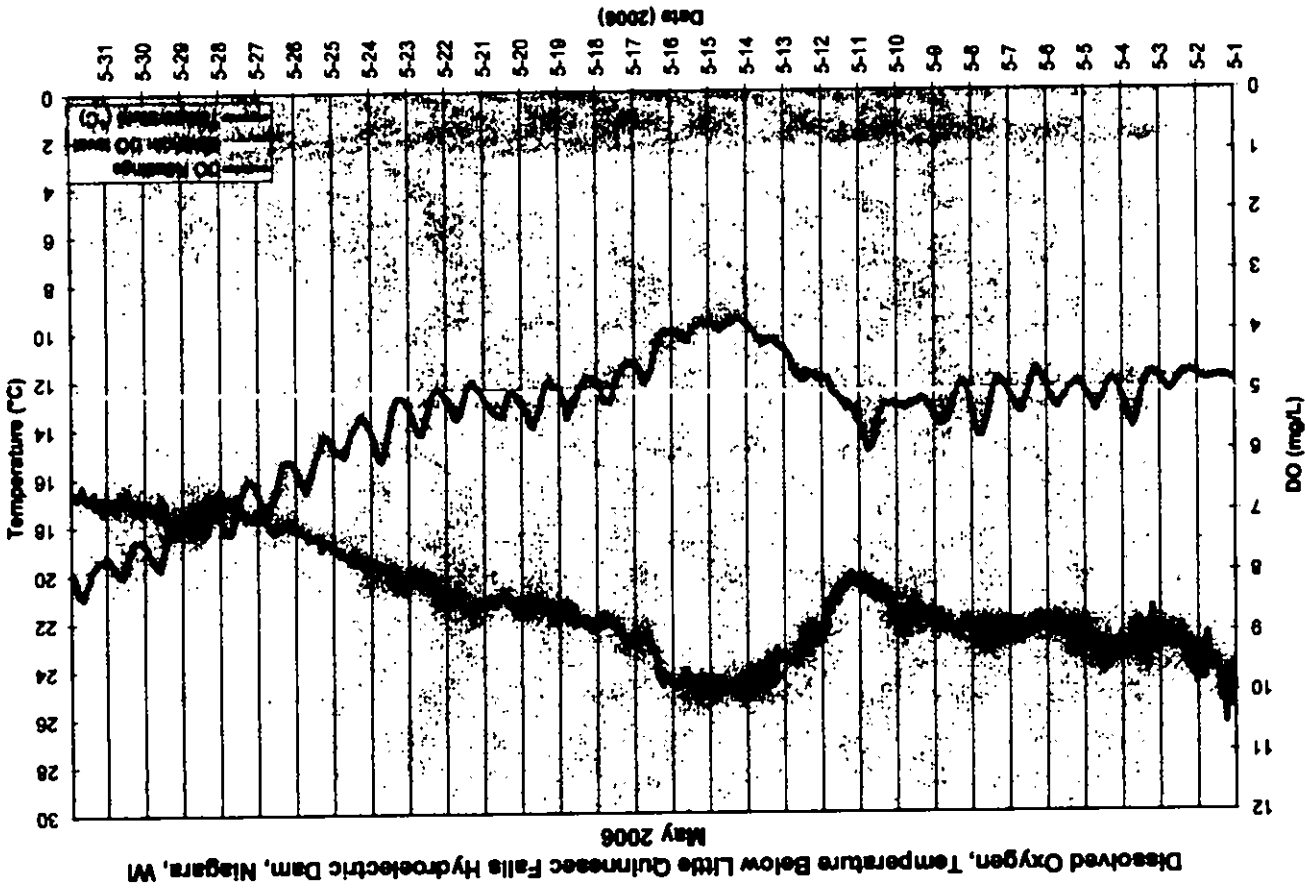


Dissolved Oxygen, Temperature Below Little Quinnesec Falls Hydroelectric Dam, Niagara, WI June 2006

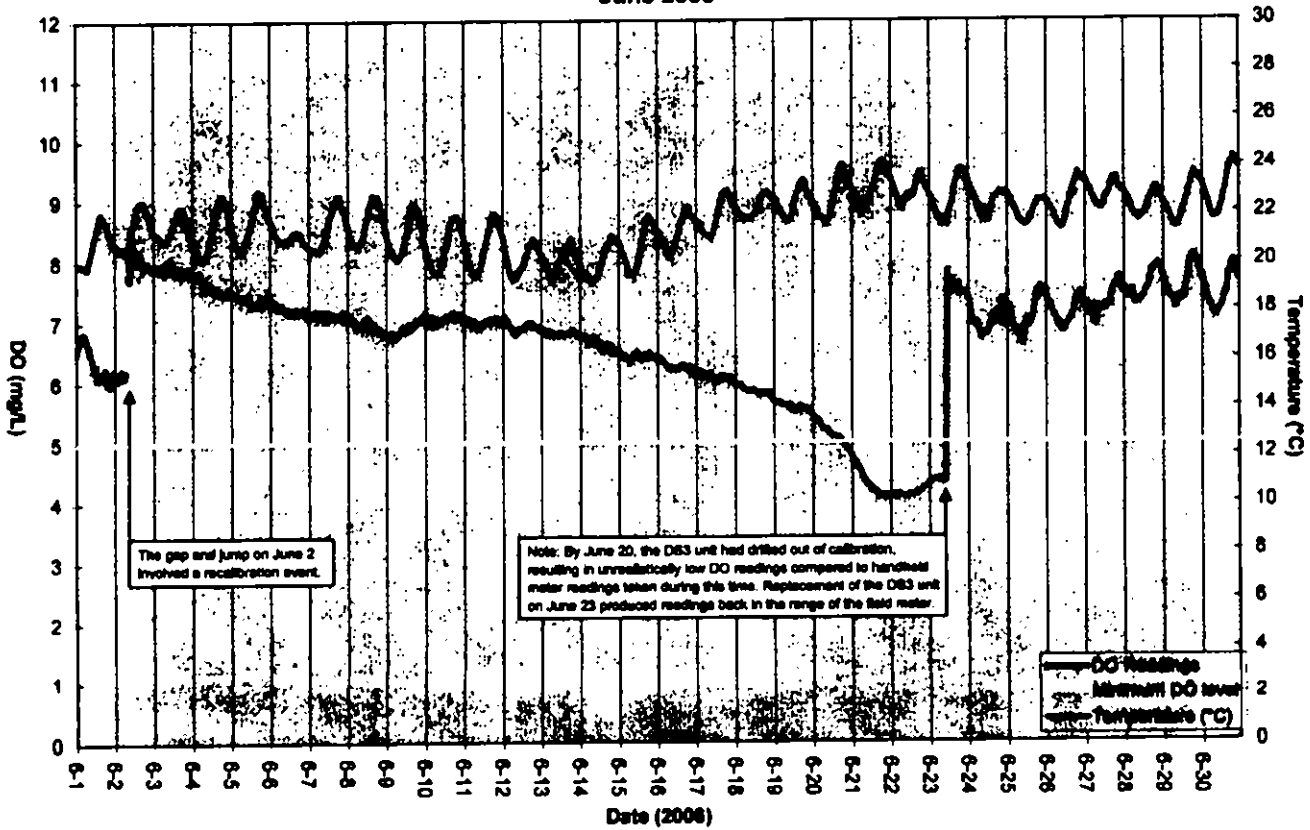


Dissolved Oxygen, Temperature Below Little Quinnesec Falls Hydroelectric Dam, Niagara, WI
July 2006

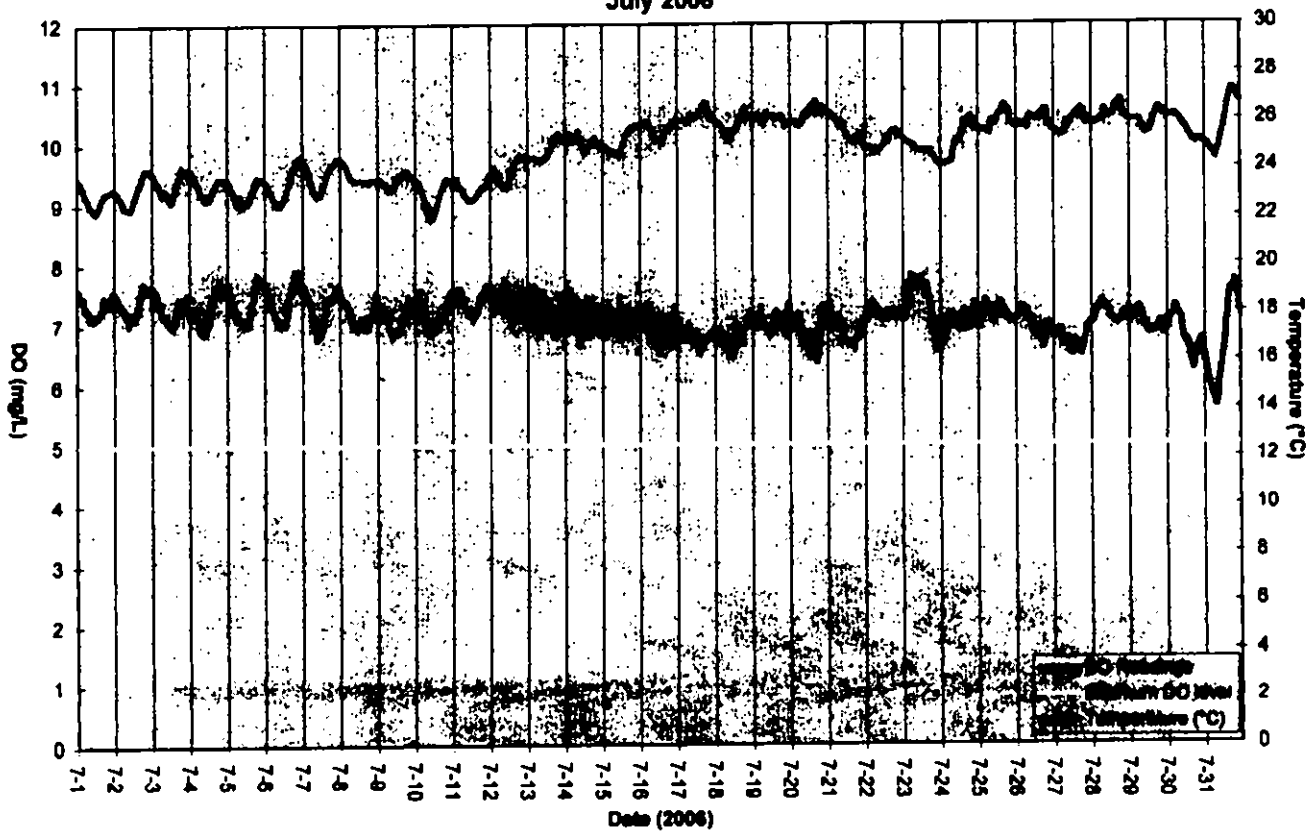


Dissolved Oxygen, Temperature Below Little Quinneec Falls Hydroelectric Dam, Niagara, WI August 2006

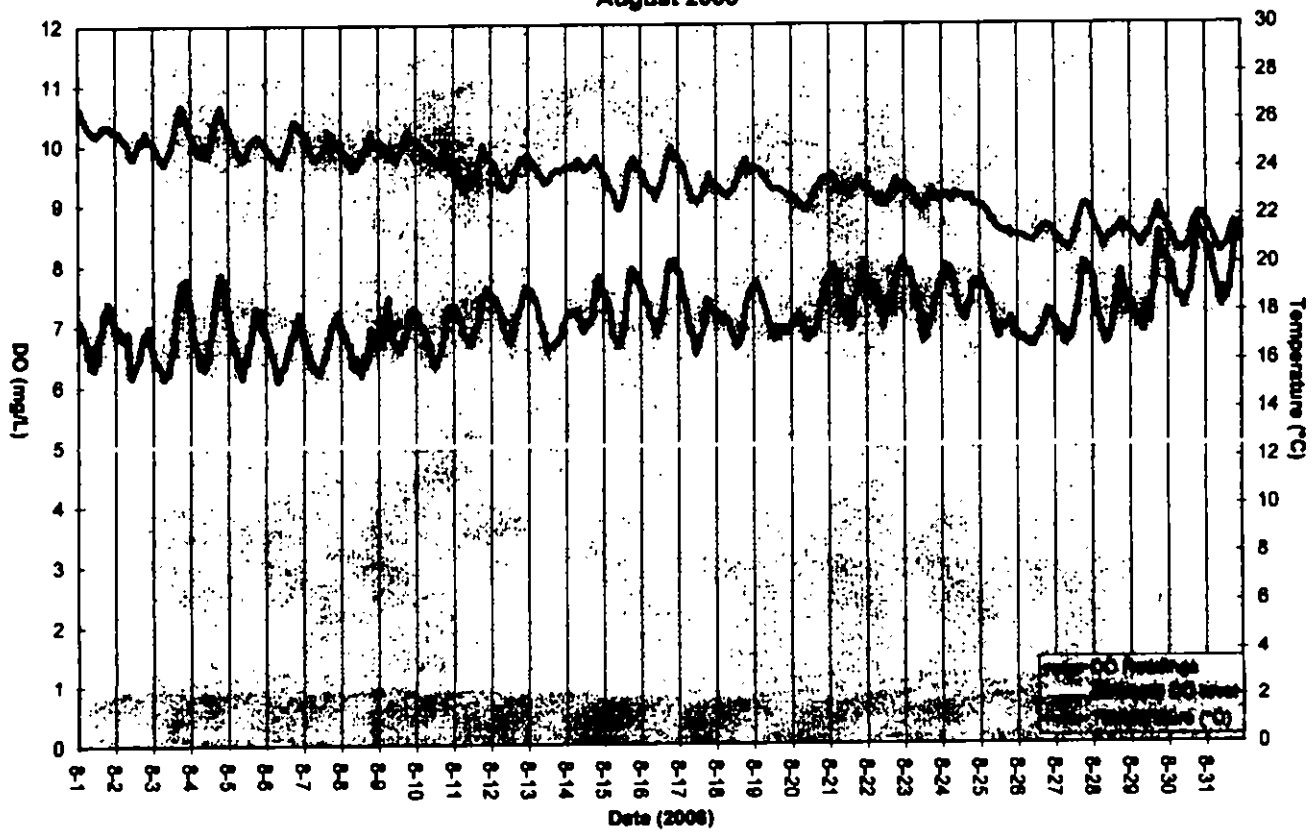

Dissolved Oxygen, Temperature Below Little Quinnesec Falls Hydroelectric Dam, Niagara, WI
September 2006

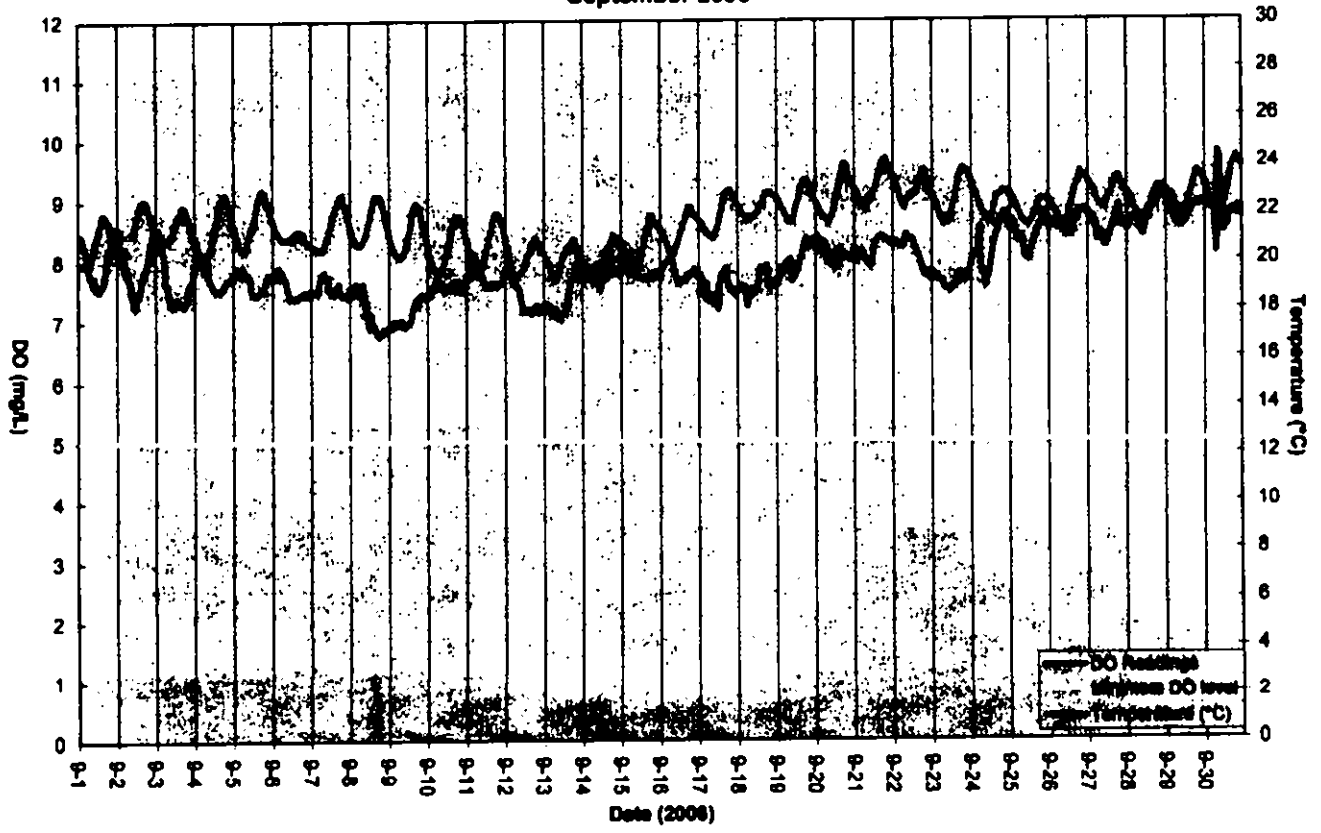

**pH Below Little Quinnesec Falls Hydroelectric Dam, Niagara, WI
Entire Monitoring Run (April 28-September 30, 2006)**

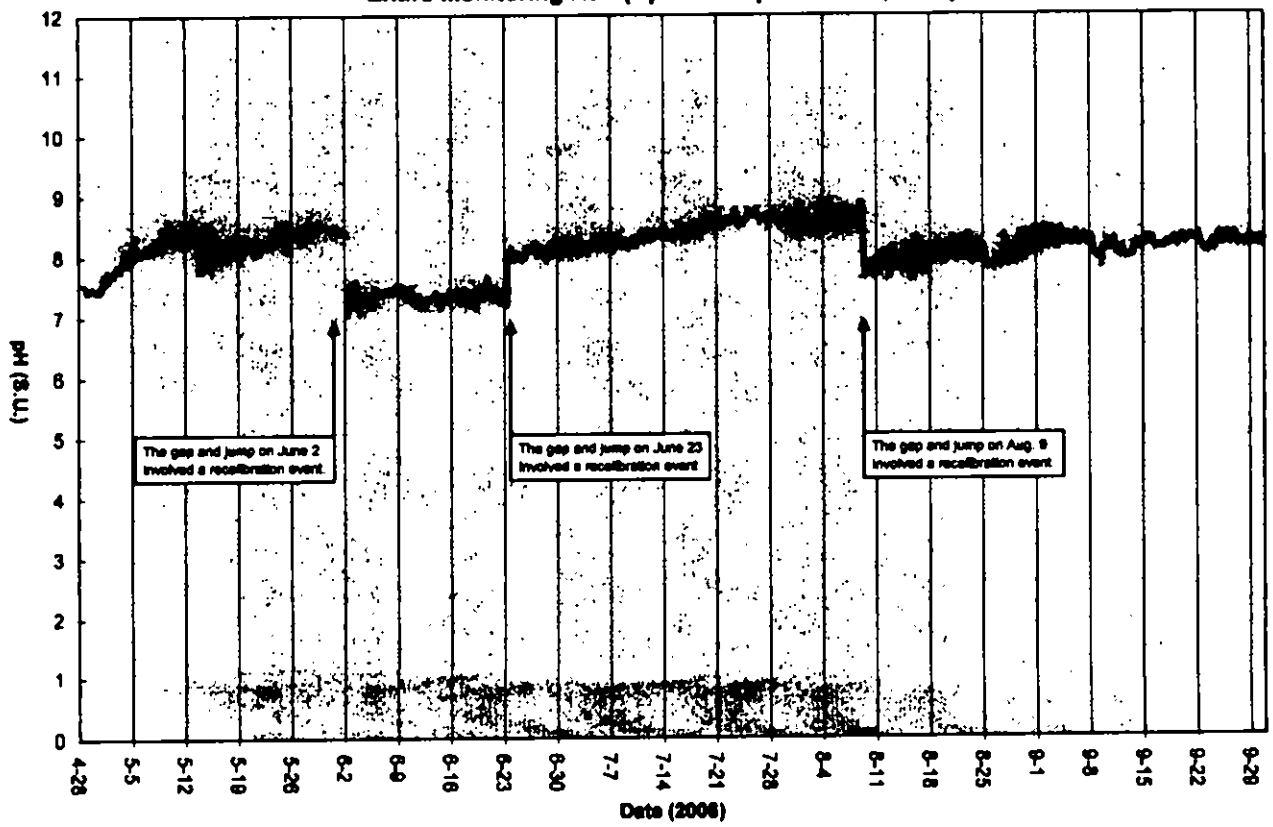

APPENDIX C:

Complete 2006 Results

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)	Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
4-28-2006	163000	13.45	7.54	9.29	5-1-2006	13000	12.1	7.49	10.08
4-28-2006	173000	13.52	7.53	9.81	5-1-2006	23000	12.12	7.46	9.54
4-28-2006	183000	13.52	7.53	9.36	5-1-2006	33000	12.03	7.55	10.26
4-28-2006	193000	13.47	7.53	9.64	5-1-2006	43000	12.03	7.53	10.18
4-28-2006	203000	13.17	7.52	9.74	5-1-2006	53000	12	7.53	9.59
4-28-2006	213000	12.92	7.51	9.81	5-1-2006	63000	11.95	7.69	10.52
4-28-2006	223000	12.68	7.5	9.68	5-1-2006	73000	11.97	7.54	9.81
4-28-2006	233000	12.43	7.49	9.52	5-1-2006	83000	12.05	7.57	10.02
4-29-2006	3000	12.25	7.48	9.4	5-1-2006	93000	11.95	7.54	10.17
4-29-2006	13000	12.1	7.47	9.48	5-1-2006	103000	11.97	7.55	9.79
4-29-2006	23000	12	7.46	9.81	5-1-2006	113000	11.95	7.56	9.57
4-29-2006	33000	11.95	7.42	9.53	5-1-2006	123000	12.02	7.58	9.62
4-29-2006	43000	11.93	7.43	9.54	5-1-2006	133000	12	7.58	9.58
4-29-2006	53000	11.92	7.43	9.59	5-1-2006	143000	12.02	7.59	9.43
4-29-2006	63000	11.89	7.42	9.95	5-1-2006	153000	12.07	7.58	9.65
4-29-2006	73000	11.9	7.42	10.99	5-1-2006	163000	12.08	7.59	9.57
4-29-2006	83000	11.92	7.46	10.29	5-1-2006	173000	12.12	7.61	9.48
4-29-2006	93000	11.98	7.43	10.83	5-1-2006	183000	12.1	7.76	9.04
4-29-2006	103000	12.08	7.44	10.92	5-1-2006	193000	12.1	7.62	9.16
4-29-2006	113000	12.25	7.45	10.81	5-1-2006	203000	12.08	7.64	9.81
4-29-2006	123000	12.33	7.46	10.87	5-1-2006	213000	12.05	7.73	9.61
4-29-2006	133000	12.4	7.45	10.87	5-1-2006	223000	12	7.74	9.38
4-29-2006	143000	12.46	7.48	9.82	5-1-2006	233000	11.95	7.87	9.41
4-29-2006	153000	12.53	7.48	10.54	5-2-2006	3000	11.89	7.66	9.44
4-29-2006	163000	12.64	7.47	11.39	5-2-2006	13000	11.87	7.67	9.86
4-29-2006	173000	12.76	7.48	11.07	5-2-2006	23000	11.84	7.68	9.3
4-29-2006	183000	12.64	7.47	11.26	5-2-2006	33000	11.82	7.68	9.71
4-29-2006	193000	12.51	7.49	11.32	5-2-2006	43000	11.8	7.69	9.44
4-29-2006	203000	12.44	7.49	10.44	5-2-2006	53000	11.79	7.69	9.52
4-29-2006	213000	12.33	7.47	11.02	5-2-2006	63000	11.77	7.68	9.15
4-29-2006	223000	12.26	7.48	10.15	5-2-2006	73000	11.8	7.68	9.46
4-29-2006	233000	12.2	7.47	10.86	5-2-2006	83000	11.9	7.68	9.52
4-30-2006	3000	12.07	7.46	10.94	5-2-2006	93000	11.8	7.73	9.19
4-30-2006	13000	11.98	7.45	10.91	5-2-2006	103000	11.97	7.69	8.91
4-30-2006	23000	11.93	7.45	10.95	5-2-2006	113000	11.89	7.7	9.19
4-30-2006	33000	11.92	7.46	11.33	5-2-2006	123000	12.14	7.73	9.28
4-30-2006	43000	11.9	7.44	10.59	5-2-2006	133000	12.07	7.69	9.13
4-30-2006	53000	11.9	7.43	11.02	5-2-2006	143000	12.23	7.72	9.22
4-30-2006	63000	11.89	7.43	11.11	5-2-2006	153000	12.43	7.71	9.09
4-30-2006	73000	11.89	7.43	10.7	5-2-2006	163000	12.41	7.72	9.1
4-30-2006	83000	11.89	7.42	11.11	5-2-2006	173000	12.51	7.76	9.07
4-30-2006	93000	12.02	7.44	11.2	5-2-2006	183000	12.56	7.75	9.24
4-30-2006	103000	12.1	7.44	11.11	5-2-2006	193000	12.53	7.8	8.98
4-30-2006	113000	12.23	7.45	10.84	5-2-2006	203000	12.44	7.78	8.95
4-30-2006	123000	12.31	7.46	9.78	5-2-2006	213000	12.3	7.8	9.26
4-30-2006	133000	12.36	7.46	10.93	5-2-2006	223000	12.21	7.78	9.09
4-30-2006	143000	12.44	7.47	10.02	5-2-2006	233000	12.12	7.78	9.09
4-30-2006	153000	12.53	7.48	10.61	5-3-2006	3000	11.95	7.78	8.09
4-30-2006	163000	12.58	7.44	11.08	5-3-2006	13000	11.9	7.79	8.92
4-30-2006	173000	12.59	7.41	10.45	5-3-2006	23000	11.95	7.85	8.92
4-30-2006	183000	12.51	7.44	10.19	5-3-2006	33000	11.89	7.79	8.93
4-30-2006	193000	12.46	7.45	10.48	5-3-2006	43000	11.8	7.8	9.03
4-30-2006	203000	12.41	7.45	10.34	5-3-2006	53000	11.77	7.8	8.6
4-30-2006	213000	12.37	7.47	10.54	5-3-2006	63000	11.8	7.8	9.35
4-30-2006	223000	12.26	7.5	10.14	5-3-2006	73000	11.8	7.81	9.01
4-30-2006	233000	12.21	7.46	9.88	5-3-2006	83000	12.03	7.85	9.65
5-1-2006	3000	12.13	7.51	9.9	5-3-2006	93000	12.02	7.77	9.22

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)	Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
5-3-2006	103000	12.25	7.82	9.22	5-5-2006	193000	13.14	8.04	9.05
5-3-2006	113000	12.51	7.83	9.46	5-5-2006	203000	13	8.09	8.79
5-3-2006	123000	12.72	7.83	9.5	5-5-2006	213000	12.84	8.09	8.8
5-3-2006	133000	13.02	7.83	9.1	5-5-2006	223000	12.71	8.06	9.03
5-3-2006	143000	13.43	7.84	8.84	5-5-2006	233000	12.83	8.06	9
5-3-2006	153000	13.73	7.86	9.04	5-6-2006	3000	12.41	8.06	9
5-3-2006	163000	13.83	7.88	8.83	5-6-2006	13000	12.25	8.07	8.73
5-3-2006	173000	14.03	7.9	8.9	5-6-2006	23000	12.13	8.05	8.88
5-3-2006	183000	13.91	7.91	9.2	5-6-2006	33000	11.95	8.07	8.92
5-3-2006	193000	13.76	7.91	9.13	5-6-2006	43000	11.87	8.05	8.75
5-3-2006	203000	13.6	7.95	9.2	5-6-2006	53000	11.82	8.05	8.87
5-3-2006	213000	13.33	7.91	9.4	5-6-2006	63000	11.66	8.06	8.82
5-3-2006	223000	13.1	7.99	9.31	5-6-2006	73000	11.64	8.03	8.74
5-3-2006	233000	12.91	7.93	9.44	5-6-2006	83000	11.74	8.04	9
5-4-2006	3000	12.81	7.93	9.39	5-6-2006	93000	11.9	8.06	9.03
5-4-2006	13000	12.83	7.92	9.06	5-6-2006	103000	12.07	8.07	8.86
5-4-2006	23000	12.38	8.11	9.47	5-6-2006	113000	12.38	8.07	9.07
5-4-2006	33000	12.26	7.93	9.29	5-6-2006	123000	12.58	8.08	8.99
5-4-2006	43000	12.18	7.93	9.17	5-6-2006	133000	12.79	8.09	8.93
5-4-2006	53000	12.13	7.93	9.35	5-6-2006	143000	12.99	8.1	8.87
5-4-2006	63000	12.12	7.84	9.18	5-6-2006	153000	13.2	8.11	8.99
5-4-2006	73000	12.05	7.89	9.36	5-6-2006	163000	13.38	8.11	9.2
5-4-2006	83000	12.1	7.89	9.38	5-6-2006	173000	13.43	8.15	8.88
5-4-2006	93000	12.23	7.87	9.6	5-6-2006	183000	13.37	8.12	9.16
5-4-2006	103000	12.4	7.9	9.58	5-6-2006	193000	13.24	8.13	9.11
5-4-2006	113000	12.53	8	9.26	5-6-2006	203000	13.2	8.11	9.19
5-4-2006	123000	12.72	7.92	9.69	5-6-2006	213000	13.04	8.14	9
5-4-2006	133000	12.91	8	9.19	5-6-2006	223000	12.87	8.16	8.98
5-4-2006	143000	12.92	7.96	9.19	5-6-2006	233000	12.76	8.14	8.95
5-4-2006	153000	13.05	7.95	9.41	5-7-2006	3000	12.64	8.11	8.85
5-4-2006	163000	13.24	7.98	9.18	5-7-2006	13000	12.49	8.15	9.18
5-4-2006	173000	13.38	7.98	9.36	5-7-2006	23000	12.44	8.13	8.78
5-4-2006	183000	13.22	7.99	9.4	5-7-2006	33000	12.31	8.14	9.05
5-4-2006	193000	13.05	8.07	9.38	5-7-2006	43000	12.21	8.12	8.86
5-4-2006	203000	12.84	8.02	9.2	5-7-2006	53000	12.15	8.13	9.11
5-4-2006	213000	12.86	8.02	9.18	5-7-2006	63000	12.08	8.13	8.97
5-4-2006	223000	12.68	8.04	8.94	5-7-2006	73000	11.98	8.11	9.03
5-4-2006	233000	12.59	8.15	8.78	5-7-2006	83000	12.05	8.1	9.07
5-5-2006	3000	12.56	8.05	9.05	5-7-2006	93000	12.28	8.12	8.93
5-5-2006	13000	12.4	8.02	9.1	5-7-2006	103000	12.35	8.12	8.88
5-5-2006	23000	12.36	8.19	8.83	5-7-2006	113000	12.71	8.15	9.19
5-5-2006	33000	12.28	8.02	9.4	5-7-2006	123000	12.99	8.15	9.36
5-5-2006	43000	12.25	8.06	8.87	5-7-2006	133000	13.42	8.12	9.17
5-5-2006	53000	12.23	8.06	9.15	5-7-2006	143000	13.74	8.12	9.01
5-5-2006	63000	12.26	8.02	9.3	5-7-2006	153000	13.93	8.23	9.35
5-5-2006	73000	12.28	7.99	9.09	5-7-2006	163000	14.13	8.12	9.08
5-5-2006	83000	12.33	7.99	9.3	5-7-2006	173000	14.36	8.16	9.14
5-5-2006	93000	12.43	8.01	9	5-7-2006	183000	14.41	8.17	9
5-5-2006	103000	12.43	8.02	8.92	5-7-2006	193000	14.43	8.15	8.99
5-5-2006	113000	12.61	8.34	8.93	5-7-2006	203000	14.32	8.23	8.87
5-5-2006	123000	Data missing due to site visit and check			5-7-2006	213000	14.21	8.21	9.17
5-5-2006	133000	12.74	8.06	8.83	5-7-2006	223000	13.98	8.12	9.26
5-5-2006	143000	12.86	8.1	8.89	5-7-2006	233000	13.87	8.24	8.97
5-5-2006	153000	12.92	8.11	8.85	5-8-2006	3000	13.22	8.21	8.93
5-5-2006	163000	13.09	8.13	8.72	5-8-2006	13000	12.91	8.19	8.92
5-5-2006	173000	13.25	8.16	8.99	5-8-2006	23000	12.64	8.09	8.86
5-5-2006	183000	13.19	8.11	9.04	5-8-2006	33000	12.48	8.2	8.93

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
5-8-2006	43000	12.33	8.27	8.98
5-8-2006	53000	12.2	8.26	8.75
5-8-2006	63000	12.2	8.24	8.94
5-8-2006	73000	12.15	8.22	8.91
5-8-2006	83000	12.25	8.16	9.12
5-8-2006	93000	12.4	8.17	8.96
5-8-2006	103000	12.59	8.16	9
5-8-2006	113000	12.77	8.2	8.99
5-8-2006	123000	13.05	8.23	9.04
5-8-2006	133000	13.33	8.22	8.93
5-8-2006	143000	13.5	8.28	8.86
5-8-2006	153000	13.7	8.3	8.79
5-8-2006	163000	13.73	8.3	8.81
5-8-2006	173000	13.75	8.29	9
5-8-2006	183000	13.83	8.3	8.95
5-8-2006	193000	13.9	8.29	8.79
5-8-2006	203000	13.93	8.23	8.8
5-8-2006	213000	13.75	8.47	8.68
5-8-2006	223000	13.68	8.34	8.86
5-8-2006	233000	13.58	8.45	8.97
5-9-2006	3000	13.45	8.34	8.95
5-9-2006	13000	13.37	8.47	8.81
5-9-2006	23000	13.3	8.21	8.64
5-9-2006	33000	13.19	8.09	8.7
5-9-2006	43000	13.05	8.19	8.77
5-9-2006	53000	12.96	8.29	8.68
5-9-2006	63000	12.92	8.16	8.73
5-9-2006	73000	12.82	8.26	8.81
5-9-2006	83000	12.87	8.21	8.79
5-9-2006	93000	12.84	8.3	8.81
5-9-2006	103000	12.94	8.27	8.82
5-9-2006	113000	13.05	8.24	8.54
5-9-2006	123000	13	8.29	8.79
5-9-2006	133000	13.02	8.31	8.56
5-9-2006	143000	13.12	8.26	8.47
5-9-2006	153000	12.99	8.34	8.84
5-9-2006	163000	13.1	8.36	8.49
5-9-2006	173000	13.2	8.39	8.85
5-9-2006	183000	13.17	8.38	8.67
5-9-2006	193000	13.25	8.36	8.85
5-9-2006	203000	13.17	8.6	9.06
5-9-2006	213000	13.12	8.33	9.02
5-9-2006	223000	13.19	8.41	9.05
5-9-2006	233000	13.14	8.31	8.86
5-10-2006	3000	13.14	8.57	9.06
5-10-2006	13000	13.17	8.21	8.81
5-10-2006	23000	13.05	8.28	8.82
5-10-2006	33000	13.05	8.33	8.74
5-10-2006	43000	13.07	8.27	8.82
5-10-2006	53000	13.09	8.32	8.55
5-10-2006	63000	13.05	8.36	8.46
5-10-2006	73000	13.02	8.35	8.42
5-10-2006	83000	13.05	8.43	8.46
5-10-2006	93000	13.2	8.41	8.27
5-10-2006	103000	13.29	8.37	8.35
5-10-2006	113000	13.45	8.24	8.32
5-10-2006	123000	13.63	8.34	8.34

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
5-10-2006	133000	14.03	8.21	8.45
5-10-2006	143000	14.54	8.37	8.47
5-10-2006	153000	14.74	8.29	8.23
5-10-2006	163000	14.86	8.33	8.42
5-10-2006	173000	14.89	8.28	8.14
5-10-2006	183000	14.99	8.33	8.18
5-10-2006	193000	14.88	8.27	8.15
5-10-2006	203000	14.48	8.25	8.32
5-10-2006	213000	14.29	8.36	8.08
5-10-2006	223000	14.1	8.29	8.09
5-10-2006	233000	13.98	8.38	8.11
5-11-2006	3000	13.78	8.35	8.1
5-11-2006	13000	13.67	8.24	8.2
5-11-2006	23000	13.55	8.29	8.23
5-11-2006	33000	13.42	8.34	8.2
5-11-2006	43000	13.29	8.38	8.17
5-11-2006	53000	13.25	8.26	8.16
5-11-2006	63000	13.17	8.38	8.01
5-11-2006	73000	12.99	8.39	8.17
5-11-2006	83000	13.27	8.38	8.11
5-11-2006	93000	13.15	8.3	8.31
5-11-2006	103000	12.99	8.43	8.22
5-11-2006	113000	12.86	8.34	8.24
5-11-2006	123000	12.86	8.4	8.35
5-11-2006	133000	12.74	8.38	8.25
5-11-2006	143000	12.59	8.42	8.52
5-11-2006	153000	12.69	8.38	8.26
5-11-2006	163000	12.59	8.45	8.4
5-11-2006	173000	12.53	8.29	8.4
5-11-2006	183000	12.51	8.28	8.67
5-11-2006	193000	12.16	8.43	8.54
5-11-2006	203000	12	8.41	8.49
5-11-2006	213000	12.05	8.37	8.83
5-11-2006	223000	11.97	8.42	9
5-11-2006	233000	11.93	8.35	9.04
5-12-2006	3000	12.1	8.3	9.17
5-12-2006	13000	12.08	8.31	9.02
5-12-2006	23000	11.97	8.34	9.06
5-12-2006	33000	12.03	8.3	8.9
5-12-2006	43000	11.8	8.36	9.19
5-12-2006	53000	11.87	8.35	9.05
5-12-2006	63000	11.77	8.33	9.09
5-12-2006	73000	11.75	8.25	9.07
5-12-2006	83000	11.82	8.28	9.3
5-12-2006	93000	11.75	8.24	9.36
5-12-2006	103000	12	8.23	9.15
5-12-2006	113000	12.08	8.35	8.98
5-12-2006	123000	11.93	8.57	8.92
5-12-2006	133000	12.08	8.44	9.06
5-12-2006	143000	11.85	8.57	9.2
5-12-2006	153000	11.72	8.52	9.43
5-12-2006	163000	11.89	8.44	9.57
5-12-2006	173000	11.51	8.46	9.35
5-12-2006	183000	11.57	8.46	9.45
5-12-2006	193000	11.33	8.37	9.51
5-12-2006	203000	11.11	8.36	9.52
5-12-2006	213000	11.05	8.5	9.46

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)	Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
5-12-2006	223000	10.92	8.47	9.49	5-15-2006	73000	9.72	7.79	9.79
5-12-2006	233000	10.9	8.4	9.5	5-15-2006	83000	9.79	7.92	9.82
5-13-2006	3000	10.74	8.65	9.44	5-15-2006	93000	9.79	7.92	9.96
5-13-2006	13000	10.77	8.64	9.44	5-15-2006	103000	9.87	8.11	9.85
5-13-2006	23000	10.65	8.55	9.36	5-15-2006	113000	9.95	8.12	9.92
5-13-2006	33000	10.65	8.56	9.46	5-15-2006	123000	10.11	8.13	9.85
5-13-2006	43000	10.52	8.55	9.46	5-15-2006	133000	10.18	8.14	9.95
5-13-2006	53000	10.56	8.49	9.26	5-15-2006	143000	10.45	8.15	9.71
5-13-2006	63000	10.44	8.49	9.65	5-15-2006	153000	10.41	8.08	9.6
5-13-2006	73000	10.38	8.49	9.88	5-15-2006	163000	10.39	8.06	9.62
5-13-2006	83000	10.36	8.44	9.86	5-15-2006	173000	10.36	8.01	9.83
5-13-2006	93000	10.33	8.43	9.76	5-15-2006	183000	10.31	7.83	9.82
5-13-2006	103000	10.43	8.38	9.37	5-15-2006	193000	10.25	7.99	9.74
5-13-2006	113000	10.49	8.35	9.84	5-15-2006	203000	10.13	7.96	9.87
5-13-2006	123000	10.43	8.4	9.62	5-15-2006	213000	10.11	8.09	9.93
5-13-2006	133000	10.54	8.3	9.97	5-15-2006	223000	10.03	8.17	9.87
5-13-2006	143000	10.59	8.24	9.58	5-15-2006	233000	10.02	8.09	9.91
5-13-2006	153000	10.43	8.24	9.82	5-16-2006	3000	10.03	8.05	9.87
5-13-2006	163000	10.43	8.05	9.81	5-16-2006	13000	10.03	8.13	9.75
5-13-2006	173000	10.29	8.15	9.7	5-16-2006	23000	10.08	8.11	9.78
5-13-2006	183000	10.2	8.1	9.8	5-16-2006	33000	10.03	8.1	9.81
5-13-2006	193000	10.03	7.9	9.89	5-16-2006	43000	10.07	8.11	9.7
5-13-2006	203000	9.95	7.79	10.06	5-16-2006	53000	10.03	8.09	9.82
5-13-2006	213000	9.97	7.83	9.86	5-16-2006	63000	10.07	8.18	9.88
5-13-2006	223000	9.84	7.76	10.04	5-16-2006	73000	10.11	8.25	9.82
5-13-2006	233000	9.84	7.75	9.58	5-16-2006	83000	10.39	8.21	9.75
5-14-2006	3000	9.7	8.04	10.14	5-16-2006	93000	10.41	8.24	9.72
5-14-2006	13000	9.64	7.76	10.02	5-16-2006	103000	10.8	8.22	9.42
5-14-2006	23000	9.62	7.82	10.2	5-16-2006	113000	10.92	8.25	9.25
5-14-2006	33000	9.56	8.13	9.81	5-16-2006	123000	11.26	8.25	9.27
5-14-2006	43000	9.51	7.84	9.94	5-16-2006	133000	11.59	8.25	9.23
5-14-2006	53000	9.46	7.91	10.11	5-16-2006	143000	11.74	8.11	9.28
5-14-2006	63000	9.49	7.92	10.09	5-16-2006	153000	11.95	8.19	8.99
5-14-2006	73000	9.48	7.85	10.01	5-16-2006	163000	11.98	8.27	9.17
5-14-2006	83000	9.51	7.83	9.93	5-16-2006	173000	12.15	8.23	8.96
5-14-2006	93000	9.64	7.79	10.03	5-16-2006	183000	12.15	8.18	9.06
5-14-2006	103000	9.61	7.79	9.91	5-16-2006	193000	11.97	8.19	9.14
5-14-2006	113000	9.7	8.17	9.94	5-16-2006	203000	11.59	8.28	9.14
5-14-2006	123000	9.7	8.25	9.95	5-16-2006	213000	11.47	8.24	9.02
5-14-2006	133000	9.77	8.4	9.97	5-16-2006	223000	11.46	8.22	9.09
5-14-2006	143000	9.82	8.45	9.96	5-16-2006	233000	11.26	8.16	9.24
5-14-2006	153000	9.85	8.45	10	5-17-2006	3000	11.36	8.21	9.01
5-14-2006	163000	9.9	8.46	9.9	5-17-2006	13000	11.36	8.21	9.09
5-14-2006	173000	10	8.45	9.83	5-17-2006	23000	11.29	8.22	9.06
5-14-2006	183000	9.93	8.47	9.79	5-17-2006	33000	11.38	8.21	9.06
5-14-2006	193000	9.86	8.55	10.06	5-17-2006	43000	11.28	8.18	9.23
5-14-2006	203000	9.87	8.41	10.03	5-17-2006	53000	11.33	8.19	9.2
5-14-2006	213000	9.75	8.43	10	5-17-2006	63000	11.36	8.2	9.1
5-14-2006	223000	9.7	8.36	9.92	5-17-2006	73000	11.47	8.13	9.07
5-14-2006	233000	9.69	8.34	9.98	5-17-2006	83000	11.57	8.13	9.05
5-15-2006	3000	9.72	8.28	9.84	5-17-2006	93000	11.7	7.96	8.91
5-15-2006	13000	9.72	8.24	10.03	5-17-2006	103000	11.9	8.13	8.91
5-15-2006	23000	9.67	8.2	9.95	5-17-2006	113000	12	8.23	8.99
5-15-2006	33000	9.67	8.06	10.08	5-17-2006	123000	12.2	8.13	8.91
5-15-2006	43000	9.7	7.97	9.89	5-17-2006	133000	12.41	8.23	8.86
5-15-2006	53000	9.66	8.15	10.08	5-17-2006	143000	12.71	8.05	8.9
5-15-2006	63000	9.64	7.87	10.03	5-17-2006	153000	12.94	8.26	8.87

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
5-17-2006	163000	12.94	8.03	8.73
5-17-2006	173000	12.89	8.1	8.86
5-17-2006	183000	12.89	8	8.77
5-17-2006	193000	12.91	8.2	8.86
5-17-2006	203000	12.72	8.23	8.73
5-17-2006	213000	12.43	8.21	8.86
5-17-2006	223000	12.3	8.21	8.85
5-17-2006	233000	12.21	8.28	8.93
5-18-2006	3000	12.21	8.18	8.88
5-18-2006	13000	12.1	8.24	8.96
5-18-2006	23000	12.08	8.28	8.96
5-18-2006	33000	11.93	8.28	8.97
5-18-2006	43000	11.9	8.28	8.94
5-18-2006	53000	11.92	8.28	8.82
5-18-2006	63000	11.87	8.24	8.84
5-18-2006	73000	11.87	8.28	8.9
5-18-2006	83000	12.31	8.24	8.73
5-18-2006	93000	12.31	8.25	8.85
5-18-2006	103000	12.23	8.25	8.83
5-18-2006	113000	12.48	8.28	8.79
5-18-2006	123000	12.71	8.2	8.81
5-18-2006	133000	12.58	8.14	8.86
5-18-2006	143000	13.04	8.27	8.56
5-18-2006	153000	12.77	8.3	8.84
5-18-2006	163000	13.09	8.29	8.71
5-18-2006	173000	13.25	8.28	8.58
5-18-2006	183000	13.53	8.03	8.56
5-18-2006	193000	13.6	8.03	8.48
5-18-2006	203000	12.97	8.12	8.59
5-18-2006	213000	12.94	8.05	8.47
5-18-2006	223000	12.61	8.03	8.69
5-18-2006	233000	12.43	8.08	8.72
5-19-2006	3000	12.36	7.97	8.71
5-19-2006	13000	12.26	7.96	8.83
5-19-2006	23000	12.3	8.03	8.72
5-19-2006	33000	12.31	7.94	8.7
5-19-2006	43000	12.23	8.03	8.53
5-19-2006	53000	12.05	7.97	8.82
5-19-2006	63000	12	8.01	8.72
5-19-2006	73000	12.07	8.24	8.62
5-19-2006	83000	12.2	8.28	8.64
5-19-2006	93000	12.4	8.25	8.6
5-19-2006	103000	12.58	8.27	8.48
5-19-2006	113000	12.68	8.26	8.59
5-19-2006	123000	13.24	8.23	8.56
5-19-2006	133000	13.37	8.29	8.53
5-19-2006	143000	13.52	8.3	8.36
5-19-2006	153000	13.63	8.3	8.62
5-19-2006	163000	13.98	8.31	8.45
5-19-2006	173000	13.8	8.32	8.7
5-19-2006	183000	13.9	8.33	8.48
5-19-2006	193000	13.71	8.32	8.47
5-19-2006	203000	13.33	8.35	8.73
5-19-2006	213000	13.37	8.29	8.49
5-19-2006	223000	13.22	8.3	8.43
5-19-2006	233000	13.19	8.27	8.43
5-20-2006	3000	12.91	8.29	8.52

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
5-20-2006	13000	12.96	8.27	8.59
5-20-2006	23000	12.87	8.27	8.51
5-20-2006	33000	12.61	8.3	8.73
5-20-2006	43000	12.58	8.29	8.69
5-20-2006	53000	12.53	8.28	8.66
5-20-2006	63000	12.48	8.27	8.56
5-20-2006	73000	12.54	8.24	8.39
5-20-2006	83000	12.53	8.27	8.46
5-20-2006	93000	12.78	8.24	8.53
5-20-2006	103000	12.99	8.24	8.44
5-20-2006	113000	13.37	8.23	8.31
5-20-2006	123000	13.5	8.25	8.27
5-20-2006	133000	13.5	8.28	8.42
5-20-2006	143000	13.52	8.27	8.37
5-20-2006	153000	13.5	8.26	8.44
5-20-2006	163000	13.43	8.26	8.52
5-20-2006	173000	13.4	8.25	8.55
5-20-2006	183000	13.35	8.24	8.46
5-20-2006	193000	13.29	8.21	8.54
5-20-2006	203000	13.1	8.24	8.41
5-20-2006	213000	13.04	8.25	8.43
5-20-2006	223000	13.04	8.28	8.53
5-20-2006	233000	12.84	8.29	8.57
5-21-2006	3000	12.77	8.27	8.5
5-21-2006	13000	12.58	8.28	8.53
5-21-2006	23000	12.49	8.28	8.51
5-21-2006	33000	12.48	8.26	8.47
5-21-2006	43000	12.35	8.02	8.57
5-21-2006	53000	12.28	8.25	8.52
5-21-2006	63000	12.21	8.24	8.5
5-21-2006	73000	12.03	8.27	8.85
5-21-2006	83000	12.13	8.26	8.82
5-21-2006	93000	12.13	8.28	8.64
5-21-2006	103000	12.33	8.26	8.52
5-21-2006	113000	12.4	8.26	8.64
5-21-2006	123000	12.66	8.27	8.64
5-21-2006	133000	12.97	8.28	8.64
5-21-2006	143000	13.2	8.28	8.44
5-21-2006	153000	13.43	8.27	8.42
5-21-2006	163000	13.5	8.27	8.34
5-21-2006	173000	13.6	8.29	8.4
5-21-2006	183000	13.58	8.26	8.46
5-21-2006	193000	13.53	8.28	8.51
5-21-2006	203000	13.25	8.05	8.52
5-21-2006	213000	13.12	8.09	8.3
5-21-2006	223000	13.04	8.18	8.44
5-21-2006	233000	12.84	8.21	8.41
5-22-2006	3000	12.69	8.25	8.49
5-22-2006	13000	12.61	8.2	8.47
5-22-2006	23000	12.53	8.17	8.57
5-22-2006	33000	12.53	8.2	8.38
5-22-2006	43000	12.41	8.19	8.46
5-22-2006	53000	12.38	8.19	8.54
5-22-2006	63000	12.33	8.23	8.58
5-22-2006	73000	12.43	8.21	8.16
5-22-2006	83000	12.49	8.21	8.3
5-22-2006	93000	12.58	8.21	8.2

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
5-22-2006	103000	12.81	8.21	8.22
5-22-2006	113000	13.09	8.22	8.03
5-22-2006	123000	13.4	8.22	8.07
5-22-2006	133000	13.68	8.22	8.21
5-22-2006	143000	13.9	8.23	8.05
5-22-2006	153000	14.08	8.23	7.98
5-22-2006	163000	14.21	8.24	8.25
5-22-2006	173000	14.26	8.23	8.05
5-22-2006	183000	14.16	8.24	7.94
5-22-2006	193000	14.01	8.26	8.19
5-22-2006	203000	13.83	8.24	8.13
5-22-2006	213000	13.62	8.25	8.09
5-22-2006	223000	13.45	8.24	7.9
5-22-2006	233000	13.27	8.25	8.03
5-23-2006	3000	12.99	8.24	8.25
5-23-2006	13000	12.97	8.23	8.24
5-23-2006	23000	12.84	8.24	8.07
5-23-2006	33000	12.79	8.26	8.32
5-23-2006	43000	12.77	8.22	8.23
5-23-2006	53000	12.71	8.21	8.23
5-23-2006	63000	12.72	8.22	7.99
5-23-2006	73000	12.72	8.16	8.19
5-23-2006	83000	12.77	8.2	8.07
5-23-2006	93000	12.94	8.28	8.18
5-23-2006	103000	13.22	8.28	8.01
5-23-2006	113000	13.48	8.29	8.18
5-23-2006	123000	13.88	8.29	8.1
5-23-2006	133000	14.23	8.2	8.07
5-23-2006	143000	14.63	8.25	7.9
5-23-2006	153000	14.96	8.28	7.93
5-23-2006	163000	15.21	8.2	7.89
5-23-2006	173000	15.36	8.19	7.89
5-23-2006	183000	15.31	8.26	7.85
5-23-2006	193000	15.24	8.31	7.95
5-23-2006	203000	15.03	8.38	7.82
5-23-2006	213000	14.71	8.3	7.85
5-23-2006	223000	14.56	8.25	7.87
5-23-2006	233000	14.34	8.24	7.86
5-24-2006	3000	14.13	8.26	7.82
5-24-2006	13000	13.96	8.24	7.91
5-24-2006	23000	13.93	8.42	7.89
5-24-2006	33000	13.7	8.49	8
5-24-2006	43000	13.7	8.54	7.73
5-24-2006	53000	13.57	8.45	7.9
5-24-2006	63000	13.42	8.41	7.86
5-24-2006	73000	13.48	8.51	7.75
5-24-2006	83000	13.6	8.49	7.85
5-24-2006	93000	13.81	8.37	7.79
5-24-2006	103000	13.86	8.39	7.65
5-24-2006	113000	14.03	8.49	7.8
5-24-2006	123000	14.11	8.42	7.84
5-24-2006	133000	14.26	8.43	7.74
5-24-2006	143000	14.48	8.41	7.78
5-24-2006	153000	14.69	8.42	7.74
5-24-2006	163000	15.04	8.4	7.7
5-24-2006	173000	15.16	8.37	7.71
5-24-2006	183000	15.13	8.5	7.66

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
5-24-2006	193000	15.09	8.47	7.59
5-24-2006	203000	14.98	8.41	7.7
5-24-2006	213000	14.94	8.47	7.62
5-24-2006	223000	14.94	8.49	7.64
5-24-2006	233000	14.99	8.48	7.62
5-25-2006	3000	14.79	8.57	7.57
5-25-2006	13000	14.71	8.5	7.57
5-25-2006	23000	14.56	8.43	7.52
5-25-2006	33000	14.41	8.26	7.5
5-25-2006	43000	14.43	8.21	7.46
5-25-2006	53000	14.29	8.19	7.53
5-25-2006	63000	14.26	8.19	7.48
5-25-2006	73000	14.31	8.2	7.42
5-25-2006	83000	14.59	8.08	7.6
5-25-2006	93000	14.81	8.17	7.37
5-25-2006	103000	14.96	8.22	7.42
5-25-2006	113000	15.16	8.17	7.42
5-25-2006	123000	15.38	8.22	7.41
5-25-2006	133000	15.64	8.33	7.42
5-25-2006	143000	15.91	8.52	7.37
5-25-2006	153000	16.06	8.5	7.41
5-25-2006	163000	16.35	8.53	7.44
5-25-2006	173000	16.58	8.53	7.32
5-25-2006	183000	16.57	8.58	7.33
5-25-2006	193000	16.3	8.44	7.34
5-25-2006	203000	16.28	8.52	7.3
5-25-2006	213000	16.11	8.51	7.31
5-25-2006	223000	15.96	8.48	7.26
5-25-2006	233000	15.79	8.49	7.22
5-26-2006	3000	15.64	8.42	7.19
5-26-2006	13000	15.46	8.42	7.25
5-26-2006	23000	15.41	8.48	7.27
5-26-2006	33000	15.38	8.43	7.22
5-26-2006	43000	15.31	8.46	7.25
5-26-2006	53000	15.34	8.4	7.16
5-26-2006	63000	15.31	8.42	7.16
5-26-2006	73000	15.41	8.45	7.18
5-26-2006	83000	15.43	8.41	7.19
5-26-2006	93000	15.63	8.36	7.28
5-26-2006	103000	15.83	8.46	7.19
5-26-2006	113000	16.1	8.34	7.16
5-26-2006	123000	16.4	8.44	7.28
5-26-2006	133000	16.63	8.45	7.2
5-26-2006	143000	16.82	8.4	7.32
5-26-2006	153000	16.99	8.41	7.26
5-26-2006	163000	17.26	8.31	7.28
5-26-2006	173000	17.54	8.32	7.16
5-26-2006	183000	17.63	8.3	7.14
5-26-2006	193000	17.63	8.32	7.13
5-26-2006	203000	17.48	8.3	7.07
5-26-2006	213000	17.17	8.29	7.1
5-26-2006	223000	17.14	8.27	7.1
5-26-2006	233000	16.82	8.29	7.08
5-27-2006	3000	16.64	8.27	7.06
5-27-2006	13000	16.5	8.27	6.96
5-27-2006	23000	16.26	8.25	6.99
5-27-2006	33000	16.23	8.25	7.11

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
5-27-2006	43000	16.15	8.27	7.07
5-27-2006	53000	16.11	8.35	7.09
5-27-2006	63000	16.18	8.3	7.05
5-27-2006	73000	16.1	8.4	7.02
5-27-2006	83000	16.21	8.4	7.11
5-27-2006	93000	16.41	8.34	7.01
5-27-2006	103000	16.57	8.3	6.94
5-27-2006	113000	16.8	8.32	6.98
5-27-2006	123000	17.07	8.33	6.9
5-27-2006	133000	17.33	8.31	6.96
5-27-2006	143000	17.6	8.34	6.95
5-27-2006	153000	17.87	8.36	6.97
5-27-2006	163000	18.11	8.46	6.83
5-27-2006	173000	18.28	8.52	6.87
5-27-2006	183000	18.35	8.51	6.89
5-27-2006	193000	18.31	8.51	6.74
5-27-2006	203000	18.23	8.5	6.84
5-27-2006	213000	18.12	8.5	6.83
5-27-2006	223000	18.02	8.47	6.8
5-27-2006	233000	17.89	8.5	6.7
5-28-2006	3000	17.72	8.45	6.78
5-28-2006	13000	17.49	8.49	6.6
5-28-2006	23000	17.36	8.51	6.72
5-28-2006	33000	17.26	8.49	6.75
5-28-2006	43000	17.14	8.53	6.73
5-28-2006	53000	17.05	8.43	6.79
5-28-2006	63000	17	8.43	7.01
5-28-2006	73000	16.99	8.35	7.1
5-28-2006	83000	16.91	8.33	7.26
5-28-2006	93000	16.72	8.34	7.33
5-28-2006	103000	16.95	8.3	7.19
5-28-2006	113000	16.92	8.31	7.38
5-28-2006	123000	17.26	8.32	7.31
5-28-2006	133000	17.56	8.32	7.17
5-28-2006	143000	17.85	8.35	7.17
5-28-2006	153000	18.23	8.33	7.17
5-28-2006	163000	18.35	8.41	7.05
5-28-2006	173000	18.29	8.39	7
5-28-2006	183000	18.43	8.38	6.8
5-28-2006	193000	18.19	8.42	7.18
5-28-2006	203000	18.09	8.43	7.21
5-28-2006	213000	17.97	8.44	7.22
5-28-2006	223000	17.9	8.43	7.27
5-28-2006	233000	17.85	8.42	6.95
5-29-2006	3000	17.83	8.41	7.12
5-29-2006	13000	17.8	8.41	7.06
5-29-2006	23000	17.7	8.4	7.31
5-29-2006	33000	17.88	8.4	7.17
5-29-2006	43000	17.65	8.4	7.35
5-29-2006	53000	17.66	8.37	7.13
5-29-2006	63000	17.75	8.55	7.1
5-29-2006	73000	17.73	8.56	7.12
5-29-2006	83000	17.92	8.56	7.13
5-29-2006	93000	18.07	8.57	7.09
5-29-2006	103000	18.47	8.54	7.08
5-29-2006	113000	18.81	8.55	6.84
5-29-2006	123000	19.15	8.57	6.92

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
5-29-2006	133000	19.57	8.56	6.73
5-29-2006	143000	19.77	8.54	6.68
5-29-2006	153000	19.7	8.55	6.96
5-29-2006	163000	19.7	8.56	7.08
5-29-2006	173000	19.55	8.57	6.85
5-29-2006	183000	19.48	8.57	6.92
5-29-2006	193000	19.46	8.57	6.94
5-29-2006	203000	19.25	8.55	6.97
5-29-2006	213000	19.15	8.53	6.92
5-29-2006	223000	19.01	8.54	6.79
5-29-2006	233000	18.86	8.51	6.84
5-30-2006	3000	18.77	8.48	6.91
5-30-2006	13000	18.69	8.48	6.88
5-30-2006	23000	18.65	8.49	7.01
5-30-2006	33000	18.64	8.47	6.96
5-30-2006	43000	18.62	8.49	6.94
5-30-2006	53000	18.6	8.47	6.77
5-30-2006	63000	18.64	8.49	6.9
5-30-2006	73000	18.71	8.49	6.97
5-30-2006	83000	18.81	8.46	6.95
5-30-2006	93000	18.95	8.47	6.76
5-30-2006	103000	19.1	8.47	6.74
5-30-2006	113000	19.41	8.47	6.61
5-30-2006	123000	19.65	8.51	6.83
5-30-2006	133000	19.89	8.52	6.69
5-30-2006	143000	20.09	8.5	6.66
5-30-2006	153000	20.02	8.49	6.83
5-30-2006	163000	19.95	8.5	6.72
5-30-2006	173000	19.93	8.49	6.69
5-30-2006	183000	19.83	8.48	6.81
5-30-2006	193000	19.79	8.48	6.95
5-30-2006	203000	19.69	8.48	6.75
5-30-2006	213000	19.53	8.48	6.78
5-30-2006	223000	19.41	8.48	6.69
5-30-2006	233000	19.34	8.48	6.78
5-31-2006	3000	19.31	8.46	6.93
5-31-2006	13000	19.35	8.46	6.9
5-31-2006	23000	19.46	8.44	6.73
5-31-2006	33000	19.43	8.44	6.98
5-31-2006	43000	19.48	8.44	6.73
5-31-2006	53000	19.43	8.45	6.83
5-31-2006	63000	19.46	8.45	6.83
5-31-2006	73000	19.62	8.43	6.72
5-31-2006	83000	19.6	8.45	6.66
5-31-2006	93000	19.78	8.47	6.66
5-31-2006	103000	19.84	8.47	6.74
5-31-2006	113000	20.22	8.45	6.71
5-31-2006	123000	20.36	8.47	6.8
5-31-2006	133000	20.5	8.5	6.75
5-31-2006	143000	20.71	8.49	6.75
5-31-2006	153000	20.98	8.47	6.62
5-31-2006	163000	20.69	8.49	6.52
5-31-2006	173000	20.85	8.48	6.69
5-31-2006	183000	20.82	8.48	6.63
5-31-2006	193000	20.59	8.45	6.74
5-31-2006	203000	20.3	8.48	6.66
5-31-2006	213000	20.17	8.49	6.7

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)	Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
5-31-2006	223000	20	8.49	6.65	6-3-2006	73000	20.84	7.58	7.97
5-31-2006	233000	19.95	8.47	6.68	6-3-2006	83000	20.87	7.55	8.02
6-1-2006	3000	19.98	8.45	6.47	6-3-2006	93000	21.12	7.49	7.93
6-1-2006	13000	19.89	8.46	6.62	6-3-2006	103000	21.08	7.58	8.07
6-1-2006	23000	19.86	8.46	6.66	6-3-2006	113000	21.38	7.57	7.96
6-1-2006	33000	19.89	8.43	6.76	6-3-2006	123000	21.43	7.54	7.98
6-1-2006	43000	19.83	8.43	6.83	6-3-2006	133000	21.77	7.54	7.89
6-1-2006	53000	19.81	8.43	6.83	6-3-2006	143000	21.93	7.56	7.81
6-1-2006	63000	19.76	8.44	6.77	6-3-2006	153000	22.09	7.15	7.88
6-1-2006	73000	19.74	8.44	6.65	6-3-2006	163000	22.28	7.15	7.93
6-1-2006	83000	20.09	8.46	6.62	6-3-2006	173000	22.28	7.16	7.86
6-1-2006	93000	20.31	8.43	6.47	6-3-2006	183000	22.18	7.13	7.81
6-1-2006	103000	20.57	8.45	6.4	6-3-2006	193000	21.96	7.17	7.79
6-1-2006	113000	20.86	8.4	6.22	6-3-2006	203000	21.75	7.38	7.83
6-1-2006	123000	21.1	8.43	6.3	6-3-2006	213000	21.41	7.31	7.92
6-1-2006	133000	21.42	8.41	6.06	6-3-2006	223000	21.24	7.19	7.83
6-1-2006	143000	21.57	8.46	6.15	6-3-2006	233000	21.06	7.09	7.88
6-1-2006	153000	22	8.43	6.11	6-4-2006	3000	21.01	7.04	7.86
6-1-2006	163000	21.93	8.45	6.07	6-4-2006	13000	20.77	7.09	7.73
6-1-2006	173000	21.88	8.41	6.14	6-4-2006	23000	20.57	7.15	7.76
6-1-2006	183000	21.68	8.44	6.25	6-4-2006	33000	20.4	7.13	7.77
6-1-2006	193000	21.66	8.4	5.98	6-4-2006	43000	20.22	7.3	7.85
6-1-2006	203000	21.27	8.38	6.16	6-4-2006	53000	20.17	7.21	7.76
6-1-2006	213000	21.19	8.38	5.94	6-4-2006	63000	20.14	7.31	7.69
6-1-2006	223000	20.92	8.41	6.07	6-4-2006	73000	20.1	7.26	7.65
6-1-2006	233000	20.8	8.41	6.21	6-4-2006	83000	20.17	7.26	7.53
6-2-2006	3000	20.78	8.38	6.18	6-4-2006	93000	20.38	7.27	7.63
6-2-2006	13000	20.76	8.39	6.13	6-4-2006	103000	20.59	7.25	7.66
6-2-2006	23000	20.58	8.41	6.05	6-4-2006	113000	20.92	7.31	7.55
6-2-2006	33000	20.59	8.37	6.13	6-4-2006	123000	21.2	7.27	7.61
6-2-2006	43000	20.57	8.37	6.22	6-4-2006	133000	21.56	7.32	7.6
6-2-2006	53000	20.61	8.35	6.09	6-4-2006	143000	21.89	7.34	7.58
6-2-2006	63000	20.42	8.37	6.09	6-4-2006	153000	22.25	7.35	7.51
6-2-2006	73000	20.35	8.35	6.19	6-4-2006	163000	22.52	7.36	7.56
6-2-2006	83000	Data missing due to site visit and check			6-4-2006	173000	22.66	7.37	7.52
6-2-2006	93000	21.2	7.1	7.7	6-4-2006	183000	22.77	7.33	7.5
6-2-2006	103000	21.12	7.02	8.57	6-4-2006	193000	22.77	7.34	7.47
6-2-2006	113000	21.36	7.04	8.27	6-4-2006	203000	22.57	7.36	7.49
6-2-2006	123000	21.79	7.48	7.98	6-4-2006	213000	22.3	7.34	7.45
6-2-2006	133000	22.04	7.53	8.01	6-4-2006	223000	22.09	7.36	7.46
6-2-2006	143000	22.34	7.46	8.18	6-4-2006	233000	21.7	7.37	7.56
6-2-2006	153000	22.48	7.48	8.19	6-5-2006	3000	21.43	7.33	7.51
6-2-2006	163000	22.41	7.51	8.14	6-5-2006	13000	21.19	7.29	7.49
6-2-2006	173000	22.53	7.52	7.97	6-5-2006	23000	20.94	7.34	7.46
6-2-2006	183000	22.5	7.52	8.02	6-5-2006	33000	20.73	7.35	7.49
6-2-2006	193000	22.27	7.55	7.98	6-5-2006	43000	20.56	7.33	7.45
6-2-2006	203000	22.02	7.57	7.99	6-5-2006	53000	20.52	7.32	7.42
6-2-2006	213000	21.8	7.57	7.94	6-5-2006	63000	20.45	7.27	7.39
6-2-2006	223000	21.59	7.57	7.92	6-5-2006	73000	20.36	7.22	7.41
6-2-2006	233000	21.36	7.56	7.94	6-5-2006	83000	20.73	7.21	7.36
6-3-2006	3000	21.24	7.57	7.9	6-5-2006	93000	20.89	7.21	7.43
6-3-2006	13000	21.17	7.54	7.96	6-5-2006	103000	21.13	7.19	7.41
6-3-2006	23000	21.06	7.56	7.96	6-5-2006	113000	21.22	7.18	7.46
6-3-2006	33000	21.12	7.52	7.91	6-5-2006	123000	21.62	7.22	7.32
6-3-2006	43000	21.05	7.54	7.92	6-5-2006	133000	21.82	7.23	7.25
6-3-2006	53000	20.89	7.58	7.87	6-5-2006	143000	22.2	7.21	7.32
6-3-2006	63000	20.89	7.5	7.87	6-5-2006	153000	22.53	7.25	7.28

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
6-5-2006	163000	22.86	7.22	7.32
6-5-2006	173000	22.95	7.28	7.33
6-5-2006	183000	22.8	7.36	7.45
6-5-2006	193000	22.86	7.38	7.33
6-5-2006	203000	22.48	7.44	7.36
6-5-2006	213000	22.3	7.42	7.41
6-5-2006	223000	22.14	7.4	7.32
6-5-2006	233000	21.86	7.4	7.52
6-6-2006	3000	21.72	7.4	7.32
6-6-2006	13000	21.5	7.39	7.31
6-6-2006	23000	21.26	7.38	7.37
6-6-2006	33000	21.17	7.36	7.35
6-6-2006	43000	21.05	7.35	7.29
6-6-2006	53000	20.98	7.38	7.23
6-6-2006	63000	20.87	7.4	7.28
6-6-2006	73000	20.89	7.41	7.3
6-6-2006	83000	20.94	7.39	7.23
6-6-2006	93000	20.89	7.39	7.18
6-6-2006	103000	20.96	7.4	7.23
6-6-2006	113000	20.85	7.39	7.22
6-6-2006	123000	21.01	7.4	7.22
6-6-2006	133000	21.1	7.4	7.18
6-6-2006	143000	21.1	7.4	7.21
6-6-2006	153000	21.24	7.4	7.17
6-6-2006	163000	21.26	7.42	7.23
6-6-2006	173000	21.24	7.42	7.17
6-6-2006	183000	21.15	7.42	7.13
6-6-2006	193000	21.15	7.4	7.15
6-6-2006	203000	20.89	7.41	7.23
6-6-2006	213000	20.8	7.4	7.21
6-6-2006	223000	20.73	7.43	7.09
6-6-2006	233000	20.66	7.43	7.18
6-7-2006	3000	20.63	7.43	7.18
6-7-2006	13000	20.61	7.44	7.09
6-7-2006	23000	20.57	7.42	7.11
6-7-2006	33000	20.5	7.41	7.09
6-7-2006	43000	20.52	7.41	7.19
6-7-2006	53000	20.47	7.41	7.07
6-7-2006	63000	20.42	7.39	7.09
6-7-2006	73000	20.43	7.42	7.18
6-7-2006	83000	20.68	7.41	7.11
6-7-2006	93000	20.84	7.42	7.17
6-7-2006	103000	20.99	7.42	7.13
6-7-2006	113000	21.29	7.43	7.11
6-7-2006	123000	21.56	7.43	7.18
6-7-2006	133000	21.8	7.45	7.13
6-7-2006	143000	22.04	7.44	7.08
6-7-2006	153000	22.2	7.45	7.15
6-7-2006	163000	22.35	7.45	7.05
6-7-2006	173000	22.64	7.45	7.08
6-7-2006	183000	22.71	7.46	7.07
6-7-2006	193000	22.73	7.45	7.08
6-7-2006	203000	22.34	7.46	7.08
6-7-2006	213000	22.23	7.45	7.19
6-7-2006	223000	21.96	7.46	7.13
6-7-2006	233000	21.7	7.44	7.05
6-8-2006	3000	21.42	7.41	7.11

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
6-8-2006	13000	21.15	7.41	7.08
6-8-2006	23000	20.98	7.41	7.04
6-8-2006	33000	20.82	7.4	7.07
6-8-2006	43000	20.71	7.39	7.04
6-8-2006	53000	20.66	7.4	6.9
6-8-2006	63000	20.63	7.4	6.93
6-8-2006	73000	20.7	7.4	6.95
6-8-2006	83000	20.84	7.4	6.91
6-8-2006	93000	20.96	7.41	6.95
6-8-2006	103000	21.19	7.39	7.06
6-8-2006	113000	21.54	7.41	7.03
6-8-2006	123000	21.72	7.41	7.09
6-8-2006	133000	22.16	7.43	6.93
6-8-2006	143000	22.39	7.45	7.04
6-8-2006	153000	22.7	7.45	6.94
6-8-2006	163000	22.62	7.45	6.87
6-8-2006	173000	22.71	7.46	6.91
6-8-2006	183000	22.71	7.47	6.92
6-8-2006	193000	22.57	7.51	6.9
6-8-2006	203000	22.3	7.52	6.85
6-8-2006	213000	22.05	7.54	6.86
6-8-2006	223000	21.68	7.44	6.82
6-8-2006	233000	21.42	7.42	6.8
6-9-2006	3000	21.06	7.46	6.76
6-9-2006	13000	20.8	7.44	6.74
6-9-2006	23000	20.6	7.46	6.79
6-9-2006	33000	20.45	7.42	6.83
6-9-2006	43000	20.31	7.42	6.81
6-9-2006	53000	20.19	7.44	6.82
6-9-2006	63000	20.14	7.42	6.73
6-9-2006	73000	20.1	7.41	6.8
6-9-2006	83000	20.16	7.46	6.82
6-9-2006	93000	20.29	7.43	6.89
6-9-2006	103000	20.4	7.51	6.93
6-9-2006	113000	20.77	7.45	6.92
6-9-2006	123000	21.02	7.47	6.83
6-9-2006	133000	21.35	7.52	6.87
6-9-2006	143000	21.97	7.48	6.98
6-9-2006	153000	22.2	7.49	6.98
6-9-2006	163000	22.39	7.48	6.96
6-9-2006	173000	22.39	7.48	6.92
6-9-2006	183000	22.25	7.48	7.05
6-9-2006	193000	22.21	7.48	7.03
6-9-2006	203000	21.75	7.49	7.01
6-9-2006	213000	21.54	7.43	7.04
6-9-2006	223000	21.26	7.42	7.1
6-9-2006	233000	20.89	7.41	7.01
6-10-2006	3000	20.57	7.38	7.17
6-10-2006	13000	20.24	7.38	7.09
6-10-2006	23000	20.05	7.37	6.94
6-10-2006	33000	19.86	7.37	7.07
6-10-2006	43000	19.65	7.36	7.02
6-10-2006	53000	19.57	7.37	6.92
6-10-2006	63000	19.5	7.36	7.07
6-10-2006	73000	19.48	7.31	6.95
6-10-2006	83000	19.6	7.37	6.99
6-10-2006	93000	19.65	7.34	6.97

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)	Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
6-10-2006	103000	19.84	7.4	7.05	6-12-2006	193000	20.94	7.3	6.94
6-10-2006	113000	20.09	7.42	7.06	6-12-2006	203000	20.78	7.31	6.93
6-10-2006	123000	20.45	7.43	7.05	6-12-2006	213000	20.63	7.3	6.89
6-10-2006	133000	20.71	7.43	7.11	6-12-2006	223000	20.5	7.31	6.92
6-10-2006	143000	21.03	7.47	7.1	6-12-2006	233000	20.38	7.32	6.92
6-10-2006	153000	21.38	7.46	7.08	6-13-2006	3000	20.26	7.32	6.84
6-10-2006	163000	21.7	7.47	7.12	6-13-2006	13000	20.07	7.32	6.83
6-10-2006	173000	21.77	7.48	7.17	6-13-2006	23000	19.96	7.31	6.87
6-10-2006	183000	21.86	7.49	7.15	6-13-2006	33000	19.81	7.31	6.78
6-10-2006	193000	21.89	7.35	7.1	6-13-2006	43000	19.62	7.3	6.85
6-10-2006	203000	21.82	7.36	7.15	6-13-2006	53000	19.43	7.3	6.86
6-10-2006	213000	21.54	7.34	7.12	6-13-2006	63000	19.32	7.3	6.78
6-10-2006	223000	21.42	7.32	7.04	6-13-2006	73000	19.19	7.3	6.83
6-10-2006	233000	21.17	7.3	7.09	6-13-2006	83000	19.34	7.29	6.8
6-11-2006	3000	20.85	7.27	7.04	6-13-2006	93000	19.53	7.29	6.78
6-11-2006	13000	20.54	7.25	7.08	6-13-2006	103000	19.78	7.31	6.8
6-11-2006	23000	20.21	7.24	7.02	6-13-2006	113000	20.02	7.31	6.77
6-11-2006	33000	19.88	7.22	6.96	6-13-2006	123000	20.19	7.33	6.82
6-11-2006	43000	19.7	7.21	7.03	6-13-2006	133000	20.36	7.32	6.77
6-11-2006	53000	19.51	7.19	6.99	6-13-2006	143000	20.47	7.33	6.8
6-11-2006	63000	19.41	7.21	7.03	6-13-2006	153000	20.57	7.33	6.79
6-11-2006	73000	19.36	7.21	6.96	6-13-2006	163000	20.63	7.35	6.82
6-11-2006	83000	19.43	7.22	6.93	6-13-2006	173000	20.73	7.34	6.81
6-11-2006	93000	19.58	7.23	6.95	6-13-2006	183000	20.91	7.36	6.81
6-11-2006	103000	19.76	7.24	6.92	6-13-2006	193000	20.87	7.36	6.84
6-11-2006	113000	20.02	7.26	6.98	6-13-2006	203000	20.5	7.37	6.85
6-11-2006	123000	20.33	7.28	6.97	6-13-2006	213000	20.29	7.37	6.82
6-11-2006	133000	20.63	7.3	7.03	6-13-2006	223000	20.16	7.36	6.8
6-11-2006	143000	20.98	7.32	7	6-13-2006	233000	19.96	7.4	6.76
6-11-2006	153000	21.27	7.33	7.01	6-14-2006	3000	19.81	7.41	6.78
6-11-2006	163000	21.57	7.36	7.06	6-14-2006	13000	19.6	7.4	6.78
6-11-2006	173000	21.86	7.35	7.01	6-14-2006	23000	19.55	7.39	6.75
6-11-2006	183000	22	7.34	7.04	6-14-2006	33000	19.56	7.38	6.78
6-11-2006	193000	21.98	7.36	7.02	6-14-2006	43000	19.43	7.38	6.72
6-11-2006	203000	21.91	7.35	7.06	6-14-2006	53000	19.27	7.33	6.72
6-11-2006	213000	21.7	7.36	7.07	6-14-2006	63000	19.17	7.31	6.63
6-11-2006	223000	21.49	7.28	6.96	6-14-2006	73000	19.05	7.31	6.64
6-11-2006	233000	21.2	7.32	7.03	6-14-2006	83000	19.27	7.25	6.77
6-12-2006	3000	20.94	7.2	7	6-14-2006	93000	19.32	7.28	6.73
6-12-2006	13000	20.54	7.3	7.09	6-14-2006	103000	19.34	7.22	6.74
6-12-2006	23000	20.21	7.21	7.01	6-14-2006	113000	19.48	7.22	6.66
6-12-2006	33000	19.89	7.22	7.02	6-14-2006	123000	19.57	7.17	6.65
6-12-2006	43000	19.58	7.2	6.93	6-14-2006	133000	19.91	7.21	6.58
6-12-2006	53000	19.38	7.17	6.92	6-14-2006	143000	20.1	7.28	6.57
6-12-2006	63000	19.27	7.18	6.84	6-14-2006	153000	20.52	7.27	6.53
6-12-2006	73000	19.24	7.19	6.87	6-14-2006	163000	20.43	7.28	6.64
6-12-2006	83000	19.29	7.2	6.8	6-14-2006	173000	20.66	7.24	6.63
6-12-2006	93000	19.51	7.18	6.83	6-14-2006	183000	20.92	7.13	6.63
6-12-2006	103000	19.53	7.19	6.89	6-14-2006	193000	21.06	7.33	6.62
6-12-2006	113000	19.63	7.15	6.85	6-14-2006	203000	20.94	7.33	6.5
6-12-2006	123000	19.84	7.16	6.88	6-14-2006	213000	20.96	7.36	6.5
6-12-2006	133000	20.03	7.19	6.9	6-14-2006	223000	20.94	7.35	6.53
6-12-2006	143000	20.16	7.14	6.95	6-14-2006	233000	20.84	7.36	6.49
6-12-2006	153000	20.36	7.15	6.97	6-15-2006	3000	20.8	7.36	6.54
6-12-2006	163000	20.59	7.25	6.99	6-15-2006	13000	20.63	7.34	6.44
6-12-2006	173000	20.71	7.31	6.91	6-15-2006	23000	20.35	7.35	6.44
6-12-2006	183000	20.94	7.3	6.99	6-15-2006	33000	20.19	7.34	6.46

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
6-15-2006	43000	19.98	7.32	6.42
6-15-2006	53000	19.83	7.31	6.39
6-15-2006	63000	19.39	7.32	6.37
6-15-2006	73000	19.46	7.3	6.33
6-15-2006	83000	19.44	7.28	6.4
6-15-2006	93000	19.38	7.33	6.46
6-15-2006	103000	19.57	7.28	6.43
6-15-2006	113000	19.76	7.28	6.51
6-15-2006	123000	20.09	7.3	6.42
6-15-2006	133000	20.45	7.33	6.39
6-15-2006	143000	20.75	7.33	6.45
6-15-2006	153000	21.08	7.36	6.43
6-15-2006	163000	21.45	7.38	6.47
6-15-2006	173000	21.63	7.41	6.41
6-15-2006	183000	21.89	7.41	6.38
6-15-2006	193000	21.8	7.41	6.49
6-15-2006	203000	21.57	7.43	6.43
6-15-2006	213000	21.56	7.41	6.44
6-15-2006	223000	21.44	7.43	6.42
6-15-2006	233000	21.35	7.42	6.41
6-16-2006	3000	21.19	7.42	6.42
6-16-2006	13000	21.13	7.41	6.4
6-16-2006	23000	21.03	7.41	6.35
6-16-2006	33000	20.85	7.4	6.38
6-16-2006	43000	20.88	7.39	6.31
6-16-2006	53000	20.5	7.38	6.29
6-16-2006	63000	20.28	7.37	6.23
6-16-2006	73000	20.1	7.36	6.23
6-16-2006	83000	20.4	7.31	6.25
6-16-2006	93000	20.45	7.32	6.22
6-16-2006	103000	20.54	7.33	6.23
6-16-2006	113000	20.78	7.33	6.21
6-16-2006	123000	20.99	7.34	6.23
6-16-2006	133000	21.24	7.38	6.24
6-16-2006	143000	21.52	7.36	6.24
6-16-2006	153000	21.61	7.38	6.28
6-16-2006	163000	21.91	7.38	6.24
6-16-2006	173000	22.21	7.42	6.26
6-16-2006	183000	22.23	7.43	6.25
6-16-2006	193000	22.23	7.44	6.25
6-16-2006	203000	21.89	7.43	6.25
6-16-2006	213000	21.86	7.45	6.14
6-16-2006	223000	21.8	7.25	6.17
6-16-2006	233000	21.68	7.24	6.19
6-17-2006	3000	21.65	7.26	6.18
6-17-2006	13000	21.59	7.24	6.18
6-17-2006	23000	21.54	7.42	6.18
6-17-2006	33000	21.26	7.4	6.12
6-17-2006	43000	21.27	7.4	6.12
6-17-2006	53000	21.08	7.41	6.1
6-17-2006	63000	21.08	7.4	6.12
6-17-2006	73000	21.03	7.21	6.14
6-17-2006	83000	20.98	7.24	6.07
6-17-2006	93000	20.89	7.32	6.1
6-17-2006	103000	21.06	7.35	6.06
6-17-2006	113000	21.35	7.37	6.07
6-17-2006	123000	21.57	7.37	6.07

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
6-17-2006	133000	21.89	7.38	6.01
6-17-2006	143000	22.23	7.41	6.08
6-17-2006	153000	22.53	7.42	6.07
6-17-2006	163000	22.79	7.46	6.11
6-17-2006	173000	22.82	7.46	6.09
6-17-2006	183000	22.89	7.47	6.09
6-17-2006	193000	22.88	7.44	6.08
6-17-2006	203000	22.75	7.46	6.08
6-17-2006	213000	22.66	7.42	6.08
6-17-2006	223000	22.5	7.42	6.03
6-17-2006	233000	22.34	7.42	6.04
6-18-2006	3000	22.25	7.41	5.97
6-18-2006	13000	22.16	7.42	5.97
6-18-2006	23000	21.96	7.41	5.96
6-18-2006	33000	21.89	7.4	5.93
6-18-2006	43000	21.82	7.4	5.93
6-18-2006	53000	21.73	7.39	5.88
6-18-2006	63000	21.68	7.39	5.86
6-18-2006	73000	21.82	7.39	5.86
6-18-2006	83000	21.7	7.38	5.84
6-18-2006	93000	21.75	7.38	5.84
6-18-2006	103000	21.77	7.35	5.86
6-18-2006	113000	21.86	7.35	5.87
6-18-2006	123000	21.96	7.34	5.85
6-18-2006	133000	22.09	7.34	5.81
6-18-2006	143000	22.3	7.35	5.78
6-18-2006	153000	22.39	7.36	5.83
6-18-2006	163000	22.61	7.33	5.78
6-18-2006	173000	22.71	7.32	5.83
6-18-2006	183000	22.81	7.4	5.8
6-18-2006	193000	22.79	7.4	5.82
6-18-2006	203000	22.82	7.35	5.79
6-18-2006	213000	22.71	7.4	5.83
6-18-2006	223000	22.64	7.42	5.74
6-18-2006	233000	22.62	7.16	5.69
6-19-2006	3000	22.59	7.16	5.68
6-19-2006	13000	22.5	7.16	5.66
6-19-2006	23000	22.32	7.26	5.67
6-19-2006	33000	22.14	7.38	5.67
6-19-2006	43000	22.09	7.37	5.65
6-19-2006	53000	21.88	7.38	5.64
6-19-2006	63000	21.8	7.36	5.62
6-19-2006	73000	21.66	7.12	5.6
6-19-2006	83000	21.59	7.34	5.61
6-19-2006	93000	21.61	7.32	5.61
6-19-2006	103000	21.66	7.35	5.62
6-19-2006	113000	21.92	7.35	5.58
6-19-2006	123000	22.23	7.39	5.55
6-19-2006	133000	22.53	7.42	5.52
6-19-2006	143000	22.77	7.43	5.52
6-19-2006	153000	23	7.49	5.59
6-19-2006	163000	23.2	7.45	5.56
6-19-2006	173000	23.27	7.48	5.58
6-19-2006	183000	23.31	7.48	5.58
6-19-2006	193000	23.25	7.46	5.56
6-19-2006	203000	22.84	7.46	5.56
6-19-2006	213000	22.71	7.45	5.55

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
6-19-2006	223000	22.62	7.47	5.54
6-19-2006	233000	22.55	7.46	5.46
6-20-2006	3000	22.39	7.42	5.44
6-20-2006	13000	22.3	7.42	5.38
6-20-2006	23000	22.11	7.4	5.34
6-20-2006	33000	21.95	7.4	5.34
6-20-2006	43000	21.73	7.4	5.34
6-20-2006	53000	21.8	7.38	5.25
6-20-2006	63000	21.7	7.37	5.23
6-20-2006	73000	21.63	7.45	5.19
6-20-2006	83000	21.45	7.44	5.21
6-20-2006	93000	21.63	7.44	5.18
6-20-2006	103000	21.77	7.48	5.16
6-20-2006	113000	22.12	7.5	5.11
6-20-2006	123000	22.34	7.51	5.09
6-20-2006	133000	22.71	7.54	5.08
6-20-2006	143000	22.98	7.57	5.09
6-20-2006	153000	23.4	7.59	5.07
6-20-2006	163000	23.71	7.62	5.08
6-20-2006	173000	23.92	7.65	5.05
6-20-2006	183000	23.98	7.65	5.01
6-20-2006	193000	23.85	7.64	4.96
6-20-2006	203000	23.36	7.62	4.94
6-20-2006	213000	23.34	7.6	4.89
6-20-2006	223000	23.22	7.57	4.85
6-20-2006	233000	23.09	7.56	4.81
6-21-2006	3000	22.89	7.55	4.77
6-21-2006	13000	22.88	7.54	4.71
6-21-2006	23000	22.66	7.51	4.67
6-21-2006	33000	22.5	7.5	4.64
6-21-2006	43000	22.34	7.48	4.57
6-21-2006	53000	22.18	7.45	4.53
6-21-2006	63000	22.11	7.44	4.46
6-21-2006	73000	22	7.43	4.42
6-21-2006	83000	22.57	7.42	4.34
6-21-2006	93000	22.43	7.41	4.29
6-21-2006	103000	22.36	7.42	4.29
6-21-2006	113000	22.64	7.38	4.26
6-21-2006	123000	22.88	7.37	4.23
6-21-2006	133000	22.91	7.35	4.22
6-21-2006	143000	23.25	7.38	4.15
6-21-2006	153000	23.52	7.35	4.18
6-21-2006	163000	23.87	7.38	4.14
6-21-2006	173000	23.98	7.4	4.13
6-21-2006	183000	24.09	7.44	4.11
6-21-2006	193000	24.16	7.44	4.08
6-21-2006	203000	23.8	7.42	4.12
6-21-2006	213000	23.83	7.4	4.12
6-21-2006	223000	23.69	7.49	4.11
6-21-2006	233000	23.51	7.45	4.11
6-22-2006	3000	23.38	7.45	4.11
6-22-2006	13000	23.16	7.42	4.12
6-22-2006	23000	23	7.4	4.11
6-22-2006	33000	22.77	7.4	4.13
6-22-2006	43000	22.53	7.37	4.12
6-22-2006	53000	22.32	7.37	4.13
6-22-2006	63000	22.21	7.33	4.12

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
6-22-2006	73000	22.14	7.32	4.11
6-22-2006	83000	22.5	7.33	4.09
6-22-2006	93000	22.52	7.32	4.1
6-22-2006	103000	22.71	7.34	4.09
6-22-2006	113000	22.53	7.26	4.11
6-22-2006	123000	22.75	7.27	4.13
6-22-2006	133000	22.79	7.21	4.13
6-22-2006	143000	22.68	7.26	4.14
6-22-2006	153000	23	7.31	4.14
6-22-2006	163000	23.22	7.34	4.17
6-22-2006	173000	23.51	7.39	4.17
6-22-2006	183000	23.68	7.43	4.18
6-22-2006	193000	23.69	7.42	4.19
6-22-2006	203000	23.25	7.4	4.24
6-22-2006	213000	23.09	7.41	4.25
6-22-2006	223000	22.95	7.45	4.26
6-22-2006	233000	22.84	7.42	4.27
6-23-2006	3000	22.64	7.42	4.34
6-23-2006	13000	22.62	7.4	4.34
6-23-2006	23000	22.28	7.4	4.36
6-23-2006	33000	22.17	7.38	4.38
6-23-2006	43000	21.98	7.35	4.36
6-23-2006	53000	21.73	7.34	4.39
6-23-2006	63000	21.65	7.33	4.4
6-23-2006	73000	21.45	7.3	4.38
6-23-2006	83000	21.77	7.25	4.33
6-23-2006	93000	21.54	7.21	4.35
6-23-2006	103000	21.5	7.2	4.35
6-23-2006	113000	21.69	7.83	7.84
6-23-2006	123000	21.99	7.88	7.55
6-23-2006	133000	22.29	7.89	7.66
6-23-2006	143000	22.51	7.91	7.69
6-23-2006	153000	22.97	7.95	7.5
6-23-2006	163000	23.26	7.99	7.59
6-23-2006	173000	23.53	8.03	7.53
6-23-2006	183000	23.75	8.07	7.57
6-23-2006	193000	23.79	8.1	7.45
6-23-2006	203000	23.68	8.14	7.48
6-23-2006	213000	23.68	8.14	7.46
6-23-2006	223000	23.6	8.13	7.46
6-23-2006	233000	23.44	8.11	7.46
6-24-2006	3000	23.21	8.09	7.35
6-24-2006	13000	23.01	8.06	7.25
6-24-2006	23000	22.83	8.05	6.97
6-24-2006	33000	22.74	8.03	6.94
6-24-2006	43000	22.47	8.01	6.96
6-24-2006	53000	22.24	8	6.97
6-24-2006	63000	22.11	7.98	6.89
6-24-2006	73000	21.92	7.97	6.84
6-24-2006	83000	21.9	7.96	6.71
6-24-2006	93000	21.69	7.96	6.75
6-24-2006	103000	21.81	7.95	6.77
6-24-2006	113000	21.62	7.94	6.8
6-24-2006	123000	21.6	7.96	6.78
6-24-2006	133000	21.88	7.97	6.89
6-24-2006	143000	22.11	7.99	6.93
6-24-2006	153000	22.42	8.01	7.02

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
6-24-2006	163000	22.61	8.05	7.09
6-24-2006	173000	22.65	8.05	7.14
6-24-2006	183000	22.69	8.06	7.16
6-24-2006	193000	22.85	8.02	7.11
6-24-2006	203000	22.79	8.05	6.94
6-24-2006	213000	22.83	8.02	7.37
6-24-2006	223000	22.83	8.01	7.15
6-24-2006	233000	22.83	8.02	7.18
6-25-2006	3000	22.74	8.01	7.28
6-25-2006	13000	22.6	7.99	7.14
6-25-2006	23000	22.52	7.98	7.21
6-25-2006	33000	22.22	7.95	6.92
6-25-2006	43000	22.2	7.93	6.9
6-25-2006	53000	22.03	7.98	6.87
6-25-2006	63000	21.88	7.98	6.78
6-25-2006	73000	21.65	7.98	6.74
6-25-2006	83000	21.62	7.98	6.83
6-25-2006	93000	21.51	7.98	6.78
6-25-2006	103000	21.51	7.98	6.61
6-25-2006	113000	21.42	7.98	6.89
6-25-2006	123000	21.46	7.98	7.04
6-25-2006	133000	21.55	7.98	6.92
6-25-2006	143000	21.78	7.99	6.92
6-25-2006	153000	21.87	8.02	6.98
6-25-2006	163000	22.04	8.03	7.09
6-25-2006	173000	22.24	8.02	7.33
6-25-2006	183000	22.38	8.06	7.51
6-25-2006	193000	22.51	8.14	7.35
6-25-2006	203000	22.47	8.14	7.57
6-25-2006	213000	22.51	8.15	7.42
6-25-2006	223000	22.51	8.15	7.42
6-25-2006	233000	22.51	8.14	7.54
6-26-2006	3000	22.42	8.14	7.49
6-26-2006	13000	22.4	8.14	7.23
6-26-2006	23000	22.2	8.13	7.2
6-26-2006	33000	22.1	8.13	7.27
6-26-2006	43000	21.95	8.12	7.09
6-26-2006	53000	21.81	8.1	7.09
6-26-2006	63000	21.64	8.09	7.03
6-26-2006	73000	21.46	8.08	6.92
6-26-2006	83000	21.46	8.07	6.96
6-26-2006	93000	21.3	8.06	6.85
6-26-2006	103000	21.35	8.07	6.81
6-26-2006	113000	21.49	8.07	6.82
6-26-2006	123000	21.79	8.07	6.87
6-26-2006	133000	22.17	8.06	6.93
6-26-2006	143000	22.38	8.07	7.01
6-26-2006	153000	22.67	8.09	7
6-26-2006	163000	22.95	8.11	7.09
6-26-2006	173000	23.15	8.12	7.17
6-26-2006	183000	23.26	8.16	7.33
6-26-2006	193000	23.62	8.2	7.38
6-26-2006	203000	23.39	8.23	7.43
6-26-2006	213000	23.35	8.23	7.47
6-26-2006	223000	23.44	8.18	7.36
6-26-2006	233000	23.35	8.19	7.22
6-27-2006	3000	23.21	8.17	7.29

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
6-27-2006	13000	23.12	8.16	7.28
6-27-2006	23000	22.95	8.12	7.25
6-27-2006	33000	22.92	8.12	7.09
6-27-2006	43000	22.63	8.08	7.11
6-27-2006	53000	22.52	8.06	6.98
6-27-2006	63000	22.35	8.05	7.01
6-27-2006	73000	22.27	8.04	6.93
6-27-2006	83000	22.26	7.99	7.24
6-27-2006	93000	22.13	8	7.18
6-27-2006	103000	22.1	7.98	7.18
6-27-2006	113000	22.22	8.03	7.19
6-27-2006	123000	22.52	8.03	7.24
6-27-2006	133000	22.69	8.04	7.19
6-27-2006	143000	22.67	8.03	7.27
6-27-2006	153000	22.9	8.05	7.26
6-27-2006	163000	23.21	8.1	7.37
6-27-2006	173000	23.37	8.14	7.52
6-27-2006	183000	23.39	8.14	7.56
6-27-2006	193000	23.42	8.15	7.62
6-27-2006	203000	23.1	8.16	7.71
6-27-2006	213000	22.99	8.14	7.73
6-27-2006	223000	22.92	8.08	7.51
6-27-2006	233000	22.83	8.1	7.52
6-28-2006	3000	22.77	8.1	7.55
6-28-2006	13000	22.65	8.09	7.48
6-28-2006	23000	22.51	8.05	7.38
6-28-2006	33000	22.4	8.05	7.37
6-28-2006	43000	22.15	8.03	7.44
6-28-2006	53000	21.99	8.01	7.51
6-28-2006	63000	21.88	8.02	7.32
6-28-2006	73000	21.78	8	7.26
6-28-2006	83000	21.63	7.97	7.32
6-28-2006	93000	21.65	7.98	7.29
6-28-2006	103000	21.72	7.97	7.31
6-28-2006	113000	21.76	7.98	7.37
6-28-2006	123000	21.9	7.91	7.37
6-28-2006	133000	21.95	8.01	7.47
6-28-2006	143000	22.03	7.98	7.52
6-28-2006	153000	22.35	8.07	7.54
6-28-2006	163000	22.58	8.06	7.75
6-28-2006	173000	22.69	8.1	7.64
6-28-2006	183000	22.88	8.13	7.8
6-28-2006	193000	23.01	8.17	7.91
6-28-2006	203000	22.99	8.16	7.88
6-28-2006	213000	22.88	8.15	7.94
6-28-2006	223000	22.61	8.15	7.89
6-28-2006	233000	22.51	8.13	7.82
6-29-2006	3000	22.36	8.12	7.71
6-29-2006	13000	22.26	8.09	7.64
6-29-2006	23000	22.11	8.06	7.43
6-29-2006	33000	22.01	8.07	7.51
6-29-2006	43000	21.83	8.06	7.4
6-29-2006	53000	21.65	8.05	7.35
6-29-2006	63000	21.49	8.02	7.37
6-29-2006	73000	21.33	8.01	7.21
6-29-2006	83000	21.41	7.99	7.2
6-29-2006	93000	21.35	8	7.33

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
6-29-2006	103000	21.51	8	7.4
6-29-2006	113000	21.74	8.01	7.33
6-29-2006	123000	22.08	8.03	7.38
6-29-2006	133000	22.17	8.05	7.38
6-29-2006	143000	22.54	8.1	7.6
6-29-2006	153000	22.58	8.14	7.67
6-29-2006	163000	22.95	8.19	7.9
6-29-2006	173000	23.19	8.26	8.06
6-29-2006	183000	23.37	8.29	8.05
6-29-2006	193000	23.64	8.31	8.09
6-29-2006	203000	23.48	8.31	7.99
6-29-2006	213000	23.46	8.28	7.94
6-29-2006	223000	23.41	8.28	7.9
6-29-2006	233000	23.26	8.26	7.8
6-30-2006	3000	23.12	8.23	7.73
6-30-2006	13000	22.88	8.21	7.58
6-30-2006	23000	22.7	8.16	7.42
6-30-2006	33000	22.47	8.13	7.41
6-30-2006	43000	22.27	8.12	7.3
6-30-2006	53000	21.99	8.09	7.27
6-30-2006	63000	21.83	8.06	7.18
6-30-2006	73000	21.71	8.05	7.09
6-30-2006	83000	21.72	8.04	7.08
6-30-2006	93000	21.76	8.02	7.06
6-30-2006	103000	21.79	7.99	7.15
6-30-2006	113000	22.13	8.03	7.18
6-30-2006	123000	22.31	8.07	7.23
6-30-2006	133000	22.81	8.1	7.31
6-30-2006	143000	22.9	8.14	7.46
6-30-2006	153000	23.28	8.18	7.43
6-30-2006	163000	23.7	8.23	7.77
6-30-2006	173000	23.91	8.28	7.76
6-30-2006	183000	24	8.31	7.94
6-30-2006	193000	24.26	8.32	7.99
6-30-2006	203000	23.99	8.3	7.85
6-30-2006	213000	23.93	8.31	7.76
6-30-2006	223000	23.88	8.29	7.67
6-30-2006	233000	23.79	8.25	7.69
7-1-2006	3000	23.62	8.24	7.6
7-1-2006	13000	23.51	8.22	7.58
7-1-2006	23000	23.44	8.21	7.47
7-1-2006	33000	23.26	8.19	7.42
7-1-2006	43000	23.19	8.17	7.47
7-1-2006	53000	22.92	8.14	7.26
7-1-2006	63000	22.86	8.13	7.27
7-1-2006	73000	22.72	8.1	7.26
7-1-2006	83000	22.54	8.09	7.11
7-1-2006	93000	22.45	8.06	7.15
7-1-2006	103000	22.33	8.05	7.12
7-1-2006	113000	22.26	8.06	7.09
7-1-2006	123000	22.19	8.04	7.19
7-1-2006	133000	22.35	8.06	7.15
7-1-2006	143000	22.42	8.07	7.17
7-1-2006	153000	22.63	8.09	7.25
7-1-2006	163000	22.79	8.1	7.24
7-1-2006	173000	22.9	8.13	7.48
7-1-2006	183000	23.01	8.13	7.41

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
7-1-2006	193000	23.03	8.16	7.36
7-1-2006	203000	23.06	8.17	7.41
7-1-2006	213000	23.1	8.19	7.38
7-1-2006	223000	23.12	8.2	7.52
7-1-2006	233000	23.17	8.2	7.57
7-2-2006	3000	23.12	8.19	7.55
7-2-2006	13000	23.03	8.19	7.46
7-2-2006	23000	22.97	8.17	7.44
7-2-2006	33000	22.85	8.16	7.34
7-2-2006	43000	22.78	8.15	7.35
7-2-2006	53000	22.65	8.13	7.28
7-2-2006	63000	22.4	8.13	7.3
7-2-2006	73000	22.4	8.09	7.24
7-2-2006	83000	22.36	8.08	7.15
7-2-2006	93000	22.35	8.07	7.03
7-2-2006	103000	22.31	8.06	7.18
7-2-2006	113000	22.43	8.08	7.21
7-2-2006	123000	22.67	8.1	7.2
7-2-2006	133000	22.79	8.11	7.11
7-2-2006	143000	23.03	8.12	7.25
7-2-2006	153000	23.24	8.14	7.3
7-2-2006	163000	23.35	8.18	7.38
7-2-2006	173000	23.6	8.23	7.63
7-2-2006	183000	23.75	8.26	7.71
7-2-2006	193000	23.9	8.29	7.69
7-2-2006	203000	23.97	8.29	7.56
7-2-2006	213000	23.99	8.3	7.63
7-2-2006	223000	23.95	8.3	7.66
7-2-2006	233000	23.9	8.3	7.65
7-3-2006	3000	23.84	8.3	7.65
7-3-2006	13000	23.7	8.26	7.61
7-3-2006	23000	23.53	8.24	7.4
7-3-2006	33000	23.41	8.22	7.51
7-3-2006	43000	23.39	8.21	7.33
7-3-2006	53000	23.15	8.16	7.37
7-3-2006	63000	22.97	8.16	7.25
7-3-2006	73000	22.92	8.13	7.14
7-3-2006	83000	23.12	8.12	7.17
7-3-2006	93000	23.06	8.11	7.17
7-3-2006	103000	22.97	8.08	7.05
7-3-2006	113000	22.74	8.08	7.03
7-3-2006	123000	22.61	8.06	6.99
7-3-2006	133000	22.77	8.06	6.95
7-3-2006	143000	22.95	8.1	7.02
7-3-2006	153000	23.3	8.1	7.19
7-3-2006	163000	23.5	8.14	7.29
7-3-2006	173000	23.66	8.17	7.41
7-3-2006	183000	23.86	8.2	7.45
7-3-2006	193000	24.1	8.19	7.4
7-3-2006	203000	23.82	8.21	7.38
7-3-2006	213000	23.9	8.21	7.34
7-3-2006	223000	23.93	8.21	7.52
7-3-2006	233000	23.97	8.22	7.29
7-4-2006	3000	23.93	8.22	7.31
7-4-2006	13000	23.9	8.22	7.25
7-4-2006	23000	23.79	8.21	7.16
7-4-2006	33000	23.73	8.2	7.26

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
7-4-2006	43000	23.55	8.17	7.17
7-4-2006	53000	23.37	8.18	7.12
7-4-2006	63000	23.21	8.14	7.07
7-4-2006	73000	23.01	8.14	7.13
7-4-2006	83000	22.97	8.12	6.91
7-4-2006	93000	22.81	8.12	6.85
7-4-2006	103000	22.72	8.09	6.92
7-4-2006	113000	22.69	8.1	6.96
7-4-2006	123000	22.79	8.11	7.03
7-4-2006	133000	22.79	8.16	7.23
7-4-2006	143000	23.08	8.21	7.3
7-4-2006	153000	23.15	8.2	7.47
7-4-2006	163000	23.28	8.24	7.53
7-4-2006	173000	23.44	8.28	7.64
7-4-2006	183000	23.55	8.27	7.69
7-4-2006	193000	23.57	8.27	7.73
7-4-2006	203000	23.6	8.32	7.7
7-4-2006	213000	23.6	8.34	7.6
7-4-2006	223000	23.59	8.34	7.68
7-4-2006	233000	23.59	8.32	7.62
7-5-2006	3000	23.53	8.32	7.7
7-5-2006	13000	23.39	8.29	7.53
7-5-2006	23000	23.26	8.27	7.47
7-5-2006	33000	23.12	8.25	7.43
7-5-2006	43000	22.99	8.22	7.31
7-5-2006	53000	22.86	8.2	7.17
7-5-2006	63000	22.81	8.18	7.24
7-5-2006	73000	22.51	8.17	7.1
7-5-2006	83000	22.9	8.13	7.13
7-5-2006	93000	22.47	8.11	7.09
7-5-2006	103000	22.43	8.09	7.09
7-5-2006	113000	22.54	8.11	7.04
7-5-2006	123000	22.56	8.09	7.06
7-5-2006	133000	22.56	8.12	7
7-5-2006	143000	22.77	8.13	7.06
7-5-2006	153000	22.9	8.15	7.19
7-5-2006	163000	23.04	8.18	7.37
7-5-2006	173000	23.37	8.23	7.54
7-5-2006	183000	23.5	8.29	7.75
7-5-2006	193000	23.62	8.34	7.85
7-5-2006	203000	23.48	8.36	7.77
7-5-2006	213000	23.53	8.39	7.78
7-5-2006	223000	23.6	8.36	7.7
7-5-2006	233000	23.57	8.34	7.72
7-6-2006	3000	23.46	8.32	7.7
7-6-2006	13000	23.35	8.3	7.62
7-6-2006	23000	23.28	8.28	7.54
7-6-2006	33000	23.1	8.27	7.51
7-6-2006	43000	22.97	8.24	7.38
7-6-2006	53000	22.81	8.21	7.28
7-6-2006	63000	22.67	8.18	7.19
7-6-2006	73000	22.49	8.17	7.17
7-6-2006	83000	22.67	8.14	7
7-6-2006	93000	22.49	8.1	7.11
7-6-2006	103000	22.49	8.09	7
7-6-2006	113000	22.61	8.1	7.08
7-6-2006	123000	22.69	8.09	7.02

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
7-6-2006	133000	22.86	8.1	7
7-6-2006	143000	23.13	8.12	7.12
7-6-2006	153000	23.33	8.16	7.38
7-6-2006	163000	23.53	8.23	7.52
7-6-2006	173000	23.8	8.25	7.65
7-6-2006	183000	23.97	8.31	7.73
7-6-2006	193000	24.15	8.35	7.91
7-6-2006	203000	24.3	8.37	7.88
7-6-2006	213000	24.46	8.37	7.91
7-6-2006	223000	24.41	8.37	7.79
7-6-2006	233000	24.5	8.36	7.62
7-7-2006	3000	24.41	8.35	7.7
7-7-2006	13000	24.22	8.31	7.64
7-7-2006	23000	24.22	8.29	7.48
7-7-2006	33000	23.99	8.28	7.53
7-7-2006	43000	23.77	8.23	7.41
7-7-2006	53000	23.5	8.2	7.42
7-7-2006	63000	23.35	8.17	7.24
7-7-2006	73000	23.1	8.14	7.06
7-7-2006	83000	22.95	8.09	7.02
7-7-2006	93000	22.85	8.08	6.83
7-7-2006	103000	22.9	8.06	6.77
7-7-2006	113000	22.92	8.07	6.86
7-7-2006	123000	23.08	8.08	6.93
7-7-2006	133000	23.28	8.11	6.96
7-7-2006	143000	23.39	8.13	7.12
7-7-2006	153000	23.59	8.17	7.29
7-7-2006	163000	23.84	8.21	7.41
7-7-2006	173000	23.99	8.23	7.42
7-7-2006	183000	24.04	8.25	7.41
7-7-2006	193000	24.15	8.27	7.43
7-7-2006	203000	24.19	8.29	7.51
7-7-2006	213000	24.32	8.36	7.64
7-7-2006	223000	24.37	8.37	7.58
7-7-2006	233000	24.43	8.39	7.67
7-8-2006	3000	24.37	8.37	7.6
7-8-2006	13000	24.32	8.38	7.47
7-8-2006	23000	24.28	8.35	7.37
7-8-2006	33000	24.17	8.32	7.39
7-8-2006	43000	24.06	8.32	7.4
7-8-2006	53000	23.86	8.28	7.33
7-8-2006	63000	23.7	8.26	7.28
7-8-2006	73000	23.57	8.22	7.22
7-8-2006	83000	23.55	8.2	6.96
7-8-2006	93000	23.44	8.19	6.97
7-8-2006	103000	23.48	8.18	6.96
7-8-2006	113000	23.51	8.17	6.93
7-8-2006	123000	23.5	8.17	6.96
7-8-2006	133000	23.5	8.19	7.12
7-8-2006	143000	23.5	8.17	7.03
7-8-2006	153000	23.44	8.17	7.13
7-8-2006	163000	23.44	8.17	6.97
7-8-2006	173000	23.46	8.15	7.05
7-8-2006	183000	23.42	8.15	6.97
7-8-2006	193000	23.44	8.16	7.12
7-8-2006	203000	23.5	8.2	7.16
7-8-2006	213000	23.55	8.24	7.26

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
7-8-2006	223000	23.53	8.27	7.29
7-8-2006	233000	23.55	8.28	7.54
7-9-2006	3000	23.55	8.25	7.39
7-9-2006	13000	23.59	8.24	7.31
7-9-2006	23000	23.46	8.25	7.11
7-9-2006	33000	23.44	8.22	7.33
7-9-2006	43000	23.39	8.21	7.25
7-9-2006	53000	23.32	8.18	7.12
7-9-2006	63000	23.24	8.18	7.15
7-9-2006	73000	23.17	8.15	7.08
7-9-2006	83000	23.12	8.13	6.9
7-9-2006	93000	23.15	8.12	6.88
7-9-2006	103000	23.17	8.12	6.8
7-9-2006	113000	23.37	8.13	6.93
7-9-2006	123000	23.46	8.17	6.89
7-9-2006	133000	23.55	8.16	6.89
7-9-2006	143000	23.7	8.2	6.96
7-9-2006	153000	23.79	8.19	7
7-9-2006	163000	23.79	8.22	7.17
7-9-2006	173000	23.86	8.21	7.06
7-9-2006	183000	23.8	8.21	7.33
7-9-2006	193000	23.9	8.24	7.18
7-9-2006	203000	23.79	8.26	7.43
7-9-2006	213000	23.66	8.29	7.32
7-9-2006	223000	23.66	8.3	7.43
7-9-2006	233000	23.57	8.31	7.38
7-10-2006	3000	23.55	8.31	7.39
7-10-2006	13000	23.41	8.31	7.25
7-10-2006	23000	23.39	8.31	7.56
7-10-2006	33000	23.24	8.3	7.29
7-10-2006	43000	23.08	8.3	7.32
7-10-2006	53000	22.9	8.29	7.22
7-10-2006	63000	22.72	8.26	7.22
7-10-2006	73000	22.51	8.23	7.02
7-10-2006	83000	22.22	8.19	6.9
7-10-2006	93000	21.97	8.17	6.82
7-10-2006	103000	21.94	8.15	7
7-10-2006	113000	21.95	8.16	6.91
7-10-2006	123000	22.03	8.17	7.04
7-10-2006	133000	22.26	8.18	6.88
7-10-2006	143000	22.47	8.19	6.93
7-10-2006	153000	22.69	8.21	7.07
7-10-2006	163000	22.94	8.26	7.16
7-10-2006	173000	23.15	8.26	7.15
7-10-2006	183000	23.32	8.27	7.15
7-10-2006	193000	23.5	8.32	7.17
7-10-2006	203000	23.57	8.32	7.36
7-10-2006	213000	23.48	8.33	7.47
7-10-2006	223000	23.46	8.37	7.37
7-10-2006	233000	23.48	8.39	7.27
7-11-2006	3000	23.5	8.39	7.59
7-11-2006	13000	23.57	8.38	7.52
7-11-2006	23000	23.58	8.4	7.54
7-11-2006	33000	23.44	8.41	7.57
7-11-2006	43000	23.26	8.42	7.61
7-11-2006	53000	23.21	8.38	7.61
7-11-2006	63000	23.13	8.4	7.35

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
7-11-2006	73000	23.01	8.37	7.45
7-11-2006	83000	22.88	8.34	7.29
7-11-2006	93000	22.76	8.28	7.29
7-11-2006	103000	22.7	8.27	7.16
7-11-2006	113000	22.69	8.28	7.22
7-11-2006	123000	22.65	8.25	7.27
7-11-2006	133000	22.69	8.27	7.09
7-11-2006	143000	22.78	8.25	7.14
7-11-2006	153000	22.85	8.29	7.19
7-11-2006	163000	22.94	8.28	7.2
7-11-2006	173000	23.06	8.28	7.32
7-11-2006	183000	23.15	8.32	7.45
7-11-2006	193000	23.21	8.33	7.51
7-11-2006	203000	23.28	8.39	7.56
7-11-2006	213000	23.28	8.41	7.65
7-11-2006	223000	23.3	8.42	7.56
7-11-2006	233000	23.48	8.4	7.46
7-12-2006	3000	23.46	8.4	7.57
7-12-2006	13000	23.9	8.41	7.65
7-12-2006	23000	24.04	8.41	7.6
7-12-2006	33000	23.86	8.41	7.46
7-12-2006	43000	23.86	8.42	7.4
7-12-2006	53000	23.6	8.39	7.57
7-12-2006	63000	23.55	8.39	7.39
7-12-2006	73000	23.35	8.35	7.48
7-12-2006	83000	23.24	8.34	7.3
7-12-2006	93000	23.22	8.29	7.77
7-12-2006	103000	23.22	8.27	7.69
7-12-2006	113000	23.35	8.27	7.26
7-12-2006	123000	23.46	8.27	7.43
7-12-2006	133000	23.6	8.26	7.48
7-12-2006	143000	23.84	8.29	6.97
7-12-2006	153000	24.04	8.3	7.13
7-12-2006	163000	24.19	8.29	7.24
7-12-2006	173000	24.37	8.3	7.5
7-12-2006	183000	24.5	8.32	7.34
7-12-2006	193000	24.52	8.37	7.49
7-12-2006	203000	24.5	8.34	7.35
7-12-2006	213000	24.5	8.37	7.41
7-12-2006	223000	24.52	8.41	7.38
7-12-2006	233000	24.48	8.41	7.58
7-13-2006	3000	24.44	8.42	6.93
7-13-2006	13000	24.41	8.41	7.56
7-13-2006	23000	24.41	8.39	7.4
7-13-2006	33000	24.41	8.4	7.21
7-13-2006	43000	24.43	8.39	7.66
7-13-2006	53000	24.39	8.39	7.35
7-13-2006	63000	24.39	8.39	7.59
7-13-2006	73000	24.32	8.4	6.9
7-13-2006	83000	24.35	8.34	6.85
7-13-2006	93000	24.28	8.33	7.54
7-13-2006	103000	24.37	8.33	7.56
7-13-2006	113000	24.35	8.33	7.28
7-13-2006	123000	24.46	8.34	7.15
7-13-2006	133000	24.65	8.37	7.2
7-13-2006	143000	24.78	8.33	7.34
7-13-2006	153000	24.78	8.35	7.28

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
7-13-2006	163000	25.09	8.35	6.98
7-13-2006	173000	25.29	8.37	6.84
7-13-2006	183000	25.27	8.37	6.87
7-13-2006	193000	25.42	8.4	6.99
7-13-2006	203000	25.22	8.46	7.21
7-13-2006	213000	25.29	8.47	7.07
7-13-2006	223000	25.32	8.47	7.03
7-13-2006	233000	25.27	8.48	7.52
7-14-2006	3000	25.37	8.47	7.17
7-14-2006	13000	25.29	8.48	7.26
7-14-2006	23000	25.33	8.49	6.92
7-14-2006	33000	25.44	8.49	7.59
7-14-2006	43000	25.31	8.47	7.01
7-14-2006	53000	25.33	8.47	7.44
7-14-2006	63000	25.27	8.46	7.47
7-14-2006	73000	25.2	8.45	7.47
7-14-2006	83000	25.54	8.41	7.13
7-14-2006	93000	25.2	8.39	6.87
7-14-2006	103000	25.27	8.35	7.04
7-14-2006	113000	24.89	8.36	7.23
7-14-2006	123000	24.66	8.37	7.16
7-14-2006	133000	24.72	8.34	6.95
7-14-2006	143000	24.7	8.29	7.04
7-14-2006	153000	24.92	8.31	6.8
7-14-2006	163000	25.07	8.29	7.04
7-14-2006	173000	25.11	8.31	7.26
7-14-2006	183000	25.18	8.33	7.2
7-14-2006	193000	25.27	8.37	6.9
7-14-2006	203000	24.92	8.35	7.1
7-14-2006	213000	24.94	8.36	7.08
7-14-2006	223000	24.94	8.37	6.92
7-14-2006	233000	24.9	8.36	7.31
7-15-2006	3000	24.83	8.37	7
7-15-2006	13000	24.81	8.35	7.11
7-15-2006	23000	24.92	8.35	6.79
7-15-2006	33000	24.78	8.34	6.92
7-15-2006	43000	24.7	8.35	7.3
7-15-2006	53000	24.72	8.35	6.87
7-15-2006	63000	24.72	8.34	7.02
7-15-2006	73000	24.65	8.34	7.15
7-15-2006	83000	24.57	8.34	7.22
7-15-2006	93000	24.57	8.27	7.03
7-15-2006	103000	24.57	8.29	7.08
7-15-2006	113000	24.65	8.26	6.75
7-15-2006	123000	24.79	8.31	6.83
7-15-2006	133000	24.9	8.33	6.93
7-15-2006	143000	25.22	8.35	6.89
7-15-2006	153000	25.39	8.35	7.13
7-15-2006	163000	25.52	8.37	7.09
7-15-2006	173000	25.61	8.41	7.21
7-15-2006	183000	25.66	8.4	6.95
7-15-2006	193000	25.72	8.42	6.84
7-15-2006	203000	25.76	8.46	7.12
7-15-2006	213000	25.76	8.47	7.23
7-15-2006	223000	25.76	8.42	7.25
7-15-2006	233000	25.78	8.43	7.27
7-16-2006	3000	25.82	8.5	7.23

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
7-16-2006	13000	25.83	8.51	7.15
7-16-2006	23000	25.91	8.51	6.95
7-16-2006	33000	25.89	8.54	7.3
7-16-2006	43000	25.87	8.51	6.98
7-16-2006	53000	25.8	8.51	7.35
7-16-2006	63000	25.72	8.48	7.06
7-16-2006	73000	25.61	8.46	7.22
7-16-2006	83000	25.52	8.39	7.09
7-16-2006	93000	25.37	8.36	6.89
7-16-2006	103000	25.24	8.32	7.1
7-16-2006	113000	25.11	8.28	7.04
7-16-2006	123000	25.14	8.26	6.51
7-16-2006	133000	25.14	8.26	6.6
7-16-2006	143000	25.18	8.25	7.15
7-16-2006	153000	25.31	8.25	6.98
7-16-2006	163000	25.48	8.28	6.7
7-16-2006	173000	25.55	8.28	6.75
7-16-2006	183000	25.68	8.31	6.98
7-16-2006	193000	25.78	8.31	6.77
7-16-2006	203000	25.78	8.33	6.95
7-16-2006	213000	25.87	8.35	6.96
7-16-2006	223000	25.91	8.36	7.3
7-16-2006	233000	25.98	8.36	6.64
7-17-2006	3000	25.93	8.38	6.89
7-17-2006	13000	25.98	8.38	7.09
7-17-2006	23000	25.97	8.37	6.89
7-17-2006	33000	25.97	8.35	6.91
7-17-2006	43000	25.98	8.4	6.88
7-17-2006	53000	25.95	8.38	6.92
7-17-2006	63000	25.87	8.39	6.82
7-17-2006	73000	25.85	8.37	7.02
7-17-2006	83000	26.23	8.35	6.92
7-17-2006	93000	26.06	8.34	6.77
7-17-2006	103000	26.13	8.34	6.65
7-17-2006	113000	26.19	8.32	6.65
7-17-2006	123000	26.08	8.31	6.9
7-17-2006	133000	26.25	8.3	6.75
7-17-2006	143000	26.3	8.31	6.51
7-17-2006	153000	26.42	8.32	6.59
7-17-2006	163000	26.55	8.37	6.58
7-17-2006	173000	26.72	8.39	6.67
7-17-2006	183000	26.64	8.42	6.74
7-17-2006	193000	26.66	8.46	6.8
7-17-2006	203000	26.1	8.46	6.76
7-17-2006	213000	25.98	8.43	6.84
7-17-2006	223000	26	8.51	6.87
7-17-2006	233000	25.97	8.49	6.87
7-18-2006	3000	25.95	8.49	6.93
7-18-2006	13000	25.87	8.51	6.74
7-18-2006	23000	25.85	8.49	6.79
7-18-2006	33000	25.78	8.51	6.85
7-18-2006	43000	25.7	8.5	6.89
7-18-2006	53000	25.5	8.47	6.82
7-18-2006	63000	25.31	8.43	6.8
7-18-2006	73000	25.22	8.4	6.79
7-18-2006	83000	25.54	8.36	6.52
7-18-2006	93000	25.18	8.4	6.52

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)	Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
7-18-2006	103000	25.05	8.37	6.5	7-20-2006	193000	26.29	8.6	7.01
7-18-2006	113000	25.44	8.35	6.44	7-20-2006	203000	26.55	8.61	7.05
7-18-2006	123000	25.57	8.36	6.49	7-20-2006	213000	26.38	8.62	7.31
7-18-2006	133000	25.54	8.35	7.03	7-20-2006	223000	26.36	8.64	7.31
7-18-2006	143000	25.57	8.38	6.65	7-20-2006	233000	26.3	8.65	7.1
7-18-2006	153000	25.91	8.39	6.99	7-21-2006	3000	26.29	8.66	7.01
7-18-2006	163000	26.08	8.39	6.86	7-21-2006	13000	26.23	8.68	7.38
7-18-2006	173000	26.27	8.41	6.7	7-21-2006	23000	26.19	8.69	7.1
7-18-2006	183000	26.42	8.42	6.92	7-21-2006	33000	26.1	8.7	7.12
7-18-2006	193000	26.49	8.48	6.93	7-21-2006	43000	26.1	8.71	6.99
7-18-2006	203000	26.13	8.52	6.98	7-21-2006	53000	25.98	8.72	7.13
7-18-2006	213000	26.1	8.55	7.02	7-21-2006	63000	25.82	8.7	7.11
7-18-2006	223000	26.13	8.58	7.21	7-21-2006	73000	25.69	8.68	7.12
7-18-2006	233000	26.08	8.58	7.13	7-21-2006	83000	25.97	8.64	6.96
7-19-2006	3000	26.1	8.59	7.1	7-21-2006	93000	25.76	8.59	7.03
7-19-2006	13000	26.1	8.61	7.12	7-21-2006	103000	25.61	8.55	6.73
7-19-2006	23000	26.12	8.63	7.02	7-21-2006	113000	25.42	8.5	6.7
7-19-2006	33000	26.19	8.62	7.17	7-21-2006	123000	25.33	8.47	6.72
7-19-2006	43000	26.12	8.61	7.04	7-21-2006	133000	25.18	8.45	6.71
7-19-2006	53000	25.97	8.6	7.29	7-21-2006	143000	25.09	8.45	6.71
7-19-2006	63000	25.87	8.59	6.96	7-21-2006	153000	25.11	8.46	6.72
7-19-2006	73000	25.8	8.55	6.98	7-21-2006	163000	25.03	8.46	6.68
7-19-2006	83000	26.3	8.53	6.99	7-21-2006	173000	25.16	8.44	6.59
7-19-2006	93000	26.12	8.47	6.93	7-21-2006	183000	25.29	8.46	6.76
7-19-2006	103000	26.17	8.39	6.86	7-21-2006	193000	25.26	8.47	6.79
7-19-2006	113000	26.12	8.45	6.84	7-21-2006	203000	25.09	8.49	6.92
7-19-2006	123000	26.08	8.44	6.81	7-21-2006	213000	25.02	8.52	6.94
7-19-2006	133000	26.15	8.46	6.87	7-21-2006	223000	24.96	8.55	7.04
7-19-2006	143000	25.98	8.5	7.13	7-21-2006	233000	24.92	8.56	7.05
7-19-2006	153000	26.02	8.54	7.21	7-22-2006	3000	24.87	8.57	7.06
7-19-2006	163000	26.13	8.54	7.15	7-22-2006	13000	24.83	8.58	7.23
7-19-2006	173000	26.15	8.51	7	7-22-2006	23000	24.81	8.59	7.2
7-19-2006	183000	26.06	8.5	6.98	7-22-2006	33000	24.81	8.6	7.25
7-19-2006	193000	26.12	8.52	6.94	7-22-2006	43000	24.79	8.62	7.38
7-19-2006	203000	25.68	8.55	6.82	7-22-2006	53000	24.74	8.62	7.33
7-19-2006	213000	25.8	8.59	6.8	7-22-2006	63000	24.76	8.6	7.31
7-19-2006	223000	25.85	8.61	7.25	7-22-2006	73000	24.74	8.6	7.26
7-19-2006	233000	25.87	8.68	7.35	7-22-2006	83000	24.61	8.59	7.19
7-20-2006	3000	25.89	8.68	7.13	7-22-2006	93000	24.72	8.55	7.21
7-20-2006	13000	25.83	8.65	6.95	7-22-2006	103000	24.74	8.53	7.07
7-20-2006	23000	25.87	8.64	6.91	7-22-2006	113000	24.87	8.53	7.19
7-20-2006	33000	25.91	8.64	7.02	7-22-2006	123000	24.92	8.54	7.08
7-20-2006	43000	25.85	8.62	7.06	7-22-2006	133000	25.16	8.56	7.06
7-20-2006	53000	25.78	8.61	7.16	7-22-2006	143000	25.2	8.58	7.16
7-20-2006	63000	25.87	8.57	7.1	7-22-2006	153000	25.29	8.59	7.16
7-20-2006	73000	25.8	8.54	6.97	7-22-2006	163000	25.42	8.59	7.21
7-20-2006	83000	26.12	8.52	6.63	7-22-2006	173000	25.49	8.61	7.22
7-20-2006	93000	26.12	8.47	6.87	7-22-2006	183000	25.55	8.61	7.24
7-20-2006	103000	26.32	8.44	6.83	7-22-2006	193000	25.54	8.61	7.08
7-20-2006	113000	26.23	8.44	6.87	7-22-2006	203000	25.48	8.62	7.21
7-20-2006	123000	26.3	8.47	6.46	7-22-2006	213000	25.44	8.61	7.2
7-20-2006	133000	26.47	8.5	6.44	7-22-2006	223000	25.42	8.63	7.21
7-20-2006	143000	26.59	8.53	6.56	7-22-2006	233000	25.26	8.63	7.11
7-20-2006	153000	26.64	8.54	6.81	7-23-2006	3000	25.18	8.6	7.06
7-20-2006	163000	26.78	8.56	6.71	7-23-2006	13000	25.09	8.6	7.08
7-20-2006	173000	26.21	8.57	6.36	7-23-2006	23000	25.05	8.68	7.17
7-20-2006	183000	26.21	8.58	6.45	7-23-2006	33000	25	8.67	7.23

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
7-23-2006	43000	25	8.69	7.71
7-23-2006	53000	24.8	8.72	7.81
7-23-2006	63000	24.83	8.74	7.82
7-23-2006	73000	24.9	8.78	7.78
7-23-2006	83000	24.7	8.78	7.7
7-23-2006	93000	24.72	8.75	7.72
7-23-2006	103000	24.68	8.73	7.7
7-23-2006	113000	24.72	8.73	7.78
7-23-2006	123000	24.72	8.71	7.82
7-23-2006	133000	24.72	8.7	7.85
7-23-2006	143000	24.68	8.7	7.57
7-23-2006	153000	24.72	8.69	7.65
7-23-2006	163000	24.65	8.67	7.5
7-23-2006	173000	24.68	8.63	7.32
7-23-2006	183000	24.54	8.59	7.28
7-23-2006	193000	24.5	8.58	6.88
7-23-2006	203000	24.33	8.53	6.8
7-23-2006	213000	24.21	8.5	6.55
7-23-2006	223000	24.19	8.48	7.04
7-23-2006	233000	24.08	8.48	6.59
7-24-2006	3000	24.11	8.48	6.62
7-24-2006	13000	24.11	8.5	6.78
7-24-2006	23000	24.13	8.52	6.66
7-24-2006	33000	24.1	8.53	6.78
7-24-2006	43000	24.19	8.57	7.08
7-24-2006	53000	24.21	8.58	7.13
7-24-2006	63000	24.19	8.58	7.19
7-24-2006	73000	24.22	8.59	7.18
7-24-2006	83000	24.74	8.58	7.07
7-24-2006	93000	24.98	8.57	7.01
7-24-2006	103000	25.03	8.53	7.05
7-24-2006	113000	25.14	8.53	7.03
7-24-2006	123000	25.07	8.53	6.89
7-24-2006	133000	25.39	8.54	7.04
7-24-2006	143000	25.61	8.54	7.12
7-24-2006	153000	25.82	8.55	7.23
7-24-2006	163000	25.87	8.56	6.98
7-24-2006	173000	25.97	8.58	6.92
7-24-2006	183000	26.02	8.59	7.04
7-24-2006	193000	26.1	8.58	6.93
7-24-2006	203000	25.83	8.61	7.18
7-24-2006	213000	25.57	8.61	7.35
7-24-2006	223000	25.55	8.63	7.07
7-24-2006	233000	25.55	8.63	7.22
7-25-2006	3000	25.61	8.66	6.98
7-25-2006	13000	25.54	8.67	7.06
7-25-2006	23000	25.55	8.69	7.07
7-25-2006	33000	25.59	8.71	7.08
7-25-2006	43000	25.55	8.72	7.39
7-25-2006	53000	25.5	8.75	7.39
7-25-2006	63000	25.48	8.75	7.25
7-25-2006	73000	25.39	8.75	7.3
7-25-2006	83000	25.91	8.72	7.17
7-25-2006	93000	25.93	8.7	7.03
7-25-2006	103000	25.93	8.69	7.14
7-25-2006	113000	25.78	8.69	7.19
7-25-2006	123000	26.04	8.7	7.25

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
7-25-2006	133000	26.19	8.69	7.38
7-25-2006	143000	26.21	8.7	7.38
7-25-2006	153000	26.44	8.69	7.34
7-25-2006	163000	26.57	8.69	7.1
7-25-2006	173000	26.55	8.67	7.21
7-25-2006	183000	26.42	8.65	7.16
7-25-2006	193000	26.34	8.66	7.13
7-25-2006	203000	25.91	8.67	7.01
7-25-2006	213000	25.78	8.66	7.08
7-25-2006	223000	25.7	8.66	7.07
7-25-2006	233000	25.8	8.67	7.04
7-26-2006	3000	25.8	8.69	7.11
7-26-2006	13000	25.78	8.71	7.12
7-26-2006	23000	25.82	8.73	7.14
7-26-2006	33000	25.68	8.75	7.15
7-26-2006	43000	25.8	8.77	7.28
7-26-2006	53000	25.7	8.78	7.25
7-26-2006	63000	25.67	8.79	7.16
7-26-2006	73000	25.63	8.77	7.23
7-26-2006	83000	26.1	8.73	7.07
7-26-2006	93000	26.12	8.7	7.12
7-26-2006	103000	26.08	8.68	6.98
7-26-2006	113000	26.04	8.63	7.08
7-26-2006	123000	25.98	8.63	6.88
7-26-2006	133000	26	8.62	6.91
7-26-2006	143000	26.02	8.59	6.83
7-26-2006	153000	26.19	8.61	6.85
7-26-2006	163000	26.21	8.59	6.68
7-26-2006	173000	26.3	8.59	6.88
7-26-2006	183000	26.38	8.62	6.6
7-26-2006	193000	26.38	8.62	7
7-26-2006	203000	25.74	8.63	6.84
7-26-2006	213000	25.72	8.64	7.01
7-26-2006	223000	25.7	8.63	6.95
7-26-2006	233000	25.63	8.63	6.87
7-27-2006	3000	25.55	8.62	6.6
7-27-2006	13000	25.47	8.62	6.81
7-27-2006	23000	25.46	8.63	6.78
7-27-2006	33000	25.39	8.63	6.89
7-27-2006	43000	25.42	8.64	6.91
7-27-2006	53000	25.35	8.65	6.9
7-27-2006	63000	25.37	8.66	6.85
7-27-2006	73000	25.4	8.65	6.71
7-27-2006	83000	25.85	8.65	6.68
7-27-2006	93000	25.88	8.63	6.75
7-27-2006	103000	25.78	8.61	6.74
7-27-2006	113000	25.93	8.6	6.49
7-27-2006	123000	26.04	8.61	6.71
7-27-2006	133000	26.04	8.61	6.73
7-27-2006	143000	26.23	8.61	6.7
7-27-2006	153000	26.21	8.6	6.54
7-27-2006	163000	26.21	8.58	6.83
7-27-2006	173000	26.42	8.57	6.68
7-27-2006	183000	26.36	8.55	6.49
7-27-2006	193000	26.32	8.54	6.6
7-27-2006	203000	25.78	8.58	6.77
7-27-2006	213000	25.83	8.58	6.96

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
7-27-2006	223000	25.98	8.8	6.92
7-27-2006	233000	25.85	8.63	7.01
7-28-2006	3000	25.85	8.66	6.99
7-28-2006	13000	25.83	8.67	7.02
7-28-2006	23000	25.85	8.7	7.1
7-28-2006	33000	25.85	8.72	7.14
7-28-2006	43000	25.82	8.74	7.28
7-28-2006	53000	25.87	8.76	7.26
7-28-2006	63000	26	8.76	7.37
7-28-2006	73000	25.85	8.77	7.39
7-28-2006	83000	26.38	8.76	7.28
7-28-2006	93000	26.15	8.73	7.3
7-28-2006	103000	26.13	8.7	7.29
7-28-2006	113000	26.02	8.67	7.23
7-28-2006	123000	26.17	8.64	7.09
7-28-2006	133000	26.19	8.62	7.1
7-28-2006	143000	26.12	8.6	7.06
7-28-2006	153000	26.51	8.58	7.01
7-28-2006	163000	26.55	8.58	7.03
7-28-2006	173000	26.64	8.57	6.99
7-28-2006	183000	26.8	8.6	7.03
7-28-2006	193000	26.7	8.6	7.06
7-28-2006	203000	26.25	8.59	7.17
7-28-2006	213000	26.06	8.58	7.06
7-28-2006	223000	26.12	8.6	7.18
7-28-2006	233000	25.95	8.58	7.18
7-29-2006	3000	25.97	8.59	7.24
7-29-2006	13000	25.91	8.6	7.08
7-29-2006	23000	25.93	8.6	7.07
7-29-2006	33000	25.95	8.6	7.06
7-29-2006	43000	25.95	8.63	7.13
7-29-2006	53000	25.95	8.65	7.23
7-29-2006	63000	25.93	8.66	7.27
7-29-2006	73000	25.87	8.66	7.24
7-29-2006	83000	25.72	8.66	7.2
7-29-2006	93000	25.54	8.63	7.08
7-29-2006	103000	25.39	8.56	6.96
7-29-2006	113000	25.4	8.52	7
7-29-2006	123000	25.44	8.5	6.84
7-29-2006	133000	25.46	8.49	6.83
7-29-2006	143000	25.65	8.49	6.87
7-29-2006	153000	26	8.51	6.9
7-29-2006	163000	26	8.52	6.84
7-29-2006	173000	26.25	8.54	6.87
7-29-2006	183000	26.4	8.56	6.93
7-29-2006	193000	26.44	8.6	6.96
7-29-2006	203000	26.3	8.62	7.04
7-29-2006	213000	26.34	8.61	6.93
7-29-2006	223000	26.15	8.6	6.81
7-29-2006	233000	26.13	8.59	7.04
7-30-2006	3000	26.12	8.6	6.92
7-30-2006	13000	26.1	8.61	7.04
7-30-2006	23000	26.1	8.64	7.05
7-30-2006	33000	26.13	8.65	7.13
7-30-2006	43000	26.13	8.68	7.14
7-30-2006	53000	26.17	8.7	7.29
7-30-2006	63000	26.12	8.72	7.25

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
7-30-2006	73000	26.03	8.71	7.15
7-30-2006	83000	25.97	8.69	7.14
7-30-2006	93000	25.8	8.65	7.08
7-30-2006	103000	25.78	8.61	6.88
7-30-2006	113000	25.68	8.55	6.77
7-30-2006	123000	25.63	8.51	6.66
7-30-2006	133000	26.5	8.47	6.71
7-30-2006	143000	25.31	8.45	6.65
7-30-2006	153000	25.22	8.41	6.51
7-30-2006	163000	25.13	8.38	6.32
7-30-2006	173000	25.02	8.37	6.24
7-30-2006	183000	25.05	8.39	6.36
7-30-2006	193000	25.07	8.44	6.55
7-30-2006	203000	25.11	8.49	6.61
7-30-2006	213000	25.11	8.51	6.69
7-30-2006	223000	25.03	8.48	6.74
7-30-2006	233000	25.05	8.51	6.67
7-31-2006	3000	24.98	8.43	6.46
7-31-2006	13000	24.89	8.4	6.35
7-31-2006	23000	24.9	8.38	6.16
7-31-2006	33000	24.7	8.35	6.05
7-31-2006	43000	24.66	8.34	5.97
7-31-2006	53000	24.59	8.31	5.8
7-31-2006	63000	24.44	8.3	5.77
7-31-2006	73000	24.32	8.3	5.68
7-31-2006	83000	24.61	8.31	5.63
7-31-2006	93000	24.74	8.32	5.68
7-31-2006	103000	25.11	8.38	6.19
7-31-2006	113000	25.39	8.41	6.3
7-31-2006	123000	25.67	8.48	6.53
7-31-2006	133000	25.97	8.55	6.75
7-31-2006	143000	26.32	8.62	7.08
7-31-2006	153000	26.74	8.72	7.34
7-31-2006	163000	26.99	8.81	7.56
7-31-2006	173000	27.22	8.88	7.53
7-31-2006	183000	27.22	8.89	7.61
7-31-2006	193000	27.14	8.88	7.71
7-31-2006	203000	27.03	8.87	7.53
7-31-2006	213000	26.82	8.82	7.45
7-31-2006	223000	26.78	8.76	7.32
7-31-2006	233000	26.7	8.69	7.11
8-1-2006	3000	26.53	8.67	7.06
8-1-2006	13000	26.51	8.63	7.08
8-1-2006	23000	26.36	8.57	6.83
8-1-2006	33000	26.13	8.53	6.98
8-1-2006	43000	26.1	8.5	6.82
8-1-2006	53000	25.87	8.45	6.79
8-1-2006	63000	25.76	8.42	6.5
8-1-2006	73000	25.83	8.4	6.69
8-1-2006	83000	25.63	8.39	6.32
8-1-2006	93000	25.48	8.38	6.66
8-1-2006	103000	25.54	8.39	6.28
8-1-2006	113000	25.42	8.4	6.7
8-1-2006	123000	25.48	8.42	6.4
8-1-2006	133000	25.5	8.42	6.68
8-1-2006	143000	25.57	8.46	6.9
8-1-2006	153000	25.67	8.5	6.84

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
8-1-2006	163000	25.78	8.54	7.18
8-1-2006	173000	25.76	8.57	7.28
8-1-2006	183000	25.8	8.6	7.12
8-1-2006	193000	25.8	8.6	7.39
8-1-2006	203000	25.82	8.62	7.32
8-1-2006	213000	25.83	8.61	7.28
8-1-2006	223000	25.83	8.59	7.29
8-1-2006	233000	25.85	8.57	6.93
8-2-2006	3000	25.59	8.53	6.92
8-2-2006	13000	25.57	8.53	6.83
8-2-2006	23000	25.54	8.49	6.97
8-2-2006	33000	25.39	8.44	6.91
8-2-2006	43000	25.31	8.41	6.88
8-2-2006	53000	25.2	8.41	6.79
8-2-2006	63000	25.2	8.38	6.76
8-2-2006	73000	25.16	8.38	6.82
8-2-2006	83000	24.9	8.35	6.9
8-2-2006	93000	24.83	8.34	6.24
8-2-2006	103000	24.52	8.35	6.15
8-2-2006	113000	24.48	8.37	6.22
8-2-2006	123000	24.61	8.4	6.28
8-2-2006	133000	24.83	8.41	6.34
8-2-2006	143000	24.89	8.48	6.42
8-2-2006	153000	25.2	8.49	6.44
8-2-2006	163000	25.26	8.52	6.61
8-2-2006	173000	25.27	8.56	6.75
8-2-2006	183000	25.33	8.6	6.86
8-2-2006	193000	25.59	8.59	6.87
8-2-2006	203000	25.22	8.6	6.9
8-2-2006	213000	25.2	8.59	6.99
8-2-2006	223000	25.2	8.55	6.78
8-2-2006	233000	25.14	8.53	6.65
8-3-2006	3000	25.11	8.5	6.6
8-3-2006	13000	24.92	8.47	6.38
8-3-2006	23000	24.85	8.45	6.42
8-3-2006	33000	24.66	8.43	6.39
8-3-2006	43000	24.54	8.4	6.32
8-3-2006	53000	24.46	8.38	6.31
8-3-2006	63000	24.37	8.34	6.19
8-3-2006	73000	24.19	8.32	6.12
8-3-2006	83000	24.44	8.31	6.21
8-3-2006	93000	24.5	8.33	6.23
8-3-2006	103000	24.76	8.35	6.21
8-3-2006	113000	24.81	8.39	6.44
8-3-2006	123000	25.16	8.45	6.56
8-3-2006	133000	25.44	8.52	6.66
8-3-2006	143000	25.72	8.59	6.86
8-3-2006	153000	26.02	8.69	7.14
8-3-2006	163000	26.23	8.8	7.45
8-3-2006	173000	26.57	8.89	7.54
8-3-2006	183000	26.63	8.91	7.68
8-3-2006	193000	26.49	8.92	7.72
8-3-2006	203000	26.19	8.92	7.75
8-3-2006	213000	26.02	8.89	7.77
8-3-2006	223000	25.82	8.83	7.51
8-3-2006	233000	25.55	8.75	7.42
8-4-2006	3000	25.52	8.71	7.2

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
8-4-2006	13000	25.26	8.65	7.01
8-4-2006	23000	25.18	8.58	6.83
8-4-2006	33000	25.05	8.54	6.68
8-4-2006	43000	24.92	8.51	6.63
8-4-2006	53000	24.66	8.46	6.48
8-4-2006	63000	24.7	8.42	6.32
8-4-2006	73000	24.57	8.4	6.38
8-4-2006	83000	24.9	8.38	6.3
8-4-2006	93000	25.02	8.38	6.28
8-4-2006	103000	24.52	8.4	6.37
8-4-2006	113000	24.66	8.42	6.52
8-4-2006	123000	24.98	8.4	6.65
8-4-2006	133000	25.2	8.51	6.83
8-4-2006	143000	25.48	8.58	6.99
8-4-2006	153000	25.83	8.66	7.19
8-4-2006	163000	26.1	8.79	7.51
8-4-2006	173000	26.32	8.66	7.63
8-4-2006	183000	26.45	8.9	7.77
8-4-2006	193000	26.61	8.93	7.86
8-4-2006	203000	26.19	8.94	7.79
8-4-2006	213000	26.04	8.91	7.74
8-4-2006	223000	25.91	8.81	7.48
8-4-2006	233000	25.89	8.83	7.33
8-5-2006	3000	25.7	8.78	7.12
8-5-2006	13000	25.5	8.74	7
8-5-2006	23000	25.35	8.8	6.8
8-5-2006	33000	25.18	8.65	6.78
8-5-2006	43000	25.05	8.6	6.6
8-5-2006	53000	24.94	8.65	6.61
8-5-2006	63000	24.76	8.59	6.31
8-5-2006	73000	24.61	8.55	6.43
8-5-2006	83000	24.59	8.51	6.26
8-5-2006	93000	24.41	8.49	6.13
8-5-2006	103000	24.39	8.44	6.34
8-5-2006	113000	24.52	8.47	6.45
8-5-2006	123000	24.65	8.39	6.41
8-5-2006	133000	24.89	8.45	6.71
8-5-2006	143000	25.11	8.48	6.69
8-5-2006	153000	25.16	8.54	6.87
8-5-2006	163000	25.24	8.69	7.04
8-5-2006	173000	25.35	8.73	7.28
8-5-2006	183000	25.37	8.66	7.29
8-5-2006	193000	25.37	8.77	7.25
8-5-2006	203000	25.27	8.77	7.27
8-5-2006	213000	25.22	8.67	7.26
8-5-2006	223000	25.2	8.69	6.95
8-5-2006	233000	25.16	8.68	6.97
8-6-2006	3000	24.94	8.65	6.83
8-6-2006	13000	24.86	8.61	6.83
8-6-2006	23000	24.79	8.58	6.73
8-6-2006	33000	24.66	8.56	6.57
8-6-2006	43000	24.65	8.53	6.51
8-6-2006	53000	24.44	8.5	6.42
8-6-2006	63000	24.46	8.48	6.28
8-6-2006	73000	24.41	8.46	6.1
8-6-2006	83000	24.37	8.44	6.08
8-6-2006	93000	24.13	8.42	6.22

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
8-8-2006	103000	24.22	8.35	6.29
8-8-2006	113000	24.32	8.37	6.28
8-8-2006	123000	24.55	8.36	6.3
8-8-2006	133000	24.7	8.38	6.51
8-8-2006	143000	24.98	8.52	6.48
8-8-2006	153000	25.18	8.56	6.7
8-8-2006	163000	25.48	8.62	6.73
8-8-2006	173000	25.82	8.68	6.84
8-8-2006	183000	25.98	8.72	6.85
8-8-2006	193000	25.89	8.78	7.02
8-8-2006	203000	25.87	8.8	7.07
8-8-2006	213000	25.82	8.82	7.2
8-8-2006	223000	25.68	8.82	7
8-8-2006	233000	25.65	8.8	6.9
8-7-2006	3000	25.52	8.73	6.82
8-7-2006	13000	25.48	8.73	6.72
8-7-2006	23000	25.22	8.68	6.66
8-7-2006	33000	25.09	8.63	6.61
8-7-2006	43000	24.85	8.61	6.48
8-7-2006	53000	24.72	8.53	6.31
8-7-2006	63000	24.59	8.51	6.4
8-7-2006	73000	24.39	8.47	6.32
8-7-2006	83000	24.55	8.41	6.26
8-7-2006	93000	24.44	8.43	6.21
8-7-2006	103000	24.48	8.38	6.2
8-7-2006	113000	24.55	8.4	6.23
8-7-2006	123000	24.72	8.42	6.38
8-7-2006	133000	24.81	8.44	6.41
8-7-2006	143000	24.98	8.46	6.48
8-7-2006	153000	25	8.48	6.66
8-7-2006	163000	25.2	8.53	6.67
8-7-2006	173000	25.33	8.57	6.89
8-7-2006	183000	25.48	8.6	7.02
8-7-2006	193000	25.22	8.64	7.01
8-7-2006	203000	25.13	8.68	7.14
8-7-2006	213000	25.02	8.73	7.02
8-7-2006	223000	24.96	8.72	7.21
8-7-2006	233000	24.89	8.78	7.17
8-8-2006	3000	24.87	8.71	6.9
8-8-2006	13000	24.76	8.72	6.95
8-8-2006	23000	24.7	8.7	6.87
8-8-2006	33000	24.57	8.72	6.86
8-8-2006	43000	24.44	8.69	6.68
8-8-2006	53000	24.44	8.65	6.65
8-8-2006	63000	24.22	8.65	6.68
8-8-2006	73000	23.97	8.62	6.32
8-8-2006	83000	24.37	8.54	6.44
8-8-2006	93000	24.04	8.51	6.28
8-8-2006	103000	24.02	8.48	6.46
8-8-2006	113000	24.19	8.47	6.34
8-8-2006	123000	24.28	8.45	6.3
8-8-2006	133000	24.39	8.45	6.16
8-8-2006	143000	24.7	8.47	6.32
8-8-2006	153000	24.77	8.48	6.53
8-8-2006	163000	24.98	8.5	6.33
8-8-2006	173000	25.16	8.56	6.47
8-8-2006	183000	25.35	8.65	6.64

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
8-8-2006	193000	25.55	8.71	6.95
8-8-2006	203000	25.11	8.79	6.91
8-8-2006	213000	25.13	8.83	6.74
8-8-2006	223000	25.14	8.86	6.64
8-8-2006	233000	25.16	8.88	6.83
8-9-2006	3000	25.16	8.87	6.76
8-9-2006	13000	25.07	8.88	6.89
8-9-2006	23000	25.07	8.87	6.7
8-9-2006	33000	24.92	8.85	6.99
8-9-2006	43000	24.79	8.83	6.94
8-9-2006	53000	24.68	8.8	7.04
8-9-2006	63000	24.54	8.78	7.45
8-9-2006	73000	24.54	8.76	6.83
8-9-2006	83000	24.76	7.78	7.08
8-9-2006	93000	24.46	7.72	6.85
8-9-2006	103000	24.35	7.68	6.71
8-9-2006	113000	24.37	7.65	6.69
8-9-2006	123000	24.48	7.63	6.64
8-9-2006	133000	24.54	7.63	6.56
8-9-2006	143000	24.68	7.63	6.61
8-9-2006	153000	24.92	7.64	6.64
8-9-2006	163000	25.09	7.67	6.7
8-9-2006	173000	25.24	7.71	6.85
8-9-2006	183000	25.39	7.76	6.84
8-9-2006	193000	25.57	7.81	7.04
8-9-2006	203000	25.14	7.85	7.23
8-9-2006	213000	25.29	7.86	7.24
8-9-2006	223000	25.26	7.86	7.28
8-9-2006	233000	25.27	7.88	7.26
8-10-2006	3000	25.2	7.87	7.16
8-10-2006	13000	25.13	7.86	7.21
8-10-2006	23000	25.02	7.84	7.04
8-10-2006	33000	24.92	7.83	7.01
8-10-2006	43000	24.81	7.8	6.97
8-10-2006	53000	24.66	7.89	6.93
8-10-2006	63000	24.5	7.75	6.84
8-10-2006	73000	24.39	7.82	6.77
8-10-2006	83000	24.74	7.77	6.71
8-10-2006	93000	24.46	7.72	6.61
8-10-2006	103000	24.35	7.69	6.47
8-10-2006	113000	24.3	7.66	6.36
8-10-2006	123000	24.32	7.65	6.33
8-10-2006	133000	24.22	7.65	6.4
8-10-2006	143000	24.28	7.66	6.46
8-10-2006	153000	24.35	7.69	6.53
8-10-2006	163000	24.46	7.71	6.6
8-10-2006	173000	24.52	7.74	6.71
8-10-2006	183000	24.78	7.78	6.8
8-10-2006	193000	24.87	7.84	7.02
8-10-2006	203000	24.33	7.69	7.26
8-10-2006	213000	24.32	7.92	7.19
8-10-2006	223000	24.28	7.95	7.26
8-10-2006	233000	24.21	7.94	7.32
8-11-2006	3000	24.1	7.92	7.32
8-11-2006	13000	24	7.92	7.26
8-11-2006	23000	23.93	7.91	7.25
8-11-2006	33000	23.77	7.9	7.14

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
8-11-2006	43000	23.6	7.87	7.09
8-11-2006	53000	23.48	7.85	7.11
8-11-2006	63000	23.3	7.82	6.86
8-11-2006	73000	23.1	7.79	6.84
8-11-2006	83000	23.64	7.76	6.82
8-11-2006	93000	23.32	7.73	6.74
8-11-2006	103000	23.32	7.71	6.68
8-11-2006	113000	23.3	7.7	6.72
8-11-2006	123000	23.3	7.71	6.69
8-11-2006	133000	23.42	7.72	6.89
8-11-2006	143000	23.6	7.73	6.93
8-11-2006	153000	23.91	7.75	6.95
8-11-2006	163000	24.21	7.77	7.05
8-11-2006	173000	24.37	7.87	7.23
8-11-2006	183000	24.7	7.94	7.47
8-11-2006	193000	24.96	8.01	7.44
8-11-2006	203000	24.52	8.04	7.56
8-11-2006	213000	24.48	8.07	7.62
8-11-2006	223000	24.46	8.07	7.52
8-11-2006	233000	24.39	8.07	7.51
8-12-2006	3000	24.33	8.06	7.52
8-12-2006	13000	24.22	8.06	7.35
8-12-2006	23000	24.1	8.05	7.45
8-12-2006	33000	24.02	8.04	7.44
8-12-2006	43000	23.86	8.03	7.36
8-12-2006	53000	23.71	8	7.29
8-12-2006	63000	23.55	7.96	7.19
8-12-2006	73000	23.39	7.93	7.08
8-12-2006	83000	23.3	7.88	6.92
8-12-2006	93000	23.13	7.84	6.89
8-12-2006	103000	23.13	7.77	6.79
8-12-2006	113000	23.12	7.74	6.75
8-12-2006	123000	23.19	7.78	6.7
8-12-2006	133000	23.24	7.75	6.76
8-12-2006	143000	23.51	7.73	6.79
8-12-2006	153000	23.68	7.7	6.9
8-12-2006	163000	23.99	7.72	7.11
8-12-2006	173000	24.06	7.75	7.12
8-12-2006	183000	24.22	7.8	7.24
8-12-2006	193000	24.41	7.87	7.3
8-12-2006	203000	24.35	8.05	7.48
8-12-2006	213000	24.44	8.06	7.53
8-12-2006	223000	24.48	8.12	7.64
8-12-2006	233000	24.46	8.15	7.6
8-13-2006	3000	24.57	8.14	7.53
8-13-2006	13000	24.41	8.14	7.44
8-13-2006	23000	24.32	8.13	7.58
8-13-2006	33000	24.19	8.1	7.45
8-13-2006	43000	24.1	8.08	7.44
8-13-2006	53000	24.02	8.06	7.34
8-13-2006	63000	23.86	8.02	7.27
8-13-2006	73000	23.75	7.99	7.09
8-13-2006	83000	23.71	7.95	7.02
8-13-2006	93000	23.53	7.82	6.96
8-13-2006	103000	23.35	7.86	6.81
8-13-2006	113000	23.39	7.84	6.67
8-13-2006	123000	23.39	7.82	6.54

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
8-13-2006	133000	23.48	7.82	6.66
8-13-2006	143000	23.59	7.82	6.66
8-13-2006	153000	23.75	7.82	6.66
8-13-2006	163000	23.82	7.81	6.63
8-13-2006	173000	23.86	7.82	6.72
8-13-2006	183000	23.95	7.83	6.72
8-13-2006	193000	23.9	7.84	6.71
8-13-2006	203000	23.93	7.86	6.82
8-13-2006	213000	23.93	7.87	6.8
8-13-2006	223000	23.95	7.91	6.99
8-13-2006	233000	23.99	7.93	7.03
8-14-2006	3000	24.06	7.96	7.12
8-14-2006	13000	24.02	7.98	7.19
8-14-2006	23000	24.08	8.01	7.19
8-14-2006	33000	24.06	8.02	7.22
8-14-2006	43000	24.15	8.02	7.19
8-14-2006	53000	24.04	8.02	7.24
8-14-2006	63000	24.06	8.01	7.2
8-14-2006	73000	23.99	7.99	7.14
8-14-2006	83000	24.37	7.97	7.23
8-14-2006	93000	24.21	7.93	7.09
8-14-2006	103000	24.17	7.82	6.95
8-14-2006	113000	24.06	7.88	6.88
8-14-2006	123000	23.88	7.8	7.05
8-14-2006	133000	24.02	7.88	6.99
8-14-2006	143000	24.02	7.87	7.02
8-14-2006	153000	24.13	7.88	7.02
8-14-2006	163000	24.22	7.9	7.06
8-14-2006	173000	24.33	7.95	7.22
8-14-2006	183000	24.32	8.02	7.36
8-14-2006	193000	24.48	8.11	7.64
8-14-2006	203000	24.15	8.15	7.74
8-14-2006	213000	24.1	8.18	7.81
8-14-2006	223000	23.97	8.2	7.72
8-14-2006	233000	23.91	8.2	7.64
8-15-2006	3000	23.77	8.17	7.49
8-15-2006	13000	23.7	8.13	7.52
8-15-2006	23000	23.57	8.1	7.42
8-15-2006	33000	23.32	8.05	7.38
8-15-2006	43000	23.17	8	7.24
8-15-2006	53000	23.04	7.95	7.07
8-15-2006	63000	22.95	7.9	6.82
8-15-2006	73000	22.77	7.86	6.79
8-15-2006	83000	22.51	7.81	6.75
8-15-2006	93000	22.31	7.68	6.69
8-15-2006	103000	22.26	7.63	6.64
8-15-2006	113000	22.38	7.61	6.73
8-15-2006	123000	22.54	7.6	6.84
8-15-2006	133000	22.76	7.7	6.97
8-15-2006	143000	23.13	7.7	7.13
8-15-2006	153000	23.46	7.76	7.48
8-15-2006	163000	23.88	7.86	7.55
8-15-2006	173000	24.13	7.94	7.86
8-15-2006	183000	24.28	8.05	7.93
8-15-2006	193000	24.41	8.13	7.91
8-15-2006	203000	24.15	8.16	7.85
8-15-2006	213000	24.22	8.15	7.84

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
8-15-2006	223000	24.08	8.14	7.68
8-15-2006	233000	23.95	8.13	7.74
8-16-2006	3000	23.79	8.12	7.56
8-16-2006	13000	23.75	8.08	7.6
8-16-2006	23000	23.53	8.05	7.51
8-16-2006	33000	23.39	8	7.36
8-16-2006	43000	23.22	7.97	7.35
8-16-2006	53000	23.17	7.92	7.24
8-16-2006	63000	23.01	7.88	7.1
8-16-2006	73000	23.13	7.83	7.08
8-16-2006	83000	22.83	7.78	7.01
8-16-2006	93000	22.69	7.73	6.88
8-16-2006	103000	22.79	7.74	6.84
8-16-2006	113000	23.01	7.75	6.89
8-16-2006	123000	23.26	7.78	6.97
8-16-2006	133000	23.33	7.81	7.06
8-16-2006	143000	23.5	7.86	7.23
8-16-2006	153000	23.91	7.96	7.47
8-16-2006	163000	24.21	8.05	7.64
8-16-2006	173000	24.52	8.14	7.9
8-16-2006	183000	24.72	8.22	8.04
8-16-2006	193000	24.9	8.25	7.94
8-16-2006	203000	24.63	8.18	7.96
8-16-2006	213000	24.57	8.23	8.08
8-16-2006	223000	24.5	8.19	8.05
8-16-2006	233000	24.44	8.18	7.87
8-17-2006	3000	24.33	8.16	7.9
8-17-2006	13000	24.22	8.14	7.86
8-17-2006	23000	24.17	8.09	7.62
8-17-2006	33000	24.08	8.05	7.51
8-17-2006	43000	23.66	7.99	7.39
8-17-2006	53000	23.44	7.94	7.29
8-17-2006	63000	23.19	7.88	7.12
8-17-2006	73000	23.06	7.84	6.87
8-17-2006	83000	22.86	7.78	6.97
8-17-2006	93000	22.65	7.7	6.89
8-17-2006	103000	22.7	7.74	6.62
8-17-2006	113000	22.6	7.74	6.5
8-17-2006	123000	22.56	7.75	6.57
8-17-2006	133000	22.63	7.78	6.64
8-17-2006	143000	22.72	7.82	6.82
8-17-2006	153000	22.85	7.84	6.83
8-17-2006	163000	22.97	7.89	6.93
8-17-2006	173000	23.28	7.99	7.23
8-17-2006	183000	23.33	8.01	7.42
8-17-2006	193000	23.77	8.04	7.31
8-17-2006	203000	23.53	8.01	7.4
8-17-2006	213000	23.39	8.01	7.24
8-17-2006	223000	23.32	8.04	7.22
8-17-2006	233000	23.32	8.04	7.24
8-18-2006	3000	23.28	8.04	7.23
8-18-2006	13000	23.21	8.03	7.17
8-18-2006	23000	23.13	8.02	7.17
8-18-2006	33000	23.06	8.01	7.1
8-18-2006	43000	22.95	8	7.03
8-18-2006	53000	22.88	7.99	7.17
8-18-2006	63000	22.88	7.97	7.07

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
8-18-2006	73000	22.77	7.96	7.06
8-18-2006	83000	22.95	7.94	7.07
8-18-2006	93000	23.03	7.9	6.95
8-18-2006	103000	23.01	7.89	6.89
8-18-2006	113000	23.19	7.87	6.79
8-18-2006	123000	23.28	7.87	6.66
8-18-2006	133000	23.42	7.87	6.62
8-18-2006	143000	23.62	7.86	6.65
8-18-2006	153000	23.84	7.9	6.68
8-18-2006	163000	24.02	7.94	6.62
8-18-2006	173000	24.1	8	6.91
8-18-2006	183000	24.3	8.07	7.11
8-18-2006	193000	24.37	8.14	7.34
8-18-2006	203000	23.91	8.2	7.41
8-18-2006	213000	24.06	8.23	7.54
8-18-2006	223000	24.04	8.25	7.53
8-18-2006	233000	24.08	8.27	7.63
8-19-2006	3000	24.06	8.27	7.66
8-19-2006	13000	24	8.27	7.6
8-19-2006	23000	24	8.26	7.7
8-19-2006	33000	23.97	8.26	7.6
8-19-2006	43000	23.93	8.25	7.53
8-19-2006	53000	23.8	8.23	7.51
8-19-2006	63000	23.62	8.2	7.37
8-19-2006	73000	23.68	8.16	7.25
8-19-2006	83000	23.51	8.12	7.22
8-19-2006	93000	23.37	8.08	7.09
8-19-2006	103000	23.21	8.03	7
8-19-2006	113000	23.15	7.98	6.81
8-19-2006	123000	23.13	7.95	6.9
8-19-2006	133000	23.1	7.93	6.77
8-19-2006	143000	23.12	7.93	6.95
8-19-2006	153000	23.08	7.92	6.86
8-19-2006	163000	23.12	7.92	6.77
8-19-2006	173000	23.08	7.92	6.95
8-19-2006	183000	23.01	7.92	6.91
8-19-2006	193000	22.99	7.91	6.87
8-19-2006	203000	22.95	7.92	6.95
8-19-2006	213000	22.9	7.93	6.86
8-19-2006	223000	22.83	7.95	6.91
8-19-2006	233000	22.83	7.97	6.86
8-20-2006	3000	22.77	7.98	7.02
8-20-2006	13000	22.74	8	7.09
8-20-2006	23000	22.69	8.01	6.99
8-20-2006	33000	22.58	8.02	7.03
8-20-2006	43000	22.58	8.02	7.15
8-20-2006	53000	22.52	8.02	7.16
8-20-2006	63000	22.43	8.01	7.14
8-20-2006	73000	22.35	7.99	6.99
8-20-2006	83000	22.24	7.95	7.02
8-20-2006	93000	22.26	7.92	6.76
8-20-2006	103000	22.24	7.91	6.75
8-20-2006	113000	22.42	7.91	6.73
8-20-2006	123000	22.51	7.92	6.91
8-20-2006	133000	22.7	7.92	6.84
8-20-2006	143000	22.88	7.93	6.81
8-20-2006	153000	23.01	7.95	6.86

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
8-20-2006	163000	23.17	7.97	6.92
8-20-2006	173000	23.26	8	7.11
8-20-2006	183000	23.42	8.04	7.17
8-20-2006	193000	23.5	8.09	7.4
8-20-2006	203000	23.55	8.13	7.34
8-20-2006	213000	23.6	8.18	7.68
8-20-2006	223000	23.6	8.22	7.71
8-20-2006	233000	23.62	8.26	7.8
8-21-2006	3000	23.62	8.28	7.83
8-21-2006	13000	23.66	8.3	7.83
8-21-2006	23000	23.73	8.31	7.9
8-21-2006	33000	23.62	8.3	8
8-21-2006	43000	23.42	8.28	7.86
8-21-2006	53000	23.22	8.25	7.73
8-21-2006	63000	23.15	8.2	7.84
8-21-2006	73000	23.01	8.15	7.42
8-21-2006	83000	23.22	8.09	7.21
8-21-2006	93000	23.1	8.02	7.29
8-21-2006	103000	23.03	7.95	7.34
8-21-2006	113000	22.88	7.91	7.08
8-21-2006	123000	22.94	7.91	7.19
8-21-2006	133000	23.1	7.9	7.07
8-21-2006	143000	23.06	7.92	7.13
8-21-2006	153000	23.01	7.94	6.95
8-21-2006	163000	23.3	7.96	7.36
8-21-2006	173000	23.32	8.02	7.47
8-21-2006	183000	23.51	8.09	7.5
8-21-2006	193000	23.64	8.16	7.67
8-21-2006	203000	23.39	8.2	7.81
8-21-2006	213000	23.37	8.25	7.82
8-21-2006	223000	23.33	8.28	8.04
8-21-2006	233000	23.35	8.29	7.89
8-22-2006	3000	23.24	8.26	7.74
8-22-2006	13000	23.15	8.26	7.75
8-22-2006	23000	23.06	8.23	7.47
8-22-2006	33000	23.04	8.2	7.42
8-22-2006	43000	22.88	8.18	7.48
8-22-2006	53000	22.76	8.13	7.68
8-22-2006	63000	22.63	8.1	7.83
8-22-2006	73000	22.47	8.06	7.56
8-22-2006	83000	22.81	8.02	7.33
8-22-2006	93000	22.85	7.97	7.24
8-22-2006	103000	22.65	7.94	7.33
8-22-2006	113000	22.4	7.94	6.92
8-22-2006	123000	22.61	7.94	7.16
8-22-2006	133000	22.63	7.95	7.41
8-22-2006	143000	22.81	7.95	7.41
8-22-2006	153000	22.94	7.98	7.5
8-22-2006	163000	23.06	8	7.46
8-22-2006	173000	23.12	8.06	7.22
8-22-2006	183000	23.48	8.11	7.59
8-22-2006	193000	23.53	8.16	7.73
8-22-2006	203000	23.1	8.23	7.92
8-22-2006	213000	23.28	8.29	7.96
8-22-2006	223000	23.3	8.32	8.04
8-22-2006	233000	23.33	8.35	8.09
8-23-2006	3000	23.3	8.35	7.99

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
8-23-2006	13000	23.32	8.35	7.87
8-23-2006	23000	23.24	8.35	7.85
8-23-2006	33000	23.19	8.35	7.89
8-23-2006	43000	23.08	8.33	7.9
8-23-2006	53000	22.99	8.3	7.68
8-23-2006	63000	22.81	8.26	7.61
8-23-2006	73000	22.77	8.21	7.59
8-23-2006	83000	22.76	8.14	7.3
8-23-2006	93000	22.6	8.05	7.28
8-23-2006	103000	22.29	7.98	7.28
8-23-2006	113000	22.19	7.92	7
8-23-2006	123000	22.27	7.87	6.72
8-23-2006	133000	22.33	7.86	6.87
8-23-2006	143000	22.65	7.86	6.75
8-23-2006	153000	22.74	7.88	6.9
8-23-2006	163000	22.97	7.9	7.05
8-23-2006	173000	23.01	7.92	7.09
8-23-2006	183000	23.08	7.94	7.1
8-23-2006	193000	22.7	7.98	7.28
8-23-2006	203000	22.72	8.02	7.47
8-23-2006	213000	22.72	8.05	7.47
8-23-2006	223000	22.77	8.08	7.68
8-23-2006	233000	22.76	8.11	7.6
8-24-2006	3000	22.77	8.15	7.75
8-24-2006	13000	22.83	8.19	7.83
8-24-2006	23000	22.83	8.22	7.98
8-24-2006	33000	22.88	8.24	7.93
8-24-2006	43000	22.76	8.26	7.66
8-24-2006	53000	22.77	8.25	7.95
8-24-2006	63000	22.72	8.24	7.84
8-24-2006	73000	22.65	8.22	7.87
8-24-2006	83000	22.97	8.17	7.67
8-24-2006	93000	22.94	8.09	7.47
8-24-2006	103000	22.83	8.04	7.36
8-24-2006	113000	22.88	7.99	7.22
8-24-2006	123000	22.81	7.97	7.2
8-24-2006	133000	22.77	7.93	7.1
8-24-2006	143000	22.83	7.92	7.09
8-24-2006	153000	22.65	7.9	7.06
8-24-2006	163000	22.65	7.91	7.14
8-24-2006	173000	22.77	7.91	7.34
8-24-2006	183000	22.81	7.95	7.32
8-24-2006	193000	22.81	8.01	7.51
8-24-2006	203000	22.43	8.06	7.68
8-24-2006	213000	22.42	8.11	7.72
8-24-2006	223000	22.45	8.14	7.7
8-24-2006	233000	22.45	8.15	7.6
8-25-2006	3000	22.42	8.15	7.72
8-25-2006	13000	22.36	8.15	7.8
8-25-2006	23000	22.36	8.15	7.82
8-25-2006	33000	22.24	8.13	7.59
8-25-2006	43000	22.19	8.11	7.57
8-25-2006	53000	22.13	8.07	7.51
8-25-2006	63000	21.99	8.04	7.4
8-25-2006	73000	21.78	8.03	7.47
8-25-2006	83000	21.88	7.97	7.33
8-25-2006	93000	21.76	7.92	7.04

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)	Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
8-25-2006	103000	21.64	7.87	6.93	8-27-2006	193000	22.47	8.34	8.01
8-25-2006	113000	21.51	7.83	6.88	8-27-2006	203000	22.42	8.34	7.98
8-25-2006	123000	21.42	7.81	6.78	8-27-2006	213000	22.36	8.33	7.94
8-25-2006	133000	21.41	7.81	6.78	8-27-2006	223000	22.27	8.3	7.86
8-25-2006	143000	21.32	7.81	7.01	8-27-2006	233000	22.13	8.26	7.86
8-25-2006	153000	21.32	7.82	6.99	8-28-2006	3000	21.88	8.22	7.81
8-25-2006	163000	21.35	7.82	6.98	8-28-2006	13000	21.72	8.16	7.82
8-25-2006	173000	21.26	7.83	6.94	8-28-2006	23000	21.46	8.09	7.41
8-25-2006	183000	21.37	7.84	7	8-28-2006	33000	21.39	8.01	7.23
8-25-2006	193000	21.41	7.86	7.05	8-28-2006	43000	21.23	7.95	7.08
8-25-2006	203000	21.11	7.87	7.11	8-28-2006	53000	21.04	7.92	7.02
8-25-2006	213000	21.18	7.87	6.99	8-28-2006	63000	20.91	7.89	6.88
8-25-2006	223000	21.18	7.87	6.8	8-28-2006	73000	20.62	7.86	6.82
8-25-2006	233000	21.18	7.87	6.88	8-28-2006	83000	20.98	7.84	6.69
8-26-2006	3000	21.18	7.86	6.87	8-28-2006	93000	20.93	7.83	6.69
8-26-2006	13000	21.16	7.84	6.74	8-28-2006	103000	21.14	7.84	6.72
8-26-2006	23000	21.16	7.83	6.73	8-28-2006	113000	21.07	7.85	6.85
8-26-2006	33000	21.14	7.82	6.8	8-28-2006	123000	21.21	7.86	6.84
8-26-2006	43000	21.12	7.81	6.8	8-28-2006	133000	21.12	7.88	7.06
8-26-2006	53000	21.04	7.8	6.73	8-28-2006	143000	21.26	7.92	7.28
8-26-2006	63000	21	7.8	6.68	8-28-2006	153000	21.35	7.96	7.37
8-26-2006	73000	20.98	7.78	6.7	8-28-2006	163000	21.44	8.04	7.58
8-26-2006	83000	20.97	7.77	6.65	8-28-2006	173000	21.58	8.09	7.83
8-26-2006	93000	20.93	7.76	6.65	8-28-2006	183000	21.64	8.12	7.88
8-26-2006	103000	20.97	7.77	6.7	8-28-2006	193000	21.71	8.12	7.78
8-26-2006	113000	21	7.77	6.64	8-28-2006	203000	21.33	8.06	7.49
8-26-2006	123000	21.05	7.78	6.77	8-28-2006	213000	21.53	8.07	7.51
8-26-2006	133000	21.18	7.8	6.76	8-28-2006	223000	21.39	8.05	7.35
8-26-2006	143000	21.32	7.83	6.84	8-28-2006	233000	21.42	8.05	7.41
8-26-2006	153000	21.37	7.86	6.82	8-29-2006	3000	21.28	8.04	7.21
8-26-2006	163000	21.48	7.89	6.94	8-29-2006	13000	21.26	8.03	7.21
8-26-2006	173000	21.49	7.92	6.98	8-29-2006	23000	21.14	8.01	7.25
8-26-2006	183000	21.51	7.95	7.11	8-29-2006	33000	21.07	7.99	7.1
8-26-2006	193000	21.58	7.98	7.2	8-29-2006	43000	21	7.97	7.13
8-26-2006	203000	21.53	7.99	7.23	8-29-2006	53000	20.97	7.95	6.98
8-26-2006	213000	21.48	7.98	7.2	8-29-2006	63000	20.86	7.93	7.07
8-26-2006	223000	21.41	7.96	7.11	8-29-2006	73000	20.7	7.91	6.93
8-26-2006	233000	21.3	7.93	7.06	8-29-2006	83000	20.81	7.88	6.88
8-27-2006	3000	21.16	7.91	7.08	8-29-2006	93000	21.07	7.86	6.87
8-27-2006	13000	21.18	7.9	7.05	8-29-2006	103000	21.14	7.85	7.34
8-27-2006	23000	21	7.89	6.95	8-29-2006	113000	21.12	7.88	7.27
8-27-2006	33000	20.98	7.88	6.87	8-29-2006	123000	21.23	7.89	7.04
8-27-2006	43000	20.86	7.86	6.92	8-29-2006	133000	21.49	7.92	7.03
8-27-2006	53000	20.76	7.85	6.92	8-29-2006	143000	21.62	7.96	7.46
8-27-2006	63000	20.77	7.83	6.68	8-29-2006	153000	21.94	8.06	7.54
8-27-2006	73000	20.67	7.83	6.81	8-29-2006	163000	22.1	8.19	7.99
8-27-2006	83000	20.6	7.82	6.68	8-29-2006	173000	22.35	8.29	8.27
8-27-2006	93000	20.6	7.82	6.72	8-29-2006	183000	22.4	8.36	8.52
8-27-2006	103000	20.72	7.83	6.77	8-29-2006	193000	22.27	8.36	8.45
8-27-2006	113000	20.83	7.86	6.84	8-29-2006	203000	21.88	8.3	8.1
8-27-2006	123000	21.05	7.89	6.94	8-29-2006	213000	21.87	8.31	8.09
8-27-2006	133000	21.28	7.93	7.11	8-29-2006	223000	21.76	8.3	8.09
8-27-2006	143000	21.55	7.97	7.13	8-29-2006	233000	21.6	8.29	8.13
8-27-2006	153000	21.78	8.03	7.31	8-30-2006	3000	21.53	8.27	8.04
8-27-2006	163000	22.04	8.14	7.53	8-30-2006	13000	21.28	8.24	8
8-27-2006	173000	22.26	8.23	7.76	8-30-2006	23000	21.23	8.21	7.96
8-27-2006	183000	22.42	8.31	8.03	8-30-2006	33000	21.05	8.16	7.87

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
8-30-2006	43000	20.83	8.13	7.66
8-30-2006	53000	20.76	8.09	7.5
8-30-2006	63000	20.6	8.05	7.42
8-30-2006	73000	20.53	8.01	7.46
8-30-2006	83000	20.6	7.97	7.46
8-30-2006	93000	20.67	7.92	7.37
8-30-2006	103000	20.56	7.91	7.26
8-30-2006	113000	20.56	7.91	7.28
8-30-2006	123000	20.74	7.92	7.43
8-30-2006	133000	20.86	7.95	7.49
8-30-2006	143000	21.09	8	7.53
8-30-2006	153000	21.42	8.06	7.71
8-30-2006	163000	21.64	8.15	8
8-30-2006	173000	21.76	8.24	8.19
8-30-2006	183000	21.88	8.33	8.54
8-30-2006	193000	22.06	8.39	8.63
8-30-2006	203000	21.88	8.38	8.55
8-30-2006	213000	22.03	8.39	8.5
8-30-2006	223000	21.94	8.37	8.45
8-30-2006	233000	21.85	8.37	8.34
8-31-2006	3000	21.74	8.36	8.31
8-31-2006	13000	21.69	8.34	8.29
8-31-2006	23000	21.49	8.32	8.22
8-31-2006	33000	21.28	8.29	8.22
8-31-2006	43000	21.21	8.25	7.99
8-31-2006	53000	21.02	8.21	7.81
8-31-2006	63000	20.86	8.17	7.75
8-31-2006	73000	20.63	8.13	7.64
8-31-2006	83000	20.67	8.08	7.4
8-31-2006	93000	20.56	8.04	7.38
8-31-2006	103000	20.46	8	7.27
8-31-2006	113000	20.63	8	7.59
8-31-2006	123000	20.65	8	7.35
8-31-2006	133000	20.74	8.01	7.38
8-31-2006	143000	20.97	8.04	7.51
8-31-2006	153000	21.19	8.06	7.54
8-31-2006	163000	21.35	8.11	7.81
8-31-2006	173000	21.58	8.19	8.02
8-31-2006	183000	21.65	8.29	8.26
8-31-2006	193000	21.65	8.35	8.44
8-31-2006	203000	21.42	8.4	8.47
8-31-2006	213000	21.6	8.43	8.49
8-31-2006	223000	21.65	8.44	8.36
8-31-2006	233000	21.64	8.45	8.51
9-1-2006	3000	21.6	8.43	8.27
9-1-2006	13000	21.51	8.43	8.45
9-1-2006	23000	21.48	8.43	8.42
9-1-2006	33000	21.41	8.42	8.31
9-1-2006	43000	21.35	8.4	8.24
9-1-2006	53000	21.11	8.36	8.1
9-1-2006	63000	20.95	8.31	7.96
9-1-2006	73000	21.14	8.26	7.78
9-1-2006	83000	21.11	8.2	7.75
9-1-2006	93000	20.86	8.15	7.62
9-1-2006	103000	20.74	8.1	7.75
9-1-2006	113000	20.9	8.07	7.55
9-1-2006	123000	20.91	8.07	7.57

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
9-1-2006	133000	20.88	8.06	7.52
9-1-2006	143000	21.05	8.08	7.61
9-1-2006	153000	21.21	8.09	7.6
9-1-2006	163000	21.41	8.12	7.66
9-1-2006	173000	21.53	8.16	7.66
9-1-2006	183000	21.55	8.24	8.08
9-1-2006	193000	21.62	8.3	8.11
9-1-2006	203000	21.48	8.34	8.16
9-1-2006	213000	21.6	8.4	8.34
9-1-2006	223000	21.6	8.44	8.56
9-1-2006	233000	21.62	8.47	8.5
9-2-2006	3000	21.55	8.47	8.47
9-2-2006	13000	21.56	8.48	8.54
9-2-2006	23000	21.48	8.47	8.01
9-2-2006	33000	21.39	8.47	7.99
9-2-2006	43000	21.32	8.45	8.14
9-2-2006	53000	21.25	8.41	7.85
9-2-2006	63000	21.07	8.38	7.93
9-2-2006	73000	20.88	8.32	7.75
9-2-2006	83000	20.67	8.26	7.66
9-2-2006	93000	20.69	8.21	7.53
9-2-2006	103000	20.39	8.16	7.35
9-2-2006	113000	20.44	8.13	7.25
9-2-2006	123000	20.49	8.11	7.36
9-2-2006	133000	20.7	8.12	7.42
9-2-2006	143000	20.83	8.12	7.49
9-2-2006	153000	20.97	8.13	7.6
9-2-2006	163000	21.07	8.15	7.75
9-2-2006	173000	21.11	8.17	7.86
9-2-2006	183000	21.12	8.2	7.87
9-2-2006	193000	21.11	8.25	7.97
9-2-2006	203000	21.12	8.3	8.12
9-2-2006	213000	21.23	8.35	8.26
9-2-2006	223000	21.26	8.4	8.42
9-2-2006	233000	21.32	8.43	8.5
9-3-2006	3000	21.33	8.45	8.39
9-3-2006	13000	21.3	8.46	8.55
9-3-2006	23000	21.3	8.45	8.51
9-3-2006	33000	21.19	8.44	8.4
9-3-2006	43000	21.14	8.41	8.21
9-3-2006	53000	20.98	8.38	8.11
9-3-2006	63000	21.02	8.32	7.87
9-3-2006	73000	21.02	8.27	7.62
9-3-2006	83000	20.67	8.23	7.49
9-3-2006	93000	20.62	8.17	7.32
9-3-2006	103000	20.48	8.13	7.37
9-3-2006	113000	20.42	8.11	7.27
9-3-2006	123000	20.48	8.1	7.29
9-3-2006	133000	20.56	8.1	7.39
9-3-2006	143000	20.7	8.1	7.33
9-3-2006	153000	20.74	8.1	7.32
9-3-2006	163000	20.83	8.11	7.32
9-3-2006	173000	20.93	8.11	7.26
9-3-2006	183000	21	8.12	7.3
9-3-2006	193000	21.04	8.15	7.33
9-3-2006	203000	21.11	8.18	7.47
9-3-2006	213000	21.07	8.22	7.63

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
9-3-2006	223000	21.23	8.26	7.66
9-3-2006	233000	21.14	8.29	7.74
9-4-2006	3000	21.23	8.33	7.66
9-4-2006	13000	21.23	8.37	7.98
9-4-2006	23000	21.37	8.41	7.99
9-4-2006	33000	21.38	8.43	8.07
9-4-2006	43000	21.37	8.43	8.08
9-4-2006	53000	21.33	8.44	8.09
9-4-2006	63000	21.25	8.43	7.93
9-4-2006	73000	21.12	8.4	8.01
9-4-2006	83000	21.07	8.35	7.89
9-4-2006	93000	20.97	8.29	7.7
9-4-2006	103000	20.95	8.24	7.67
9-4-2006	113000	20.9	8.2	7.58
9-4-2006	123000	20.95	8.18	7.56
9-4-2006	133000	21.07	8.18	7.54
9-4-2006	143000	21.05	8.17	7.52
9-4-2006	153000	21.12	8.17	7.51
9-4-2006	163000	21.14	8.17	7.53
9-4-2006	173000	21.21	8.18	7.57
9-4-2006	183000	21.16	8.18	7.55
9-4-2006	193000	21.16	8.18	7.65
9-4-2006	203000	21.16	8.19	7.69
9-4-2006	213000	21.09	8.21	7.68
9-4-2006	223000	21.04	8.22	7.69
9-4-2006	233000	21.02	8.23	7.74
9-5-2006	3000	21.02	8.25	7.79
9-5-2006	13000	21.09	8.28	7.85
9-5-2006	23000	21.05	8.31	7.91
9-5-2006	33000	21.09	8.32	7.9
9-5-2006	43000	21.12	8.34	7.77
9-5-2006	53000	21.14	8.34	7.83
9-5-2006	63000	21.04	8.34	7.9
9-5-2006	73000	20.98	8.33	7.79
9-5-2006	83000	21.04	8.3	7.81
9-5-2006	93000	20.95	8.25	7.8
9-5-2006	103000	20.98	8.22	7.7
9-5-2006	113000	20.97	8.19	7.54
9-5-2006	123000	21	8.17	7.46
9-5-2006	133000	21.16	8.17	7.47
9-5-2006	143000	21.25	8.17	7.47
9-5-2006	153000	21.48	8.17	7.46
9-5-2006	163000	21.67	8.17	7.48
9-5-2006	173000	21.69	8.18	7.52
9-5-2006	183000	21.79	8.19	7.55
9-5-2006	193000	21.83	8.21	7.56
9-5-2006	203000	21.71	8.23	7.71
9-5-2006	213000	21.67	8.25	7.79
9-5-2006	223000	21.58	8.27	7.77
9-5-2006	233000	21.53	8.28	7.71
9-6-2006	3000	21.55	8.3	7.77
9-6-2006	13000	21.53	8.32	7.74
9-6-2006	23000	21.49	8.34	7.83
9-6-2006	33000	21.51	8.36	7.81
9-6-2006	43000	21.51	8.37	7.9
9-6-2006	53000	21.49	8.38	7.83
9-6-2006	63000	21.41	8.37	7.83

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
9-6-2006	73000	21.37	8.35	7.74
9-6-2006	83000	21.58	8.32	7.69
9-6-2006	93000	21.32	8.27	7.6
9-6-2006	103000	21.3	8.23	7.49
9-6-2006	113000	21.25	8.21	7.39
9-6-2006	123000	21.16	8.19	7.41
9-6-2006	133000	21.18	8.17	7.39
9-6-2006	143000	21.25	8.16	7.39
9-6-2006	153000	21.26	8.17	7.41
9-6-2006	163000	21.32	8.18	7.43
9-6-2006	173000	21.39	8.17	7.43
9-6-2006	183000	21.37	8.19	7.46
9-6-2006	193000	21.41	8.2	7.42
9-6-2006	203000	21.28	8.21	7.5
9-6-2006	213000	21.28	8.23	7.46
9-6-2006	223000	21.25	8.23	7.43
9-6-2006	233000	21.18	8.23	7.51
9-7-2006	3000	21.16	8.24	7.46
9-7-2006	13000	21.14	8.25	7.52
9-7-2006	23000	21.12	8.27	7.51
9-7-2006	33000	21.11	8.29	7.46
9-7-2006	43000	21.14	8.31	7.49
9-7-2006	53000	21.11	8.33	7.67
9-7-2006	63000	21.11	8.34	7.77
9-7-2006	73000	21.11	8.34	7.77
9-7-2006	83000	21.11	8.33	7.82
9-7-2006	93000	21.05	8.31	7.75
9-7-2006	103000	21.04	8.26	7.74
9-7-2006	113000	21.09	8.23	7.53
9-7-2006	123000	21.18	8.22	7.53
9-7-2006	133000	21.23	8.21	7.45
9-7-2006	143000	21.32	8.2	7.55
9-7-2006	153000	21.35	8.19	7.55
9-7-2006	163000	21.46	8.2	7.59
9-7-2006	173000	21.39	8.18	7.64
9-7-2006	183000	21.32	8.17	7.48
9-7-2006	193000	21.28	8.16	7.44
9-7-2006	203000	21.23	8.17	7.44
9-7-2006	213000	21.26	8.18	7.44
9-7-2006	223000	21.23	8.19	7.41
9-7-2006	233000	21.25	8.2	7.47
9-8-2006	3000	21.23	8.22	7.55
9-8-2006	13000	21.23	8.24	7.57
9-8-2006	23000	21.21	8.26	7.59
9-8-2006	33000	21.21	8.28	7.46
9-8-2006	43000	21.21	8.29	7.64
9-8-2006	53000	21.19	8.3	7.62
9-8-2006	63000	21.14	8.3	7.45
9-8-2006	73000	21.12	8.28	7.49
9-8-2006	83000	21.18	8.25	7.63
9-8-2006	93000	21.12	8.2	7.38
9-8-2006	103000	21.12	8.16	7.25
9-8-2006	113000	21.04	8.13	7.06
9-8-2006	123000	20.93	8.09	6.89
9-8-2006	133000	20.72	8.06	7.12
9-8-2006	143000	20.62	8.04	6.89
9-8-2006	153000	20.46	8.02	6.94

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
9-8-2006	163000	20.34	7.99	6.83
9-8-2006	173000	20.2	7.98	6.79
9-8-2006	183000	20.11	8	6.74
9-8-2006	193000	19.87	7.96	6.81
9-8-2006	203000	19.76	7.96	6.78
9-8-2006	213000	19.66	7.97	6.87
9-8-2006	223000	19.52	7.96	6.82
9-8-2006	233000	19.47	7.96	6.9
9-9-2006	3000	19.3	7.96	6.87
9-9-2006	13000	19.21	7.96	6.94
9-9-2006	23000	19.11	7.96	6.87
9-9-2006	33000	19.04	7.96	7
9-9-2006	43000	18.93	7.97	7
9-9-2006	53000	18.83	7.97	6.93
9-9-2006	63000	18.78	7.97	6.95
9-9-2006	73000	18.71	7.97	6.93
9-9-2006	83000	18.64	7.96	7.02
9-9-2006	93000	18.66	7.95	6.96
9-9-2006	103000	18.66	7.95	6.9
9-9-2006	113000	18.78	7.95	6.95
9-9-2006	123000	18.88	7.97	6.98
9-9-2006	133000	19.02	7.8	6.97
9-9-2006	143000	19.11	7.91	7.04
9-9-2006	153000	19.26	7.99	7.22
9-9-2006	163000	19.42	8.04	7.31
9-9-2006	173000	19.45	8.07	7.38
9-9-2006	183000	19.5	8.09	7.25
9-9-2006	193000	19.47	8.1	7.38
9-9-2006	203000	19.43	8.12	7.45
9-9-2006	213000	19.36	8.11	7.42
9-9-2006	223000	19.3	8.12	7.45
9-9-2006	233000	19.3	8.11	7.39
9-10-2006	3000	19.19	8.12	7.41
9-10-2006	13000	19.23	8.12	7.44
9-10-2006	23000	19.09	8.13	7.42
9-10-2006	33000	19.11	8.16	7.55
9-10-2006	43000	19.14	8.18	7.58
9-10-2006	53000	19.09	8.2	7.62
9-10-2006	63000	19.04	8.23	7.69
9-10-2006	73000	19.04	8.25	7.64
9-10-2006	83000	19.04	8.25	7.66
9-10-2006	93000	18.93	8.23	7.54
9-10-2006	103000	18.88	8.21	7.59
9-10-2006	113000	19	8.19	7.58
9-10-2006	123000	19.05	8.18	7.52
9-10-2006	133000	19.11	8.18	7.55
9-10-2006	143000	19.18	8.17	7.61
9-10-2006	153000	19.16	8.18	7.63
9-10-2006	163000	19.21	8.19	7.63
9-10-2006	173000	19.16	8.18	7.65
9-10-2006	183000	19.09	8.16	7.6
9-10-2006	193000	18.97	8.15	7.68
9-10-2006	203000	18.88	8.14	7.62
9-10-2006	213000	18.92	8.14	7.52
9-10-2006	223000	18.76	8.15	7.49
9-10-2006	233000	18.8	8.15	7.63
9-11-2006	3000	18.78	8.16	7.75

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
9-11-2006	13000	18.81	8.19	7.79
9-11-2006	23000	18.8	8.22	7.98
9-11-2006	33000	18.83	8.23	7.96
9-11-2006	43000	18.78	8.25	8.13
9-11-2006	53000	18.76	8.27	8.1
9-11-2006	63000	18.76	8.27	7.98
9-11-2006	73000	18.76	8.24	7.99
9-11-2006	83000	18.76	8.21	7.91
9-11-2006	93000	18.64	8.17	7.75
9-11-2006	103000	18.54	8.12	7.74
9-11-2006	113000	18.57	8.1	7.66
9-11-2006	123000	18.52	8.08	7.56
9-11-2006	133000	18.54	8.07	7.61
9-11-2006	143000	18.47	8.06	7.61
9-11-2006	153000	18.44	8.07	7.62
9-11-2006	163000	18.45	8.06	7.64
9-11-2006	173000	18.39	8.05	7.59
9-11-2006	183000	18.33	8.05	7.64
9-11-2006	193000	18.28	8.05	7.58
9-11-2006	203000	18.2	8.05	7.63
9-11-2006	213000	18.2	8.06	7.65
9-11-2006	223000	18.22	8.06	7.63
9-11-2006	233000	18.23	8.07	7.7
9-12-2006	3000	18.22	8.06	7.67
9-12-2006	13000	18.22	8.1	7.85
9-12-2006	23000	18.2	8.07	7.82
9-12-2006	33000	18.23	8.13	7.86
9-12-2006	43000	18.18	8.13	7.74
9-12-2006	53000	18.2	8.12	7.64
9-12-2006	63000	18.11	8.11	7.63
9-12-2006	73000	18.2	8.1	7.56
9-12-2006	83000	18.04	8.1	7.58
9-12-2006	93000	17.99	8.05	7.52
9-12-2006	103000	17.87	8.03	7.33
9-12-2006	113000	17.91	8.01	7.24
9-12-2006	123000	17.87	8	7.17
9-12-2006	133000	17.87	7.98	7.19
9-12-2006	143000	17.82	7.98	7.15
9-12-2006	153000	17.76	7.97	7.2
9-12-2006	163000	17.81	7.97	7.15
9-12-2006	173000	17.67	7.98	7.13
9-12-2006	183000	17.6	7.98	7.19
9-12-2006	193000	17.6	7.97	7.27
9-12-2006	203000	17.55	7.96	7.27
9-12-2006	213000	17.55	7.97	7.14
9-12-2006	223000	17.47	7.97	7.19
9-12-2006	233000	17.45	7.96	7.2
9-13-2006	3000	17.4	7.97	7.25
9-13-2006	13000	17.45	7.97	7.3
9-13-2006	23000	17.42	7.98	7.3
9-13-2006	33000	17.38	7.99	7.21
9-13-2006	43000	17.43	7.99	7.26
9-13-2006	53000	17.45	7.98	7.19
9-13-2006	63000	17.37	7.99	7.17
9-13-2006	73000	17.5	7.98	7.21
9-13-2006	83000	17.45	7.97	7.12
9-13-2006	93000	17.48	7.97	7.04

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
9-13-2006	103000	17.52	7.96	7.02
9-13-2006	113000	17.4	7.96	7.09
9-13-2006	123000	17.48	7.98	7.15
9-13-2006	133000	17.65	7.98	7.13
9-13-2006	143000	17.74	7.99	7.19
9-13-2006	153000	17.89	8.03	7.42
9-13-2006	163000	18.06	8.05	7.55
9-13-2006	173000	18.23	8.08	7.68
9-13-2006	183000	18.32	8.1	7.72
9-13-2006	193000	18.35	8.12	7.84
9-13-2006	203000	18.33	8.14	7.97
9-13-2006	213000	18.33	8.14	7.93
9-13-2006	223000	18.2	8.14	7.73
9-13-2006	233000	18.18	8.14	7.72
9-14-2006	3000	18.16	8.15	7.73
9-14-2006	13000	18.06	8.12	7.84
9-14-2006	23000	18.04	8.16	7.85
9-14-2006	33000	18.11	8.18	7.81
9-14-2006	43000	18.08	8.2	7.88
9-14-2006	53000	18.06	8.21	7.79
9-14-2006	63000	18.04	8.2	7.86
9-14-2006	73000	17.98	8.19	7.89
9-14-2006	83000	18.03	8.17	7.78
9-14-2006	93000	17.84	8.15	7.69
9-14-2006	103000	17.84	8.12	7.68
9-14-2006	113000	17.89	8.11	7.51
9-14-2006	123000	18.03	8.11	7.74
9-14-2006	133000	18.08	8.12	7.76
9-14-2006	143000	18.28	8.12	7.69
9-14-2006	153000	18.3	8.13	7.71
9-14-2006	163000	18.3	8.15	7.79
9-14-2006	173000	18.51	8.16	7.78
9-14-2006	183000	18.44	8.16	7.8
9-14-2006	193000	18.47	8.17	7.79
9-14-2006	203000	18.37	8.2	7.81
9-14-2006	213000	18.3	8.2	7.85
9-14-2006	223000	18.33	8.2	7.86
9-14-2006	233000	18.18	8.19	7.77
9-15-2006	3000	18.25	8.2	7.82
9-15-2006	13000	18.2	8.22	7.9
9-15-2006	23000	18.23	8.23	8
9-15-2006	33000	18.22	8.26	8.06
9-15-2006	43000	18.27	8.28	8.02
9-15-2006	53000	18.25	8.28	8.02
9-15-2006	63000	18.27	8.3	8.07
9-15-2006	73000	18.23	8.29	8.01
9-15-2006	83000	18.33	8.27	8
9-15-2006	93000	18.27	8.25	7.89
9-15-2006	103000	18.28	8.23	7.83
9-15-2006	113000	18.25	8.21	7.73
9-15-2006	123000	18.3	8.19	7.71
9-15-2006	133000	18.33	8.18	7.69
9-15-2006	143000	18.42	8.17	7.7
9-15-2006	153000	18.47	8.17	7.72
9-15-2006	163000	18.59	8.17	7.69
9-15-2006	173000	18.64	8.17	7.73
9-15-2006	183000	18.59	8.19	7.8

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
9-15-2006	193000	18.57	8.2	7.77
9-15-2006	203000	18.56	8.2	7.8
9-15-2006	213000	18.44	8.21	7.71
9-15-2006	223000	18.44	8.21	7.83
9-15-2006	233000	18.32	8.21	7.76
9-16-2006	3000	18.35	8.21	7.8
9-16-2006	13000	18.32	8.22	7.82
9-16-2006	23000	18.33	8.24	7.92
9-16-2006	33000	18.35	8.25	7.93
9-16-2006	43000	18.45	8.27	7.96
9-16-2006	53000	18.54	8.27	8.01
9-16-2006	63000	18.51	8.28	8.01
9-16-2006	73000	18.57	8.28	8
9-16-2006	83000	18.57	8.25	7.99
9-16-2006	93000	18.47	8.23	7.81
9-16-2006	103000	18.44	8.18	7.72
9-16-2006	113000	18.42	8.16	7.67
9-16-2006	123000	18.44	8.13	7.6
9-16-2006	133000	18.47	8.12	7.84
9-16-2006	143000	18.35	8.11	7.66
9-16-2006	153000	18.3	8.12	7.7
9-16-2006	163000	18.33	8.12	7.7
9-16-2006	173000	18.32	8.11	7.78
9-16-2006	183000	18.37	8.12	7.73
9-16-2006	193000	18.32	8.12	7.78
9-16-2006	203000	18.27	8.12	7.8
9-16-2006	213000	18.16	8.11	7.86
9-16-2006	223000	18.13	8.11	7.83
9-16-2006	233000	18.18	8.11	7.73
9-17-2006	3000	18.23	8.11	7.74
9-17-2006	13000	18.18	8.12	7.77
9-17-2006	23000	18.23	8.13	7.7
9-17-2006	33000	18.22	8.13	7.41
9-17-2006	43000	18.25	8.14	7.58
9-17-2006	53000	18.23	8.15	7.63
9-17-2006	63000	18.28	8.15	7.32
9-17-2006	73000	18.32	8.15	7.4
9-17-2006	83000	18.28	8.15	7.43
9-17-2006	93000	18.28	8.14	7.31
9-17-2006	103000	18.4	8.12	7.27
9-17-2006	113000	18.39	8.11	7.31
9-17-2006	123000	18.49	8.11	7.19
9-17-2006	133000	18.49	8.12	7.68
9-17-2006	143000	18.66	8.13	7.77
9-17-2006	153000	18.76	8.14	7.75
9-17-2006	163000	18.8	8.15	7.85
9-17-2006	173000	18.8	8.15	7.88
9-17-2006	183000	18.8	8.13	7.57
9-17-2006	193000	18.83	8.13	7.52
9-17-2006	203000	18.75	8.13	7.5
9-17-2006	213000	18.76	8.13	7.53
9-17-2006	223000	18.68	8.15	7.44
9-17-2006	233000	18.66	8.16	7.42
9-18-2006	3000	18.66	8.17	7.52
9-18-2006	13000	18.66	8.2	7.52
9-18-2006	23000	18.59	8.21	7.56
9-18-2006	33000	18.56	8.2	7.58

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
9-18-2006	43000	18.61	8.21	7.58
9-18-2006	53000	18.49	8.21	7.49
9-18-2006	63000	18.44	8.21	7.24
9-18-2006	73000	18.4	8.2	7.43
9-18-2006	83000	18.39	8.19	7.38
9-18-2006	93000	18.11	8.17	7.55
9-18-2006	103000	18.08	8.14	7.52
9-18-2006	113000	18.1	8.14	7.45
9-18-2006	123000	18.13	8.14	7.55
9-18-2006	133000	18.22	8.16	7.69
9-18-2006	143000	18.13	8.17	7.89
9-18-2006	153000	18.08	8.17	7.84
9-18-2006	163000	17.96	8.18	7.86
9-18-2006	173000	17.77	8.18	7.85
9-18-2006	183000	17.65	8.19	7.92
9-18-2006	193000	17.85	8.2	7.58
9-18-2006	203000	17.7	8.22	7.58
9-18-2006	213000	17.57	8.23	7.6
9-18-2006	223000	17.43	8.24	7.66
9-18-2006	233000	17.45	8.26	7.64
9-19-2006	3000	17.38	8.26	7.82
9-19-2006	13000	17.35	8.27	7.62
9-19-2006	23000	17.3	8.21	7.75
9-19-2006	33000	17.2	8.27	7.88
9-19-2006	43000	17.23	8.27	7.8
9-19-2006	53000	17.15	8.27	7.88
9-19-2006	63000	16.93	8.26	7.97
9-19-2006	73000	16.89	8.24	7.91
9-19-2006	83000	17.08	8.21	8.01
9-19-2006	93000	16.86	8.17	7.81
9-19-2006	103000	16.82	8.15	7.65
9-19-2006	113000	16.81	8.13	7.75
9-19-2006	123000	16.76	8.13	7.8
9-19-2006	133000	16.79	8.13	7.81
9-19-2006	143000	16.77	8.15	7.97
9-19-2006	153000	16.79	8.17	8.06
9-19-2006	163000	16.88	8.2	8.16
9-19-2006	173000	16.74	8.22	8.29
9-19-2006	183000	16.67	8.24	8.38
9-19-2006	193000	16.81	8.25	8.19
9-19-2006	203000	16.45	8.27	8.31
9-19-2006	213000	16.42	8.29	8.24
9-19-2006	223000	16.34	8.3	8.35
9-19-2006	233000	16.3	8.3	8.31
9-20-2006	3000	16.24	8.31	8.26
9-20-2006	13000	16.24	8.31	8.41
9-20-2006	23000	16.24	8.32	8.35
9-20-2006	33000	16.15	8.32	8.16
9-20-2006	43000	16.13	8.32	8.26
9-20-2006	53000	16.13	8.32	8.32
9-20-2006	63000	15.98	8.3	8.28
9-20-2006	73000	15.97	8.28	8.19
9-20-2006	83000	15.95	8.26	7.95
9-20-2006	93000	16	8.23	7.97
9-20-2006	103000	16.03	8.21	7.91
9-20-2006	113000	16.02	8.2	8.11
9-20-2006	123000	16.05	8.19	8.07

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
9-20-2006	133000	16.12	8.19	8.16
9-20-2006	143000	16.2	8.19	7.9
9-20-2006	153000	16.1	8.16	8.2
9-20-2006	163000	16.18	8.19	8.01
9-20-2006	173000	16.2	8.2	8.12
9-20-2006	183000	16.27	8.21	8.04
9-20-2006	193000	16.29	8.22	8.08
9-20-2006	203000	16.17	8.24	8.04
9-20-2006	213000	16.08	8.25	8.05
9-20-2006	223000	16.15	8.27	7.99
9-20-2006	233000	16.13	8.27	8.05
9-21-2006	3000	16.08	8.26	8.19
9-21-2006	13000	16.02	8.28	8.16
9-21-2006	23000	16.05	8.28	7.97
9-21-2006	33000	16.03	8.3	8.01
9-21-2006	43000	15.98	8.31	8.08
9-21-2006	53000	15.95	8.32	8.15
9-21-2006	63000	15.93	8.31	8.06
9-21-2006	73000	16.02	8.31	8.03
9-21-2006	83000	16.15	8.3	7.85
9-21-2006	93000	16.05	8.28	7.99
9-21-2006	103000	16.12	8.26	7.89
9-21-2006	113000	16.2	8.24	7.91
9-21-2006	123000	16.27	8.24	8.21
9-21-2006	133000	16.42	8.24	8.26
9-21-2006	143000	16.5	8.26	8.31
9-21-2006	153000	16.81	8.26	8.37
9-21-2006	163000	16.76	8.27	8.37
9-21-2006	173000	16.81	8.28	8.4
9-21-2006	183000	16.88	8.29	8.39
9-21-2006	193000	16.76	8.29	8.32
9-21-2006	203000	16.57	8.28	8.35
9-21-2006	213000	16.52	8.28	8.34
9-21-2006	223000	16.45	8.27	8.26
9-21-2006	233000	16.47	8.28	8.25
9-22-2006	3000	16.54	8.28	8.28
9-22-2006	13000	16.52	8.3	8.31
9-22-2006	23000	16.59	8.31	8.31
9-22-2006	33000	16.67	8.32	8.26
9-22-2006	43000	16.67	8.33	8.21
9-22-2006	53000	16.74	8.34	8.25
9-22-2006	63000	16.74	8.35	8.22
9-22-2006	73000	16.79	8.35	8.38
9-22-2006	83000	16.82	8.34	8.43
9-22-2006	93000	16.82	8.3	8.37
9-22-2006	103000	16.81	8.27	8.34
9-22-2006	113000	16.66	8.26	8.34
9-22-2006	123000	16.82	8.24	8.35
9-22-2006	133000	16.5	8.22	8.19
9-22-2006	143000	16.5	8.2	8.2
9-22-2006	153000	16.37	8.17	8.08
9-22-2006	163000	16.22	8.14	8.04
9-22-2006	173000	16.15	8.12	7.94
9-22-2006	183000	16.07	8.1	7.87
9-22-2006	193000	16.02	8.09	7.76
9-22-2006	203000	15.97	8.08	7.75
9-22-2006	213000	16	8.08	7.75

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)	Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
9-22-2006	223000	16	8.09	7.81	9-25-2006	73000	15.55	8.27	8.41
9-22-2006	233000	16	8.09	7.67	9-25-2006	83000	15.58	8.24	8.32
9-23-2006	3000	16.05	8.1	7.71	9-25-2006	93000	15.43	8.19	8.08
9-23-2006	13000	16.05	8.1	7.77	9-25-2006	103000	15.3	8.16	8.01
9-23-2006	23000	16	8.11	7.72	9-25-2006	113000	15.28	8.15	8.1
9-23-2006	33000	16.03	8.11	7.73	9-25-2006	123000	15.31	8.15	8
9-23-2006	43000	16.02	8.1	7.67	9-25-2006	133000	15.35	8.17	8.14
9-23-2006	53000	16.02	8.1	7.68	9-25-2006	143000	15.41	8.2	8.25
9-23-2006	63000	15.98	8.09	7.67	9-25-2006	153000	15.51	8.22	8.36
9-23-2006	73000	15.97	8.07	7.67	9-25-2006	163000	15.62	8.25	8.38
9-23-2006	83000	15.95	8.06	7.53	9-25-2006	173000	15.72	8.28	8.47
9-23-2006	93000	15.92	8.04	7.53	9-25-2006	183000	15.67	8.29	8.51
9-23-2006	103000	16.03	8.04	7.52	9-25-2006	193000	15.6	8.32	8.59
9-23-2006	113000	16	8.03	7.46	9-25-2006	203000	15.55	8.33	8.8
9-23-2006	123000	16.17	8.03	7.55	9-25-2006	213000	15.67	8.34	8.64
9-23-2006	133000	16.25	8.05	7.52	9-25-2006	223000	15.67	8.35	8.58
9-23-2006	143000	16.37	8.07	7.61	9-25-2006	233000	15.68	8.35	8.61
9-23-2006	153000	16.49	8.09	7.61	9-26-2006	3000	15.67	8.35	8.54
9-23-2006	163000	16.55	8.11	7.7	9-26-2006	13000	15.62	8.36	8.65
9-23-2006	173000	16.57	8.12	7.79	9-26-2006	23000	15.62	8.36	8.59
9-23-2006	183000	16.57	8.14	7.65	9-26-2006	33000	15.58	8.34	8.62
9-23-2006	193000	16.55	8.14	7.69	9-26-2006	43000	15.5	8.33	8.57
9-23-2006	203000	16.54	8.13	7.7	9-26-2006	53000	15.43	8.32	8.58
9-23-2006	213000	16.45	8.13	7.68	9-26-2006	63000	15.38	8.3	8.55
9-23-2006	223000	16.42	8.13	7.75	9-26-2006	73000	15.08	8.27	8.66
9-23-2006	233000	16.44	8.16	7.82	9-26-2006	83000	15.06	8.24	8.54
9-24-2006	3000	16.37	8.2	7.96	9-26-2006	93000	14.88	8.19	8.46
9-24-2006	13000	16.37	8.22	8.07	9-26-2006	103000	14.85	8.17	8.49
9-24-2006	23000	16.24	8.23	8.1	9-26-2006	113000	14.86	8.15	8.38
9-24-2006	33000	16.15	8.23	8.07	9-26-2006	123000	14.86	8.15	8.41
9-24-2006	43000	15.95	8.2	8.14	9-26-2006	133000	14.93	8.16	8.41
9-24-2006	53000	15.63	8.22	8.54	9-26-2006	143000	15.01	8.17	8.41
9-24-2006	63000	15.46	8.11	7.94	9-26-2006	153000	15.06	8.19	8.63
9-24-2006	73000	15.31	8.06	7.78	9-26-2006	163000	15.11	8.21	8.63
9-24-2006	83000	15.18	8.06	7.81	9-26-2006	173000	15.16	8.23	8.65
9-24-2006	93000	15.13	8.06	7.57	9-26-2006	183000	15.16	8.27	8.8
9-24-2006	103000	15.08	8.07	7.71	9-26-2006	193000	15.16	8.29	8.82
9-24-2006	113000	15.13	8.06	7.72	9-26-2006	203000	15.36	8.31	8.79
9-24-2006	123000	15.2	8.11	7.9	9-26-2006	213000	15.4	8.33	8.82
9-24-2006	133000	15.31	8.14	8.12	9-26-2006	223000	15.38	8.33	8.65
9-24-2006	143000	15.5	8.18	8.26	9-26-2006	233000	15.38	8.33	8.77
9-24-2006	153000	15.67	8.21	8.39	9-27-2006	3000	15.5	8.34	8.79
9-24-2006	163000	15.75	8.24	8.44	9-27-2006	13000	15.5	8.34	8.71
9-24-2006	173000	15.87	8.26	8.59	9-27-2006	23000	15.43	8.33	8.72
9-24-2006	183000	15.88	8.3	8.7	9-27-2006	33000	15.53	8.32	8.71
9-24-2006	193000	15.97	8.32	8.7	9-27-2006	43000	15.5	8.31	8.65
9-24-2006	203000	15.97	8.33	8.77	9-27-2006	53000	15.46	8.29	8.55
9-24-2006	213000	15.95	8.33	8.8	9-27-2006	63000	15.38	8.28	8.32
9-24-2006	223000	15.95	8.34	8.76	9-27-2006	73000	15.3	8.25	8.46
9-24-2006	233000	15.9	8.34	8.66	9-27-2006	83000	15.23	8.22	8.45
9-25-2006	3000	15.9	8.34	8.5	9-27-2006	93000	15.13	8.18	8.35
9-25-2006	13000	15.92	8.35	8.66	9-27-2006	103000	15.01	8.16	8.23
9-25-2006	23000	15.9	8.34	8.62	9-27-2006	113000	14.98	8.14	8.21
9-25-2006	33000	15.82	8.35	8.59	9-27-2006	123000	14.98	8.13	8.34
9-25-2006	43000	15.83	8.33	8.32	9-27-2006	133000	14.95	8.14	8.43
9-25-2006	53000	15.73	8.31	8.37	9-27-2006	143000	14.95	8.17	8.43
9-25-2006	63000	15.65	8.29	8.41	9-27-2006	153000	14.95	8.2	8.57

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
9-27-2006	163000	14.91	8.18	8.56
9-27-2006	173000	14.85	8.19	8.71
9-27-2006	183000	14.78	8.2	8.81
9-27-2006	193000	14.71	8.21	8.91
9-27-2006	203000	14.73	8.21	8.71
9-27-2006	213000	14.78	8.22	8.54
9-27-2006	223000	14.76	8.23	8.57
9-27-2006	233000	14.71	8.23	8.53
9-28-2006	3000	14.7	8.23	8.64
9-28-2006	13000	14.63	8.23	8.51
9-28-2006	23000	14.57	8.23	8.63
9-28-2006	33000	14.45	8.22	8.68
9-28-2006	43000	14.47	8.22	8.7
9-28-2006	53000	14.35	8.2	8.66
9-28-2006	63000	14.27	8.19	8.64
9-28-2006	73000	14.17	8.17	8.61
9-28-2006	83000	14.03	8.15	8.57
9-28-2006	93000	13.97	8.14	8.43
9-28-2006	103000	13.9	8.13	8.4
9-28-2006	113000	13.89	8.13	8.54
9-28-2006	123000	13.93	8.14	8.65
9-28-2006	133000	14.08	8.16	8.64
9-28-2006	143000	14.07	8.17	8.75
9-28-2006	153000	14.08	8.18	8.83
9-28-2006	163000	14.18	8.2	8.88
9-28-2006	173000	14.33	8.22	8.94
9-28-2006	183000	14.32	8.24	9
9-28-2006	193000	14.37	8.26	9.1
9-28-2006	203000	14.2	8.27	9.11
9-28-2006	213000	14.25	8.28	9.19
9-28-2006	223000	14.28	8.28	9.21
9-28-2006	233000	14.32	8.29	9.1
9-29-2006	3000	14.45	8.29	9.1
9-29-2006	13000	14.4	8.28	9.12
9-29-2006	23000	14.42	8.28	9.06
9-29-2006	33000	14.42	8.28	9.05
9-29-2006	43000	14.42	8.28	9.08
9-29-2006	53000	14.33	8.27	8.96
9-29-2006	63000	14.35	8.26	8.86
9-29-2006	73000	14.3	8.23	8.87
9-29-2006	83000	14.17	8.22	8.83
9-29-2006	93000	14.03	8.2	8.68
9-29-2006	103000	13.93	8.17	8.59
9-29-2006	113000	13.87	8.16	8.71
9-29-2006	123000	13.84	8.16	8.63
9-29-2006	133000	13.77	8.15	8.66
9-29-2006	143000	13.75	8.15	8.76
9-29-2006	153000	13.72	8.17	8.76
9-29-2006	163000	13.65	8.17	8.81
9-29-2006	173000	13.6	8.18	8.9
9-29-2006	183000	13.59	8.18	8.88
9-29-2006	193000	13.62	8.2	8.94
9-29-2006	203000	13.62	8.21	8.88
9-29-2006	213000	13.65	8.22	8.9
9-29-2006	223000	13.72	8.24	8.96
9-29-2006	233000	13.82	8.24	8.93
9-30-2006	3000	13.84	8.26	8.95

Date	Time	Temp (°C)	pH (s.u.)	DO (mg/L)
9-30-2006	13000	13.85	8.26	8.96
9-30-2006	23000	13.84	8.26	9.06
9-30-2006	33000	13.84	8.25	8.93
9-30-2006	43000	13.79	8.23	8.96
9-30-2006	53000	13.75	8.2	8.91
9-30-2006	63000	13.7	8.18	8.7
9-30-2006	73000	13.75	8.15	8.11
9-30-2006	83000	13.55	8.28	9.78
9-30-2006	93000	13.54	8.27	9.68
9-30-2006	103000	13.59	8.13	8.51
9-30-2006	113000	13.59	8.12	8.47
9-30-2006	123000	13.69	8.13	8.47
9-30-2006	133000	13.75	8.14	8.63
9-30-2006	143000	13.89	8.16	8.57
9-30-2006	153000	14	8.17	8.76
9-30-2006	163000	14.08	8.19	8.74
9-30-2006	173000	14.12	8.2	8.83
9-30-2006	183000	14.15	8.21	8.78
9-30-2006	193000	14.1	8.22	8.74
9-30-2006	203000	14.07	8.22	8.87
9-30-2006	213000	14.03	8.22	8.75
9-30-2006	223000	14.02	8.23	8.74
9-30-2006	233000	14.02	8.24	8.76